



Job	Truss	Truss Type	Qty	Ply	LOT 157 CROSSING @ ANDERSON CREEK   357 TIMBER SKIP DRIVE SP
22-2670-R01	J01	Jack-Open	2	1	Job Reference (optional)

Atlantic Building Components, Moncks Corner, South Carolina

8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Apr 15 12:23:16 2022 Page 1  
 ID:te?\_8ytH1N5AHCxjPc0A\_rzRBdO-1mmXxPtXWS7Y27xvVl24OrNm6OxnyjlzBPd0JzQUY9



Scale = 1:10.4

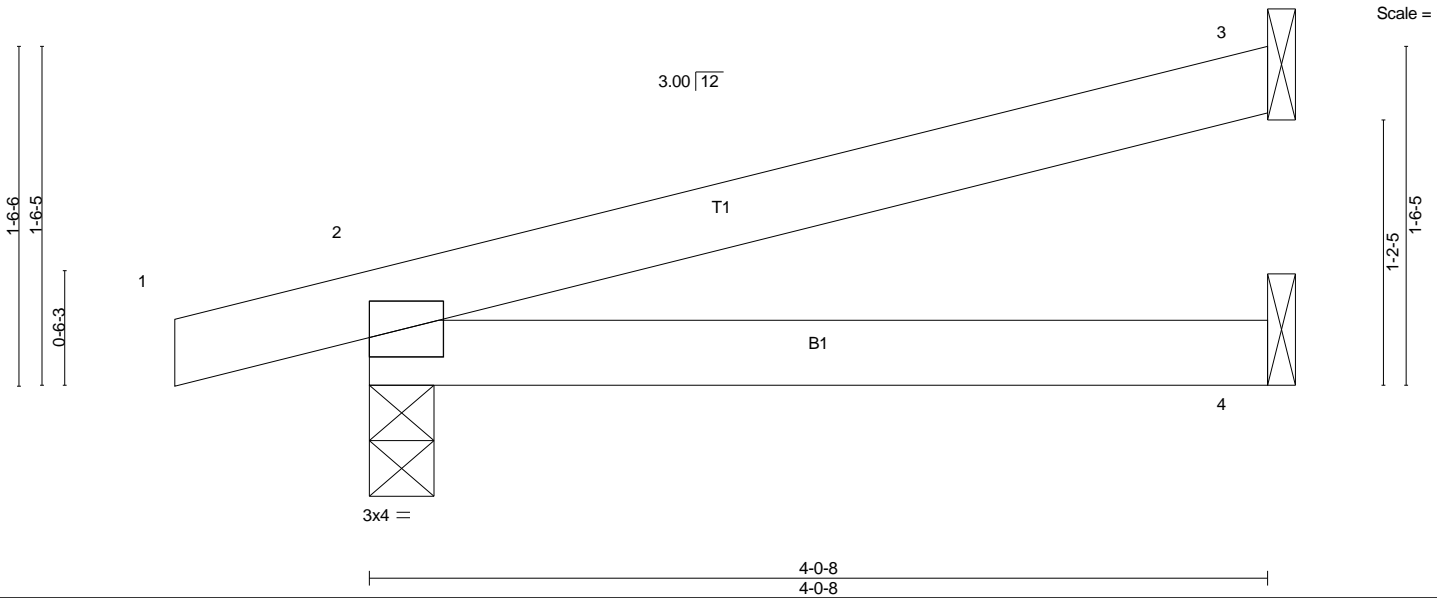

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.33	Vert(LL)	-0.01 2-4	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.18	Vert(CT)	-0.03 2-4	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.00 3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P						
								Weight: 14 lb	FT = 0%

**LUMBER-**

TOP CHORD 2x4 SP No.2  
 BOT CHORD 2x4 SP No.2

**BRACING-**

TOP CHORD

Structural wood sheathing directly applied or 4-0-8 oc purlins.

BOT CHORD

Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** (lb/size)

3	=	107/Mechanical
2	=	223/0-3-8 (min. 0-1-8)
4	=	38/Mechanical
Max Horz		
2	=	43(LC 10)
Max Uplift		
3	=	-54(LC 14)
2	=	-67(LC 10)
Max Grav		
3	=	149(LC 21)
2	=	295(LC 21)
4	=	77(LC 7)

**FORCES.** (lb)

Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-** (10-11)

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=5.0psf; BCDL=5.0psf; h=23ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10

3) Unbalanced snow loads have been considered for this design.

4) This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.

5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

6) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 1-0-0 wide will fit between the bottom chord and any other members.

7) Refer to girder(s) for truss to truss connections.

8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 54 lb uplift at joint 3 and 67 lb uplift at joint 2.

9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

10) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.

11) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

**LOAD CASE(S)**

Standard

Job 22-2670-R01	Truss PB01	Truss Type Piggyback	Qty 2	Ply 1	LOT 157 CROSSING @ ANDERSON CREEK   357 TIMBER SKIP DRIVE SP
Atlantic Building Components, Moncks Corner, South Carolina					Job Reference (optional)

8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Apr 15 12:23:19 2022 Page 1  
 ID:te?\_8ytH1N5AHCxjPc0A\_rzRBdO-RLSgZRvQpNV7vagUAubn0U?L?bzG941Q?9eHdezQUY6

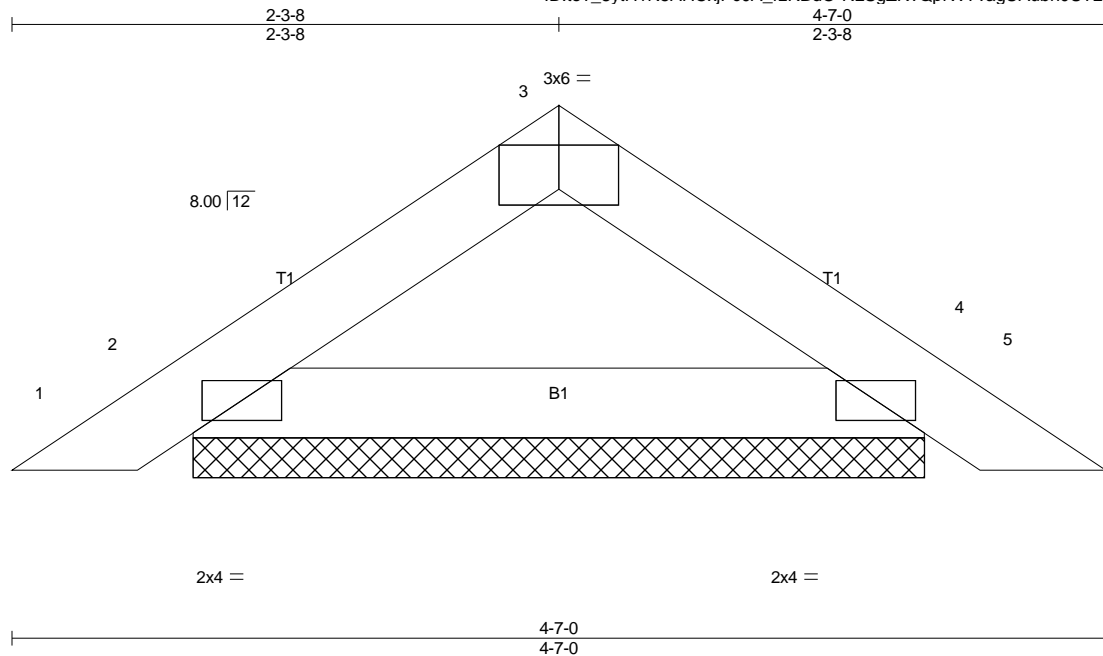


Plate Offsets (X,Y)-- [3:0-3-0,Edge]									
<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in (loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 20.0	Plate Grip DOL	1.15	TC 0.03	Vert(LL)	0.00 4	n/r	180	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.19	Vert(CT)	0.00 4	n/r	80		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00 4	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P					Weight: 13 lb	FT = 0%

**LUMBER-**  
 TOP CHORD 2x4 SP No.2  
 BOT CHORD 2x4 SP No.3

**BRACING-**  
 TOP CHORD  
 Structural wood sheathing directly applied or 4-7-0 oc purlins.  
 BOT CHORD  
 Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** (lb/size)

2 =	152/3-0-12 (min. 0-1-8)
4 =	152/3-0-12 (min. 0-1-8)
Max Horz	
2 =	-31(LC 10)
Max Uplift	
2 =	-27(LC 12)
4 =	-27(LC 13)

**FORCES.** (lb)  
 Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-** (11-12)

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=5.0psf; BCDL=5.0psf; h=23ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10

- This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 1-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 27 lb uplift at joint 2 and 27 lb uplift at joint 4.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.
- Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
- Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

**LOAD CASE(S)**  
 Standard

Job	Truss	Truss Type	Qty	Ply	LOT 157 CROSSING @ ANDERSON CREEK   357 TIMBER SKIP DRIVE SP
22-2670-R01	PB02	Piggyback	17	1	Job Reference (optional)

Atlantic Building Components, Moncks Corner, South Carolina

ID:te?\_8ytH1N5AHCxjPc0A\_rzRBdO-K7hAPoywtc?ZOCzGPjgAKA1?CKC5u1?vncVmPzQUY2

8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Apr 15 12:23:23 2022 Page 1

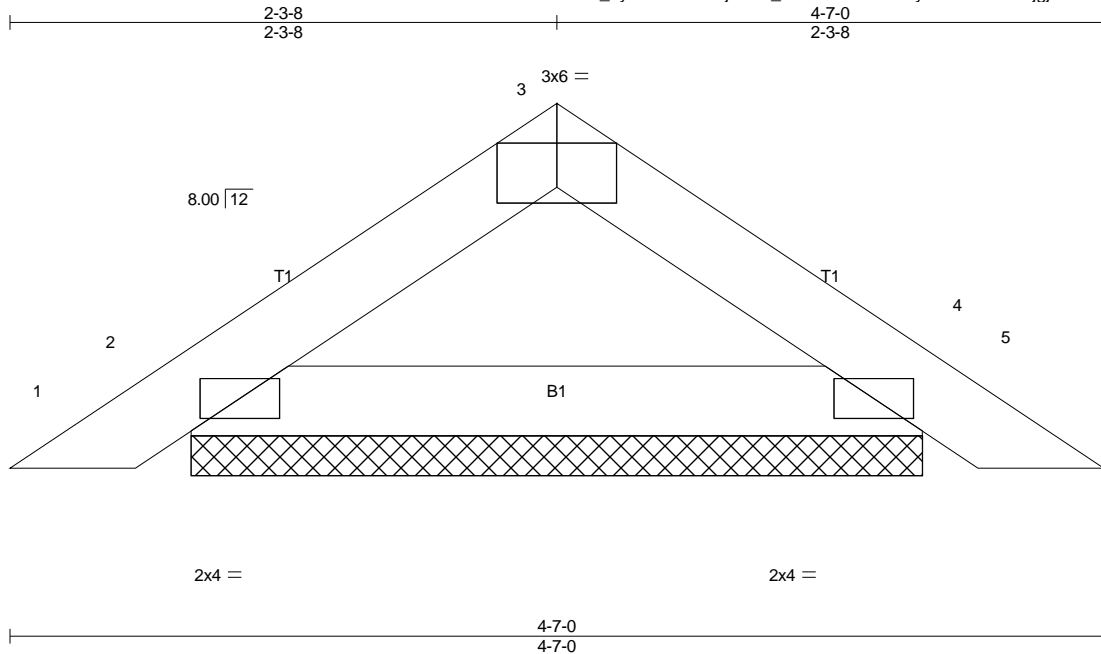


Plate Offsets (X,Y)-- [3:0-3-0,Edge]		4-7-0		4-7-0		4-7-0		4-7-0	
<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in (loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 20.0	Plate Grip DOL	1.15	TC 0.03	Vert(LL)	0.00	4	n/r	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.19	Vert(CT)	0.00	4	n/r		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	4	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P						
								Weight: 13 lb	FT = 0%

**LUMBER-**

TOP CHORD 2x4 SP No.2

BOT CHORD 2x4 SP No.3

**BRACING-**

TOP CHORD

Structural wood sheathing directly applied or 4-7-0 oc purlins.

BOT CHORD

Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** (lb/size)

2 = 152/3-0-12 (min. 0-1-8)

4 = 152/3-0-12 (min. 0-1-8)

Max Horz

2 = -31(LC 10)

Max Uplift

2 = -27(LC 12)

4 = -27(LC 13)

**FORCES.** (lb)

Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-** (11-12)

1) Unbalanced roof live loads have been considered for this design.

2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=5.0psf; BCDL=5.0psf; h=23ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60

3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10

4) This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.

5) Gable requires continuous bottom chord bearing.

6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

7) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 1-0-0 wide will fit between the bottom chord and any other members.

8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 27 lb uplift at joint 2 and 27 lb uplift at joint 4.

9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

10) See Standard Industry Piggyback Truss

Connection Detail for Connection to base truss as

applicable, or consult qualified building designer.

11) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.

12) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.


**LOAD CASE(S)**

Standard

Atlantic Building Components, Moncks Corner, South Carolina

8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Apr 15 12:23:28 2022 Page 1

ID:te?\_8ytH1N5AHCxjPc0A\_rzRBdO-h4V3SW03h8erUzsDCHFutNtryD1im8Tk33JGRczQUXZ

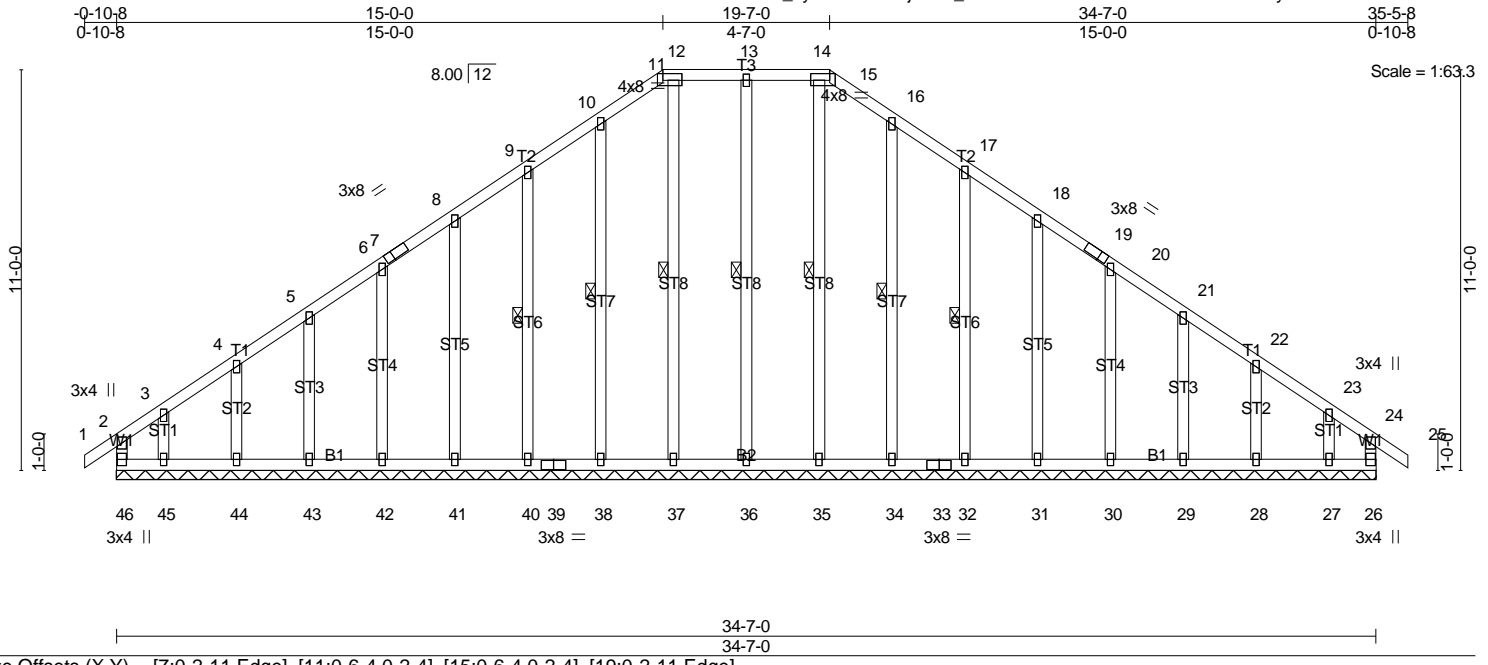

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.21	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.17	Vert(LL) -0.00 25 n/r 180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.12	Horz(CT) 0.01 26 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-R			
Weight: 274 lb FT = 0%					

**LUMBER-**

TOP CHORD 2x4 SP No.2  
 BOT CHORD 2x4 SP No.3  
 WEBS 2x4 SP No.3  
 OTHERS 2x4 SP No.3

**BRACING-**

TOP CHORD  
 Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
 BOT CHORD  
 Rigid ceiling directly applied or 6-0-0 oc bracing.  
 WEBS  
 1 Row at midpt  
 13-36, 12-37, 10-38, 9-40, 14-35, 16-34, 17-32

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.**

All bearings 34-7-0.  
 (lb) - Max Horz  
 46=-269(LC 10)  
 Max Uplift  
 All uplift 100 lb or less at joint(s)  
 36, 38, 40, 41, 42, 43, 44, 34, 32, 31,  
 30, 29, 28 except 46=-175(LC 8),  
 26=-101(LC 9), 45=-180(LC 12),  
 27=-155(LC 13)  
 Max Grav  
 All reactions 250 lb or less at joint(s)  
 46, 26, 36, 43, 44, 45, 29, 28, 27  
 except 37=283(LC 23), 38=261(LC 20),  
 40=258(LC 20), 41=256(LC 20),  
 42=264(LC 20), 35=270(LC 23),  
 34=257(LC 21), 32=260(LC 21),  
 31=256(LC 21), 30=264(LC 21)

**FORCES.**

(lb)  
 Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD  
 10-11=-184/268, 15-16=-184/260

TOP CHORD  
 10-11=-184/268, 15-16=-184/260

**NOTES-**

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=5.0psf; BCDL=5.0psf; h=23ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- Provide adequate drainage to prevent water ponding.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

12) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 1-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.

13) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 36, 38, 40, 41, 42, 43, 44, 34, 32, 31, 30, 29, 28 except (jt=lb) 46=175, 26=101, 45=180, 27=155.

14) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

15) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.


16) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

**LOAD CASE(S)**

Standard

Atlantic Building Components, Moncks Corner, South Carolina

8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Apr 15 12:23:32 2022 Page 1  
 ID:te?\_8yTH1N5AHCxjPc0A\_rzRBdO-ZrkaHt3alN8HzaA\_R6Kq1D2PZrCiin8K\_hHTaOzQUXv

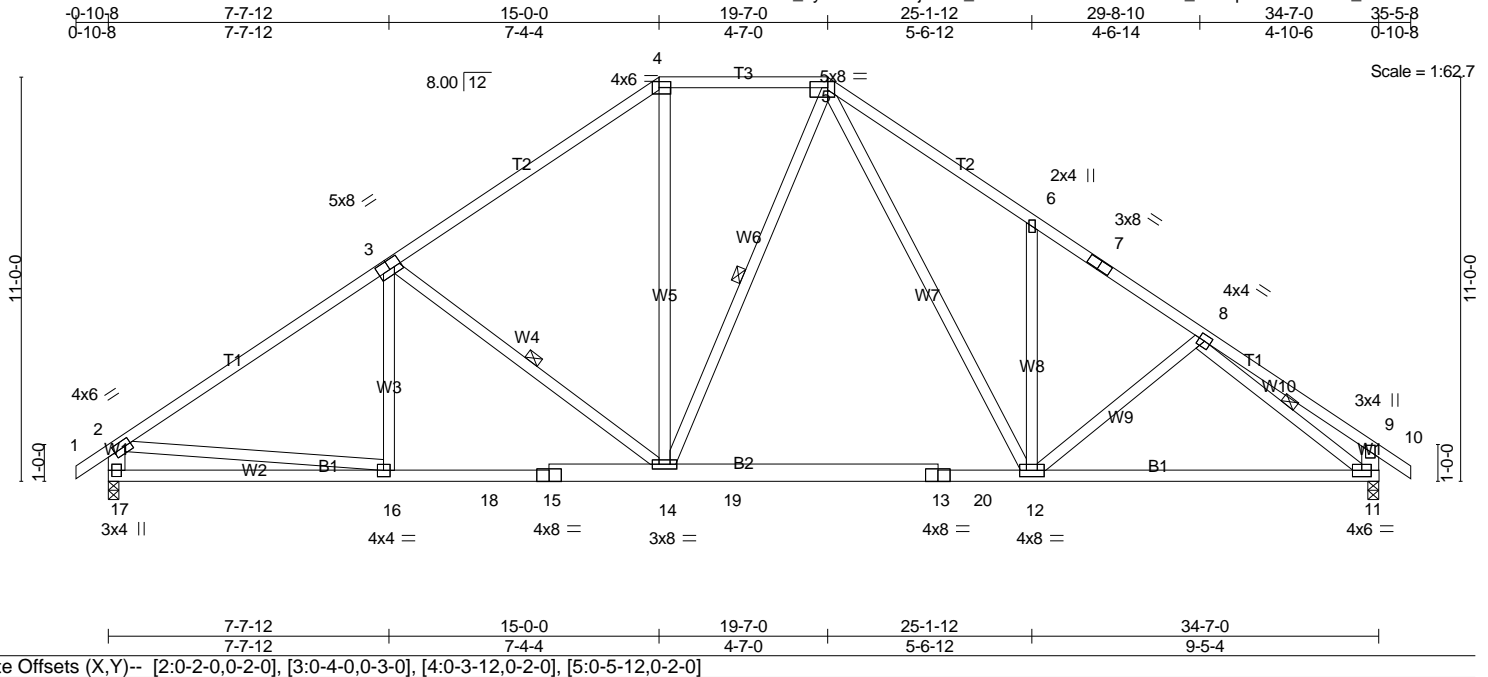

LOADING (psf)	SPACING-	CSL	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.75	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 1.00	Vert(LL) -0.28 12-14 >999 240		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.71	Vert(CT) -0.38 12-14 >999 180		
BCDL 10.0	Rep Stress Incr YES	Matrix-SH	Horz(CT) 0.05 11 n/a n/a		
	Code IRC2018/TPI2014			Weight: 236 lb	FT = 0%

**LUMBER-**

TOP CHORD 2x4 SP No.2  
 BOT CHORD 2x4 SP No.2 \*Except\*  
 B2: 2x6 SP No.2  
 WEBS 2x4 SP No.3 \*Except\*  
 W1: 2x6 SP No.2

**BRACING-**

TOP CHORD  
 Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals.  
 BOT CHORD  
 Rigid ceiling directly applied or 10-0-0 oc bracing, Except:  
 2-2-0 oc bracing: 12-14.  
 WEBS  
 1 Row at midpt  
 3-14, 5-14, 8-11

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** (lb/size)

17 = 1431/0-3-8 (min. 0-1-12)  
 11 = 1431/0-3-8 (min. 0-1-12)  
 Max Horz  
 17 = 271(LC 11)  
 Max Uplift  
 17 = -182(LC 12)  
 11 = -182(LC 13)  
 Max Grav  
 17 = 1476(LC 20)  
 11 = 1460(LC 21)

**FORCES.** (lb)

Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD  
 2-3=-1918/223, 3-4=-1553/223,  
 4-5=-1204/247, 5-6=-1853/393,  
 6-7=-1680/230, 7-8=-1797/216,  
 8-9=-397/119, 2-17=-1400/217,

**TOP CHORD**

2-3=-1918/223, 3-4=-1553/223,  
 4-5=-1204/247, 5-6=-1853/393,  
 6-7=-1680/230, 7-8=-1797/216,  
 8-9=-397/119, 2-17=-1400/217,  
 9-11=-395/141  
**BOT CHORD**  
 16-17=-283/563, 16-18=-211/1665,  
 15-18=-211/1665, 14-15=-211/1668,  
 14-19=0/1169, 13-19=0/1166,  
 13-20=0/1166, 12-20=0/1166,  
 11-12=-119/1429  
**WEBS**  
 3-14=-507/238, 4-14=-58/556,  
 5-14=-100/267, 5-12=-255/799,  
 6-12=-369/238, 2-16=0/1196,  
 8-11=-1583/127

**NOTES-** (10-11)

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=5.0psf; BCDL=5.0psf; h=23ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- 4) This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- 5) Provide adequate drainage to prevent water ponding.


- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 1-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 17=182, 11=182.
- 9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 10) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
- 11) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

**LOAD CASE(S)**

Standard

Job 22-2670-R01	Truss R02A	Truss Type PIGGYBACK BASE	Qty 1	Ply 1	LOT 157 CROSSING @ ANDERSON CREEK   357 TIMBER SKIP DRIVE SP
Atlantic Building Components, Moncks Corner, South Carolina					Job Reference (optional)

8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Apr 15 12:23:36 2022 Page 1  
 ID:te?\_8ytH1N5AHCxjPc0A\_rzRBdO-Sd\_57F64pcejSBTlgyPmC3C3aSZ0eeHwvIFh9zQUXr

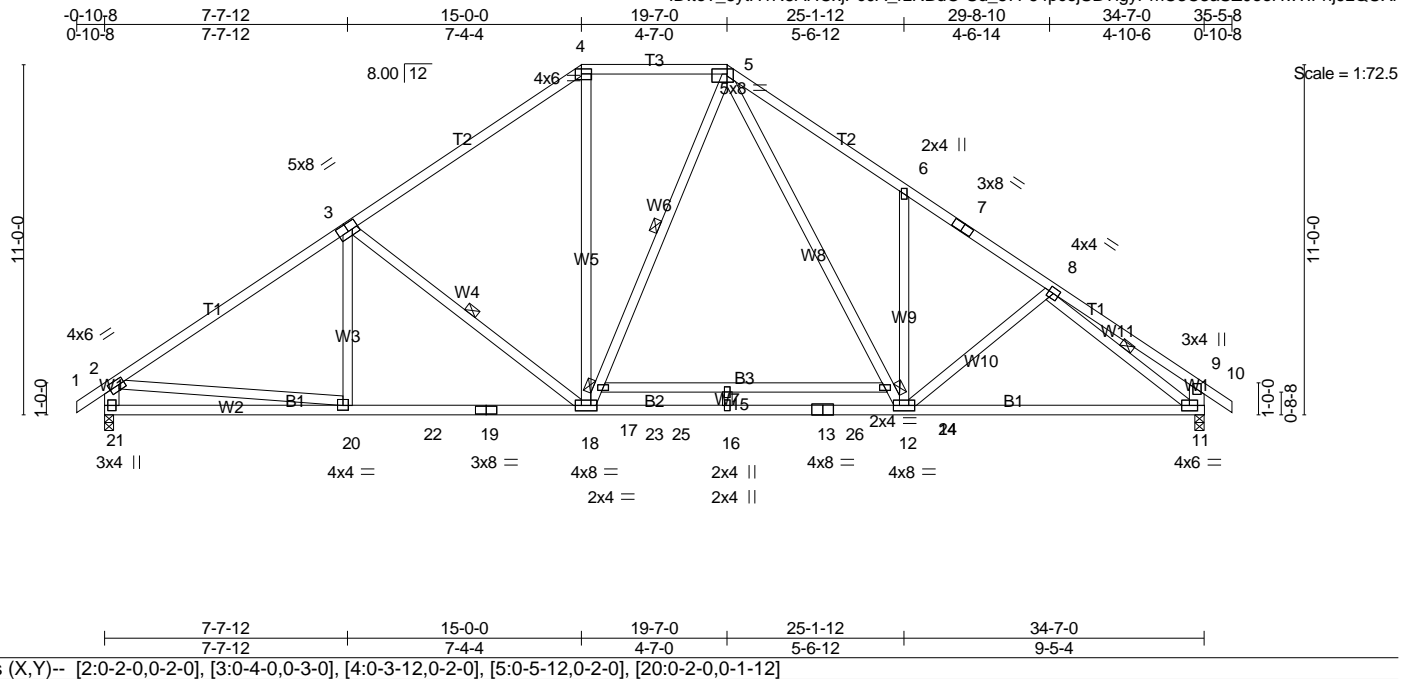

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.81	Vert(LL)	-0.67 12-16	>610	240	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.97	Vert(CT)	-0.95 12-16	>430	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.57	Horz(CT)	0.06 11	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-SH					Weight: 241 lb	FT = 0%

**LUMBER-**  
 TOP CHORD 2x4 SP No.2  
 BOT CHORD 2x4 SP No.1 \*Except\*  
 B2,B3: 2x4 SP SS  
 WEBS 2x4 SP No.3 \*Except\*  
 W1: 2x6 SP No.2

**BRACING-**  
 TOP CHORD  
 Structural wood sheathing directly applied, except end verticals.  
 BOT CHORD  
 Rigid ceiling directly applied or 10-0-0 oc bracing,  
 Except:  
 2-2-0 oc bracing: 12-16.  
 6-0-0 oc bracing: 14-17  
 WEBS  
 1 Row at midpt  
 5-17, 3-18, 8-11

TOP CHORD  
 2-3=-2170/166, 3-4=-1828/158,  
 4-5=-1434/192, 5-6=-2241/304,  
 6-7=-2067/141, 7-8=-2184/117,  
 8-9=-393/122, 2-21=-1562/180,  
 9-11=-394/142  
 BOT CHORD  
 20-21=-279/583, 20-22=-164/1874,  
 19-22=-164/1874, 18-19=-164/1874,  
 18-23=0/1415, 16-23=0/1415,  
 13-16=0/1415, 13-24=0/1415,  
 12-24=0/1415, 11-12=-54/1710  
 WEBS  
 5-17=-94/289, 3-18=-485/248,  
 4-18=-22/708, 5-14=-206/1015,  
 12-14=-246/857, 6-12=-371/237,  
 2-20=0/1386, 8-11=-1975/38

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** (lb/size)

21	=	1508/0-3-8 (min. 0-1-15)
11	=	1538/0-3-8 (min. 0-2-0)
Max Horz		
21	=	271(LC 11)
Max Uplift		
21	=	-144(LC 12)
11	=	-129(LC 13)
Max Grav		
21	=	1641(LC 20)
11	=	1689(LC 21)

**FORCES.** (lb)  
 Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD  
 2-3=-2170/166, 3-4=-1828/158,  
 4-5=-1434/192, 5-6=-2241/304,  
 6-7=-2067/141, 7-8=-2184/117,

**NOTES-** (10-11)  
 1) Unbalanced roof live loads have been considered for this design.  
 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=5.0psf; BCDL=5.0psf; h=23ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60  
 3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10  
 4) This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.  
 5) Provide adequate drainage to prevent water ponding.


6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.  
 7) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 1-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.  
 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 21=144, 11=129.  
 9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.  
 10) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.  
 11) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

**LOAD CASE(S)**  
 Standard

Job	Truss	Truss Type	Qty	Ply	LOT 157 CROSSING @ ANDERSON CREEK   357 TIMBER SKIP DRIVE SP
22-2670-R01	R03	Piggyback Base	4	1	Job Reference (optional)

Atlantic Building Components, Moncks Corner, South Carolina

ID:te?\_8ytH1N5AHCxjPc0A\_rzRBdO-KODczc9bsq88xpnXvoTmVnNme3ziaQNVqwDvswzQUXn

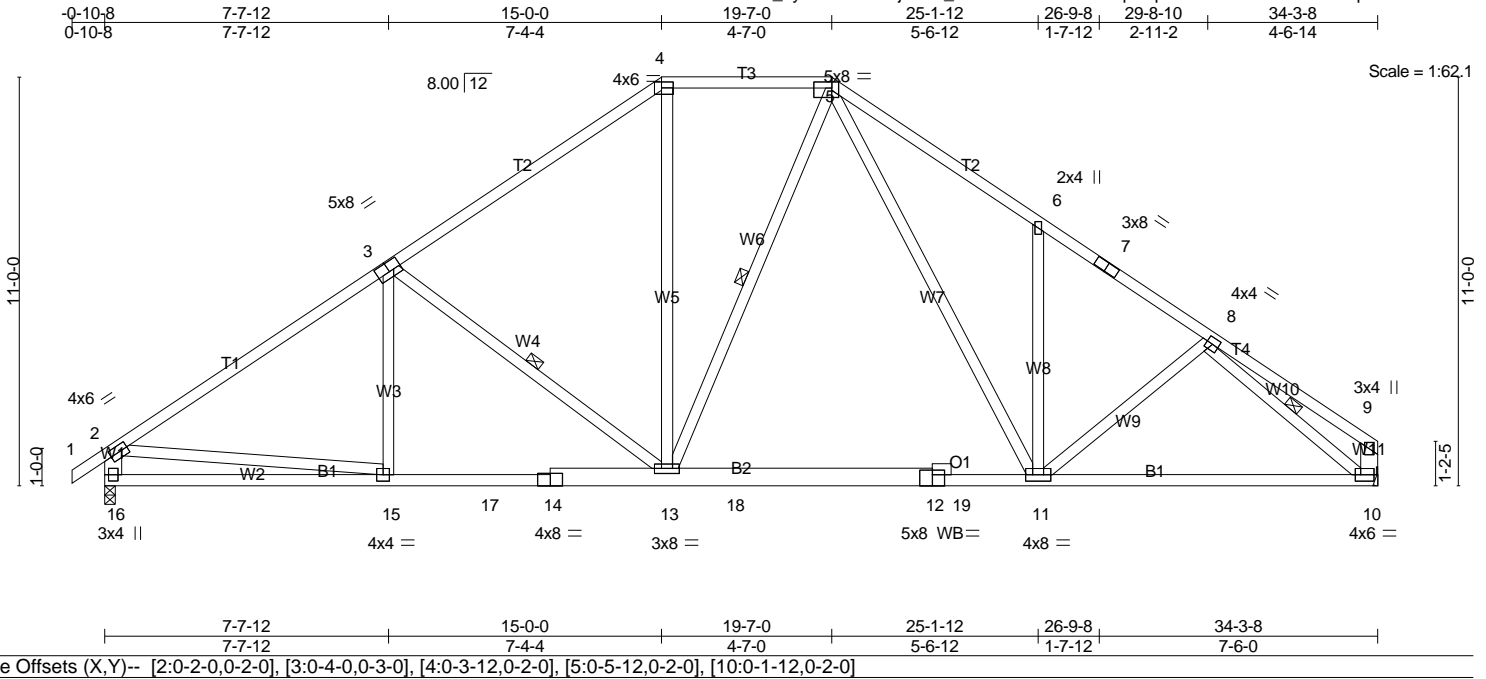

LOADING (psf)	SPACING-	CSL	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.74	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.80	Vert(LL) -0.27 11-13 >999 240		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.70	Vert(CT) -0.38 11-13 >999 180		
BCDL 10.0	Rep Stress Incr YES	Matrix-SH	Horz(CT) 0.05 10 n/a n/a		
	Code IRC2018/TPI2014			Weight: 234 lb	FT = 0%

**LUMBER-**

- TOP CHORD 2x4 SP No.2
- BOT CHORD 2x4 SP No.1 \*Except\*
- WEBS 2x4 SP No.3 \*Except\*
- OTHERS 2x4 SP No.3

**BRACING-**

- TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals.
- BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
- WEBS 1 Row at midpt

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** (lb/size)

- 16 = 1421/0-3-8 (min. 0-1-12)
- 10 = 1352/Mechanical
- Max Horz 16 = 267(LC 9)
- Max Uplift 16 = -182(LC 12)
- 10 = -157(LC 13)
- Max Grav 16 = 1465(LC 20)
- 10 = 1386(LC 21)

**FORCES.** (lb)

- Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
- TOP CHORD 2-3=-1901/222, 3-4=-1536/222, 4-5=-1189/246, 5-6=-1806/387, 6-7=-1635/224, 7-8=-1752/201, 8-9=-262/64, 2-16=-1389/216
- BOT CHORD 15-16=-292/560, 15-17=-222/1642,

**BOT CHORD**

- 15-16=-292/560, 15-17=-222/1642, 14-17=-222/1642, 13-14=-221/1646, 13-18=-7/1142, 12-18=-7/1140, 12-19=-7/1139, 11-19=-7/1139, 10-11=-138/1350
- WEBS 3-13=-507/239, 4-13=-56/546, 5-13=-98/275, 5-11=-249/757, 8-10=-1652/175, 2-15=0/1177, 6-11=-366/237

**NOTES-** (11-12)

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=5.0psf; BCDL=5.0psf; h=23ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 1-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.


- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 16=182, 10=157.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
- Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

**LOAD CASE(S)**

Standard

Job 22-2670-R01	Truss R03A	Truss Type Piggyback Base	Qty 3	Ply 1	LOT 157 CROSSING @ ANDERSON CREEK   357 TIMBER SKIP DRIVE SP
Atlantic Building Components, Moncks Corner, South Carolina					Job Reference (optional)

8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Apr 15 12:23:45 2022 Page 1  
 ID:te?\_8ytH1N5AHCxjPc0A\_rzRBdO-hMOV0KDKhNnR1afUiL3t3z4cS4e3FjcXfX7zQUXI

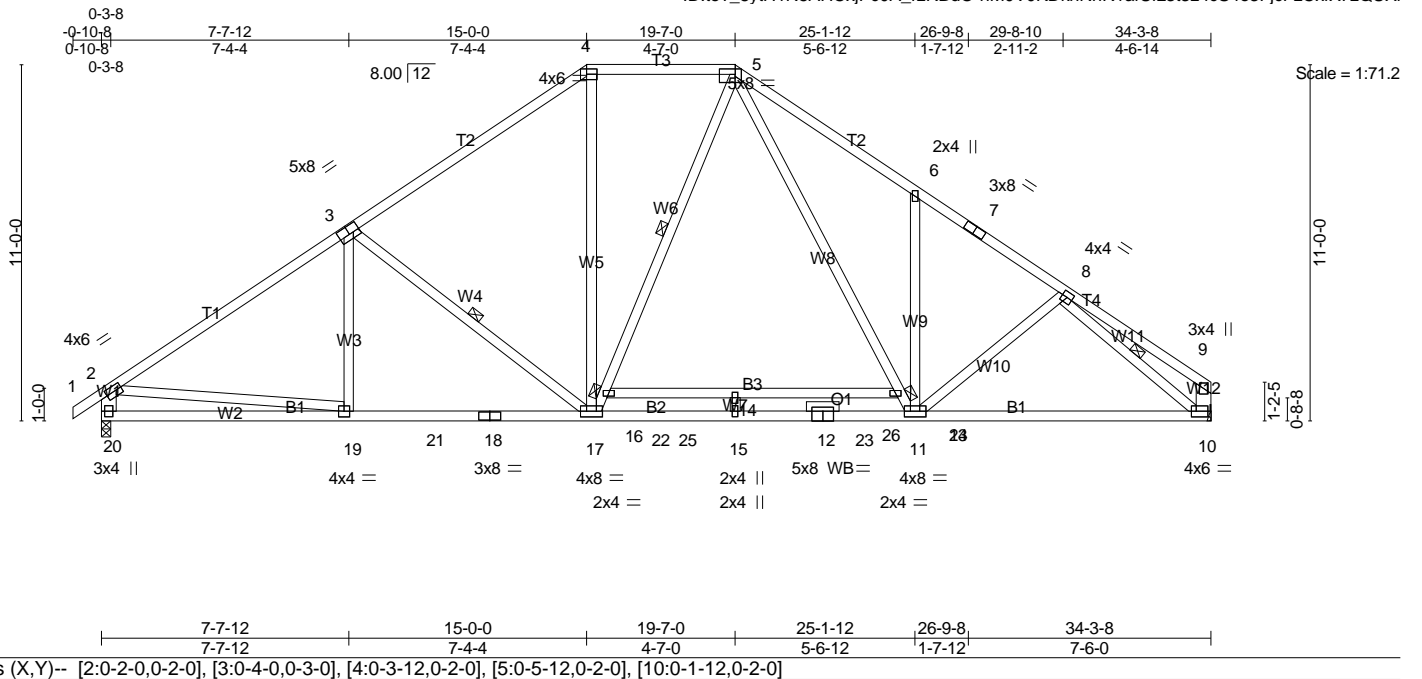

LOADING (psf)	SPACING-	CSL	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.80	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.98	Vert(LL) -0.67 11-15 >606 240		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.57	Vert(CT) -0.95 11-15 >428 180		
BCDL 10.0	Rep Stress Incr YES	Matrix-SH	Horz(CT) 0.06 10 n/a n/a		
	Code IRC2018/TPI2014			Weight: 241 lb	FT = 0%

**LUMBER-**  
 TOP CHORD 2x4 SP No.2  
 BOT CHORD 2x4 SP No.1 \*Except\*  
 WEBS 2x4 SP No.3 \*Except\*  
 OTHERS 2x4 SP No.3

**BRACING-**  
 TOP CHORD  
 Structural wood sheathing directly applied, except end verticals.  
 BOT CHORD  
 Rigid ceiling directly applied or 10-0-0 oc bracing, Except:  
 2-2-0 oc bracing: 11-15.  
 6-0-0 oc bracing: 13-16  
 WEBS  
 1 Row at midpt  
 3-17, 5-16, 8-10

**NOTES-** (11-12)  
 1) Unbalanced roof live loads have been considered for this design.  
 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=5.0psf; BCDL=5.0psf; h=23ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60  
 3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10  
 4) This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.  
 5) Provide adequate drainage to prevent water ponding.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** (lb/size)

20 =	1496/0-3-8 (min. 0-1-15)
10 =	1460/Mechanical
Max Horz	
20 =	267(LC 9)
Max Uplift	
20 =	-144(LC 12)
10 =	-103(LC 13)
Max Grav	
20 =	1629(LC 20)
10 =	1619(LC 25)

**FORCES.** (lb)  
 Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD  
 2-3=-2151/165, 3-4=-1808/157,  
 4-5=-1417/192, 5-6=-2187/299,

6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.  
 7) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 1-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.  
 8) Refer to girder(s) for truss to truss connections.  
 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 20=144, 10=103.  
 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.  
 11) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.  
 12) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

**LOAD CASE(S)**  
 Standard



Job 22-2670-R01	Truss R03B	Truss Type Piggyback Base	Qty 5	Ply 1	LOT 157 CROSSING @ ANDERSON CREEK   357 TIMBER SKIP DRIVE SFF
--------------------	---------------	------------------------------	----------	----------	---

Atlantic Building Components, Moncks Corner, South Carolina

Job Reference (optional)  
8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Apr 15 12:23:50 2022 Page 1

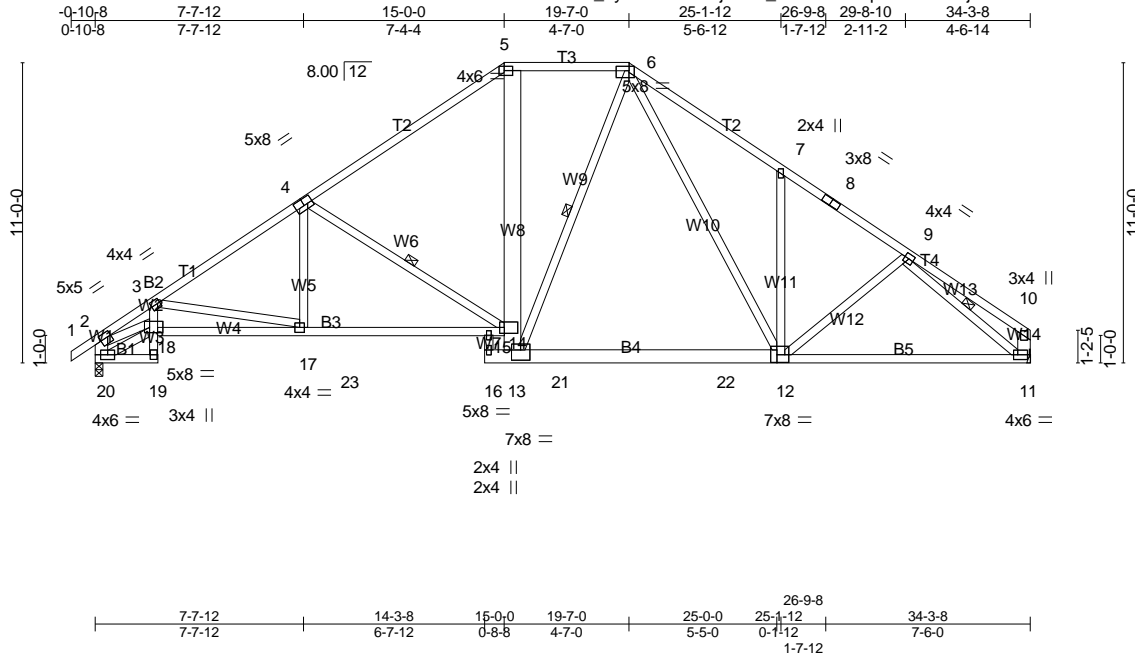


Plate Offsets (X,Y)-- [2:0-1-8,0-2-4], [3:0-1-0,0-2-0], [4:0-4-0,0-3-0], [5:0-3-12,0-2-0], [6:0-5-12,0-2-0], [11:0-1-12,0-2-0], [12:0-2-12,0-3-4], [13:0-4-0,0-4-4], [14:0-2-0,0-2-8], [18:0-5-12,0-2-4]

<b>LOADING</b> (psf)	<b>SPACING-</b>	<b>CSI.</b>	<b>DEFL.</b>	<b>PLATES</b>	<b>GRIP</b>
TCLL 20.0	2-0-0	TC 0.83	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.87	Vert(LL) -0.29 12-13 >999 240		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.84	Vert(CT) -0.43 12-13 >947 180		
BCDL 10.0	Rep Stress Incr YES	Matrix-SH	Horz(CT) 0.20 11 n/a n/a		
	Code IRC2018/TPI2014			Weight: 255 lb	FT = 0%

**LUMBER-**  
TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2 \*Except\*  
B4: 2x6 SP No.2  
WEBS 2x4 SP No.3 \*Except\*  
W8: 2x8 SP No.1, W14,W1: 2x6 SP No.2

**BRACING-**  
TOP CHORD  
Structural wood sheathing directly applied, except end verticals.  
BOT CHORD  
Rigid ceiling directly applied or 10-0-0 oc bracing, Except:  
8-4-10 oc bracing: 17-18.  
WEBS  
1 Row at midpt  
4-14, 6-13, 9-11

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** (lb/size)

11 =	1352/Mechanical
20 =	1421/0-3-8 (min. 0-1-11)
Max Horz	
20 =	267(LC 9)
Max Uplift	
11 =	-157(LC 13)
20 =	-182(LC 12)
Max Grav	
11 =	1371(LC 21)
20 =	1429(LC 20)

**FORCES.** (lb)  
Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD  
2-3=-2686/418, 3-4=-2169/285,  
4-5=-1613/222, 5-6=-1154/245,  
6-7=-1783/385, 7-8=-1612/222,

TOP CHORD  
2-3=-2686/418, 3-4=-2169/285,  
4-5=-1613/222, 5-6=-1154/245,  
6-7=-1783/385, 7-8=-1612/222,  
8-9=-1729/199, 9-10=-256/66,  
2-20=-1460/248  
BOT CHORD  
13-21=-6/1118, 21-22=-7/1116,  
12-22=-7/1115, 11-12=-137/1333,  
3-18=-90/294, 17-18=-495/2529,  
17-23=-266/1927, 15-23=-266/1927,  
14-15=-266/1927  
WEBS  
4-17=0/343, 4-14=-729/272,  
13-14=-22/555, 5-14=-47/576,  
6-13=-100/251, 6-12=-248/766,  
9-11=-1631/171, 2-18=-315/2087,  
7-12=-365/237, 15-16=-366/0,  
18-20=-258/242, 3-17=-618/233


**NOTES-** (11-12)  
1) Unbalanced roof live loads have been considered for this design.  
2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=5.0psf; BCDL=5.0psf; h=23ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60  
3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10  
4) This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.  
5) Provide adequate drainage to prevent water

6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.  
7) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 1-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.  
8) Refer to girder(s) for truss to truss connections.  
9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 11=157, 20=182.  
10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.  
11) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.  
12) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

**LOAD CASE(S)**  
Standard

Job 22-2670-R01	Truss R04	Truss Type Piggyback Base	Qty 2	Ply 1	LOT 157 CROSSING @ ANDERSON CREEK   357 TIMBER SKIP DRIVE SP
Atlantic Building Components, Moncks Corner, South Carolina					Job Reference (optional)

8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Apr 15 12:23:54 2022 Page 1  
 ID:te?\_8yH1N5AHCxjPc0A\_rzRBdO-w43uvPKNZ8v9cyrDjkj\_wsy80iiEmkZ26ceL6zQUXZ

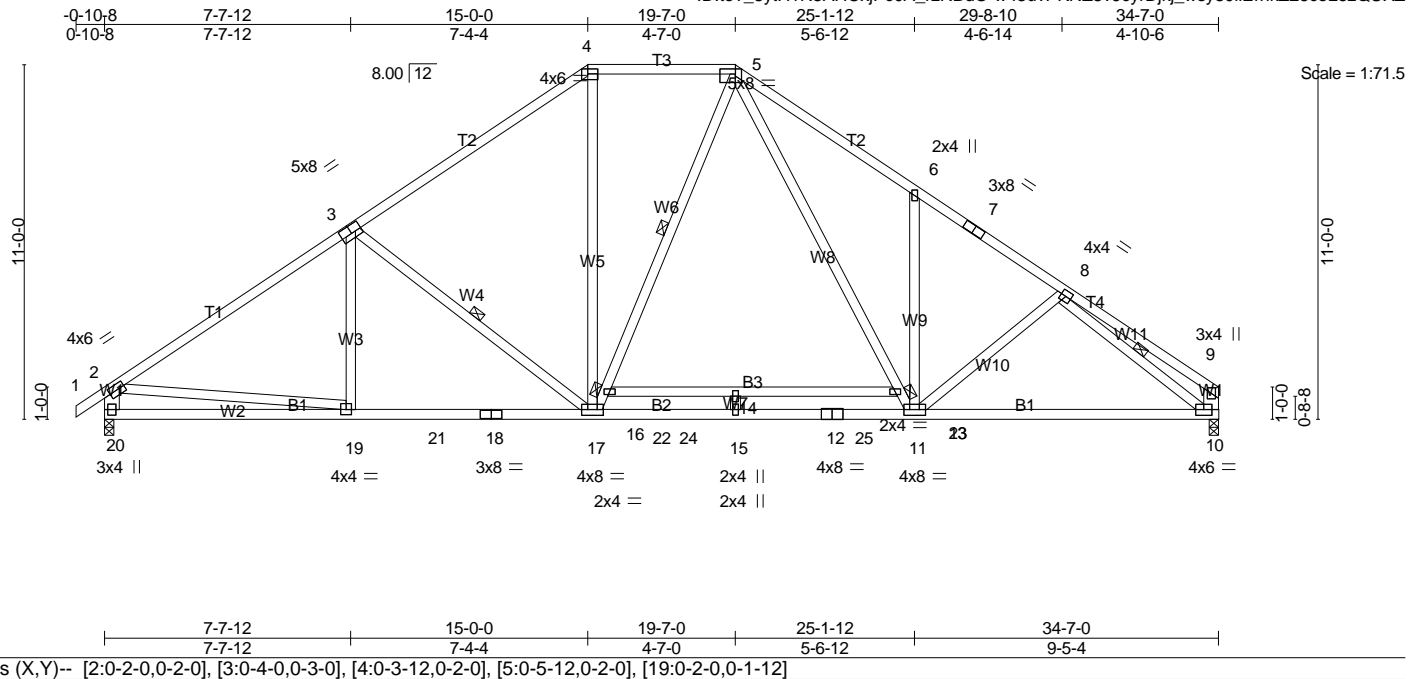

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.81	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.97	Vert(LL) -0.67 11-15 >610 240		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.57	Vert(CT) -0.95 11-15 >430 180		
BCDL 10.0	Rep Stress Incr YES	Matrix-SH	Horz(CT) 0.06 10 n/a n/a		
	Code IRC2018/TPI2014			Weight: 240 lb	FT = 0%

**LUMBER-**  
 TOP CHORD 2x4 SP No.2  
 BOT CHORD 2x4 SP No.1 \*Except\*  
 WEBS 2x4 SP No.3 \*Except\*  
 W1: 2x6 SP No.2

**BRACING-**  
 TOP CHORD  
 Structural wood sheathing directly applied, except end verticals.  
 BOT CHORD  
 Rigid ceiling directly applied or 10-0-0 oc bracing, Except:  
 2-2-0 oc bracing: 11-15.  
 6-0-0 oc bracing: 13-16  
 WEBS  
 1 Row at midpt  
 5-16, 3-17, 8-10

TOP CHORD  
 2-3=-2171/165, 3-4=-1829/158,  
 4-5=-1435/192, 5-6=-2243/303,  
 6-7=-2072/142, 7-8=-2190/118,  
 8-9=-333/81, 2-20=-1563/180,  
 9-10=-280/91  
 BOT CHORD  
 19-20=-285/575, 19-21=-175/1867,  
 18-21=-175/1867, 17-18=-175/1867,  
 17-22=0/1408, 15-22=0/1408,  
 12-15=0/1408, 12-23=0/1408,  
 11-23=0/1408, 10-11=-79/1722  
 WEBS  
 5-16=-94/289, 3-17=-485/248,  
 4-17=-22/709, 5-13=-205/1017,  
 11-13=-246/858, 6-11=-364/235,  
 2-19=0/1387, 8-10=-2052/81

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** (lb/size)

20	=	1509/0-3-8 (min. 0-1-15)
10	=	1471/0-3-8 (min. 0-1-15)
Max Horz		
20	=	265(LC 9)
Max Uplift		
20	=	-144(LC 12)
10	=	-106(LC 13)
Max Grav		
20	=	1642(LC 20)
10	=	1627(LC 21)

**FORCES.** (lb)  
 Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD  
 2-3=-2171/165, 3-4=-1829/158,  
 4-5=-1435/192, 5-6=-2243/303,  
 6-7=-2072/142, 7-8=-2190/118,

**NOTES-** (10-11)  
 1) Unbalanced roof live loads have been considered for this design.  
 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=5.0psf; BCDL=5.0psf; h=23ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60  
 3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10  
 4) This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.  
 5) Provide adequate drainage to prevent water ponding.

6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.  
 7) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 1-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.  
 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 20=144, 10=106.  
 9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.  
 10) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.  
 11) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

**LOAD CASE(S)**  
 Standard

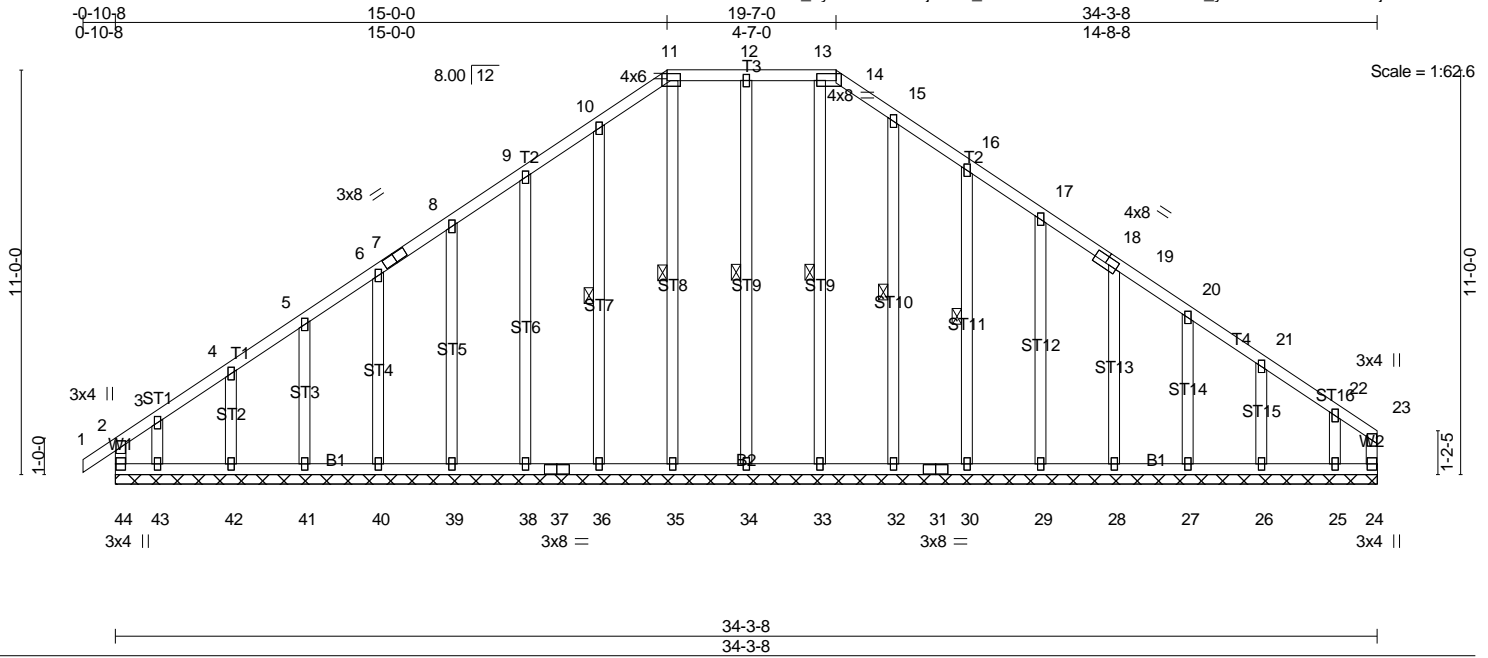


Plate Offsets (X,Y)-- [11:0-4-4,0-2-4], [14:0-6-4,0-2-4], [18:0-4-0,0-2-4]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.23	Vert(LL)	0.00	1	n/r	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.18	Vert(CT)	-0.00	1	n/r		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.16	Horz(CT)	0.01	24	n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-R						
							Weight: 272 lb	FT = 0%

**LUMBER-**

TOP CHORD 2x4 SP No.2  
 BOT CHORD 2x4 SP No.3  
 WEBS 2x4 SP No.3  
 OTHERS 2x4 SP No.3

**BRACING-**

TOP CHORD  
 Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
 BOT CHORD  
 Rigid ceiling directly applied or 6-0-0 oc bracing.  
 WEBS  
 1 Row at midpt  
 12-34, 11-35, 10-36, 13-33, 15-32, 16-30

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** All bearings 34-3-8.

(lb) - Max Horz  
 44= 267(LC 9)  
 Max Uplift  
 All uplift 100 lb or less at joint(s)  
 34, 35, 36, 38, 39, 40, 41, 42, 32, 30,  
 29, 28, 27, 26 except 44=214(LC 8),  
 24=123(LC 11), 43=197(LC 12),  
 25=171(LC 13)  
 Max Grav  
 All reactions 250 lb or less at joint(s)  
 24, 34, 41, 42, 43, 27, 26, 25 except  
 44=272(LC 21), 35=276(LC 23),  
 36=260(LC 20), 38=259(LC 20),  
 39=256(LC 20), 40=264(LC 20),  
 33=270(LC 23), 32=251(LC 21),  
 30=261(LC 21), 29=256(LC 21),  
 28=264(LC 21)

**FORCES.** (lb)

Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD  
 9-10=-169/254, 10-11=-197/283,

TOP CHORD  
 9-10=-169/254, 10-11=-197/283,  
 14-15=-193/268

**NOTES-** (15-16)

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=5.0psf; BCDL=5.0psf; h=23ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 4) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- 5) This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- 6) Provide adequate drainage to prevent water ponding.
- 7) All plates are 2x4 MT20 unless otherwise indicated.
- 8) Gable requires continuous bottom chord bearing.
- 9) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- 10) Gable studs spaced at 2-0-0 oc.
- 11) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

12) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 1-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.

13) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 34, 35, 36, 38, 39, 40, 41, 42, 32, 30, 29, 28, 27, 26 except (jt=lb) 44=214, 24=123, 43=197, 25=171.

14) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

15) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.


16) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

**LOAD CASE(S)**

Standard

Job 22-2670-R01	Truss R06	Truss Type Common Supported Gable	Qty 1	Ply 1	LOT 157 CROSSING @ ANDERSON CREEK   357 TIMBER SKIP DRIVE SP
Atlantic Building Components, Moncks Corner, South Carolina					Job Reference (optional)

8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Apr 15 12:24:02 2022 Page 1  
 ID:te?\_8ytH1N5AHCxjPc0A\_rzRBdO-hdYwa8QOhbW0aBSIBQssFYHglxe6jVGlLY3dezQUXR

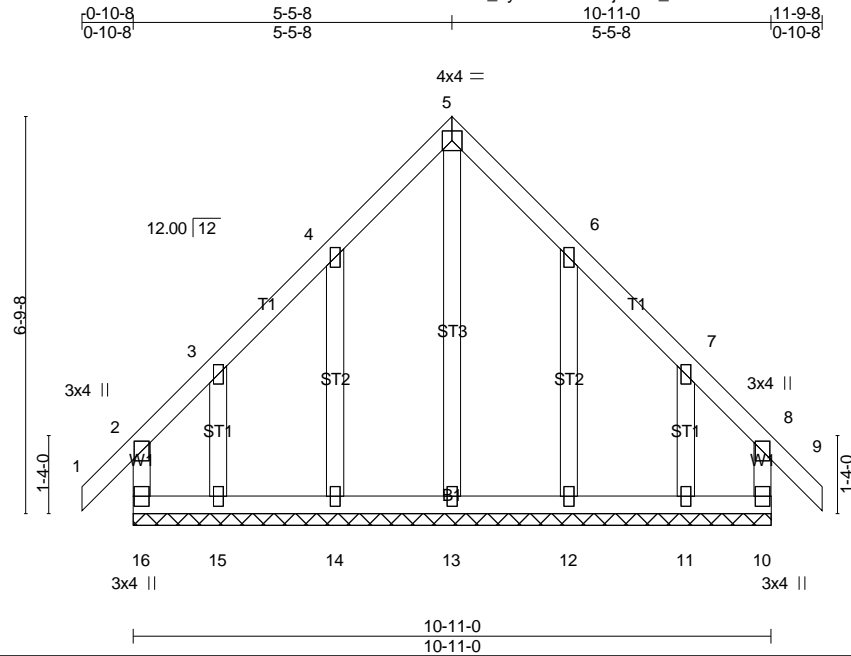

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.15	Vert(LL)	-0.00	9	n/r	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.14	Vert(CT)	-0.00	9	n/r		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.16	Horz(CT)	0.00	10	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-R						
	Code IRC2018/TPI2014						Weight: 75 lb	FT = 0%

**LUMBER-**  
 TOP CHORD 2x4 SP No.2  
 BOT CHORD 2x4 SP No.3  
 WEBS 2x4 SP No.3  
 OTHERS 2x4 SP No.3

**BRACING-**  
 TOP CHORD  
 Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
 BOT CHORD  
 Rigid ceiling directly applied or 6-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** All bearings 10-11-0.  
 (lb) - Max Horz  
 16=-183(LC 10)  
 Max Uplift  
 All uplift 100 lb or less at joint(s)  
 14, 12 except 16=-124(LC 8),  
 10=-111(LC 9), 15=-151(LC 12),  
 11=-149(LC 13)  
 Max Grav  
 All reactions 250 lb or less at joint(s)  
 16, 10, 14, 15, 12, 11 except 13=320(LC 23)

**FORCES.** (lb)  
 Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-** (14-15)  
 1) Unbalanced roof live loads have been considered for this design.  
 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=5.0psf; BCDL=5.0psf; h=23ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60

3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.  
 4) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10  
 5) This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.  
 6) All plates are 2x4 MT20 unless otherwise indicated.  
 7) Gable requires continuous bottom chord bearing.  
 8) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).  
 9) Gable studs spaced at 2-0-0 oc.  
 10) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.  
 11) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 1-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.  
 12) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 14, 12 except (jt=lb) 16=124, 10=111, 15=151, 11=149.  
 13) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.


14) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.  
 15) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

**LOAD CASE(S)**  
 Standard

Job 22-2670-R01	Truss R07	Truss Type Common Girder	Qty 1	Ply 2	LOT 157 CROSSING @ ANDERSON CREEK   357 TIMBER SKIP DRIVE SP
--------------------	--------------	-----------------------------	----------	----------	--

Atlantic Building Components, Moncks Corner, South Carolina

8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Apr 15 12:24:10 2022 Page 1  
ID:te?\_8ytH1N5AHCxjPc0A\_rzRBdO-S91yGtWPO2wuXQ3If50kaEcy89E1byGwjbUuWbZQUXJ

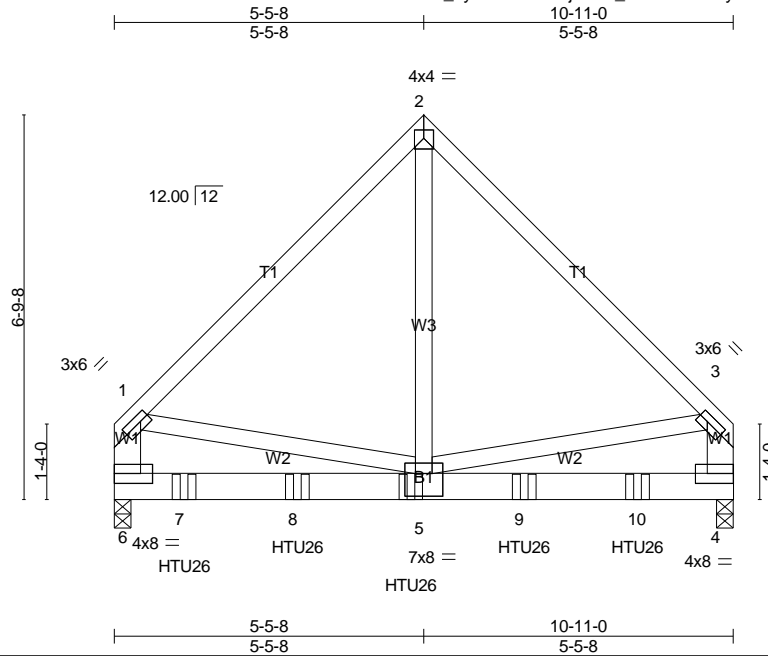

Scale = 1:40.7

Plate Offsets (X,Y)-- [1:0-2-0,0-1-8], [2:0-2-0,0-1-12], [3:0-2-0,0-1-8], [4:Edge,0-2-0], [5:0-4-0,0-4-12]

LOADING (psf)	SPACING-	CSL	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.48	Vert(LL)	-0.05	4-5	>999	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.76	Vert(CT)	-0.11	4-5	>999		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.79	Horz(CT)	0.00	4	n/a		
BCDL 10.0	Rep Stress Incr NO	Matrix-SH						
	Code IRC2018/TPI2014							
							Weight: 154 lb	FT = 0%

#### LUMBER-

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x6 SP No.1  
WEBS 2x4 SP No.3 \*Except\*  
W1: 2x6 SP No.2

#### BRACING-

TOP CHORD  
Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD  
Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS. (lb/size)

6 = 3916/0-3-8 (min. 0-2-6)  
4 = 3797/0-3-8 (min. 0-2-6)  
Max Horz  
6 = -158(LC 6)  
Max Uplift  
6 = -455(LC 11)  
4 = -369(LC 10)  
Max Grav  
6 = 3979(LC 3)  
4 = 3988(LC 3)

#### FORCES. (lb)

Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD  
1-2=-2980/364, 2-3=-2980/364,  
1-6=-2466/285, 3-4=-2428/292  
BOT CHORD  
6-7=-260/752, 7-8=-260/752,  
5-8=-260/752, 5-9=-130/861,  
9-10=-130/861, 4-10=-130/861  
WEBS  
2-5=-358/3831, 1-5=-175/1400,  
3-5=-212/1223

#### NOTES- (12-13)

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.  
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-6-0 oc.  
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=5.0psf; BCDL=5.0psf; h=23ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 1-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 6=455, 4=369.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.


- Use Simpson Strong-Tie HTU26 (20-10d Girder, 11-10dx1 1/2 Truss, Single Ply Girder) or equivalent spaced at 2-0-0 oc max. starting at 1-2-12 from the left end to 9-2-12 to connect truss(es) R03 (1 ply 2x4 SP), R03A (1 ply 2x4 SP) to back face of bottom chord.
- Fill all nail holes where hanger is in contact with lumber.
- Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
- Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

#### LOAD CASE(S)

- Standard
- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-2=-60, 2-3=-60, 4-6=-20  
Concentrated Loads (lb)  
Vert: 5=-1332(B) 7=-1332(B) 8=-1332(B)  
9=-1440(B) 10=-1440(B)


Job 22-2670-R01	Truss R08	Truss Type Common Supported Gable	Qty 1	Ply 1	LOT 157 CROSSING @ ANDERSON CREEK   357 TIMBER SKIP DRIVE SP
Atlantic Building Components, Moncks Corner, South Carolina					Job Reference (optional)

8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Apr 15 12:24:13 2022 Page 1  
ID:te?\_8ytH1N5AHCxjPc0A\_rzRBdO-skj4uuZl5zITototKDZRCiEYPMPvoU1MPZj8WVzQUXG



4x4 =

Scale = 1:33.7

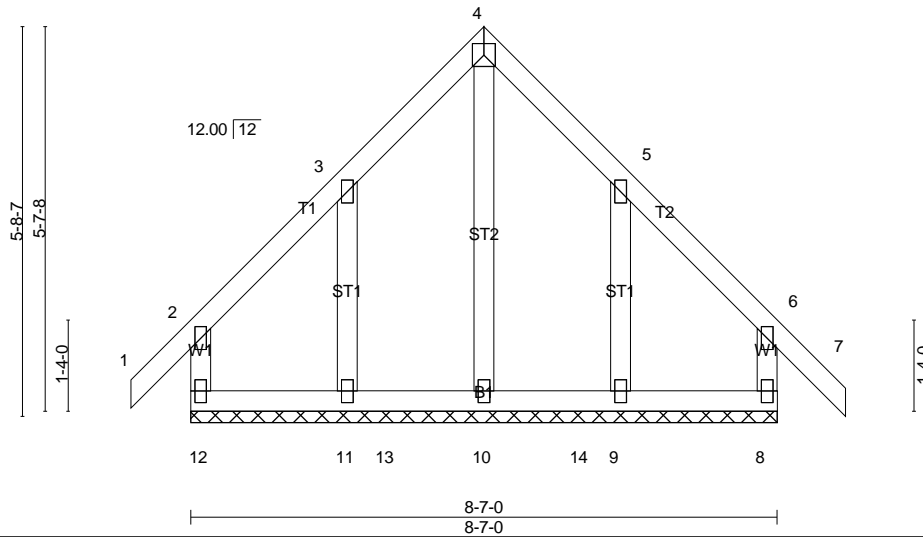

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.16	Vert(LL)	-0.00	7	n/r	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.12	Vert(CT)	-0.01	7	n/r		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.09	Horz(CT)	-0.00	8	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-R						
								Weight: 55 lb	FT = 0%

**LUMBER-**

TOP CHORD 2x4 SP No.2  
 BOT CHORD 2x4 SP No.3  
 WEBS 2x4 SP No.3  
 OTHERS 2x4 SP No.3

**BRACING-**

TOP CHORD  
 Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
 BOT CHORD  
 Rigid ceiling directly applied or 6-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** All bearings 8-7-0.

(lb) - Max Horz  
 12=-158(LC 10)  
 Max Uplift  
 All uplift 100 lb or less at joint(s)  
 12, 8 except 11=-142(LC 12), 9=-139(LC 13)  
 Max Grav  
 All reactions 250 lb or less at joint(s)  
 12, 8, 9 except 10=294(LC 23),  
 11=257(LC 20)

**FORCES.** (lb)

Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-** (14-15)

1) Unbalanced roof live loads have been considered for this design.  
 2) Wind: ASCE 7-16; Vult=130mph (3-second gust)  
 Vasd=103mph; TCDL=5.0psf; BCDL=5.0psf; h=23ft;  
 Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60


3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.  
 4) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10  
 5) This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.  
 6) All plates are 2x4 MT20 unless otherwise indicated.  
 7) Gable requires continuous bottom chord bearing.  
 8) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).  
 9) Gable studs spaced at 2-0-0 oc.  
 10) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.  
 11) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 1-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.  
 12) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 12, 8 except (jt=lb) 11=142, 9=139.  
 13) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

14) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.  
 15) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

**LOAD CASE(S)**  
 Standard

Job 22-2670-R01	Truss R09	Truss Type Common Structural Gable	Qty 1	Ply 1	LOT 157 CROSSING @ ANDERSON CREEK   357 TIMBER SKIP DRIVE SP
Atlantic Building Components, Moncks Corner, South Carolina					Job Reference (optional)

8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Apr 15 12:24:17 2022 Page 1  
 ID:te?\_8ytH1N5AHCxjPc0A\_rzRBdO-IWYbkGco9CputV6eZ3eNMjP50\_cnkFGyKBhMfHzQUX

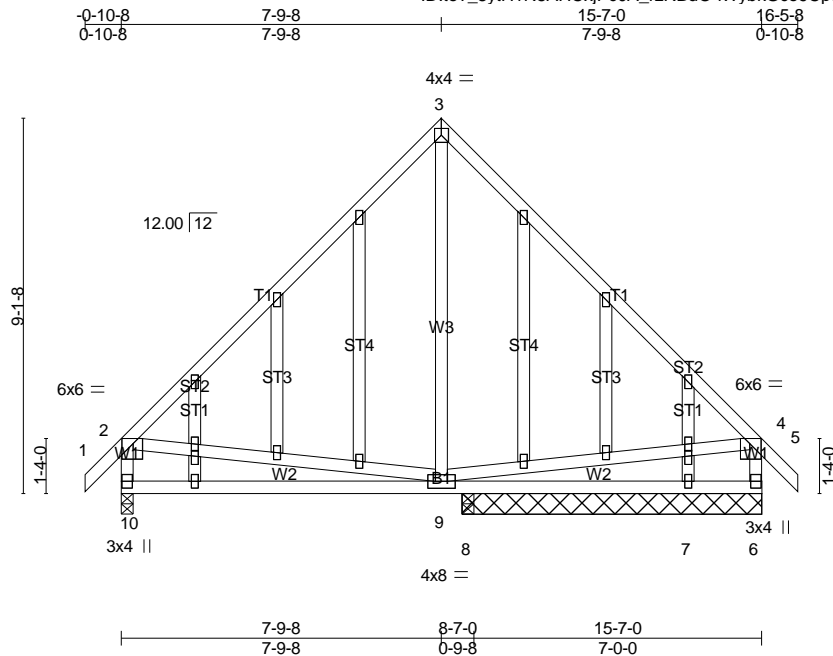

Scale = 1:56.0

Plate Offsets (X,Y)--	[2:0-3-4,0-1-8], [4:0-3-4,0-1-8], [15:0-1-9,0-1-0], [23:0-1-9,0-1-0]						
<b>LOADING</b> (psf)	<b>SPACING-</b> 2-0-0	<b>CSI.</b>	<b>DEFL.</b> in (loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 20.0	Plate Grip DOL 1.15	TC 0.76	Vert(LL) -0.09	9-10	>999	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.77	Vert(CT) -0.18	9-10	>543		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.26	Horz(CT) -0.01	6	n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-SH					
						Weight: 134 lb	FT = 0%

**LUMBER-**  
 TOP CHORD 2x4 SP No.2  
 BOT CHORD 2x4 SP No.3  
 WEBS 2x4 SP No.3 \*Except\*  
 W1: 2x4 SP No.2  
 OTHERS 2x4 SP No.3

**BRACING-**  
 TOP CHORD  
 Structural wood sheathing directly applied or 5-9-13 oc purlins, except end verticals.  
 BOT CHORD  
 Rigid ceiling directly applied or 9-3-11 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** All bearings 0-3-8 except (jt=length)  
 6=7-3-8, 7=7-3-8.  
 (lb) - Max Horz  
 10=-236(LC 10)  
 Max Uplift  
 All uplift 100 lb or less at joint(s)  
 10, 8 except 6=-117(LC 13)  
 Max Grav  
 All reactions 250 lb or less at joint(s)  
 7, 8 except 10=633(LC 1), 6=577(LC 1)

**FORCES.** (lb)  
 Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD  
 2-3=-537/140, 3-4=-536/140,  
 2-10=-559/108, 4-6=-564/104  
 BOT CHORD  
 9-10=-351/514, 8-9=-283/303,  
 7-8=-283/303, 6-7=-283/303  
 WEBS  
 3-9=0/260, 2-9=-233/389, 4-9=-197/421


- NOTES-** (12-13)
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=5.0psf; BCDL=5.0psf; h=23ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
  - TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
  - This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
  - All plates are 2x4 MT20 unless otherwise indicated.
  - Gable studs spaced at 2-0-0 oc.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 1-0-0 wide will fit between the bottom chord and any other members.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 10, 8 except (jt=lb) 6=117.
  - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

- Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
- Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

**LOAD CASE(S)**  
 Standard

Job 22-2670-R01	Truss R10	Truss Type Common Girder	Qty 1	Ply 2	LOT 157 CROSSING @ ANDERSON CREEK   357 TIMBER SKIP DRIVE SP
Atlantic Building Components, Moncks Corner, South Carolina					Job Reference (optional)

8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Apr 15 12:24:24 2022 Page 1  
 ID:te?\_8ytH1N5AHCxjPc0A\_rzRBdO-2stECfhBVMhvCZ8\_U1G08BCGgo0RtlS\_xmtEPNzQUX5

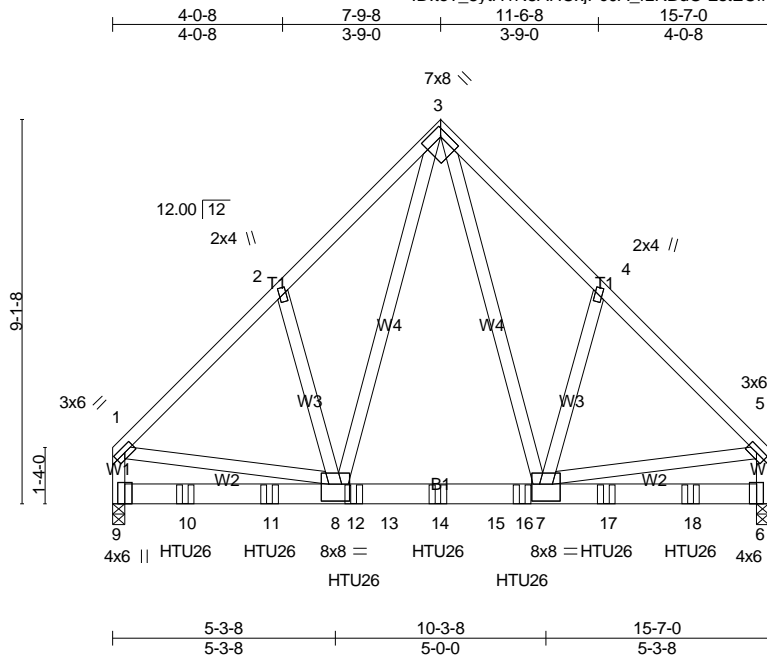

Scale = 1:54.7

Plate Offsets (X,Y)--	[3:0-2-8,0-1-12], [7:0-4-0,0-4-12], [8:0-4-0,0-4-12]						
<b>LOADING</b> (psf)	<b>SPACING-</b> 2-0-0	<b>CSI.</b>	<b>DEFL.</b> in (loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 20.0	Plate Grip DOL 1.15	TC 0.80	Vert(LL) -0.07	8-9 >999	240	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.77	Vert(CT) -0.14	8-9 >999	180		
BCLL 0.0 *	Rep Stress Incr NO	WB 0.72	Horz(CT) 0.01	6 n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-SH					
						Weight: 253 lb	FT = 0%

**LUMBER-**  
 TOP CHORD 2x4 SP No.2  
 BOT CHORD 2x6 SP No.1  
 WEBS 2x4 SP No.3 \*Except\*  
 W1: 2x4 SP No.2

**BRACING-**  
 TOP CHORD  
 Structural wood sheathing directly applied or 5-6-15 oc purlins, except end verticals.  
 BOT CHORD  
 Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (lb/size)  
 9 = 5409/0-3-8 (min. 0-1-8)  
 6 = 5248/0-3-8 (min. 0-1-8)  
 Max Horz  
 9 = -210(LC 6)  
 Max Uplift  
 9 = -608(LC 11)  
 6 = -642(LC 10)  
 Max Grav  
 9 = 5512(LC 3)  
 6 = 5250(LC 3)

**FORCES.** (lb)  
 Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD  
 1-2=-4958/633, 2-3=-4865/723,  
 3-4=-4813/732, 4-5=-4909/643,  
 1-9=-4120/521, 5-6=-4097/527  
 BOT CHORD  
 9-10=-260/773, 10-11=-260/773,  
 8-11=-260/773, 8-12=-304/2475,  
 12-13=-304/2475, 13-14=-304/2475,  
 14-15=-304/2475, 15-16=-304/2475,  
 7-16=-304/2475, 7-17=-104/626,  
 17-18=-104/626, 6-18=-104/626  
 WEBS  
 3-7=-560/3346, 3-8=-535/3484,  
 1-8=-324/2813, 5-7=-323/2837

**WEBS**  
 3-7=-560/3346, 3-8=-535/3484,  
 1-8=-324/2813, 5-7=-323/2837

**NOTES-** (13-14)  
 1) 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
 Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.  
 Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-6-0 oc.  
 Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.  
 2) All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.  
 3) Unbalanced roof live loads have been considered for this design.  
 4) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=5.0psf; BCDL=5.0psf; h=23ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60  
 5) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10  
 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.  
 7) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 1-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.  
 8) Bearing at joint(s) 9, 6 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.

9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 9=608, 6=642.  
 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.  
 11) Use Simpson Strong-Tie HTU26 (20-10d Girder, 11-10dx1 1/2 Truss, Single Ply Girder) or equivalent spaced at 2-0-0 oc max. starting at 1-8-12 from the left end to 13-8-12 to connect truss(es) R03A (1 ply 2x4 SP), R03B (1 ply 2x4 SP), R03 (1 ply 2x4 SP) to back face of bottom chord.  
 12) Fill all nail holes where hanger is in contact with lumber.  
 13) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.  
 14) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.


**LOAD CASE(S)**  
 Standard  
 1) Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15  
 Uniform Loads (plf)  
 Vert: 1-3=-60, 3-5=-60, 6-9=-20  
 Concentrated Loads (lb)  
 Vert: 10=-1440(B) 11=-1332(B) 12=-1332(B)  
 14=-1332(B) 16=-1332(B) 17=-1332(B) 18=-1332(B)




Job	Truss	Truss Type	Qty	Ply	LOT 157 CROSSING @ ANDERSON CREEK   357 TIMBER SKIP DRIVE SFF
22-2670-R01	R11	Monopitch Supported Gable	1	1	Job Reference (optional)

Atlantic Building Components, Moncks Corner, South Carolina

8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Apr 15 12:24:28 2022 Page 1  
ID:te?\_8ytH1N5AHCxjPc0A\_rzRBdO-wd7I21kiZaBKbBSljtkYl1M58PV9pH7asOrRY8zQUX1



Scale = 1:16.4

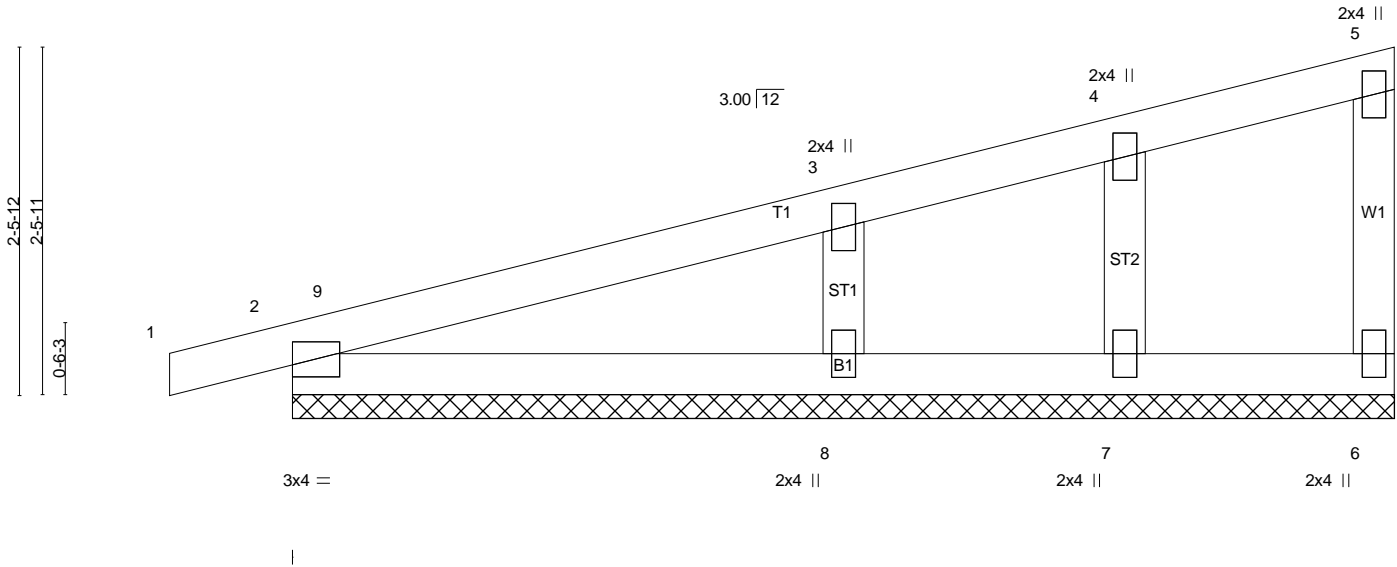

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.25	Vert(LL) 0.01	1	n/r	180	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.21	Vert(CT) 0.01	1	n/r	80		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.06	Horz(CT) -0.00	6	n/a	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-P						
	Code IRC2018/TPI2014						Weight: 31 lb	FT = 0%

**LUMBER-**

TOP CHORD 2x4 SP No.2  
 BOT CHORD 2x4 SP No.3  
 WEBS 2x4 SP No.3  
 OTHERS 2x4 SP No.3

**BRACING-**

TOP CHORD  
 Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
 BOT CHORD  
 Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** All bearings 7-10-0.

(lb) - Max Horz  
 2= 81(LC 11)  
 Max Uplift  
 All uplift 100 lb or less at joint(s) 6, 2, 8, 7  
 Max Grav  
 All reactions 250 lb or less at joint(s) 6, 2, 7 except 8=400(LC 21)

**FORCES.** (lb)

Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 WEBS  
 3-8=-320/112

**NOTES-** (12-13)

1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=5.0psf; BCDL=5.0psf; h=23ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60  
 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per

- 3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- 4) Unbalanced snow loads have been considered for this design.
- 5) This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- 6) Gable requires continuous bottom chord bearing.
- 7) Gable studs spaced at 2-0-0 oc.
- 8) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 9) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 1-0-0 wide will fit between the bottom chord and any other members.
- 10) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 6, 2, 8, 7.
- 11) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 12) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
- 13) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.


**LOAD CASE(S)**

Standard


Job	Truss	Truss Type	Qty	Ply	LOT 157 CROSSING @ ANDERSON CREEK   357 TIMBER SKIP DRIVE SP
22-2670-R01	R12	Monopitch	4	1	Job Reference (optional)

Atlantic Building Components, Moncks Corner, South Carolina

8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Apr 15 12:24:30 2022 Page 1  
 ID:te?\_8ytH1N5AHCxjPc0A\_rzRBdO-s0EVTimy5CS2xUb8qINQOSRJ7D3GHBcsKiKYd0zQUX?



Scale = 1:16.4

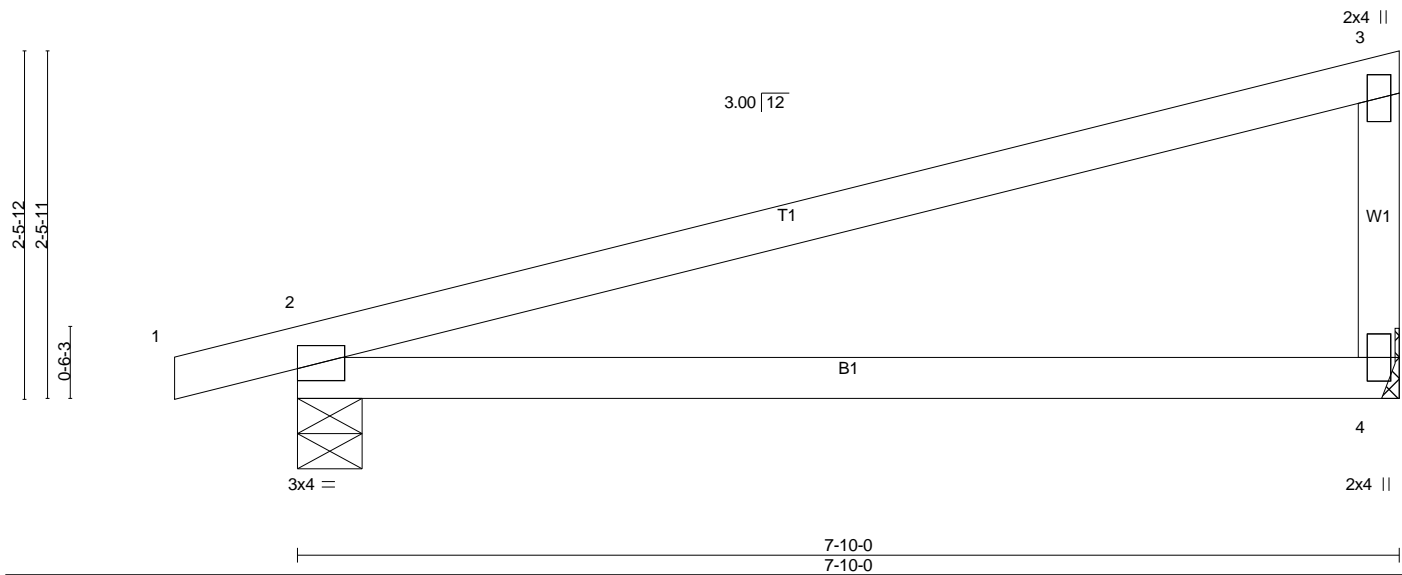

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.73	Vert(LL) -0.19	2-4	>482	240	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.74	Vert(CT) -0.37	2-4	>241	180		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.00	Horz(CT) -0.00	4	n/a	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-P						
	Code IRC2018/TPI2014							
							Weight: 28 lb	FT = 0%

**LUMBER-**

TOP CHORD 2x4 SP SS  
 BOT CHORD 2x4 SP No.2  
 WEBS 2x4 SP No.3

**BRACING-**

**TOP CHORD**

Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.

**BOT CHORD**

Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** (lb/size)

4	=	293/Mechanical
2	=	369/0-5-8 (min. 0-1-8)
Max Horz		
2	=	81(LC 11)
Max Uplift		
4	=	-63(LC 14)
2	=	-99(LC 10)
Max Grav		
4	=	381(LC 21)
2	=	458(LC 21)

**FORCES.** (lb)

Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**TOP CHORD**

3-4=-307/100

**NOTES-** (10-11)

1) Wind: ASCE 7-16; Vult=130mph (3-second gust)  
 Vasd=103mph; TCDL=5.0psf; BCDL=5.0psf; h=23ft;  
 Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60

- 2) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- 3) Unbalanced snow loads have been considered for this design.
- 4) This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 1-0-0 wide will fit between the bottom chord and any other members.
- 7) Refer to girder(s) for truss to truss connections.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 2.
- 9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 10) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
- 11) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.


**LOAD CASE(S)**

Standard

Job	Truss	Truss Type	Qty	Ply	LOT 157 CROSSING @ ANDERSON CREEK   357 TIMBER SKIP DRIVE SP
22-2670-R01	R13	Half Hip	7	1	Job Reference (optional)

Atlantic Building Components, Moncks Corner, South Carolina

8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Apr 15 12:24:34 2022 Page 1  
ID:te?\_8ytH1N5AHCxjPc0A\_rzRBdO-InU0I4pT8QyUP6vv38RMYIc0WqU?DtTSEKlllozQUWx



Scale = 1:17.2

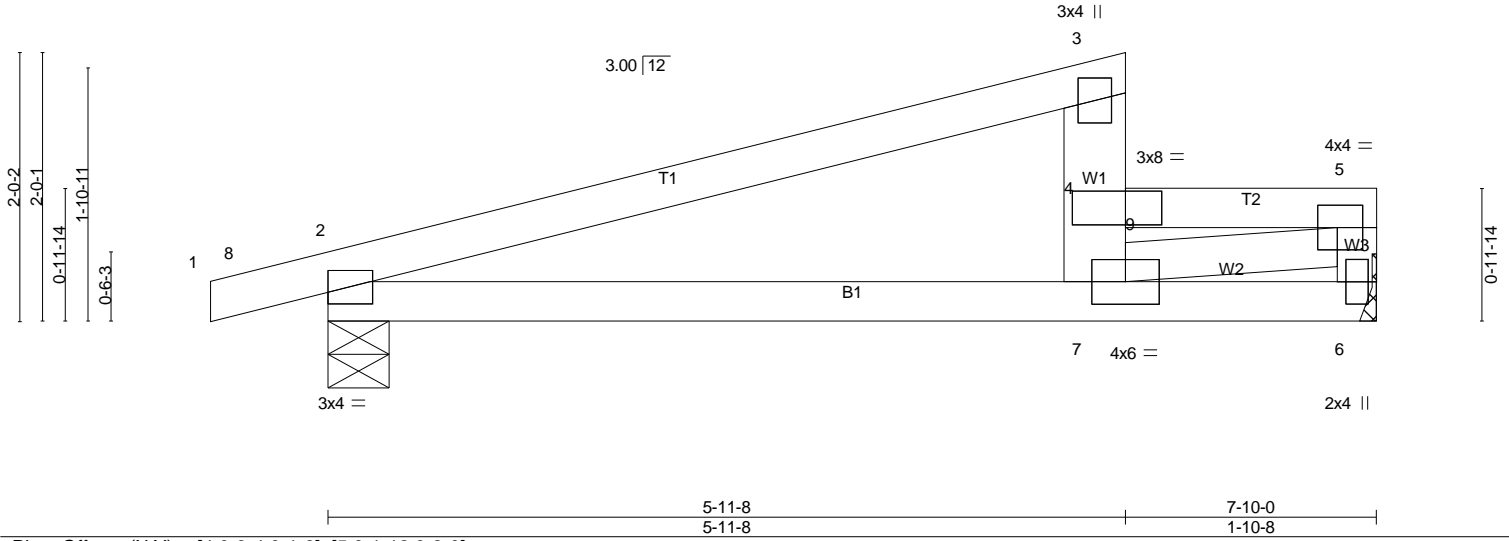


Plate Offsets (X,Y)-- [4:0-3-4,0-1-8], [5:0-1-12,0-2-0]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.64	Vert(LL) -0.03	2-7	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.50	Vert(CT) -0.09	2-7	>999	180		
BCLL 0.0 *	Rep Stress Incr NO	WB 0.52	Horz(CT) 0.01	6	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-SH						
							Weight: 31 lb	FT = 0%

**LUMBER-**

TOP CHORD 2x4 SP No.2  
 BOT CHORD 2x4 SP No.2  
 WEBS 2x4 SP No.3 \*Except\*  
 W1: 2x6 SP No.2

**BRACING-**

TOP CHORD  
 Structural wood sheathing directly applied or 4-6-4 oc purlins, except end verticals.  
 BOT CHORD  
 Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** (lb/size)

6 = 810/Mechanical  
 2 = 465/0-5-8 (min. 0-1-8)  
 Max Horz  
 2 = 86(LC 14)  
 Max Grav  
 6 = 820(LC 36)  
 2 = 594(LC 36)

**FORCES.** (lb)

Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD  
 2-3=-847/0, 4-7=-374/33, 4-9=-1371/0,  
 5-9=-1371/0, 5-6=-749/0  
 BOT CHORD  
 2-7=0/744  
 WEBS  
 5-7=0/1260

**NOTES-** (13-14)

1) Unbalanced roof live loads have been considered for this design.

- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=5.0psf; BCDL=5.0psf; h=23ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) C-C wind load user defined.
- 4) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- 5) Unbalanced snow loads have been considered for this design.
- 6) This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- 7) Provide adequate drainage to prevent water ponding.
- 8) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 9) \* This truss has been designed for a live load of 30.Opsf on the bottom chord in all areas where a rectangle 3-6-0 tall by 1-0-0 wide will fit between the bottom chord and any other members.
- 10) Refer to girder(s) for truss to truss connections.
- 11) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 12) Load case(s) 1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 14, 15, 16, 17, 18, 19, 20, 21, 22, 23, 24, 25, 26, 27, 28, 29, 30, 31, 32, 35, 36, 37, 38, 39, 40, 41, 42, 43, 44, 45, 46, 47, 48, 49, 50, 51, 52 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.

- 13) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
- 14) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

**LOAD CASE(S)**

- Standard Except:
- 1) Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15  
 Uniform Loads (plf)  
 Vert: 1-3=-60, 4-9=-60, 5-9=-260, 2-6=-20  
 Concentrated Loads (lb)  
 Vert: 9=-300
  - 2) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
 Uniform Loads (plf)  
 Vert: 1-3=-60, 4-9=-60, 5-9=-260, 2-6=-20  
 Concentrated Loads (lb)  
 Vert: 9=-300
  - 3) Dead + 0.75 Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
 Uniform Loads (plf)  
 Vert: 1-3=-50, 4-9=-50, 5-9=-250, 2-6=-20  
 Concentrated Loads (lb)  
 Vert: 9=-300
  - 4) Dead + 0.75 Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15  
 Uniform Loads (plf)  
 Vert: 1-3=-50, 4-9=-50, 5-9=-250, 2-6=-20  
 Concentrated Loads (lb)  
 Vert: 9=-300
  - 5) Dead + 0.75 Snow (Unbal. Left): Lumber Increase=1.15, Plate Increase=1.15  
 Uniform Loads (plf)  
 Vert: 1-8=-50, 3-8=-58, 4-9=-29, 5-9=-229, 2-6=-20  
 Concentrated Loads (lb)

Job	Truss	Truss Type	Qty	Ply	LOT 157 CROSSING @ ANDERSON CREEK   357 TIMBER SKIP DRIVE SPP
22-2670-R01	R13	Half Hip	7	1	Job Reference (optional)

Atlantic Building Components, Moncks Corner, South Carolina

8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Apr 15 12:24:34 2022 Page 2  
ID:te?\_8ytH1N5AHCxjPc0A\_rzRBdO-inU0l4pT8yUP6v38RMYlc0WqU?DtTSEKlllozQUWx

### LOAD CASE(S)

- |   |   |  |
|---|---|--|
| <p>Standard Except:<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>6) Dead + 0.75 Snow (Unbal. Right): Lumber Increase=1.15, Plate Increase=1.15<br/>Uniform Loads (plf)<br/>Vert: 1-3=-29, 4-9=-63, 5-9=-263, 2-6=-20<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>7) Dead + Uninhabitable Attic Without Storage: Lumber Increase=1.25, Plate Increase=1.25<br/>Uniform Loads (plf)<br/>Vert: 1-3=-20, 4-9=-20, 5-9=-220, 2-6=-40<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>8) Dead + 0.6 C-C Wind (Pos. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-10, 2-3=-5, 4-9=-5, 5-9=-205, 2-6=-10<br/>Horz: 2-3=-5, 3-4=-47, 5-6=35<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>9) Dead + 0.6 C-C Wind (Neg. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-4, 2-3=-42, 4-9=-42, 5-9=-242, 2-6=-20<br/>Horz: 2-3=22, 3-4=27, 5-6=-32<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>10) Dead + 0.6 MWFRS Wind (Pos. Internal) Left:<br/>Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=38, 2-3=26, 4-9=10, 5-9=-190, 2-6=-10<br/>Horz: 2-3=-36, 3-4=9, 5-6=19<br/>Drag: 1-2=0<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>11) Dead + 0.6 MWFRS Wind (Pos. Internal) Right:<br/>Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=8, 2-3=13, 4-9=26, 5-9=-174, 2-6=-10<br/>Horz: 2-3=-23, 3-4=-24, 5-6=-15<br/>Drag: 1-2=0<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>12) Dead + 0.6 MWFRS Wind (Neg. Internal) Left:<br/>Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=11, 2-3=6, 4-9=10, 5-9=-210, 2-6=-20<br/>Horz: 2-3=-26, 3-4=30, 5-6=9<br/>Drag: 1-2=0<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>13) Dead + 0.6 MWFRS Wind (Neg. Internal) Right:<br/>Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-2, 2-3=-7, 4-9=6, 5-9=-194, 2-6=-20<br/>Horz: 2-3=-13, 3-4=-3, 5-6=-25<br/>Drag: 1-2=0<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>14) Dead + 0.6 MWFRS Wind (Pos. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=21, 2-3=26, 4-9=10, 5-9=-190, 2-6=-10<br/>Horz: 2-3=-36, 3-4=-41, 5-6=17<br/>Drag: 1-2=0<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>15) Dead + 0.6 MWFRS Wind (Pos. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=5, 2-3=10, 4-9=26, 5-9=-174, 2-6=-10<br/>Horz: 2-3=-20, 3-4=-26, 5-6=-12<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>16) Dead + 0.6 MWFRS Wind (Pos. Internal) 3rd Parallel: Lumber Increase=1.60, Plate Increase=1.60</p> | <p>Standard Except:<br/>Uniform Loads (plf)<br/>Vert: 1-2=21, 2-3=26, 4-9=10, 5-9=-190, 2-6=-10<br/>Horz: 2-3=-36, 3-4=-41, 5-6=17<br/>Drag: 1-2=0<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>17) Dead + 0.6 MWFRS Wind (Pos. Internal) 4th Parallel: Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=5, 2-3=10, 4-9=26, 5-9=-174, 2-6=-10<br/>Horz: 2-3=-20, 3-4=-26, 5-6=-12<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>18) Dead + 0.6 MWFRS Wind (Neg. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=11, 2-3=6, 4-9=-10, 5-9=-210, 2-6=-20<br/>Horz: 2-3=-26, 3-4=-20, 5-6=7<br/>Drag: 1-2=0<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>19) Dead + 0.6 MWFRS Wind (Neg. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-5, 2-3=-10, 4-9=6, 5-9=-194, 2-6=-20<br/>Horz: 2-3=-10, 3-4=-5, 5-6=-23<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>20) Dead + Snow on Overhangs: Lumber Increase=1.15, Plate Increase=1.15<br/>Uniform Loads (plf)<br/>Vert: 1-2=-100, 2-3=-20, 4-9=-20, 5-9=-220, 2-6=-20<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>21) Dead + Snow (Unbal. Left): Lumber Increase=1.15, Plate Increase=1.15<br/>Uniform Loads (plf)<br/>Vert: 1-8=-60, 3-8=-70, 4-9=-32, 5-9=-232, 2-6=-20<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>22) Dead + Snow (Unbal. Right): Lumber Increase=1.15, Plate Increase=1.15<br/>Uniform Loads (plf)<br/>Vert: 1-3=-32, 4-9=-77, 5-9=-277, 2-6=-20<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>23) Dead: Lumber Increase=0.90, Plate Increase=0.90<br/>Plt. metal=0.90<br/>Uniform Loads (plf)<br/>Vert: 1-3=-20, 4-9=-20, 5-9=-220, 2-6=-20<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>24) Dead + 0.75 Snow (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) Left): Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-27, 2-3=-31, 4-9=-42, 5-9=-242, 2-6=-20<br/>Horz: 2-3=-19, 3-4=23, 5-6=6<br/>Drag: 1-2=0<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>25) Dead + 0.75 Snow (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) Right): Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-37, 2-3=-40, 4-9=-31, 5-9=-231, 2-6=-20<br/>Horz: 2-3=-10, 3-4=-3, 5-6=-19<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>26) Dead + 0.75 Snow (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)</p> | <p>Standard Except:<br/>Vert: 1-2=-27, 2-3=-31, 4-9=-42, 5-9=-242, 2-6=-20<br/>Horz: 2-3=-19, 3-4=-15, 5-6=5<br/>Drag: 1-2=0<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>27) Dead + 0.75 Snow (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-39, 2-3=-42, 4-9=-31, 5-9=-231, 2-6=-20<br/>Horz: 2-3=-8, 3-4=-4, 5-6=-17<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>28) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) Left): Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-27, 2-3=-31, 4-9=-42, 5-9=-242, 2-6=-20<br/>Horz: 2-3=-19, 3-4=23, 5-6=6<br/>Drag: 1-2=0<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>29) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) Right): Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-37, 2-3=-40, 4-9=-31, 5-9=-231, 2-6=-20<br/>Horz: 2-3=-10, 3-4=-3, 5-6=-19<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>30) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-27, 2-3=-31, 4-9=-42, 5-9=-242, 2-6=-20<br/>Horz: 2-3=-19, 3-4=-15, 5-6=5<br/>Drag: 1-2=0<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>31) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-39, 2-3=-42, 4-9=-31, 5-9=-231, 2-6=-20<br/>Horz: 2-3=-8, 3-4=-4, 5-6=-17<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>32) Dead + Minimum Snow: Lumber Increase=1.15, Plate Increase=1.15<br/>Uniform Loads (plf)<br/>Vert: 1-3=-60, 4-9=-60, 5-9=-260, 2-6=-20<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>35) 3rd Unbal. Dead + Snow (balanced) + Parallel: Lumber Increase=1.15, Plate Increase=1.15<br/>Uniform Loads (plf)<br/>Vert: 1-3=-32, 4-9=-89, 5-9=-289, 2-6=-20<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>36) 4th Unbal. Dead + Snow (balanced) + Parallel: Lumber Increase=1.15, Plate Increase=1.15<br/>Uniform Loads (plf)<br/>Vert: 1-3=-89, 4-9=-32, 5-9=-232, 2-6=-20<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>37) 5th Unbal. Dead + 0.75 Snow (balanced) + Parallel: Lumber Increase=1.15, Plate Increase=1.15<br/>Uniform Loads (plf)<br/>Vert: 1-3=-29, 4-9=-72, 5-9=-272, 2-6=-20<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>38) 6th Unbal. Dead + 0.75 Snow (balanced) + Parallel: Lumber Increase=1.15, Plate Increase=1.15<br/>Uniform Loads (plf)<br/>Vert: 1-3=-72, 4-9=-29, 5-9=-229, 2-6=-20<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> |
|---|---|--|

Continued on page 3

Job	Truss	Truss Type	Qty	Ply	LOT 157 CROSSING @ ANDERSON CREEK   357 TIMBER SKIP DRIVE SPP
22-2670-R01	R13	Half Hip	7	1	Job Reference (optional)

Atlantic Building Components, Moncks Corner, South Carolina

8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Apr 15 12:24:34 2022 Page 3  
ID:te?\_8ytH1N5AHCxjPc0A\_rzRBdO-InU0l4pT8QyUP6vv38RMYlc0WqU?DtTSEKlllozQUWx


### LOAD CASE(S)

- 39) 7th Unbal.Death + 0.75 Snow (unbal.) + 0.75(0.6 MWFRS Wind (Neg. Int) Left) + Parallel: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-2=-6, 2-3=-10, 4-9=-64, 5-9=-264, 2-6=-20  
Horz: 2-3=-19, 3-4=23, 5-6=6  
Drag: 1-2=0  
Concentrated Loads (lb)  
Vert: 9=-300
- 40) 8th Unbal.Death + 0.75 Snow (unbal.) + 0.75(0.6 MWFRS Wind (Neg. Int) Left) + Parallel: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-2=-49, 2-3=-53, 4-9=-21, 5-9=-221, 2-6=-20  
Horz: 2-3=-19, 3-4=23, 5-6=6  
Drag: 1-2=0  
Concentrated Loads (lb)  
Vert: 9=-300
- 41) 9th Unbal.Death + 0.75 Snow (unbal.) + 0.75(0.6 MWFRS Wind (Neg. Int) Right) + Parallel: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-2=-16, 2-3=-19, 4-9=-53, 5-9=-253, 2-6=-20  
Horz: 2-3=-10, 3-4=-3, 5-6=-19  
Concentrated Loads (lb)  
Vert: 9=-300
- 42) 10th Unbal.Death + 0.75 Snow (unbal.) + 0.75(0.6 MWFRS Wind (Neg. Int) Right) + Parallel: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-2=-58, 2-3=-62, 4-9=-10, 5-9=-210, 2-6=-20  
Horz: 2-3=-10, 3-4=-3, 5-6=-19  
Concentrated Loads (lb)  
Vert: 9=-300
- 43) 11th Unbal.Death + 0.75 Snow (unbal.) + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-2=-6, 2-3=-10, 4-9=-64, 5-9=-264, 2-6=-20  
Horz: 2-3=-19, 3-4=-15, 5-6=5  
Drag: 1-2=0  
Concentrated Loads (lb)  
Vert: 9=-300
- 44) 12th Unbal.Death + 0.75 Snow (unbal.) + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-2=-49, 2-3=-53, 4-9=-21, 5-9=-221, 2-6=-20  
Horz: 2-3=-19, 3-4=-15, 5-6=5  
Drag: 1-2=0  
Concentrated Loads (lb)  
Vert: 9=-300
- 45) 13th Unbal.Death + 0.75 Snow (unbal.) + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-2=-18, 2-3=-21, 4-9=-53, 5-9=-253, 2-6=-20  
Horz: 2-3=-8, 3-4=-4, 5-6=-17  
Concentrated Loads (lb)  
Vert: 9=-300
- 46) 14th Unbal.Death + 0.75 Snow (unbal.) + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-2=-61, 2-3=-64, 4-9=-10, 5-9=-210, 2-6=-20  
Horz: 2-3=-8, 3-4=-4, 5-6=-17  
Concentrated Loads (lb)  
Vert: 9=-300
- 47) 15th Unbal.Death + Minimum Snow + Parallel: Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-3=-32, 4-9=-89, 5-9=-289, 2-6=-20  
Concentrated Loads (lb)  
Vert: 9=-300
- 48) 16th Unbal.Death + Minimum Snow + Parallel: Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-3=-89, 4-9=-32, 5-9=-232, 2-6=-20
- Concentrated Loads (lb)  
Vert: 9=-300
- 49) 1st Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-3=-60, 4-9=-20, 5-9=-220, 2-6=-20  
Concentrated Loads (lb)  
Vert: 9=-300
- 50) 2nd Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-3=-20, 4-9=-60, 5-9=-260, 2-6=-20  
Concentrated Loads (lb)  
Vert: 9=-300
- 51) 3rd Dead + 0.75 Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-3=-50, 4-9=-20, 5-9=-220, 2-6=-20  
Concentrated Loads (lb)  
Vert: 9=-300
- 52) 4th Dead + 0.75 Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-3=-20, 4-9=-50, 5-9=-250, 2-6=-20  
Concentrated Loads (lb)  
Vert: 9=-300


Job 22-2670-R01	Truss R14	Truss Type GABLE	Qty 1	Ply 1	LOT 157 CROSSING @ ANDERSON CREEK   357 TIMBER SKIP DRIVE SP
--------------------	--------------	---------------------	----------	----------	--

Atlantic Building Components, Moncks Corner, South Carolina

8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Apr 15 12:24:37 2022 Page 1  
ID:te?\_8ytH1N5AHCxjPc0A\_rzRBdO-9MA9x6rLRLK3GZeUKG?3AxEac2QLQGfuxlXQM6zQUWu



Scale = 1:19.9

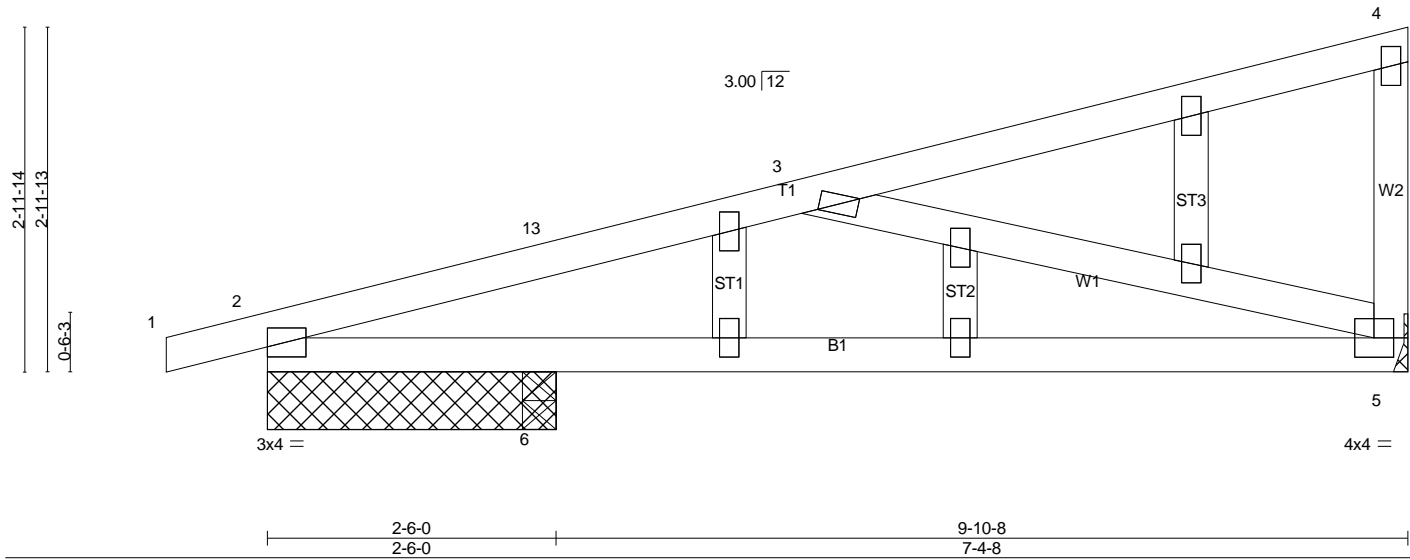

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.40	Vert(LL) -0.08	5-6	>999	240	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.78	Vert(CT) -0.16	5-6	>554	180		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.39	Horz(CT) 0.01	5	n/a	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-SH						
	Code IRC2018/TPI2014							
							Weight: 47 lb	FT = 0%

**LUMBER-**

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.3  
WEBS 2x4 SP No.3  
OTHERS 2x4 SP No.3

**BRACING-**

TOP CHORD  
Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD  
Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** (lb/size)

5 =	343/Mechanical
2 =	306/2-6-0 (min. 0-1-8)
6 =	182/0-3-8 (min. 0-1-8)
Max Horz	
2 =	100(LC 11)
Max Uplift	
5 =	-97(LC 14)
2 =	-151(LC 10)
Max Grav	
5 =	449(LC 21)
2 =	367(LC 21)
6 =	311(LC 7)

**FORCES.** (lb)

Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD  
2-13=-855/232, 3-13=-772/239  
BOT CHORD  
2-6=-248/781, 5-6=-248/781  
WEBS  
3-5=-765/280

**NOTES-** (13-14)

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=5.0psf; BCDL=5.0psf; h=23ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- 4) Unbalanced snow loads have been considered for this design.
- 5) This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- 6) All plates are 2x4 MT20 unless otherwise indicated.
- 7) Gable studs spaced at 2-0-0 oc.
- 8) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 9) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 1-0-0 wide will fit between the bottom chord and any other members.
- 10) Refer to girder(s) for truss to truss connections.
- 11) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5 except (jt=lb) 2=151.
- 12) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.


- 13) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
- 14) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

**LOAD CASE(S)**

Standard

Job 22-2670-R01	Truss R15	Truss Type Half Hip	Qty 1	Ply 1	LOT 157 CROSSING @ ANDERSON CREEK   357 TIMBER SKIP DRIVE SP
Atlantic Building Components, Moncks Corner, South Carolina					Job Reference (optional)

8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Apr 15 12:24:40 2022 Page 1  
 ID:te?\_8ytH1N5AHCxjPc0A\_rzRBdO-axrHZ7uEkGid71M3QOYmoZs01FUidj0LdGI4yRzQUWR

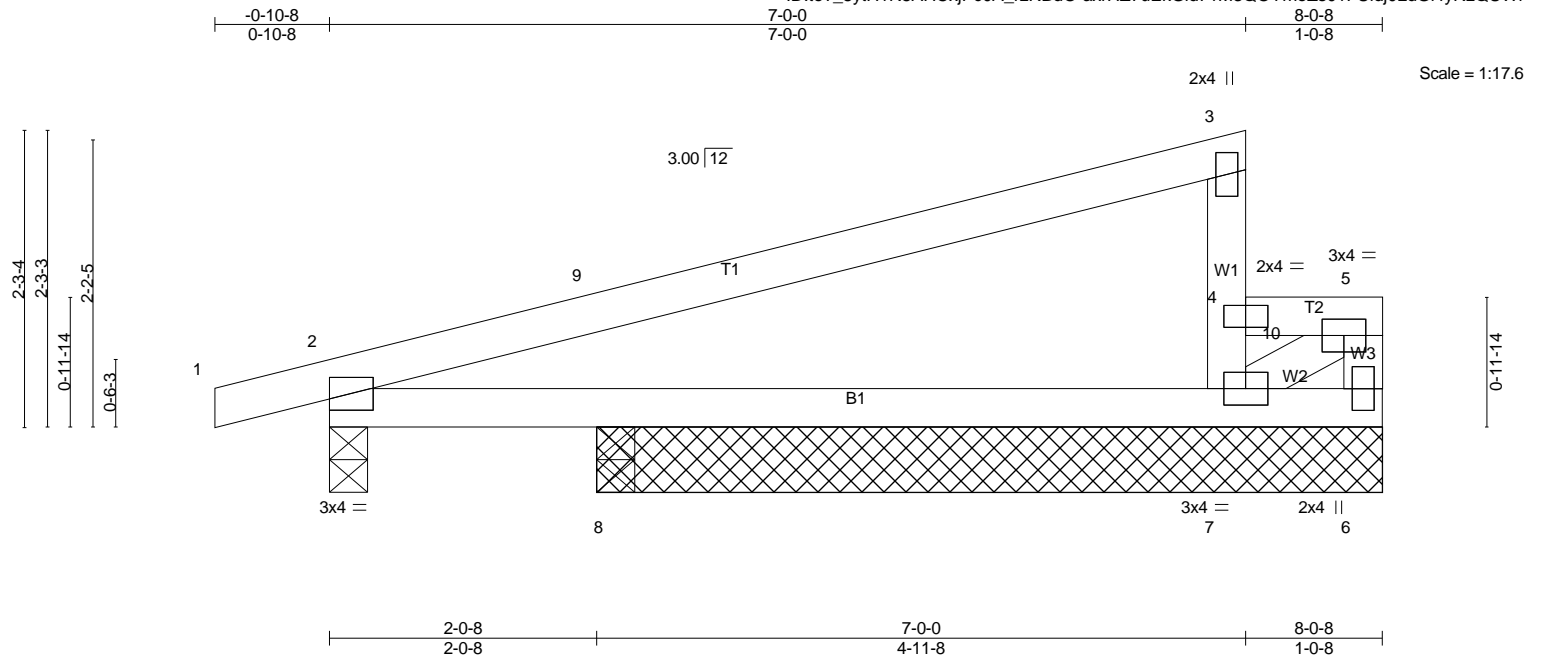

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.71	Vert(LL) -0.01	7-8	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.67	Vert(CT) -0.02	7-8	>999	180		
BCLL 0.0 *	Rep Stress Incr NO	WB 0.01	Horz(CT) -0.00	6	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-P						
							Weight: 30 lb	FT = 0%

**LUMBER-**

TOP CHORD 2x4 SP SS \*Except\*  
 T2: 2x4 SP No.2  
 BOT CHORD 2x4 SP No.2  
 WEBS 2x4 SP No.3

**BRACING-**  
 TOP CHORD  
 Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
 BOT CHORD  
 Rigid ceiling directly applied or 6-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** All bearings 6-0-0 except (jt=length)  
 2=0-3-8, 8=0-3-8.  
 (lb) - Max Horz  
 2= 101(LC 14)  
 Max Uplift  
 All uplift 100 lb or less at joint(s)  
 except 2=118(LC 10)  
 Max Grav  
 All reactions 250 lb or less at joint(s)  
 6, 8 except 7=649(LC 36), 2=403(LC 36)

**FORCES.** (lb)  
 Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD  
 4-7=-558/0, 3-4=-293/100, 5-6=-253/0

**NOTES-** (13-14)  
 1) Unbalanced roof live loads have been considered for this design.  
 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=5.0psf; BCDL=5.0psf; h=23ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60  
 3) C-C wind load user defined.

- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 1-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 118 lb uplift at joint 2.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Load case(s) 1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 14, 15, 16, 17, 18, 19, 20, 21, 22, 23, 24, 25, 26, 27, 28, 29, 30, 31, 32, 33, 34, 35, 36, 37, 38, 39, 40, 41, 42, 43, 44, 45, 46, 47, 48, 49, 50, 51, 52 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
- Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

- LOAD CASE(S)**  
 Standard Except:
- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15  
 Uniform Loads (plf)  
 Vert: 1-3=-60, 4-5=-260, 2-6=-20  
 Concentrated Loads (lb)  
 Vert: 10=-250
  - Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
 Uniform Loads (plf)  
 Vert: 1-3=-60, 4-5=-260, 2-6=-20  
 Concentrated Loads (lb)  
 Vert: 10=-250
  - Dead + 0.75 Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
 Uniform Loads (plf)  
 Vert: 1-3=-50, 4-5=-250, 2-6=-20  
 Concentrated Loads (lb)  
 Vert: 10=-250
  - Dead + 0.75 Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15  
 Uniform Loads (plf)  
 Vert: 1-3=-50, 4-5=-250, 2-6=-20  
 Concentrated Loads (lb)  
 Vert: 10=-250
  - Dead + 0.75 Snow (Unbal. Left): Lumber Increase=1.15, Plate Increase=1.15  
 Uniform Loads (plf)  
 Vert: 1-9=-50, 3-9=-56, 4-5=-229, 2-6=-20  
 Concentrated Loads (lb)  
 Vert: 10=-250
  - Dead + 0.75 Snow (Unbal. Right): Lumber Increase=1.15, Plate Increase=1.15  
 Uniform Loads (plf)  
 Vert: 1-3=-29, 4-5=-263, 2-6=-20  
 Concentrated Loads (lb)  
 Vert: 10=-250
  - Dead + Uninhabitable Attic Without Storage:  
 Lumber Increase=1.25, Plate Increase=1.25  
 Uniform Loads (plf)

Job	Truss	Truss Type	Qty	Ply	LOT 157 CROSSING @ ANDERSON CREEK   357 TIMBER SKIP DRIVE SPP
22-2670-R01	R15	Half Hip	1	1	Job Reference (optional)

Atlantic Building Components, Moncks Corner, South Carolina

8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Apr 15 12:24:40 2022 Page 2  
ID:te?\_8ytH1N5AHCxjPc0A\_rzRbD0-axrHZ7uEkGid71M3QOYmZs01FUidj0LdGI4yRzQUWR

**LOAD CASE(S)**

- |   |   |   |
|---|---|---|
| <p>Standard Except:<br/>Uniform Loads (plf)<br/>Vert: 1-3=-20, 4-5=-220, 2-6=-40<br/>Concentrated Loads (lb)<br/>Vert: 10=-250</p> <p>8) Dead + 0.6 C-C Wind (Pos. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-10, 2-3=-5, 4-5=-205, 2-6=-10<br/>Horz: 2-3=-5, 3-4=-42, 5-6=35<br/>Concentrated Loads (lb)<br/>Vert: 10=-250</p> <p>9) Dead + 0.6 C-C Wind (Neg. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-4, 2-3=-41, 4-5=-241, 2-6=-20<br/>Horz: 2-3=21, 3-4=21, 5-6=-32<br/>Drag: 1-2=0<br/>Concentrated Loads (lb)<br/>Vert: 10=-250</p> <p>10) Dead + 0.6 MWFRS Wind (Pos. Internal) Left:<br/>Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=38, 2-3=26, 4-5=-190, 2-6=-10<br/>Horz: 2-3=-36, 3-4=15, 5-6=19<br/>Drag: 1-2=0<br/>Concentrated Loads (lb)<br/>Vert: 10=-250</p> <p>11) Dead + 0.6 MWFRS Wind (Pos. Internal) Right:<br/>Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=8, 2-3=13, 4-5=-174, 2-6=-10<br/>Horz: 2-3=-23, 3-4=-19, 5-6=-15<br/>Drag: 1-2=0<br/>Concentrated Loads (lb)<br/>Vert: 10=-250</p> <p>12) Dead + 0.6 MWFRS Wind (Neg. Internal) Left:<br/>Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=11, 2-3=6, 4-5=-210, 2-6=-20<br/>Horz: 2-3=-26, 3-4=25, 5-6=9<br/>Drag: 1-2=0<br/>Concentrated Loads (lb)<br/>Vert: 10=-250</p> <p>13) Dead + 0.6 MWFRS Wind (Neg. Internal) Right:<br/>Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-2, 2-3=-7, 4-5=-194, 2-6=-20<br/>Horz: 2-3=-13, 3-4=-9, 5-6=-25<br/>Drag: 1-2=0<br/>Concentrated Loads (lb)<br/>Vert: 10=-250</p> <p>14) Dead + 0.6 MWFRS Wind (Pos. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=21, 2-3=26, 4-5=-190, 2-6=-10<br/>Horz: 2-3=-36, 3-4=-36, 5-6=17<br/>Drag: 1-2=0<br/>Concentrated Loads (lb)<br/>Vert: 10=-250</p> <p>15) Dead + 0.6 MWFRS Wind (Pos. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=5, 2-3=10, 4-5=-174, 2-6=-10<br/>Horz: 2-3=-20, 3-4=-20, 5-6=-12<br/>Concentrated Loads (lb)<br/>Vert: 10=-250</p> <p>16) Dead + 0.6 MWFRS Wind (Pos. Internal) 3rd Parallel: Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=21, 2-3=26, 4-5=-190, 2-6=-10<br/>Horz: 2-3=-36, 3-4=-36, 5-6=17<br/>Drag: 1-2=0<br/>Concentrated Loads (lb)<br/>Vert: 10=-250</p> <p>17) Dead + 0.6 MWFRS Wind (Pos. Internal) 4th Parallel: Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)</p> | <p>Standard Except:<br/>Vert: 1-2=5, 2-3=10, 4-5=-174, 2-6=-10<br/>Horz: 2-3=-20, 3-4=-20, 5-6=-12<br/>Concentrated Loads (lb)<br/>Vert: 10=-250</p> <p>18) Dead + 0.6 MWFRS Wind (Neg. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=11, 2-3=6, 4-5=-210, 2-6=-20<br/>Horz: 2-3=-26, 3-4=-26, 5-6=7<br/>Drag: 1-2=0<br/>Concentrated Loads (lb)<br/>Vert: 10=-250</p> <p>19) Dead + 0.6 MWFRS Wind (Neg. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-5, 2-3=-10, 4-5=-194, 2-6=-20<br/>Horz: 2-3=-10, 3-4=-10, 5-6=-23<br/>Concentrated Loads (lb)<br/>Vert: 10=-250</p> <p>20) Dead + Snow on Overhangs: Lumber Increase=1.15, Plate Increase=1.15<br/>Uniform Loads (plf)<br/>Vert: 1-2=-100, 2-3=-20, 4-5=-220, 2-6=-20<br/>Concentrated Loads (lb)<br/>Vert: 10=-250</p> <p>21) Dead + Snow (Unbal. Left): Lumber Increase=1.15, Plate Increase=1.15<br/>Uniform Loads (plf)<br/>Vert: 1-9=-60, 3-9=-68, 4-5=-232, 2-6=-20<br/>Concentrated Loads (lb)<br/>Vert: 10=-250</p> <p>22) Dead + Snow (Unbal. Right): Lumber Increase=1.15, Plate Increase=1.15<br/>Uniform Loads (plf)<br/>Vert: 1-3=-32, 4-5=-277, 2-6=-20<br/>Concentrated Loads (lb)<br/>Vert: 10=-250</p> <p>23) Dead: Lumber Increase=0.90, Plate Increase=0.90<br/>Plt. metal=0.90<br/>Uniform Loads (plf)<br/>Vert: 1-3=-20, 4-5=-220, 2-6=-20<br/>Concentrated Loads (lb)<br/>Vert: 10=-250</p> <p>24) Dead + 0.75 Snow (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) Left): Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-27, 2-3=-31, 4-5=-242, 2-6=-20<br/>Horz: 2-3=-19, 3-4=19, 5-6=6<br/>Drag: 1-2=0<br/>Concentrated Loads (lb)<br/>Vert: 10=-250</p> <p>25) Dead + 0.75 Snow (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) Right): Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-37, 2-3=-40, 4-5=-231, 2-6=-20<br/>Horz: 2-3=-10, 3-4=-6, 5-6=-19<br/>Concentrated Loads (lb)<br/>Vert: 10=-250</p> <p>26) Dead + 0.75 Snow (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-27, 2-3=-31, 4-5=-242, 2-6=-20<br/>Horz: 2-3=-19, 3-4=-19, 5-6=5<br/>Drag: 1-2=0<br/>Concentrated Loads (lb)<br/>Vert: 10=-250</p> <p>27) Dead + 0.75 Snow (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-39, 2-3=-42, 4-5=-231, 2-6=-20<br/>Horz: 2-3=-8, 3-4=-8, 5-6=-17</p> | <p>Standard Except:<br/>Concentrated Loads (lb)<br/>Vert: 10=-250</p> <p>28) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) Left): Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-27, 2-3=-31, 4-5=-242, 2-6=-20<br/>Horz: 2-3=-19, 3-4=19, 5-6=6<br/>Drag: 1-2=0<br/>Concentrated Loads (lb)<br/>Vert: 10=-250</p> <p>29) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) Right): Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-37, 2-3=-40, 4-5=-231, 2-6=-20<br/>Horz: 2-3=-10, 3-4=-6, 5-6=-19<br/>Concentrated Loads (lb)<br/>Vert: 10=-250</p> <p>30) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-27, 2-3=-31, 4-5=-242, 2-6=-20<br/>Horz: 2-3=-19, 3-4=-19, 5-6=5<br/>Drag: 1-2=0<br/>Concentrated Loads (lb)<br/>Vert: 10=-250</p> <p>31) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-39, 2-3=-42, 4-5=-231, 2-6=-20<br/>Horz: 2-3=-8, 3-4=-8, 5-6=-17<br/>Concentrated Loads (lb)<br/>Vert: 10=-250</p> <p>32) Dead + Minimum Snow: Lumber Increase=1.15, Plate Increase=1.15<br/>Uniform Loads (plf)<br/>Vert: 1-3=-60, 4-5=-260, 2-6=-20<br/>Concentrated Loads (lb)<br/>Vert: 10=-250</p> <p>33) Dead + 0.6 C-C Wind Min. Down: Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=6, 2-3=-26, 4-5=-226, 2-6=-10<br/>Horz: 2-3=16, 3-4=16, 5-6=-16<br/>Drag: 1-2=0</p> <p>34) Dead + 0.6 C-C Wind Min. Upward: Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-3=6, 4-5=-194, 2-6=-10<br/>Horz: 2-3=-16, 3-4=-16, 5-6=16<br/>Drag: 1-2=0</p> <p>35) 3rd Unbal. Dead + Snow (balanced) + Parallel: Lumber Increase=1.15, Plate Increase=1.15<br/>Uniform Loads (plf)<br/>Vert: 1-3=-32, 4-5=-289, 2-6=-20<br/>Concentrated Loads (lb)<br/>Vert: 10=-250</p> <p>36) 4th Unbal. Dead + Snow (balanced) + Parallel: Lumber Increase=1.15, Plate Increase=1.15<br/>Uniform Loads (plf)<br/>Vert: 1-3=-89, 4-5=-232, 2-6=-20<br/>Concentrated Loads (lb)<br/>Vert: 10=-250</p> <p>37) 5th Unbal. Dead + 0.75 Snow (balanced) + Parallel: Lumber Increase=1.15, Plate Increase=1.15<br/>Uniform Loads (plf)<br/>Vert: 1-3=-29, 4-5=-272, 2-6=-20<br/>Concentrated Loads (lb)<br/>Vert: 10=-250</p> <p>38) 6th Unbal. Dead + 0.75 Snow (balanced) + Parallel: Lumber Increase=1.15, Plate Increase=1.15<br/>Uniform Loads (plf)<br/>Vert: 1-3=-72, 4-5=-229, 2-6=-20<br/>Concentrated Loads (lb)</p> |
|---|---|---|

Continued on page 3




Job	Truss	Truss Type	Qty	Ply	LOT 157 CROSSING @ ANDERSON CREEK   357 TIMBER SKIP DRIVE SPP
22-2670-R01	R15	Half Hip	1	1	Job Reference (optional)

Atlantic Building Components, Moncks Corner, South Carolina


8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Apr 15 12:24:40 2022 Page 3  
ID:te?\_8ytH1N5AHCxjPc0A\_rzRBd0-axrHZ7uEkGid71M3QOYmoZs01FUiidj0LdGI4yRzQUWr

**LOAD CASE(S)**

- |  |   |
|--|---|
| <p>Concentrated Loads (lb)<br/>Vert: 10=-250</p> <p>39) 7th Unbal.Dead + 0.75 Snow (unbal.) + 0.75(0.6 MWFRS Wind (Neg. Int) Left) + Parallel: Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-6, 2-3=-10, 4-5=-264, 2-6=-20<br/>Horz: 2-3=-19, 3-4=19, 5-6=6<br/>Drag: 1-2=0<br/>Concentrated Loads (lb)<br/>Vert: 10=-250</p> <p>40) 8th Unbal.Dead + 0.75 Snow (unbal.) + 0.75(0.6 MWFRS Wind (Neg. Int) Left) + Parallel: Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-49, 2-3=-53, 4-5=-221, 2-6=-20<br/>Horz: 2-3=-19, 3-4=19, 5-6=6<br/>Drag: 1-2=0<br/>Concentrated Loads (lb)<br/>Vert: 10=-250</p> <p>41) 9th Unbal.Dead + 0.75 Snow (unbal.) + 0.75(0.6 MWFRS Wind (Neg. Int) Right) + Parallel: Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-16, 2-3=-19, 4-5=-253, 2-6=-20<br/>Horz: 2-3=-10, 3-4=-6, 5-6=-19<br/>Concentrated Loads (lb)<br/>Vert: 10=-250</p> <p>42) 10th Unbal.Dead + 0.75 Snow (unbal.) + 0.75(0.6 MWFRS Wind (Neg. Int) Right) + Parallel: Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-58, 2-3=-62, 4-5=-210, 2-6=-20<br/>Horz: 2-3=-10, 3-4=-6, 5-6=-19<br/>Concentrated Loads (lb)<br/>Vert: 10=-250</p> <p>43) 11th Unbal.Dead + 0.75 Snow (unbal.) + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-6, 2-3=-10, 4-5=-264, 2-6=-20<br/>Horz: 2-3=-19, 3-4=-19, 5-6=5<br/>Drag: 1-2=0<br/>Concentrated Loads (lb)<br/>Vert: 10=-250</p> <p>44) 12th Unbal.Dead + 0.75 Snow (unbal.) + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-49, 2-3=-53, 4-5=-221, 2-6=-20<br/>Horz: 2-3=-19, 3-4=-19, 5-6=5<br/>Drag: 1-2=0<br/>Concentrated Loads (lb)<br/>Vert: 10=-250</p> <p>45) 13th Unbal.Dead + 0.75 Snow (unbal.) + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-18, 2-3=-21, 4-5=-253, 2-6=-20<br/>Horz: 2-3=-8, 3-4=-8, 5-6=-17<br/>Concentrated Loads (lb)<br/>Vert: 10=-250</p> <p>46) 14th Unbal.Dead + 0.75 Snow (unbal.) + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-61, 2-3=-64, 4-5=-210, 2-6=-20<br/>Horz: 2-3=-8, 3-4=-8, 5-6=-17<br/>Concentrated Loads (lb)<br/>Vert: 10=-250</p> <p>47) 15th Unbal.Dead + Minimum Snow + Parallel: Lumber Increase=1.15, Plate Increase=1.15<br/>Uniform Loads (plf)<br/>Vert: 1-3=-32, 4-5=-289, 2-6=-20<br/>Concentrated Loads (lb)<br/>Vert: 10=-250</p> <p>48) 16th Unbal.Dead + Minimum Snow + Parallel: Lumber Increase=1.15, Plate Increase=1.15</p> | <p>Uniform Loads (plf)<br/>Vert: 1-3=-89, 4-5=-232, 2-6=-20<br/>Concentrated Loads (lb)<br/>Vert: 10=-250</p> <p>49) 1st Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15<br/>Uniform Loads (plf)<br/>Vert: 1-3=-60, 4-5=-220, 2-6=-20<br/>Concentrated Loads (lb)<br/>Vert: 10=-250</p> <p>50) 2nd Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15<br/>Uniform Loads (plf)<br/>Vert: 1-3=-20, 4-5=-260, 2-6=-20<br/>Concentrated Loads (lb)<br/>Vert: 10=-250</p> <p>51) 3rd Dead + 0.75 Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15<br/>Uniform Loads (plf)<br/>Vert: 1-3=-50, 4-5=-220, 2-6=-20<br/>Concentrated Loads (lb)<br/>Vert: 10=-250</p> <p>52) 4th Dead + 0.75 Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15<br/>Uniform Loads (plf)<br/>Vert: 1-3=-20, 4-5=-250, 2-6=-20<br/>Concentrated Loads (lb)<br/>Vert: 10=-250</p> |
|--|---|



Scale = 1:18.1

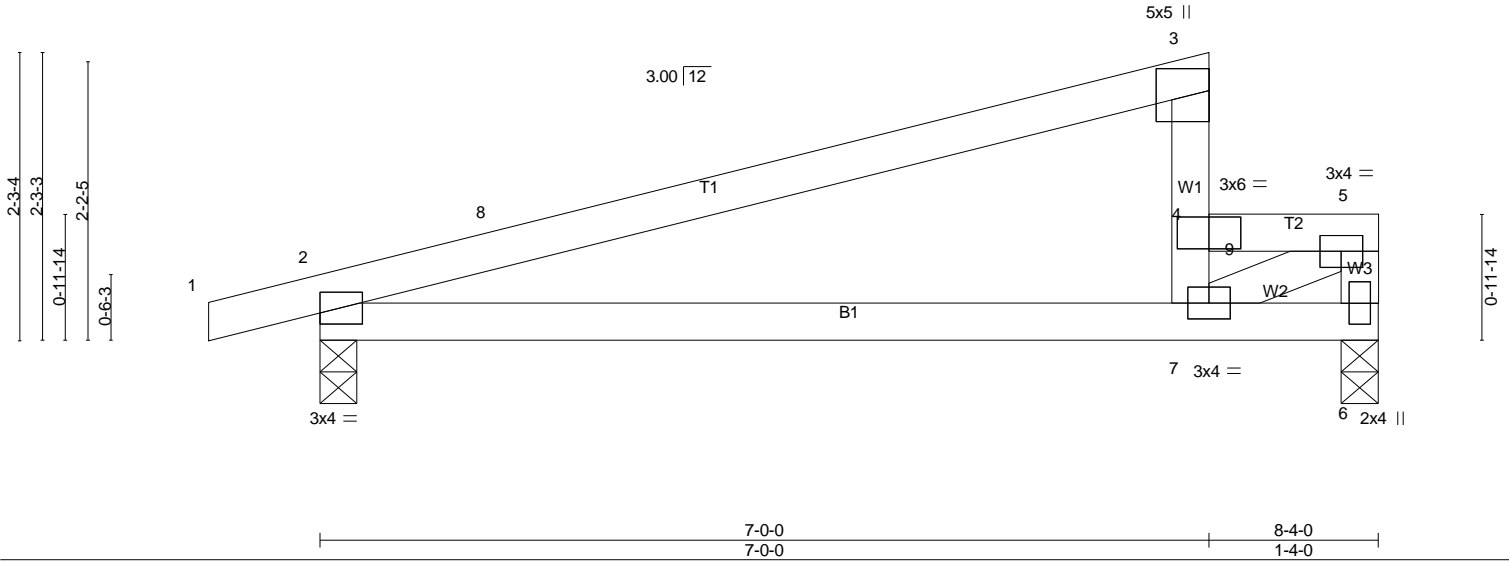

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.95	Vert(LL) -0.08	2-7	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.62	Vert(CT) -0.17	2-7	>567	180		
BCLL 0.0 *	Rep Stress Incr NO	WB 0.36	Horz(CT) 0.01	6	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-SH						
							Weight: 31 lb	FT = 0%

**LUMBER-**

TOP CHORD 2x4 SP No.1 \*Except\*  
 T2: 2x4 SP No.2  
 BOT CHORD 2x4 SP No.2  
 WEBS 2x4 SP No.3 \*Except\*  
 W1: 2x4 SP No.2

**BRACING-**

TOP CHORD  
 Structural wood sheathing directly applied or 5-8-14 oc purlins, except end verticals.  
 BOT CHORD  
 Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** (lb/size)

6 = 633/0-3-8 (min. 0-1-8)  
 2 = 420/0-3-8 (min. 0-1-8)  
 Max Horz  
 2 = 101(LC 14)  
 Max Uplift  
 2 = -65(LC 10)  
 Max Grav  
 6 = 679(LC 36)  
 2 = 563(LC 36)

**FORCES.** (lb)

Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD  
 2-8=-607/0, 3-8=-526/0, 4-7=-264/0,  
 4-9=-870/0, 5-9=-870/0, 5-6=-689/0  
 BOT CHORD  
 2-7=0/506  
 WEBS  
 5-7=0/862

**NOTES-** (12-13)

1) Unbalanced roof live loads have been considered for this design.

2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=5.0psf; BCDL=5.0psf; h=23ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-10-8 to 8-2-4 zone; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60  
 3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10  
 4) Unbalanced snow loads have been considered for this design.  
 5) This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.  
 6) Provide adequate drainage to prevent water ponding.  
 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.  
 8) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 1-0-0 wide will fit between the bottom chord and any other members.  
 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 65 lb uplift at joint 2.  
 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.  
 11) Load case(s) 1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 14, 15, 16, 17, 18, 19, 20, 21, 22, 23, 24, 25, 26, 27, 28, 29, 30, 31, 32, 33, 34, 35, 36, 37, 38, 39, 40, 41, 42, 43, 44, 45, 46, 47, 48, 49, 50, 51, 52 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.

12) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.  
 13) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

**LOAD CASE(S)**

Standard  
 1) Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15  
 Uniform Loads (plf)  
 Vert: 1-3=-60, 4-9=-60, 5-9=-170, 2-6=-20  
 Concentrated Loads (lb)  
 Vert: 9=-250  
 2) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
 Uniform Loads (plf)  
 Vert: 1-3=-60, 4-9=-60, 5-9=-170, 2-6=-20  
 Concentrated Loads (lb)  
 Vert: 9=-250  
 3) Dead + 0.75 Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
 Uniform Loads (plf)  
 Vert: 1-3=-50, 4-9=-50, 5-9=-160, 2-6=-20  
 Concentrated Loads (lb)  
 Vert: 9=-250  
 4) Dead + 0.75 Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15  
 Uniform Loads (plf)  
 Vert: 1-3=-50, 4-9=-50, 5-9=-160, 2-6=-20  
 Concentrated Loads (lb)  
 Vert: 9=-250  
 5) Dead + 0.75 Snow (Unbal. Left): Lumber Increase=1.15, Plate Increase=1.15  
 Uniform Loads (plf)  
 Vert: 1-8=-50, 3-8=-57, 4-9=-29, 5-9=-139, 2-6=-20  
 Concentrated Loads (lb)  
 Vert: 9=-250

Job	Truss	Truss Type	Qty	Ply	LOT 157 CROSSING @ ANDERSON CREEK   357 TIMBER SKIP DRIVE SPP
22-2670-R01	R16	Half Hip	3	1	Job Reference (optional)

Atlantic Building Components, Moncks Corner, South Carolina

8,430 s Feb 12 2021 MiTek Industries, Inc. Fri Apr 15 12:24:44 2022 Page 2  
ID:te?\_8yH1N5AHCxjPc0A\_rzRBdO-Si5oPVkoVC3cegqfEdjyP1flssTZRWwYujH5CzQUWn

**LOAD CASE(S)**

- |   |   |   |
|---|---|---|
| <p>Standard</p> <p>6) Dead + 0.75 Snow (Unbal. Right): Lumber Increase=1.15, Plate Increase=1.15<br/>Uniform Loads (plf)<br/>Vert: 1-3=-29, 4-9=-63, 5-9=-173, 2-6=-20<br/>Concentrated Loads (lb)<br/>Vert: 9=-250</p> <p>7) Dead + Uninhabitable Attic Without Storage: Lumber Increase=1.25, Plate Increase=1.25<br/>Uniform Loads (plf)<br/>Vert: 1-3=-20, 4-9=-20, 5-9=-130, 2-6=-40<br/>Concentrated Loads (lb)<br/>Vert: 9=-250</p> <p>8) Dead + 0.6 C-C Wind (Pos. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-10, 2-3=-5, 4-9=-5, 5-9=-115, 2-6=-10<br/>Horz: 2-3=-5, 3-4=-42, 5-6=35<br/>Concentrated Loads (lb)<br/>Vert: 9=-250</p> <p>9) Dead + 0.6 C-C Wind (Neg. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-4, 2-3=-41, 4-9=-41, 5-9=-151, 2-6=-20<br/>Horz: 2-3=21, 3-4=21, 5-6=-32<br/>Drag: 1-2=0<br/>Concentrated Loads (lb)<br/>Vert: 9=-250</p> <p>10) Dead + 0.6 MWFRS Wind (Pos. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=38, 2-3=26, 4-9=10, 5-9=-100, 2-6=-10<br/>Horz: 2-3=-36, 3-4=15, 5-6=19<br/>Drag: 1-2=0<br/>Concentrated Loads (lb)<br/>Vert: 9=-250</p> <p>11) Dead + 0.6 MWFRS Wind (Pos. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=8, 2-3=13, 4-9=26, 5-9=-84, 2-6=-10<br/>Horz: 2-3=-23, 3-4=-19, 5-6=-15<br/>Drag: 1-2=0<br/>Concentrated Loads (lb)<br/>Vert: 9=-250</p> <p>12) Dead + 0.6 MWFRS Wind (Neg. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=11, 2-3=6, 4-9=10, 5-9=-120, 2-6=-20<br/>Horz: 2-3=-26, 3-4=25, 5-6=9<br/>Drag: 1-2=0<br/>Concentrated Loads (lb)<br/>Vert: 9=-250</p> <p>13) Dead + 0.6 MWFRS Wind (Neg. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-2, 2-3=-7, 4-9=6, 5-9=-104, 2-6=-20<br/>Horz: 2-3=-13, 3-4=-9, 5-6=-25<br/>Drag: 1-2=0<br/>Concentrated Loads (lb)<br/>Vert: 9=-250</p> <p>14) Dead + 0.6 MWFRS Wind (Pos. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=21, 2-3=26, 4-9=10, 5-9=-100, 2-6=-10<br/>Horz: 2-3=-36, 3-4=-36, 5-6=17<br/>Drag: 1-2=0<br/>Concentrated Loads (lb)<br/>Vert: 9=-250</p> <p>15) Dead + 0.6 MWFRS Wind (Pos. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=5, 2-3=10, 4-9=26, 5-9=-84, 2-6=-10<br/>Horz: 2-3=-20, 3-4=-20, 5-6=-12<br/>Concentrated Loads (lb)<br/>Vert: 9=-250</p> <p>16) Dead + 0.6 MWFRS Wind (Pos. Internal) 3rd Parallel: Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)</p> | <p>Standard</p> <p>17) Dead + 0.6 MWFRS Wind (Pos. Internal) 4th Parallel: Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=5, 2-3=10, 4-9=26, 5-9=-84, 2-6=-10<br/>Horz: 2-3=-20, 3-4=-20, 5-6=-12<br/>Concentrated Loads (lb)<br/>Vert: 9=-250</p> <p>18) Dead + 0.6 MWFRS Wind (Neg. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=11, 2-3=6, 4-9=-10, 5-9=-120, 2-6=-20<br/>Horz: 2-3=-26, 3-4=-26, 5-6=7<br/>Drag: 1-2=0<br/>Concentrated Loads (lb)<br/>Vert: 9=-250</p> <p>19) Dead + 0.6 MWFRS Wind (Neg. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-5, 2-3=-10, 4-9=6, 5-9=-104, 2-6=-20<br/>Horz: 2-3=-10, 3-4=-10, 5-6=-23<br/>Concentrated Loads (lb)<br/>Vert: 9=-250</p> <p>20) Dead + Snow on Overhangs: Lumber Increase=1.15, Plate Increase=1.15<br/>Uniform Loads (plf)<br/>Vert: 1-2=-100, 2-3=-20, 4-9=-20, 5-9=-130, 2-6=-20<br/>Concentrated Loads (lb)<br/>Vert: 9=-250</p> <p>21) Dead + Snow (Unbal. Left): Lumber Increase=1.15, Plate Increase=1.15<br/>Uniform Loads (plf)<br/>Vert: 1-8=-60, 3-8=-69, 4-9=-32, 5-9=-142, 2-6=-20<br/>Concentrated Loads (lb)<br/>Vert: 9=-250</p> <p>22) Dead + Snow (Unbal. Right): Lumber Increase=1.15, Plate Increase=1.15<br/>Uniform Loads (plf)<br/>Vert: 1-3=-32, 4-9=-77, 5-9=-187, 2-6=-20<br/>Concentrated Loads (lb)<br/>Vert: 9=-250</p> <p>23) Dead: Lumber Increase=0.90, Plate Increase=0.90<br/>Plt. metal=0.90<br/>Uniform Loads (plf)<br/>Vert: 1-3=-20, 4-9=-20, 5-9=-130, 2-6=-20<br/>Concentrated Loads (lb)<br/>Vert: 9=-250</p> <p>24) Dead + 0.75 Snow (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) Left): Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-27, 2-3=-31, 4-9=-42, 5-9=-152, 2-6=-20<br/>Horz: 2-3=-19, 3-4=19, 5-6=6<br/>Drag: 1-2=0<br/>Concentrated Loads (lb)<br/>Vert: 9=-250</p> <p>25) Dead + 0.75 Snow (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) Right): Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-37, 2-3=-40, 4-9=-31, 5-9=-141, 2-6=-20<br/>Horz: 2-3=-10, 3-4=-6, 5-6=-19<br/>Concentrated Loads (lb)<br/>Vert: 9=-250</p> <p>26) Dead + 0.75 Snow (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)</p> | <p>Standard</p> <p>27) Dead + 0.75 Snow (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-39, 2-3=-42, 4-9=-31, 5-9=-141, 2-6=-20<br/>Horz: 2-3=-8, 3-4=-8, 5-6=-17<br/>Concentrated Loads (lb)<br/>Vert: 9=-250</p> <p>28) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) Left): Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-27, 2-3=-31, 4-9=-42, 5-9=-152, 2-6=-20<br/>Horz: 2-3=-19, 3-4=19, 5-6=6<br/>Drag: 1-2=0<br/>Concentrated Loads (lb)<br/>Vert: 9=-250</p> <p>29) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) Right): Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-37, 2-3=-40, 4-9=-31, 5-9=-141, 2-6=-20<br/>Horz: 2-3=-10, 3-4=-6, 5-6=-19<br/>Concentrated Loads (lb)<br/>Vert: 9=-250</p> <p>30) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-27, 2-3=-31, 4-9=-42, 5-9=-152, 2-6=-20<br/>Horz: 2-3=-19, 3-4=-19, 5-6=5<br/>Drag: 1-2=0<br/>Concentrated Loads (lb)<br/>Vert: 9=-250</p> <p>31) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-39, 2-3=-42, 4-9=-31, 5-9=-141, 2-6=-20<br/>Horz: 2-3=-8, 3-4=-8, 5-6=-17<br/>Concentrated Loads (lb)<br/>Vert: 9=-250</p> <p>32) Dead + Minimum Snow: Lumber Increase=1.15, Plate Increase=1.15<br/>Uniform Loads (plf)<br/>Vert: 1-3=-60, 4-9=-60, 5-9=-170, 2-6=-20<br/>Concentrated Loads (lb)<br/>Vert: 9=-250</p> <p>33) Dead + 0.6 C-C Wind Min. Down: Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=6, 2-3=-26, 4-9=-26, 5-9=-136, 2-6=-10<br/>Horz: 2-3=16, 3-4=16, 5-6=-16<br/>Drag: 1-2=0<br/>Concentrated Loads (lb)<br/>Vert: 9=-250</p> <p>34) Dead + 0.6 C-C Wind Min. Upward: Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-3=6, 4-9=6, 5-9=-104, 2-6=-10<br/>Horz: 2-3=-16, 3-4=-16, 5-6=16<br/>Drag: 1-2=0<br/>Concentrated Loads (lb)<br/>Vert: 9=-250</p> <p>35) 3rd Unbal. Dead + Snow (balanced) + Parallel: Lumber Increase=1.15, Plate Increase=1.15<br/>Uniform Loads (plf)<br/>Vert: 1-3=-32, 4-9=-89, 5-9=-199, 2-6=-20<br/>Concentrated Loads (lb)<br/>Vert: 9=-250</p> <p>36) 4th Unbal. Dead + Snow (balanced) + Parallel: Lumber Increase=1.15, Plate Increase=1.15</p> |
|---|---|---|

Continued on page 3

Job	Truss	Truss Type	Qty	Ply	LOT 157 CROSSING @ ANDERSON CREEK   357 TIMBER SKIP DRIVE SPP
22-2670-R01	R16	Half Hip	3	1	Job Reference (optional)

Atlantic Building Components, Moncks Corner, South Carolina

8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Apr 15 12:24:44 2022 Page 3  
ID:te?\_8ytH1N5AHCxjPc0A\_rzRBdO-Si5oPVkxVC3cegqfEdiyP1flssTZRWwYujH5CzQUWw


### LOAD CASE(S)

- |  |   |
|--|---|
| <p><b>Standard</b><br/>Uniform Loads (plf)<br/>Vert: 1-3=-89, 4-9=-32, 5-9=-142, 2-6=-20<br/>Concentrated Loads (lb)<br/>Vert: 9=-250</p> <p>37) 5th Unbal.Dead + 0.75 Snow (balanced) + Parallel:<br/>Lumber Increase=1.15, Plate Increase=1.15<br/>Uniform Loads (plf)<br/>Vert: 1-3=-29, 4-9=-72, 5-9=-182, 2-6=-20<br/>Concentrated Loads (lb)<br/>Vert: 9=-250</p> <p>38) 6th Unbal.Dead + 0.75 Snow (balanced) + Parallel:<br/>Lumber Increase=1.15, Plate Increase=1.15<br/>Uniform Loads (plf)<br/>Vert: 1-3=-72, 4-9=-29, 5-9=-139, 2-6=-20<br/>Concentrated Loads (lb)<br/>Vert: 9=-250</p> <p>39) 7th Unbal.Dead + 0.75 Snow (unbal.) + 0.75(0.6<br/>MWFRS Wind (Neg. Int) Left) + Parallel: Lumber<br/>Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-6, 2-3=-10, 4-9=-64, 5-9=-174, 2-6=-20<br/>Horz: 2-3=-19, 3-4=19, 5-6=6<br/>Drag: 1-2=0<br/>Concentrated Loads (lb)<br/>Vert: 9=-250</p> <p>40) 8th Unbal.Dead + 0.75 Snow (unbal.) + 0.75(0.6<br/>MWFRS Wind (Neg. Int) Left) + Parallel: Lumber<br/>Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-49, 2-3=-53, 4-9=-21, 5-9=-131, 2-6=-20<br/>Horz: 2-3=-19, 3-4=19, 5-6=6<br/>Drag: 1-2=0<br/>Concentrated Loads (lb)<br/>Vert: 9=-250</p> <p>41) 9th Unbal.Dead + 0.75 Snow (unbal.) + 0.75(0.6<br/>MWFRS Wind (Neg. Int) Right) + Parallel: Lumber<br/>Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-16, 2-3=-19, 4-9=-53, 5-9=-163, 2-6=-20<br/>Horz: 2-3=-10, 3-4=-6, 5-6=-19<br/>Concentrated Loads (lb)<br/>Vert: 9=-250</p> <p>42) 10th Unbal.Dead + 0.75 Snow (unbal.) + 0.75(0.6<br/>MWFRS Wind (Neg. Int) Right) + Parallel: Lumber<br/>Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-58, 2-3=-62, 4-9=-10, 5-9=-120, 2-6=-20<br/>Horz: 2-3=-10, 3-4=-6, 5-6=-19<br/>Concentrated Loads (lb)<br/>Vert: 9=-250</p> <p>43) 11th Unbal.Dead + 0.75 Snow (unbal.) + 0.75(0.6<br/>MWFRS Wind (Neg. Int) 1st Parallel): Lumber<br/>Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-6, 2-3=-10, 4-9=-64, 5-9=-174, 2-6=-20<br/>Horz: 2-3=-19, 3-4=-19, 5-6=5<br/>Drag: 1-2=0<br/>Concentrated Loads (lb)<br/>Vert: 9=-250</p> <p>44) 12th Unbal.Dead + 0.75 Snow (unbal.) + 0.75(0.6<br/>MWFRS Wind (Neg. Int) 1st Parallel): Lumber<br/>Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-49, 2-3=-53, 4-9=-21, 5-9=-131, 2-6=-20<br/>Horz: 2-3=-19, 3-4=-19, 5-6=5<br/>Drag: 1-2=0<br/>Concentrated Loads (lb)<br/>Vert: 9=-250</p> <p>45) 13th Unbal.Dead + 0.75 Snow (unbal.) + 0.75(0.6<br/>MWFRS Wind (Neg. Int) 2nd Parallel): Lumber<br/>Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-18, 2-3=-21, 4-9=-53, 5-9=-163, 2-6=-20<br/>Horz: 2-3=-8, 3-4=-8, 5-6=-17<br/>Concentrated Loads (lb)<br/>Vert: 9=-250</p> | <p><b>Standard</b><br/>46) 14th Unbal.Dead + 0.75 Snow (unbal.) + 0.75(0.6<br/>MWFRS Wind (Neg. Int) 2nd Parallel): Lumber<br/>Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-61, 2-3=-64, 4-9=-10, 5-9=-120, 2-6=-20<br/>Horz: 2-3=-8, 3-4=-8, 5-6=-17<br/>Concentrated Loads (lb)<br/>Vert: 9=-250</p> <p>47) 15th Unbal.Dead + Minimum Snow + Parallel:<br/>Lumber Increase=1.15, Plate Increase=1.15<br/>Uniform Loads (plf)<br/>Vert: 1-3=-32, 4-9=-89, 5-9=-199, 2-6=-20<br/>Concentrated Loads (lb)<br/>Vert: 9=-250</p> <p>48) 16th Unbal.Dead + Minimum Snow + Parallel:<br/>Lumber Increase=1.15, Plate Increase=1.15<br/>Uniform Loads (plf)<br/>Vert: 1-3=-89, 4-9=-32, 5-9=-142, 2-6=-20<br/>Concentrated Loads (lb)<br/>Vert: 9=-250</p> <p>49) 1st Dead + Roof Live (unbalanced): Lumber<br/>Increase=1.15, Plate Increase=1.15<br/>Uniform Loads (plf)<br/>Vert: 1-3=-60, 4-9=-20, 5-9=-130, 2-6=-20<br/>Concentrated Loads (lb)<br/>Vert: 9=-250</p> <p>50) 2nd Dead + Roof Live (unbalanced): Lumber<br/>Increase=1.15, Plate Increase=1.15<br/>Uniform Loads (plf)<br/>Vert: 1-3=-20, 4-9=-60, 5-9=-170, 2-6=-20<br/>Concentrated Loads (lb)<br/>Vert: 9=-250</p> <p>51) 3rd Dead + 0.75 Roof Live (unbalanced): Lumber<br/>Increase=1.15, Plate Increase=1.15<br/>Uniform Loads (plf)<br/>Vert: 1-3=-50, 4-9=-20, 5-9=-130, 2-6=-20<br/>Concentrated Loads (lb)<br/>Vert: 9=-250</p> <p>52) 4th Dead + 0.75 Roof Live (unbalanced): Lumber<br/>Increase=1.15, Plate Increase=1.15<br/>Uniform Loads (plf)<br/>Vert: 1-3=-20, 4-9=-50, 5-9=-160, 2-6=-20<br/>Concentrated Loads (lb)<br/>Vert: 9=-250</p> |
|--|---|

Job	Truss	Truss Type	Qty	Ply	LOT 157 CROSSING @ ANDERSON CREEK   357 TIMBER SKIP DRIVE SP
22-2670-R01	R16A	Half Hip	2	1	Job Reference (optional)

Atlantic Building Components, Moncks Corner, South Carolina

ID:te?\_8ytH1N5AHCxjPc0A\_rzRBdO-LTKJEs\_FrkjV5Gzbu4he6FBKRTe6VGNWSVhVE\_zQUWj  
8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Apr 15 12:24:48 2022 Page 1



Scale = 1:17.6

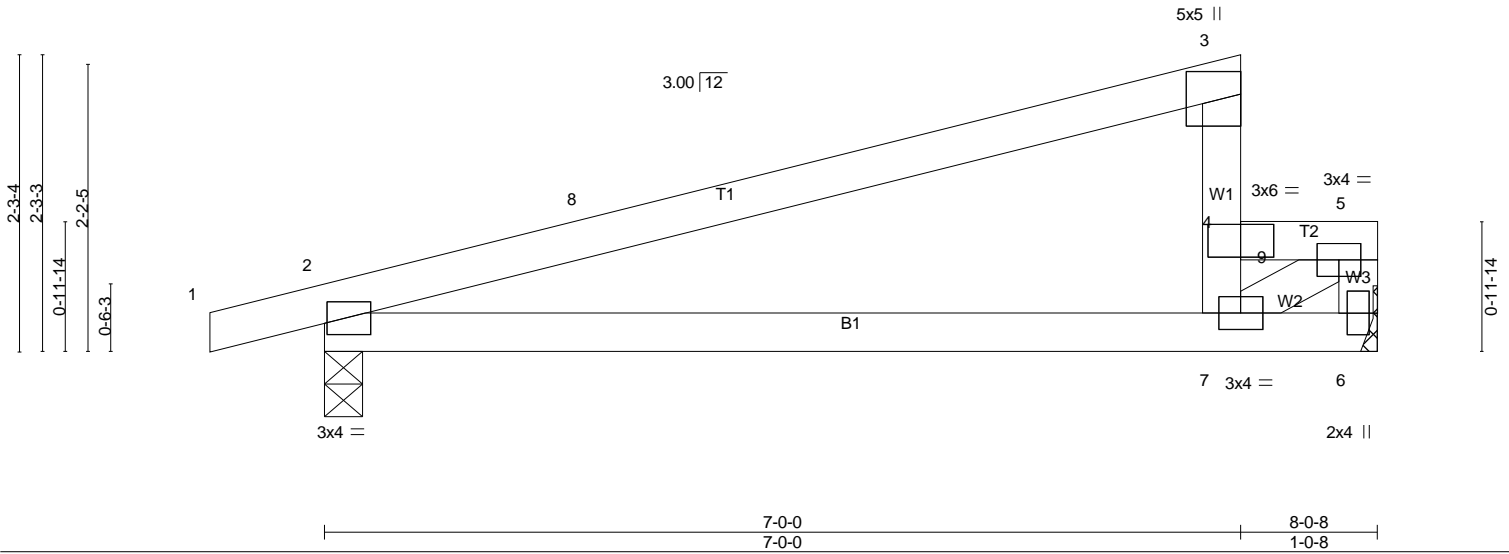


Plate Offsets (X,Y)-- [2:0-1-10,0-1-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 1.00	Vert(LL) -0.08	2-7	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.64	Vert(CT) -0.16	2-7	>575	180		
BCLL 0.0 *	Rep Stress Incr NO	WB 0.30	Horz(CT) 0.00	6	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-SH					Weight: 30 lb	FT = 0%

**LUMBER-**

TOP CHORD 2x4 SP No.2  
 BOT CHORD 2x4 SP No.2  
 WEBS 2x4 SP No.3 \*Except\*  
 W1: 2x4 SP No.2

**BRACING-**

TOP CHORD  
 Structural wood sheathing directly applied, except end verticals.  
 BOT CHORD  
 Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** (lb/size)

6 = 646/Mechanical  
 2 = 401/0-3-8 (min. 0-1-8)  
 Max Horz  
 2 = 101(LC 14)  
 Max Uplift  
 2 = -70(LC 10)  
 Max Grav  
 6 = 702(LC 36)  
 2 = 542(LC 36)

**FORCES.** (lb)

Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD  
 2-8=-542/0, 3-8=-460/0, 4-9=-694/0,  
 5-9=-694/0, 5-6=-743/0  
 BOT CHORD  
 2-7=0/442  
 WEBS  
 5-7=0/726

**NOTES-** (14-15)

1) Unbalanced roof live loads have been considered for this design.

- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=5.0psf; BCDL=5.0psf; h=23ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) C-C wind load user defined.
- 4) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- 5) Unbalanced snow loads have been considered for this design.
- 6) This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- 7) Provide adequate drainage to prevent water ponding.
- 8) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 9) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 1-0-0 wide will fit between the bottom chord and any other members.
- 10) Refer to girder(s) for truss to truss connections.
- 11) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 70 lb uplift at joint 2.
- 12) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 13) Load case(s) 1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 14, 15, 16, 17, 18, 19, 20, 21, 22, 23, 24, 25, 26, 27, 28, 29, 30, 31, 32, 33, 34, 35, 36, 37, 38, 39, 40, 41, 42, 43, 44, 45, 46, 47, 48, 49, 50, 51, 52 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.

- 14) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
- 15) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

**LOAD CASE(S)**

- Standard Except:
- 1) Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15  
 Uniform Loads (plf)  
 Vert: 1-3=-60, 4-9=-60, 5-9=-170, 2-6=-20  
 Concentrated Loads (lb)  
 Vert: 9=-300
  - 2) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
 Uniform Loads (plf)  
 Vert: 1-3=-60, 4-9=-60, 5-9=-170, 2-6=-20  
 Concentrated Loads (lb)  
 Vert: 9=-300
  - 3) Dead + 0.75 Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
 Uniform Loads (plf)  
 Vert: 1-3=-50, 4-9=-50, 5-9=-160, 2-6=-20  
 Concentrated Loads (lb)  
 Vert: 9=-300
  - 4) Dead + 0.75 Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15  
 Uniform Loads (plf)  
 Vert: 1-3=-50, 4-9=-50, 5-9=-160, 2-6=-20  
 Concentrated Loads (lb)  
 Vert: 9=-300
  - 5) Dead + 0.75 Snow (Unbal. Left): Lumber Increase=1.15, Plate Increase=1.15  
 Uniform Loads (plf)  
 Vert: 1-8=-50, 3-8=-56, 4-9=-29, 5-9=-139, 2-6=-20  
 Concentrated Loads (lb)

Job	Truss	Truss Type	Qty	Ply	LOT 157 CROSSING @ ANDERSON CREEK   357 TIMBER SKIP DRIVE SPP
22-2670-R01	R16A	Half Hip	2	1	Job Reference (optional)

Atlantic Building Components, Moncks Corner, South Carolina

8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Apr 15 12:24:48 2022 Page 2  
ID:te?\_8yhtH1N5AHCxjPc0A\_rzRBdO-LTKJEs\_FrkjV5Gzbu4he6FBKRTe6VGNWSVhV\_ezQUWj

**LOAD CASE(S)**

- |  |   |   |
|--|---|---|
| <p>Standard Except:<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>6) Dead + 0.75 Snow (Unbal. Right): Lumber Increase=1.15, Plate Increase=1.15<br/>Uniform Loads (plf)<br/>Vert: 1-3=-29, 4-9=-63, 5-9=-173, 2-6=-20<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>7) Dead + Uninhabitable Attic Without Storage: Lumber Increase=1.25, Plate Increase=1.25<br/>Uniform Loads (plf)<br/>Vert: 1-3=-20, 4-9=-20, 5-9=-130, 2-6=-40<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>8) Dead + 0.6 C-C Wind (Pos. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-10, 2-3=-5, 4-9=-5, 5-9=-115, 2-6=-10<br/>Horz: 2-3=-5, 3-4=-42, 5-6=35<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>9) Dead + 0.6 C-C Wind (Neg. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-4, 2-3=-41, 4-9=-41, 5-9=-151, 2-6=-20<br/>Horz: 2-3=21, 3-4=21, 5-6=-32<br/>Drag: 1-2=-0<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>10) Dead + 0.6 MWFRS Wind (Pos. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=38, 2-3=26, 4-9=10, 5-9=-100, 2-6=-10<br/>Horz: 2-3=-36, 3-4=15, 5-6=19<br/>Drag: 1-2=-0<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>11) Dead + 0.6 MWFRS Wind (Pos. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=8, 2-3=13, 4-9=26, 5-9=-84, 2-6=-10<br/>Horz: 2-3=-23, 3-4=-19, 5-6=15<br/>Drag: 1-2=-0<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>12) Dead + 0.6 MWFRS Wind (Neg. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=11, 2-3=6, 4-9=-10, 5-9=-120, 2-6=-20<br/>Horz: 2-3=-26, 3-4=25, 5-6=9<br/>Drag: 1-2=-0<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>13) Dead + 0.6 MWFRS Wind (Neg. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-2, 2-3=-7, 4-9=6, 5-9=-104, 2-6=-20<br/>Horz: 2-3=-13, 3-4=-9, 5-6=25<br/>Drag: 1-2=-0<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>14) Dead + 0.6 MWFRS Wind (Pos. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=21, 2-3=26, 4-9=10, 5-9=-100, 2-6=-10<br/>Horz: 2-3=-36, 3-4=-36, 5-6=17<br/>Drag: 1-2=-0<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>15) Dead + 0.6 MWFRS Wind (Pos. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=5, 2-3=10, 4-9=26, 5-9=-84, 2-6=-10<br/>Horz: 2-3=-20, 3-4=-20, 5-6=-12<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> | <p>Standard Except:<br/>16) Dead + 0.6 MWFRS Wind (Pos. Internal) 3rd Parallel: Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=21, 2-3=26, 4-9=10, 5-9=-100, 2-6=-10<br/>Horz: 2-3=-36, 3-4=-36, 5-6=17<br/>Drag: 1-2=-0<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>17) Dead + 0.6 MWFRS Wind (Pos. Internal) 4th Parallel: Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=5, 2-3=10, 4-9=26, 5-9=-84, 2-6=-10<br/>Horz: 2-3=-20, 3-4=-20, 5-6=-12<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>18) Dead + 0.6 MWFRS Wind (Neg. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=11, 2-3=6, 4-9=-10, 5-9=-120, 2-6=-20<br/>Horz: 2-3=-26, 3-4=-26, 5-6=7<br/>Drag: 1-2=-0<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>19) Dead + 0.6 MWFRS Wind (Neg. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-5, 2-3=-10, 4-9=6, 5-9=-104, 2-6=-20<br/>Horz: 2-3=-10, 3-4=-10, 5-6=-23<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>20) Dead + Snow on Overhangs: Lumber Increase=1.15, Plate Increase=1.15<br/>Uniform Loads (plf)<br/>Vert: 1-2=-100, 2-3=-20, 4-9=-20, 5-9=-130, 2-6=-20<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>21) Dead + Snow (Unbal. Left): Lumber Increase=1.15, Plate Increase=1.15<br/>Uniform Loads (plf)<br/>Vert: 1-8=-60, 3-8=-68, 4-9=-32, 5-9=-142, 2-6=-20<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>22) Dead + Snow (Unbal. Right): Lumber Increase=1.15, Plate Increase=1.15<br/>Uniform Loads (plf)<br/>Vert: 1-3=-32, 4-9=-77, 5-9=-187, 2-6=-20<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>23) Dead: Lumber Increase=0.90, Plate Increase=0.90<br/>Plt. metal=0.90<br/>Uniform Loads (plf)<br/>Vert: 1-3=-20, 4-9=-20, 5-9=-130, 2-6=-20<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>24) Dead + 0.75 Snow (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) Left): Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-27, 2-3=-31, 4-9=-42, 5-9=-152, 2-6=-20<br/>Horz: 2-3=-19, 3-4=19, 5-6=6<br/>Drag: 1-2=-0<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>25) Dead + 0.75 Snow (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) Right): Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-37, 2-3=-40, 4-9=-31, 5-9=-141, 2-6=-20<br/>Horz: 2-3=-10, 3-4=-6, 5-6=-19<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> | <p>Standard Except:<br/>26) Dead + 0.75 Snow (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-27, 2-3=-31, 4-9=-42, 5-9=-152, 2-6=-20<br/>Horz: 2-3=-19, 3-4=-19, 5-6=5<br/>Drag: 1-2=-0<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>27) Dead + 0.75 Snow (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-39, 2-3=-42, 4-9=-31, 5-9=-141, 2-6=-20<br/>Horz: 2-3=-8, 3-4=-8, 5-6=-17<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>28) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) Left): Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-27, 2-3=-31, 4-9=-42, 5-9=-152, 2-6=-20<br/>Horz: 2-3=-19, 3-4=19, 5-6=6<br/>Drag: 1-2=-0<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>29) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) Right): Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-37, 2-3=-40, 4-9=-31, 5-9=-141, 2-6=-20<br/>Horz: 2-3=-10, 3-4=-6, 5-6=-19<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>30) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-27, 2-3=-31, 4-9=-42, 5-9=-152, 2-6=-20<br/>Horz: 2-3=-19, 3-4=-19, 5-6=5<br/>Drag: 1-2=-0<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>31) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=-39, 2-3=-42, 4-9=-31, 5-9=-141, 2-6=-20<br/>Horz: 2-3=-8, 3-4=-8, 5-6=-17<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>32) Dead + Minimum Snow: Lumber Increase=1.15, Plate Increase=1.15<br/>Uniform Loads (plf)<br/>Vert: 1-3=-60, 4-9=-60, 5-9=-170, 2-6=-20<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>33) Dead + 0.6 C-C Wind Min. Down: Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-2=6, 2-3=-26, 4-9=-26, 5-9=-136, 2-6=-10<br/>Horz: 2-3=16, 3-4=16, 5-6=16<br/>Drag: 1-2=-0</p> <p>34) Dead + 0.6 C-C Wind Min. Upward: Lumber Increase=1.60, Plate Increase=1.60<br/>Uniform Loads (plf)<br/>Vert: 1-3=6, 4-9=6, 5-9=-104, 2-6=-10<br/>Horz: 2-3=-16, 3-4=-16, 5-6=16<br/>Drag: 1-2=-0</p> <p>35) 3rd Unbal. Dead + Snow (balanced) + Parallel: Lumber Increase=1.15, Plate Increase=1.15<br/>Uniform Loads (plf)<br/>Vert: 1-3=-32, 4-9=-89, 5-9=-199, 2-6=-20<br/>Concentrated Loads (lb)<br/>Vert: 9=-300</p> <p>36) 4th Unbal. Dead + Snow (balanced) + Parallel: Lumber Increase=1.15, Plate Increase=1.15</p> |
|--|---|---|

Job	Truss	Truss Type	Qty	Ply	LOT 157 CROSSING @ ANDERSON CREEK   357 TIMBER SKIP DRIVE SPP
22-2670-R01	R16A	Half Hip	2	1	Job Reference (optional)

Atlantic Building Components, Moncks Corner, South Carolina

8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Apr 15 12:24:48 2022 Page 3  
ID:te?\_8ytH1N5AHCxjPc0A\_rzRBdO-LTKJEs\_FrkjV5Gzbu4he6FBKRTe6VGNWSVhVE\_zQUWj


**LOAD CASE(S)**

- Uniform Loads (plf)  
Vert: 1-3=-89, 4-9=-32, 5-9=-142, 2-6=-20  
Concentrated Loads (lb)  
Vert: 9=-300
- 37) 5th Unbal.Death + 0.75 Snow (balanced) + Parallel:  
Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-3=-29, 4-9=-72, 5-9=-182, 2-6=-20  
Concentrated Loads (lb)  
Vert: 9=-300
- 38) 6th Unbal.Death + 0.75 Snow (balanced) + Parallel:  
Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-3=-72, 4-9=-29, 5-9=-139, 2-6=-20  
Concentrated Loads (lb)  
Vert: 9=-300
- 39) 7th Unbal.Death + 0.75 Snow (unbal.) + 0.75(0.6  
MWFRS Wind (Neg. Int) Left) + Parallel: Lumber  
Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-2=-6, 2-3=-10, 4-9=-64, 5-9=-174, 2-6=-20  
Horz: 2-3=-19, 3-4=19, 5-6=6  
Drag: 1-2=0  
Concentrated Loads (lb)  
Vert: 9=-300
- 40) 8th Unbal.Death + 0.75 Snow (unbal.) + 0.75(0.6  
MWFRS Wind (Neg. Int) Left) + Parallel: Lumber  
Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-2=-49, 2-3=-53, 4-9=-21, 5-9=-131, 2-6=-20  
Horz: 2-3=-19, 3-4=19, 5-6=6  
Drag: 1-2=0  
Concentrated Loads (lb)  
Vert: 9=-300
- 41) 9th Unbal.Death + 0.75 Snow (unbal.) + 0.75(0.6  
MWFRS Wind (Neg. Int) Right) + Parallel: Lumber  
Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-2=-16, 2-3=-19, 4-9=-53, 5-9=-163, 2-6=-20  
Horz: 2-3=-10, 3-4=-6, 5-6=-19  
Concentrated Loads (lb)  
Vert: 9=-300
- 42) 10th Unbal.Death + 0.75 Snow (unbal.) + 0.75(0.6  
MWFRS Wind (Neg. Int) Right) + Parallel: Lumber  
Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-2=-58, 2-3=-62, 4-9=-10, 5-9=-120, 2-6=-20  
Horz: 2-3=-10, 3-4=-6, 5-6=-19  
Concentrated Loads (lb)  
Vert: 9=-300
- 43) 11th Unbal.Death + 0.75 Snow (unbal.) + 0.75(0.6  
MWFRS Wind (Neg. Int) 1st Parallel): Lumber  
Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-2=-6, 2-3=-10, 4-9=-64, 5-9=-174, 2-6=-20  
Horz: 2-3=-19, 3-4=-19, 5-6=5  
Drag: 1-2=0  
Concentrated Loads (lb)  
Vert: 9=-300
- 44) 12th Unbal.Death + 0.75 Snow (unbal.) + 0.75(0.6  
MWFRS Wind (Neg. Int) 1st Parallel): Lumber  
Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-2=-49, 2-3=-53, 4-9=-21, 5-9=-131, 2-6=-20  
Horz: 2-3=-19, 3-4=-19, 5-6=5  
Drag: 1-2=0  
Concentrated Loads (lb)  
Vert: 9=-300
- 45) 13th Unbal.Death + 0.75 Snow (unbal.) + 0.75(0.6  
MWFRS Wind (Neg. Int) 2nd Parallel): Lumber  
Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-2=-18, 2-3=-21, 4-9=-53, 5-9=-163, 2-6=-20  
Horz: 2-3=-8, 3-4=-8, 5-6=-17  
Concentrated Loads (lb)  
Vert: 9=-300
- 46) 14th Unbal.Death + 0.75 Snow (unbal.) + 0.75(0.6  
MWFRS Wind (Neg. Int) 2nd Parallel): Lumber  
Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-2=-61, 2-3=-64, 4-9=-10, 5-9=-120, 2-6=-20  
Horz: 2-3=-8, 3-4=-8, 5-6=-17  
Concentrated Loads (lb)  
Vert: 9=-300
- 47) 15th Unbal.Death + Minimum Snow + Parallel:  
Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-3=-32, 4-9=-89, 5-9=-199, 2-6=-20  
Concentrated Loads (lb)  
Vert: 9=-300
- 48) 16th Unbal.Death + Minimum Snow + Parallel:  
Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-3=-89, 4-9=-32, 5-9=-142, 2-6=-20  
Concentrated Loads (lb)  
Vert: 9=-300
- 49) 1st Dead + Roof Live (unbalanced): Lumber  
Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-3=-60, 4-9=-20, 5-9=-130, 2-6=-20  
Concentrated Loads (lb)  
Vert: 9=-300
- 50) 2nd Dead + Roof Live (unbalanced): Lumber  
Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-3=-20, 4-9=-60, 5-9=-170, 2-6=-20  
Concentrated Loads (lb)  
Vert: 9=-300
- 51) 3rd Dead + 0.75 Roof Live (unbalanced): Lumber  
Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-3=-50, 4-9=-20, 5-9=-130, 2-6=-20  
Concentrated Loads (lb)  
Vert: 9=-300
- 52) 4th Dead + 0.75 Roof Live (unbalanced): Lumber  
Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-3=-20, 4-9=-50, 5-9=-160, 2-6=-20  
Concentrated Loads (lb)  
Vert: 9=-300

Job	Truss	Truss Type	Qty	Ply	LOT 157 CROSSING @ ANDERSON CREEK   357 TIMBER SKIP DRIVE SP
22-2670-R01	R17	Half Hip	1	1	Job Reference (optional)

Atlantic Building Components, Moncks Corner, South Carolina

8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Apr 15 12:24:51 2022 Page 1  
 ID:te?\_8ytH1N5AHCxjPc0A\_rzRBdO-i20Stu078f53yjiAZCFLkuvpZhJ4if\_y9Tw9rJzQUWg



Scale = 1:17.6

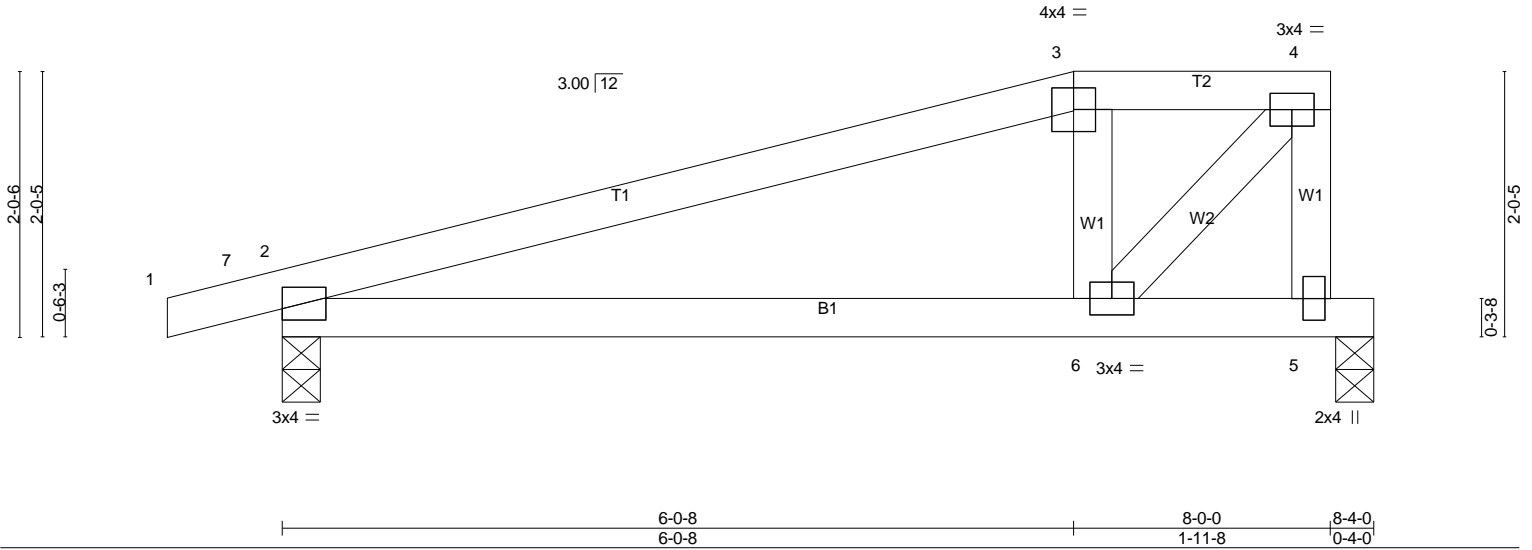


Plate Offsets (X,Y)-- [5:0-2-0,0-1-0]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.75	Vert(LL) -0.05	2-6	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.36	Vert(CT) -0.09	2-6	>999	180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.18	Horz(CT) 0.00	5	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-P						
							Weight: 33 lb	FT = 0%

**LUMBER-**

TOP CHORD 2x4 SP No.1 \*Except\*  
 T2: 2x4 SP No.2  
 BOT CHORD 2x4 SP No.2  
 WEBS 2x4 SP No.3

**BRACING-**

TOP CHORD  
 Structural wood sheathing directly applied or 5-6-0 oc purlins, except end verticals.  
 BOT CHORD  
 Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** (lb/size)

5 = 304/0-3-8 (min. 0-1-8)  
 2 = 374/0-3-8 (min. 0-1-8)  
 Max Horz  
 2 = 65(LC 13)  
 Max Uplift  
 5 = -62(LC 10)  
 2 = -99(LC 10)  
 Max Grav  
 5 = 323(LC 36)  
 2 = 506(LC 36)

**FORCES.** (lb)

Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD  
 2-3=-395/25, 3-4=-304/40, 4-5=-344/48  
 BOT CHORD  
 2-6=-21/320  
 WEBS  
 4-6=-34/438

**NOTES-** (10-11)

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=5.0psf; BCDL=5.0psf; h=23ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- 3) Unbalanced snow loads have been considered for this design.
- 4) This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- 5) Provide adequate drainage to prevent water ponding.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 1-0-0 wide will fit between the bottom chord and any other members.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 62 lb uplift at joint 5 and 99 lb uplift at joint 2.
- 9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

- 10) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
- 11) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

**LOAD CASE(S)**


Standard



Job 22-2670-R01	Truss R18	Truss Type Half Hip Girder	Qty 1	Ply 1	LOT 157 CROSSING @ ANDERSON CREEK   357 TIMBER SKIP DRIVE SP
--------------------	--------------	-------------------------------	----------	----------	--

Atlantic Building Components, Moncks Corner, South Carolina

8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Apr 15 12:24:55 2022 Page 1  
ID:te?\_8ytH1N5AHCxjPc0A\_rzRBdO-epFyiF3eCtbVQK0xo2JHvk\_b?ldGeRrY35uN\_4zQUWc



Scale = 1:17.6

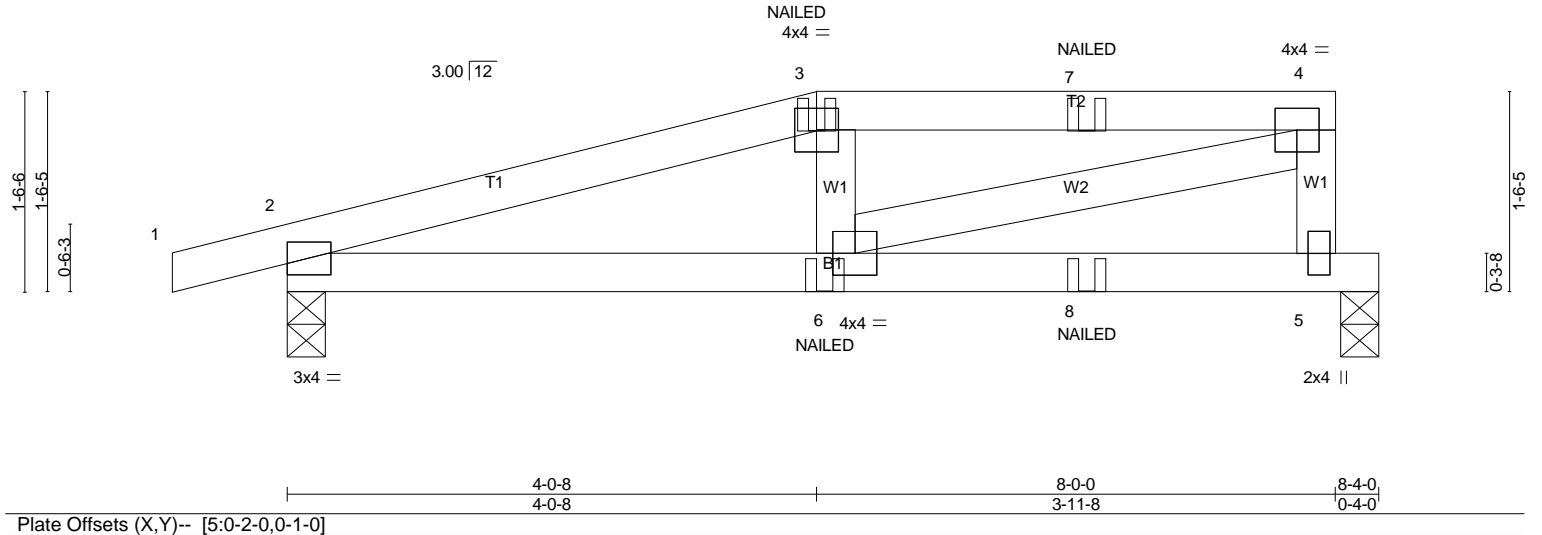


Plate Offsets (X,Y)-- [5:0-2-0,0-1-0]									
<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b> in (loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>	
TCLL 20.0	Plate Grip DOL	1.15	TC 0.66	Vert(LL) -0.02	6	>999	MT20	244/190	
TCDL 10.0	Lumber DOL	1.15	BC 0.60	Vert(CT) -0.03	6	>999			
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.32	Horz(CT) 0.01	5	n/a			
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P						
							Weight: 34 lb	FT = 0%	

**LUMBER-**

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.3  
WEBS 2x4 SP No.3

**BRACING-**

TOP CHORD  
Structural wood sheathing directly applied or 5-5-3 oc purlins, except end verticals.  
BOT CHORD  
Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** (lb/size)

5	=	441/0-3-8 (min. 0-1-8)
2	=	450/0-3-8 (min. 0-1-8)
Max Horz		
2	=	47(LC 50)
Max Uplift		
5	=	-84(LC 8)
2	=	-114(LC 8)
Max Grav		
5	=	476(LC 33)
2	=	548(LC 34)

**FORCES.** (lb)

Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD  
2-3=-836/119, 3-7=-728/118,  
4-7=-728/118, 4-5=-434/100  
BOT CHORD  
2-6=-111/743  
WEBS  
4-6=-112/768

**NOTES-** (12-13)

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=5.0psf; BCDL=5.0psf; h=23ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- 3) Unbalanced snow loads have been considered for this design.
- 4) This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- 5) Provide adequate drainage to prevent water ponding.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 1-0-0 wide will fit between the bottom chord and any other members.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 84 lb uplift at joint 5 and 114 lb uplift at joint 2.
- 9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 10) "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.
- 11) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

- 12) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
- 13) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

**LOAD CASE(S)**


Standard  
1) Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-3=-60, 3-4=-60, 2-5=-20  
Concentrated Loads (lb)  
Vert: 3=-89(F) 6=-18(F) 7=-89(F) 8=-18(F)

Job 22-2670-R01	Truss VT01	Truss Type Valley	Qty 1	Ply 1	LOT 157 CROSSING @ ANDERSON CREEK   357 TIMBER SKIP DRIVE SP
--------------------	---------------	----------------------	----------	----------	--

Atlantic Building Components, Moncks Corner, South Carolina

8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Apr 15 12:24:58 2022 Page 1

ID:te?\_8ytH1N5AHCxjPc0A\_rzRBdO-2Ox5LH6WVoz4IokWTAt\_WMcEkVikrrr\_m361bPzQUWZ

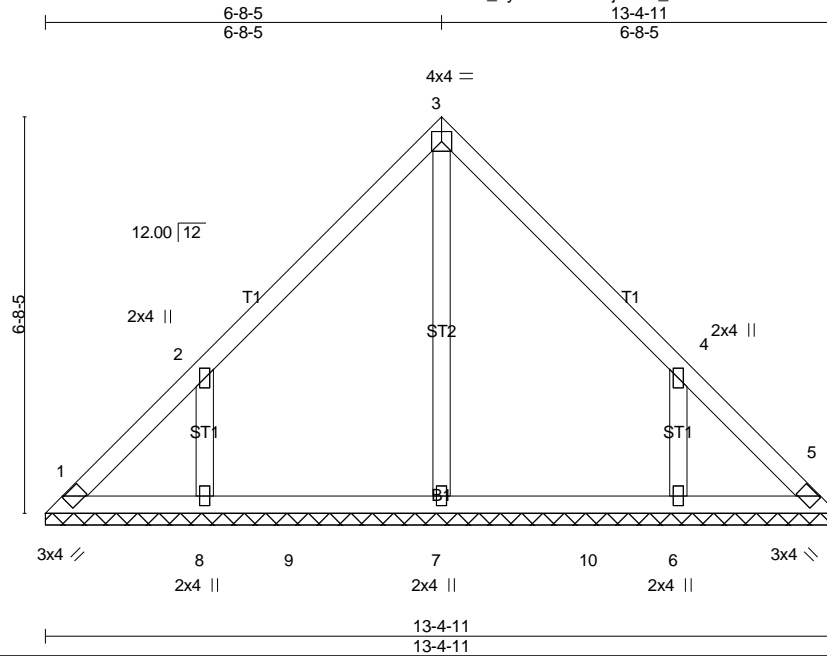

Scale = 1:38.9

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.18	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.36	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.11	Horz(CT)	0.00	5	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-SH						
	Code IRC2018/TPI2014						Weight: 62 lb	FT = 0%

**LUMBER-**

TOP CHORD 2x4 SP No.2  
 BOT CHORD 2x4 SP No.3  
 OTHERS 2x4 SP No.3

**BRACING-**

**TOP CHORD**

Structural wood sheathing directly applied or 6-0-0 oc purlins.

**BOT CHORD**

Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** All bearings 13-4-11.

(lb) - Max Horz

1=-145(LC 8)

Max Uplift

All uplift 100 lb or less at joint(s) 1,

5 except 8=-206(LC 12), 6=-205(LC 13)

Max Grav

All reactions 250 lb or less at joint(s)

1, 5 except 7=396(LC 26), 8=374(LC 19),

6=374(LC 20)

**FORCES.** (lb)

Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

WEBS

2-8=-269/238, 4-6=-268/238

**NOTES-** (9-10)

1) Unbalanced roof live loads have been considered for this design.

2) Wind: ASCE 7-16; Vult=130mph (3-second gust)  
 Vasd=103mph; TCDL=5.0psf; BCDL=5.0psf; h=23ft;  
 Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60


- 3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- 4) Gable requires continuous bottom chord bearing.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 1-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5 except (jt=lb) 8=206, 6=205.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 9) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
- 10) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

**LOAD CASE(S)**

Standard

Job 22-2670-R01	Truss VT02	Truss Type Valley	Qty 1	Ply 1	LOT 157 CROSSING @ ANDERSON CREEK   357 TIMBER SKIP DRIVE SP
Atlantic Building Components, Moncks Corner, South Carolina					Job Reference (optional)

8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Apr 15 12:25:01 2022 Page 1  
 ID:te?\_8ytH1N5AHCxjPc0A\_rzRBdO-SzcEzJ8PnjLf9FT58JQh8?Elnjmu2B1QS1LhCjzQUWW

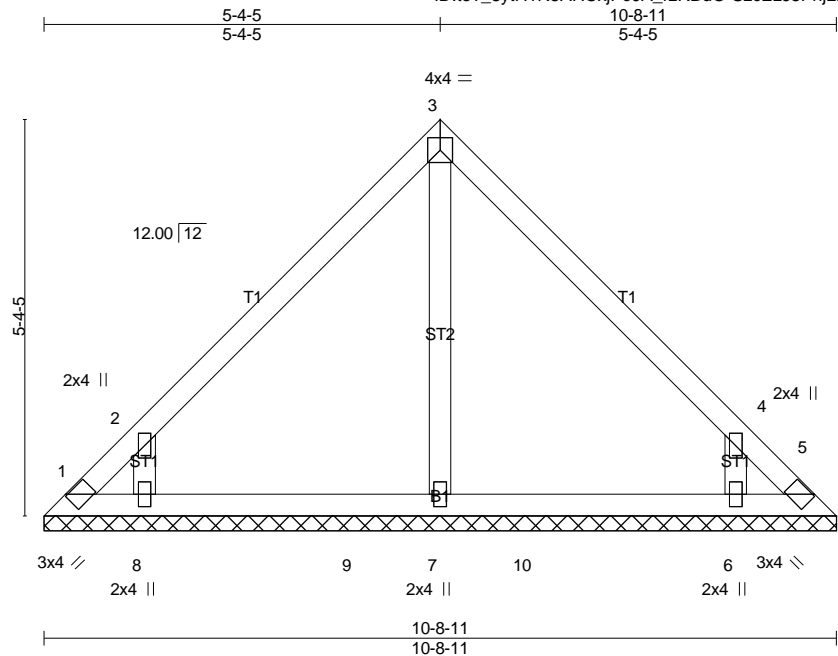

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.19	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.20	Vert(LL) n/a - n/a 999		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.08	Vert(CT) n/a - n/a 999		
BCDL 10.0	Rep Stress Incr YES	Matrix-SH	Horz(CT) 0.00 5 n/a n/a		
	Code IRC2018/TPI2014			Weight: 47 lb	FT = 0%

**LUMBER-**  
 TOP CHORD 2x4 SP No.2  
 BOT CHORD 2x4 SP No.3  
 OTHERS 2x4 SP No.3

**BRACING-**  
 TOP CHORD  
 Structural wood sheathing directly applied or 6-0-0 oc purlins.  
 BOT CHORD  
 Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** All bearings 10-8-11.  
 (lb) - Max Horz  
 1=-115(LC 8)  
 Max Uplift  
 All uplift 100 lb or less at joint(s)  
 5 except 1=-109(LC 10), 8=-215(LC 12), 6=-215(LC 13)  
 Max Grav  
 All reactions 250 lb or less at joint(s)  
 1, 5 except 7=314(LC 19), 8=357(LC 19), 6=357(LC 20)

**FORCES.** (lb)  
 Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 WEBS  
 2-8=-300/270, 4-6=-299/270

**NOTES-** (9-10)  
 1) Unbalanced roof live loads have been considered for this design.  
 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=5.0psf; BCDL=5.0psf; h=23ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60

- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 1-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5 except (jt=lb) 1=109, 8=215, 6=215.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.
- Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

**LOAD CASE(S)**  
 Standard


Job 22-2670-R01	Truss VT03	Truss Type Valley	Qty 1	Ply 1	LOT 157 CROSSING @ ANDERSON CREEK   357 TIMBER SKIP DRIVE SP
--------------------	---------------	----------------------	----------	----------	--

Atlantic Building Components, Moncks Corner, South Carolina

ID:te?\_8ytH1N5AHCxjPc0A\_rzRBdO-tYIMbKAH4ekD0jCgqR\_OmdsEuwn9FZMt8?ZLp2zQUWT

8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Apr 15 12:25:04 2022 Page 1

Job Reference (optional)

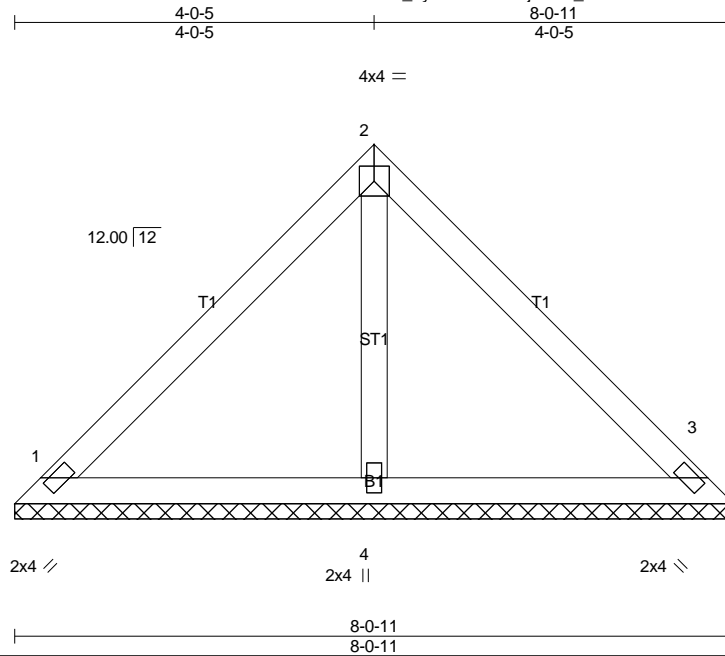

Scale = 1:25.8

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.26	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.23	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.04	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-P						
	Code IRC2018/TPI2014							
							Weight: 33 lb	FT = 0%

**LUMBER-**

TOP CHORD 2x4 SP No.2

BOT CHORD 2x4 SP No.3

OTHERS 2x4 SP No.3

**BRACING-**

TOP CHORD

Structural wood sheathing directly applied or 6-0-0 oc purlins.

BOT CHORD

Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** (lb/size)

1 = 177/8-0-11 (min. 0-1-8)

3 = 177/8-0-11 (min. 0-1-8)

4 = 234/8-0-11 (min. 0-1-8)

Max Horz

1 = -84(LC 8)

Max Uplift

1 = -45(LC 13)

3 = -45(LC 13)

**FORCES.** (lb)

Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

6) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 1-0-0 wide will fit between the bottom chord and any other members.

7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.

8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

9) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.

10) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

**LOAD CASE(S)**

Standard

**NOTES-** (9-10)

1) Unbalanced roof live loads have been considered for this design.

2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=5.0psf; BCDL=5.0psf; h=23ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60


3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10

4) Gable requires continuous bottom chord bearing.

Job 22-2670-R01	Truss VT04	Truss Type Valley	Qty 1	Ply 1	LOT 157 CROSSING @ ANDERSON CREEK   357 TIMBER SKIP DRIVE SP
--------------------	---------------	----------------------	----------	----------	--

Atlantic Building Components, Moncks Corner, South Carolina

8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Apr 15 12:25:07 2022 Page 1  
 ID:te?\_8ytH1N5AHCxjPc0A\_rzRBdO-H7\_VEIMD9NZ6otAwFVZX5OFUoi8r?SwTJqzo?PNzQUWQ

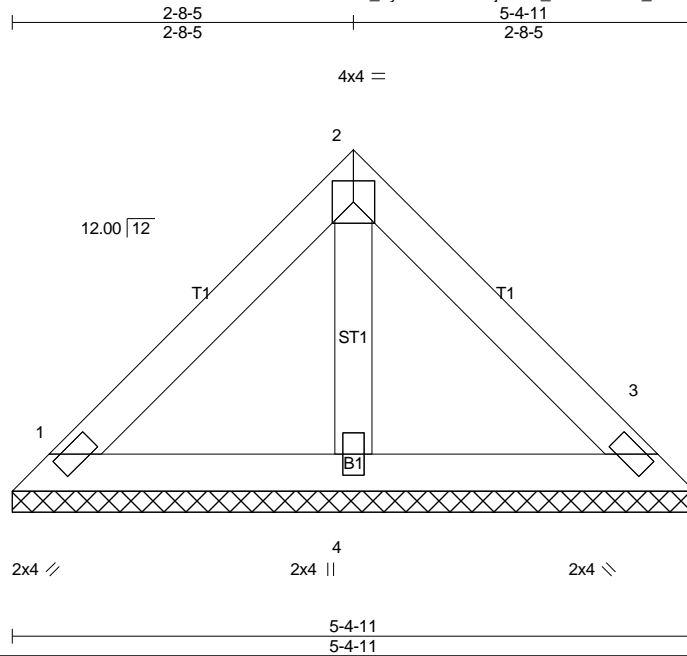

Scale = 1:18.2

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.10	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.10	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.02	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-P						
	Code IRC2018/TPI2014							
							Weight: 21 lb	FT = 0%

**LUMBER-**

TOP CHORD 2x4 SP No.2  
 BOT CHORD 2x4 SP No.3  
 OTHERS 2x4 SP No.3

**BRACING-**

**TOP CHORD**

Structural wood sheathing directly applied or 5-4-11 oc purlins.

**BOT CHORD**

Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** (lb/size)

1 = 113/5-4-11 (min. 0-1-8)  
 3 = 113/5-4-11 (min. 0-1-8)  
 4 = 149/5-4-11 (min. 0-1-8)

**Max Horz**

1 = 54(LC 9)

**Max Uplift**

1 = -29(LC 13)  
 3 = -29(LC 13)

**FORCES.** (lb)

Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-** (9-10)

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=5.0psf; BCDL=5.0psf; h=23ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- Gable requires continuous bottom chord bearing.

5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

6) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 1-0-0 wide will fit between the bottom chord and any other members.

7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.

8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

9) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.

10) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.


**LOAD CASE(S)**

Standard

Job 22-2670-R01	Truss VT05	Truss Type Valley	Qty 1	Ply 1	LOT 157 CROSSING @ ANDERSON CREEK   357 TIMBER SKIP DRIVE SP
--------------------	---------------	----------------------	----------	----------	--

Atlantic Building Components, Moncks Corner, South Carolina

8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Apr 15 12:25:10 2022 Page 1  
ID:te?\_8ytH1N5AHCxjPc0A\_rzRBdO-hifdsOF2gUUNkefqAi5o?u6JFLtvfHPIWw0f0izQUWN

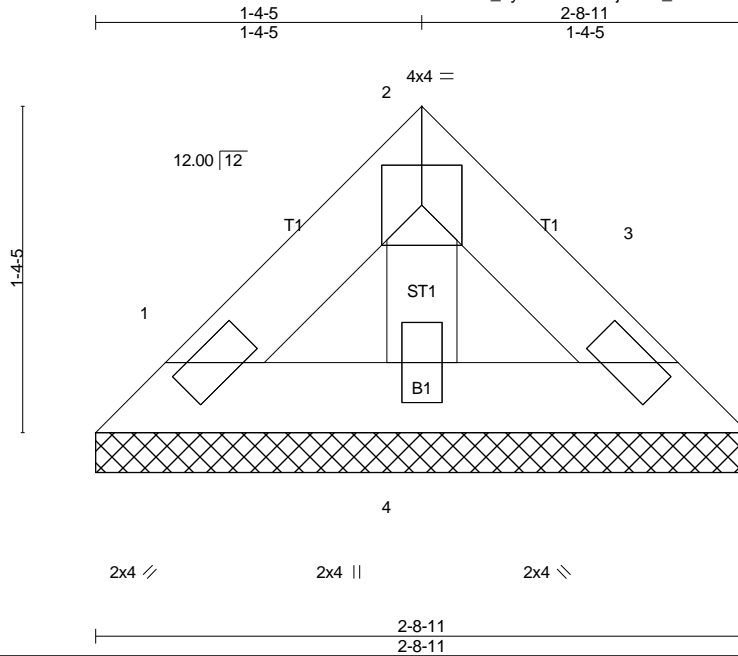

Scale = 1:9.6

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.02	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.02	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.01	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-P						
	Code IRC2018/TPI2014						Weight: 10 lb	FT = 0%

**LUMBER-**

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.3  
OTHERS 2x4 SP No.3

**BRACING-**

TOP CHORD  
Structural wood sheathing directly applied or 2-8-11 oc purlins.  
BOT CHORD  
Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** (lb/size)

1 = 49/2-8-11 (min. 0-1-8)  
3 = 49/2-8-11 (min. 0-1-8)  
4 = 64/2-8-11 (min. 0-1-8)

Max Horz  
1 = -23(LC 8)  
Max Uplift  
1 = -12(LC 13)  
3 = -12(LC 13)

**FORCES.** (lb)

Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-** (9-10)

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=5.0psf; BCDL=5.0psf; h=23ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- 4) Gable requires continuous bottom chord bearing.

5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

6) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 1-0-0 wide will fit between the bottom chord and any other members.

7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.

8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

9) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.

10) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.


**LOAD CASE(S)**

Standard

Job	Truss	Truss Type	Qty	Ply	LOT 157 CROSSING @ ANDERSON CREEK   357 TIMBER SKIP DRIVE SP
22-2670-R01	VT06	Valley	1	1	Job Reference (optional)

Atlantic Building Components, Moncks Corner, South Carolina

8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Apr 15 12:25:12 2022 Page 1  
ID:te?\_8ytH1N5AHCxjPc0A\_rzRBdO-e5nOH3GIC5k5zypCI67H5JBb?9VM7BC2\_EVm5bzQUWL

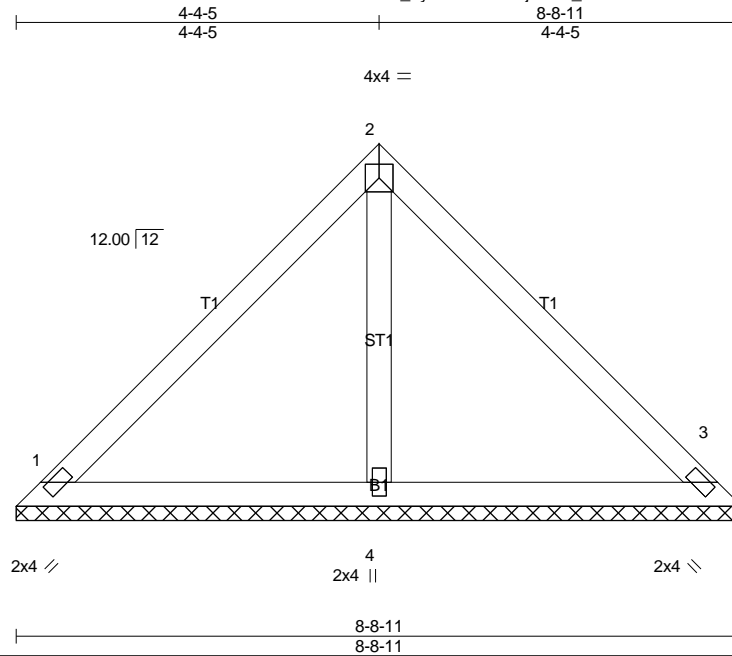

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.32	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.28	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.05	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-P						
	Code IRC2018/TPI2014						Weight: 36 lb	FT = 0%

**LUMBER-**

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.3  
OTHERS 2x4 SP No.3

**BRACING-**

**TOP CHORD**

Structural wood sheathing directly applied or 6-0-0 oc purlins.

**BOT CHORD**

Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** (lb/size)

1 = 193/8-8-11 (min. 0-1-8)  
3 = 193/8-8-11 (min. 0-1-8)  
4 = 255/8-8-11 (min. 0-1-8)

**Max Horz**

1 = 92(LC 9)

**Max Uplift**

1 = -50(LC 13)  
3 = -50(LC 13)

**FORCES.** (lb)

Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

6) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 1-0-0 wide will fit between the bottom chord and any other members.

7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.

8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

9) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.

10) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

**LOAD CASE(S)**

Standard

**NOTES-** (9-10)

1) Unbalanced roof live loads have been considered for this design.


2) Wind: ASCE 7-16; Vult=130mph (3-second gust)  
Vasd=103mph; TCDL=5.0psf; BCDL=5.0psf; h=23ft;  
Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60

3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10

4) Gable requires continuous bottom chord bearing.

Job 22-2670-R01	Truss VT07	Truss Type Valley	Qty 1	Ply 1	LOT 157 CROSSING @ ANDERSON CREEK   357 TIMBER SKIP DRIVE SP
Atlantic Building Components, Moncks Corner, South Carolina					Job Reference (optional)

8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Apr 15 12:25:15 2022 Page 1  
 ID:te?\_8ytH1N5AHCxjPc0A\_rzRBdO-2gSWv5JBU06gqPXnzFg\_ixp8AMaQKYOUgCkQiwzQUWI

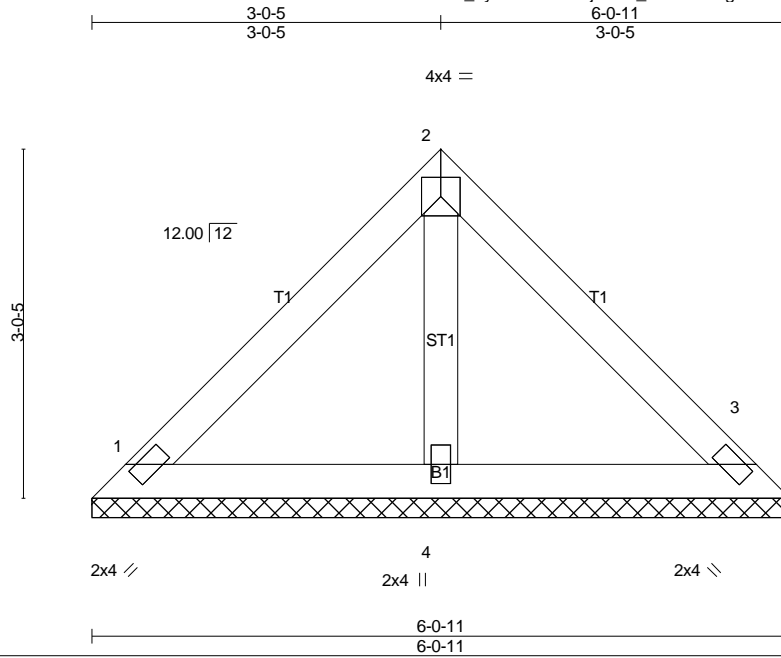

Scale = 1:20.0

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.13	Vert(LL)	n/a	n/a	999	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.12	Vert(CT)	n/a	n/a	999		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.02	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-P						
	Code IRC2018/TPI2014						Weight: 24 lb	FT = 0%

**LUMBER-**

TOP CHORD 2x4 SP No.2  
 BOT CHORD 2x4 SP No.3  
 OTHERS 2x4 SP No.3

**BRACING-**

**TOP CHORD**

Structural wood sheathing directly applied or 6-0-0 oc purlins.

**BOT CHORD**

Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** (lb/size)

1 = 129/6-0-11 (min. 0-1-8)  
 3 = 129/6-0-11 (min. 0-1-8)  
 4 = 170/6-0-11 (min. 0-1-8)

**Max Horz**

1 = -61(LC 8)

**Max Uplift**

1 = -33(LC 13)  
 3 = -33(LC 13)

**FORCES.** (lb)

Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-** (9-10)

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=5.0psf; BCDL=5.0psf; h=23ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- Gable requires continuous bottom chord bearing.

5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

6) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 1-0-0 wide will fit between the bottom chord and any other members.

7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.

8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

9) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.

10) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.

**LOAD CASE(S)**

Standard




Job 22-2670-R01	Truss VT08	Truss Type Valley	Qty 1	Ply 1	LOT 157 CROSSING @ ANDERSON CREEK   357 TIMBER SKIP DRIVE SP
--------------------	---------------	----------------------	----------	----------	--

Atlantic Building Components, Moncks Corner, South Carolina

ID:te?\_8ytH1N5AHCxjPc0A\_rzRBdO-SF8fX7L3nxVEhtGMeNEhKaRh0ZcZXuLxMAy4IEzQUWF

8.430 s Feb 12 2021 MiTek Industries, Inc. Fri Apr 15 12:25:18 2022 Page 1

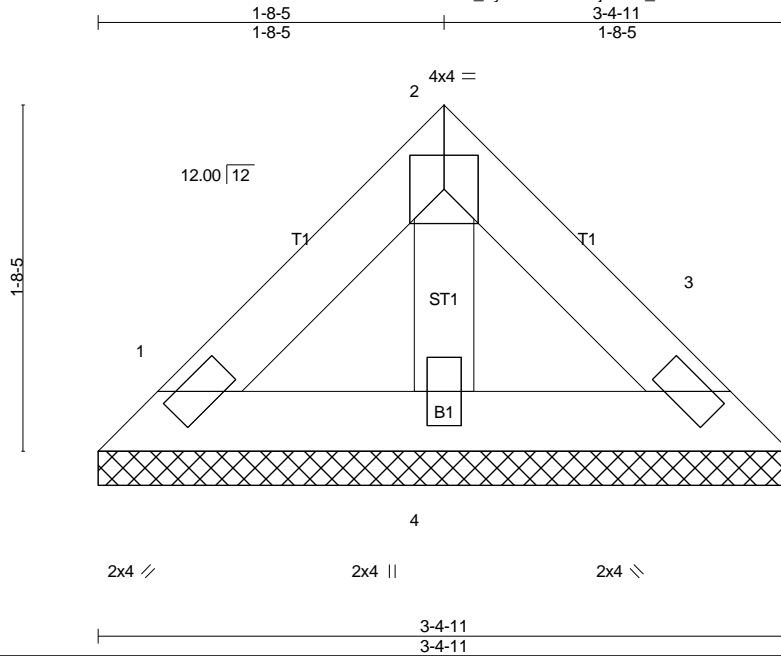

Scale = 1:11.3

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.03	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.03	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.01	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-P						
	Code IRC2018/TPI2014						Weight: 12 lb	FT = 0%

**LUMBER-**

TOP CHORD 2x4 SP No.2

BOT CHORD 2x4 SP No.3

OTHERS 2x4 SP No.3

**BRACING-**

TOP CHORD

Structural wood sheathing directly applied or 3-4-11 oc purlins.

BOT CHORD

Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** (lb/size)

1 = 65/3-4-11 (min. 0-1-8)

3 = 65/3-4-11 (min. 0-1-8)

4 = 85/3-4-11 (min. 0-1-8)

Max Horz

1 = -31(LC 8)

Max Uplift

1 = -17(LC 13)

3 = -17(LC 13)

**FORCES.** (lb)

Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**LOAD CASE(S)**

Standard

**NOTES-** (9-10)

1) Unbalanced roof live loads have been considered for this design.

2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=5.0psf; BCDL=5.0psf; h=23ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60

3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10

4) Gable requires continuous bottom chord bearing.

5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

6) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 1-0-0 wide will fit between the bottom chord and any other members.

7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.

8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

9) Graphical web bracing representation does not depict the size, type or the orientation of the brace on the web. Symbol only indicates that the member must be braced.

10) Bearing symbols are only graphical representations of a possible bearing condition. Bearing symbols are not considered in the structural design of the truss to support the loads indicated.