Crossing 20 - 221 Timber Skip Dr, Spring Lake, 28390 Harnett County Created: 1/8/2021

House Plan: Braxton Elevation: A Stone/Brick Option: #1 Foundation: Slab Foundation Finish: 3 Sides Parged Garage Hand: Left Garage: 2 Car Front Garage Door:(1) 16x8 Front Porch: Concrete Roof: Truss Siding: Vinyl Ceiling Height 1st Floor: 9' Ceiling Height 2nd Floor: 9' Door Frame Height 1st Floor: 83" Door Frame Height 2nd Floor: 83" Windows 1st Floor: 6/0 Front Only Windows 2nd Floor: 5/0


OPTIONS


Covered Porch Bedroom #4 Trey Ceiling in Master Bedroom Trey Ceiling in Dining Room


Total Heated Sq. Ft.: 2216 Total Unheated Sq. Ft.: 810 Total SQ FT: 3026

Bedrooms: 4 Full Bathrooms: 2 Half Bathrooms: 1



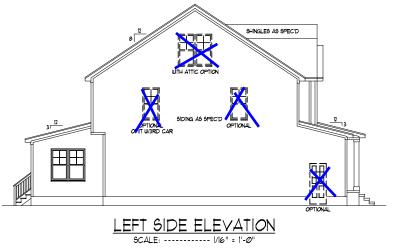



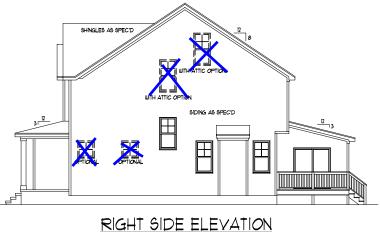


SCALE: ----- 1/16" = 1'-0"




Stone/Brick Location



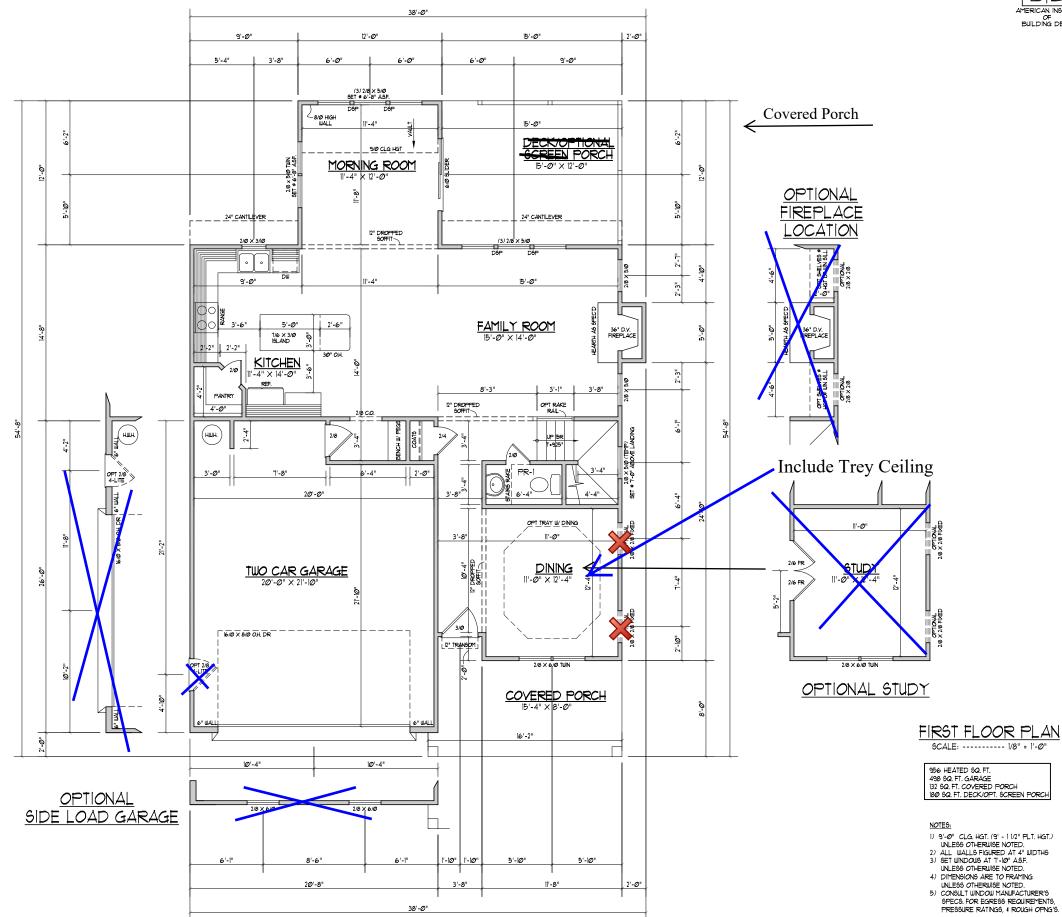




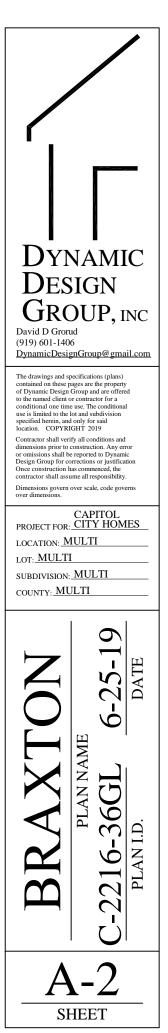



OPT SCREEN PORCH/BBQ DECK



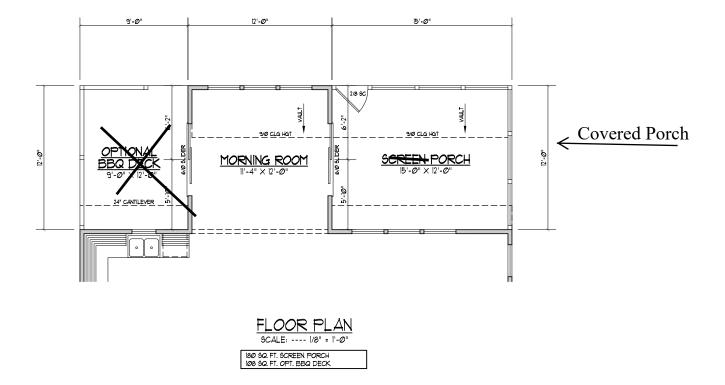



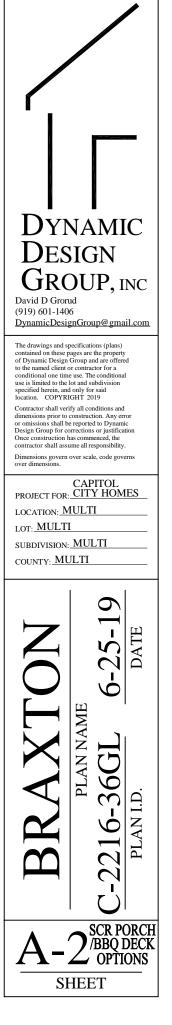


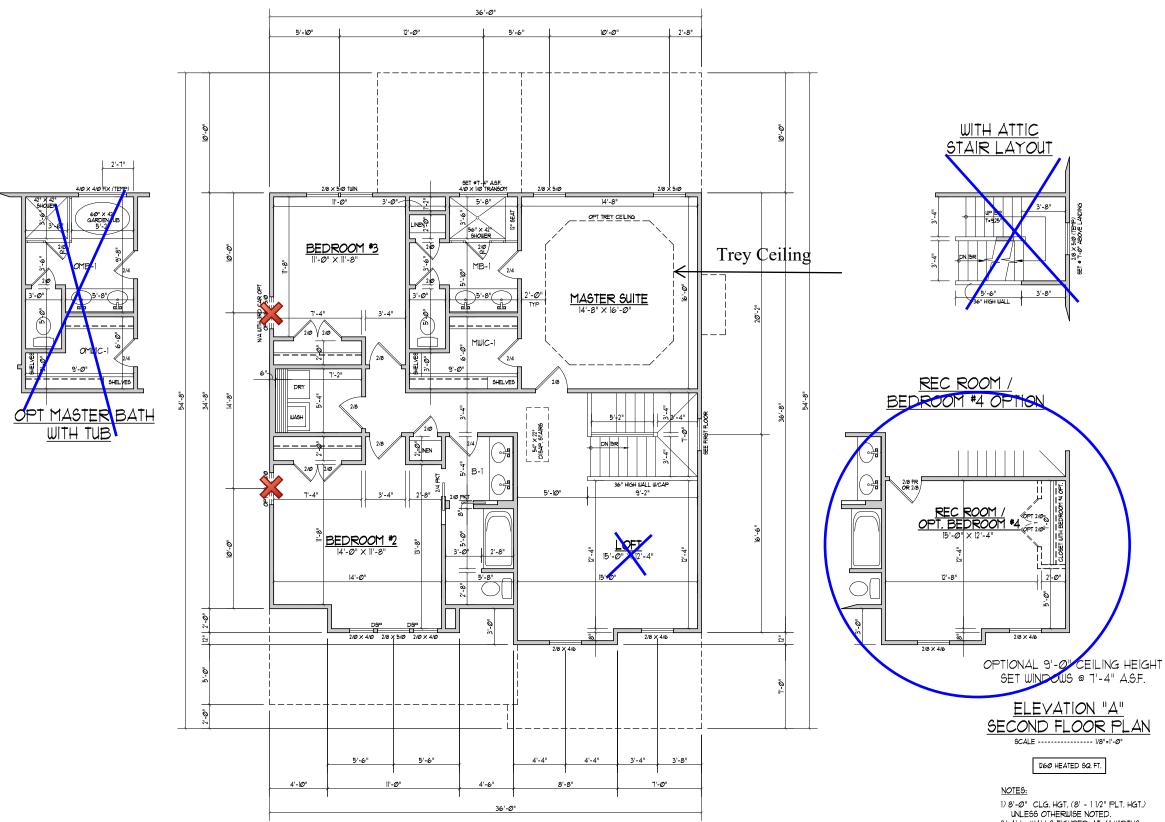




- UNLESS OTHERWISE NOTED. 2) ALL WALLS FIGURED AT 4" WIDTHS UNLESS OTHERWISE NOTED.
- 3) SET WINDOWS AT 6'-8" A.S.F.
- UNLESS OTHERWISE NOTED. 4) DIMENSIONS ARE TO FRAMING
- UNLESS OTHERWISE NOTED. 5) CONSULT WINDOW MANUFACTURER'S SPECS. FOR EGRESS REQUIREMENTS, PRESSURE RATINGS, & ROUGH OPNG'S.



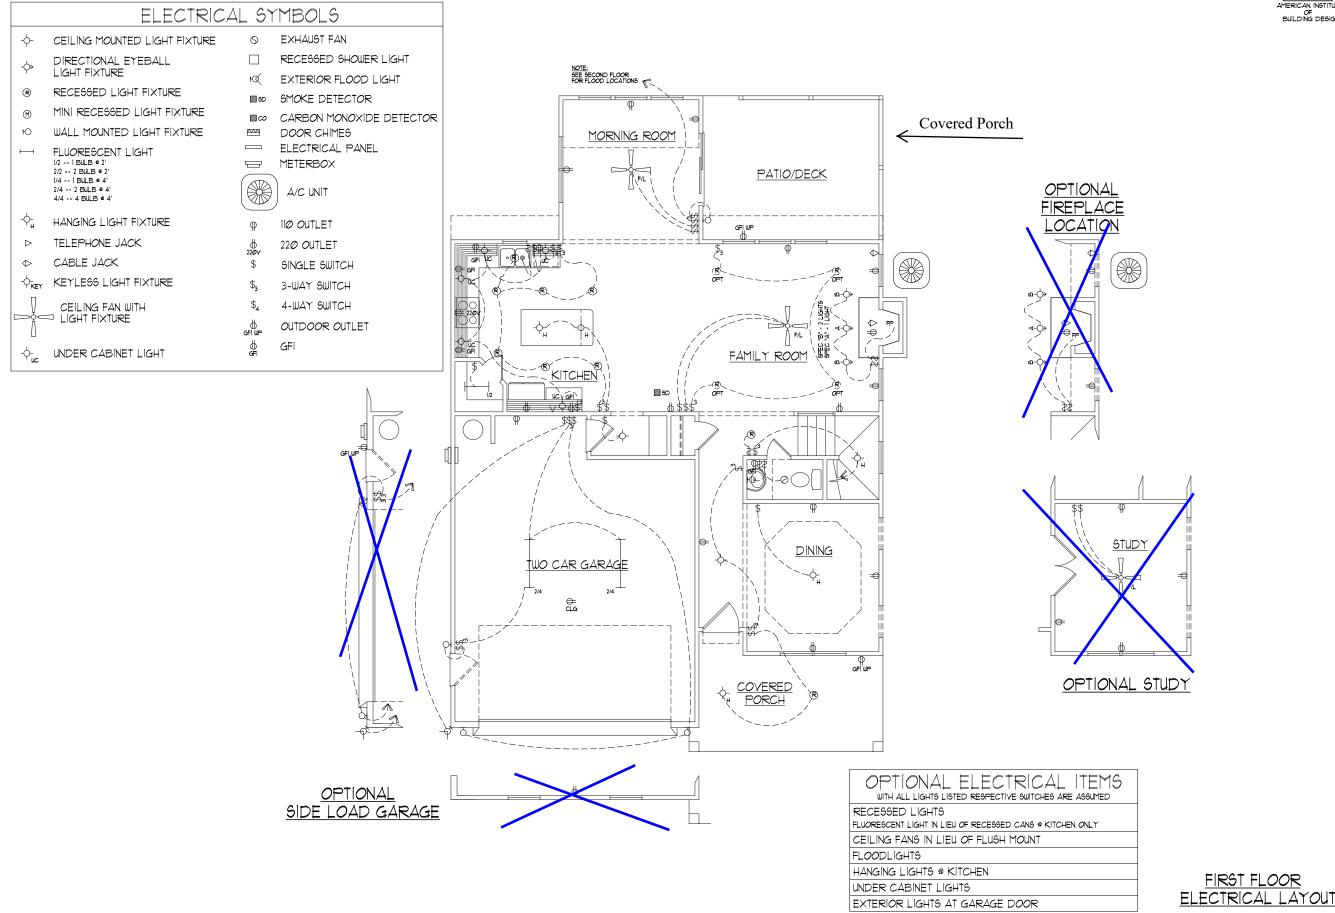




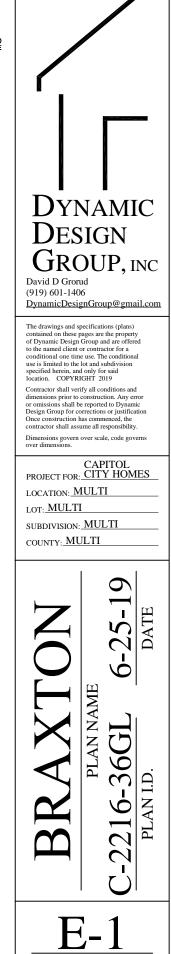

SHEET

	ELECTRICAL	SYM	1BC
- ф -	CEILING MOUNTED LIGHT FIXTURE	9	EXH,
- \$ *	DIRECTIONAL EYEBALL LIGHT FIXTURE		REC
R	RECESSED LIGHT FIXTURE	ю	EXTE
C		5D	SMO
(\mathfrak{M})	MINI RECESSED LIGHT FIXTURE	⊠co	CAR
Ю	WALL MOUNTED LIGHT FIXTURE	<u>~~</u>	DOC
H I	FLUORESCENT LIGHT		ELEC
	1/2 1 BULB # 2' 2/2 2 BULB # 2'	\square	METE
	2/2 2 DULB # 4' 2/4 2 DULB # 4' 4/4 4 BULB # 4') д/с
-¢_	HANGING LIGHT FIXTURE	φ	11Ø C
\triangleright	TELEPHONE JACK		22Ø -
\diamondsuit	CABLE JACK	\$	SING
-\$_KEY	KEYLESS LIGHT FIXTURE	\$3	3-W4
Ų	CEILING FAN WITH	\$4	4-W4
j	□ LIGHT FIXTURE	defiwer	OUTE
-\$- uc	UNDER CABINET LIGHT	⊕ GFi	GFI

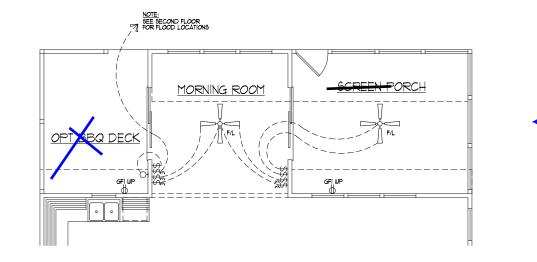

Covered Porch



OLS

IAUST FAN

- CESSED SHOWER LIGHT
- TERIOR FLOOD LIGHT
- OKE DETECTOR
- RBON MONOXIDE DETECTOR XOR CHIMES ECTRICAL PANEL TERBOX

/C UNIT

OUTLET

OUTLET


GLE SWITCH


NAY SWITCH

UAY SWITCH

TDOOR OUTLET



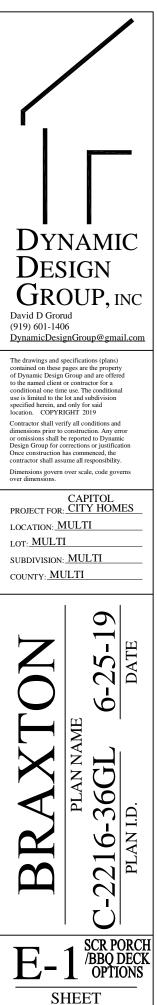

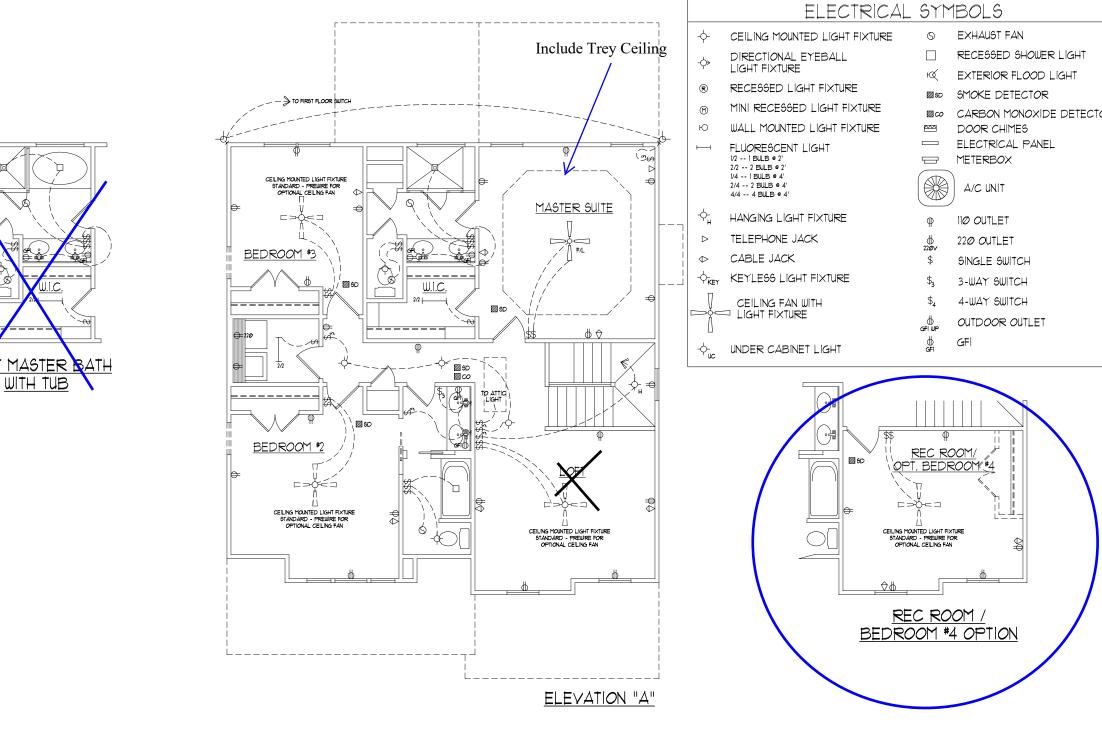

þ


Ŭ Ø


OPT



\$	EXHAUST FAN
	RECESSED SHOWER LIGHT
ю	EXTERIOR FLOOD LIGHT
5D	SMOKE DETECTOR
⊠ co	CARBON MONOXIDE DETECTOR DOOR CHIMES
	ELECTRICAL PANEL
	METERBOX
	A/C UNIT
φ	110 OUTLET
2200	220 OUTLET
\$	SINGLE SWITCH
\$3	3-WAY SWITCH
\$4	4-WAY SWITCH
GFIWP	OUTDOOR OUTLET
d GFI	GFI



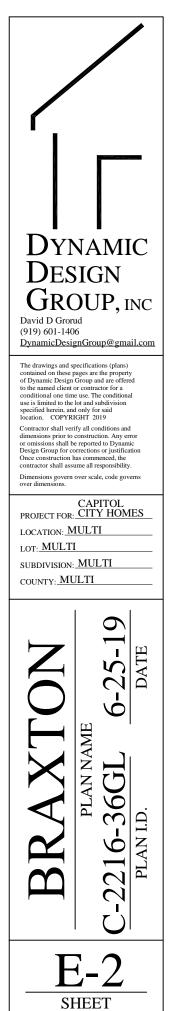

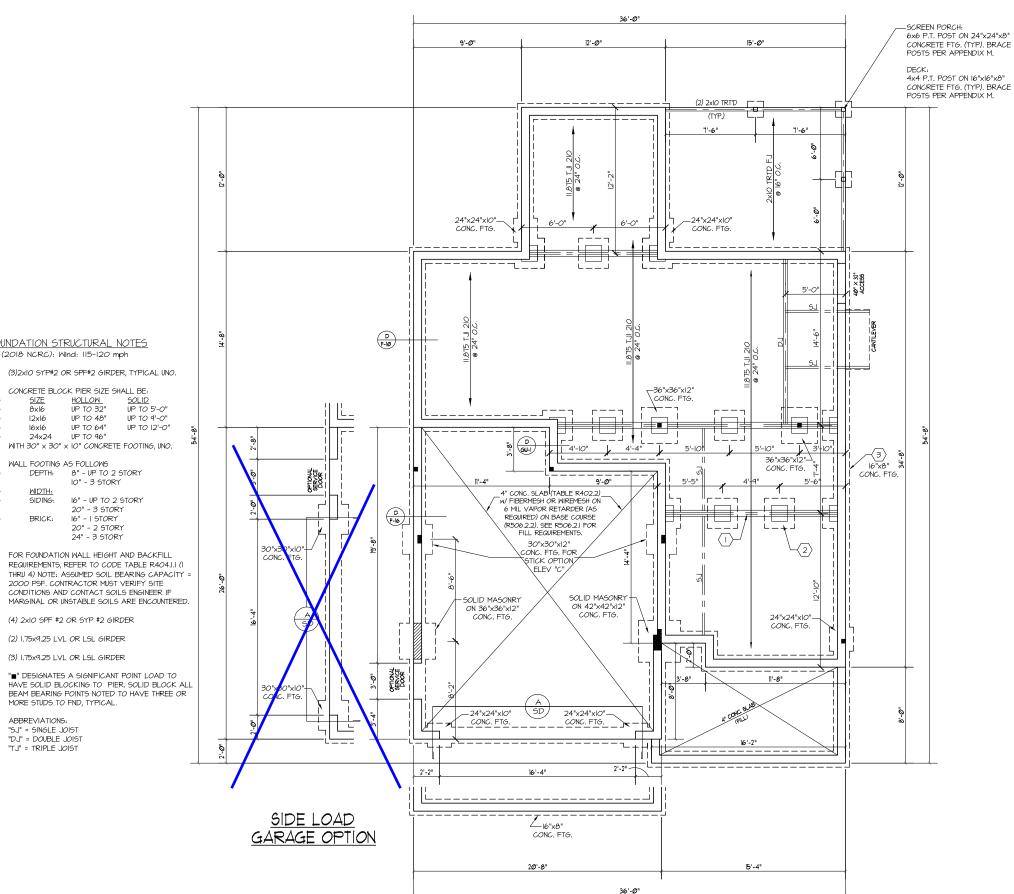

- FOUNDATION STRUCTURAL NOTES NC (2018 NCRC): Wind: 115-120 mph

- $\langle I \rangle$ (3)2x10 SYP#2 OR SPF#2 GIRDER, TYPICAL UNO.

<u>HOLLOW</u> UP TO 32"

UP TO 48"

UP TO 64"

UP TO 96"

8" - UP TO 2 STORY

IO" - 3 STORY

20" - 3 STORY 16" - 1 STORY

20" - 2 STORY

24" - 3 STORY

<u>SIZE</u> 8xl6

|2x|6

16x16

24x24

DEPTH:

WIDTH:

SIDING:

BRICK:

WALL FOOTING AS FOLLOWS

(4) (4) 2x10 SPF #2 OR SYP #2 GIRDER

(6) (3) 1.75x9.25 LVL OR LSL GIRDER

(2) 1.75x9.25 LVL OR LSL GIRDER

MORE STUDS TO FND, TYPICAL

ABBREVIATIONS:

"SJ" = SINGLE JOIST

"DJ" = DOUBLE JOIST

"TJ" = TRIPLE JOIST

(2) ••

...

...

.

3)

...


....


....

.

(5)

8.

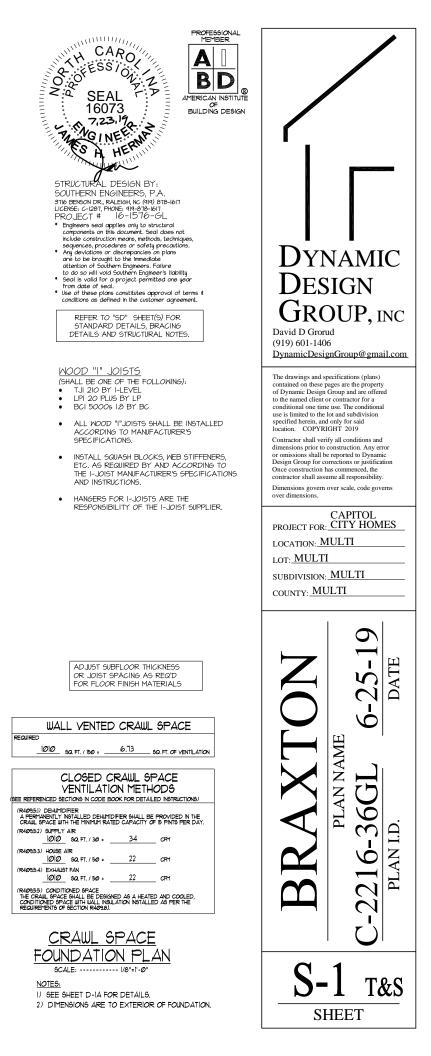

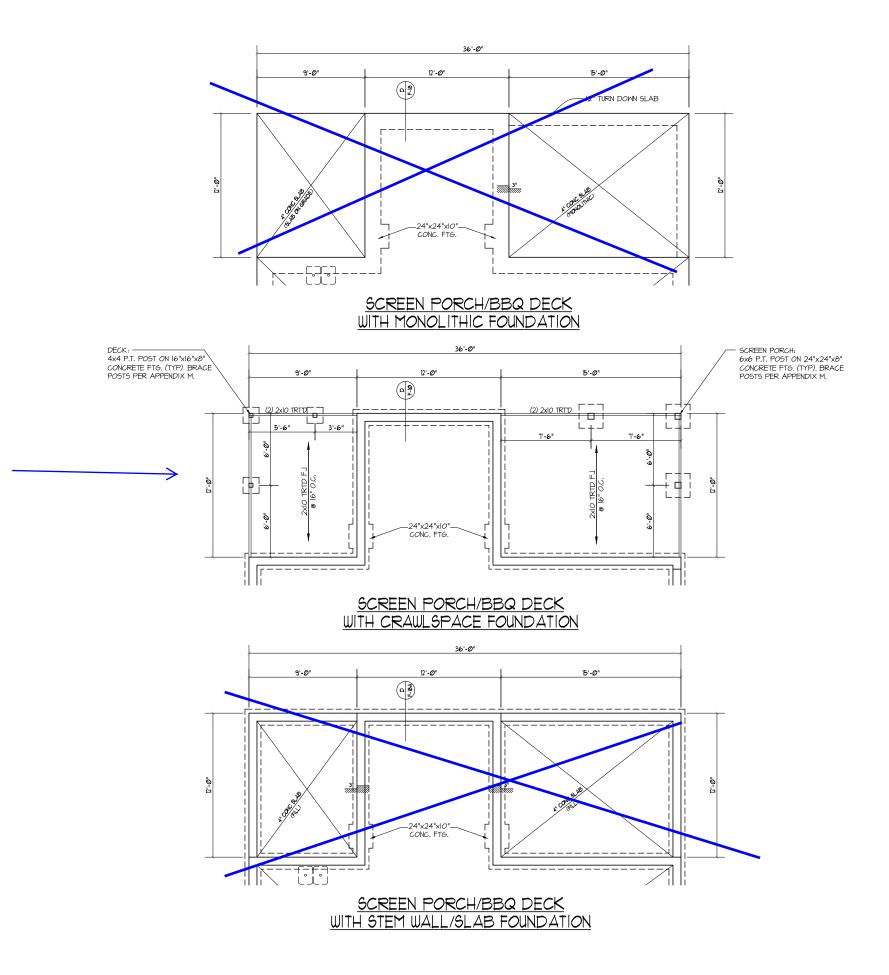



PROFESSIONAL MEMBER A BD AMERICAN INSTITUTE OF BUILDING DESIGN

- STRUCTURAL DESIGN BY:
 SOUTHERN ENGINEERS, P.A.
 STID BERGON DR., RALEIGH, NC (914) 978-1617
 LICENEE. C1287, FHONE: 914-978-1617
 PROJECT # 16-1576-6L
 Engineers seal applies only to structural commons on this document. Seal does not include construction means, methods, techniques, sequences, procedures or sofely precations.
 Any deviations or discrepancies on plans are to be brought to the immediate attention of Southern Engineers's liability.
 Seal Is valid for a project permitted one year from date of seal.
 Use of these plans constitutes approval of terms 4 conditions as defined in the customer agreement.

REFER TO "SD" SHEET(S) FOR STANDARD DETAILS, BRACING DETAILS AND STRUCTURAL NOTES.


SCREEN PORCH/BBQ DECK FOUNDATION OPTIONS

SCALE: ----- 1/8"=1'-Ø"

NOTES:

1) SEE SHEET D-1A FOR DETAILS.

2) DIMENSIONS ARE TO EXTERIOR OF FOUNDATION.

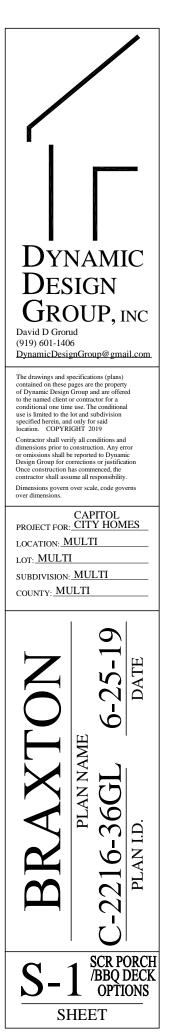

HEADER / BEAM NOTES

- I. ALL EXTERIOR AND LOAD BEARING HEADERS SHALL BE MIN. (2)2x6 (4" WALL) OR (3)2x6 (6' WALL) WITH (I) SUPPORT STUD AND (I) KING STUD, UNLESS NOTED OTHERWISE.
- 2. THE NUMBER SHOWN AT BEAM AND HEADER SUPPORTS INDICATES THE NUMBER OF SUPPORT STUDS REQUIRED IN STUD POCKET OR COLUMN. THE NUMBER OF KING STUDS FOR HEADERS SHALL BE ACCORDING TO ITEM "d" IN TABLE R602.3(5) OR AS BELOW: UP TO 4' SPAN: (I) KING STUD E/E
- OVER 4' AND TO 8' SPAN: (2) KING STUDS F/F
- OVER 8' AND UP TO IO' SPAN: (3) KING
- STUDS E/E OVER 10' SPAN: (4) KING STUDS E/E

FRAMING NOTES


NC (2018 NCRC): Wind: 115-120 mph


- I. BRACING METHOD AND TYPE; CONTINUOUSLY SHEATHED WSP; CS-WSP NOTE THAT THE WALL BRACING AMOUNT PROVIDED ON THE PLANS (DETAILS AND SPECIFICATIONS) IS GREATER THAN THE AMOUNT OF WALL BRACING REQUIRED BY THE CODE. SEE NOTES BELON FOR DETAILS AND SPECIFICATIONS FOR WALL BRACING AND WALL FRAMING.
- 2. EXTERIOR WALL SHEATHING: WALLS SHALL BE BRACED BY SHEATHING WALLS ON ALL STORIES WITH WOOD STRUCTURAL PANEL SHEATHING (WSP) (EXPOSURE B: 7/16". EXPOSURE C: 15/32"). SHEATHING SHALL BE ATTACHED WITH 8d NAILS AT A 6"/12" NAILING PATTERN (6" OC AT PANEL EDGES AND 12" OC AT INTERMEDIATE SUPPORTS). INSTALL BLOCKING AT ALL PANEL EDGES.
- 3. WSP SHEATHING SHALL EXTEND TO THE UPPERMOST DOUBLE BEARING PLATE. BLOCK AT ROOF AND ATTACH BRACED WALLS PER CODE. WSP SHEATHING BETWEEN FLOORS SHALL BE SPLICED ALONG CONTINUOUS BAND OR THE WEP SHEATHING MAY BE SPLICED ACROSS STUDS (CONTINUOUS ACROSS FLOOR SYSTEM) WITH BLOCKING AT PANEL EDGES. (MINIMUM 12" BEYOND FLOOR BREAK) OR OTHER APPROVED METHOD
- 4. <u>"HD" = HOLDOWN:</u> HOLD-DOWN DEVICE (NOTED AS "HD" ON PLANS) SHALL BE AN 800 POUND CAPACITY ASSEMBLY AS NOTED ON PLANS. SEE DETAILS FOR HD ASSEMBLY
- *GROUND/FIRST FLOOR: USE "HD HOLD-DOWN DETAIL" ON SD SHEET (OR EQUIV.)
- STRAP DOWN ACROSS THE BAND AND DOWN TO A STUD BELOW OR HEADER BELOW. EXTEND STRAP 7" MIN ALONG EACH STUD (OR HEADER) AND ATTACH EACH END W/ (7) 8d NAILS.
- 5. INTERIOR BRACED WALL: (NOTED AS "IBW" ON PLANS) ATTACH 1/2" GYPSUM BOARD (GB) ON EACH SIDE OF WALL WITH A MIN. OF 5d COOLER NAILS OR #6 SCREWS @ T" O.C. ALONG THE EDGES AND AT INTERMEDIATE SUPPORTS.
- 6. INTERIOR BRACED WALL-WOOD STRUCTURAL PANEL: (NOTED AS "IBW-WSP" ON PLANS). ATTACH ONE SIDE WITH 1/6" WSP SHEATHING MITH & NAILS AT A 6"/12" NAILING PATTERN (6" OC AT PANEL EDGES AND 12" OC AT INTERMEDIATE SUPPORTS). INSTALL BLOCKING AT ALL PANEL EDGES. ATTACH GB OVER MSP AS REQUIRED. ATTACH OPPOSITE SIDE WITH 1/2" GB WITH A MIN. OF 5d COOLER NAILS OR $\#_{6C}$ SCREWS @ 7" OC ALONG THE EDGES AND AT INTERMEDIATE SUPPORTS. CS PORTAL F

END COND


SD


NTG









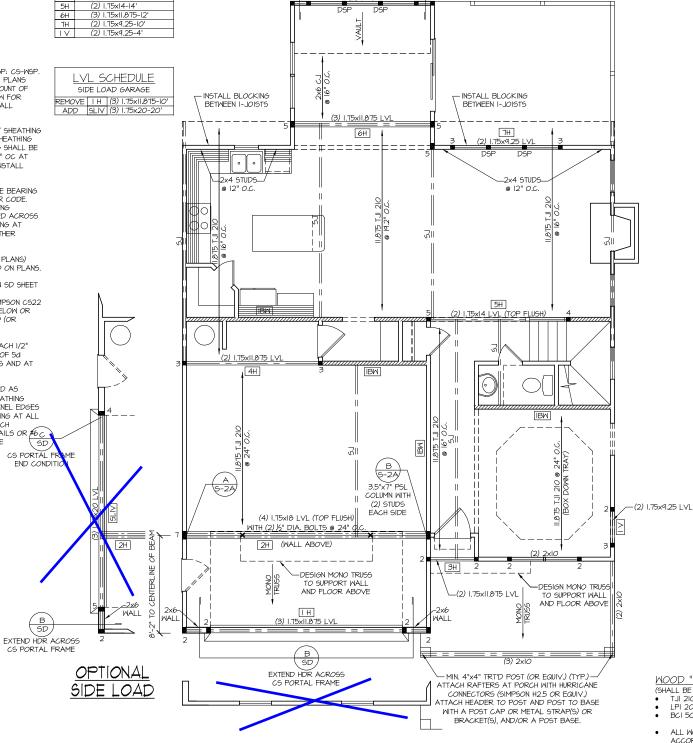


́в

EXTEND HDR ACROSS

CS PORTAL FRAME


SD

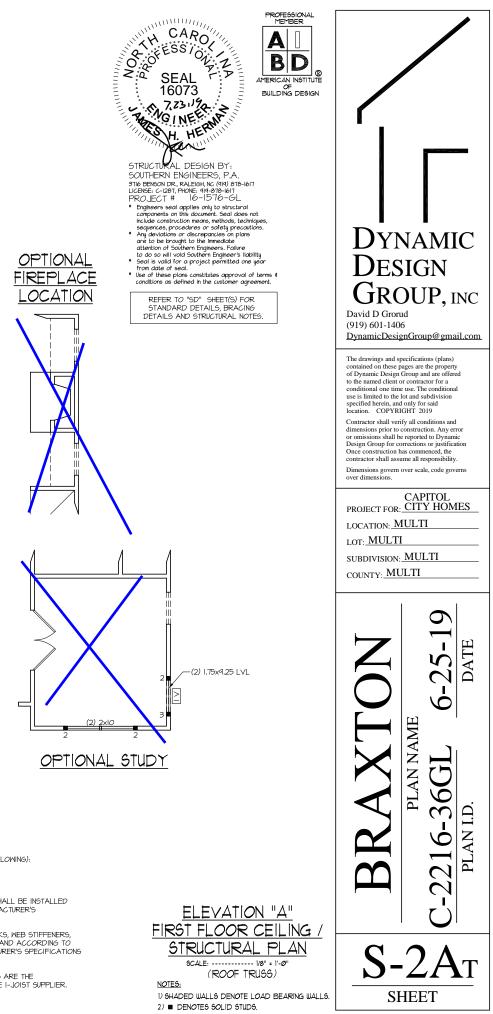




WOOD "I" JOISTS (SHALL BE ONE OF THE FOLLOWING): TJI 210 BY I-LEVEL

- LPI 20 PLUS BY LP
- BCI 50005 1.8 BY BC
 - ALL WOOD "I"JOISTS SHALL BE INSTALLED ACCORDING TO MANUFACTURER'S SPECIFICATIONS.
 - INSTALL SQUASH BLOCKS WEB STIFFENERS ETC. AS REQUIRED BY AND ACCORDING TO THE I-JOIST MANUFACTURER'S SPECIFICATIONS AND INSTRUCTIONS
 - HANGERS FOR I-JOISTS ARE THE . RESPONSIBILITY OF THE I-JOIST SUPPLIER

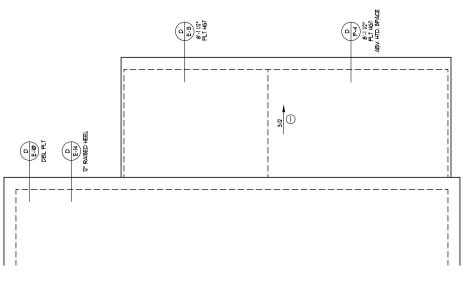



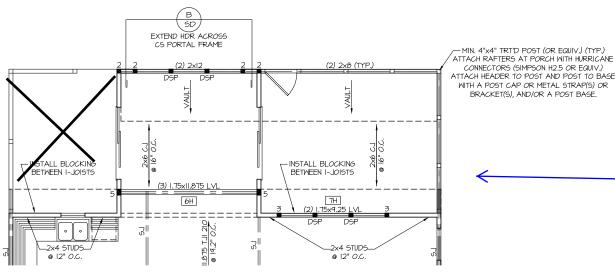

CEILING / STRUCTURAL PLAN


CONNECTORS (SIMPSON H2.5 OR EQUIV.) ATTACH HEADER TO POST AND POST TO BASE WITH A POST CAP OR METAL STRAP(S) OR BRACKET(S), AND/OR A POST BASE.




REFER TO "SD" SHEET(S) FOR STANDARD DETAILS, BRACING DETAILS AND STRUCTURAL NOTES.




NOTES: 1) SHADED WALLS DENOTE LOAD BEARING WALLS. 2) DENOTES SOLID STUDS. 3) SEE SHEET D-IB FOR DETAILS.

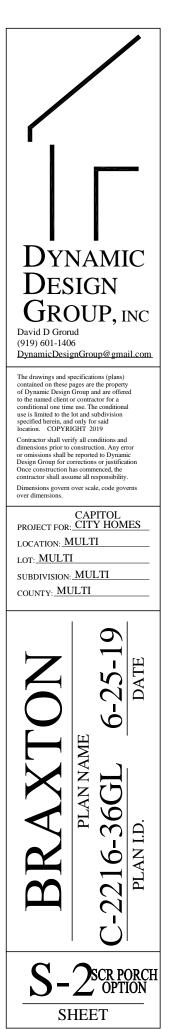




FRAMING NOTES NC (2018 NCRC): Wind: 115-120 mph

- BRACING METHOD AND TYPE: CONTINUOUSLY SHEATHED WSP: CS-WSP. NOTE THAT THE WALL BRACING AMOUNT PROVIDED ON THE PLANS (DETAILS AND SPECIFICATIONS) IS GREATER THAN THE AMOUNT OF WALL BRACING REQUIRED BY THE CODE. SEE NOTES BELOW FOR DETAILS AND SPECIFICATIONS FOR WALL BRACING AND WALL FRAMING
- EXTERIOR WALL SHEATHING: WALLS SHALL BE BRACED BY SHEATHING WALLS ON ALL STORIES WITH WOOD STRUCTURAL PANEL SHEATHING (WSP) (EXPOSURE B: 17/16". EXPOSURE C: 15/32"). SHEATHING SHALL BE ATTACHED WITH 8d NAILS AT A 6"/12" NAILING PATTERN (6" OC AT PANEL EDGES AND 12" OC AT INTERMEDIATE SUPPORTS). INSTALL BLOCKING AT ALL PANEL EDGES.
- 3. WSP SHEATHING SHALL EXTEND TO THE UPPERMOST DOUBLE BEARING PLATE. BLOCK AT ROOF AND ATTACH BRACED WALLS PER CODE. WSP SHEATHING BETWEEN FLOORS SHALL BE SPLICED ALONG CONTINUOUS BAND OR THE WSP SHEATHING MAY BE SPLICED ACROSS STUDS (CONTINUOUS ACROSS FLOOR SYSTEM) WITH BLOCKING AT PANEL EDGES. (MINIMUM 12" BEYOND FLOOR BREAK) OR OTHER APPROVED METHOD.
- 4. "HD" = HOLDOWN: HOLD-DOWN DEVICE (NOTED AS "HD" ON PLANS) SHALL BE AN 800 POUND CAPACITY ASSEMBLY AS NOTED ON PLANS. SEE DETAILS FOR HD ASSEMBLY.
- **GROUND/FIRST FLOOR: USE "HD HOLD-DOWN DETAIL" ON SD SHEET (OR EQUIV.)
- **UPPER FLOORS: ATTACH BASE OF KING STUD WITH A SIMPSON CS22 STRAP DOWN ACROSS THE BAND AND DOWN TO A STUD BELOW OR HEADER BELOW. EXTEND STRAP 7" MIN ALONG EACH STUD (OR HEADER) AND ATTACH EACH END W/ (7) 8d NAILS.
- 5. INTERIOR BRACED WALL: (NOTED AS "IBW" ON PLANS) ATTACH 1/2" GYPSUM BOARD (GB) ON EACH SIDE OF WALL WITH A MIN. OF 5d COOLER NAILS OR #6 SCREMS ($7^{\prime\prime}$ O.C. ALONG THE EDGES AND AT INTERMEDIATE SUPPORTS.
- 6. INTERIOR BRACED WALL-WOOD STRUCTURAL PANEL: (NOTED AS "IBM-MSP" ON PLANS). ATTACH ONE SIDE WITH ${\cal H}_6$ " MSP SHEATHING WITH 8d NAILS AT A 6"/12" NAILING PATTERN (6" OC AT PANEL EDGES AND 12" OC AT INTERMEDIATE SUPPORTS). INSTALL BLOCKING AT ALL PANEL EDGES. ATTACH GB OVER WSP AS REQUIRED. ATTACH OPPOSITE SIDE WITH 1/2" GB WITH A MIN. OF 5d COOLER NAILS OR #6 SCREWS @ 7" OC ALONG THE EDGES AND AT INTERMEDIATE SUPPORTS

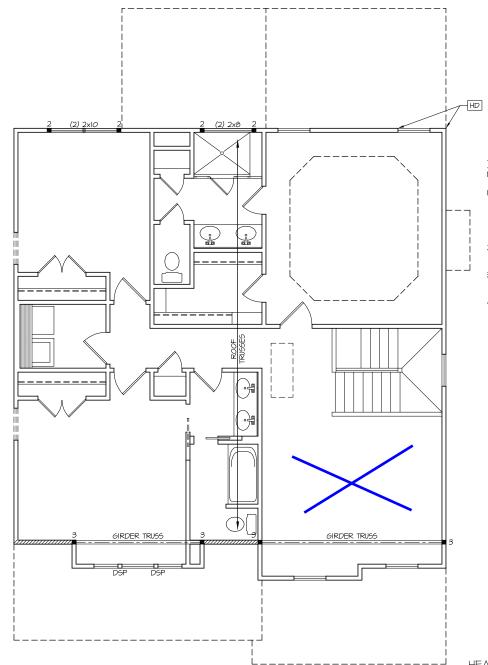


TRUSS SYSTEM REQUIREMENTS NC (2018 NCRC): Wind: 115-120 mph

- TRUSS SYSTEM LAYOUTS (PLACEMENT PLANS) SHALL BE DESIGNED IN ACCORDANCE WITH SEALED STRUCTURAL PLANS. ANY NEED TO CHANGE TRUSSES SHALL BE COORDINATED WITH SOUTHERN ENGINEERS
- TRUSS SCHEMATICS (PROFILES) SHALL BE 2. PREPARED AND SEALED BY TRUSS MANUFACTURER
- ALL TRUSSES SHALL BE DESIGNED FOR BEARING З. ON SPF #2 OR #3 PLATES OR LEDGERS (UNO).
- ALL REQUIRED ANCHORS FOR TRUSSES DUE TO UPLIET OR BEARING SHALL MEET THE REQUIREMENTS AS SPECIFIED ON THE TRUSS SCHEMATICS.

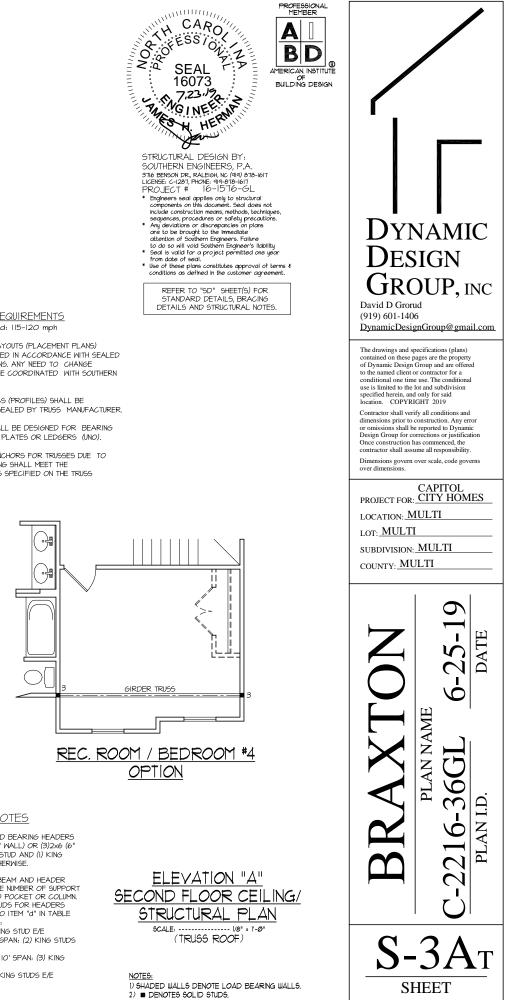

HEADER / BEAM NOTES


- ALL EXTERIOR AND LOAD BEARING HEADERS SHALL BE MIN. (2)2×6 (4" WALL) OR (3)2×6 (6" WALL) WITH (I) SUPPORT STUD AND (I) KING STUD, UNLESS NOTED OTHERWISE
- THE NUMBER SHOWN AT BEAM AND HEADER SUPPORTS INDICATES THE NUMBER OF SUPPORT STUDS REQUIRED IN STUD POCKET OR COLUMN. THE NUMBER OF KING STUDS FOR HEADERS SHALL BE ACCORDING TO ITEM "d" IN TABLE R602,3(5) OR AS BELOW:
- UP TO 4' SPAN: (I) KING STUD E/E OVER 4' AND TO 8' SPAN: (2) KING STUDS E/E
 - OVER 8' AND UP TO IO' SPAN: (3) KING STUDS E/E
- OVER IO' SPAN: (4) KING STUDS E/E

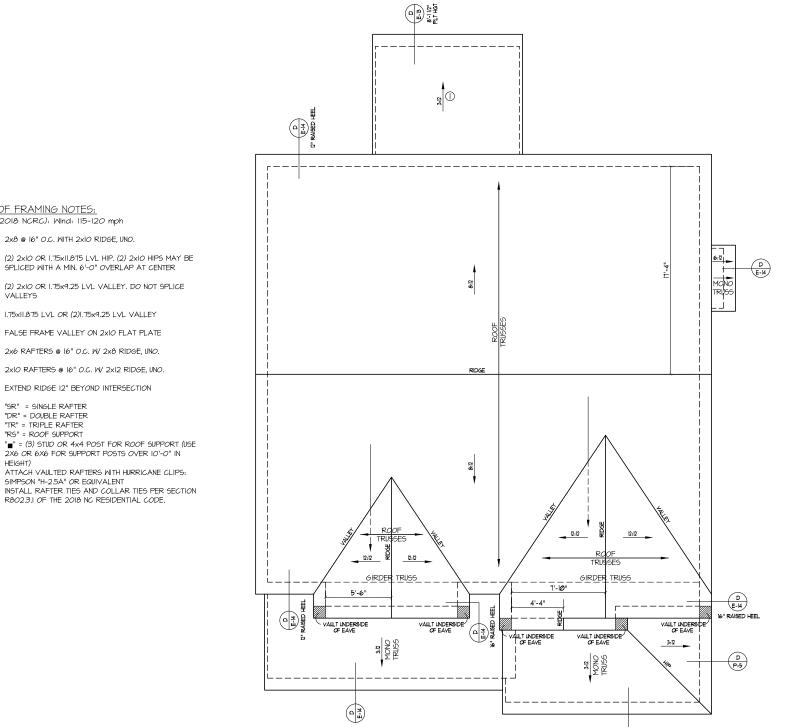

ROOF FRAMING NOTES: NC (2018 NCRC): Wind: 115-120 mph

- (1.) 2×8 @ 16" O.C. WITH 2×10 RIDGE, UNO.
- 2) (2) 2x10 OR 1.75x11.875 LVL HIP. (2) 2x10 HIPS MAY BE SPLICED WITH A MIN. 6'-O" OVERLAP AT CENTER
- 3. (2) 2x10 OR 1.75x9.25 LVL VALLEY. DO NOT SPLICE VALLEYS
- (4) 1.75x11.875 LVL OR (2)1.75x9.25 LVL VALLEY
- 5. FALSE FRAME VALLEY ON 2x10 FLAT PLATE
- 2x6 RAFTERS @ 16" O.C. W/ 2x8 RIDGE, UNO. 6)
- 1. 2x10 RAFTERS @ 16" O.C. W/ 2x12 RIDGE, UNO.
- 8. EXTEND RIDGE 12" BEYOND INTERSECTION
- "SR" = SINGLE RAFTER "DR" = DOUBLE RAFTER
- "TR" = TRIPLE RAFTER
- 2X6 OR 6X6 FOR SUPPORT POSTS OVER IO'-O" IN HEIGHT)
- ATTACH VAULTED RAFTERS WITH HURRICANE CLIPS: SIMPSON "H-2.5A" OR EQUIVALENT
- INSTALL RAFTER TIES AND COLLAR TIES PER SECTION R802.3.1 OF THE 2018 NC RESIDENTIAL CODE.

REQUIRED PROVIDED

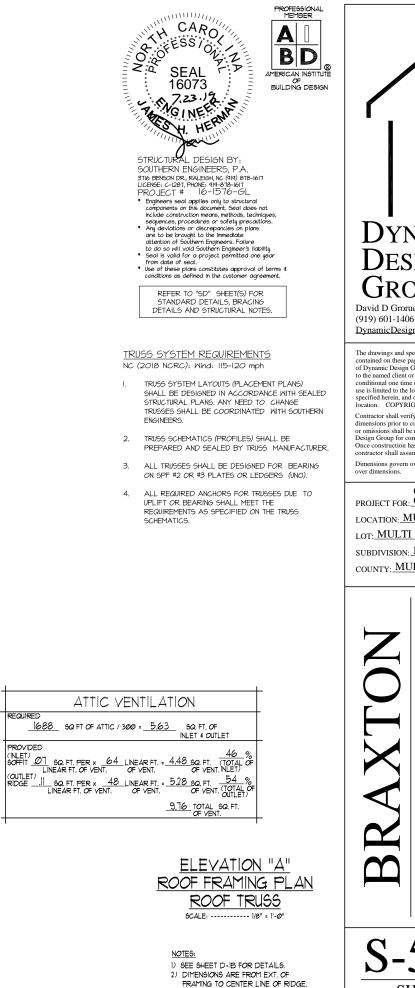


			-				
DYNAMIC DESIGN GROUP, INC David D Grorud (919) 601-1406 DynamicDesignGroup@gmail.com							
The drawings and specifications (plans) contained on these pages are the property of Dynamic Design Group and are offered to the named client or contractor for a conditional one time use. The conditional use is limited to the lot and subdivision specified herein, and only for said location. COPYRIGHT 2019 Contractor shall verify all conditions and dimensions prior to construction. Any error or or omissions shall be reported to Dynamic Design Group for corrections or justification Once construction has commenced, the contractor shall assume all responsibility. Dimensions govern over scale, code governs							
CAPITOL PROJECT FOR: CITY HOMES LOCATION: MULTI LOT: MULTI SUBDIVISION: MULTI COUNTY: MULTI							
ION	ЛЕ	6-25-19	DATE				
BRAX	PLAN NAME	C-2216-36GL	PLAN I.D.				
S-5AT SHEET							

STRUCTURAL NOTES


NC (2018 NCRC): Wind: 115-120 mph

- ENGINEER'S SEAL APPLIES ONLY TO STRUCTURAL COMPONENTS INCLUDING ROOF RAFTERS, HIPS VALLEYS, RIDGES, FLOORS, WALLS, BEAMS AND HEADERS, COLUMNS, CANTILEVERS, OFFSET LOAD BEARING MALLS, PIER & GIRDER SYSTEM, FOOTING, AND PILING SYSTEM. ENGINEER'S SEAL DOES NOT CERTIFY DIMENSIONAL ACCURACY OR ARCHITECTURAL LAYOUT INCLUDING ROOF SYSTEM. ALL REQUIREMENTS FOR PROFESSIONAL CERTIFICATION SHALL BE PROVIDED BY THE APPROPRIATE PROFESSIONAL. SOUTHERN ENGINEERS, P.A. CERTIFIES ONLY THE STRUCTURAL COMPONENTS AS SPECIFICALLY STATED.
- 2. ALL CONSTRUCTION SHALL CONFORM TO THE LATEST REQUIREMENTS OF RESIDENTIAL CODE, PLUS ALL LOCAL CODES AND REGULATIONS. THE STRUCTURAL ENGINEER IS NOT RESPONSIBLE FOR AND MILL NOT HAVE CONTROL OF, CONSTRUCTION MEANS, METHODALED STOCHNOLES, SEQUENCES OR PROCEDURES, OR FOR SAFETY PRECAUTIONS AND PROGRAMS IN CONNECTION WITH THE CONSTRUCTION WORK, NOR WILL THE ENGINEER BE RESPONSIBLE FOR THE CONTRACTOR'S FAILURE TO CARRY OUT THE CONSTRUCTION WORK IN ACCORDANCE WITH THE CONTRACT DOCUMENTS. "CONSTRUCTION REVIEW" SERVICES ARE NOT PART OF OUR CONTRACT ALL MEMBERS SHALL BE FRAMED ANCHORED, TIED AND BRACED IN ACCORDANCE WITH GOOD CONSTRUCTION PRACTICE AND THE BUILDING CODE.
- DESIGN LOADS (LISTED AS: LIVE LOAD, DEAD LOAD, DEFLECTION)
 ROOMS OTHER THAN SLEEPING ROOMS: (40 PSF, IO PSF, L/360)
- SLEEPING ROOMS: (30 PSF, 10 PSF, L/360) ATTIC WITH PERMANENT STAIR (40 PSE 10 PSE 1/360)
- ATTIC WITHOUT PERMANENT STAIR: (20 PSF, IO PSF, L/360)
- ATTIC WITHOUT STORAGE: (IO PSF, IO PSF, L/240)
- STAIRS: (40 PSF, 10 PSF, L/360)
- EXTERIOR BALCONIES: (60 PSF, 10 PSF, L/360) DECKS: (40 PSF, 10 PSF, L/360)
- GUARDRAILS AND HANDRAILS: (200 LBS)
- PASSSENGER VEHICLE GARAGES: (50 PSF. 10 PSF. L/360) FIRE ESCAPES: (40 PSF, 10 PSF, L/360)
- SNOW: (20 PSF)
- 4. WALLS SHALL BE BRACED BY SHEATHING WALLS ON ALL STORIES WITH WOOD STRUCTURAL PANELS. SEE FRAMING NOTES FOR THICKNESS AND NAILING REQUIREMENTS
- 5. SEE APPENDIX M (DCA6) FOR EXTERIOR DECK REQUIREMENTS INCLUDING ATTACHMENTS FOR LATERAL LOADS
- CONCRETE SHALL HAVE A MINIMUM 28 DAY STRENGTH OF 3000 PSI AND A MAXIMUM SLUMP OF 5 INCHES UNLESS NOTED OTHERWISE (UNO). AIR ENTRAINED PER TABLE 402.2. ALL CONCRETE SHALL BE PROPORTIONED, MIXED, HANDLED, SAMPLED, TESTED, AND PLACED IN ACCORDANCE WITH ACI STANDARDS. ALL SAMPLES FOR PUMPING SHALL BE TAKEN FROM THE EXIT END OF THE PUMP, CONTROL JOINTS IN SLABS SHALL BE SPACED ON A GRID OF +-30 TIMES THE DEPTH (D). CONTROL JOINTS SHALL BE SAWCUT TO A DEPTH OF I/D. (I.E. 4" CONCRETE SLABS SHALL HAVE 1/4" DEEP CONTROL JOINTS SAWCUT IN SLAB ON A +-10'-0" X +-10'-0" GRID).
- ALLOWABLE SOIL BEARING PRESSURE ASSUMED TO BE 2000 PSF. THE CONTRACTOR MUST 7. CONTACT A GEOTECHNICAL ENGINEER AND THE STRICTUAL ENGINEER IF UNSATISFACTORY SUBSURFACE CONDITIONS ARE ENCOUNTERED. THE SURFACE AREA ADJACENT TO THE FOUNDATION WALL SHALL BE PROVIDED WITH ADEQUATE DRAINAGE, AND SHALL BE GRADED SO AS TO DRAINSURFACE WATER AWAY FROM FOUNDATION WALLS.
- 8. ALL FRAMING LUMBER SHALL BE SPF #2 (Fb = 875 PSI) UNLESS NOTED OTHERWISE (UNO), ALL TREATED LUMBER SHALL BE SYP # 2. PLATE MATERIAL MAY BE SPF # 3 OR SYP #3 (Fc(perp) = 425 PSI - MIN)
- 9. L.V.L. SHALL BE LAMINATED VENEER LUMBER: Fb=2600 PSI, Fv=285 PSI, E=1,9x10 PSI,
- 41.
 PSL.
 SHALL BE PARALLEL STRAND LUMBER: Fb=2400 PSI, Fv=240 PSI, E=2,0x10 PSI,


 42.
 LS.L.
 SHALL BE LAMINATED STRAND LUMBER: Fb=2250 PSI, Fv=400 PSI, E=1.55x10 PSI.
- INSTALL ALL CONNECTIONS PER MANUFACTURERS INSTRUCTIONS. IQ. ALL ROOF TRUES AND I- WIST LAYOUTS SHALL BE PREPARED IN ACCORDANCE WITH THE
- SEALED STRUCTURAL DRAWINGS. TRUSSES AND I-JOIST SHALL BE INSTALLED ACCORDING TO THE MANUFACTURE'S SPECIFICATIONS. ANY CHANGE IN TRUSS OR I-JOIST LAYOUT SHALL BE COORDINATED WITH SOUTHERN ENGINEERS.
- ALL STRUCTURAL STEEL SHALL BE ASTM A-36. STEEL BEAMS SHALL BE SUPPORTED AT EACH END WITH A MINIMUM BEARING LENGTH OF 3 1/2" INCHES AND FULL FLANGE WIDTH. PROVIDE SOLID BEARING FROM BEAM SUPPORT TO FOUNDATION. BEAMS SHALL BE ATTACHED TO EACH SUPPORT WITH TWO LAG SCREWS (1/2" DIAMETER x 4" LONG) LATERAL SUPPORT IS CONSIDERED. ADEQUATE PROVIDING THE JOST ARE TO HAILED TO THE SOLE PLATE, AND SOLE PLATE IS NAILED OR BOLTED TO THE BEAM FLANGE @ 48" O.C. ALL STEEL TIBING SHALL BE ASTM A500. LAP ALL REBAR SPLICES 30 BAR DIAMETERS.
- 12. REBAR SHALL BE DEFORMED STEEL, ASTMOIS, GRADE 60.
- 13 FLITCH BEAMS SHALL BE BOLTED TOGETHER VAING (2) ROWS OF 1/2" DIAMETER BOLTS (ASTM A325) WITH WASHERS PLACED WIDER THE THREADED END OF BOLT. BOLTS SHALL BE SPACED AT 24" O.C. (MAX), AND STAGGERED AT THE TOP AND BOTTOM OF BEAM (2" EDGE DISTANCE), WITH 2 BOLTS LOCATED AT 6" FROM EACH END.
- 14. BRICK LINTELS (WHEN REQUIRED) SHALL BE 3 1/2"x3 1/2"x1/4" STEEL ANGLE FOR UP TO 6'-0" SPAN AND 6"x4"x5/16" STEEL ANGLE WITH 6" LEG VERTICAL FOR SPANS UP TO 9'-0". SEE PLANS FOR SPANS OVER 9'-O". SEE ALSO SECTION R703.7.3 LINTELS.

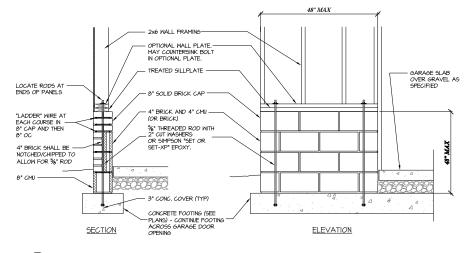


GARAGE 'WING WALL' REINFORCING Ά (CODE REFERENCE: IRC FIGURE R602.10.5.3)

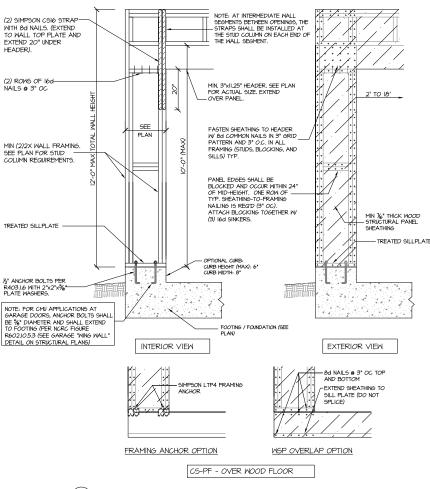



(B) CS-PF: CONTINUOUS PORTAL FRAME CONSTRUCTION DETAIL AND APPLICATION BASED ON NCRC FIGURE R602.IO.I - PORTAL FRAME CONSTRUCTION

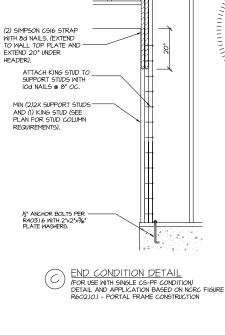


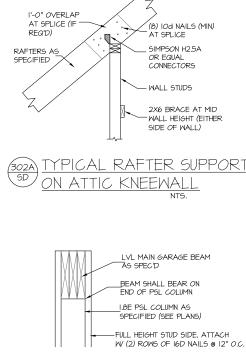



(204D)	TYP.	GARAGE	BEA
(sd)			

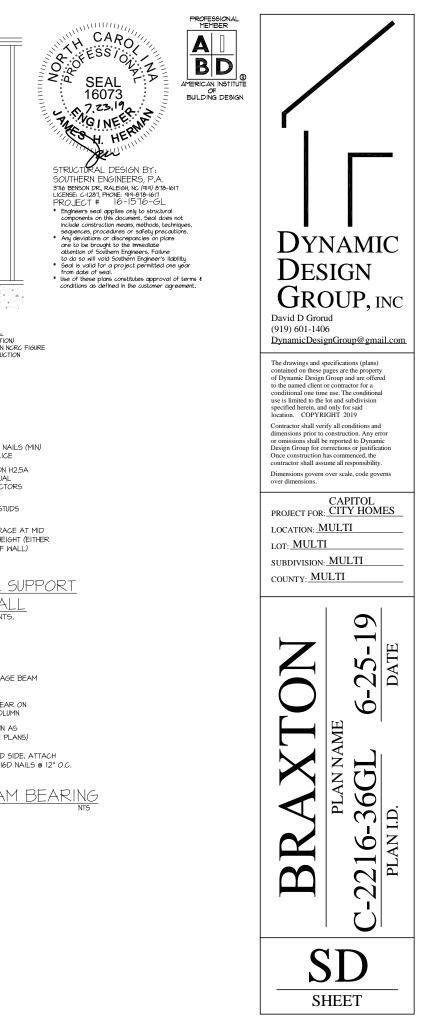

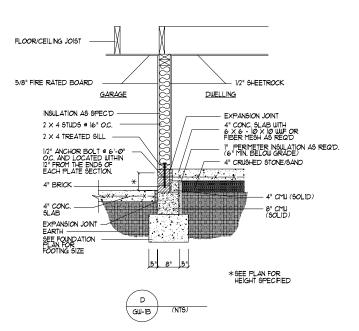

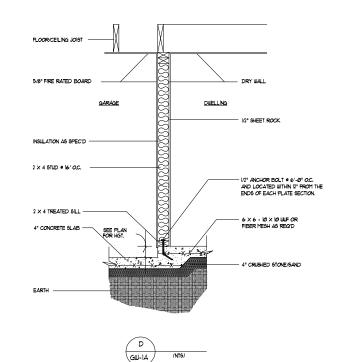

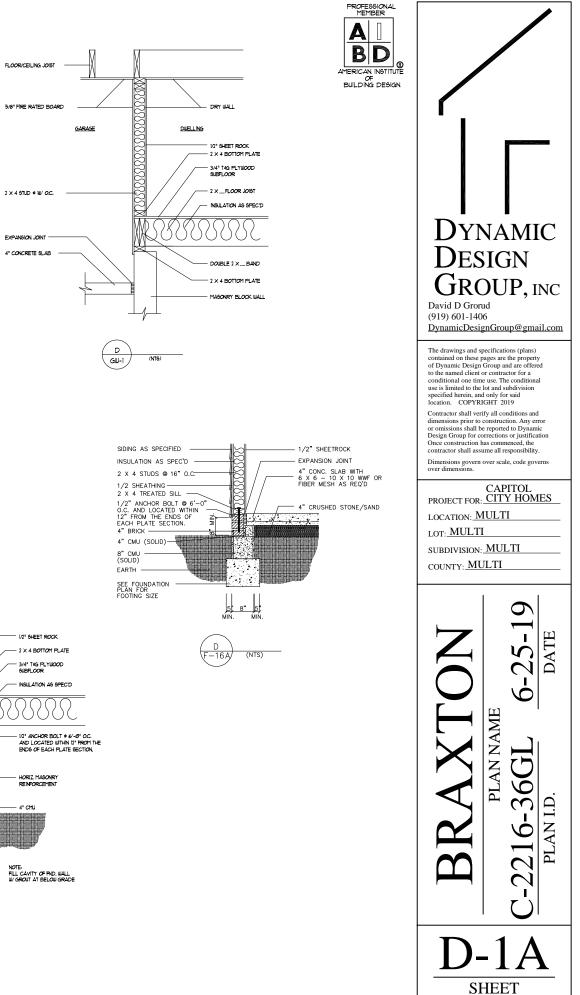



SIDING AS SPECIFIED

2 × 4 STUDS # 16" O.C.

2 × 4 TREATED SILL

8" SOLID MASONRY CA

1/2 SHEATHING

4" BRICK

4" CMU

FARTH

SEE FOUNDATION PLAN FOR FOOTING SIZE

F-16 ,

HORIZ MASONRY

D

F-18A

