

Block up walls @ each end of BM1 / RUN 2x10 BEAM ON TOP OF BOTTOM CHORD.

5-1/2" Trey Ceiling Built Into Truss

8'-0" Light Storage / HVAC Platform

### Truss Placement Plan SCALE: 1/4" = 1'-0"

▲ = Denotes Left End of Truss  
(Reference Engineered Truss Drawing)

All Truss Reactions are Less than 3,000 lbs. Unless Noted Otherwise.

○ -- Denotes Reaction Greater than 3,000 lbs. Reaction / # of Studs

■	HUS28	USP	5		16d/3-1/2"	16d/3-1/2"
●	MSH422	USP	2	Varies	10d/3"	10d/3"

Estimation			
Name	Selection	Formula	Calculation
Roof Area	1st Floor	Roof Area	2046.74
Roof Decking	1st Floor	Roof Decking	70

BEAM LEGEND					
PlotID	Length	Product	Plies	Net Qty	Fab Type
2852 TWIN	7' 0"	1-3/4" x 9-1/4" LVL Kerto-S	2	4	FF
GDH (dropped)	12' 0"	2x12 SPF No.2	2	2	FF

LOAD CHART FOR JACK STUDS			
TRUSS SPACING (ft)	TRUSS TYPE	TRUSS SIZE	MAXIMUM LOAD (lb)
1700	1	2550	3400
3400	2	5100	6500
5100	3	7650	10500
6800	4	10200	13600
8500	5	12750	17000
10200	6	15300	
11900	7		
13600	8		
15300	9		

BUILDER	Weaver Development
JOB NAME	Sinawa Job
PLAN	Leyland "A"
SEAL DATE	Seal Date
QUOTE #	Quote #
JOB #	J0522-2818

CITY / CO.	Lillington / Harnett
ADDRESS	Manor Hill Rd.
MODEL	ROOF
DATE REV.	/ /
DRAWN BY	Lenny Norris
SALES REP.	Lenny Norris



THIS IS A TRUSS PLACEMENT DIAGRAM ONLY. These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult BCSH-B1 and BCSH-B3 provided with the truss delivery package or online @ sbcindustry.com

Bearing reactions less than or equal to 3000# are deemed to comply with the prescriptive Code requirements. The contractor shall refer to the attached Tables ( derived from the prescriptive Code requirements ) to determine the minimum foundation size and number of wood studs required to support reactions greater than 3000# but not greater than 15000#. A registered design professional shall be retained to design the support system for any reaction that exceeds those specified in the attached Tables. A registered design professional shall be retained to design the support system for all reactions that exceed 15000#.

Signature: Lenny Norris  
Lenny Norris

**ROOF & FLOOR TRUSSES & BEAMS**

Reilly Road Industrial Park  
Fayetteville, N.C. 28309  
Phone: (910) 864-8787  
Fax: (910) 864-4444

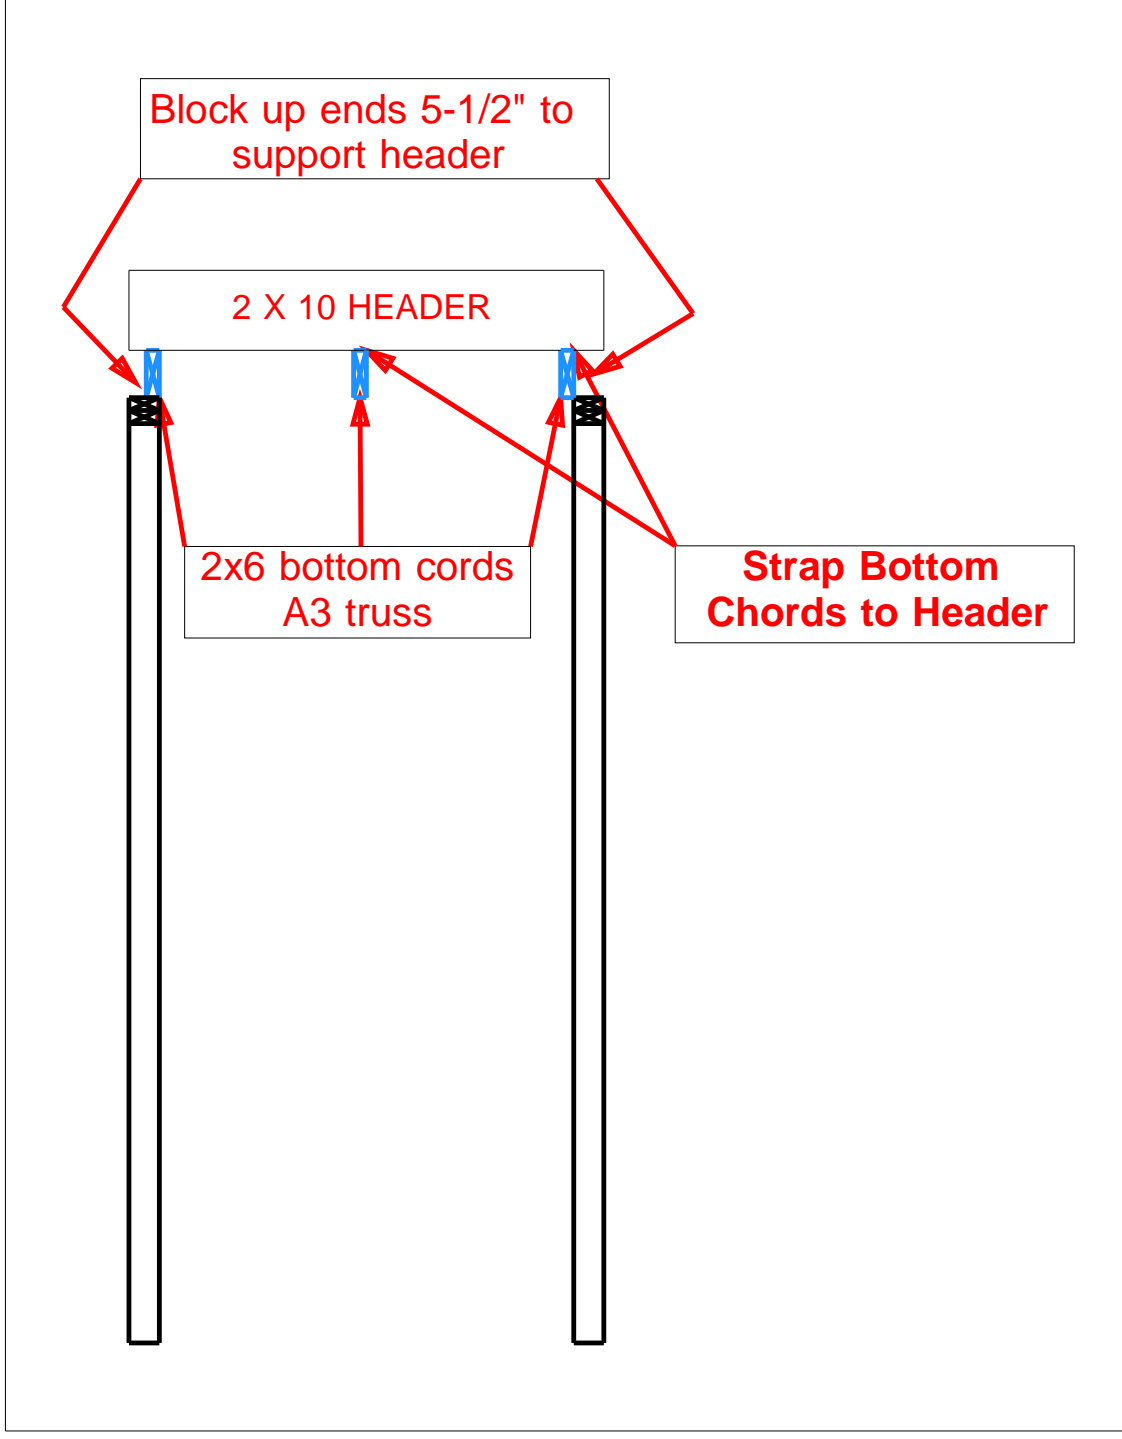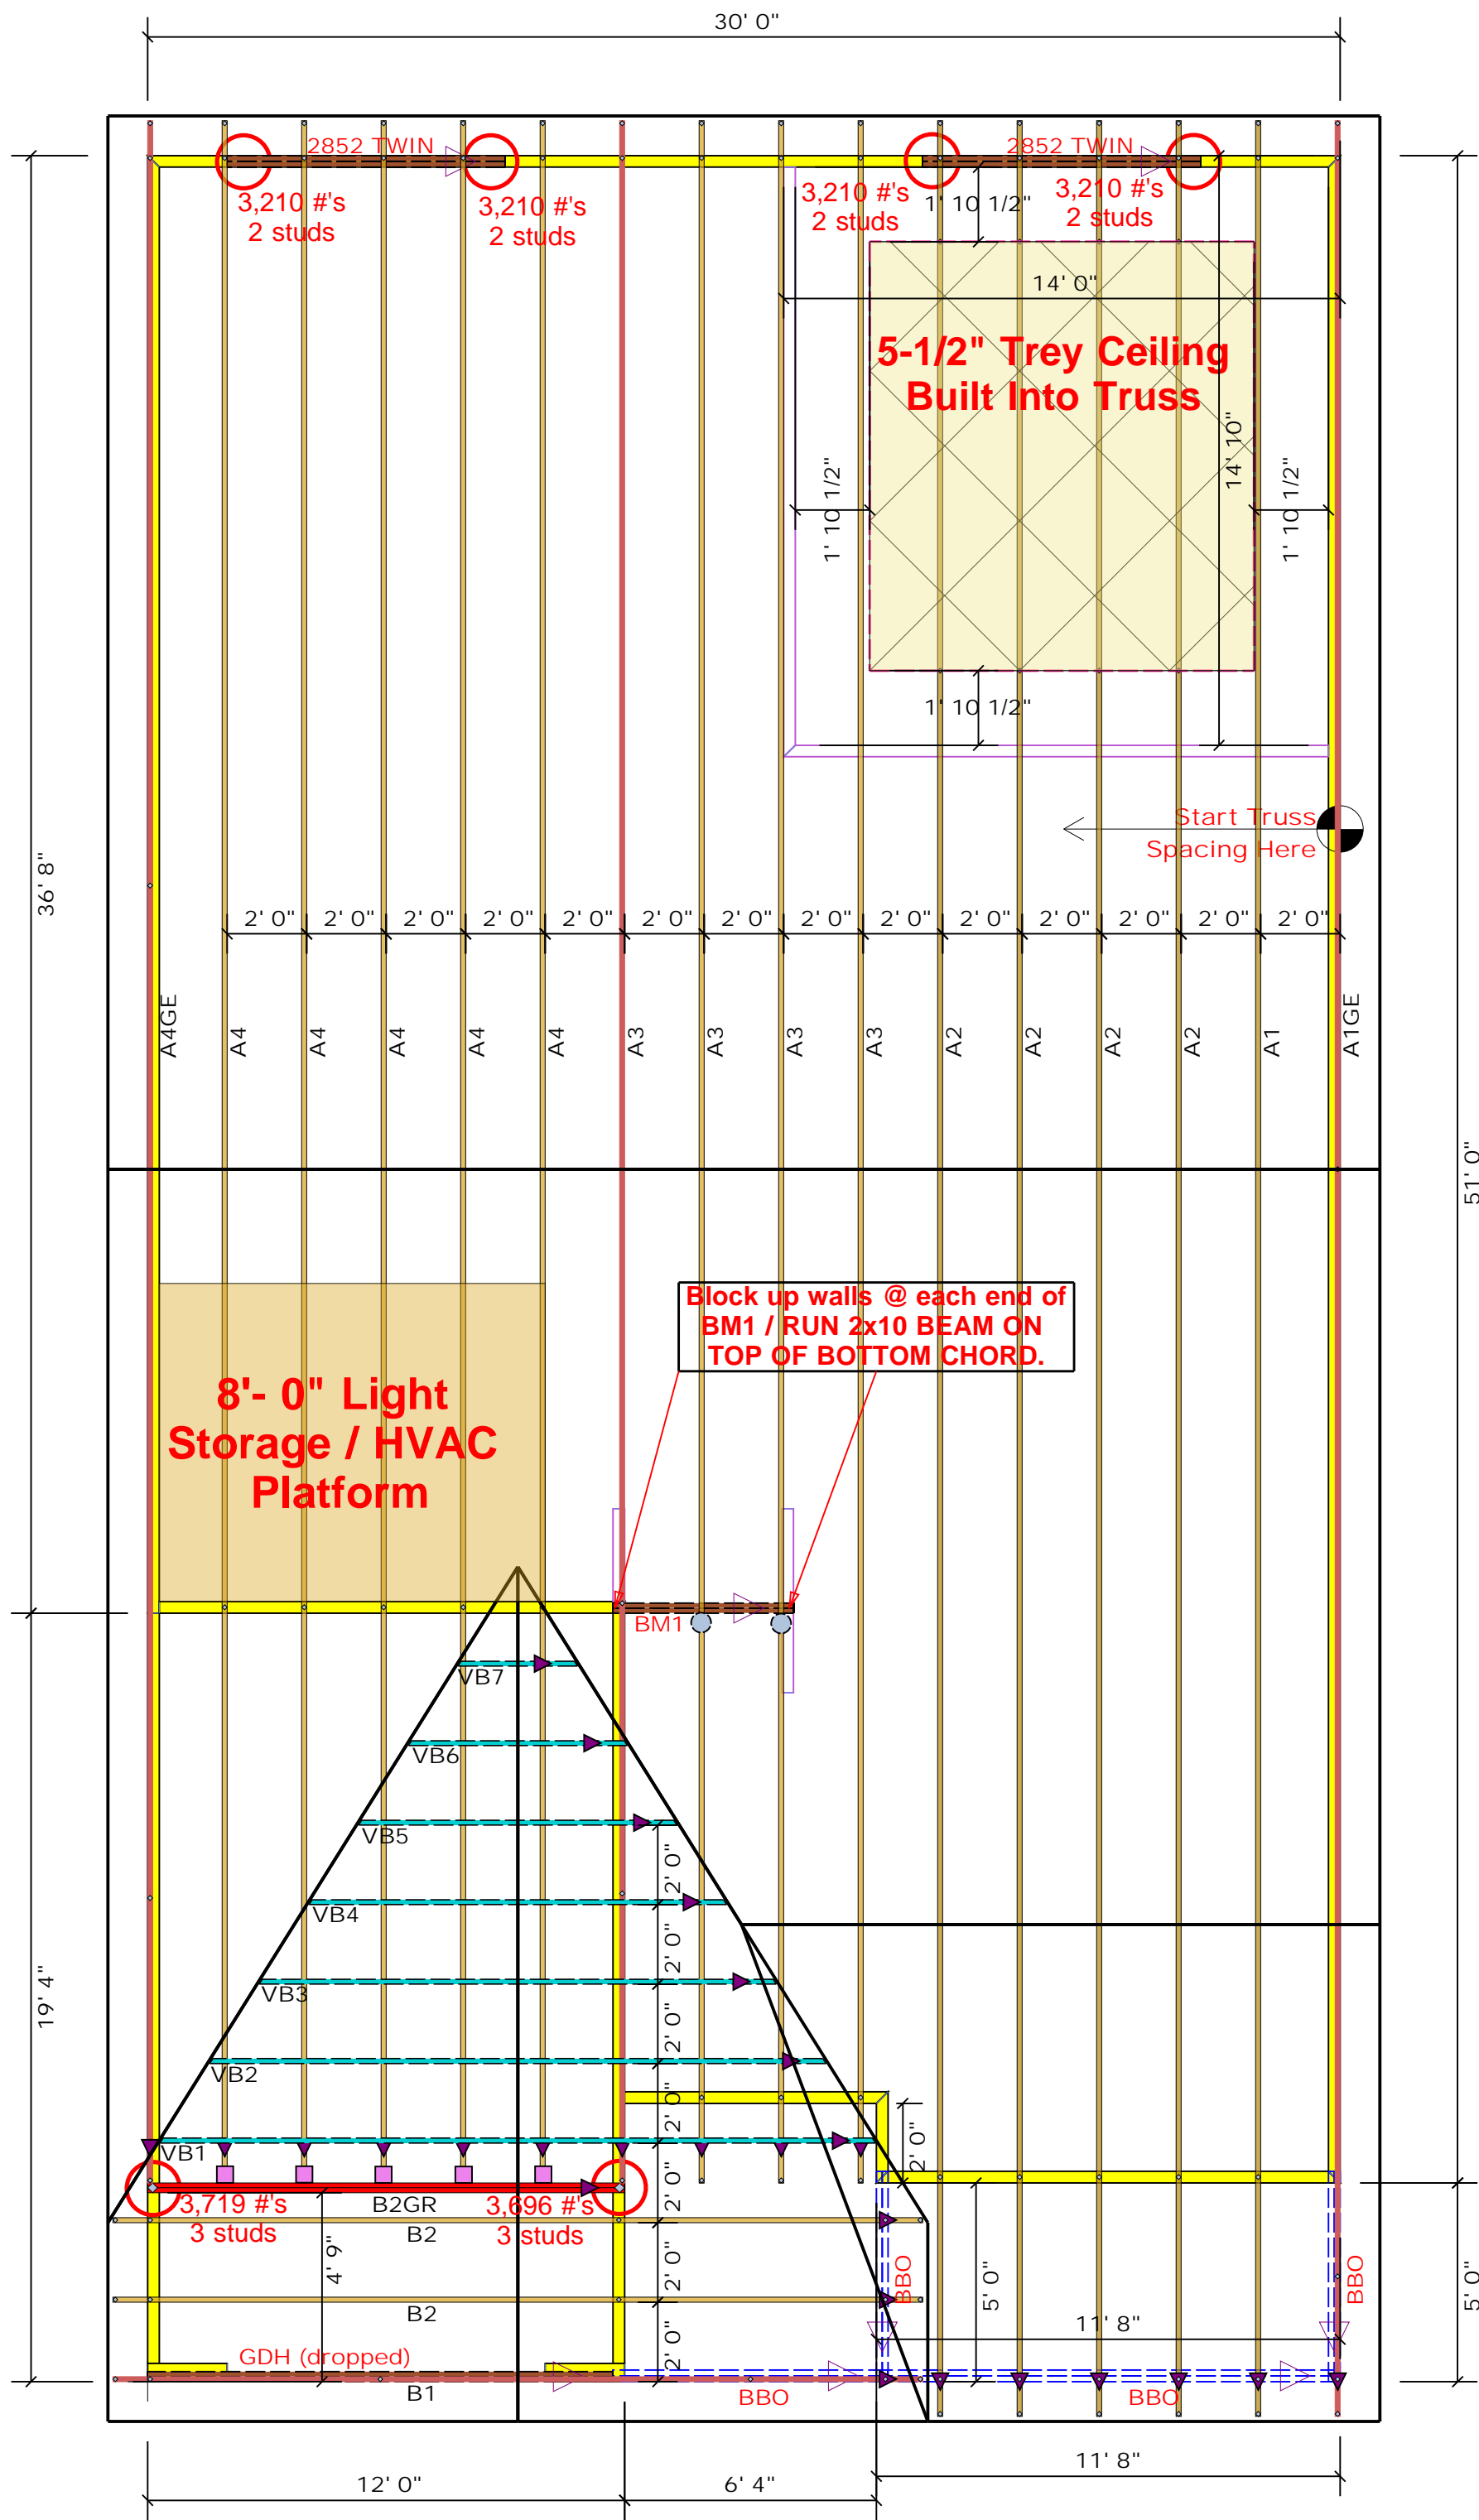

**Truss Placement Plan**  
**SCALE: 1/4" = 1'-0"**

▲ = Denotes Left End of Truss  
 (Reference Engineered Truss Drawing)

*All Truss Reactions are Less than 3,000 lbs. Unless Noted Otherwise.*

○ -- Denotes Reaction Greater than 3,000 lbs.  
 Reaction / # of Studs

■	HUS28	USP	5		16d/3-1/2	16d/3-1/2"
●	MSH422	USP	2	Varies	10d/3"	10d/3"

Estimation			
Name	Selection	Formula	Calculation
Roof Area	1st Floor	Roof Area	2046.74
Roof Decking	1st Floor	Roof Decking	70

BEAM LEGEND					
PlotID	Length	Product	Plies	Net Qty	Fab Type
2852 TWIN	7' 0"	1-3/4" x 9-1/4" LVL Kerto-S	2	4	FF
GDH (dropped)	12' 0"	2x12 SPF No.2	2	2	FF

LOAD CHART FOR JACK STUDS			
IRF LOAD (UP TO 10' SPAN)	IRF LOAD (10' TO 12' SPAN)	IRF LOAD (12' TO 14' SPAN)	IRF LOAD (14' TO 16' SPAN)
1700	1	2550	3400
3400	2	5100	6800
5100	3	7650	10200
6800	4	10200	13600
8500	5	12750	17000
10200	6	15300	
11900	7		
13600	8		
15300	9		

BUILDER	Weaver Development	CITY / CO.	Lillington / Harnett
JOB NAME	Sinawa Job	ADDRESS	Manor Hill Rd.
PLAN	Leyland "A"	MODEL	ROOF
SEAL DATE	Seal Date	DATE REV.	/ /
QUOTE #	Quote #	DRAWN BY	Lenny Norris
JOB #	J0522-2818	SALES REP.	Lenny Norris

THIS IS A TRUSS PLACEMENT DIAGRAM ONLY. These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult BCSH-B1 and BCSH-B3 provided with the truss delivery package or online @ sbcindustry.com

Bearing reactions less than or equal to 3000# are deemed to comply with the prescriptive Code requirements. The contractor shall refer to the attached Tables ( derived from the prescriptive Code requirements ) to determine the minimum foundation size and number of wood studs required to support reactions greater than 3000# but not greater than 15000#. A registered design professional shall be retained to design the support system for any reaction that exceeds those specified in the attached Tables. A registered design professional shall be retained to design the support system for all reactions that exceed 15000#.

Signature \_\_\_\_\_  
**Lenny Norris**  
 Lenny Norris

  
**ROOF & FLOOR TRUSSES & BEAMS**  
 Reilly Road Industrial Park  
 Fayetteville, N.C. 28309  
 Phone: (910) 864-8787  
 Fax: (910) 864-4444