

Elevation B - Sheet List	
Sheet Number	Sheet Name
B-Pg1	Front & Rear Elevations
B-Pg2	Side Elevations
B-Pg3	1st Floor Plan
B-Pg4	Roof Plan
Pg5	Sections
Pg6	Electrical
Sec-Crawl/Brick	Typical Wall Section
Structural Pages	by Engineer



① Front - Elev B
1/8" = 1'-0"



② Rear - Elev B
1/8" = 1'-0"

Area Schedule (Elevation B)	
Name	Area
Heated	
1st Floor	1755 SF
	1755 SF
Unheated	
Covered Porch	24 SF
Front Porch	117 SF
Garage	420 SF
	561 SF
Under Roof	2316 SF



CAMDEN - Elevation B


Front & Rear Elevations

Job #: 23-05-09
Address: 3493 South River Rd.
Lillington, NC 27546
County: Harnett County

Plan Version Date: 2-2-21

Job Version Date: 6-16-22

Sheet #: B-Pg1

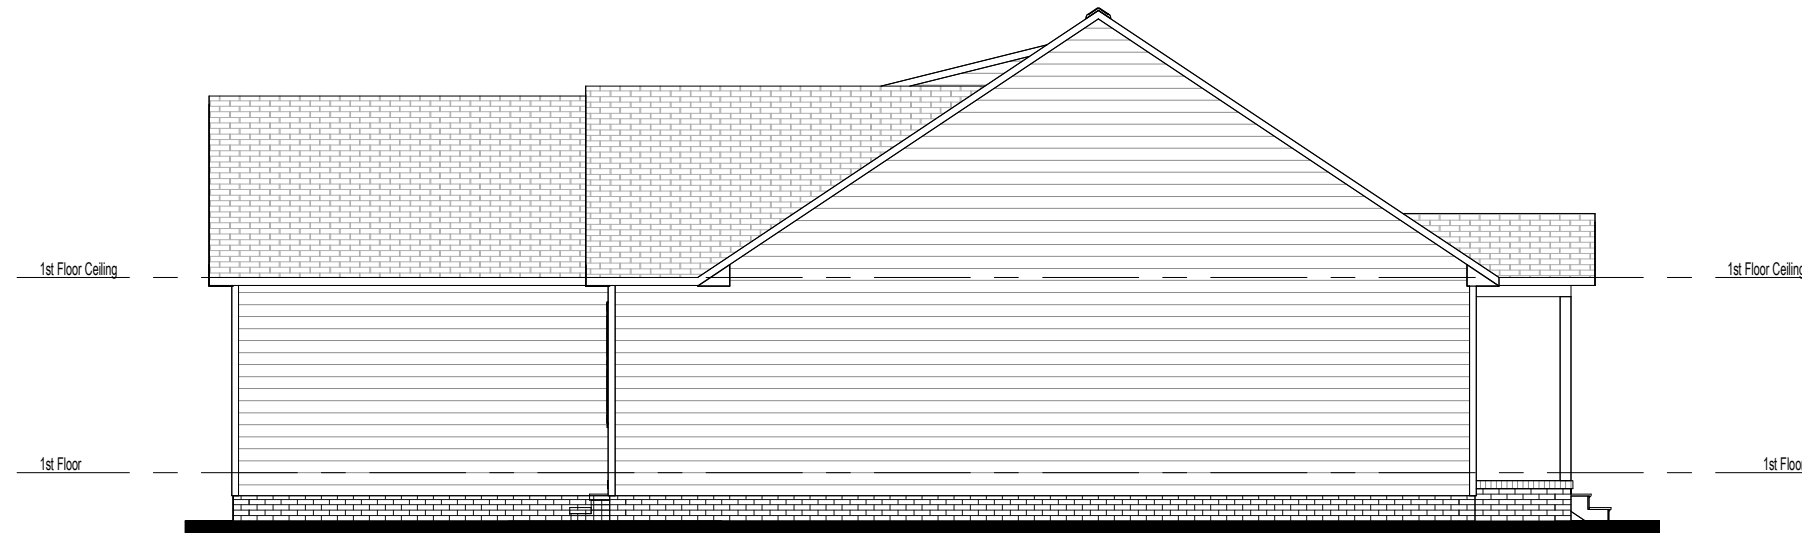


① Right - Elev B
1/8" = 1'-0"



② Left - Elev B
1/8" = 1'-0"

Wall Stud Size
 — = 2x4
 // = 2x6

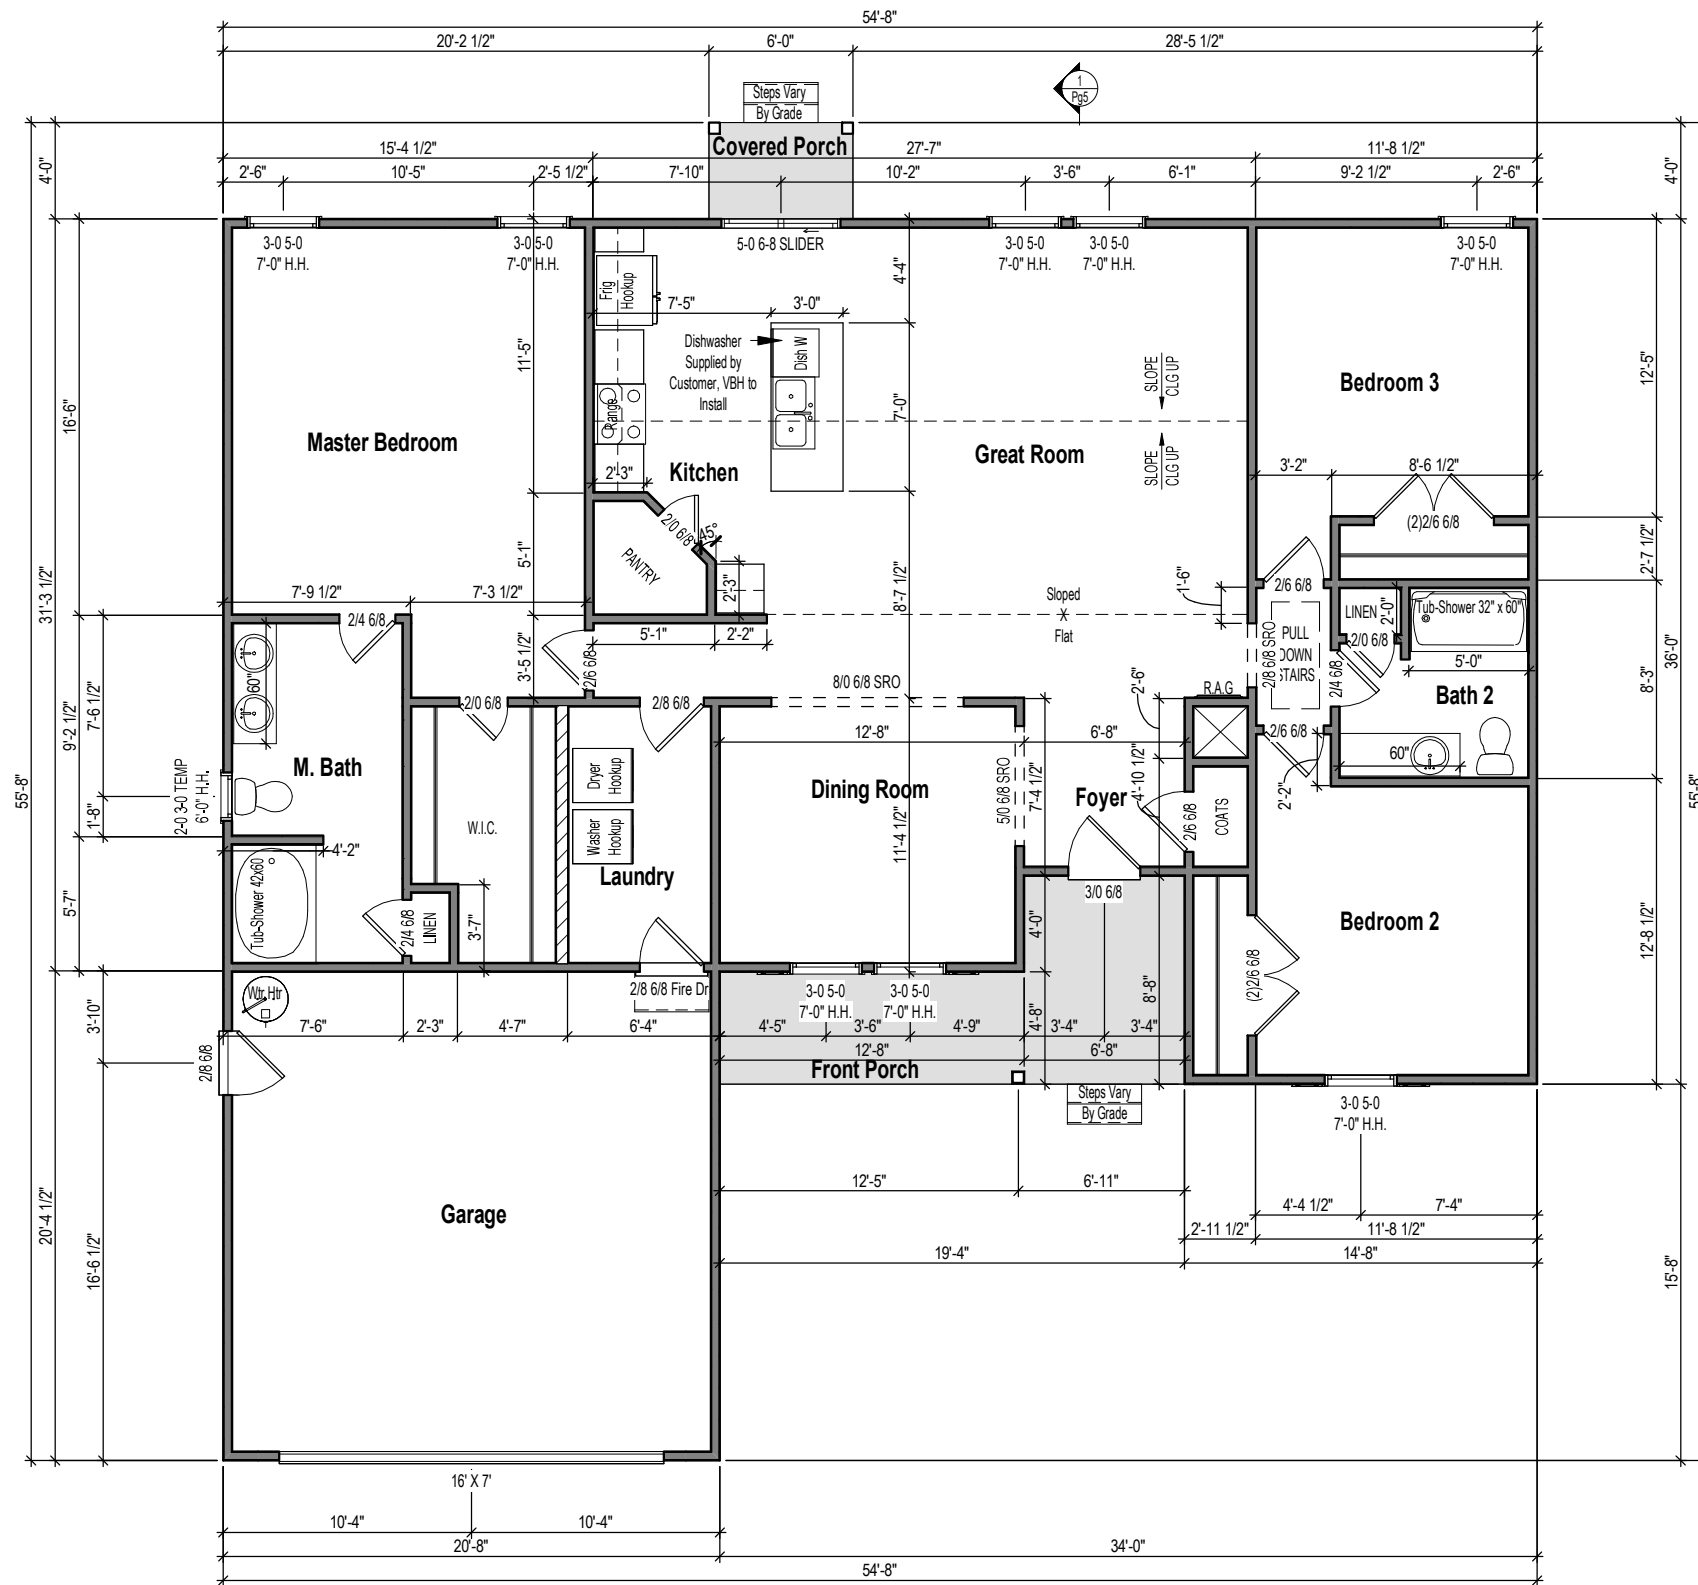

1 1st Floor Plan - Elev B
 1/8" = 1'-0"

DIMENSIONS
 • EXTERIOR WALL DIMENSIONS ARE TO FACE OF SHEATHING
 • INTERIOR WALL DIMENSIONS ARE TO FACE OF STUD

EXTERIOR DOOR ROUGH OPENINGS
 • ALL EXTERIOR SWING DOORS HAVE A HEADER HEIGHT = TO 3" HIGHER THAN CALL SIZE
 • ALL EXTERIOR SLIDING DOORSHAVE A HEADER HEIGHT = TO CALL SIZE



CAMDEN - Elevation B
 1st Floor Plan


Job #: 23-05-09
 Address: 3493 South River Rd.
 Lillington, NC 27546
 County: Harnett County

Plan Version Date: 2-2-21
 Job Version Date: 6-16-22
 Sheet #: B-Pg3

Attic Ventilation Calcs 1/300 (sq.in.)

Name	Area	Ventilation Required (sq.in.)	Max Upper (sq.in.)	Min Upper (sq.in.)	Upper Ventilation (sq.in.)	Lower Ventilation (sq.in.)	Total Ventilation (sq.in.)	Ridge Vent (ln.ft.)	Roof Vents (ea)	Soffit Vents (sq.ft.)
Main Roof	2292 SF	1100	880	550	690	582	1272	46	0	97

- CALCS BASED ON THE FOLLOWING VALUES**
- Ridge Vents = 15 in² of net free area per linear foot
 - Roof Vents = 50 in² of net free area per unit
 - Soffit Vents = 6 in² of net free area per square foot

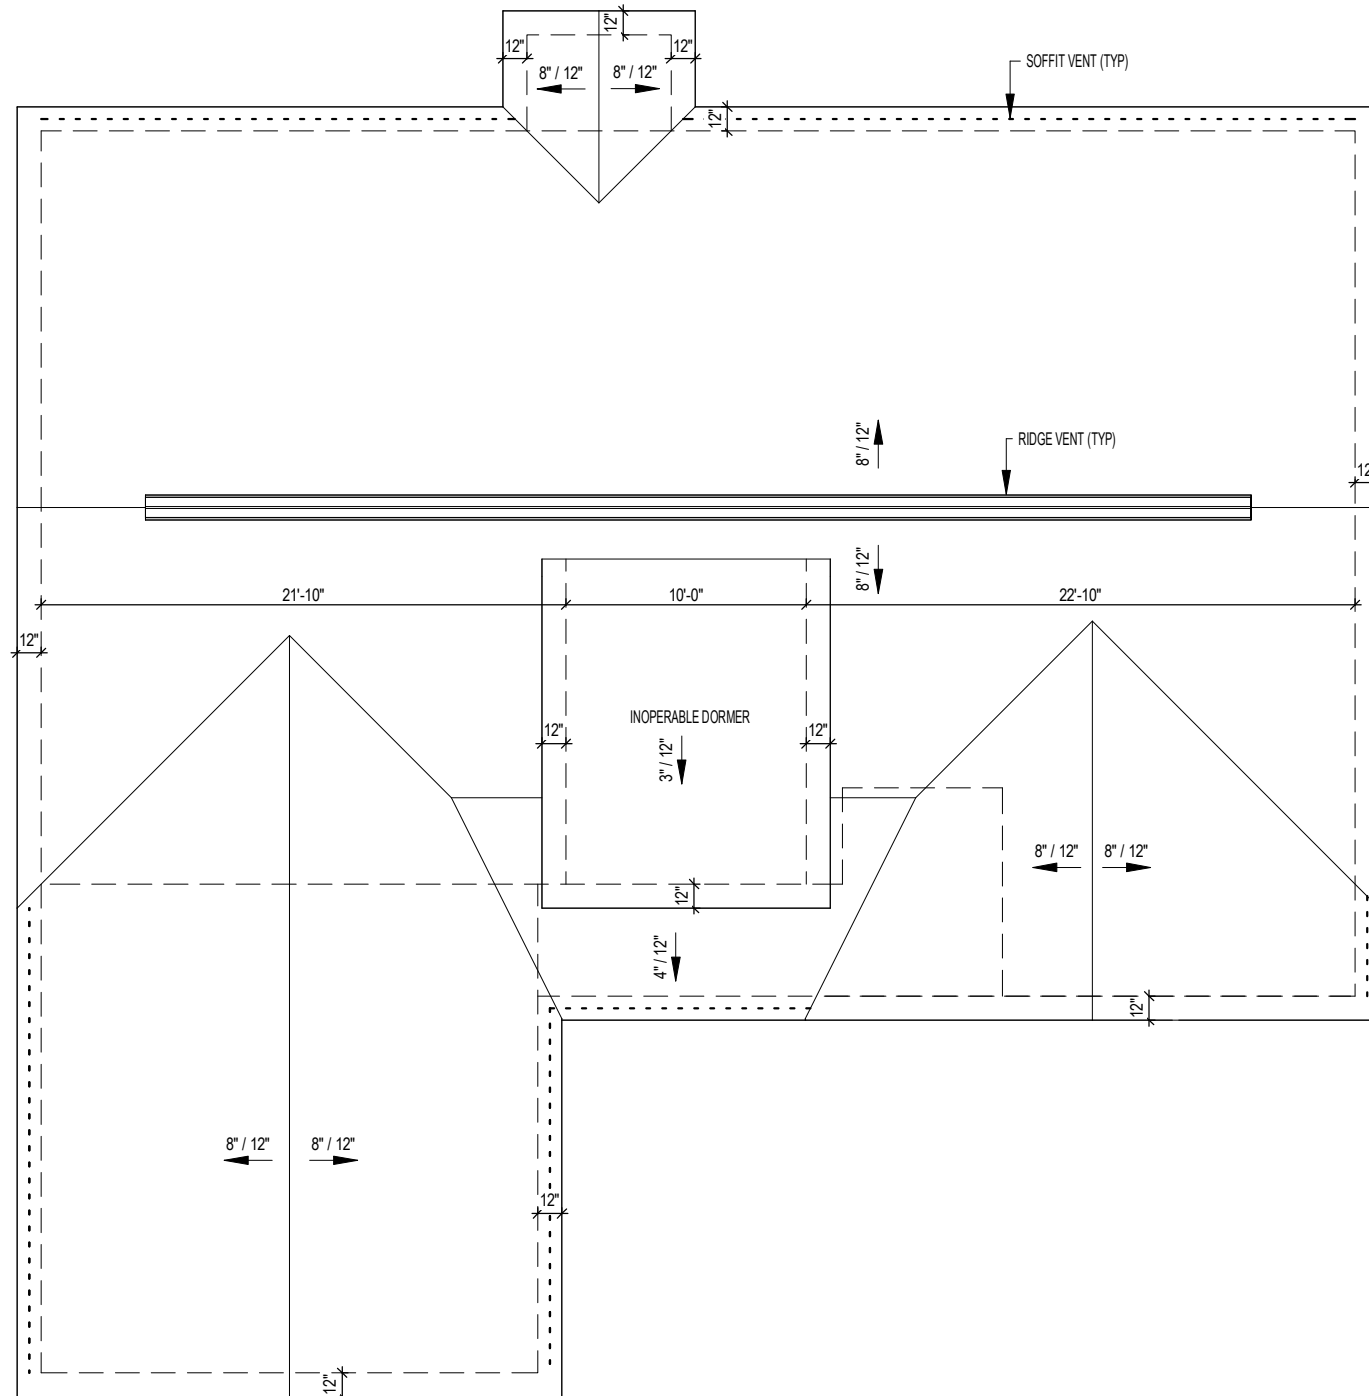

① Roof Plan - Elev B
1/8" = 1'-0"



CAMDEN - Elevation B


Roof Plan

Job #: 23-05-09
Address: 3493 South River Rd.
Lillington, NC 27546
County: Harnett County

Plan Version Date:
2-2-21

Job Version Date:
6-16-22

Sheet #:
B-Pg4

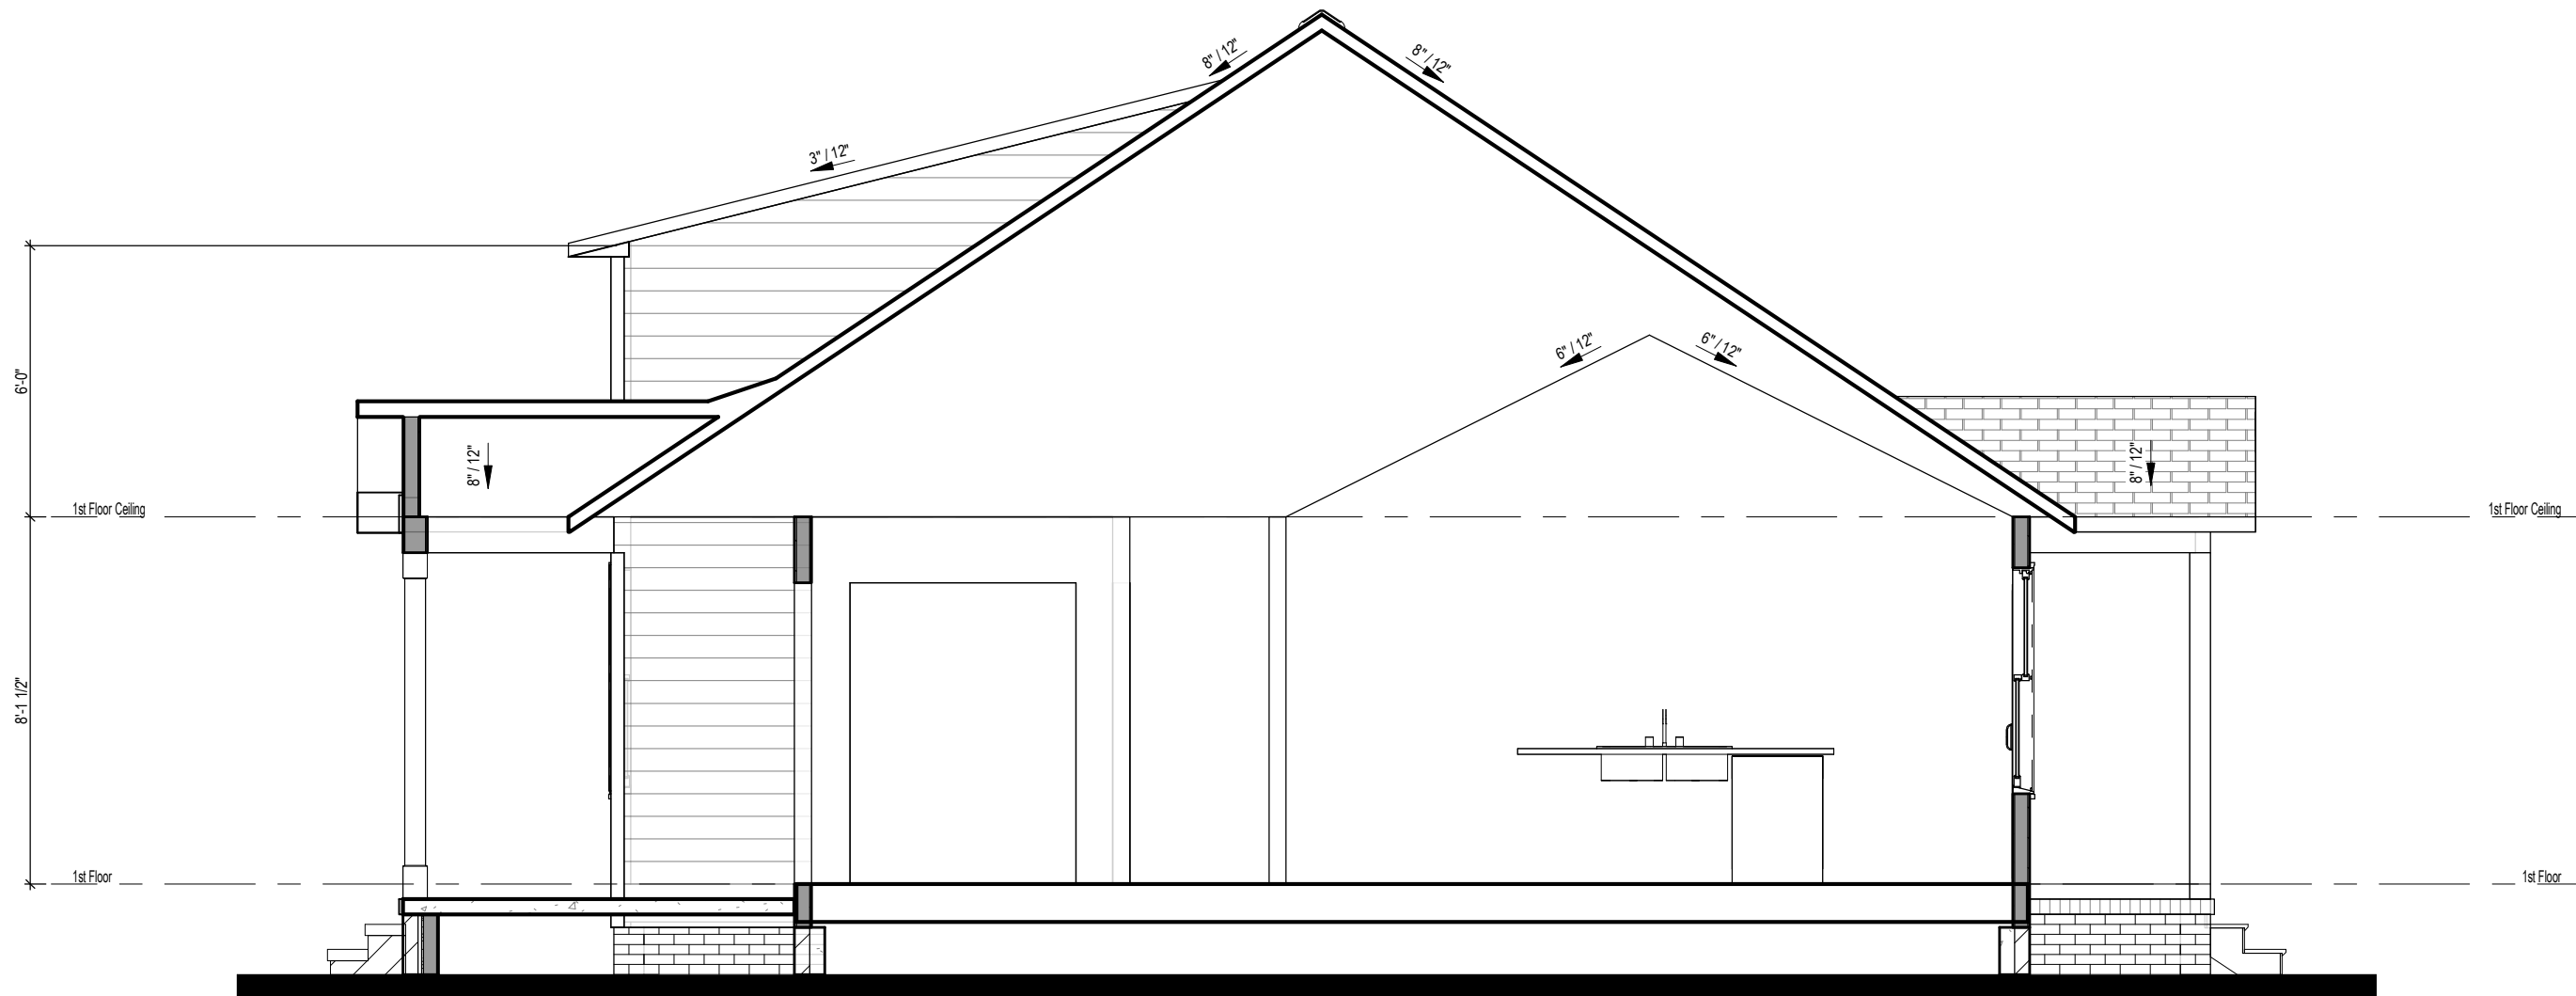

① Building Section
 1/4" = 1'-0"

CAMDEN - Elevation B

Sections

Job #: 23-05-09
 Address: 3493 South River Rd.
 Lillington, NC 27546
 County: Harnett County

Plan Version Date:
 2-2-21

Job Version Date:
 6-16-22

Sheet #:
 Pg5


ELECTRICAL LEGEND

WALL MOUNTED FIXTURES


- Outlet - 110V
- Outlet - 110V
- Ground Fault Interrupter
- Outlet - 110V
- Ground Fault Interrupter
- Water Proof
- Outlet - 220V
- Outlet - TV
- Outlet - Phone
- Switch - Single Pole
- Switch - 3 way
- Switch - 4 way
- 18" Light Bar
- Wall Light
- Coach Light - Front Door
- Coach Light - Rear Door

CEILING MOUNTED FIXTURES

- Track Light 3 bulbs
- Surface Can Light
- Flush Mount
- Flush Mount w-fan prewire
- Smoke Detector
- Smoke Detector/CO2
- Bathroom Exhaust Fan
- Garage Door Opener Prewire

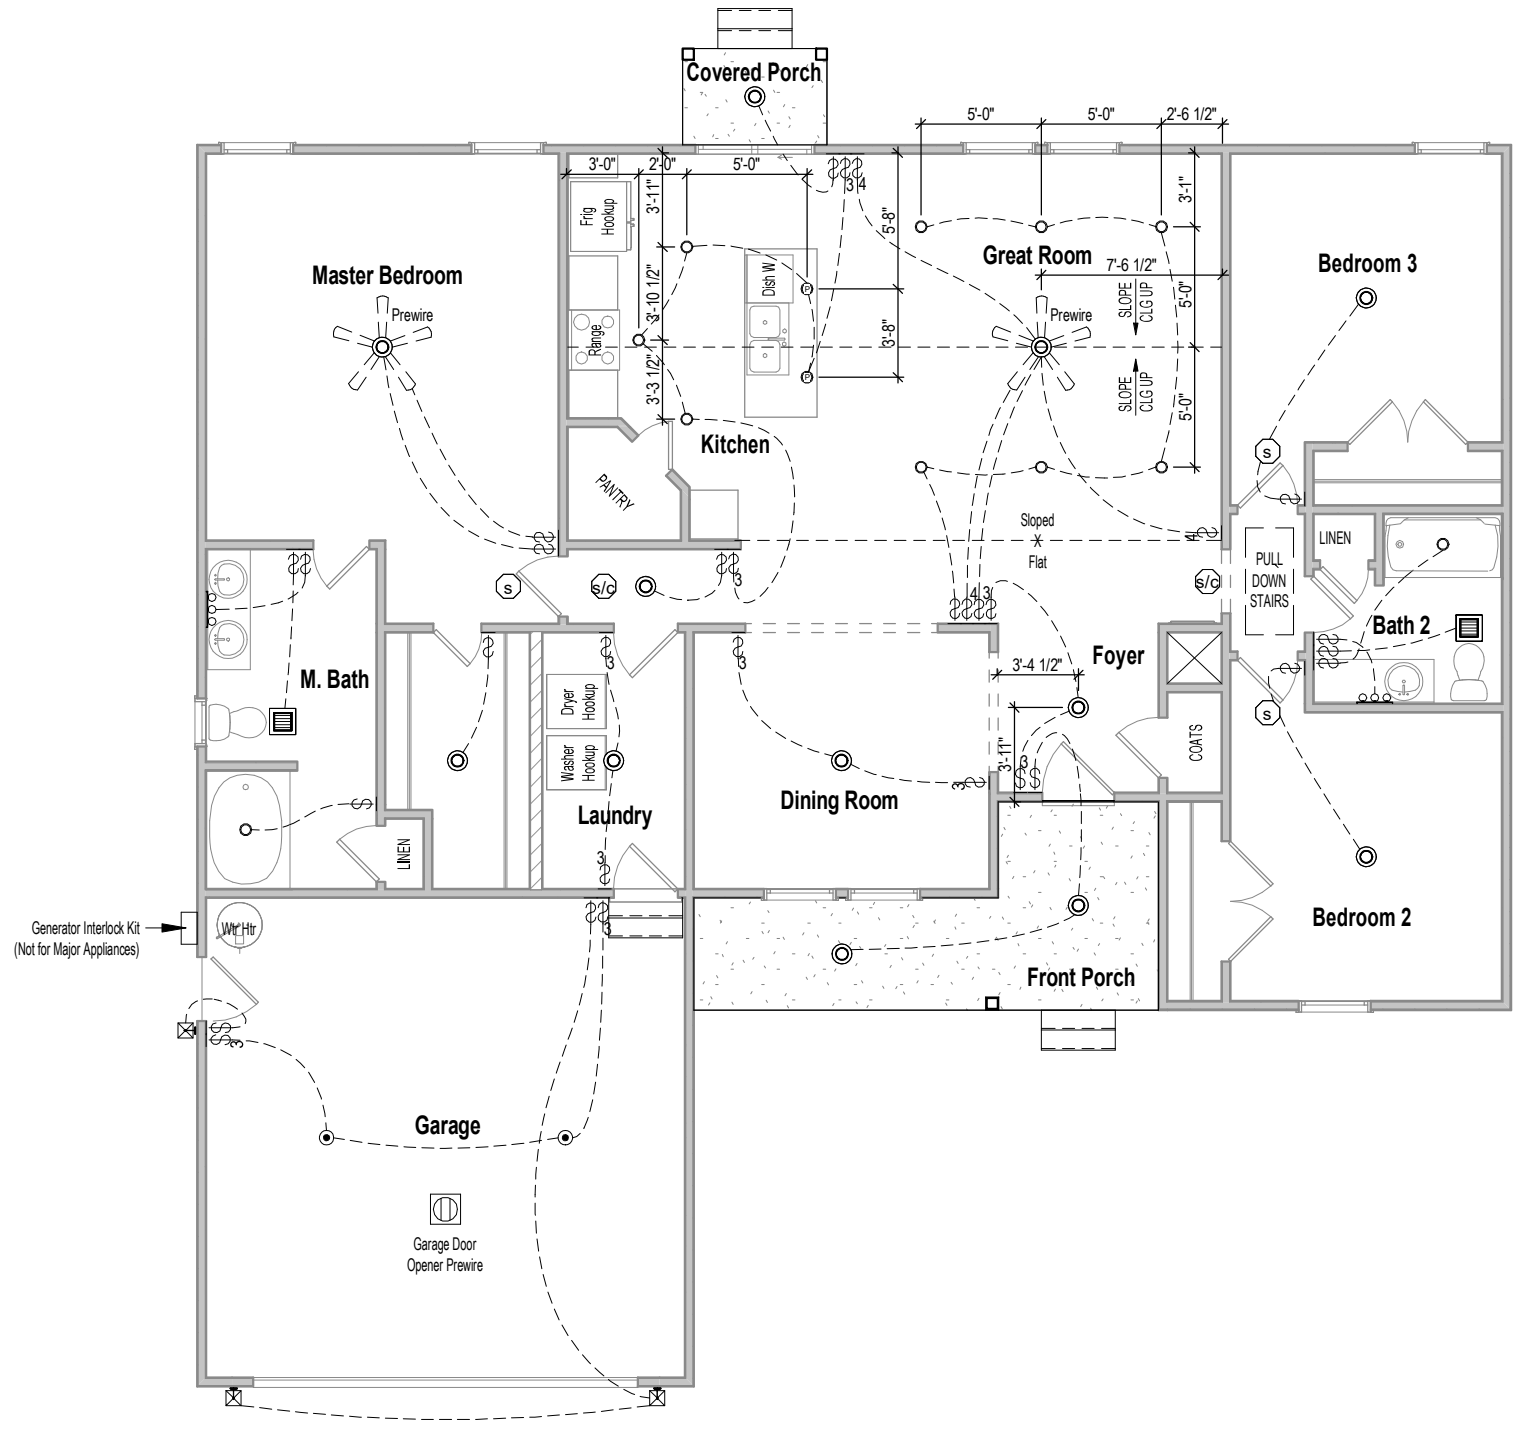

1 1st Floor Electrical
1/8" = 1'-0"

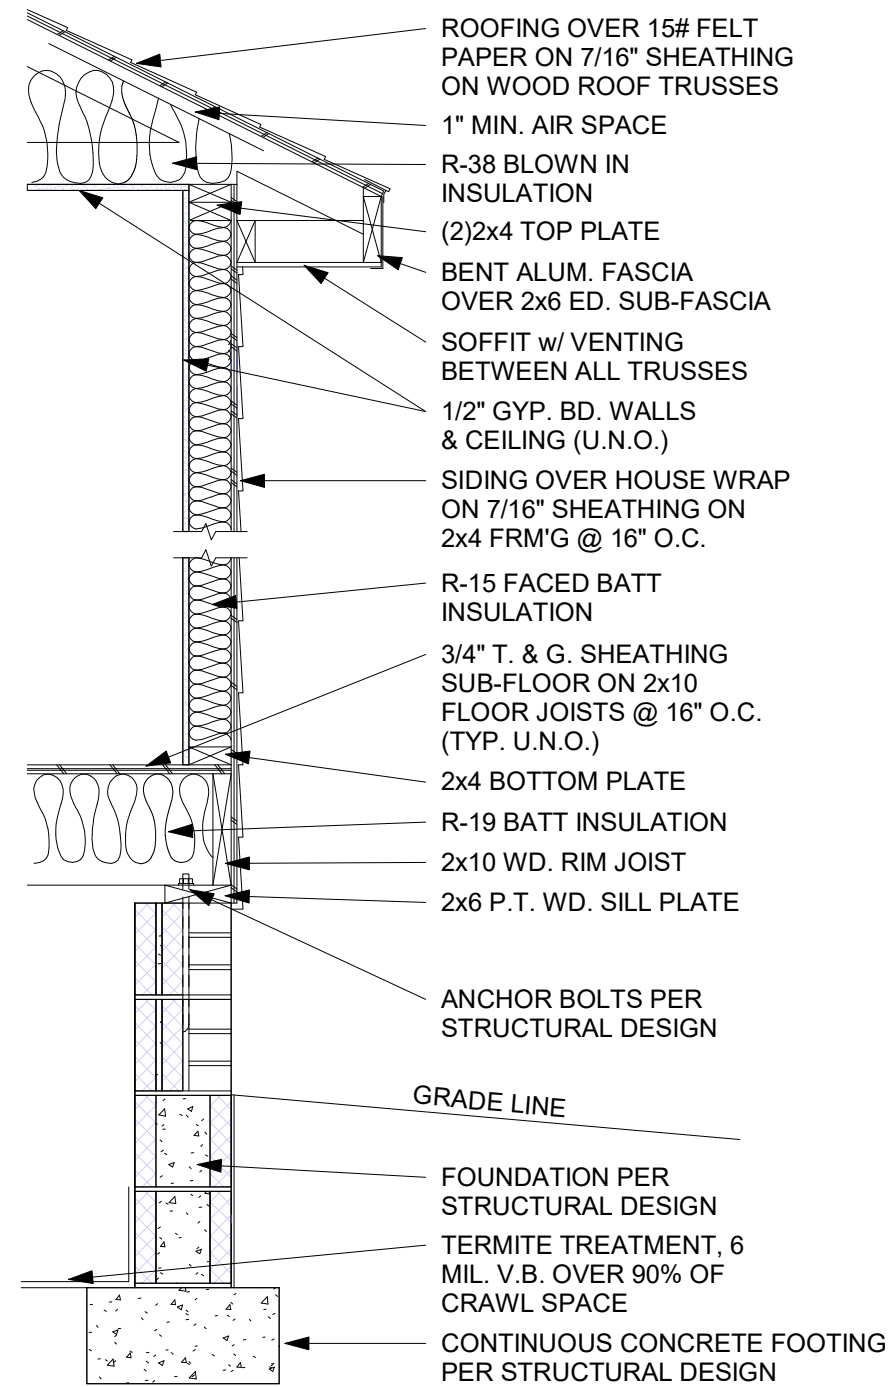

① Typical Wall Section - Brick Fnd
 1/64" = 1'-0"

CAMDEN - Elevation B

Typical Wall Section



Job #: 23-05-09
 Address: 3493 South River Rd.
 Lillington, NC 27546
 County: Harnett County

Plan Version Date:
 2-2-21

Job Version Date:
 6-16-22

Sheet #:
 Sec-Crawl/Brick

The structural design of this plan is the property of Engineering Tech Associates, P.A. These plans are for the one time use at the location and for the client listed. Engineering Tech Associates, P.A. assumes no liability for these plans if they are reproduced, in whole or in part, for construction at any other location without written permission from Engineering Tech Associates, P.A.

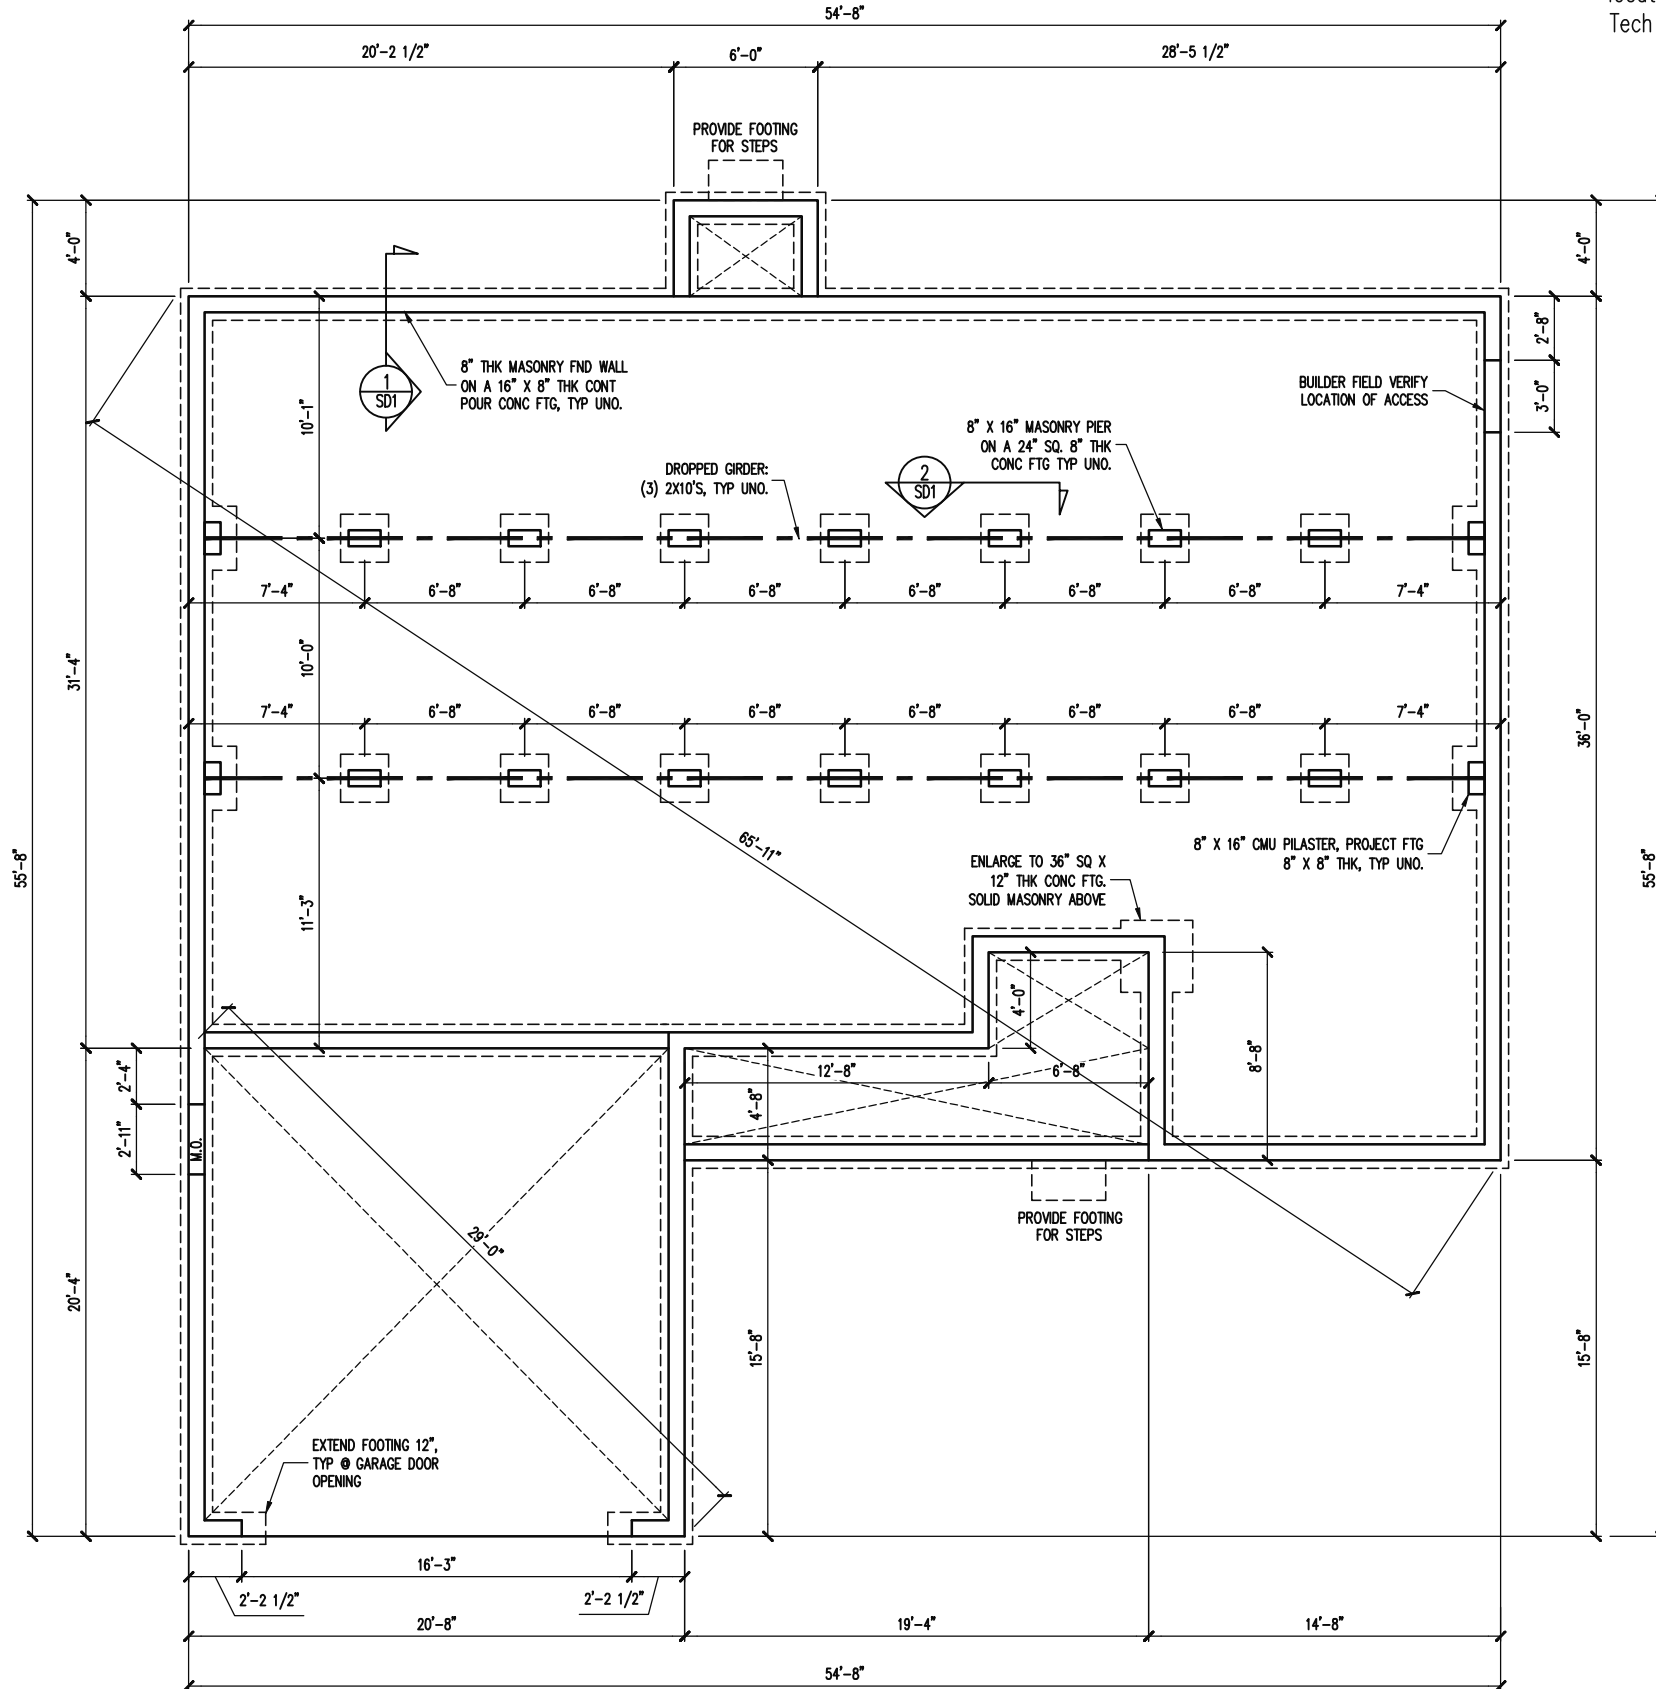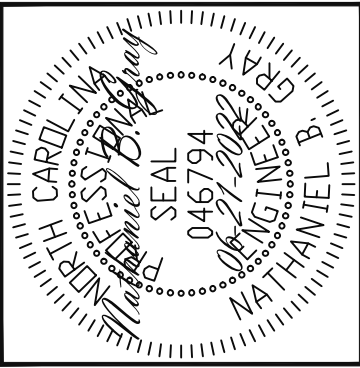

NOTES:
 -HEIGHT AND BACKFILL LIMITATIONS FOR FOUNDATION WALLS ARE TO BE GOVERNED BY THE NCSBC, LATEST EDITION. REINFORCEMENT AND GROUTING SHALL BE DETERMINED BY FINAL SITE CONDITIONS.
 -BUILDER TO FIELD LOCATE CRAWLSPACE ACCESS OPENING WITH MINIMUM DIMENSIONS OF 18X24. DO NOT LOCATE ACCESS OPENING BELOW POINT LOADS FROM ABOVE WITHOUT ENGINEER APPROVAL.

FOUNDATION PLAN
 1/8" = 1'-0"

Engineering Tech ASSOCIATES, P.A.
 STRUCTURAL ENGINEERS
 License No. C-3870
 318 W MILLBROOK RD, SUITE 201
 Raleigh, North Carolina 27609
 Phone (919) 844-1661

VALUE BUILD HOMES
 STRUCTURAL ADDENDUM
 SCOPE
 LOC
 3493 SOUTH RIVER RD
 LILLINGTON, NC
 JOB# 23-05-09 RAWLS



ENG: NBG/EAF
 DATE: 06-21-2022

PLAN
 CAMDEN B

PROJECT NO.
 22-26-135

SHEET NO.
 S1
 1 of 6

The structural design of this plan is the property of Engineering Tech Associates, P.A. These plans are for the one time use at the location and for the client listed. Engineering Tech Associates, P.A. assumes no liability for these plans if they are reproduced, in whole or in part, for construction at any other location without written permission from Engineering Tech Associates, P.A.

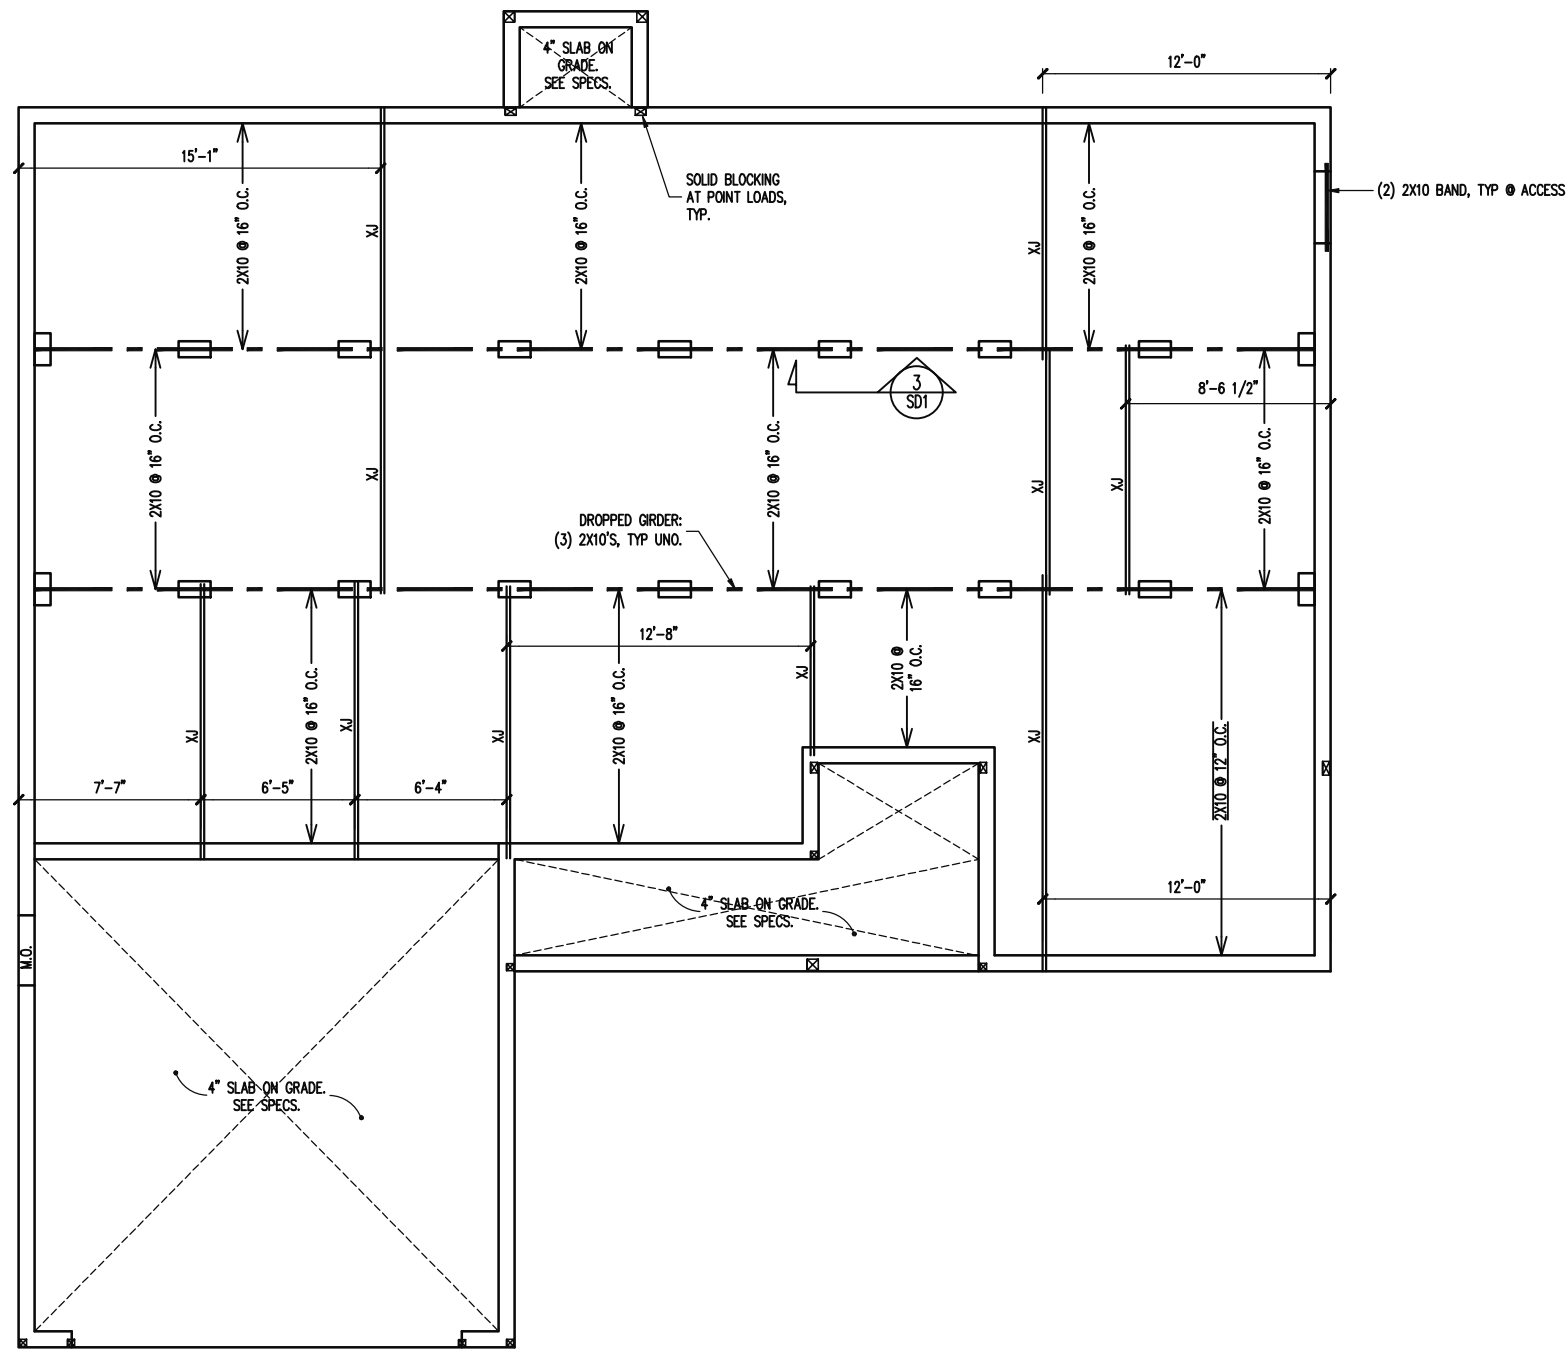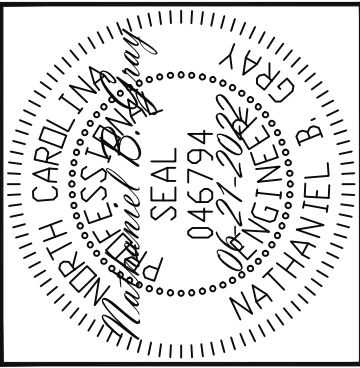

Engineering Tech Associates, P.A.
 STRUCTURAL ENGINEERS
 License No. C-3870
 318 W MILLBROOK RD, SUITE 201
 Raleigh, North Carolina 27609
 Phone (919) 844-1661

VALUE BUILD HOMES
 STRUCTURAL ADDENDUM
 SCOPE
 LOC: 3493 SOUTH RIVER RD
 LILLINGTON, NC
 JOB# 23-05-09 RAWLS

ENG: NBG/EAF
 DATE: 06-21-2022

PLAN
 CAMDEN B

PROJECT NO.
 22-26-135



SHEET NO.
 S2

2 of 6

CRAWL SPACE FRAMING PLAN

1/8" = 1'-0"

The structural design of this plan is the property of Engineering Tech Associates, P.A. These plans are for the one time use at the location and for the client listed. Engineering Tech Associates, P.A. assumes no liability for these plans if they are reproduced, in whole or in part, for construction at any other location without written permission from Engineering Tech Associates, P.A.

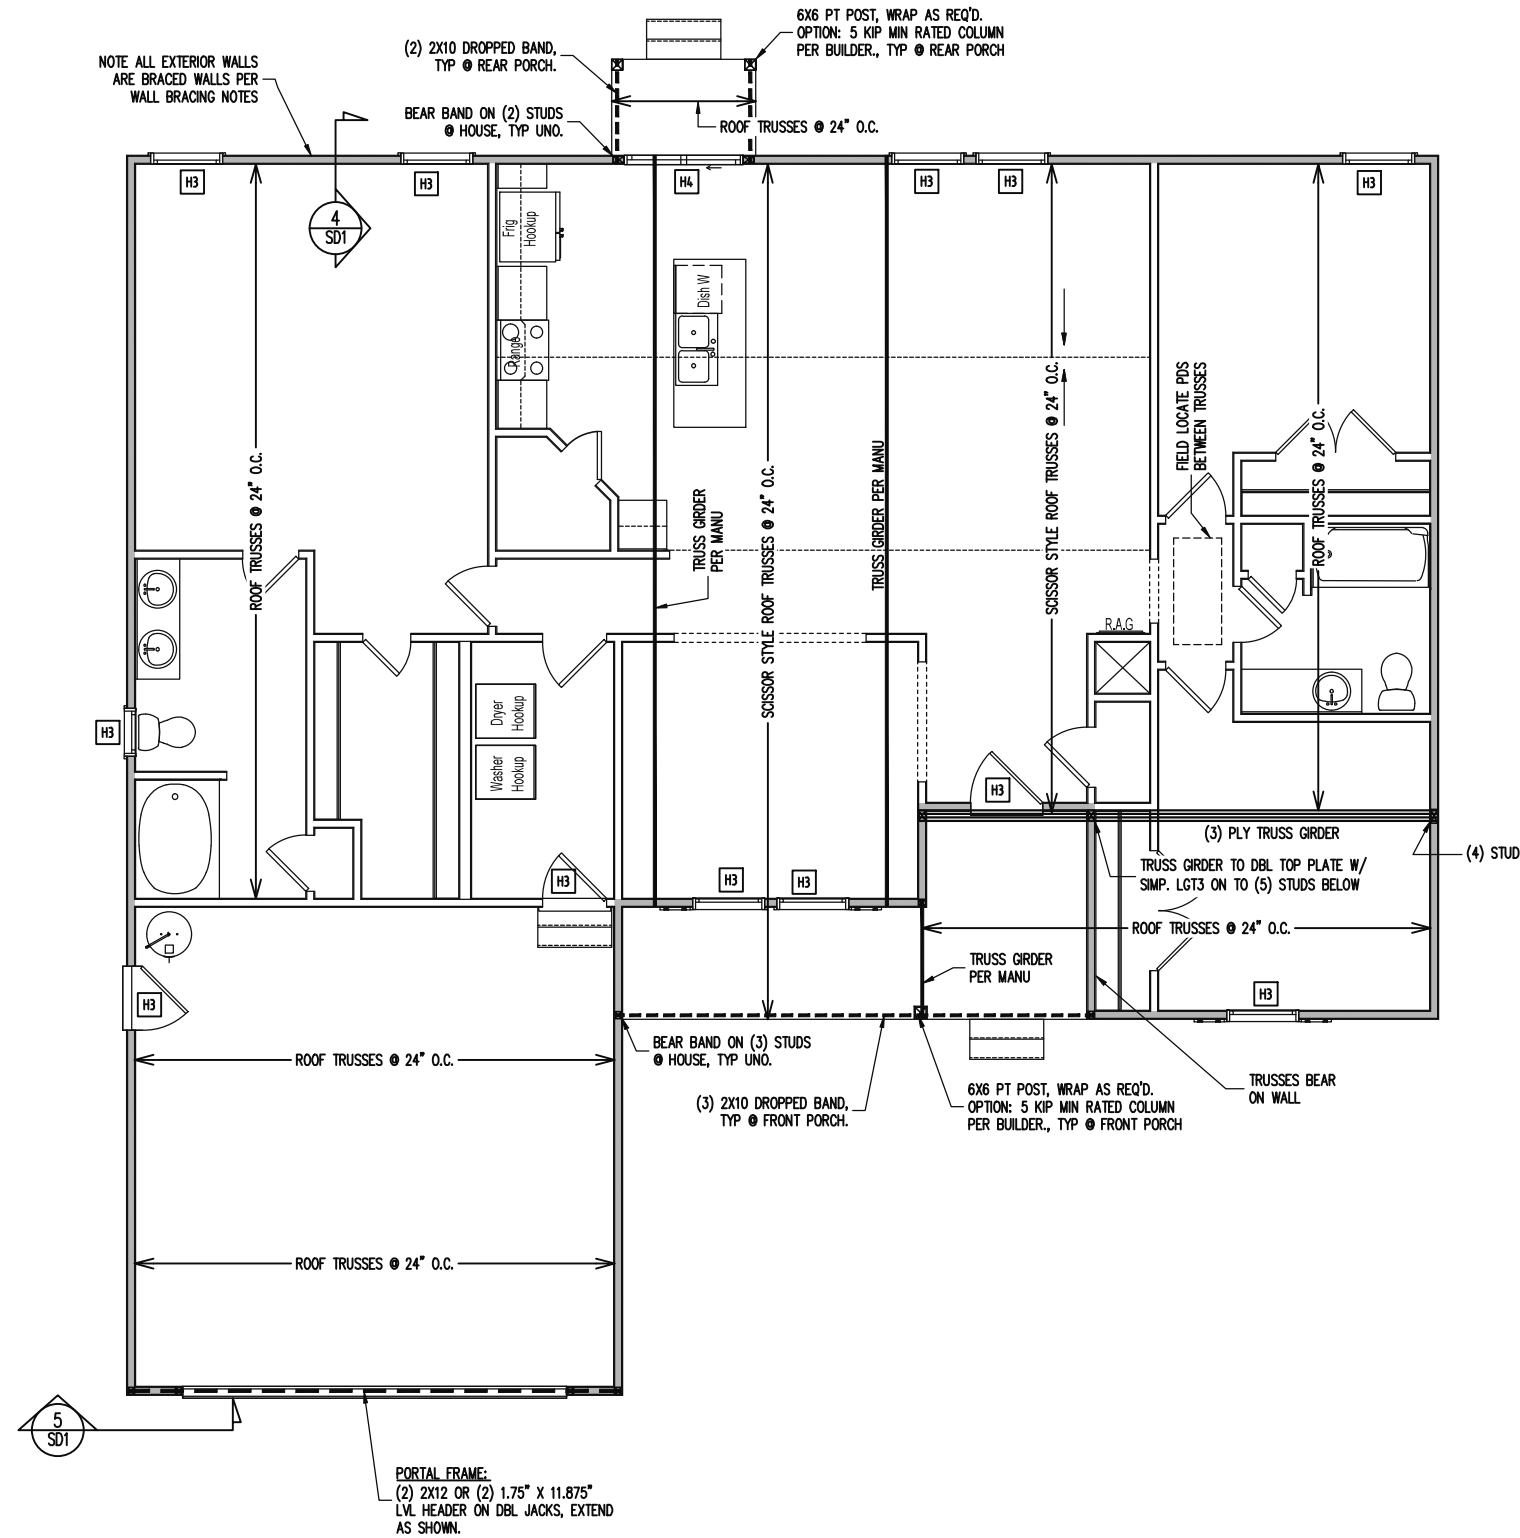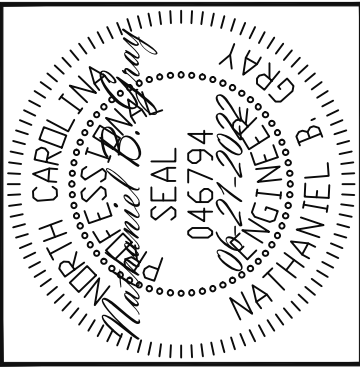

CONSTRUCTION SPECIFICATIONS
INSTANT REFERENCES

REFER TO THE CONSTRUCTION SPECIFICATIONS SECTIONS FOR THE FOLLOWING INFORMATION:
PART 1.01: CURRENT GOVERNING CODE
PART 14: STUD SUPPORT FOR BEAMS
PART 17: KING STUDS FOR EXTERIOR WALLS
SEE DETAIL / CONSTRUCTION SPECIFICATIONS SHEETS FOR I-JOISTS ALLOWABLE SUBSTITUTIONS

WALL BRACING

SHADED WALLS:
ALL EXTERIOR STUD WALLS, EXTERIOR SIDE, ARE TO BE CONTINUOUSLY SHEATHED WITH 7/16 APA RATED OSB NAILED TO STUDS WITH 8d NAILS @ 6" O.C. AT PANEL EDGES, 12" O.C. IN PANEL FIELD.
NOTES:
PROVIDED CONTINUOUS SHEATHING = 228' MIN.
REFERENCE PART 16.02 OF CONSTRUCTION SPECIFICATIONS FOR GENERAL WIND BRACING INFORMATION.

HEADER SCHEDULE

- H1 SINGLE 2X4 TURNED FLAT (A)
 - H2 (2) 2X4'S ON SINGLE JACKS (B)
 - H3 (2) 2X8'S ON SINGLE JACKS (C)
 - H4 (2) 1.75" X 9.25" LVL'S ON DBL JACKS
- NOTES:**
-HEADERS IN NON LOAD BEARING INTERIOR WALLS ARE NOT LABELED.

Engineering Tech Associates, P.A.
STRUCTURAL ENGINEERS
License No. C-3870
318 W MILLBROOK RD, SUITE 201
Raleigh, North Carolina 27609
Phone (919) 844-1661

VALUE BUILD HOMES	STRUCTURAL ADDENDUM
SCOPE	3493 SOUTH RIVER RD
LOC	LILLINGTON, NC
	JOB# 23-05-09 RAWLS

ENG: NBG/EAF
DATE: 06-21-2022

PLAN
CAMDEN B



PROJECT NO.
22-26-135

SHEET NO.
S3

3 of 6

1ST FLOOR FRAMING PLAN
WALLS AND CEILING
1/8" = 1'-0"

The structural design of this plan is the property of Engineering Tech Associates, P.A. These plans are for the one time use at the location and for the client listed. Engineering Tech Associates, P.A. assumes no liability for these plans if they are reproduced, in whole or in part, for construction at any other location without written permission from Engineering Tech Associates, P.A.

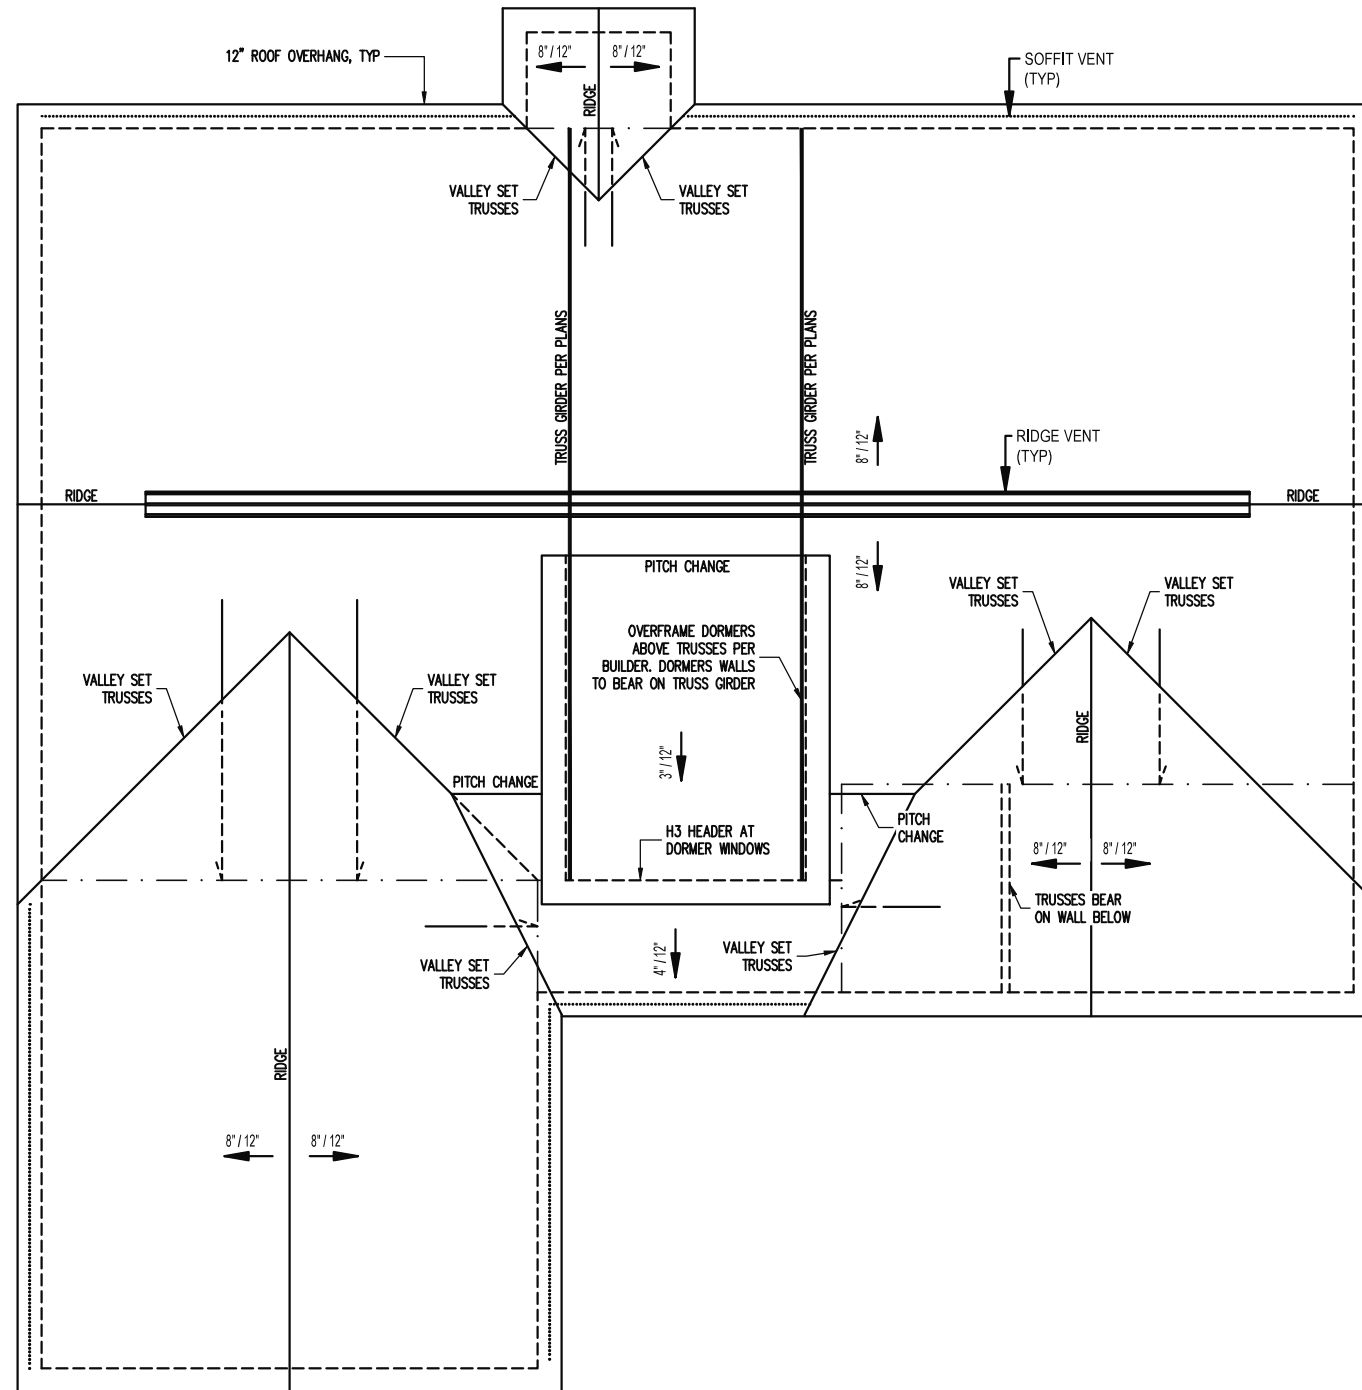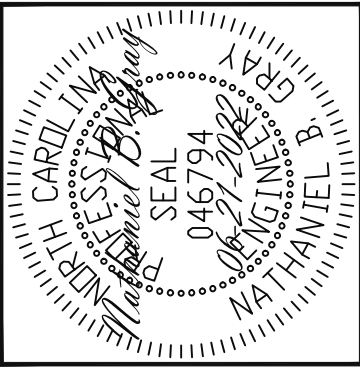

TRUSS UPLIFT CONNECTORS
 EXPOSURE B, 120 MPH, ANY PITCH
 24\"/>

TRUSSES SHALL BE ATTACHED TO SUPPORT WALL FOR UPLIFT RESISTANCE. CONTINUOUS OSB WALL SHEATHING BELOW PROVIDES CONTINUOUS UPLIFT RESISTANCE TO FOUNDATION. ALL TRUSSES SUPPORTED BY INTERMEDIATE SUPPORT WALLS, KNEEWALLS OR BEAMS SHALL BE ATTACHED TO SUPPORTING MEMBER PER SCHEDULE BELOW.

ROOF SPAN IS MEASURED HORIZONTALLY BETWEEN FURTHEST SUPPORT POINTS.

ROOF SPAN UP TO 18'	CONNECTOR NAILING PER TABLE 602.3(1) NCRBC 2018 EDITION
OVER 18'	(1) SIMPSON H2.5A HURRICANE CLIP TO DBL TOP PLATE OR BEAM

FRAMING NOTES
 ROOF ONLY
 -ROOF TRUSSES PER MANUFACTURER, TYP U.N.O.
 -VERIFY ROOF PITCHES, OVERHANG LENGTHS, AND KNEEWALL FRAMING HGTS WITH ARCHITECTURAL DRAWINGS, TYPICAL.

ROOF FRAMING PLAN
 1/8" = 1'-0"

Engineering Tech Associates, P.A.
 STRUCTURAL ENGINEERS
 License No. C-3870
 318 W MILLBROOK RD, SUITE 201
 Raleigh, North Carolina 27609
 Phone (919) 844-1661







VALUE BUILD HOMES
 STRUCTURAL ADDENDUM
 SCOPE: VALUE BUILD HOMES
 LOC: 3493 SOUTH RIVER RD
 LILLINGTON, NC
 JOB# 23-05-09 RAWLS

ENG: NBG/EAF
 DATE: 06-21-2022

PLAN
 CAMDEN B

PROJECT NO.
 22-26-135

SHEET NO.
 S4
 4 of 6

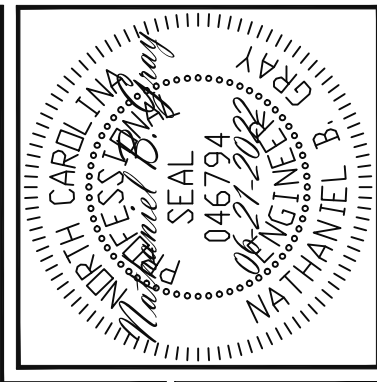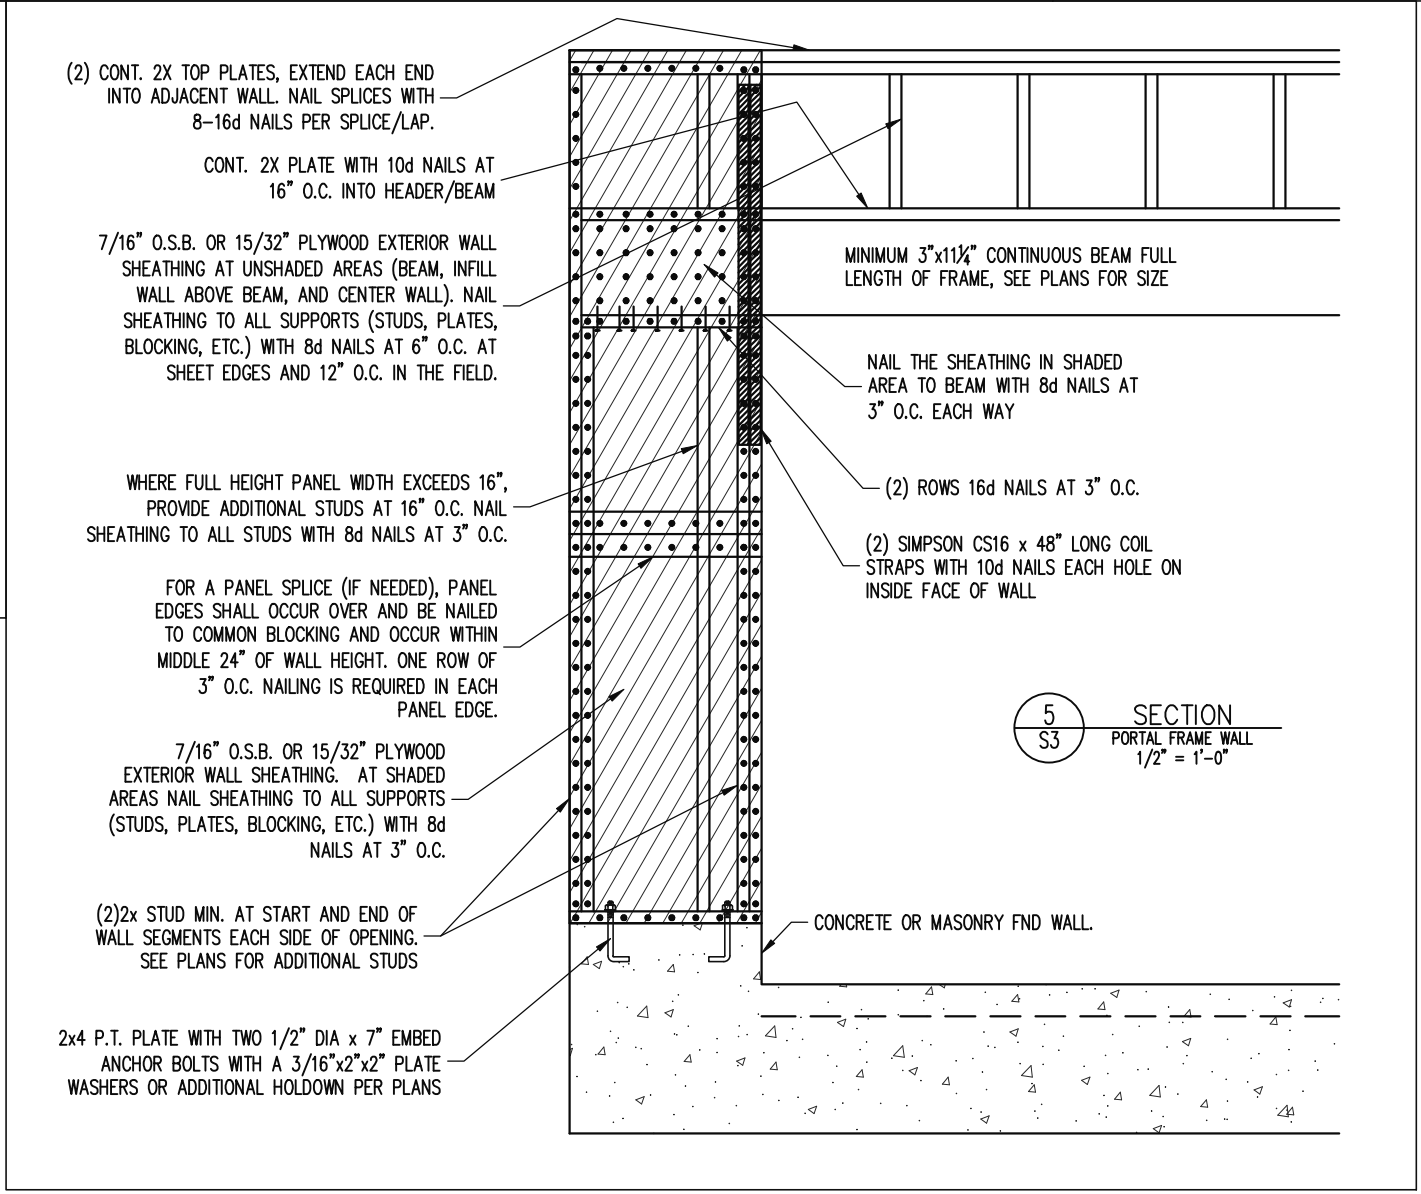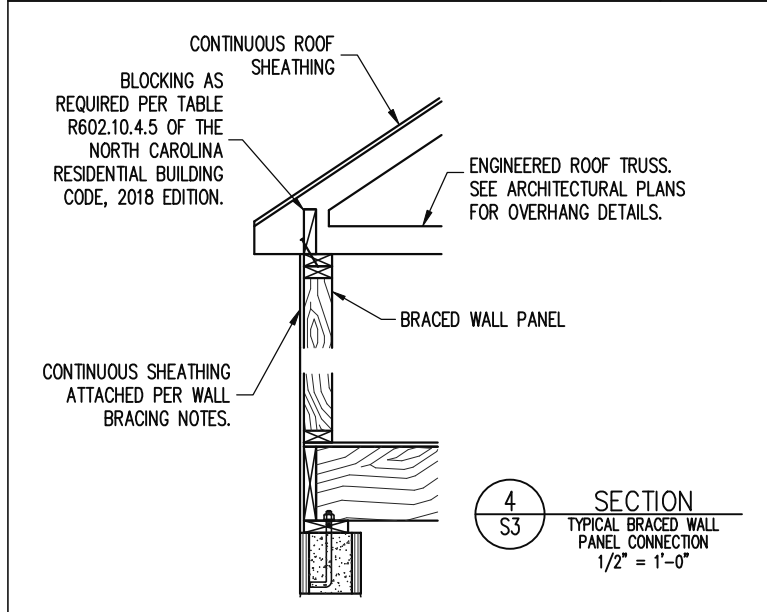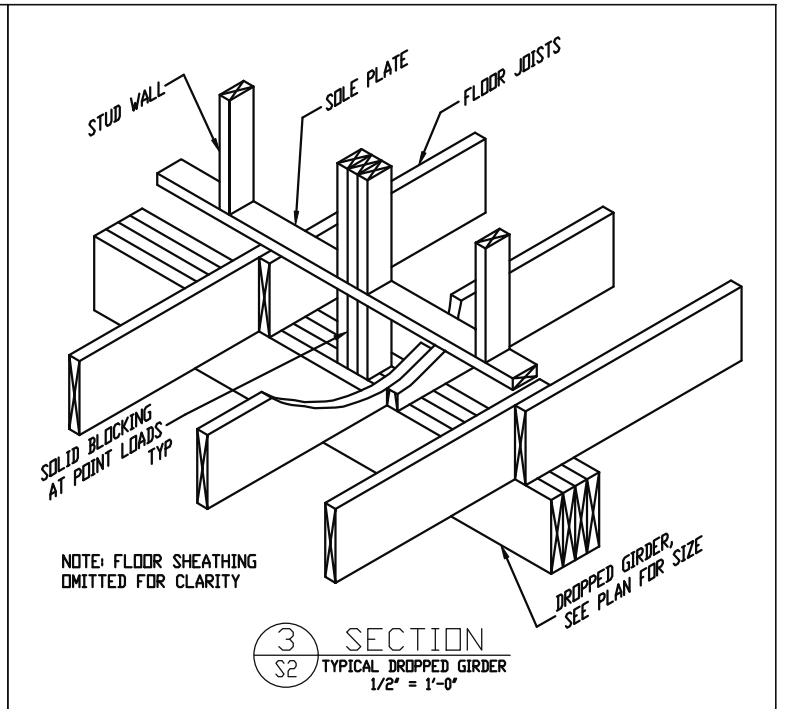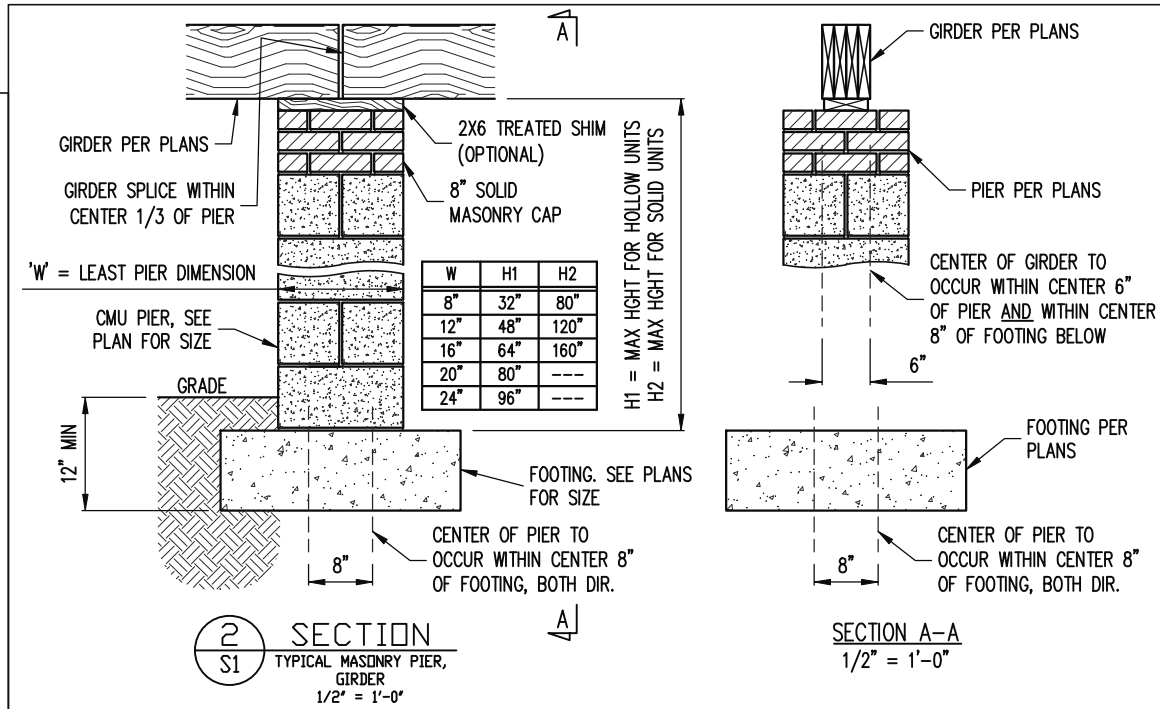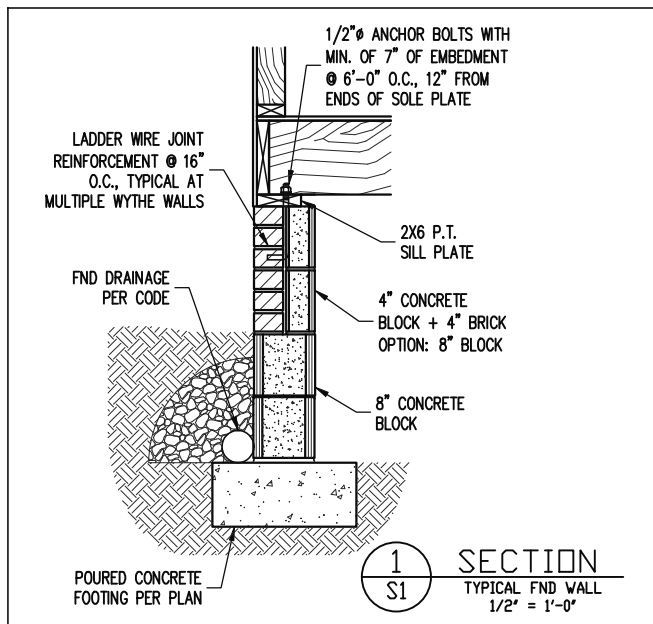

STRUCTURAL ENGINEERS
License No. C-3870
318 W MILLBROOK RD, SUITE 201
Raleigh, North Carolina 27609
Phone (919) 844-1661
Associates, P.A.

VALUE BUILD HOMES
STRUCTURAL ADDENDUM
SCOPE: 3493 SOUTH RIVER RD
LOC: LILLINGTON, NC
JOB#: 23-05-09 RAWLS


ENG: NBG/EAF
DATE: 06-21-2022

PLAN
CAMDEN B

PROJECT NO.
22-26-135

SHEET NO.
SD1

CONSTRUCTION SPECIFICATIONS

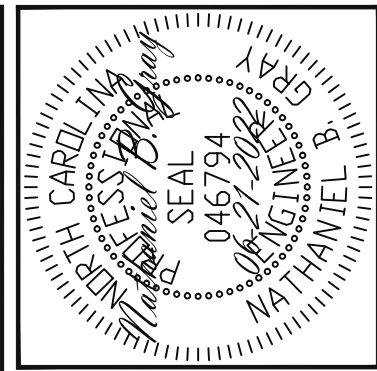

PART 1: GENERAL

1.01 CONSTRUCTION SHALL MEET THE REQUIREMENTS OF THE NORTH CAROLINA RESIDENTIAL CODE, 2018 EDITION.

1.02 DIMENSIONS SHOWN SHALL GOVERN OVER SCALE ON THESE DRAWINGS.

1.05 METHODS, PROCEDURES AND SEQUENCES OF CONSTRUCTION ARE THE RESPONSIBILITY OF THE CONTRACTOR, WHO SHALL TAKE ALL NECESSARY PRECAUTIONS TO MAINTAIN AND INSURE THE INTEGRITY OF THE STRUCTURE AT ALL STAGES OF CONSTRUCTION.

PART 2: DESIGN LOADS

2.01 DESIGN LOADS SHALL CONFORM WITH THE TABLE BELOW:

USE	LIVE LOAD (PSF)	DEAD LOAD (PSF)
BALCONIES, DECKS, ATTICS WITH FIXED STAIR ACCESS, DWELLING UNITS INCLUDING ATTICS WITH FIXED STAIR ACCESS, STAIRS, FIRE ESCAPES	40	10
GARAGES (PASSENGER CARS ONLY)	50	--
ATTICS (NO STORAGE, LESS THAN 5' HEADROOM)	10	10
ATTICS (WITH STORAGE)	20	10
ROOF	20	10 (15 FOR VAULTS)

NOTES: - INDIVIDUAL STAIR TREADS ARE TO BE DESIGNED FOR THE UNIFORMLY DISTRIBUTED LIVE LOAD OF 40 PSF OR A 300 LB. CONCENTRATED LOAD ACTING OVER AN AREA OF 4 SQ. WHICHEVER PRODUCES THE GREATER STRESS.
- BUILDER TO VERIFY DEAD LOAD DOES NOT EXCEED 10 PSF WHEN HEAVY FLOOR OR ROOF FINISHES SUCH AS TILE OR SLATE ARE UTILIZED. NOTIFY ENGINEERING UNDER THESE CONDITIONS

2.02 INTERIOR WALLS: 5 PSF LATERAL.

2.03 BASIC WIND DESIGN VELOCITY OF 120 MPH.

2.04 SOIL BEARING CAPACITY 2000 PSF (PRESUMPTIVE).

PART 3: STRUCTURAL STEEL

3.01 WIDE FLANGE BEAMS AND TEE SECTIONS SHALL CONFORM TO ASTM A992 MINIMUM GRADE

3.02 SQUARE AND RECTANGULAR TUBING SHALL CONFORM TO ASTM A500 GRADE B MINIMUM GRADE.

3.03 STEEL PIPE SHALL CONFORM TO ASTM A53 GRADE B, TYPE S, MINIMUM GRADE

3.04 ALL OTHER STRUCTURAL STEEL SHALL CONFORM TO ASTM A36 MINIMUM GRADE

3.05 STRUCTURAL STEEL CONSTRUCTION SHALL MEET THE REQUIREMENTS OF THE AISC SPECIFICATION FOR THE DESIGN, FABRICATION AND ERECTION OF STRUCTURAL STEEL FOR BUILDINGS.

PART 4: WELDING

4.01 WELDING ELECTRODES SHALL BE E70XX AND ALL WELDING SHALL BE PERFORMED BY AN AWS CERTIFIED WELDER

PART 5: CONCRETE AND SLABS ON GRADE

5.01 CAST IN PLACE CONCRETE SHALL BE OF NORMAL WEIGHT, 6% AIR ENTRAINMENT, AND SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI AT 28 DAYS TYP UNO. ALL CONCRETE, INCLUDING CONCRETE FOR FOOTINGS, IS TO BE CAST IN PLACE, TYP UNO.

5.02 REINFORCED CAST IN PLACE CONCRETE SHALL BE PROPORTIONED, MIXED AND PLACED IN ACCORDANCE WITH THE SPECIFICATIONS OF ACI 318, LATEST EDITION.

5.03 SLABS ON GRADE, IF ANY, SHALL CONTAIN SYNTHETIC POLYPROPYLENE FIBRILLATED MICRO FIBERS, FIBER LENGTH 1 1/2", DOSAGE RATE 1 1/2 LBS/CU YD. SLAB TO BE PLACED ON A 6 MIL VAPOR BARRIER ON 2" MIN GRANULAR FILL ON SOIL WITH 90% MIN STANDARD PROCTOR DENSITY. VAPOR BARRIER MAY BE OMITTED FOR SLABS NOT IN ENCLOSED AREAS

PART 6: REBAR AND WIRE REINFORCEMENT

6.01 REBAR SHALL BE DEFORMED STEEL CONFORMING TO ASTM A615 GRADE 60 TYP UNO

6.02 LAP SPLICES SHALL BE CLASS B AS DEFINED BY ACI 318, TYP UNO

6.03 WIRE REINFORCEMENT SHALL BE 9 GA AND SHALL CONFORM TO ASTM A1064.

PART 7: MASONRY

7.01 CONCRETE MASONRY UNITS SHALL CONFORM TO ASTM C90 AND C55, NORMAL WEIGHT, f'm = 1,500 PSI MIN

7.02 CLAY MASONRY UNITS SHALL CONFORM TO ASTM C62-17 GRADE SW

7.03 MORTAR SHALL BE TYPE S. MORTAR AND GROUT SHALL CONFORM TO ASTM C476, MIN COMPRESSIVE STRENGTH OF 2000 PSI.

7.04 MASONRY CONSTRUCTION SHALL CONFORM TO THE SPECIFICATIONS OF ACI 530

7.05 LADDER WIRE REINFORCEMENT SHALL CONFORM TO ASTM A951. 6" MIN LAPS FOR CONTINUOUS WALL APPLICATIONS

PART 8: BOLTS AND LAG SCREWS

8.01 BOLTS SHALL CONFORM TO ASTM A307 MINIMUM GRADE TYP UNO. INSTALL STANDARD STEEL WASHERS (ASTM F844-07a) FOR THE NUT / BOLT HEAD WHEN BOLTING WOOD MEMBERS

8.02 LAG SCREWS SHALL CONFORM TO ANSI/ASME STANDARD B18.2.1-1981. PILOT HOLES SHALL BE USED FOR LAG SCREW INSTALLATION AND SHALL BE BORED ACCORDING TO NDS SPECIFICATIONS. INSTALL STANDARD STEEL WASHERS (ASTM F844-07a) FOR SCREW HEAD

8.03 ANCHOR RODS AND BOLTS SHALL CONFORM TO ASTM F1554-15 GRADE 36 UNO. BENT ANCHOR BOLTS SHALL HAVE A 2" MIN HOOK UNO

PART 9: DRIVEN FASTENERS

9.01 NAILS, SPIKES AND STAPLES SHALL CONFORM TO ASTM F 1667-05. NAILS ARE TO BE COMMON WIRE OR BOX

PART 10: DIMENSIONAL LUMBER

10.01 SOLID SAWN WOOD FRAMING DESIGN IS BASED ON NO. 2 SPRUCE PINE FIR OR SYP #2 FOR JOISTS, RAFTERS, GIRDERS, BEAMS, STUDS, ETC.

PART 11: ENGINEERED LUMBER

11.01 LVL OR PSL MINIMUM ALLOWABLE DESIGN STRESSES ARE AS FOLLOWS:
E= 1.9 X 10E6 PSI, Fb = 2600 PSI, Fv = 285 PSI, Fc = 750 PSI
LSL MINIMUM ALLOWABLE DESIGN STRESSES ARE AS FOLLOWS:
E= 1.3 X 10E6 PSI, Fb = 1700 PSI, Fv = 400 PSI, Fc = 680 PSI

11.02 LVL OR PSL MEMBERS MAY BE RIPPED FROM DEEPER MEMBERS TO MATCH THE MEMBER DEPTH SPECIFIED IN THE PLANS

PART 12: PRESSURE TREATED LUMBER

12.01 LUMBER IN CONTACT WITH THE GROUND, CONCRETE OR MASONRY SHALL BE PRESSURE TREATED IN ACCORDANCE WITH AWPA STANDARD C-15. ALL OTHER EXPOSED LUMBER SHALL BE TREATED IN ACCORDANCE WITH AWPA STANDARD C-2 OR BY ANY METHOD GIVING EQUAL PROTECTION. THE BUILDING CODE OFFICE MAY ALSO APPROVE A NATURAL DECAY RESISTANT WOOD PER SECTION 19-6(A)

PART 13: STEEL FLITCH PLATE BEAMS

13.01 FLITCH PLATE BEAMS SHALL CONSIST OF A CONTINUOUS STEEL PLATE BOLTED BETWEEN TWO PIECES OF CONTINUOUS LUMBER AS SIZED ON THE PLANS. BOLT PIECES TOGETHER USING 1/2" Ø BOLTS SPACED AT 24" O.C. STAGGERED TOP TO BOTTOM OF THE BEAM. MAINTAIN A 2" EDGE DISTANCE. PLACE TWO BOLTS, ONE ABOVE THE OTHER, 6" ± 2" FROM EACH END OF THE BEAM.

PART 14: STUD SUPPORTS FOR BEAMS

14.01 STEEL, ENGINEERED LUMBER, AND FLITCH PLATE BEAMS BEARING ON A STUD WALL SHALL BEAR AS FOLLOWS:

1-WHEN THE BEAM IS PERPENDICULAR TO, OR SKEWED RELATIVE TO THE WALL, THE BEAM SHALL BEAR FULL WIDTH ON THE SUPPORTING WALL INDICATED AND SHALL BE SUPPORTED BY A MINIMUM OF THREE GANGED STUDS, OR A GANGED STUD COLUMN WITH A NUMBER OF STUDS SUCH THAT THE STUD COLUMN IS AT LEAST AS WIDE AS THE TRUE WIDTH OF THE BEAM BEING SUPPORTED, WHICHEVER IS GREATER, TYP UNO. FOR THE SKEWED CONDITION PARTICULAR CARE SHALL BE TAKEN TO ENSURE STUD COLUMN IS CENTERED ON THE BEAM

2-BEAMS BEARING ONTO THE END OF A STUD WALL PARALLEL TO THE BEAM SHALL BEAR A MINIMUM OF 4 1/2" ONTO THE WALL AND BE SUPPORTED BY A TRPL STUD GANGED COLUMN TYP UNO.

14.02 DIMENSIONAL LUMBER BEAMS BEARING ON A STUD WALL SHALL BEAR AS FOLLOWS:

1-WHEN THE BEAM IS PERPENDICULAR TO, OR SKEWED RELATIVE TO THE WALL, THE BEAM SHALL BEAR FULL WIDTH ON THE SUPPORTING WALL INDICATED (LESS 1 1/2" TO ALLOW

FOR A CONTINUOUS RIM JOIST WHERE APPLICABLE) AND SHALL BE SUPPORTED BY A GANGED STUD COLUMN THE SAME WIDTH AS THE BEAM TYP UNO. (E.G. A TRIPLE 2X10 IS TO BE SUPPORTED BY (3) STUDS). FOR THE SKEWED CONDITION PARTICULAR CARE SHALL BE TAKEN TO ENSURE STUD COLUMN IS CENTERED ON THE BEAM

2-BEAMS BEARING ONTO THE END OF A STUD WALL PARALLEL TO THE BEAM SHALL BEAR A MINIMUM OF 3" ONTO THE WALL AND BE SUPPORTED BY A DBL STUD GANGED COLUMN TYP UNO.

14.03 EXTRA JOISTS BEARING ON A STUD WALL PERPENDICULAR TO OR SKEWED RELATIVE TO THE BEAM SHALL BE SUPPORTED BY ONE ADDITIONAL STUD.

14.04 STUDS THAT ARE GANGED TO FORM A COLUMN SHALL HAVE ADJACENT STUDS WITHIN THE COLUMN NAILED TOGETHER WITH ONE ROW OF 10d NAILS AT 8" O.C. (TWO ROWS OF 10d NAILS @ 8" O.C., 3" APART, FOR 2X8 OR 2X10 STUDS) ALL COLUMNS SHALL BE CONTINUOUS DOWN TO THE FOUNDATION OR OTHER PROPERLY DESIGNED STRUCTURAL ELEMENT SUCH AS A BEAM. COLUMNS TRANSFERRING LOADS THROUGH FLOOR LEVELS SHALL BE SOLIDLY BLOCKED FOR THE FULL WIDTH OF THE STUD COLUMN WITHIN THE CAVITY FORMED BY THE FLOOR JOISTS.

PART 15: NAILING OF MULTI PLY WOOD BEAMS

15.01 SOLID SAWN LUMBER JOISTS THAT ARE GANGED TO FORM A BEAM SHALL HAVE ADJACENT MEMBERS IN THE BEAM NAILED TOGETHER WITH THREE ROWS OF 10d NAILS @ 16" O.C. FOR 2X10 OR LARGER, TWO ROWS OF 10d NAILS @ 16" O.C. FOR 2X8, ONE ROW OF 10d NAILS @ 16" O.C. FOR 2X6 OR SMALLER. STAGGER ROWS 5" MIN.

15.02 LVL MEMBERS THAT ARE GANGED TO FORM A BEAM SHALL HAVE ADJACENT MEMBERS IN THE BEAM FASTENED TOGETHER PER MANUFACTURERS RECOMMENDATIONS, TYP UNO

PART 16: WALL FRAMING AND BRACING

16.01 STUD WALLS SHALL CONSIST OF 2X4 STUDS SPACED AT 16" O.C. UNO. STUDS SHALL BE CONTINUOUS FROM SOLE PLATE AT FLOOR TO DOUBLE TOP PLATE AT THE CEILING OR ROOF. NO INTERMEDIATE BANDS OR PLATES SHALL CAUSE DISCONTINUITIES IN A STUD WALL EXCEPT AS REQUIRED FOR DOOR OR WINDOW OPENINGS. THE KING STUDS FOR SUCH OPENINGS SHALL BE CONTINUOUS, TYP UNO.

MAX ALLOWABLE WALL HEIGHTS FOR EXTERIOR STUD WALLS, WITH SOLE PLATE AND DBL TOP PLATE AND 7/16" OSB EXTERIOR BRACING AND ROW OF 2X4 / 2X6 PURLINS AT 8' HEIGHT (AND AT 16' HEIGHT FOR TALL WALLS), TYP UNO:
2X4 @ 16" O.C.: 11'-1 1/2" 2X6 @ 16" O.C.: 17'-0"
2X4 @ 12" O.C.: 12'-1 1/2" 2X6 @ 12" O.C.: 18'-8"
DBL 2X4 @ 16" O.C.: 13'-4" DBL 2X6 @ 16" O.C.: 21'-0"

16.02 FOR WALL BRACING THE FOLLOWING SHALL APPLY:
-BLOCKING AT UNSUPPORTED PANEL EDGES IS REQUIRED TYP UNO.
-WALL BRACING IS BY ENGINEERED DESIGN AND NOT PRESCRIPTIVE PER SECTION 602.10 OF THE 2018 NCR. CONTINUOUS SHEATHING HAS BEEN PROVIDED, ALONG WITH ALTERNATIVE METHODS TO INSURE THE MINIMUM INTENT OF SECTION 602.10 OF THE 2018 NCR HAS BEEN MET AND EXCEEDED.
-BRACED WALL PANELS SHALL BE FASTENED IN ACCORDANCE WITH TABLE 602.3(1) TO PROVIDE CONTINUOUS PANEL UPLIFT RESISTANCE AND COMPLIANCE WITH NCRBC R602.3.5 AND R802.11 UNLESS NOTED OTHERWISE ON STRUCTURAL PLANS.
-MAY SUBSTITUTE WSP FOR GB
-SINGLE JOIST, CONTINUOUS RIM JOIST, OR BLOCKING OF EQUAL DEPTH IS REQUIRED ABOVE AND BELOW ALL BRACED WALLS. NAIL BLOCKING ABOVE WALL TO TOP PLATE WITH 16d TOE NAILS @ 6" O.C. NAIL SOLE PLATE OF BRACED WALL TO BLOCKING BELOW WITH (3) 16d NAILS @ 16" O.C. BLOCKING AT HORIZONTAL JOINTS IN BRACED WALL LINES ONLY REQUIRED AT SHADED WALLS, UNO.

PART 17: KING STUDS

17.01 KING STUDS FOR OPENINGS IN EXTERIOR WALLS SHALL BE AS FOLLOWS:

MAX OPENING WIDTH	NUMBER OF KING STUDS				
	5'-0"	9'-0"	13'-0"	17'-0"	21'-0"
2X4	1	2	3	4	5
2X6	1	1	2	2	2
2X8	1	1	1	1	2

PART 18: SUBSTITUTIONS

18.01 MATERIAL OR MEMBER SIZE SUBSTITUTIONS OR PLAN DEVIATIONS REQUIRE THE WRITTEN AUTHORIZATION OF THE DESIGNERS. UNAUTHORIZED DEVIATIONS ARE THE SOLE RESPONSIBILITY OF THE CONTRACTOR.

PART 19: OWNERSHIP OF STRUCTURAL DESIGN

19.01 THE STRUCTURAL DESIGN OF THIS PLAN IS THE PROPERTY OF ENGINEERING TECH ASSOCIATES (ETA). THESE PLANS ARE FOR THE ONE TIME USE AT THE LOCATION INDICATED AND FOR THE CLIENT LISTED. ETA ASSUMES NO LIABILITY FOR THESE PLANS IF THEY ARE REPRODUCED, IN WHOLE OR IN PART, FOR CONSTRUCTION AT ANY OTHER LOCATION WITHOUT WRITTEN PERMISSION FROM ETA

ABBREVIATIONS																																					
<table border="0"> <tr><td>TJ</td><td>TRIPLE JOIST</td></tr> <tr><td>TYP</td><td>TYPICAL</td></tr> <tr><td>TRPL</td><td>TRIPLE</td></tr> <tr><td>TSP</td><td>TRIPLE STUD POCKET</td></tr> <tr><td>UNO</td><td>UNLESS NOTED OTHERWISE</td></tr> <tr><td>XJ</td><td>EXTRA JOIST</td></tr> </table>	TJ	TRIPLE JOIST	TYP	TYPICAL	TRPL	TRIPLE	TSP	TRIPLE STUD POCKET	UNO	UNLESS NOTED OTHERWISE	XJ	EXTRA JOIST	<table border="0"> <tr><td>FOUNDATION</td><td></td></tr> <tr><td>FTG</td><td>FOOTING</td></tr> <tr><td>HDG</td><td>HOT DIPPED GALVANIZED</td></tr> <tr><td>HGR</td><td>HANGER</td></tr> <tr><td>LVL</td><td>LAMINATED VENEER LUMBER</td></tr> <tr><td>NTS</td><td>NOT TO SCALE</td></tr> <tr><td>O.C.</td><td>ON CENTER</td></tr> <tr><td>PSL</td><td>PARALLEL STRAND LUMBER</td></tr> <tr><td>PT</td><td>PRESSURE TREATED</td></tr> <tr><td>QU</td><td>QUAD JOIST</td></tr> <tr><td>SP</td><td>STUD POCKET</td></tr> <tr><td>SQ</td><td>SQUARE</td></tr> </table>	FOUNDATION		FTG	FOOTING	HDG	HOT DIPPED GALVANIZED	HGR	HANGER	LVL	LAMINATED VENEER LUMBER	NTS	NOT TO SCALE	O.C.	ON CENTER	PSL	PARALLEL STRAND LUMBER	PT	PRESSURE TREATED	QU	QUAD JOIST	SP	STUD POCKET	SQ	SQUARE
TJ	TRIPLE JOIST																																				
TYP	TYPICAL																																				
TRPL	TRIPLE																																				
TSP	TRIPLE STUD POCKET																																				
UNO	UNLESS NOTED OTHERWISE																																				
XJ	EXTRA JOIST																																				
FOUNDATION																																					
FTG	FOOTING																																				
HDG	HOT DIPPED GALVANIZED																																				
HGR	HANGER																																				
LVL	LAMINATED VENEER LUMBER																																				
NTS	NOT TO SCALE																																				
O.C.	ON CENTER																																				
PSL	PARALLEL STRAND LUMBER																																				
PT	PRESSURE TREATED																																				
QU	QUAD JOIST																																				
SP	STUD POCKET																																				
SQ	SQUARE																																				
<table border="0"> <tr><td>ABV</td><td>ABOVE</td></tr> <tr><td>B.</td><td>BOTH</td></tr> <tr><td>B.E.</td><td>BOTH ENDS</td></tr> <tr><td>BTWN</td><td>BETWEEN</td></tr> <tr><td>CIP</td><td>CAST IN PLACE CONCRETE</td></tr> <tr><td>CONC</td><td>CONCRETE</td></tr> <tr><td>CS</td><td>CONTINUOUS SHEATHING</td></tr> <tr><td>DIA</td><td>DIAMETER</td></tr> <tr><td>DBL</td><td>DOUBLE</td></tr> <tr><td>DJ</td><td>DOUBLE JOIST</td></tr> <tr><td>DSP</td><td>DBL STUD POCKET</td></tr> <tr><td>EQ</td><td>EQUAL</td></tr> <tr><td>EA</td><td>EACH</td></tr> <tr><td>FLG</td><td>FLANGE</td></tr> <tr><td>FL PL</td><td>FLITCH PLATE</td></tr> <tr><td>FLR</td><td>FLOOR</td></tr> </table>	ABV	ABOVE	B.	BOTH	B.E.	BOTH ENDS	BTWN	BETWEEN	CIP	CAST IN PLACE CONCRETE	CONC	CONCRETE	CS	CONTINUOUS SHEATHING	DIA	DIAMETER	DBL	DOUBLE	DJ	DOUBLE JOIST	DSP	DBL STUD POCKET	EQ	EQUAL	EA	EACH	FLG	FLANGE	FL PL	FLITCH PLATE	FLR	FLOOR	<p>THE BUILDER IS RESPONSIBLE FOR REVIEWING PLANS PRIOR TO CONSTRUCTION. THE BUILDER SHALL IMMEDIATELY CONTACT THE ENGINEER OF RECORD (EOR) BEFORE PROCEEDING IF THE FOLLOWING CONDITIONS ARE NOTED BEFORE OR DURING CONSTRUCTION:</p> <p>1) THE WORKING PLANS DO NOT BEAR THE SEAL OF THE EOR</p> <p>2) THE PLANS CONTAIN DISCREPANT OR INCOMPLETE INFORMATION</p> <p>ANY ERRORS DUE TO A FAILURE TO FOLLOW THE ABOVE PROCEDURES SHALL NOT BE THE RESPONSIBILITY OF THE EOR. FURTHERMORE, IT IS THE RESPONSIBILITY OF THE BUILDER TO ENSURE THAT ANY REVISIONS ISSUED BY THE EOR ARE PROMPTLY DISTRIBUTED TO THE SUBCONTRACTORS</p> <p>THE EOR DOES NOT PERFORM FENESTRATION OR VENTING CALCULATIONS OR ANY OTHER CALCULATIONS THAT ARE NOT DIRECTLY RELATED TO STRUCTURAL ENGINEERING.</p> <p>ROOF AND FLOOR TRUSSES TO BE DESIGNED BY AN ENGINEER REGISTERED BY THE STATE. FINAL TRUSS DRAWING SHOULD BE SUBMITTED TO THE EOR FOR REVIEW</p>				
ABV	ABOVE																																				
B.	BOTH																																				
B.E.	BOTH ENDS																																				
BTWN	BETWEEN																																				
CIP	CAST IN PLACE CONCRETE																																				
CONC	CONCRETE																																				
CS	CONTINUOUS SHEATHING																																				
DIA	DIAMETER																																				
DBL	DOUBLE																																				
DJ	DOUBLE JOIST																																				
DSP	DBL STUD POCKET																																				
EQ	EQUAL																																				
EA	EACH																																				
FLG	FLANGE																																				
FL PL	FLITCH PLATE																																				
FLR	FLOOR																																				
NOTES																																					

Engineering

STRUCTURAL ENGINEERS
License No. C-3870
318 W MILLBROOK RD, SUITE 201
Raleigh, North Carolina 27609
Lech Nathaniel B. Associates, P.A.

SCOPE	VALUE BUILD HOMES	LOC	3493 SOUTH RIVER RD
STRUCTURAL ADDENDUM		LILLINGTON, NC	
		JOB#	23-05-09 RAWLS

ENG: NBG/EAF
DATE: 06-21-2022

PLAN
CAMDEN B

PROJECT NO.
22-26-135

SHEET NO.
SPECS

6 of 6