


THESE PLANS, NOTES AND DETAILS ARE DESIGNED TO MEET THE 2018 EDITION OF THE NORTH CAROLINA RESIDENTIAL BUILDING CODE





#### FRONT ELEVATION SCALE: 1/8" = 1'-0"

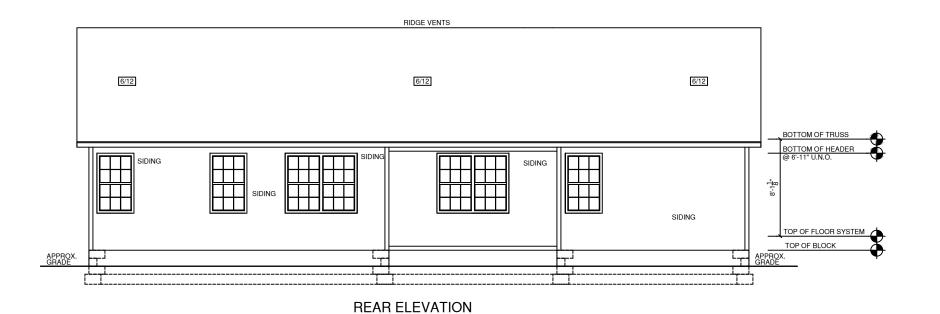

SCALE: 1/8" = 1'-0"

**BUYER** DATE **BUYER** DATE

**FINAL** 109-22-128 RANDALL

#### **GENERAL NOTES**

1.) MAIN FLOOR PLATE HEIGHT TO BE 8'-0" UNLESS NOTED OTHERWISE.

2.) OPTIONAL BONUS PLATE HEIGHT TO BE 8'-0" UNLESS NOTED OTHERWISE.

8-0" ONLESS NOTED OTHERWISE.

3.) INTERIOR & EXTERIOR WALLS TO BE DRAWN @ 3 1/2" UNLESS NOTED OTHERWISE.

4.) ALL ANGLES TO BE DRAWN AT 45° OR 90° UNLESS NOTED OTHERWISE.

5.) WINDOW HEADER HEIGHT TO BE SET @ 6-11" UNLESS NOTED OTHERWISE. HEADER SIZE AND MATERIAL TO BE DETERMINED & VERIFIED BY FRAMER, BUILDER, TRUSS SHOP OR BY A LICENSED ENGINEER.

6.) SIZE, LOCATION AND MATERIALS OF BEAMS

6.) SIZE, LOCA TION AND MAIEMALS OF BEAMS TRUSSES, GIRDERS AND HEADERS TO BE DETERMINED & VERIFIED BY BUILDER, FRAMER TRUSS SHOP OR LICENSED ENGINEER.

7.) FOOTER SIZE, MATERIAL & LOCATIONS TO BE VERIFIED AND DETERMINED BY BUILDER, FOOTER CONTRACTOR OR LICENSED ENGINEER.

8.) ROOF VENTELLATION TO BE DETERMINED & VERIFIED BUILDER, ROOFING COTRACTOR OR LICENSED ENGINEER.

OR LICENSED ENGINEER.

9.) ALL MECHANICAL SYSTEMS DESIGNS,
LOCATIONS AND SIZING TO BE DETERMINED
& VERIFIED BY BUILDER, APPROPRIATE TRADE
CONTRACTOR AND OR LICENSED ENGINEER.

10.) BUILDER RESPONSIBLE FOR VERIFYING
AND COMPLYING WITH ALL LOCAL, STATE
& NATIONAL CODES.

11.) LOCAL, STATE AND NATIONAL CODES
TAKE DEGISISING OVER DEAWINGS

TAKE PRECIDENCE OVER DRAWINGS. 12.) BUILDER TO VERIFY ALL DIMENSIONS.

COPYRIGHT 2022 RED DOOR HOMES, LLC. LICENSED TO RED DOOR HOMES OF: CENTRAL CAROLINA



#### SQUARE FOOTAGE CHART

HEATED & COOLED TO FRAMING:	1877
GARAGE AREA TO FRAMING:	432
FRONT PORCH AREA:	42
REAR PORCH AREA:	84
TOTAL UNDER BEAM AREA	2435
·	

SUBDIVISION NAME:

XXXXXXXXX

CITY: XXXXXXXXX

PHASE:

LOT:

XXXXXXXXX


BLOCK: XXXXXXXXX


XXXXXXXXX DRAFTING DATES:

PRELIMINARY: 06/09/2022 PJM PERM: 07/11/2022 PJM

FINAL: 8/17/2022 JPH

Front & Rear Elevation

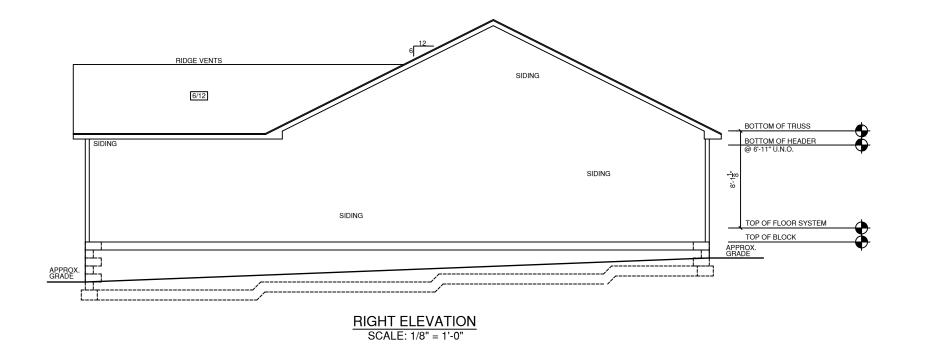

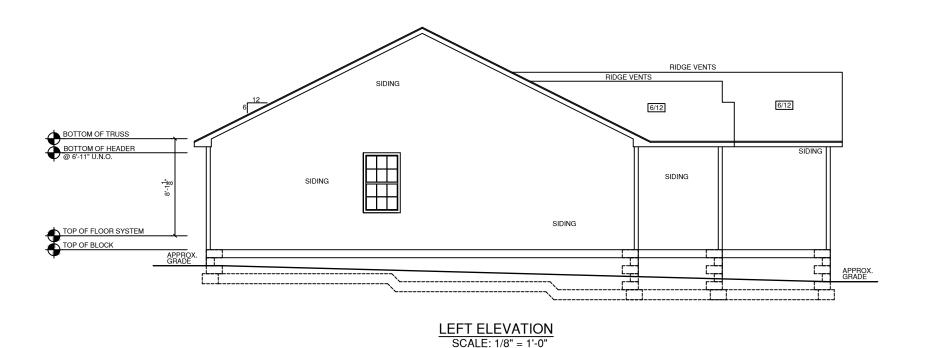

**BUYER** DATE **BUYER** DATE

**FINAL** 109-22-128 RANDALL

#### **GENERAL NOTES**

1.) MAIN FLOOR PLATE HEIGHT TO BE 8'-0" UNLESS NOTED OTHERWISE. 2.) OPTIONAL BONUS PLATE HEIGHT TO BE 8'-0" UNLESS NOTED OTHERWISE.

8-0\* UNLESS NOTED OTHERWISE.

3.) INTERIOR & EXTERIOR WALLS TO BE DRAWN @ 3 1/2" UNLESS NOTED OTHERWISE.

4.) ALL ANGLES TO BE DRAWN AT 45° OR 90° UNLESS NOTED OTHERWISE.

OR 30° UNLESS NOTED OTHERWISE.
5) WINDOW HEADER HEIGHT TO BE SET @
6'-11" UNLESS NOTED OTHERWISE. HEADER
SIZE AND MATERIAL TO BE DETERMINED &
VERIFIED BY FRAMER, BUILDER, TRUSS SHOP
OR BY A LICENSED ENGINEER.
6.) SIZE, LOCATION AND MATERIALS OF BEAMS
TDIESES, EIDENER AND HEADERS TO BE

16.) SIZE, LUCATION AND MATERIALS OF BEAMS TRUSSES, GIRDERS AND HEADERS TO BE DETERMINED & VERIFIED BY BUILDER, FRAMER TRUSS SHOP OR LICENSED ENGINEER.

7.) FOOTER SIZE, MATERIAL & LOCATIONS TO BE VERIFIED AND DETERMINED BY BUILDER, FOOTER CONTRACTOR OR LICENSED ENGINEER.

8.) ROOF VENTELLATION TO BE DETERMINED & VERIFIED BUILDER, ROOFING COTRACTOR OR LICENSED ENGINEER.

OR LICENSED ENGINEER.

9.) ALL MECHANICAL SYSTEMS DESIGNS, LOCATIONS AND SIZING TO BE DETERMINED & VERIFIED BY BUILDER, APPROPRIATE TRADE CONTRACTOR AND OR LICENSED ENGINEER.

10.) BUILDER RESPONSIBLE FOR VERIFYING AND COMPLYING WITH ALL LOCAL, STATE & NATIONAL CODES.

11.) LOCAL, STATE AND NATIONAL CODES TAKE PRECIDENCE OVER DRAWINGS.

12.) BUILDER TO VERIFY ALL DIMENSIONS.

COPYRIGHT 2022 RED DOOR HOMES, LLC. LICENSED TO RED DOOR HOMES OF: CENTRAL CAROLINA



#### SQUARE FOOTAGE CHART

- 1		
	HEATED & COOLED TO FRAMING:	1877
	GARAGE AREA TO FRAMING:	432
	FRONT PORCH AREA:	42
	REAR PORCH AREA:	84
	TOTAL UNDER BEAM AREA	2435

#### SUBDIVISION NAME:

XXXXXXXXX

CITY: XXXXXXXXX

PHASE: XXXXXXXXX

BLOCK:

XXXXXXXXX

LOT:

XXXXXXXXX DRAFTING DATES:

PRELIMINARY: 06/09/2022 PJM

PERM: 07/11/2022 PJM FINAL: 8/17/2022 JPH

Right & Left Elevation

BEAM (S) TO BE SIZED TO LOCAL & STATE CODES BY BUILDER (TYP).

NOTE: LOCATION AND SIZE OF CRAWL ACCESS DOOR T.B.D. AT PRECONSTRUCTION / LOT **INSPECTION** 


PIER SIZE AND LOCATION T.B.D. BY CODE, TRUSS SHOP & BY BUILDER (TÝP).

NOTE: LOCATION AND NUMBER OF CRAWL VENTS TO BE VERIFIED PRIOR TO CONST.

NOTE: FLOOR SYSTEM TYPE, SIZE AND SPACING T.B.D. BY BUILDER & TRUSS SHOP.



**BUYER** 

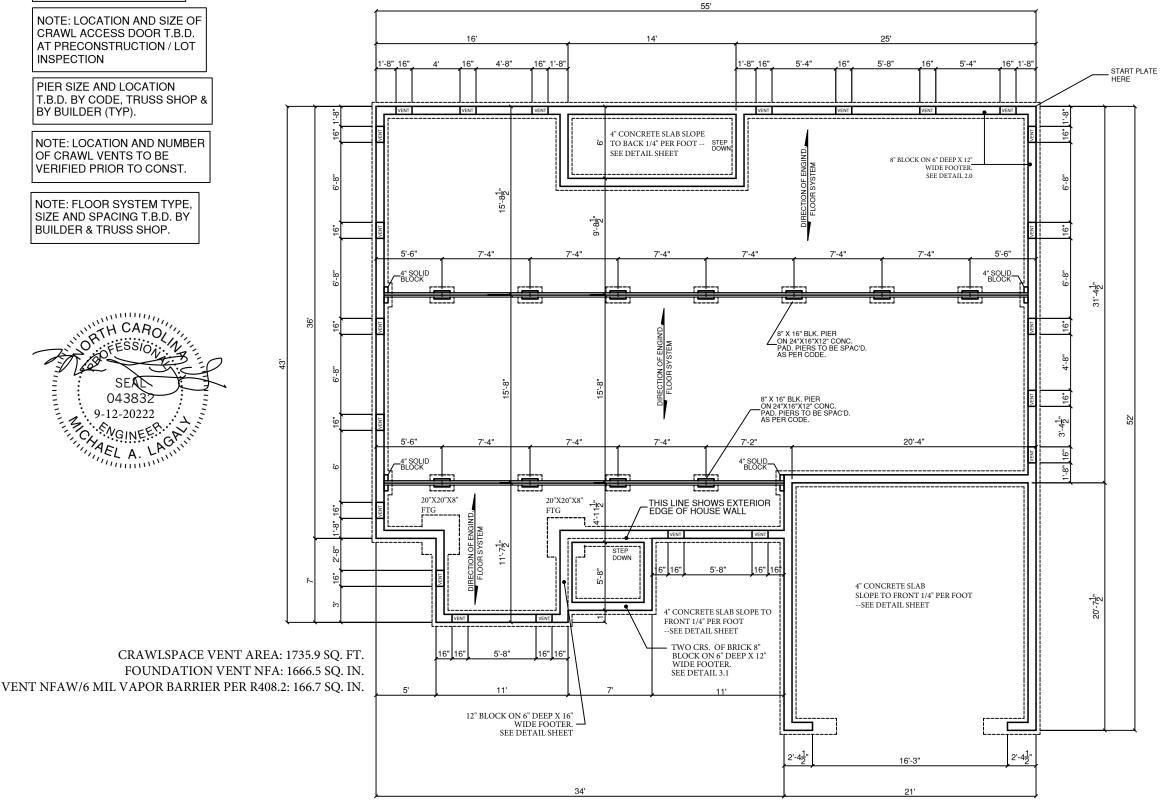

**BUYER** DATE

DATE

**CRAWL SPACE FOUNDATION** 

**FINAL** 109-22-128 RANDALL

#### **GENERAL NOTES**

1.) MAIN FLOOR PLATE HEIGHT TO BE 8'-0" UNLESS NOTED OTHERWISE. 2.) OPTIONAL BONUS PLATE HEIGHT TO BE 8'-0" UNLESS NOTED OTHERWISE.

8-0" UNLESS NOTED OTHERWISE.

3.) INTERIOR & EXTERIOR WALLS TO BE DRAWN @ 3 1/2" UNLESS NOTED OTHERWISE.

4.) ALL ANGLES TO BE DRAWN AT 45° OR 90° UNLESS NOTED OTHERWISE.

5.) WINDOW HEADER HEIGHT TO BE SET @ 6-11" UNLESS NOTED OTHERWISE. HEADER SIZE AND MATERIAL TO BE DETERMINED & VERIFIED BY FRAMER, BUILDER, TRUSS SHOP OR BY A LICENSED ENGINEER.

6.) SIZE, LOCATION AND MATERIALS OF BEAMS TRUSSES, GIRDERS AND HEADERS TO BE DETERMINED & VERIFIED BY BUILDER. FRAMER TRUSS SHOP OR LICENSED ENGINEER.

7.) FOOTER SIZE, MATERIAL & LOCATIONS TO BE VERIFIED AND DETERMINED BY BUILDER, FOOTER CONTRACTOR OR LICENSED ENGINEER.

8.) ROOF VENTELLATION TO BE DETERMINED & VERIFIED BUILDER, ROOFING COTRACTOR OR LICENSED ENGINEER.

OR LICENSED ENGINEER.

9.) ALL MECHANICAL SYSTEMS DESIGNS,
LOCATIONS AND SIZING TO BE DETERMINED
& VERIFIED BY BUILDER, APPROPRIATE TRADE
CONTRACTOR AND OR LICENSED ENGINEER. IO.) BUILDER RESPONSIBLE FOR VERIFYING AND COMPLYING WITH ALL LOCAL, STATE & NATIONAL CODES. 11.) LOCAL, STATE AND NATIONAL CODES

TAKE PRECIDENCE OVER DRAWINGS.

12.) BUILDER TO VERIFY ALL DIMENSIONS.

COPYRIGHT 2022 RED DOOR HOMES, LLC. LICENSED TO RED DOOR HOMES OF: CENTRAL CAROLINA



#### SQUARE FOOTAGE CHART

HEATED & COOLED TO FRAMING:	1877
GARAGE AREA TO FRAMING:	432
FRONT PORCH AREA:	42
REAR PORCH AREA:	84
TOTAL UNDER BEAM AREA	2435

#### SUBDIVISION NAME:

XXXXXXXXX

CITY: XXXXXXXXX

PHASE:

XXXXXXXXX

BLOCK:


XXXXXXXXX LOT:

XXXXXXXXX DRAFTING DATES:

PRELIMINARY: 06/09/2022 PJM

PERM: 07/11/2022 PJM FINAL: 8/17/2022 JPH

**Crawl Space Foundation** 

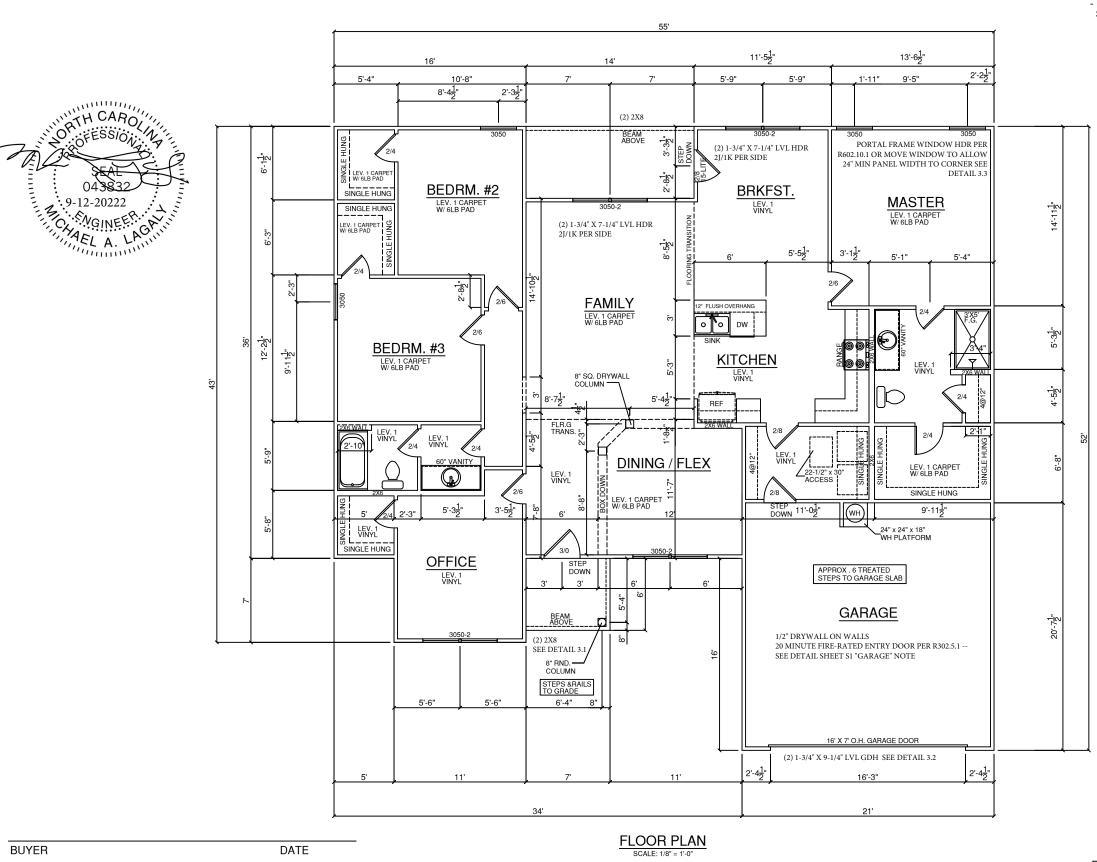

**BUYER** 

DATE

- GARAGE DOOR OPENER W/ TWO REMOTES
- LOCATE FLOOD LIGHTS @ C.E.M.
- 8" DEEP S.S. KITCHEN SINK
- LEV. 4 FRIGIDAIRE APPLIANCE PACKAGE S.S. W/ SIDE BY SIDE REF.

**FINAL** 

109-22-128 RANDALL

#### **GENERAL NOTES**

1.) MAIN FLOOR PLATE HEIGHT TO BE 8'-0" UNLESS NOTED OTHERWISE.

2.) OPTIONAL BONUS PLATE HEIGHT TO BE 8'-0" UNLESS NOTED OTHERWISE.

3.) INTERIOR & EXTERIOR WALLS TO BE DRAWN @ 3 1/2" UNLESS NOTED OTHERWISE.

4.) ALL ANGLES TO BE DRAWN AT 45° OR 90° UNLESS NOTED OTHERWISE.
5.) WINDOW HEADER HEIGHT TO BE SET @
6'-11" UNLESS NOTED OTHERWISE. HEADER SIZE AND MATERIAL TO BE DETERMINED & VERIFIED BY FRAMER, BUILDER, TRUSS SHOP OR BY A LICENSED ENGINEER.

6.) SIZE, LOCATION AND MATERIALS OF BEAMS TRUSSES, GIRDERS AND HEADERS TO BE DETERMINED & VERIFIED BY BUILDER, FRAMER TRUSS SHOP OR LICENSED ENGINEER.

7.) FOOTER SIZE, MATERIAL & LOCATIONS TO BE VERIFIED AND DETERMINED BY BUILDER, FOOTER CONTRACTOR OR LICENSED ENGINEER.

8.) ROOF VENTELLATION TO BE DETERMINED & VERIFIED BUILDER, ROOFING COTRACTOR OR LICENSED ENGINEER.

OR LICENSED ENGINELER.

9.) ALL MECHANICAL SYSTEMS DESIGNS,
LOCATIONS AND SIZING TO BE DETERMINED
& VERIFIED BY BUILDER, APPROPRIATE TRADE
CONTRACTOR AND OR LICENSED ENGINEER.

10.) BUILDER RESPONSIBLE FOR VERIFYING
AND COMPLYING WITH ALL LOCAL, STATE
& NATIONAL CODES

11.) LOCAL, STATE AND NATIONAL CODES

TAKE PRECIDENCE OVER DRAWINGS.

12.) BUILDER TO VERIFY ALL DIMENSIONS.

COPYRIGHT 2022 RED DOOR HOMES, LLC. LICENSED TO RED DOOR HOMES OF: CENTRAL CAROLINA



#### SQUARE FOOTAGE CHART

HEATED & COOLED TO FRAMING:	1877
GARAGE AREA TO FRAMING:	432
FRONT PORCH AREA:	42
REAR PORCH AREA:	84
TOTAL UNDER BEAM AREA	2435

#### SUBDIVISION NAME:

XXXXXXXXX

CITY: XXXXXXXXXX

PHASE:

XXXXXXXXX


BLOCK: XXXXXXXXXX

LOT:

XXXXXXXXXX DRAFTING DATES:

PRELIMINARY: 06/09/2022 PJM PERM: 07/11/2022 PJM FINAL: 8/17/2022 JPH

Floor Plan

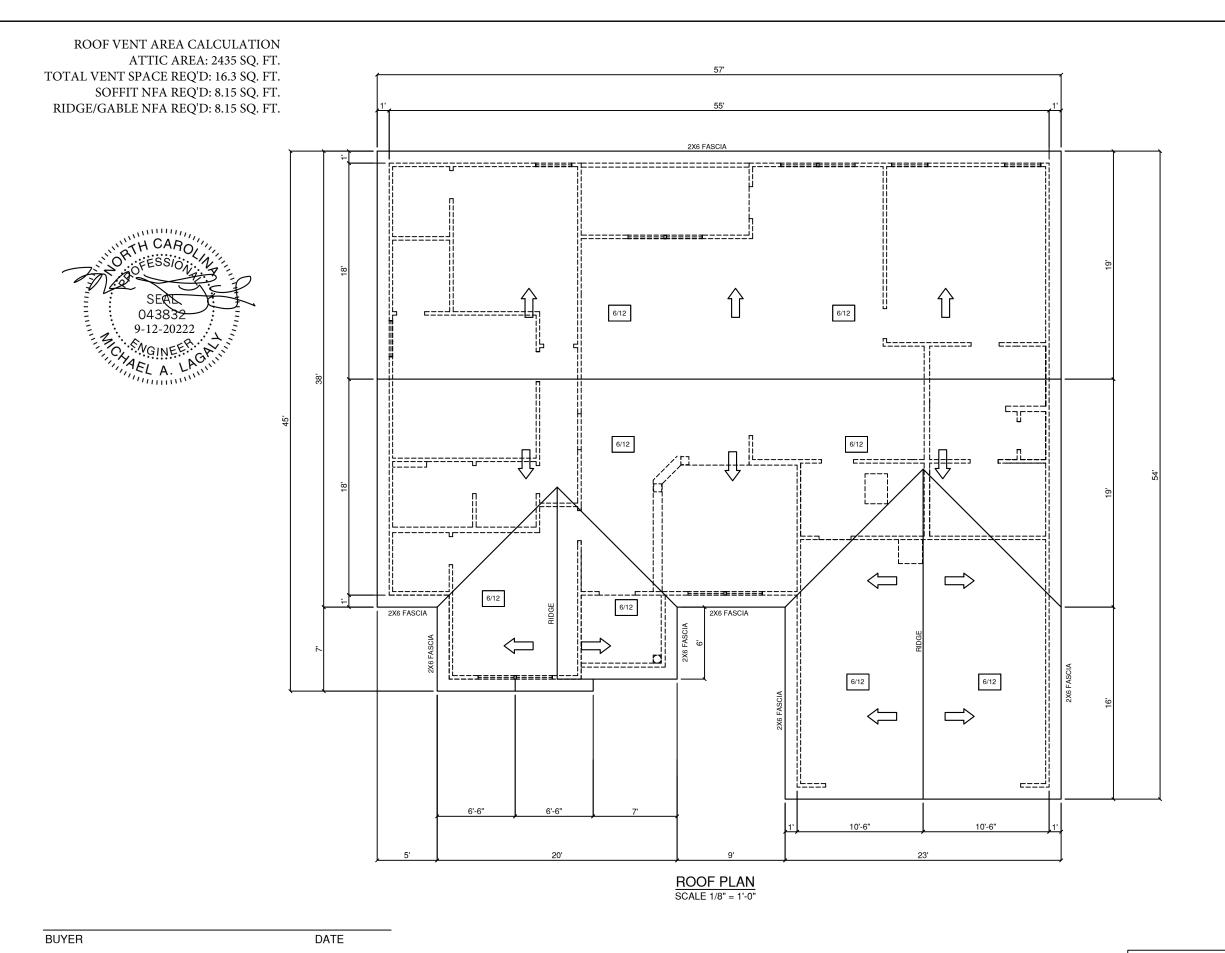

**BUYER** 

DATE

**FINAL** 109-22-128 RANDALL

### **GENERAL NOTES**

1.) MAIN FLOOR PLATE HEIGHT TO BE 8'-0" UNLESS NOTED OTHERWISE. 2.) OPTIONAL BONUS PLATE HEIGHT TO BE 8'-0" UNLESS NOTED OTHERWISE.

8-0" ONLESS NOTED OTHERWISE.

3.) INTERIOR & EXTERIOR WALLS TO BE DRAWN @ 3 1/2" UNLESS NOTED OTHERWISE.

4.) ALL ANGLES TO BE DRAWN AT 45° OR 90° UNLESS NOTED OTHERWISE.

OR 90\* UNLESS NOTED OTHERWISE. 5.) WINDOW HEADER HEIGHT TO BE SET @ 6'-11" UNLESS NOTED OTHERWISE. HEADER SIZE AND MATERIAL TO BE DETERMINED & VERIFIED BY FRAMER, BUILDER, TRUSS SHOP OR BY A LICENSED ENGINEER.

6.) SIZE, LOCATION AND MATERIALS OF BEAMS

6.) SIZE, LOCATION AND MATERIALS OF BEAMS TRUSSES, GIRDERS AND HEADERS TO BE DETERMINED & VERIFIED BY BUILDER, FRAMER TRUSS SHOP OR LICENSED ENGINEER.

7.) FOOTER SIZE, MATERIAL & LOCATIONS TO BE VERIFIED AND DETERMINED BY BUILDER, FOOTER CONTRACTOR OR LICENSED ENGINEER.

ENGINEER.

8.) ROOF VENTELLATION TO BE DETERMINED

& VERIFIED BUILDER, ROOFING COTRACTOR
OR LICENSED ENGINEER.

OR LICENSED ENGINEER.

9.) ALL MECHANICAL SYSTEMS DESIGNS, LOCATIONS AND SIZING TO BE DETERMINED & VERIFIED BY BUILDER, APPROPRIATE TRADE CONTRACTOR AND OR LICENSED ENGINEER.

10.) BUILDER RESPONSIBLE FOR VERIFYING AND COMPLYING WITH ALL LOCAL, STATE & NATIONAL CODES.

11.) LOCAL, STATE AND NATIONAL CODES TAKE PRECIDENCE OVER DRAWINGS.

12.) BUILDER TO VERIFY ALL DIMENSIONS.

COPYRIGHT 2022 RED DOOR HOMES, LLC. LICENSED TO RED DOOR HOMES OF: CENTRAL CAROLINA



#### SQUARE FOOTAGE CHART

HEATED & COOLED TO FRAMING:	1877
GARAGE AREA TO FRAMING:	432
FRONT PORCH AREA:	42
REAR PORCH AREA:	84
TOTAL UNDER BEAM AREA	2435

#### SUBDIVISION NAME:

XXXXXXXXX

CITY: XXXXXXXXX

PHASE:

LOT:

XXXXXXXXX

BLOCK: XXXXXXXXX


XXXXXXXXX


#### DRAFTING DATES:

PRELIMINARY: 06/09/2022 PJM PERM: 07/11/2022 PJM FINAL: 8/17/2022 JPH

Roof Plan

- GARAGE DOOR OPENER W/ TWO REMOTES - LOCATE FLOOD LIGHTS @ C.E.M.

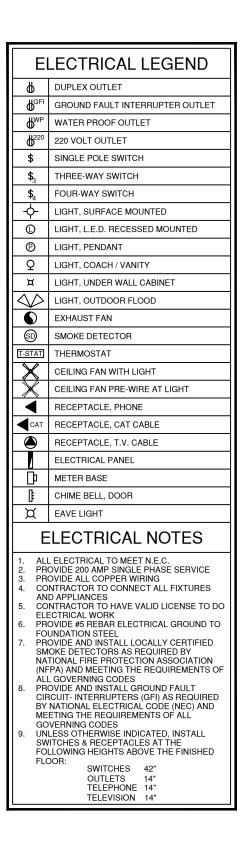

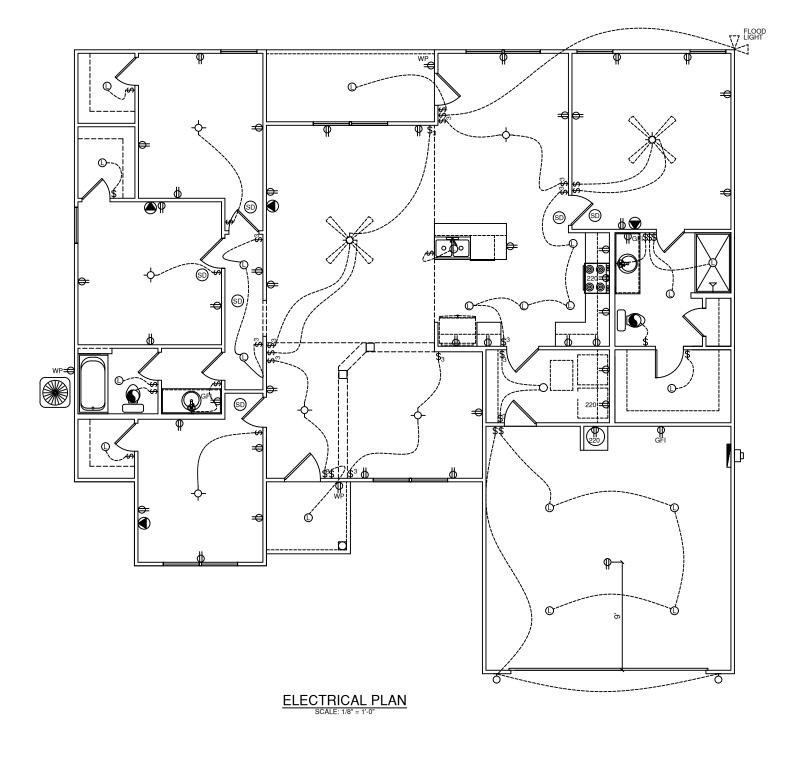

BUYER DATE

BUYER DATE

FINAL 109-22-128 RANDALL

#### **GENERAL NOTES**

1.) MAIN FLOOR PLATE HEIGHT TO BE 8'-0" UNLESS NOTED OTHERWISE. 2.) OPTIONAL BONUS PLATE HEIGHT TO BE 8'-0" UNLESS NOTED OTHERWISE.

8-0" UNLESS NOTED OTHERWISE.

3.) INTERIOR & EXTERIOR WALLS TO BE DRAWN @ 3 1/2" UNLESS NOTED OTHERWISE.

4.) ALL ANGLES TO BE DRAWN AT 45° OR 90° UNLESS NOTED OTHERWISE.

OR 90° UNLESS NOTED OTHERWISE.
5.) WINDOW HEADER HEIGHT TO BE SET @
6'-11" UNLESS NOTED OTHERWISE. HEADER
SIZE AND MATERIAL TO BE DETERMINED &
VERIFIED BY FRAMER, BUILDER, TRUSS SHOP
OR BY A LICENSED ENGINEER.

6.) SIZE, LOCATION AND MATERIALS OF BEAMS TRUSSES, GIRDERS AND HEADERS TO BE DETERMINED & VERIFIED BY BUILDER, FRAMEF TRUSS SHOP OR LICENSED ENGINEER.

7.) FOOTER SIZE, MATERIAL & LOCATIONS TO BE VERIFIED AND DETERMINED BY BUILDER, FOOTER CONTRACTOR OR LICENSED ENGINEER.

8.) ROOF VENTELLATION TO BE DETERMINED & VERIFIED BUILDER,ROOFING COTRACTOR OR LICENSED ENGINEER.

9.) ALL MECHANICAL SYSTEMS DESIGNS,
LOCATIONS AND SIZING TO BE DETERMINED
& VERIFIED BY BUILDER, APPROPRIATE TRADE
CONTRACTOR AND OR LICENSED ENGINEER.

10.) BUILDER RESPONSIBLE FOR VERIFYING
AND COMPLYING WITH ALL LOCAL, STATE
& NATIONAL CODES.

11.) LOCAL, STATE AND NATIONAL CODES

11.) LOCAL, STATE AND NATIONAL CODES
TAKE PRECIDENCE OVER DRAWINGS.
12.) BUILDER TO VERIFY ALL DIMENSIONS.

COPYRIGHT 2022 RED DOOR HOMES, LLC. LICENSED TO RED DOOR HOMES OF: CENTRAL CAROLINA



#### SQUARE FOOTAGE CHART

	HEATED & COOLED TO FRAMING:	1877
	GARAGE AREA TO FRAMING:	432
	FRONT PORCH AREA:	42
	REAR PORCH AREA:	84
	TOTAL UNDER BEAM AREA	2435
- 1		

SUBDIVISION NAME:

XXXXXXXXX

CITY: XXXXXXXXXX

PHASE:

XXXXXXXXXX

BLOCK:

LOT:


XXXXXXXXX


XXXXXXXXXX DRAFTING DATES:


PRELIMINARY: 06/09/2022 PJM

PRELIMINARY: 06/09/2022 PJI PERM: 07/11/2022 PJM FINAL: 8/17/2022 JPH

Electrical Plan

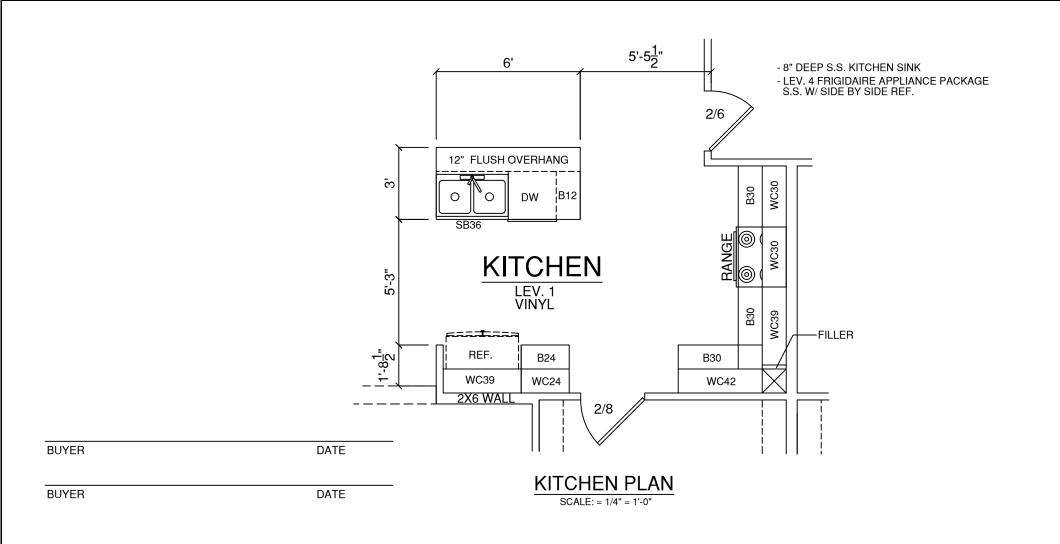


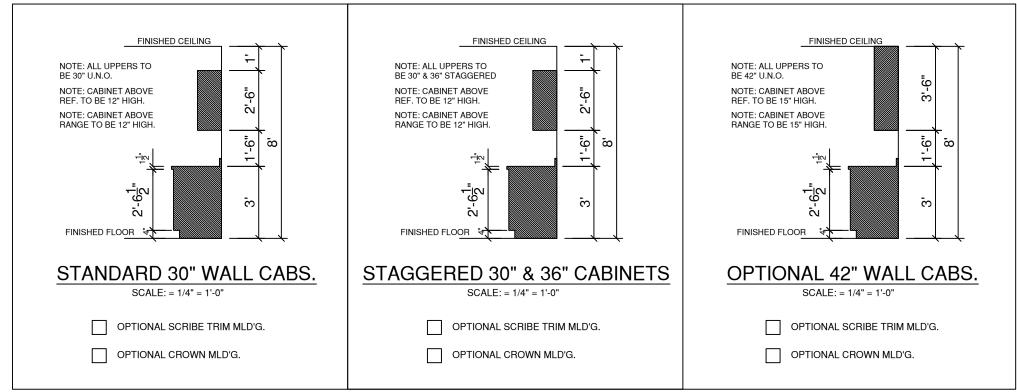



## MASTER VANITY

SCALE: = 1/4" = 1'-0"



HALL VANITY
SCALE: = 1/4" = 1'-0"

#### **CABINET LEGEND**

WC: WALL CABINET
WCC: WALL CORNER
CABINET

B: BASE CABINET SB: SINK BASE

**CB: CORNER BASE** 

FINAL 109-22-128 RANDALL

#### GENERAL NOTES

1.) MAIN FLOOR PLATE HEIGHT TO BE 8'-0" UNLESS NOTED OTHERWISE.

2.) OPTIONAL BONUS PLATE HEIGHT TO BE 8'-0" UNLESS NOTED OTHERWISE.

3.) INTERIOR & EXTERIOR WALLS TO BE DRAWN @ 3 1/2" UNLESS NOTED OTHERWISE.

4.) ALL ANGLES TO BE DRAWN AT 45° OR 90° UNLESS NOTED OTHERWISE.
5.) WINDOW HEADER HEIGHT TO BE SET @
6'-11" UNLESS NOTED OTHERWISE. HEADER SIZE AND MATERIAL TO BE DETERMINED & VERIFIED BY FRAMER, BUILDER, TRUSS SHOP OR BY A LICENSED ENGINEER.

6.) SIZE, LOCATION AND MATERIALS OF BEAMS TRUSSES, GIRDERS AND HEADERS TO BE DETERMINED & VERIFIED BY BUILDER, FRAMEF TRUSS SHOP OR LICENSED ENGINEER.

7.) FOOTER SIZE, MATERIAL & LOCATIONS TO BE VERIFIED AND DETERMINED BY BUILDER, FOOTER CONTRACTOR OR LICENSED ENGINEER.

8.) ROOF VENTELLATION TO BE DETERMINED & VERIFIED BUILDER, ROOFING COTRACTOR OR LICENSED ENGINEER.

OH LICENSED ENGINELTI.

9) ALL MECHANICAL SYSTEMS DESIGNS,
LOCATIONS AND SIZING TO BE DETERMINED
& VERIFIED BY BUILDER, APPROPRIATE TRADE
CONTRACTOR AND OR LICENSED ENGINEER.

10.) BUILDER RESPONSIBLE FOR VERIFYING
AND COMPLYING WITH ALL LOCAL, STATE
& NATIONAL CODES.

11.) LOCAL, STATE AND NATIONAL CODES TAKE PRECIDENCE OVER DRAWINGS.
12.) BUILDER TO VERIFY ALL DIMENSIONS.

COPYRIGHT 2022 RED DOOR HOMES, LLC. LICENSED TO RED DOOR HOMES OF: CENTRAL CAROLINA



#### SQUARE FOOTAGE CHART

HEATED & COOLED TO FRAMING:	1877
GARAGE AREA TO FRAMING:	432
FRONT PORCH AREA:	42
REAR PORCH AREA:	84
TOTAL UNDER BEAM AREA	2435

#### SUBDIVISION NAME:

XXXXXXXXX

XXXXXXXXX

PHASE:

CITY:

XXXXXXXXX

BLOCK: XXXXXXXXXX

LOT:

## XXXXXXXXXX DRAFTING DATES:

PRELIMINARY: 06/09/2022 PJM PERM: 07/11/2022 PJM FINAL: 8/17/2022 JPH

Cabinets

## **GENERAL NOTES**

- PLANS ARE ISSUED FOR THE CONDITIONAL USE TO BUILD THE STRUCTURE ON THE LOT OR ADDRESS SPECIFIED IN THE TITLE BLOCK. PLANS MUST HAVE SIGNED SEAL AND BE CONSTRUCTED ON THE SPECIFIED LOT OR ADDRESS TO BE VALID.
- 2. ENGINEER'S SEAL APPLIES TO STRUCTURAL COMPONENTS ONLY. ENGINEER'S SEAL DOES NOT CERTIFY DIMENSIONAL ACCURACY OR ARCHITECTURAL LAYOUT INCLUDING ROOF GEOMETRY. MDL ENGINEERING SE3RVICES ASSUMES NO LIABILITY FOR CHANGES MADE TO THESE PLANS BY OTHERS, OR FOR CONSTRUCTION METHODS. OR FOR ANY DEVIATION FROM THE PLANS. ENGINEER OF RECORD TO BE NOTIFIED PRIOR TO CONSTRUCTION IF ANY DISCREPANCIES ARE NOTED ON THE PLANS.
- 3. ALL CONSTRTUCTION WORKMANSHIP, MATERIAL QUALITY AND SELECTION SHALL BE IN ACCORDANCE WITH THE 2018 EDITION OF THE NORTH CAROLINA STATE BUILDING CODE. DIMENSIONS SHALL TAKE PRECEDENCE OVER SCALE AND CODE SHALL TAKE PRECEDENCE OVER DIMENSIONS
- 4. SEALED ENGINEERING DRAWINGS TAKE PRECEDENCE OVER STANDARD DETAILS AND NOTES.

## CONSTRUCTION

- 1. IT IS THE CONTRACTORS RESPONSIBILITY TO VERIFY ALL DIMENSIONS PRIOR TO CONSTRUCTION. CONTRACTOR IS ULTIMATELY RESPONSIBLE FOR CONSTRUCTION MEANS, METHODS AND SAFETY ON-SITE. NOTIFY MDL ENGINEERING IMMEDIATELY IF DISCREPANCIES ON PLANS ARE DISCOVERED.
- 2. ALL BEAMS TO BE CONTINUOUSLY SUPPORTED LATERALLY AND SHALL BEAR FULL WIDTH ON THE SUPPORTING WALLS OR COLUMNS INDICATED WITH A MINIMUM OF THREE STUDS U.N.O.
- 3. SOLID BLOCKING TO BE PROVIDED AT ALL POINT LOADS THROUGH FLOOR LEVELS TO THE FOUNDATION OR OTHER STRUCTURAL COMPONENTS
- 4. ALL ENGINEERED WOOD PRODUCTS (LVL, PSL, LSL, ETC.) SHALL BE INSTALLED WITH CONNECTIONS PER MANUFACTURER SPECIFICATIONS.
- 5. ENGINEERED FLOOR SYSTEMS, WALL SYSTEMS AND ROOF TRUSS SYSTEMS TO BE PROVIDED FOR REVIEW AND COORDINATED WITH THE ENGINEER OF RECORD PRIOR TO CONSTRUCTION. INSTALLATION TO BE IN ACCORDANCE WITH THE
- MANUFACTURERS INSTRUCTIONS. 6. ALL STEEL BEAMS TO BE SUPPORTED AT EACH END WITH A MINIMUM BEARING LENGTH OF 3-1/2" AND FULL FLANGE WIDTH U.N.O. BEAMS MUST BE ATTACHED AT EACH END WITH A MINIMUM OF FOUR 16d NAILS OR TWO 12" X 4" LAG SCREWS U.N.O. 7. STEEL FLITCH BEAMS TO BE BOLTED TOGETHER USING TWO ROWS OF 1/2" DIAMETER BOLTS (ASTM 307) WITH WASHERS AT BOTH ENDS. BOLTS TO BE SPACED AT 24" O.C.
- AND STAGGERED TOP AND BOTTOM OF THE BEAM (2" MIN. EDGE DISTANCE), WITH TWO BOLTS LOCATED AT 6" FROM EACH END 8. ALL METAL HANGERS, STRAPS AND HOLD-DOWNS TO BE SIMPSON STRONG-TIE OR EQUIVALENT.
- 9. SEE TABLE R602.3 NCRBC 2018 FOR STRUCTURAL MEMBER FASTENING REQUIREMENTS.

## **MATERIALS**

- 1. INTERIOR FRAMING LUMBER SHALL BE #2 SPRUCE PINE FIR (SPF) WITH THE FOLLOWING
- Fb=875 PSI Fv=70 PSI E=1.4E6 PSI
- 2. FRAMING LUMBER EXPOSED TO WEATHER OR IN CONTACT WITH THE GROUND, CONCRETE OR MASONRY SHALL BE PRESSURE TREATED #2 SOUTHERN YELLOW PINE (SYP) WITH THE FOLLOWING PROPERTIES: Fb=975 PSI Fv=95 PSI E=1.6E6 PSI
- 3. LVL (LAMINATED VENEER LUMBER) STRUCTURAL MEMBERS TO HAVE THE FOLLOWING PROPERTIES:
- Fb=2600 PSI Fv=285 PSI E=1.9E6 PSI
- 4. PSL (PARALLEL STRAND LUMBER) STRUCTURAL MEMBERS TO HAVE THE FOLLOWING Fb=2900 PSI Fv=290 PSI E=2.0E6 PSI
- 5. LSL (LAMINATED STRAND LUMBER) STRUCTURAL MEMBERS TO HAVE THE FOLLOWING PROPERTIES: Fb=2250 PSI Fv=400 PSI E=1.55E6 PSI
- 6. STRUCTURAL STEEL WIDE FLANGE BEAMS SHALL CONFORM TO ASTM A36, Fy=36 KSI
- 7. REBAR SHALL BE DEFORMED STEEL CONFORMING TO ASTM A615 GRADE 60. 8. POURED CONCRETE TO BE MINIMUM 3000 PSI @ 28 DAYS. MATERIALS USED TO PRODUCE CONCRETE SHALL COMPLY WITH THE APPLICABLE STANDARDS LISTED IN ACI 318 OR ASTM C 1157.
- 9. CONCRETE SUBJECT TO MODERATE OR SEVERE WEATHERING AS INDICATED IN TABLE R301.2(1) SHALL BE AIR ENTRAINED AS SPECIFIED IN TABLE R402.2
- 10. MASONRY UNITS SHALL CONFORM TO ACI 530/ASCE 5/TMS 402 AND MORTAR SHALL COMPLY WITH ASTM C 270.

## **FOUNDATION NOTES:**

- 1. CRAWL SPACE TO BE LEVEL AND FREE OF CONSTRUCTION DEBRIS, VEGETATION AND ANY ORGANIC MATERIAL
- 2. ONE VENT MUST BE WITHIN 3' OF EACH CORNER OF THE BUILDING. ALL OTHER VENTS TO BE LOCATED PER R408
- 3. OPTIONAL UNVENTED CRAWL SPACE TO MEET R409 REQUIREMENTS
- 4. A MINIMUM OPENING OF 18" BY 24" SHALL BE PROVIDED FOR ACCESS UNLESS MECHANICAL EQUIPMENT IS PRESENT.

## **FOOTINGS:**

- 1. FOOTING PROJECTIONS SHALL BE A MINIMUM OF 2" AND SHALL NOT EXCEED THE THICKNESS OF THE FOOTING
- 2. THE TOP LEVEL OF THE FOOTING SHALL BE LEVEL WITH THE MASONARY UNITS WITH FULL **MORTAR JOINTS** 3. BOTTOM SURFACE OF FOOTING MAY SLOPE NO MORE THAN 10%, FOOTING SHALL BE STEPPED
- TO PROVIDE CHANGE IN ELEVATION OR WHERE THE BOTTOM IS SLOPED MORE THAN 10% 4. FINISHED GRADE OF THE UNDER FLOOR SURFACE MAY BE LOCATED AT THE BOTTOM OF THE FOOTINGS.
- 5. MINIMUM CONCRETE FOOTING STRENGTH TO BE 3000 PSI.

## DRAINAGE:

- 1. INSTALL AROUND FOUDATION, DRAIN TILES, GRAVEL OR CRUSHED STONE DRAINS,
- PERFERATED PIPES OR OTHER APPROVED SYSTEM AWS REQUIRED BY GRADE. 2. FOUNDATION DRAIN MAY BE OMITTED WHEN THE INTERIOR GRADE IS LESS THAN 12" BELOW THE EXTERIOR GRADE.
- 3. FINISH GRADE OF LOT TO DRAIN SURFACE WATER AWAY FROM FOUNDATION WALLS AT A MINIMUM OF 6" WITHIN THE FIRST 10'.

## **WATERPROOFING:**

1. FOUNDATION WALLS. WHERE THE INTERIOR GRADE IS LOWER THAN THE EXTERIOR GRADE SHALL BE DAMP-PROOFED FROM THE TOP OF THE FOOTING TO THE FINISHED GRADE USING CODE APPROVED METHOD.

## **ANCHORAGE:**

- 1. WOOD SOLE PLATE AT EXTERIOR WALLS ON MONOLITHIC SLAB FOUNDATIONS AND THE WOOD SILL PLATE SHALL BE ANCHORED TO THE FOUNDATION WITH ANCHOR BOLTS SPACED A MAXIMUM OD 6' O.C. AND LOCATED 12" FROM THE ENDS OF EACH PLATE SECTION. BOLTS SHALL BE AT LEAST 1/2" IN DIAMETER AND EMBEDED A MIONIMUM OF 7" INTO MASONRY OR CONCRETE
- 2. BOLTS MAY BE REPLACED BY ANCHOR STRAPS, SPACED AS REQUIRED TO PROVIDE EQUIVALENT ANCHORAGE.
- 3. INTERIOR BEARING WALL SOLE PLATES ON MONOLITHIC SLABS SHALL BE ANCHORED WITH APPROVED FASTENERS.

## **FOUNDATION WALLS:**

- 1. VERTICAL REINFORCEMENT OF THE MASONRY WALLS TO BE TIED TO THE HORIZONTAL REINFORCEMENT OF THE FOOTING
- 2. FOUNDATION WALL IS TO BE 8" CMU OR 8" BRICK AND BLOCK ON CONTINUOUS FOOTINGS.
- 3. FOUNDATION WALL IS TO HAVE SOLID 8" MASONRY CAP. 4. WALL HEIGHT ABOVE FINISHED GRADE SHALL BE 6"
- 5. WALL SUPPORTING OVER 4' OF UNBALANCED FILL MUST BE BRACED TO PREVENT
- DAMAGE DURING BACKFILL. 6. VENTS ARE 16"X8"

## PIERS:

- 1. MASONRY PIER HEIGHT SHALL NOT EXCEED 10 TIMES THEIR LEAST DIMENSION
- 2. WHEN STRUCTURAL CLAY OR HOLLOW CONCRETE MASONRY UNITS ARE USED TO SUPPORT BEAMS AND GIRDERS, THE CELLULAR SPACES MUST BE FILLED SOLIDLY WITH CONCRETE, TYPE 'M' OR TYPE 'S' MORTAR.
- 3. UNFILLED UNITS MAY BE USED IF THE HEIGHT IS NOT MORE THAN 4 TIMES THE LEAST
- 4. HOLLOW PIERS SHALL BE CAPPED WITH 4" OF SOLID MASONRY OR CONCRETE OR SHALL
- HAVE THE CAVITIES OF THE TOP COURSE FILLED WITH CONCRETE 5. PIERS INDICATED ON PLAN ARE TYPICALLY 16"X16" ON 24"X24"X8" FOOTING.
- 6. ALL HALF PIERS TO BE TIED TO FOUNDATION WALLS.

## **CAVITY ACCESS:**

- 1. MIN. CRAWL SPACE ACCESS SHALL BE 18"(W) X 24" (H) WITH DOUBLE BAND ABOVE. PLACE AT BEST LOCATION WITH REFERENCE TO GRADE.
- 2. ATTIC ACCESS TO BE 22" X 30" MINIMUM. 3. ACCES SIZE MAY BE INCEASED IF MECHANICAL EQUIPMENT IS LOCATED IN CAVITY - SEE NC

## STAIRWAYS:

1. STAIRWAYS SHALL BE A MINIMUM OF 3' WIDE.

MECHANICAL CODE FOR SIZE REQUIREMENTS.

- 2. HANDRAILS SHALL NOT PROJECT MORE THAN 4-1/2" ON EITHER SIDE
- 3. MINIMUM CLEAR WIDTH OF THE STAIRWAY AT AND BELOW THE HANDRAIL SHALL NOT BE LESS THAN 31 1/2" WHERE THE HANDRAIL IS INSTALLED ON ONE SIDE AND 27" WHERE HANDRAILS ARE ON BOTH SIDES.
- 4. STAIRS NOT REQUIRED FOR EGRESS MAY BE AS NARROW AS 26"
- 5. MAXIMUM RISER HEIGHT SHALL BE 8-1/4" AND THE MINIMUM TREAD DEPTH SHALL BE 9". 6. NOSING SHALL BE 3/4" MINIMUM AND 1-1/4" MAXIMUM
- 7. MINIMUM HEADROOM IN ALL PARTS OF THE STAIR SHALL NOT BE LESS THAN 6'-8" PER R311.7.2 8. WINDERS MUST, AT A POINT NOT MORE THAN 12" FROM THE SIDE WHERE THE TREAD IS NARROWEST BE GREATER THAN 9" AND THE MINIMUM WIDTH OF ANY TREAD AT ANY POINT MUST BE GREATER THAN 4".

## HANDRAIL AND GUARD

- 1. HANDRAILS SHALL HAVE A MINIMUM HEIGHT OF 34" AND A MAXIMUM HEIGHT OF 38" 2. PORCHES, BALCONIES OR RAISED FLOORS OVER 30" ABOVE FLOOR OR GRADE SHALL HAVE GUARDRAILS NO LESS THAN 36" HIGH.
- 3. STAIRS THAT HAVE A RISE OF 30" ABOVE THE FLOOR SHALL HAVE HANDRAILS OF 34" MIN. HEIGHT
- 4. GUARDS ON OPEN SIDES OF STAIRWAYS, RAISED FLOORS, BALCONIES AND PORCHES SHALL HAVE INTERMEDIATE RAILS OR ORNAMENTAL CLOSERS THAT DO NOT ALLOW PASSAGE OF AN OBJECT 4" OR MORE IN DIAMETER ON VERTICAL MEMBERS OR 6" ON HORIZONTAL MEMBERS.

## **EMERGENCY EGRESS:**

- 1. OPENINGS PROVIDED FOR MEANS OF ESCAPE CANNOT HAVE A SILL HEIGHT OF MORE THAN 44" ABOVE FINISHED FLOOR
- 2. ESCAPE OPENINGS SHALL HAVE A MINIMUM NET CLEAR OPENING OF 4 SQ. FT. WITH A
- MINIMUM CLEAR OPENING HEIGHT OF 20". 3. ESCAPE OPENING SHALL HAVE A MINIMUM TOTAL GLASS AREA OF 5 SQ. FT. FOR A GROUND
- WINDOW AND 5.7 SQ. FT. FOR AN UPPER STORY WINDOW.
- 4. REQUIRED EXIT DOORS SHALL BE NO LESS THAN 3'0" X 6'-8".

## **GARAGE**

- 1. DOOR FROM GARAGE TO HOUSE MUST BE 1-3/8" THICK SOLID WOOD, HONEYCOMBED
- CORE STEEL OR 20 MINUTE FIRE RATED PER R302.5.1.
- 2. GARAGE TO BE SEPARATED FROM THE RESIDENCE AS REQUIRED BY TABLE R302.6. 1/2" GYPSUM OR EQUIVALENT APPLIED TO GARAGE SIDE FOR WALLS AND ATTICS. 5/8" TYPE X GYPSUM OR EQUIVALENT APPLIED TO CEILINGS BELOW HABITABLE ROOMS.
- 3. SLOPE GARAGE SLAB TOWARDS DOOR AT 1/4" PER FOOT.

## **DESIGN LOADS**

TABLE R301.5	LIVE LOAD
	(PSF)
ATTICS W/O STORAGE	<b>`</b> 1Ó
ATTICS WITH STORAGE	20
ATTICS W/ FIXED STAIRS	30
DECKS & EXTERIOR BALCONIES	40
FIRE ESCAPES	40
GUARDRAILS AND HANDRAILS	200
GUARG IN-FILL COMPONENTS	50
PASSENGER VEHICLE GARAGES	50
ROOMS OTHER THAN SLEEPING ROOMS	40
SLEEPING ROOMS	30
STAIRS	40
SNOW R301.2(1)	20

## **ULTIMATE DESIGN WIND SPEED: 115 MPH**

- DESIGN POSITIVE AND NEGATIVE PRESSURE FOR DOORS AND WINDOWS SHALL BE 25 PSF
- DESIGN POSITIVE AND NEGATIVE PRESSURE FOR WALL CLADDING SHALL BE 24.1 PSF
- DESIGN POSITIVE AND NEGATIVE PRESSURE FOR **ROOF COMPONENT AND CLADDING SHALL BE:** 34.8 PSF FOR MEAN ROOF HEIGHT TO 30' 36.5 PSF FOR MEAN ROOF HEIGHT TO 35' 37.9 PSF FOR MEAN ROOF HEIGHT TO 40'

## VALUES FOR ENERGY COMPLIANCE R-VALUES ARE MINIMUM (N1102.1.2) U-VALUES ARE MAXIMUM (N1102.1.4)

## HEADER SCHEDULE

HDR SIZE	SPAN	
(2) 2 X 6	0 TO 4'-8"	
(2) 2 X 8	4'-8" TO 5'-6"	
(2) 2 X 10	5'-6" TO 6'-5"	

# SUPPORT COLUMN

CALLOUT	USE
SC2	2 - 2 X 4
SC3	3 - 2 X 4
SC4	4 - 2 X 4
SC5	5 - 2 X 4
SCX - Round A500	steel steel column
3" diameter	by 1/4" thick with

3-1/2"x3-1/2"x1/4" plates welded top and bottom. PSL3 - 3-1/2 X 7 1.8e PSL PSL5 - 5-1/4 X -1/4 1.8e PSL

## **BRACE WALL NOTES:**

- 1. ALL EXTERIOR WALLS CONTINUOUSLY SHEATHED WITH 7/16" OSB EXTERIOR AND 1/2" GYPSUM INSIDE UNO.
- 2. OSB TO BE NAILED USING 8d @ 6" O.C. ON EDGE AND 12" O.C. ON ALL
- INTERMEDIATE STUDS.
- 3. GYPSUM FASTENED USING 1-1/8" MINIMUM SCREWS SPACED @ 7" O.C. ALONG ALL EDGES AND ALL INTERMEDIATE STUDS.

## ROOF TRUSS TIE SCHEDULE

UPLIFT (MAX. LBS.) 400 545 1015 1450 1885 3830	SIMPSON (OR EQUIV.) H1 H2.5T H10A H10A +HGA10 H10A +HGA10 X2	FASTENER TO TRUSS (6) 8d X 1 1/2" (5) 8d (9) 10d X 1 1/2" (4) 1/4" X 1 1/2" SDS (8) 1/4" X 1 1/2" SDS (18) SD #10 X 1 1/2"	FASTENER TO TOP PLATE (4) 8d (5) 8d (9) 10d X 1 1/2" (4) 1/4" X 1 1/2" SDS (8) 1/4" X 1 1/2" SDS TITEN 5/8" X 5" ON STUD
3830	HTT4	(18) SD #10 X 1 1/2"	TITEN 5/8" X 5" ON STUD
4845	HTT4 +H10A	(9) 10d X 1 1/2"	(9) 10d X 1 1/2"

4-PLY

2 ROWS 1/2" BOLT

WASHER/NUT

@ 12" O.C.

**GIRDER FASTENINGSCHEDULE** <u>N.T.S.</u>

2-3 ROWS 16d

@ 12" O.C.

THESE PLANS, NOTES AND DETAILS ARE DESIGNED TO

THIS DETAIL SHEET IS TO BE USED ONLY IN CONJUNCTION

MEET THE 2018 NORTH CAROLINA RESIDENTIAL

WITH PLANS CREATED BY RED DOOR HOMES.

BUILDING CODE.

3-PLY

2-PLY

2 ROWS 16d

@ 12" O.C.

# **ENGINEERING SERVICES**

213 Linton Banks Pl. Cary, NC 27513 (919) 999-8153

0 , O Q 50 7 2 S ton

0

ML Sept 12, SD1084! A


SHEET

0 0 2

NCH

4

MN BY: DATE: FILE: REV:

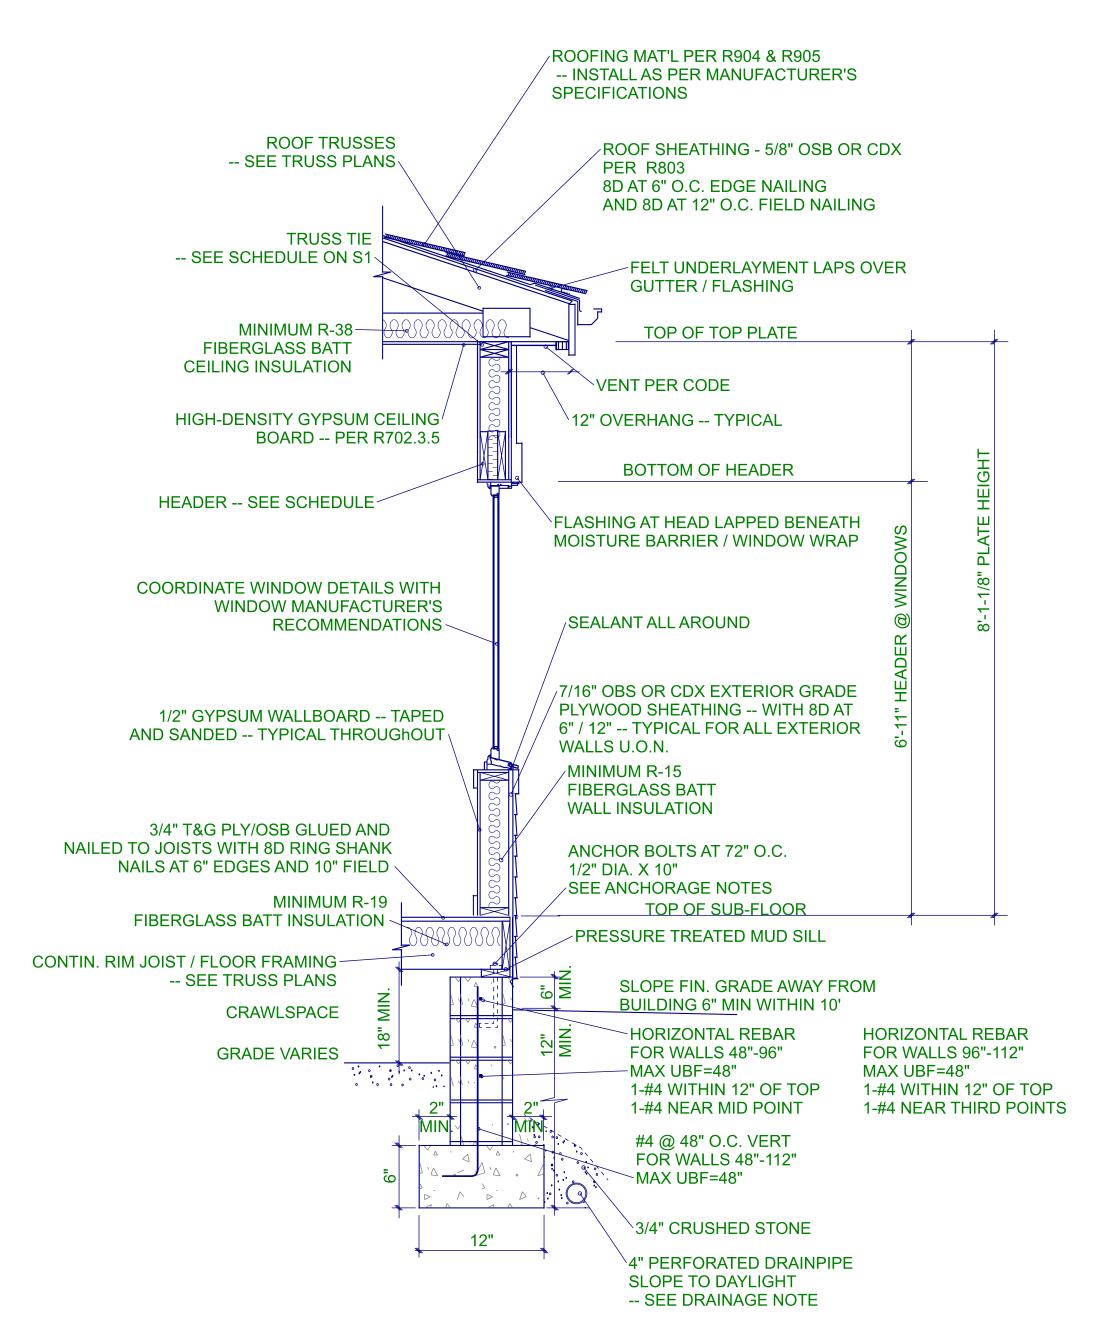


1 STOREY WALL SECTION

DETAIL 2.0

N.T.S.

PRESSURE TREATED 2x6 MUDSILL ✓ DROP GIRDER (3) 2X10 CRAWLSPACE PIER FOOTING 24" X 24" X 8" DP UNO CMU PIER/FTG **DROP GIRDER** DETAIL 2.1 N.T.S.

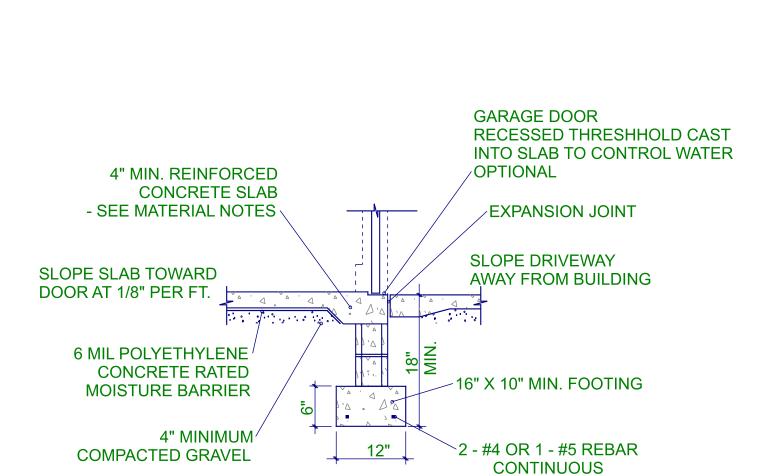

/12" OPEN WEB TRUSSES @ 19.2" O.C.

FLOOR JOISTS

-- SEE TRUSS PLANS

8"X16" CMU or

16" X 16" CMU

FILLED SOLID

AS NEEDED

PER R606.7

CMU FOOTING DETAIL @ GARAGE DOOR DETAIL 2.3 N.T.S.

N.T.S.

P.T. MUDSILL / SOLE PLATE ANCHOR BOLTS AT 72" O.C. 1/2" DIA. X 10"\ SEE ANCHORAGE NOTES EXPANSION JOINT 4" MIN. REINFORCED CONCRETE SLAB - SEE MATERIAL NOTES SLOPE SLAB TOWARD DOOR AT 1/4" PER FT. SLOPE FIN. GRADE AWAY FROM BUILDING 6" MIN WITHIN 10' 6 MIL POLYETHYLENE CONCRETE RATED MOISTURE BARRIER -16" X 10" MIN. FOOTING 4" MINIMUM<sup>\</sup> COMPACTED GRAVEL 12" 2 - #4 OR 1 - #5 REBAR CONTINUOUS N.T.S.

> **CMU FOOTING AT GARAGE** DETAIL 2.2 N.T.S.

**ENGINEERING SERVICES** 

213 Linton Banks Pl. Cary, NC 27513 (919) 999-8153

S 70 We 27520 -22-128 27 27 9-2 sin, N RE. 09 U Ci.


ML Sept 12, SD1084! A MN BY: DATE: FILE: REV:

**SHEET** 



THESE PLANS, NOTES AND DETAILS ARE DESIGNED TO MEET THE 2018 NORTH CAROLINA RESIDENTIAL BUILDING CODE.

THIS DETAIL SHEET IS TO BE USED ONLY IN CONJUNCTION WITH PLANS CREATED BY RED DOOR HOMES.

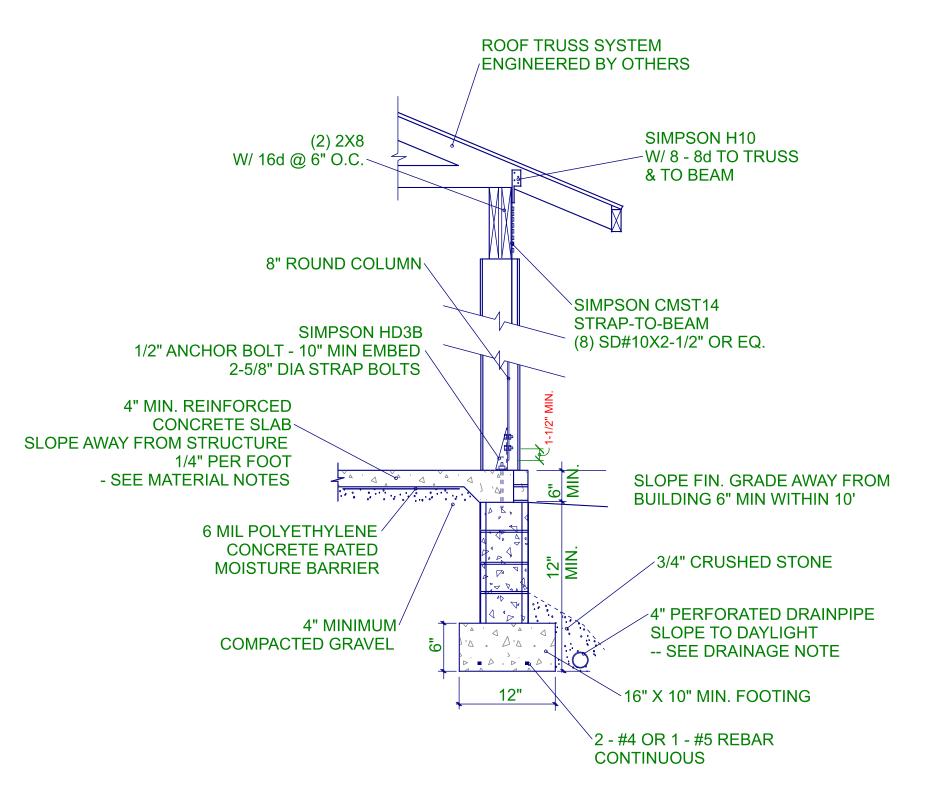

REAR PORCH
CMU FOOTING
POST AND BEAM CONNECTION
DETAIL 3.1
N.T.S.

/DBL TOP PLATE 0 0 0 0 0 **HEADER** CS16 x 6'-0" WITH 8d AT 4" O.C. CS16 x 6'-0" WITH 8d AT 4" O.C. ON OPPOSITE SIDE OF SHEATHING ON OPPOSITE SIDE OF SHEATHING 7/16" OSB SHEATHING 7/16" OSB SHEATHING 8D NAILS AT 3" O.C. IN ALL **`8D NAILS AT 3" O.C. IN ALL** FRAMING MEMBERS FRAMING MEMBERS /WOOD STRUCTURAL PANEL SHEATHING CONTINUOUS OVER BAND OR RIM JOIST MIN. 16" PANEL FOR 8' WALL MIN. 18" PANEL FOR 9' WALL MIN. 12" PANEL WIDTH WITH 7/16" NAIL SILL PLATE \
TO JOIST PER **OSB ON BOTH SIDES** TABLE 602.3 (1)

PORTAL FRAME AT WINDOW
PER R602.10.1
DETAIL 3.3
N.T.S.

(2) 1-3/4" X 9-1/4" LVL SEE TRUSS PLANS CS16 x 6'-0" WITH 8d AT 4" O.C. CS16 x 6'-0" WITH 8d AT 4" O.C. ON OPPOSITE SIDE OF SHEATHING ON OPPOSITE SIDE OF SHEATHING 7/16" OSB SHEATHING 7/16" OSB SHEATHING 8D NAILS AT 3" O.C. IN ALL **SD NAILS AT 3" O.C. IN ALL** FRAMING MEMBERS FRAMING MEMBERS SILL PLATE SILL PLATE \ 1/2" X 10" ANCHOR BOLTS 1/2" X 10" ANCHOR BOLTS 7" MIN. EMBED DEPTH 7" MIN. EMBED DEPTH 2" X 2" X 3/16" PLATE AND NUT 2" X 2" X 3/16" PLATE AND NUT

PORTAL FRAME AT GARAGE DOOR
PER R602.10.1
DETAIL 3.2
N.T.S.

ENGINEERING SERVICES

> 213 Linton Banks Pl. Cary, NC 27513 (919) 999-8153

RED DOOR HOMES
09 US Business 70 West
Clayton, NC 27520
PROJECT: 109-22-128

DRAWN BY: ML
DATE: Sept 12, 2022
FILE: SD10845
REV: A

SHEET

**S**3

SEAL 043832 9-12-20222. A

THESE PLANS, NOTES AND DETAILS ARE DESIGNED TO MEET THE 2018 NORTH CAROLINA RESIDENTIAL BUILDING CODE.
THIS DETAIL SHEET IS TO BE USED ONLY IN CONJUNCTION WITH PLANS CREATED BY RED DOOR HOMES.

TRUSSTRAX Legosanurios

A UPP INDUSTRIES COMPANY

UFP

HOMES DOOR

RANDALL

109-22-128


PLAN 1ST FLOOR 184 MARKET ST FUQUAY-VARINA, N

RICHFIELD

DSN

DESIGNER AM LAYOUT DATE 7-22-22 ARCH DATE -STRUC DATE

JOB #: 22071136F1

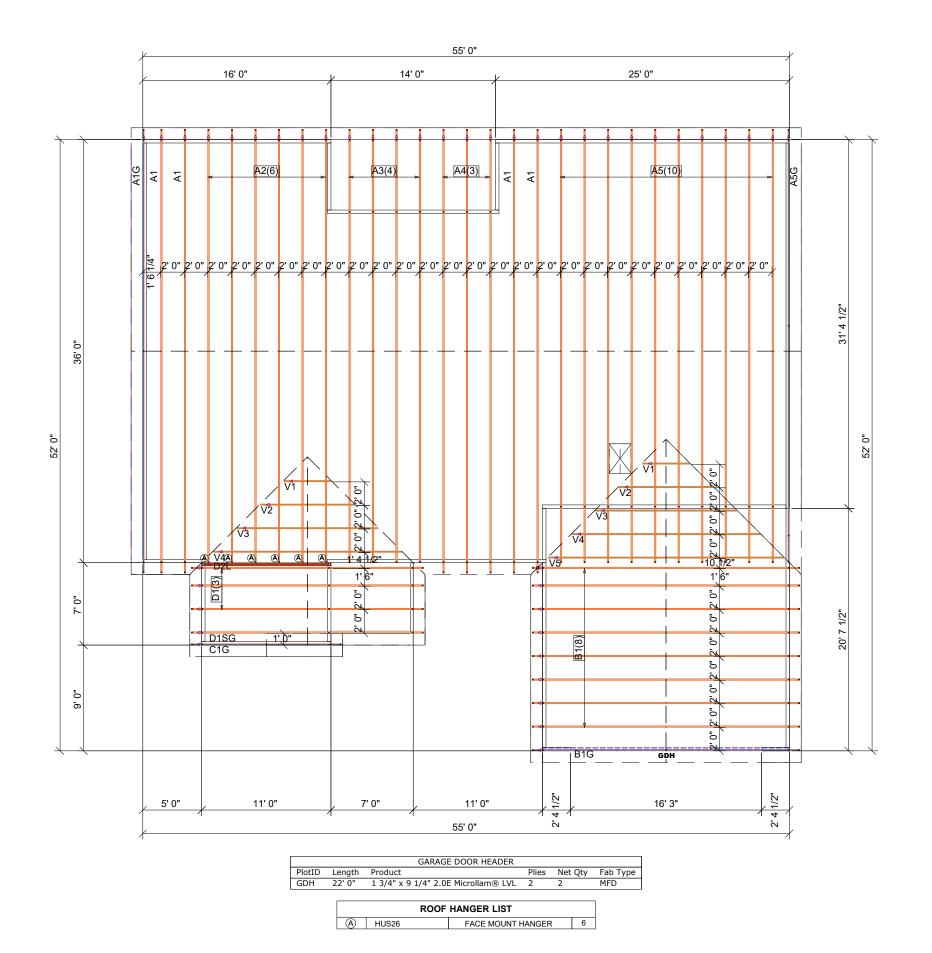

TRUSSIRAX

**UFP** SITE BUILT A UPP INDUSTRIES COMPANY

HOMES DOOR

109-22-128

RANDALL

184 MARKET STREET FUQUAY-VARINA, NC 27526 PLAN ROOF RICHFIELD

DSN

DESIGNER AM
LAYOUT DATE 7-22-22 ARCH DATE -STRUC DATE JOB #: 22071136