

HARNETT DEPARTMENT OF PUBLIC HEALTH PERMIT
TO CONSTRUCT A DRINKING WATER SUPPLY WELL

PIN #: _____ Parcel #: _____ Application #: SFD2206-0114 Subdivision: _____ Lot #: _____

Applicant Name: Steve Thomas
Address: 13042 Mcdougald Rd (SR 1229)

Type of Facility Served by Well: Private residence

Sewage System: Tire Chip for SFD

Permit Conditions: _____

General Permit Conditions:

- Drinking water supply well construction must meet 15A NCAC 02C.100 rules
- The permitted drinking water supply well shall be located in accordance with the **SITE PLAN**
- **ANY ALTERATION** of the site of the site (including location of structures and appurtenance) or modification in use of the well, may subject this Permit to revocation

Authorized State Agent *Mph A RCHS* Date 1-19-23

Grouting Inspection Witnessed _____ Date _____
 Grouting self-certified by driller GW-1 provided? Yes No

See attachment for construction sketch

WELL CERTIFICATE OF COMPLETION

Date: _____ Application #: SFD2206-0114 Well Contractor: _____

Applicant Name: Steve Thomas
Address: 13042 Mcdougald Rd (SR 1229)
Directions to Site: _____

Use of Well: _____ Date Drilled: _____ Total Depth: _____ Replacement Well? Yes No
Static Water Level: _____ Top of Casing is _____ in. above surface. Yield: _____ gpm at _____ ft.
Disinfection: Type _____ Amount _____

<u>Water Zone (depth)</u>	<u>Casing</u>	<u>Grout</u>
From _____ To _____	From _____ To _____	From <u>0</u> To _____
From _____ To _____	Diameter: _____ Material: _____ Thickness: _____	Material: _____ Method: _____
From _____ To _____	From _____ To _____	From _____ To _____
	Diameter: _____ Material: _____ Thickness: _____	Material: _____ Method: _____
	From _____ To _____	From _____ To _____
	Diameter: _____ Material: _____ Thickness: _____	Material: _____ Method: _____

Inspector: _____ On Hold Date: _____ Release Date: _____

Remarks: _____


Well Head Information

Casing Height: 13" (above finished grade) Access Port: Vent Stack:
Well ID Tag: Pump ID Tag: Sampling Tap: Backflow Preventer:
Sample Taken? Yes No Well Head properly sealed:


Remarks: _____
Authorized State Agent *Mph A RCHS* Date 2-7-23

See Attachment for completion sketch

Well Construction Sketch

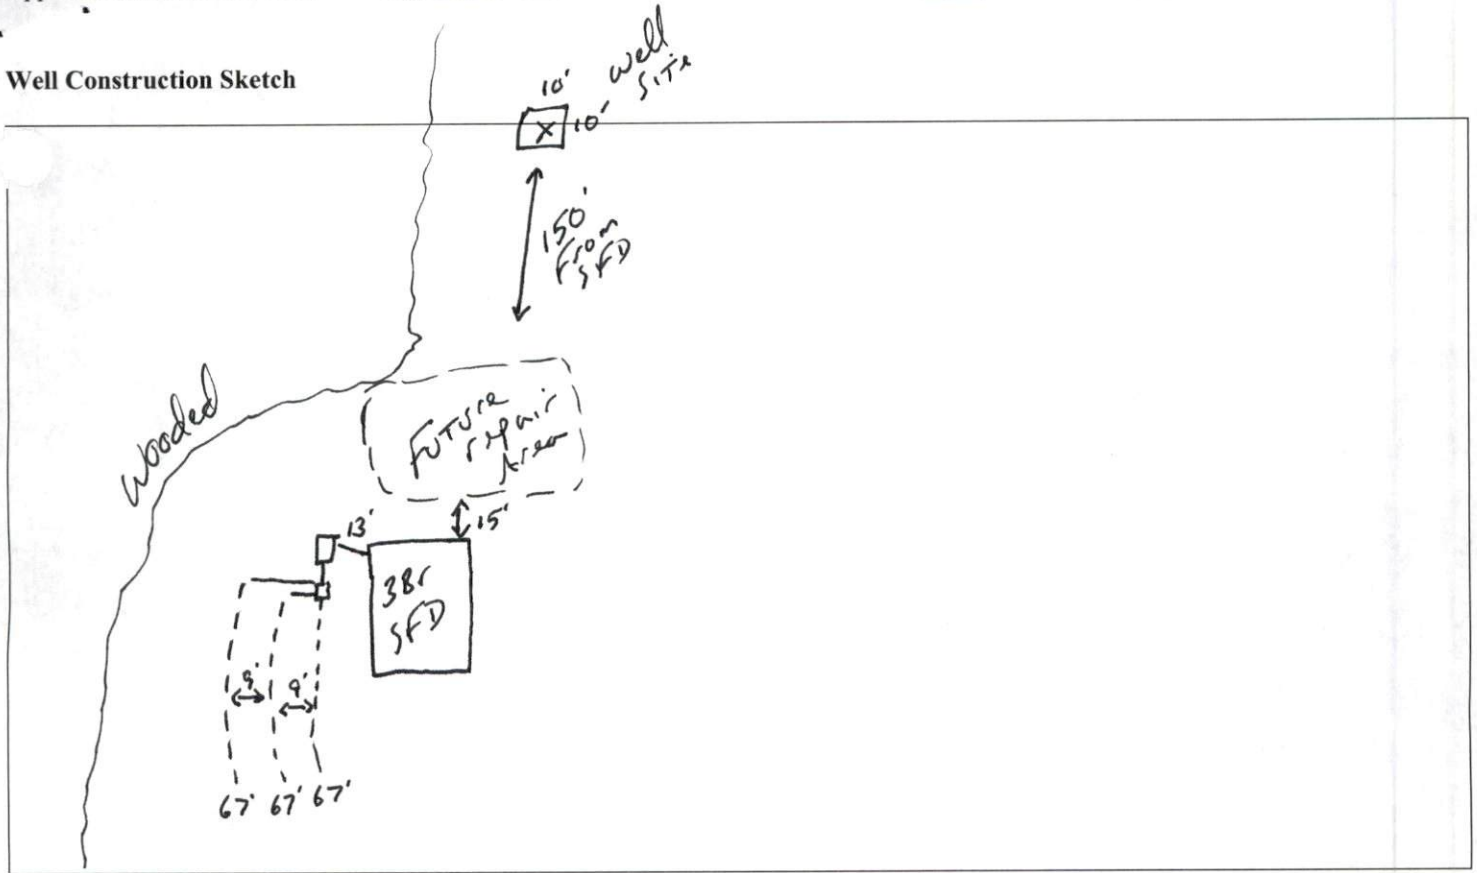

Completion Sketch

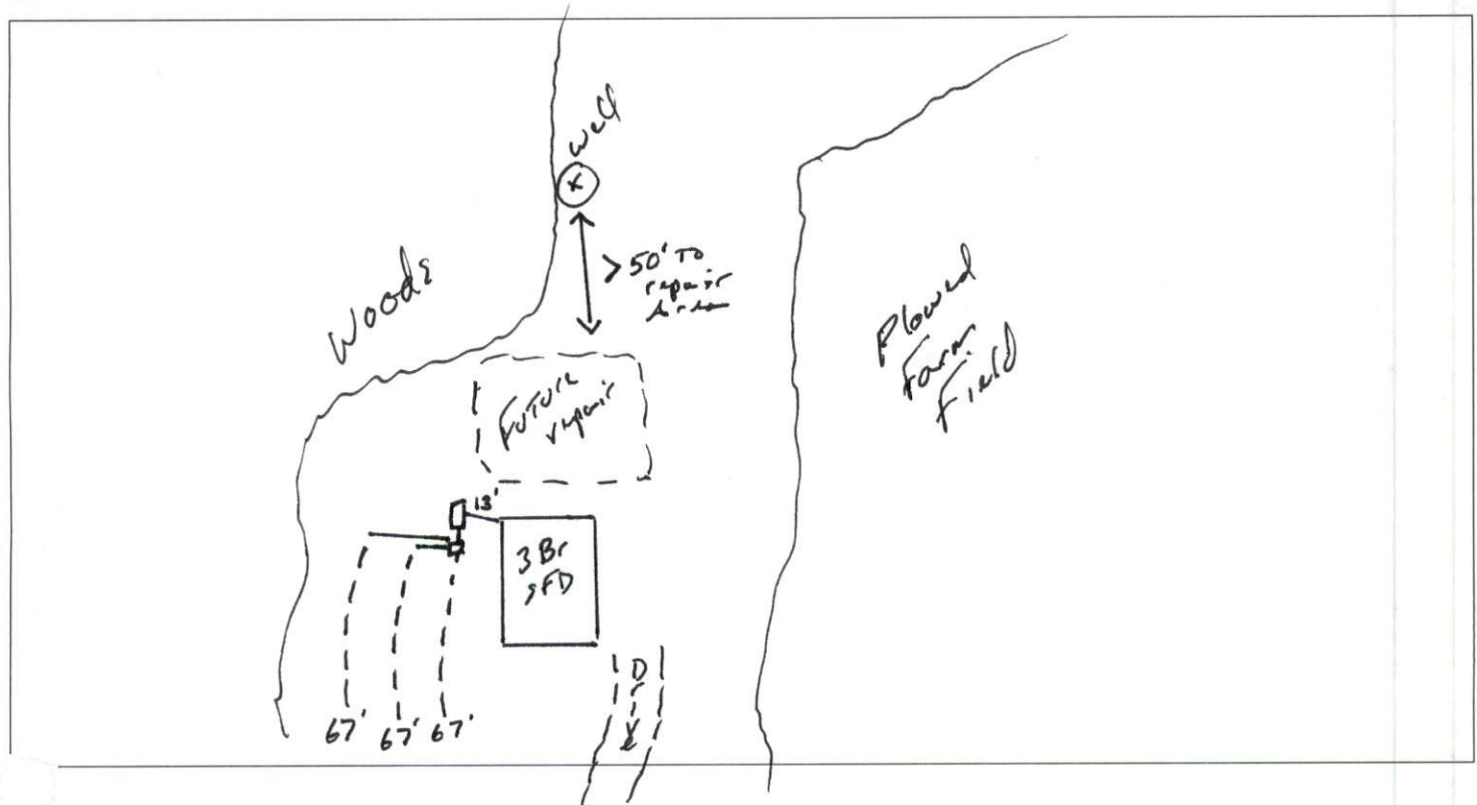

WELL CONSTRUCTION RECORD (GW-1)

1. Well Contractor Information:

Well Contractor Name: Ray Maness
 NC Well Contractor Certification Number: NC WC 2460-A
 Company Name: W W Maness & Sons

2. Well Construction Permit #: _____
 List all applicable well construction permits (i.e. UIC, County, State, Variance, etc.)

3. Well Use (check well use):

Water Supply Well:

Agricultural Municipal/Public
 Geothermal (Heating/Cooling Supply) Residential Water Supply (single)
 Industrial/Commercial Residential Water Supply (shared)
 Irrigation

Non-Water Supply Well:

Monitoring Recovery

Injection Well:

Aquifer Recharge Groundwater Remediation
 Aquifer Storage and Recovery Salinity Barrier
 Aquifer Test Stormwater Drainage
 Experimental Technology Subsidence Control
 Geothermal (Closed Loop) Tracer
 Geothermal (Heating/Cooling Return) Other (explain under #21 Remarks)

4. Date Well(s) Completed: 1-24-23 Well ID# _____

5a. Well Location:

Facility/Owner Name: Dan Johnson Facility ID# (if applicable): _____
 Physical Address, City, and Zip: 13042 McDougle RD Sanford NC 27331
 County: Harnett Parcel Identification No. (PIN): _____

5b. Latitude and longitude in degrees/minutes/seconds or decimal degrees:
 (if well field, one lat/long is sufficient)
35 382959 N 79 057418 W

6. Is(are) the well(s) Permanent or Temporary

7. Is this a repair to an existing well: Yes or No
 If this is a repair, fill out known well construction information and explain the nature of the repair under #21 remarks section or on the back of this form.

8. For Geoprobe/DPT or Closed-Loop Geothermal Wells having the same construction, only 1 GW-1 is needed. Indicate TOTAL NUMBER of wells drilled: _____

9. Total well depth below land surface: 360 (ft.)
 For multiple wells list all depths if different (example- 3@200' and 2@100')

10. Static water level below top of casing: 50 (ft.)
 If water level is above casing, use "+"

11. Borehole diameter: 6 (in.)

12. Well construction method: Air Rotary
 (i.e. auger, rotary, cable, direct push, etc.)

FOR WATER SUPPLY WELLS ONLY:

13a. Yield (gpm): 25 Method of test: Air
 13b. Disinfection type: H+H Amount: H+H

For Internal Use Only:

14. WATER ZONES						
FROM	TO	DESCRIPTION				
ft.	110	ft.	1/2 gpm			
ft.	340	ft.	24 1/2			
15. OUTER CASING (for multi-cased wells) OR LINER (if applicable)						
FROM	TO	DIAMETER	THICKNESS	MATERIAL		
ft.	20	ft.	6 1/2	188	pvc	
16. INNER CASING OR TUBING (geothermal closed-loop)						
FROM	TO	DIAMETER	THICKNESS	MATERIAL		
ft.		ft.				
ft.		ft.				
17. SCREEN						
FROM	TO	DIAMETER	SLOT SIZE	THICKNESS	MATERIAL	
0	ft.	ft.	in.			
ft.		ft.	in.			
ft.		ft.				
18. GROUT						
FROM	TO	MATERIAL	EMPLACEMENT METHOD & AMOUNT			
0	ft.	20+ ft.	Easy Seal	pumped		
ft.		ft.				
ft.		ft.				
19. SAND/GRAVEL PACK (if applicable)						
FROM	TO	MATERIAL	EMPLACEMENT METHOD			
ft.		ft.				
ft.		ft.				
20. DRILLING LOG (attach additional sheets if necessary)						
FROM	TO	DESCRIPTION (color, hardness, soil/rock type, grain size, etc.)				
0	ft.	3	ft.	Sand		
3	ft.	50	ft.	Clay		
50	ft.	85	ft.	Broken Rock		
85	ft.	360	ft.	Granite		
ft.		ft.				
ft.		ft.				
ft.		ft.				
21. REMARKS						

22. Certification:
 Signature of Certified Well Contractor: Ray Maness Date: 1-25-23

By signing this form, I hereby certify that the well(s) was (were) constructed in accordance with 15A NCAC 02C.0100 or 15A NCAC 02C.0200 Well Construction Standards and that a copy of this record has been provided to the well owner.

23. Site diagram or additional well details:
 You may use the back of this page to provide additional well site details or well construction details. You may also attach additional pages if necessary.

SUBMITTAL INSTRUCTIONS

24a. For All Wells: Submit this form within 30 days of completion of well construction to the following:

Division of Water Resources, Information Processing Unit,
 1617 Mail Service Center, Raleigh, NC 27699-1617

24b. For Injection Wells: In addition to sending the form to the address in 24a above, also submit one copy of this form within 30 days of completion of well construction to the following:

Division of Water Resources, Underground Injection Control Program,
 1636 Mail Service Center, Raleigh, NC 27699-1636

24c. For Water Supply & Injection Wells: In addition to sending the form to the address(es) above, also submit one copy of this form within 30 days of completion of well construction to the county health department of the county where constructed.