# SOUTHPORT LOT 9 WILLIAMS FARM **INVENTORY MARKED**

## SOUTHPORT **REVISION LIST - STRUCTURAL:**

- COMBINED WILMINGTON AND WILMINGTON II PLANS. (2-18)
- ADDED BRICK OPTION ON SECOND FLOOR. (2-18)
- CALLED OUT SERIES/SPACING OF I-JOISTS ON BASEMENT. (2-18)
- 2018 NCRC UPDATE (6-19)
- 2018 SC IRC (2-15-20)
- ADDED ELEVATION A.2 (BRICK WATERTABLE W/ SIDING ABOVE) & ELEVATION A.3 (STONE WATERTABLE W/ SIDING ABOVE). (2-15-20)


## SOUTHPORT **REVISION LIST - ARCHITECTURAL:**


- CREATED ELEVATIONS TO BE IN STANDARDS WITH OTHER PLANS (SEE SHEETS A-1 THROUGH A-3.5)
- CHANGED COLUMNS ON ELEVATIONS TO STANDARD COLUMNS
- CHANGED GARAGE DOORS TO REPRESENT STANDARD GARAGE DOOR FOR EACH ELEVATION 3.
- FIXED COVERED PORCH TO KEEP COLUMNS FROM OVERLAPPING EDGE OF CONCRETE 4.
- 5. REMOVED GRIDS FROM TRANSOMS ABOVE FRONT DOOR
- ADDED NOTE FOR GARAGE DOOR "GARAGE DOOR PER SPECIFICATIONS AND GLASS INSERT (TOP PANEL ONLY)" 6.
- 7. MOVED ROOF PLANS TO SHEETS A-8 & A-8.1
- 8 CREATED SLAB INTERFACE PLAN (SEE SHEET A4 THROUGH A4 2)
- MOVED ALL OPTIONS OFF BASE PLAN AND PLACED ON SEPARATE SHEET 9.
- ADDED NOTE FOR FLUSH COUNTERTOP ON ISLAND 10.
- 11 CHANGED PATIO SIZE TO STANDARD 12'X10'
- ADDED OPTIONAL GAS LINE 12.
- 13. CHANGED KITCHEN LAYOUT
- ADDED 2ND HOSE BIB 14.
- 15. CALLED OUT "45" WALL WITH CAP" AS STANDARD
- CHANGED ALL EXTERIOR WALLS FROM 2X6 TO 2X4 EXCEPT WHERE SHADED 16.
- ADDED NOTE "OPT. REF." 17.
- 18. REMOVED NUMBERS ON STAIRS
- 19 ADDED NOTE "OPT. W/D"
- ADDED NOTE "WASHER ALWAYS TO BE LOCATED TO THE LEFT OF DRYER 2.0
- 21. VERIFIED VENTILATION AND LIGHT REQUIREMENTS AT OWNER'S BEDROOM MEETS CODE (11-01-20)
- 22. SQUARE FOOTAGES ARE UPDATED AND CHANGED DUE TO MOVEMENT OF WALLS FROM 2X6 TO 2X, TO KEEP JOGS IN ROOMS,
- EXTERIOR WALL MOVED MEANING ROOF LINES HAVE CHANGED
- SQUARE FOOTAGE OF COVERED PORCH CHANGED DUE TO KEEPING COLUMNS FROM OVERLAPPING CONCRETE EDGE
- CREATED PARTIAL PLANS FOR B & C ELEVATIONS (FLOOR, SLAB, & ELECTRICAL) 24.
- REMOVED ALL WALL OUTLETS 25.
- 26. REMOVED ALL PHONE OUTLETS
- 27. REMOVED ALL TV OUTLETS
- PLACED STANDARD 3 BULB LIGHT IN KITCHEN 28
- VERIFIED COACH LIGHT LOCATIONS (SEE ELEVS. FOR DIMS.) 29.
- 30. PLACED DASHED FANS WHERE APPLICABLE WITH NOTE "STD. LIGHT, OPT. FAN/LT PREWIRE"
- 31 UPDATED ELECTRICAL KEY
  - 32. VERIFIED CO2 DETECTOR LOCATIONS
  - 33. SHOWED PENDANT LIGHTS AS OPTIONAL
  - SHOWED CAN LIGHTS IN KITCHEN AND FAMILY ROOM AS "OPTIONAL CAN LIGHTS" 34.
  - 35. PLACED OPTIONAL FLOOD LIGHTS
  - PLACED OPTIONAL FLOOR OUTLET IN FAMILY ROOM 36
  - 37. PLACED CALCULATIONS FOR SOFFIT AND RIDGE VENT REOUIREMENTS
  - UPDATED STAIR LAYOUT TO KEEP MAIN WALL AT KITCHEN FROM MOVING WHEN OPTIONAL BASEMENT SELECTED. 38.


HOMES	
COVER SHEET	
H&H HOMES southport	
DATE: SEPTEMBER 16, 2019 REV.: AUGUST 01, 2021 DRAWN BY: ENGINEERED BY: REVIEWED BY:	







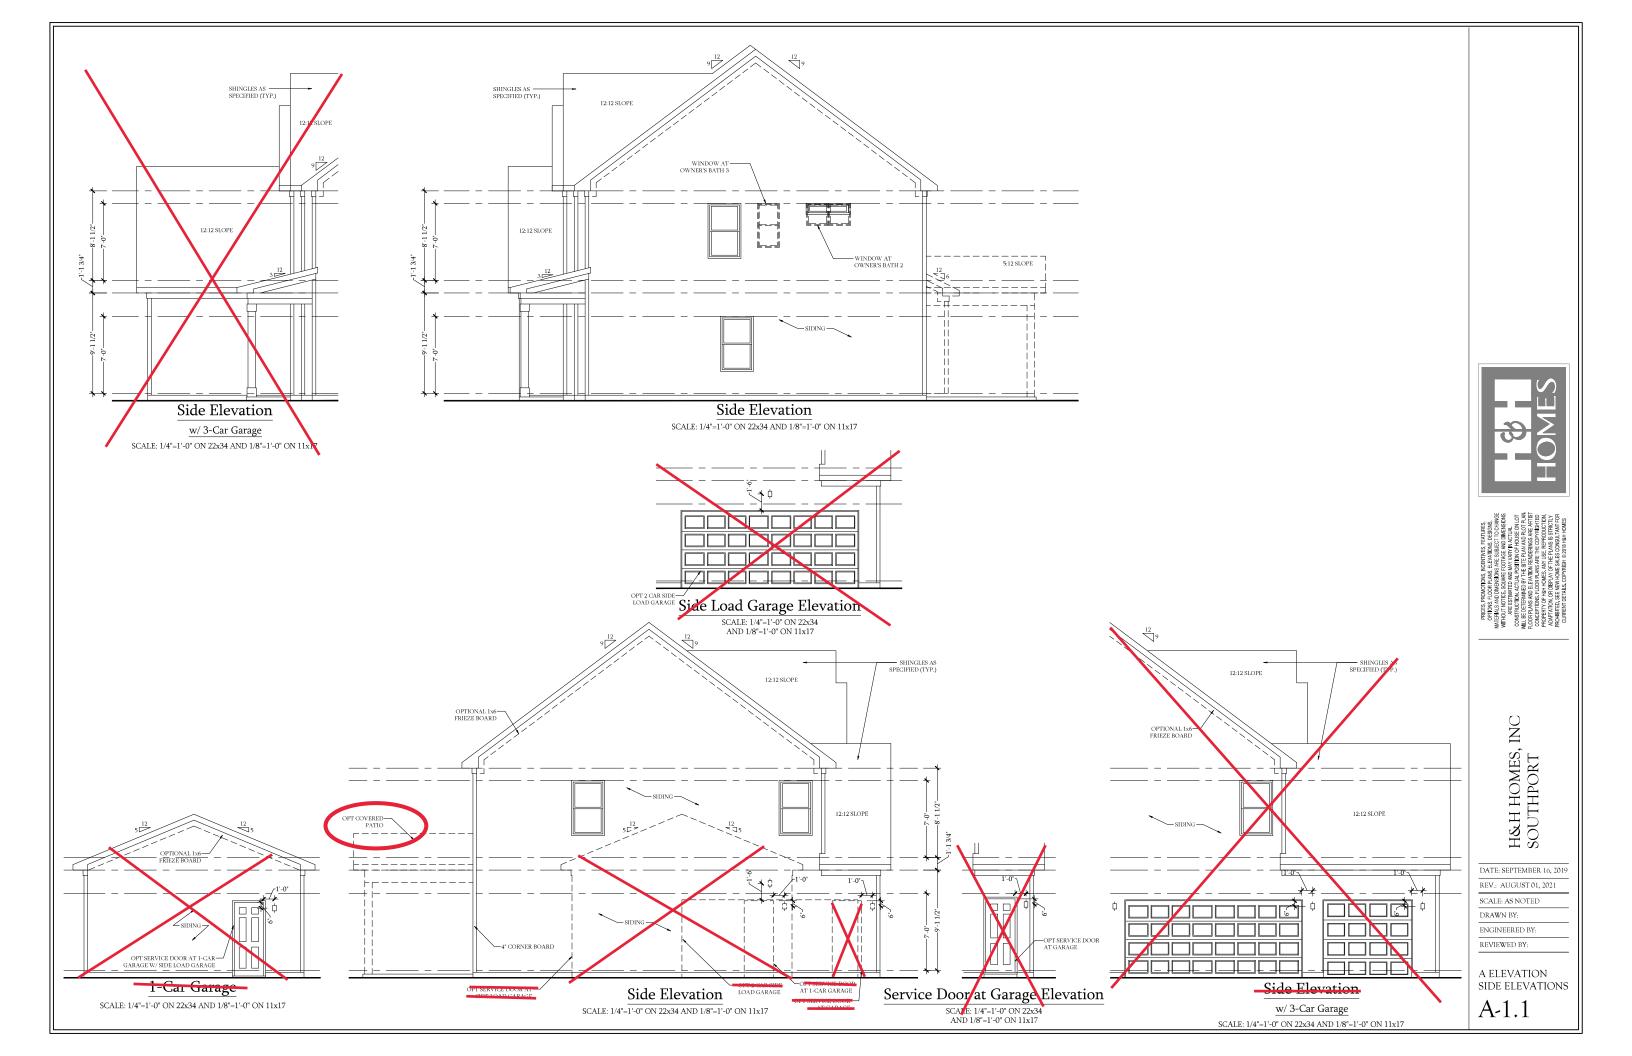

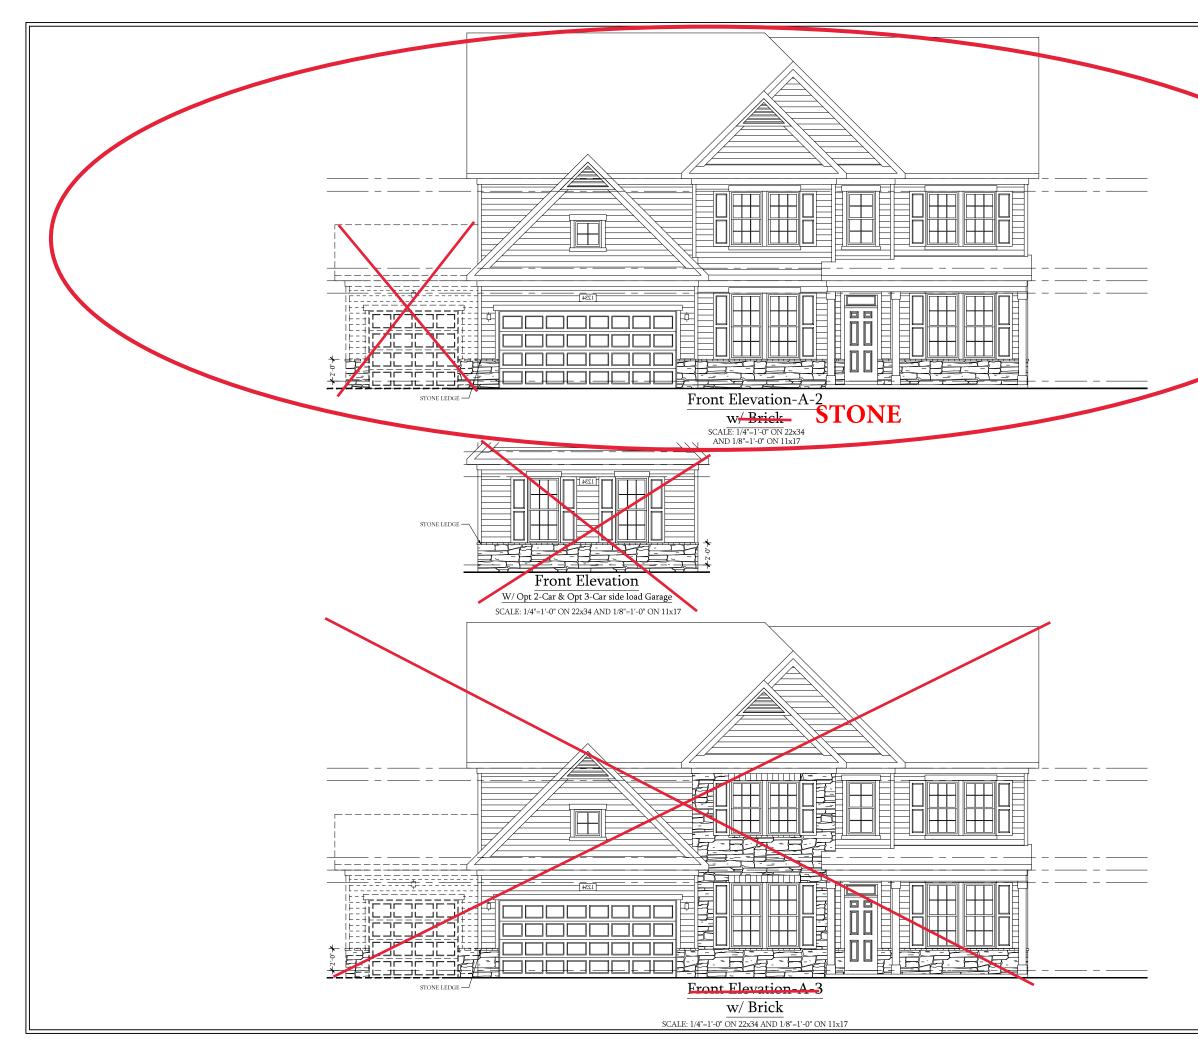


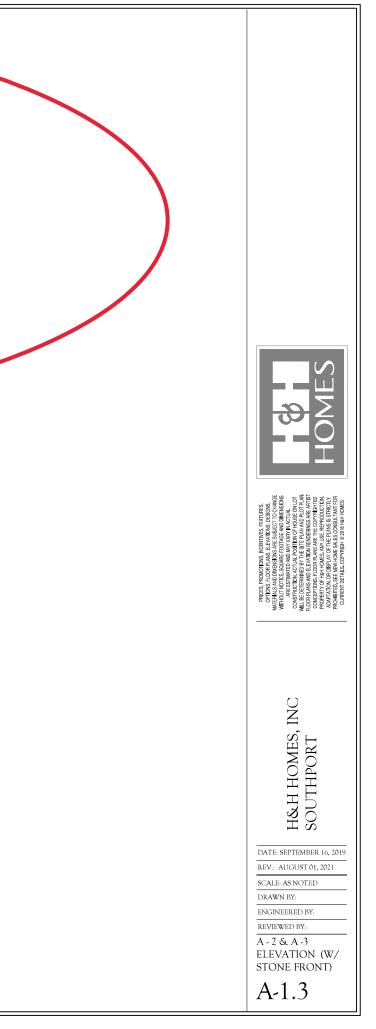


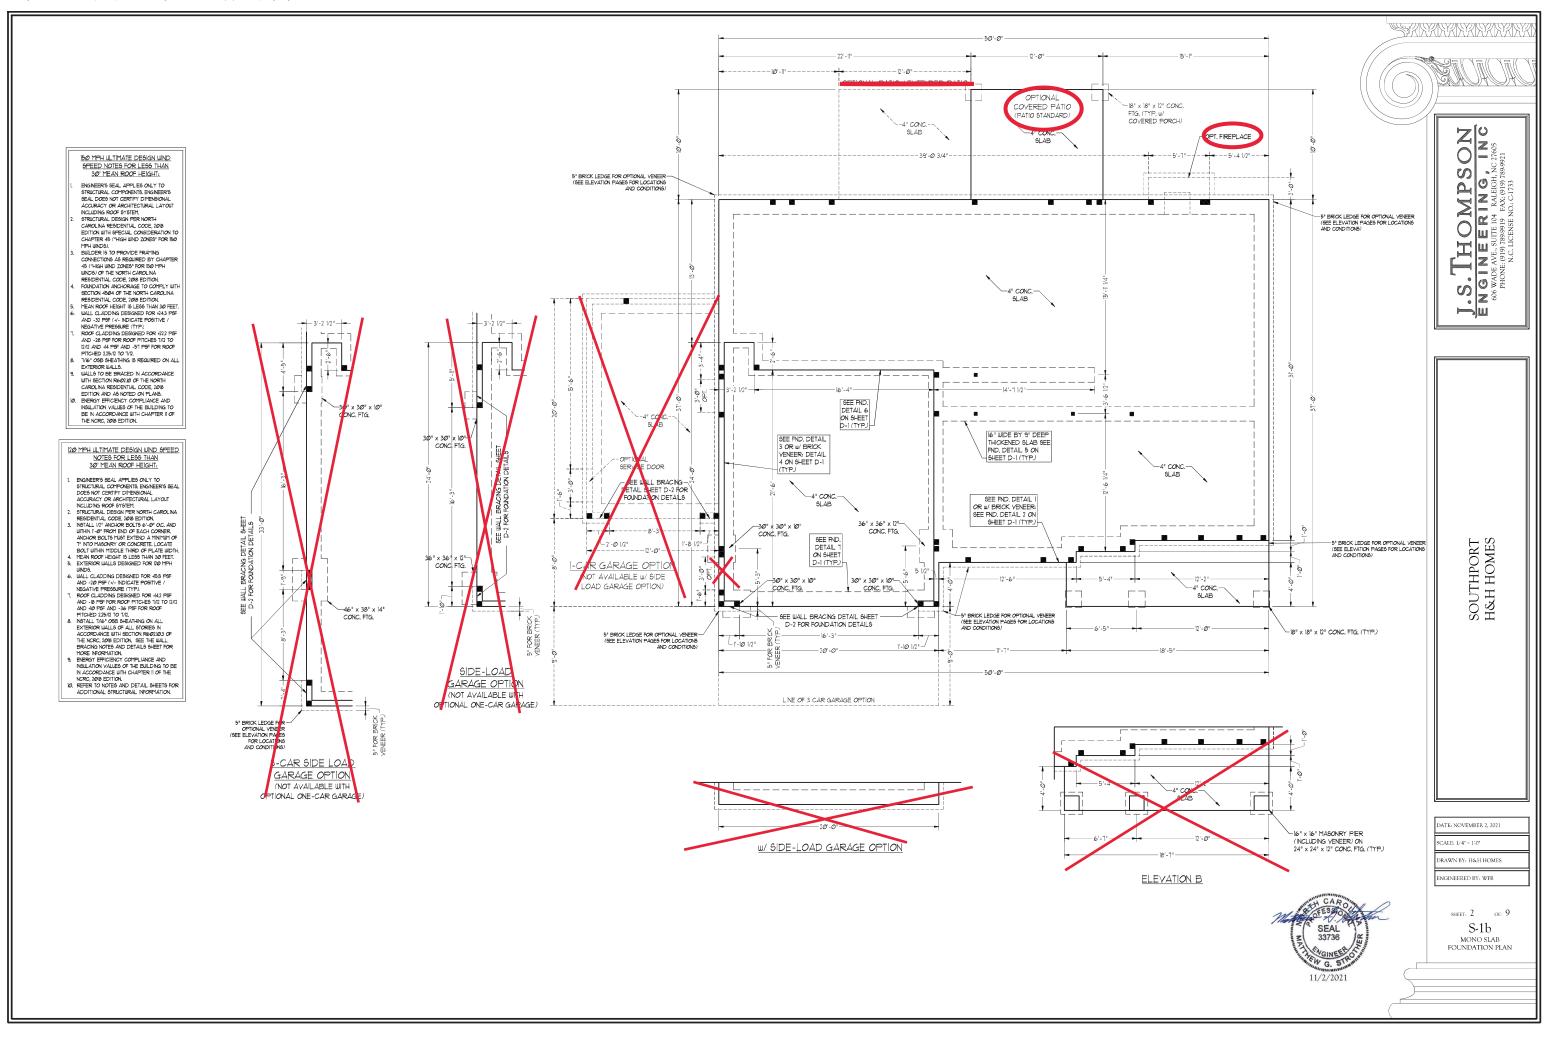


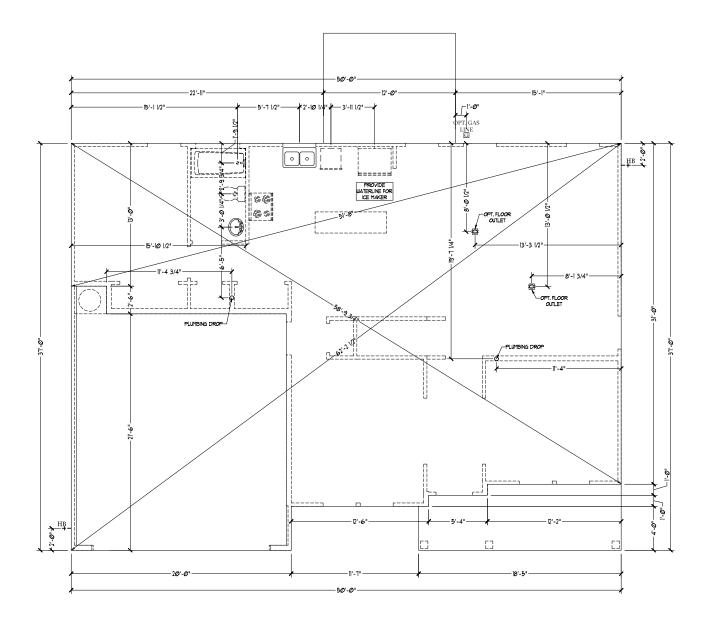

Slab Interface Plan SCALE: 1/4"=1'-0" ON 22x34 AND 1/8"=1'-0" ON 11x17

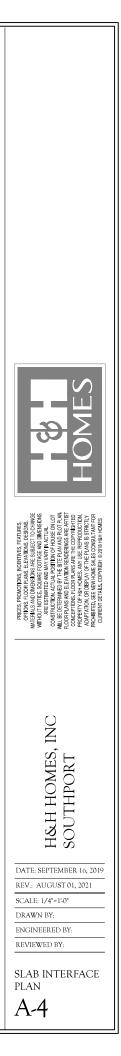

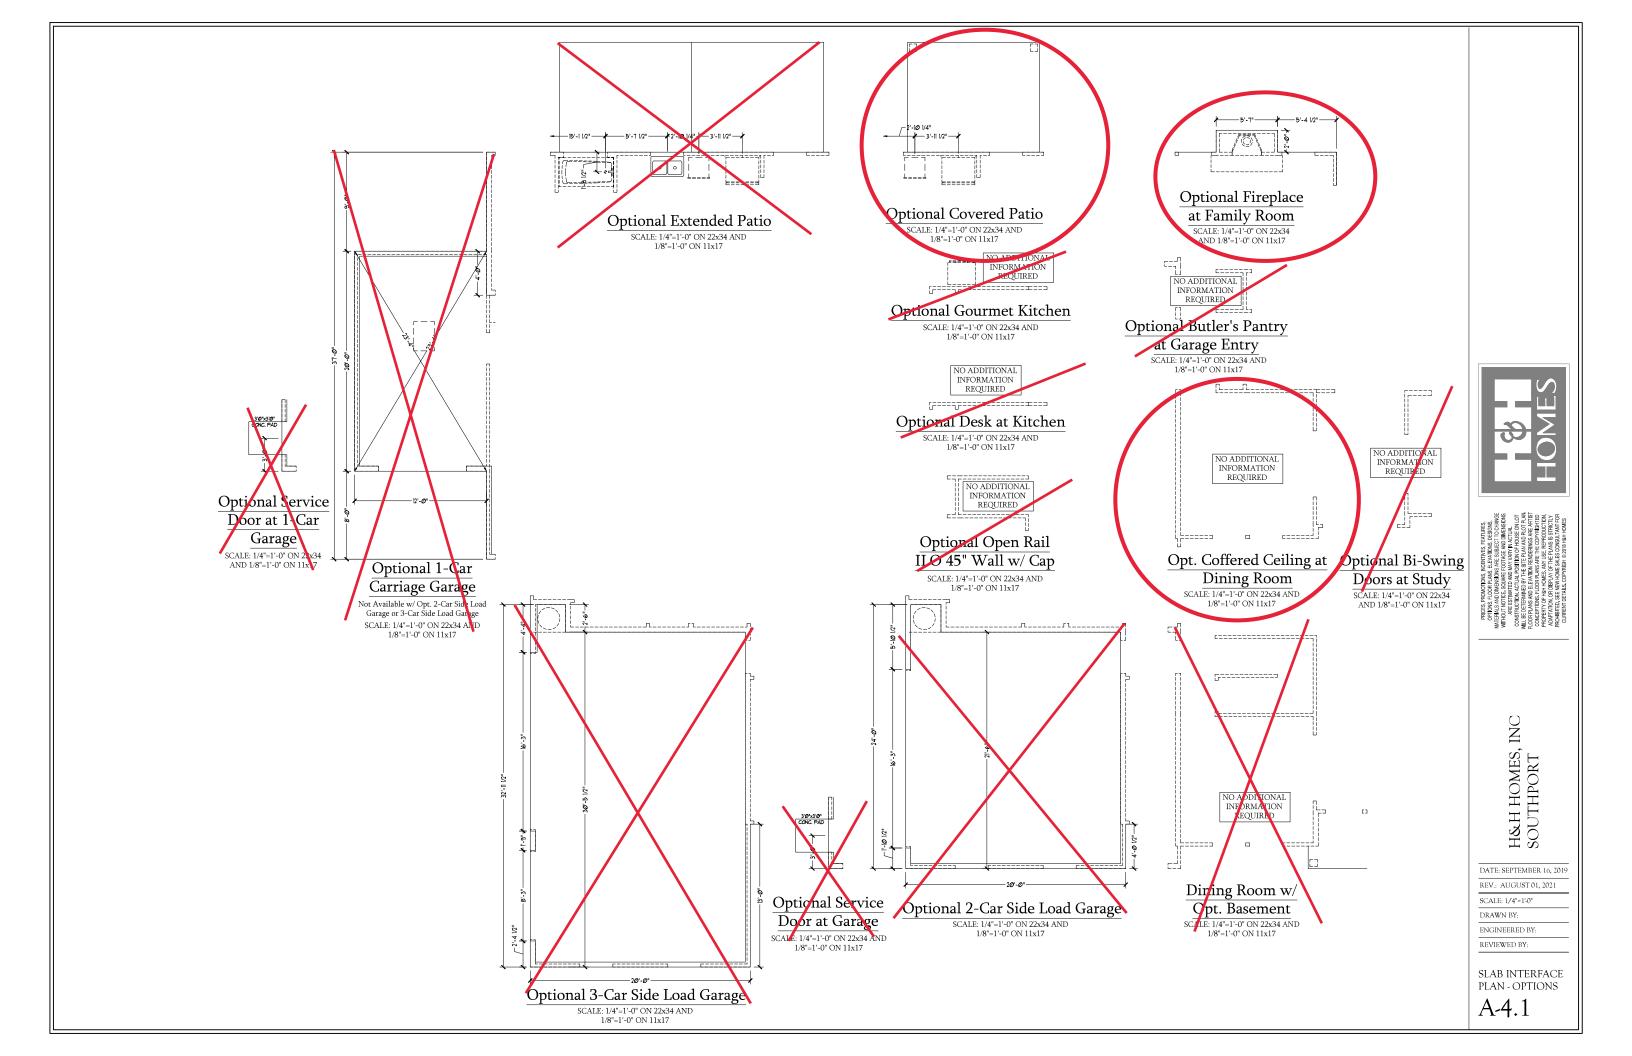

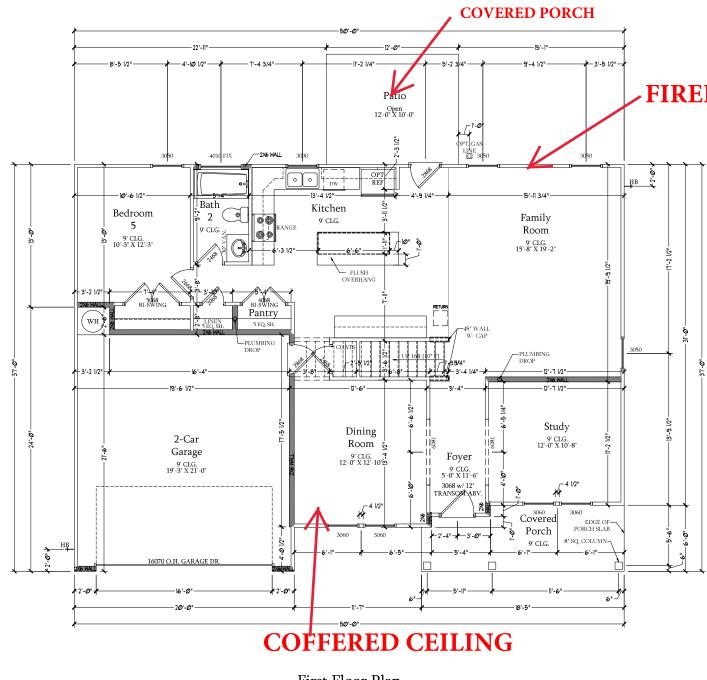

 $\underset{\substack{\text{SCALE: } 1/4"=1'-0" \text{ ON } 22x34 \text{ AND} \\ 1/8"=1'-0" \text{ ON } 11x17}}{\text{First Floor Plan}}$ 

SQUARE FOOTAG	E
Int FLOOR:	1269 SQ. FT.
2nd FLOOR:	1565 SQ. FT.
TOTAL	2834 SQ FT
GARAGE:	430 50 FT
FRONT PORCH:	104 5Q FT
PATIO:	120 5Q. FT.
OPT. BASEMENT:	1317 5Q. FT.
ist FLOOR OPTIONS	
OPTIONAL FIREPLACE:	10 SQ. FT.
Ist FLOOR W/ OPT, BASEMENT:	32 5Q. FT.
2nd FLOOR OPTIONS	
2nd FLOOR W/ OPT. BASEMENT:	32 SQ. FT.
UNHEATED OPTIONS	
OPT. I-CAR GARAGE:	240 SQ. FT.
OPT. 3-CAR GARAGE:	609 50. FT.
OPT. COVERED PATIO:	120 SQ. FT.
OPT. EXTENDED PATIO:	12Ø 5Q. FT.

## **FIREPLACE**

### SQUARE FOOTAGE W/ BRICK VENEER

Ist FLOOR: 2nd FLOOR: TOTAL: GARAGE: FRONT FORCH: FATTO:	1321 SQ. FT. 1626 SQ. FT. 2,941 SQ. FT. 430 SQ. FT. 104 SQ. FT. 120 SQ. FT.
OPT. BASEMENT:	1,317 SQ, FT.
Ist FLOOR OPTIONS OPTIONAL FIREPLACE: Ist FLOOR W/ OPT. BASEMENT:	15 SQ. FT. 25 SQ. FT.
2nd FLOOR OPTIONS 2nd FLOOR W/ OPT. BASEMENT:	25 SQ. FT.
UNHEATED OPTIONS OPT. 1-CAR GARAGE: OPT. 3-CAR GARAGE: OPT. COVERED PATIO: OPT. EXTENDED PATIO:	258 30, FT. 636 30, FT. 120 30, FT. 120 30, FT.



PRICES PROMOTIONS INCERTINES FEATURES OF DRAFT CONFLAVAS INCERTINES FEATURES OF DRAFT CONFLAVAS INCERTING DRAFT DI OPARES MITICAL STAND DRAFT DRAFT DRAFT DRAFT DRAFT MATE CONFLAVAS INCENTING AND AND DRAFT DRA CONSTRUCTION AND UNA PRICE ON OTO MATE DE CONFLAVAS INCENTING PARES ON OTO MATE DRAFT DRAFT DRAFT DRAFT DRAFT DRAFT DRAFT CONSTRUCTION AND DRAFT DRAFT





REV.: AUGUST 01, 2021 SCALE: 1/4"=1'0"


DRAWN BY: ENGINEERED BY: REVIEWED BY:


FIRST FLOOR PLAN


A-6

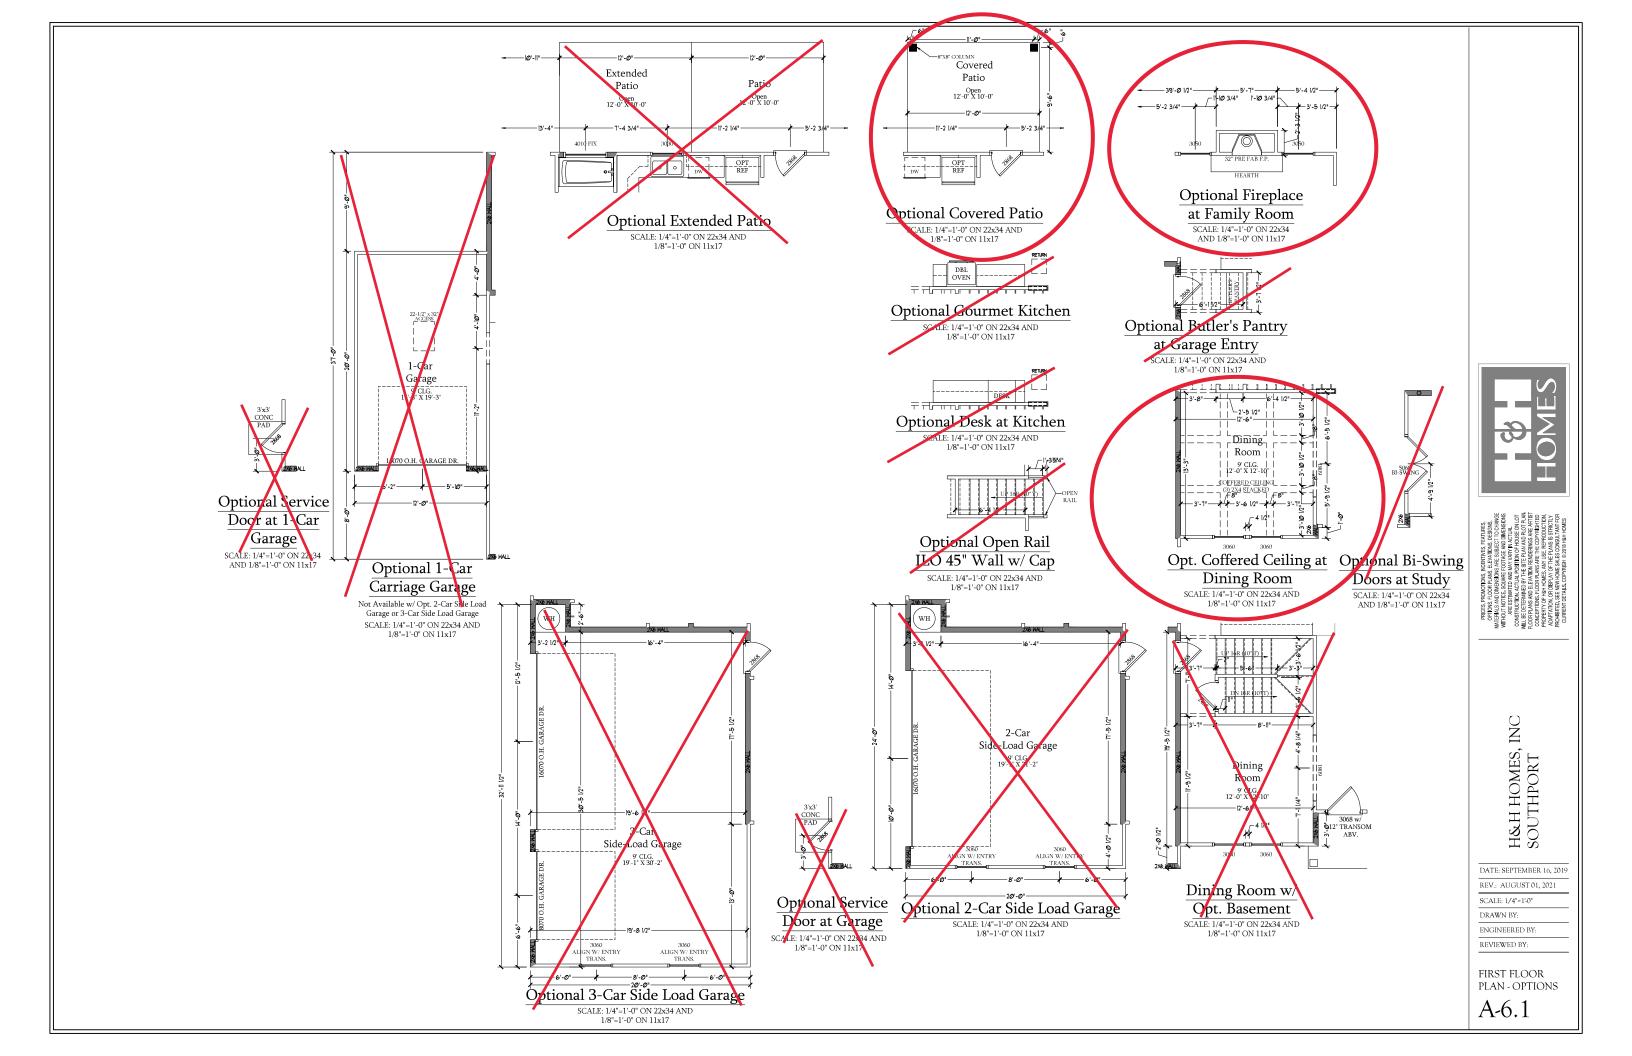


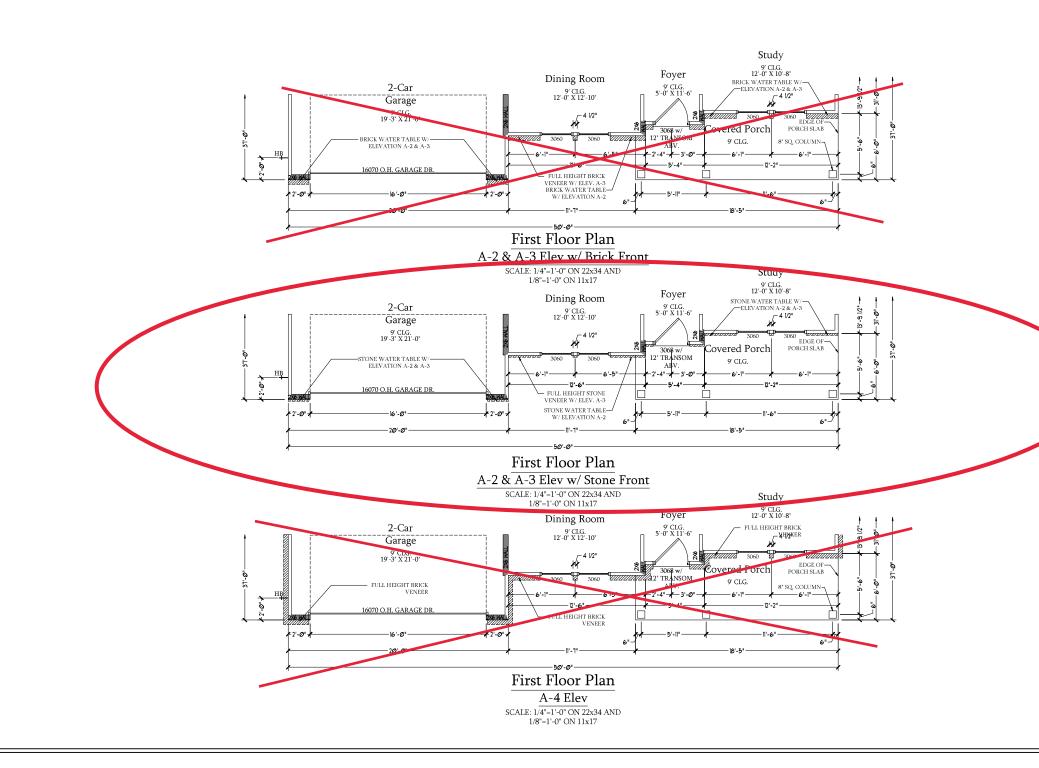

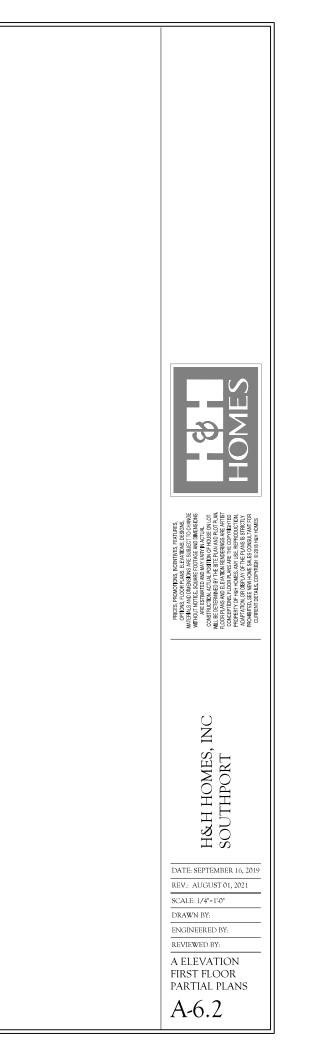


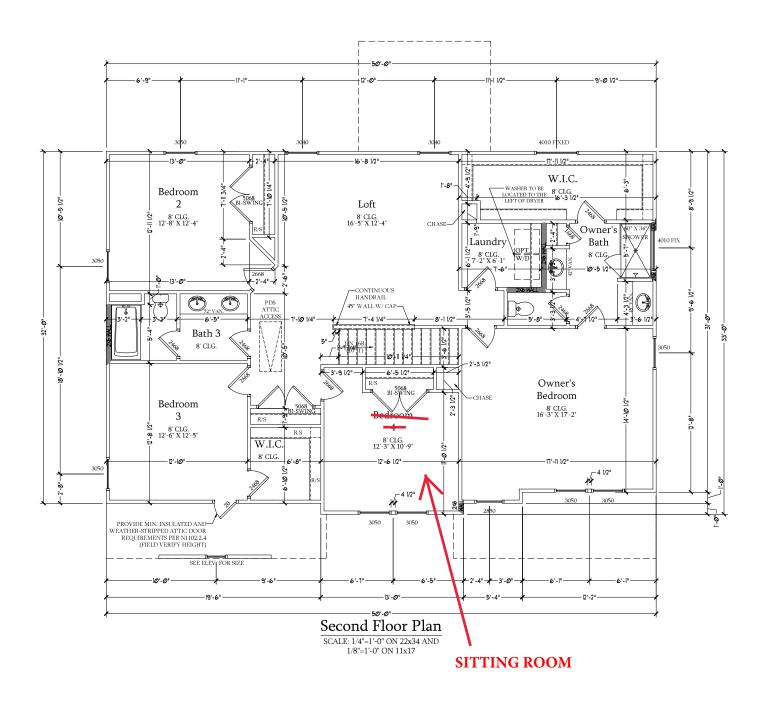

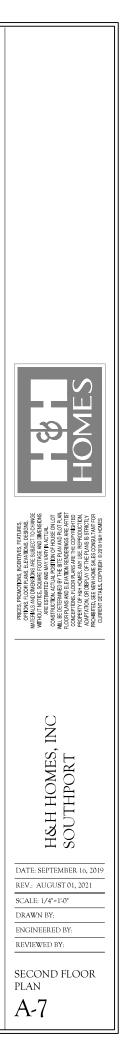


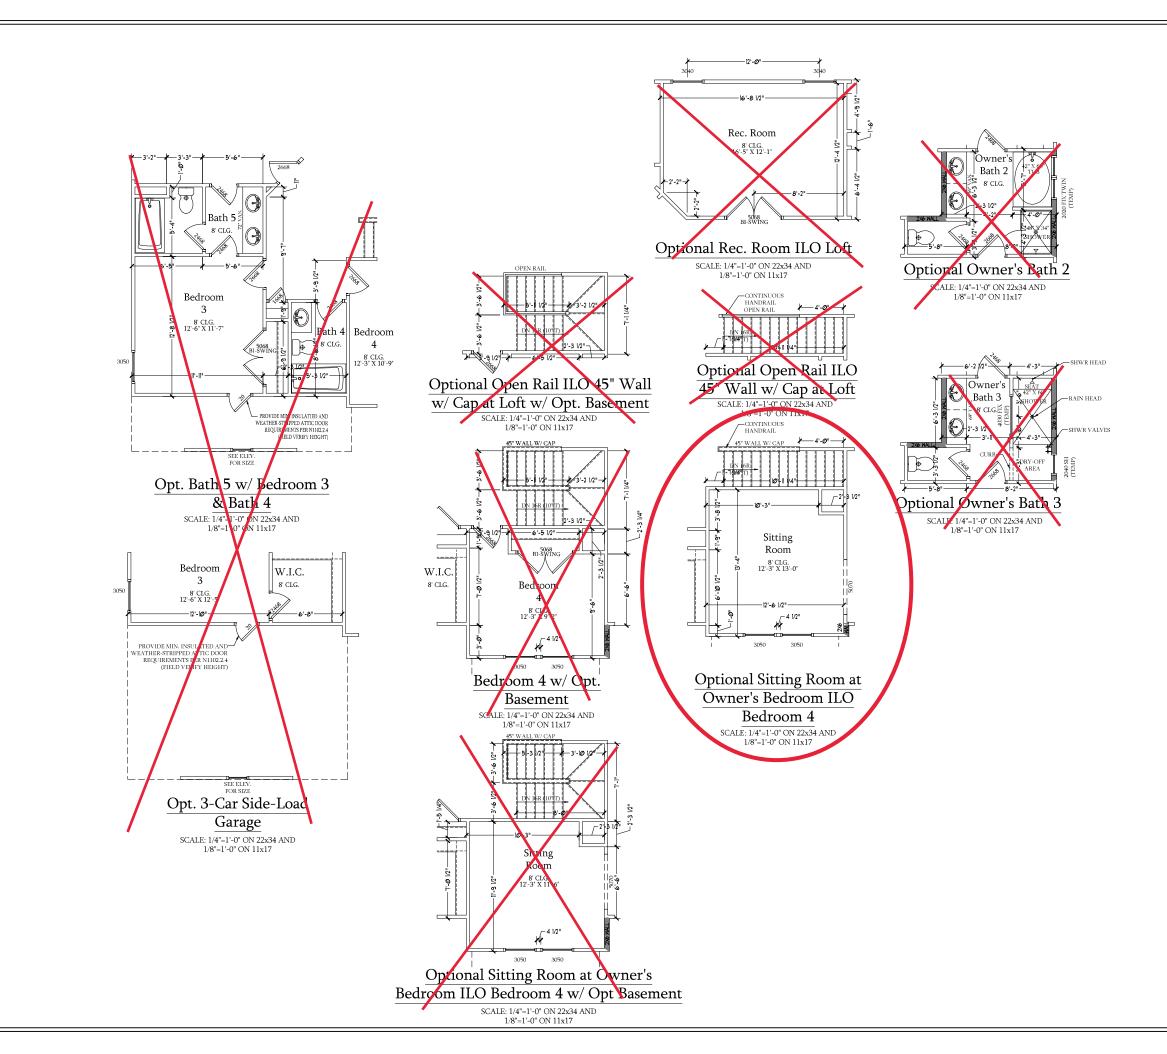





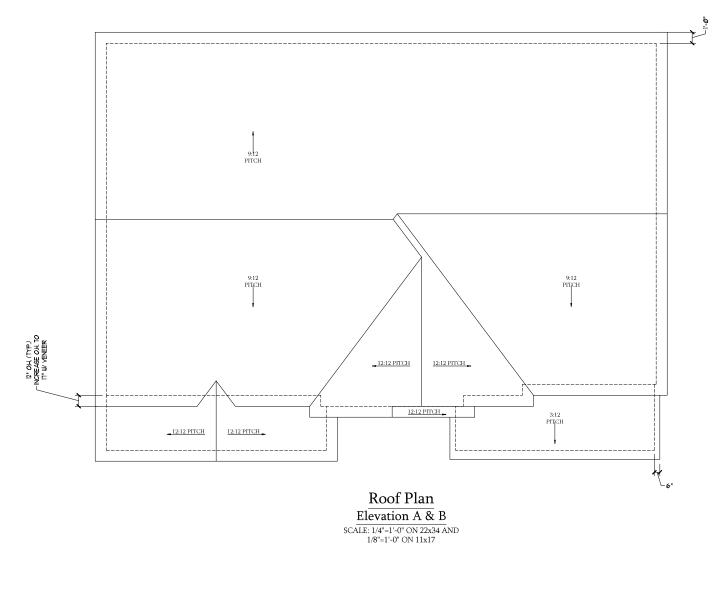

TOTAL UNDER ROOF . VENTING AREA REQU TOTAL REQUIREMENT	IRED:	*		$\frac{1600}{5.33} $ SQ FT. $\frac{5.33}{2.66}$ SQ FT.
LOWER AREA VENTIN	IG			
SOFFIT VENT	SIZE:	PER UNIT:	# UNITS:	PROVIDED:
	-	.041 SF/LF	70'-0"	2.87
	LOWER ARE	A VENTING P	ROVIDED:	-
UPPER AREA VENTING	3			
RIDGE VENT	SIZE:	PER UNIT:	# UNITS:	PROVIDED:
		.125 SF/LF	49'-0"	6.125
L	-	.125.01/11	Ŧ)-0	0.125
L	-	.125 51/11	47-0	0.125
	- UPPER ARE	VENTING PR		-
TOTAL AREA PROVID				-

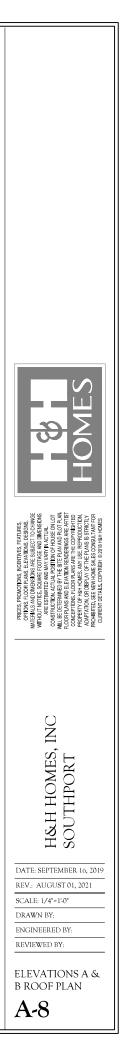

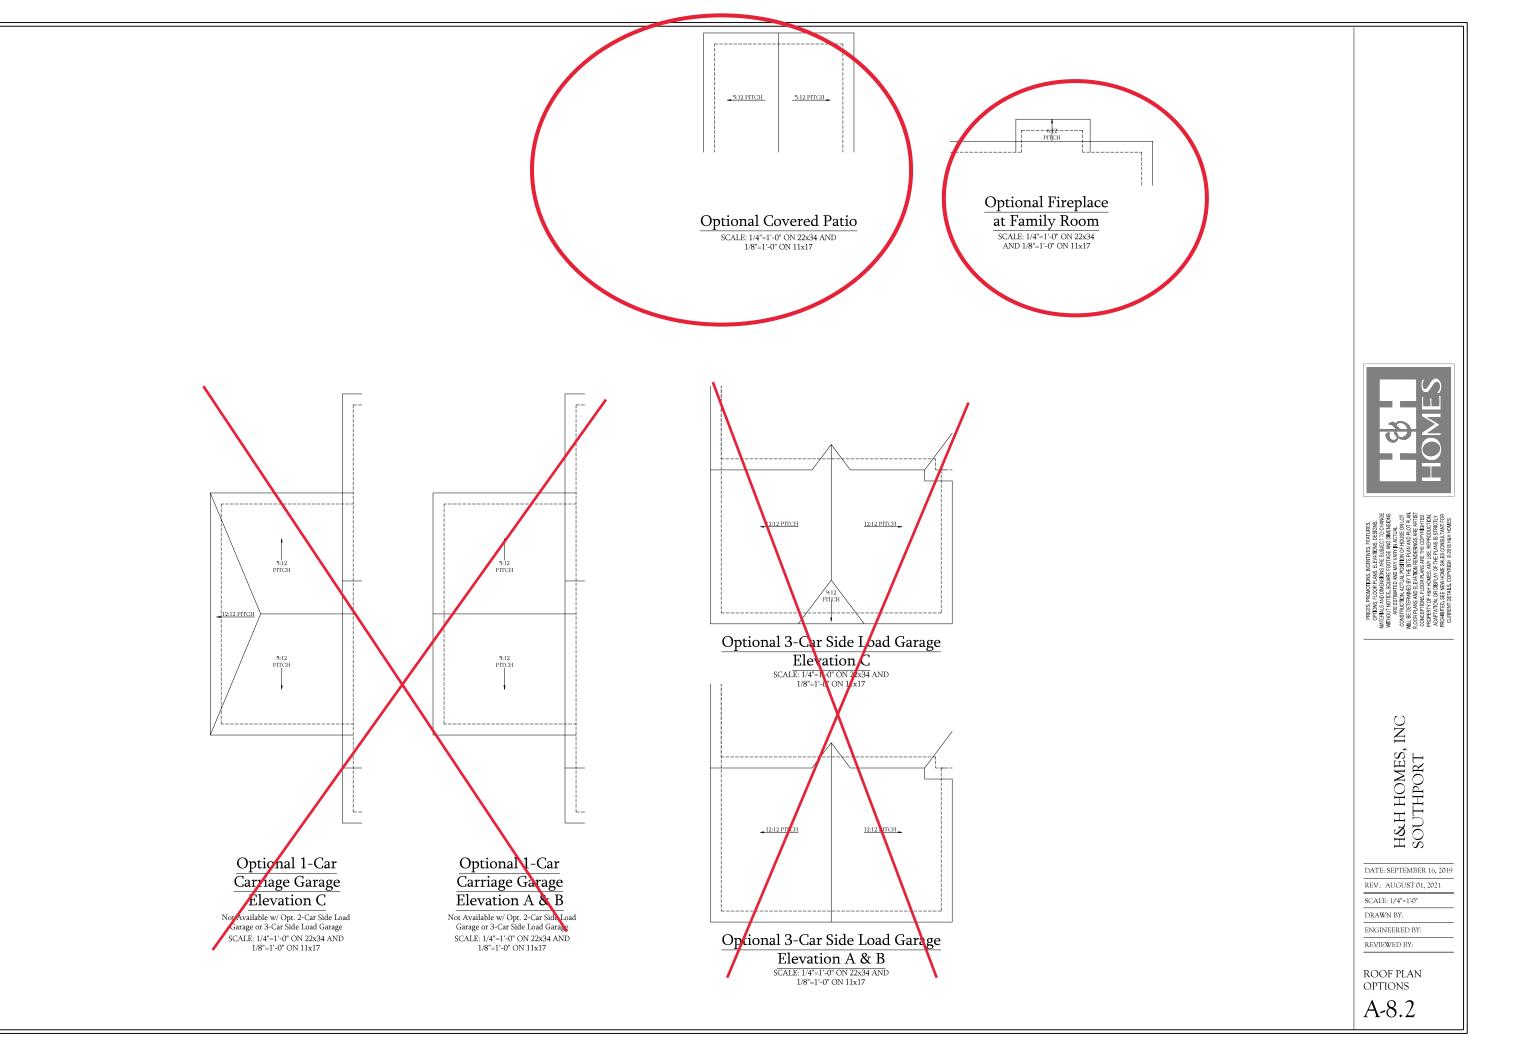

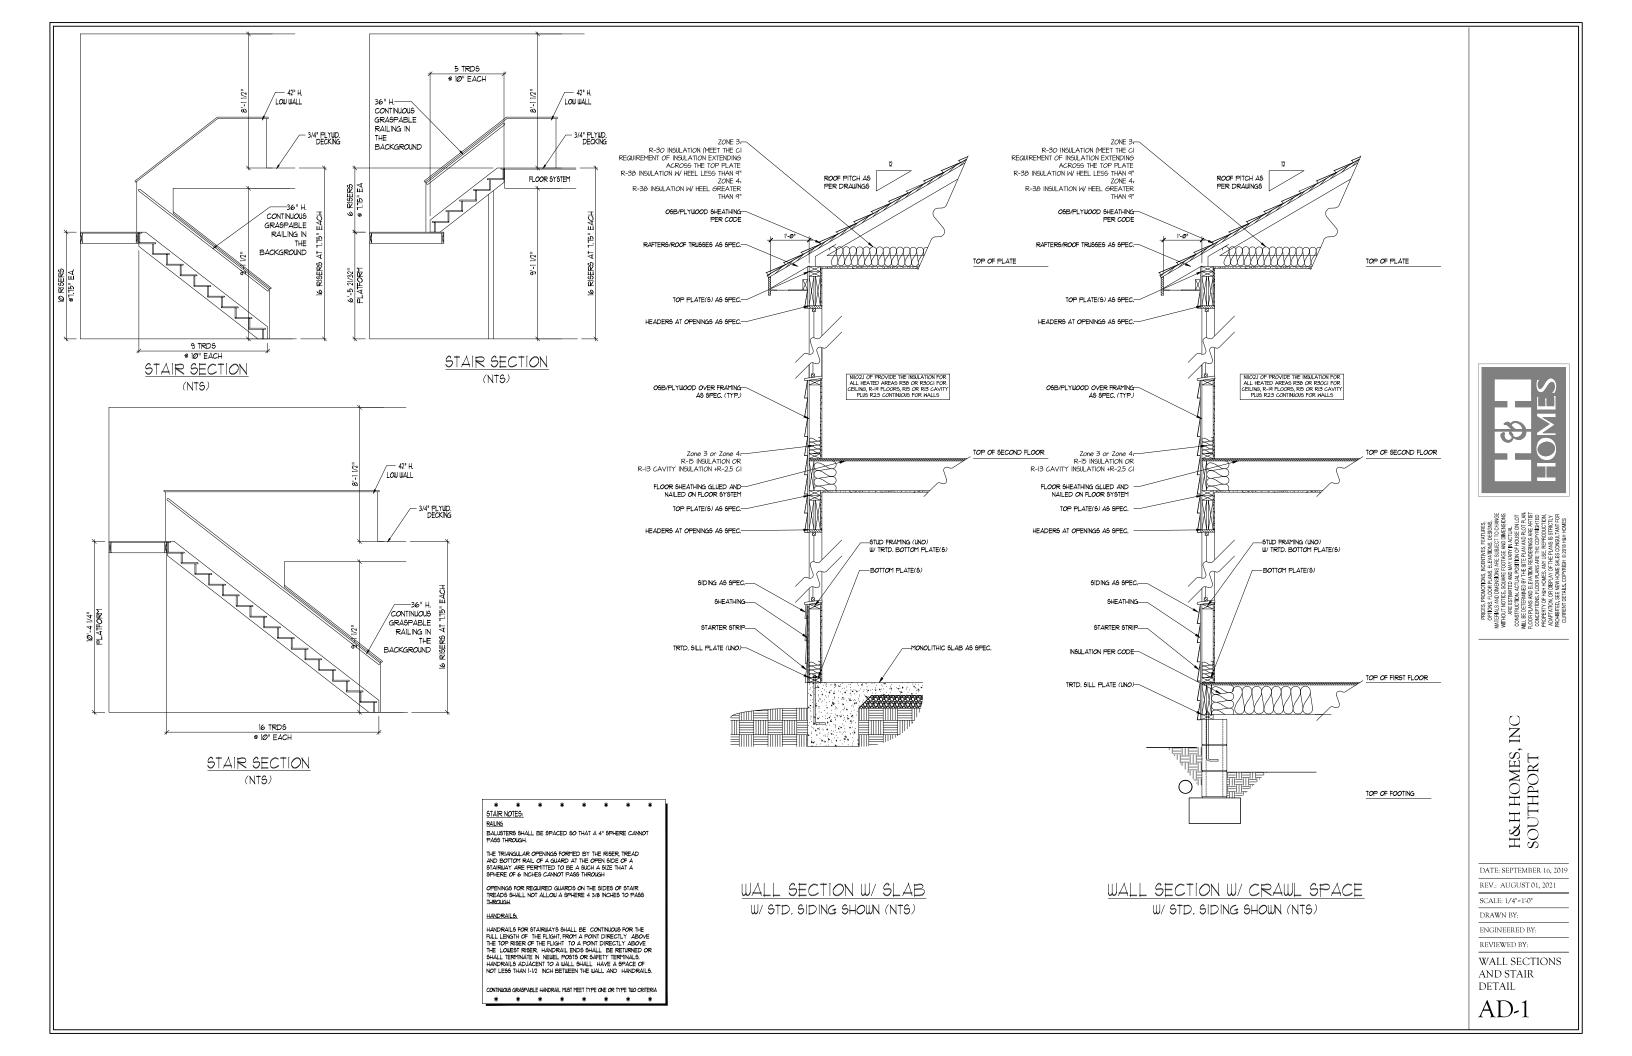



- 🚓 120V GFI OUTLET
- 120V SWITCHED OUTLET
- . 120V BASEBOARD OUTLET
- ÷
- 4-PLEX **∲**
- FLOOR MOUNTED 120V
- ₿ FLOOR MOUNTED 120V GFI
- WEATHERPROOF - Ŭ
- 220V OUTLET
- Ф Ø 120V DEDICATED CIRCUIT
- ø 220V DEDICATED CIRCUIT
- SPECIAL PURPOSE (240 V, ETC.) Ð
- ≙ WALL MOUNT LIGHT
- ¢ CEILING MOUNT LIGHT
- ¢ PENDANT LIGHT
- Q RECESSED CAN LIGHT
- Ø MINI CAN LIGHT
- $\mathbf{O}$ EYEBALL LIGHT
- FLUORESCENT LIGHT
- UNDERCABINET LIGHT
- \$ SWITCH
- \$ 3-WAY SWITCH
- \$ 4-WAY SWITCH
- \$ DIMMER SWITCH
- W TELEPHONE
- TV-TV CONNECTION
- 머 CONDUIT FOR COMPONENT WIRING
- 6P SPEAKER
- COMBO SMOKE CARBON MONOXIDE DETECTOR
- SD 110 V SMOKE DETECTOR
- EXHAUST FAN
- LVP LOW VOLTAGE PANEL

CEILING FAN CEILING FAN W/ LIGHT

#### ELECTRICAL NOTES:


PROVIDE AND INSTALL <u>GROUND FAULT</u> <u>CIRCUIT-INTERRUPTERS</u> (G.F.I.) AS INDICATED <u>ON PLANS OR AS ITEM NO. 4 AND 5 BELOW</u> INDICATES.

ALL SMOKE DETECTORS SHALL BE HARDWIRED INTO AN ELECTRICAL POWER SOURCE AND SHALL BE EQUIPPED WITH A MONITORED BATTERY BACKUP. PROVIDE AND INSTALL LOCALLY CERTIFIED SMOKE DETECTORS.


- ALL 15A AND 20A RECEPTACLES IN SLEEPING ROOMS, FAMILY ROOMS, DINING ROOMS, LIVING ROOMS, PARLORS, LIBRARIES, DENS, SUNROOMS, RECREATION ROOMS, CLOSETS, HALLWAYNS, AND SIMILAR AREAS WILL REQUIRE A COMBINATION TYPE A.F.C.I. DEVICE AND TAMPER-PROOF RECEPTACLES.
- ALL 15A AND 20A 120V RECEPTACLES LOCATED IN THE GARAGE AND UTILITY ROOMS SHALL BE G.F.C.I. PROTECTED (G.F.I).
- 5. IT IS THE RESPONSIBILITY OF THE LICENSED ELECTRICIAN TO ENSURE THAT ALL ELECTRICAL WORK IS IN FULL COMPLIANCE WITH ALL APPLICABLE LOCAL STANDARDS, CODES, AND ORDINANCES.


EVERY BUILDING HAVING A FOSSIL-FUEL-BURNING EVERT DUILING HAVING A POSSIL-PEL-DUINING HEATER OR APPLIANCE A POSSIL-PEL-DUINING OFERATIONAL CARBON MONOXIDE DETECTOR INSTALLED WITHIN 10 FEET OF EACH ROOM USED FOR SLEEPING PURPOSES.


FOR SELETEN FUNCTORS. 8. ALARMS SHALL RECEIVE THEIR PRIMARY POWER FROM THE BUILDING WIRNG WHEN SUCH WIRING IS SERVED FROM THE LOCAL. POWER UTILITY, SUCH ALARMS SHALL HAVE BATTERY BACKUP, COMBINATION SMOKP/CARENN MONOXIDE ALARMS SHALL BE LISTED OR LABELED BY A NATIONALLY RECOGNIZED TESTING LABORATORY.

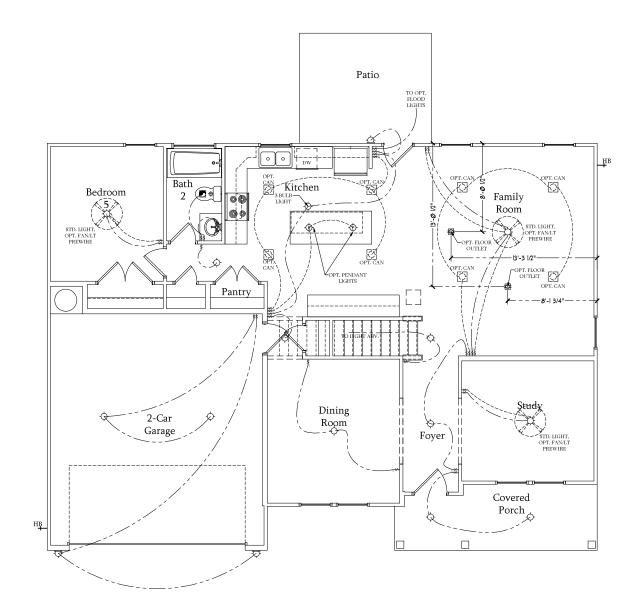

First Floor Plan SCALE: 1/4"=1'-0" ON 22x34 AND 1/8"=1'-0" ON 11x17

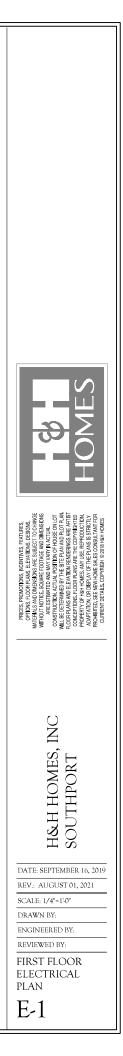


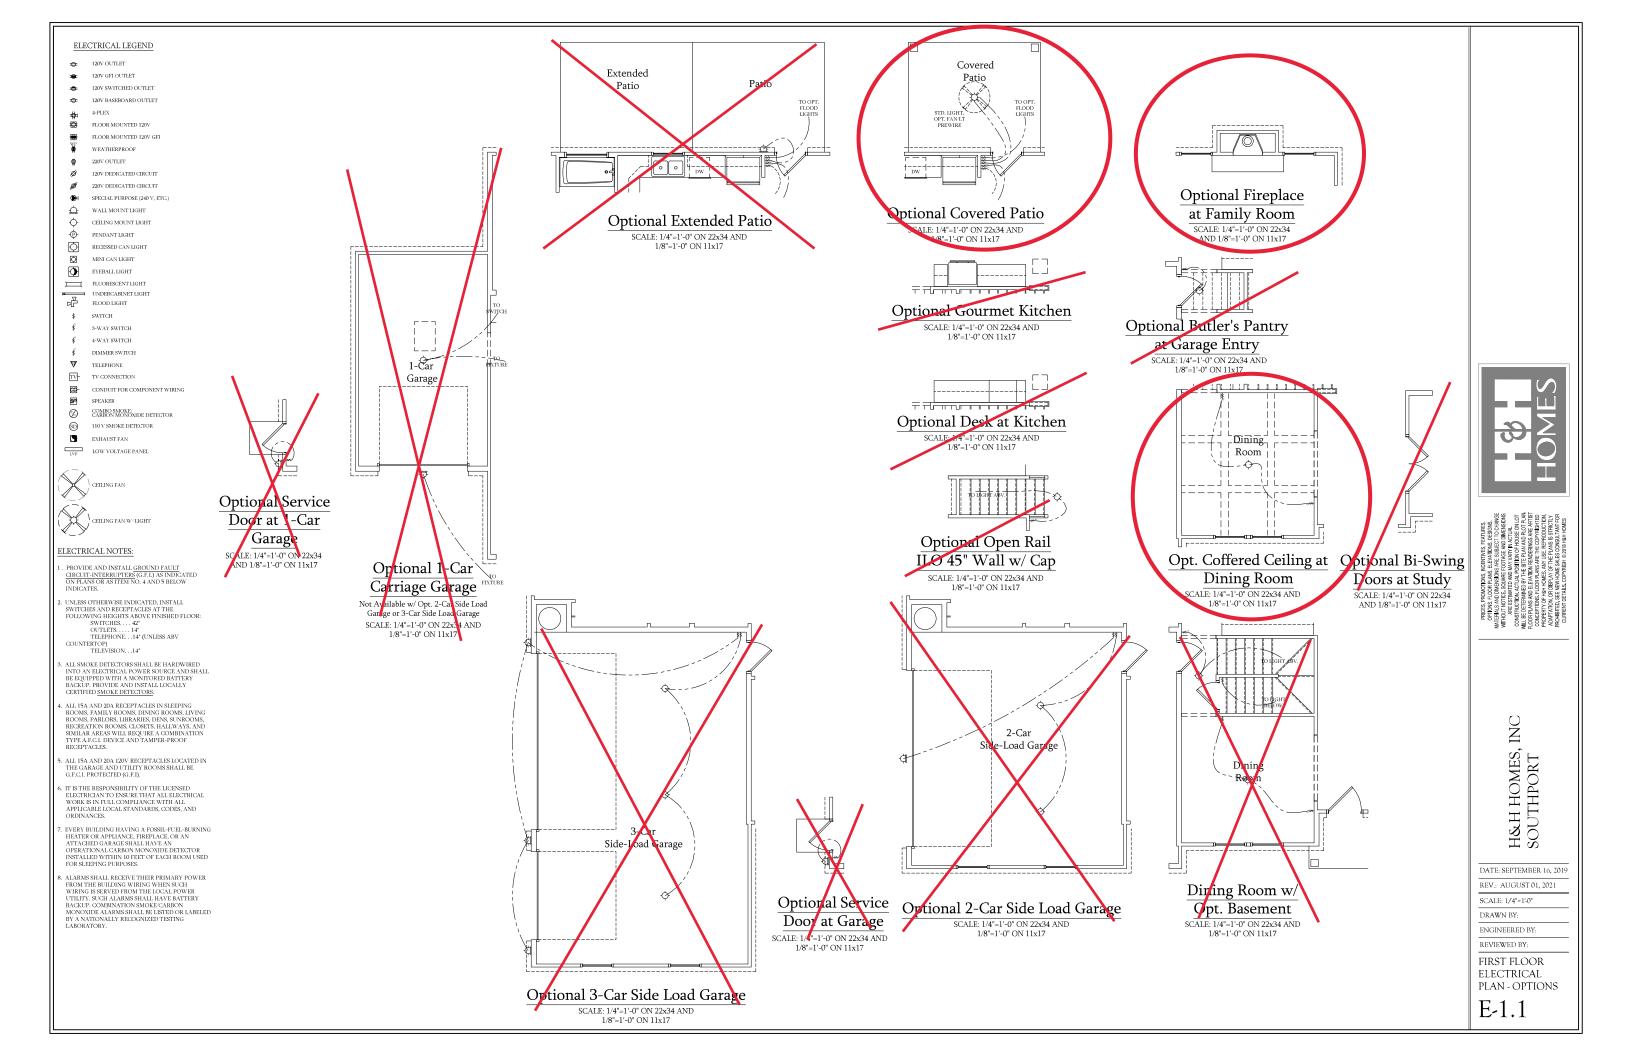


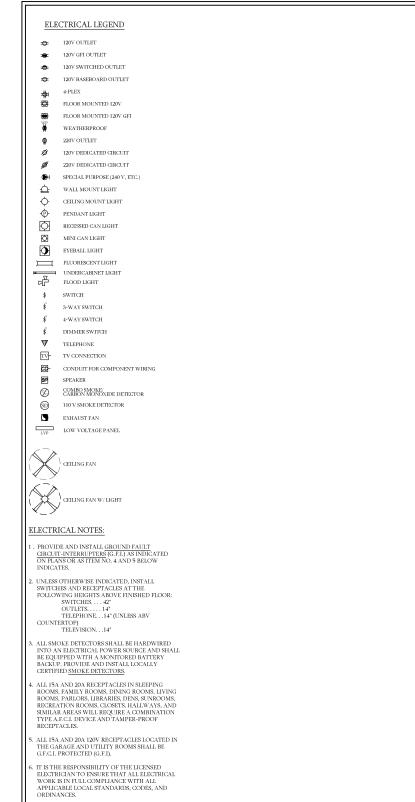


EVERY BUILDING HAVING A FOSSIL-FUEL-BURNING HEATER OR APPLIANCE, FIREPLACE, OR AN ATTACHED GARAGE SHALL HAVE AN OPERATIONAL CARBON MONOXIDE DETECTOR INSTALLED WITHIN 10 FEET OF EACH ROOM USED FOR SLEEPING PURPOSES.

FOR SELETEN FOR FORSES 8. ALARMS SHALL RECEIVE THEIR PRIMARY POWER FROM THE BUILDING WIRNG WHEN SUCH WIRING IS SERVED FROM THE LOCAL. POWER UTILITY, SUCH ALARMS SHALL HAVE BATTERY BACKUP, COMBINATION SMOKE/CAREDN MONOXIDE ALARMS SHALL BE LISTED OR LABELED BY A NATIONALLY RECOGNIZED TESTING LABORATORY.

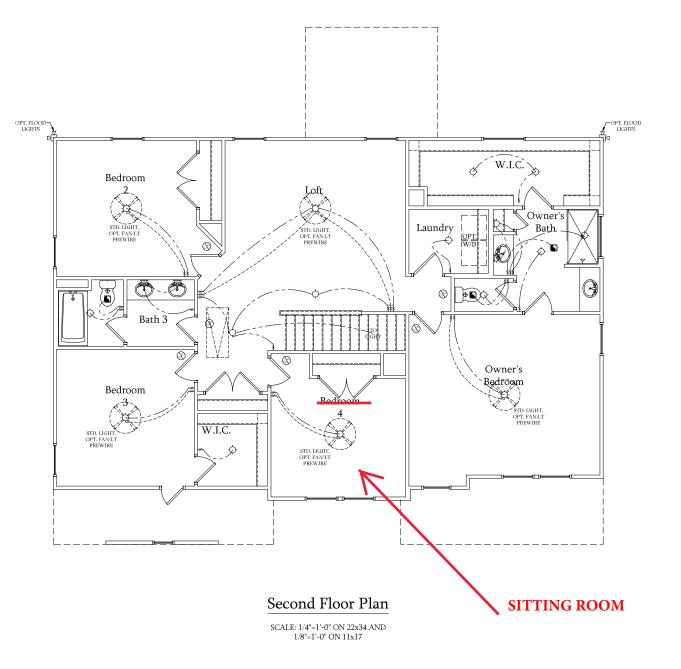

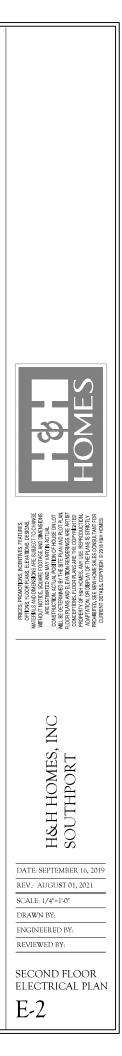

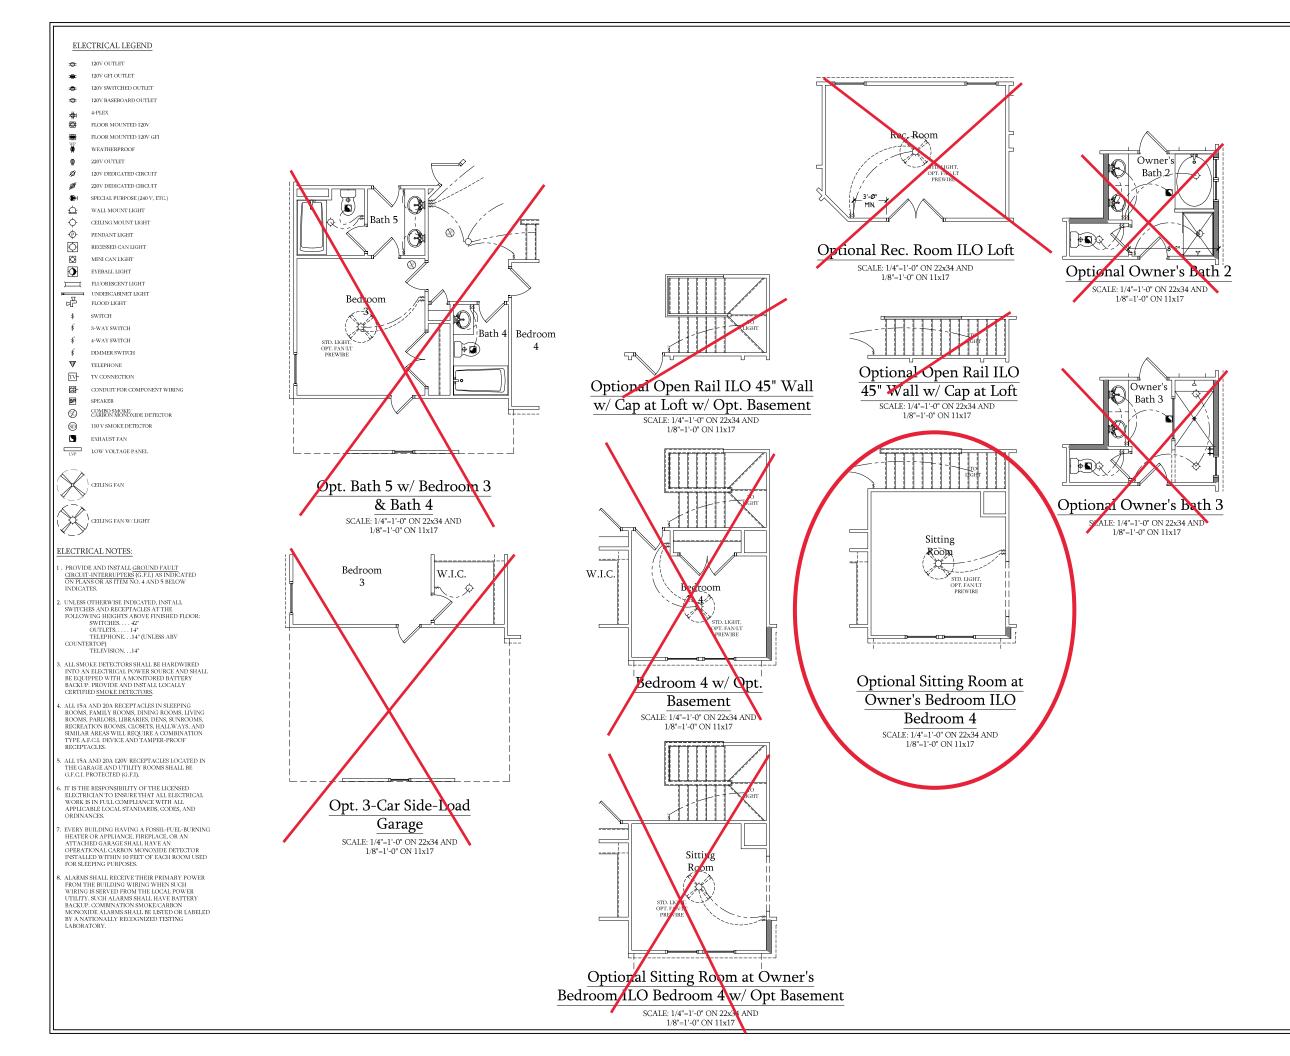



	CHEDULE FOR AL STONE SUPPORT	
LENGTH (FT.)	SIZE OF LINTEL	
UP TO 4 FT.	L 3 1/2 x 3 1/2 x 1/4	
4-8	L 5 x 3 1/2 x 5/16 LLV	
8 AND GREATER	L 6 x 4 x 5/16 LLV	
BRICK SUPPORT NOT	<u>E6:</u>	
<ol> <li>LINTEL SCHEDULE APPLIEB TO ALL OPENINGS IN BRICK VENER (UNO). SEE ARCH DUGS. FOR SIZE AND LOCATION OF OPENINGS.</li> <li>(LLV) = LONG LEG VERTICAL</li> <li>LENGTH = CLEAR OPENING</li> </ol>		
	GLE IRONS MIN. 4" EACH ER TO PROVIDE BEARING.	

- FOR ALL HEADERS & -O" AND GREATING IN LENGTH, ATTACH STEEL ANGLE TO HEADER W 12" LAG SCREWS & 12" O.C.
- STAGGERED. FOR ALL BRICK SUPPORT @ ROOF LINES,
- FOR ALL ERICK SUPFORE RODE LINES, FASTEN (2) × 10 BLOCKING BETLEEN STUDS w/ (4) /20 NALLS PER PLY, FASTEN A 6<sup>+</sup> × 4<sup>+</sup> × 5/16<sup>+</sup> STEL AVGLE TO (2) 2 × /0 BLOCKING w/ (2) /2<sup>+</sup> LAG SOREUS € 1<sup>2</sup> OC. STAGERED SEE SECTION R103821 OF THE 20/5 NCRC FOR ADDITIONAL
- BRICK SUPPORT INFORMATION PRECAST REINFORCED CONCRETE LINTELS ENGINEERED BY OTHERS MAY BE USED IN LIEU OF STEEL LINTELS.

#### NOTE:

BCI 4500A-18 JOISTS MAY BE USED IN LIEU OF TJI 110 JOISTS AT THE DEPTH AND SPACING NOTED ON THE PLAN.

#### BRACED WALL DESIGN NOTES:

- BRACED WALL DEGIGN PER SECTION R6/02J0 OF THE NCRC 20/8 EDITION. CS-UBP RETERS TO "CONTINUOUS SHEATHING WOOD STRUCTURAL PANELS" CONTRACTOR IS TO INSTALL 17/6" OFB ON ALL EXTERIOR WALLS ATTACHED W/8d NAILS SPACED 6" OK ALL BY EARLE LECES AND TO "CONTRACTOR IS TO INSTALL 1/2" (TINN GTPSUM WALL BOARD" CONTRACTOR IS TO INSTALL 1/2" (TINN GTPSUM WALL BOARD" CONTRACTOR IS TO INSTALL 1/2" (TINN GTPSUM WALL BOARD" CONTRACTOR IS TO INSTALL 1/2" (TINN GTPSUM WALL BOARD" CONTRACTOR IS TO INSTALL 1/2" (TINN GTPSUM WALL BOARD OR DIFK NOILS GPACED T" OC. ALONG PANEL EDGES AND IN THE FIELD INCLUDING TOP AND BOTTOM PLATES. BOTTOM PLATES.
- EXPLOY PLATES. BRACED WALL DESIGN APPLIED IN WIND ZONES UP TO 130 MPH. FOR HIGH WIND ZONES, BRACE WALLS ARE TO BE CONSTRUCTED IN ACCORDANCE WITH CHAPTER 45 OF THE NCRC 2018 EDITION. SEE NOTES AND DETAIL SHEETS FOR ADDITIONAL BRACED
- WALL INFORMATION.

#### NOTE:


- PER SECTION R602.00.46 OF THE 2010 NCRC, THE AMOUNT OF BRACING REQUIRED ON THE WALK OUT BASEMENT WALLS EXCEEDS THE AMOUNT OF BRACING ON THE WALL ABOVE MULTIPLIED BY A FACTOR OF US. 2
- ATTACHED WITH 80 NAILS AT 6" O.C. ALONG PANEL EDGES AND 12" O.C. IN THE FIELD.

#### STRUCTURAL NOTES:


- ALL FRAMING LUMBER TO BE 12 SPF (UNO), ALL
- TREATED LIMBER TO BE 2 STP (UNO) INSTALL AN EXTRA JOIST UNDER WALLS PARALLEL TO FLOOR JOISTS WHERE NOTED ON THE FLANS. WINDOW AND DOOR HEADERS TO BE SUPPORTED W/ (1) JACK STUD AND (1) KING STUD EA, END (UNO.), SEE
- TABLE REØ2.15 FOR ADDITIONAL KING STUD REQUIREMENTS. SQUARES DENOTE POINT LOADS UHICH REQUIRE SOLID
- Submitted DELOG IN GROER OR FOUNDATION. SUPPORT UNDERCHED PT. LOADS ALONG FRAMED WALLS w/(2) STUDS (UNO). ALL LOAD BEARING HEADERS TO BE (3) 2  $\times$  10 (UNO).
- ALL LOAD BEARING HEADERS TO BE (3) 2 × 10 (UNO.)
   STEP BASPENT FON DOWN TO 2 × 6 10° OC. WALL WERE GRADE PERMITS.
   ALL LOAD BEARING INTERIOR WALLS TO BE 2 × 4 12° OC. OR 2 × 6 16° OC. (UNO.)
   FOR HIGH WIND ZONES, ALL EXTERIOR WALLS TO BE SHEATHED WITH TOK° OBS SHEATHING WITH JOINTS BLOOKED AND SECURED WITH BA NALLS AT 3° OC.
   ALONG EDGES AND 6° OC. IN THE FIELD.
   END VIED TO SHEAT CHEAT HIS WITH JOINTS
- ALONG EDGES AND & OLC. IN THE FIELD. FOR HIGH UND ZONES, SECURE ALL EXTERIOR WALL SHEATHING PANELS TO DOUBLE TOP FLATES, BANDS, JOISTS, AND GIRDERS WITH (2) ROUG OF 8d NAILS STAGGERED AT 3° OC. PANELS SHALL EXTEND 12°
- BEYOND CANSTRUCTION JOINTS AND SHALL OVERLAP GRODERS AND DOUBLE SILL PLATES THEIR FULL DEPTH. 2. ALL 4 × 4 POSTS SHALL BE ANCHORED TO SLABS W/ SIMPSON ABUA4 POST BASES (OR EQUAL) AND 6 × 6 POSTS W/ ABUGE POST BASES (OR EQUAL) (NO). ALL 4 x 4 AND 6 x 6 POSTS TO BE INSTALLED WITH 100 LB CAPACITY UPLIFT CONNECTORS AT TOP (NO.)
- REFER TO NOTES AND DETAIL SHEETS FOR ADDITIONAL STRUCTURAL INFORMATION.

#### TABLE R602.7.5 MINIMUM NUMBER OF FULL HEIGHT STUDS AT EACH END OF HEADERS IN EXTERIOR WALLS

HE	EADER SPAN	MAXIMUM STUD SPACING (INCHES) (PER TABLE R6023(5)	
	11 (11)	16	24
	UP TO 3'	1	1
	4'	2	1
	8'	3	2
	12'	5	3
	16'	6	4

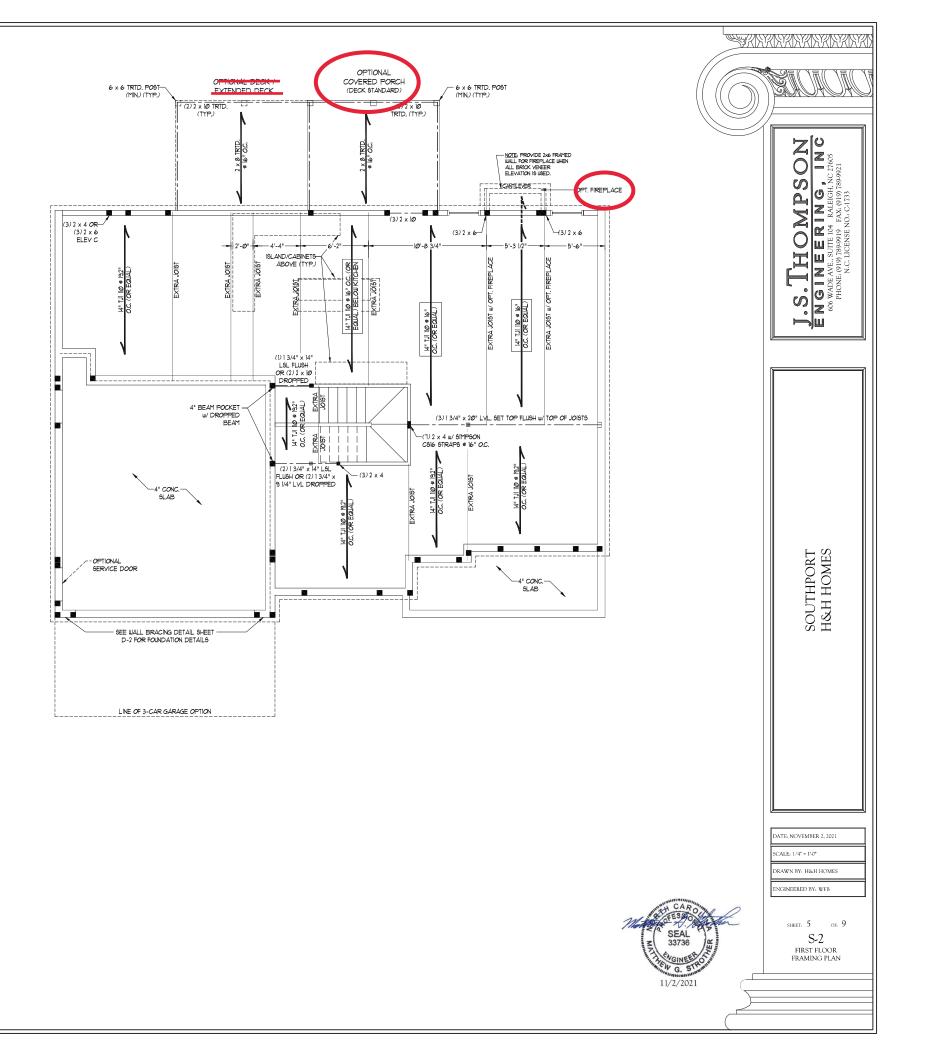

#### Z:\CAD Drawings\JST-ENG CAD\H & H Homes\Southport\Southport\_GL Structural 10-21.dwg, 11/2/2021 10:45:47 AM, Whitney Boykin, J.S. Thompson Engineer

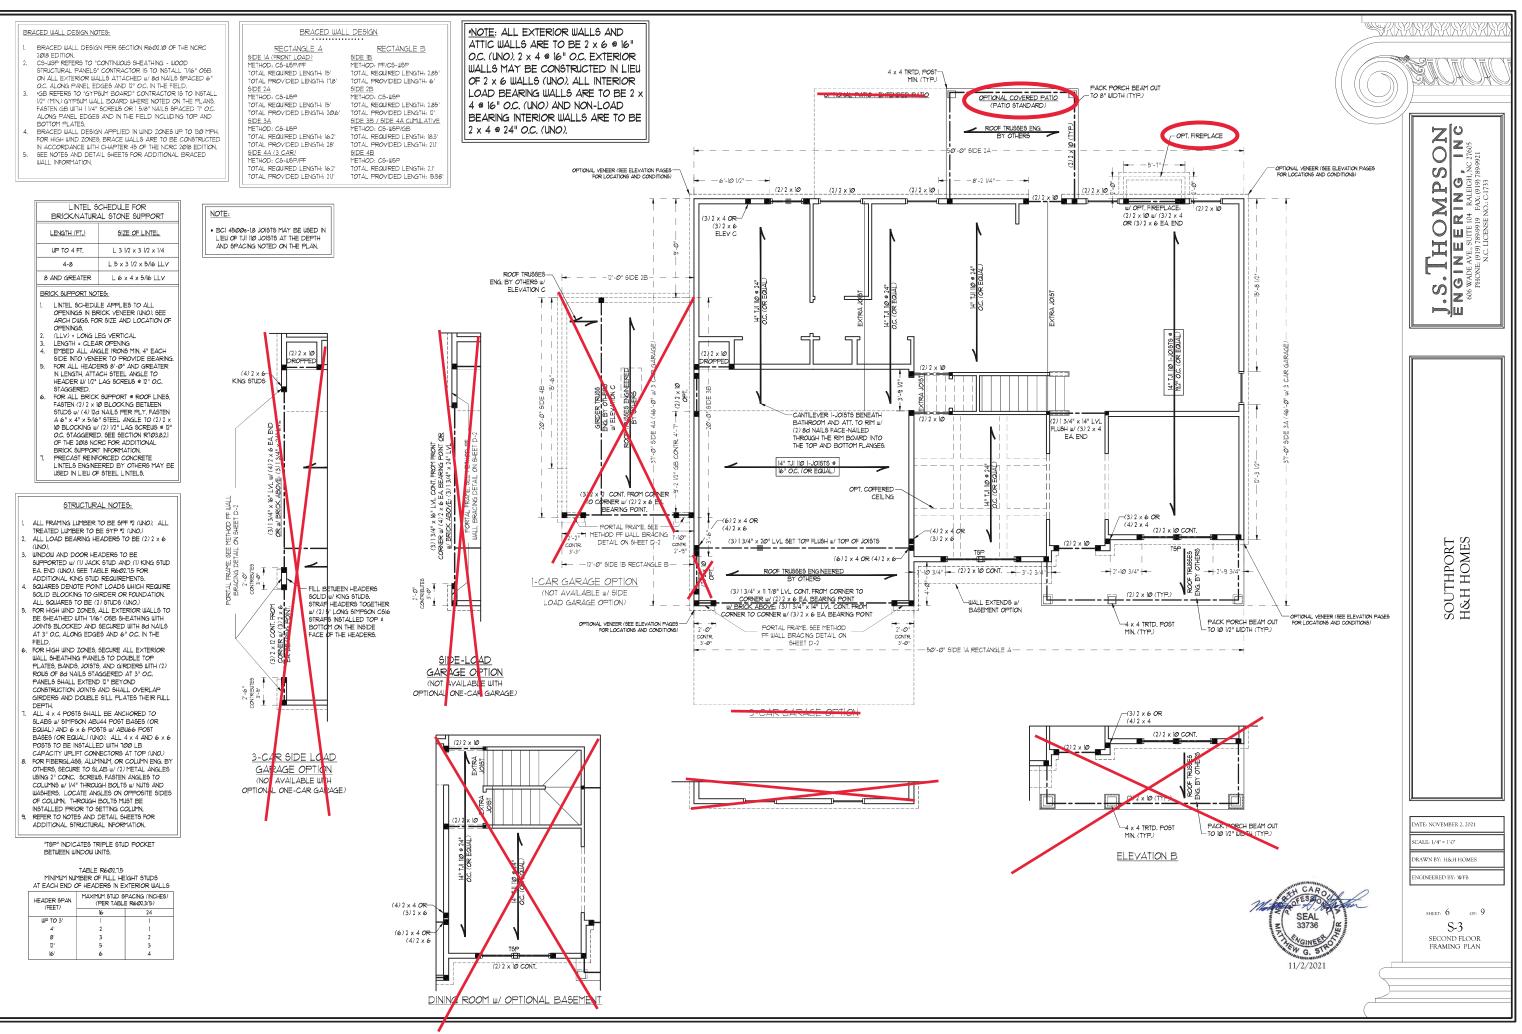


#### BRACED WALL DESIGN NOTES:

- BRACED WALL DESIGN PER SECTION R602.10 OF THE NORC
- 2018 EDITION. CS-WGP REFERS TO "CONTINUOUS SHEATHING WOOD
- C3-100P REFERS TO CONTINUOUS SHEAT HINS 4000D STRUCTURAL PANELS<sup>67</sup> CONTRACTOR IS TO INSTALL TW6 °05B ON ALL EXTERCOR WALLS ATTACHED W 3d NALS SPACED 6" OC. ALONG PANEL EDGES AND 12" OC. IN THE FIELD "GB REFERS TO "GYPSUM BOARD" CONTRACTOR IS TO INSTAL "(MIN GYPSUM WALL BOARD ULERE NOTED ON THE PLANS, FASTEN GB WITH TURA' SCREWS OR 15.68" NALS SPACED 1" OC. ALONG BUTH TURA'S CREWS OR 15.68" NALS SPACED 1" OC.
- ASTEN GB WITH 11/4" SCREWS OR 15/6" NALE SPACED 1" OC. ALONG PANEL EDCES AND IN THE FIELD IN UNDURING TOP AND BOTTOM PLATES. BRACED WALL DEGION APPLIED IN WIND ZONES UP TO 130 MPH. FOR HIGH WIND ZONES, BRACE WALLS ARE TO BE CONSTRUCTED IN ACCORDANCE WITH CHAPTER 45 OF THE NCRC 2018 EDITION. SEE NOTES AND DETAIL SHEETS FOR ADDITIONAL BRACED WALL INCERVITION 5
- WALL INFORMATION.


#### NOTE:


12'


- PER SECTION R602/032 OF THE 20/0 NCRC, THE AMOUNT OF BRACING ON THE SECOND FLOOR EXCEEDS THE AMOUNT REQUIRED FOR THE FIRST FLOOR AND NO BRACED WALL NEW YOR OF THE THREE FLOOR AND NO BRACED WALL
- ANALYSIS IS REQUIRED. 2. SHEATH ALL EXTERIOR WALLS WITH 7/16" OSB SHEATHING ATTACHED WITH 8d NAILS AT 6" O.C. ALONG PANEL EDGES AND 12" O.C. IN THE FIELD.

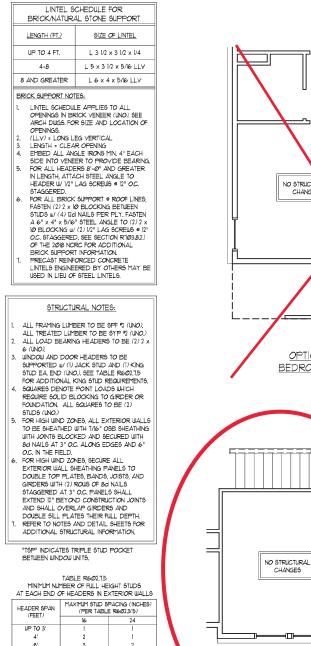



NOTE: ALL EXTERIOR WALLS AND ATTIC WALLS ARE TO BE 2 × 6 @ 16" O.C. (UNO). 2 x 4 @ 16" O.C. EXTERIOR WALLS MAY BE CONSTRUCTED IN LIEU OF 2 × 6 WALLS (UNO). ALL INTERIOR LOAD BEARING WALLS ARE TO BE 2 x 4 @ 16" O.C. (UNO) AND NON-LOAD BEARING INTERIOR WALLS ARE TO BE 2 x 4 @ 24" O.C. (UNO).

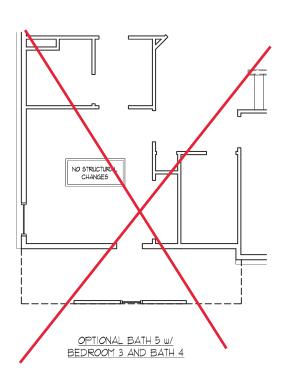

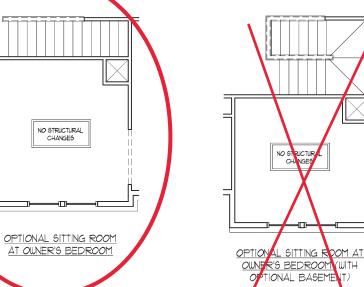


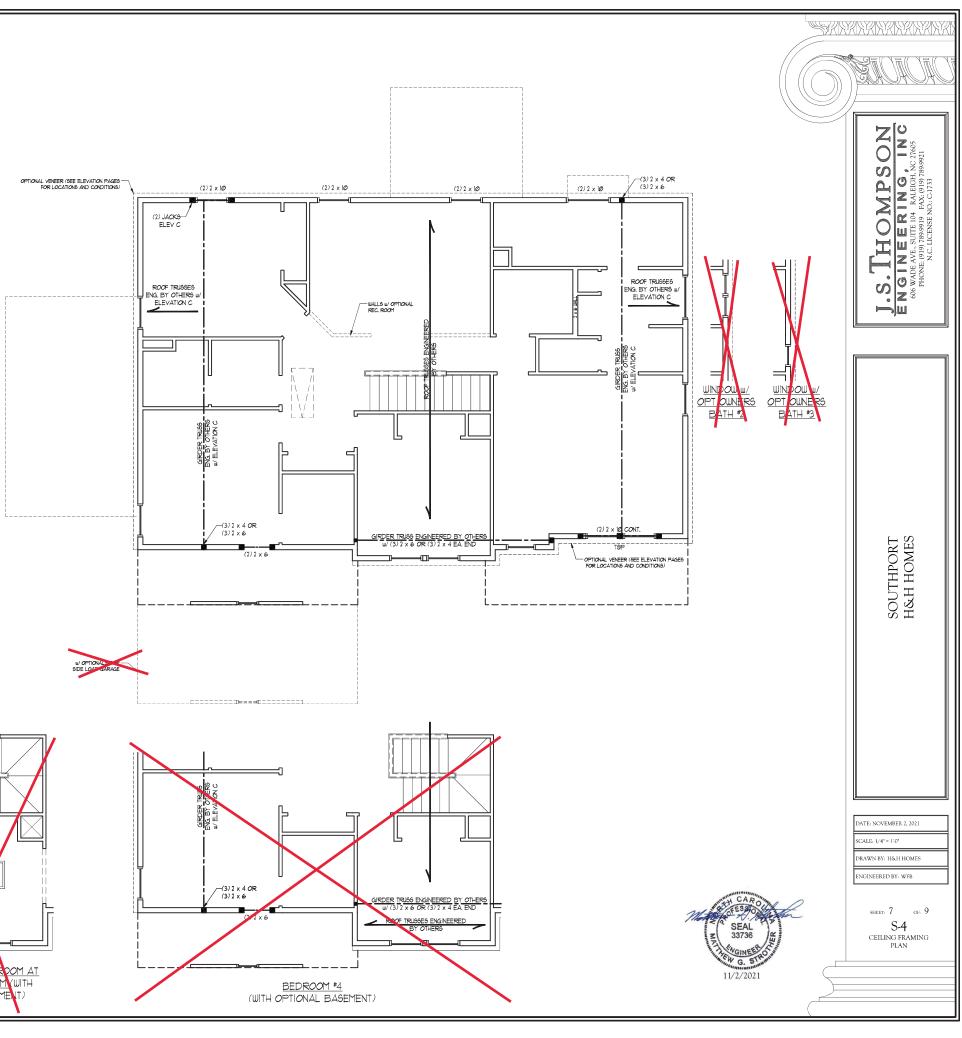

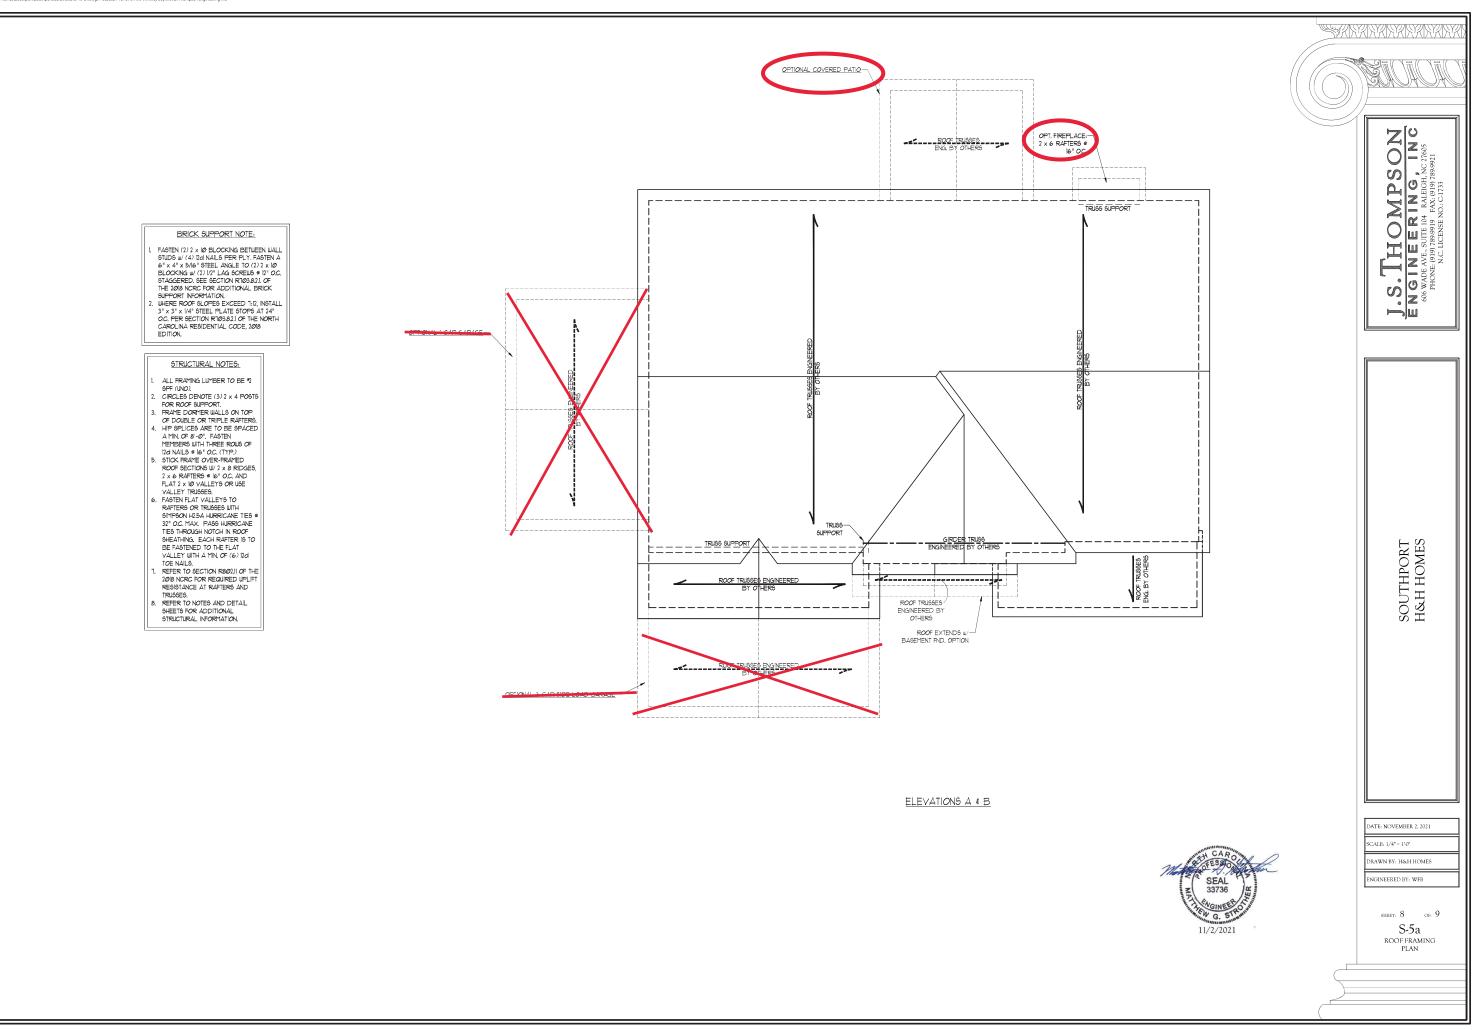

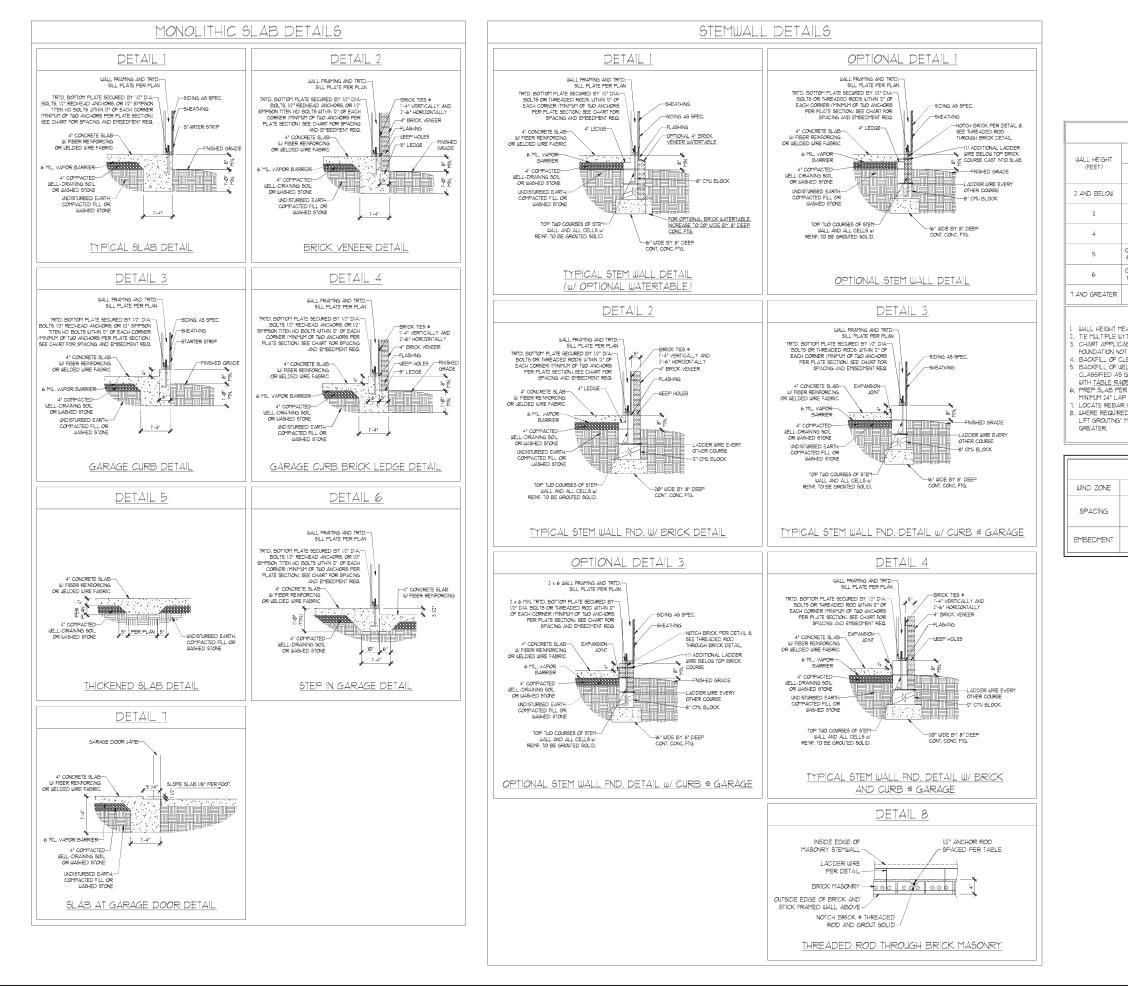

MASONRY S s" cmu ungrouted ungrouted grout solid srout solid w' <sup>44</sup> REBAR = 36" OC.	TEMWALL SPE MASONRY 4" BRICK AND 4" CMU GROUT SOLID GROUT SOLID GROUT SOLID GROUT SOLID W/ 44 REBAR © 48" O.C. NOT APPLICABLE	ECIFICATIONS WALL TYPE 4" BRICK AND 8" CMU UNGROUTED UNGROUTED GROUT SOLID GROUT SOLID W <sup>44</sup> REBAR © 36" OC.	12" CMU UNGROUTED UNGROUTED GROUT SOLID W <sup>1</sup> 44 REDAR © 64" OC. GROUT SOLID W <sup>1</sup> 44 REDAR © 64" OC.	S. THOMPSON NGINEERING, INC MOLENE SUITE 104 RALEIGH. NC 27605 PHONE, 019) 7899919 FAX: 019) 7899921 N.C. LICENSE NO.: C.1733
GROUT SOLID w/ *4 REBAR @ 24" O.C. ENG	NOT APPLICABLE	GROUT SOLID W/ *4 REBAR @ 24" O.C. SED ON SITE CONDITIO	GROUT SOLID w/ *4 REBAR © 64" O.C. ONS	
THE® TOGETHER WIT THE® TOGETHER WIT THE FOR HOUSE FOL COMMON TO HOUSE EAN \$51 / \$1 WASHE LL DRAINED OR \$44 AROUP 1 ACCORDING AROUP 1 ACCORDING SPLICE LENGTH. IN CENTER OF FOLNIC O, FILL BLOCK \$0LIT	: ID STONE IS ALLOWA ID - GRAVEL MIXTUR TO UNIFIED SOILS C RNATIONAL RESIDENT 22 BASE OF THE 201 DATION WALL. D WITH TYPE "6" MOR D WITH TYPE "6" MOR	5" O.C. VERTICALLY. BULT ENGINEER FOR D	SELOW GRADE) M IN ACCORDANCE WABLE. BIDENTIAL CODE. ROUT. USE OF "LOW	WIND SPEED
ANCHOR SF 120 M 61-0" 7"	1РН 0.С.	EMBEDMENT 130 r 4'-0" 15" INTO M	0.C.	PH ULTIMATE DESIGN WIND SPEEL DUNDATION DETAILS
		1º INTO CA	ACRE IE	120 MPH - 130 MPH ULTIN FOUNDAT
				DATE: NOVEMBER 14, 2018 SCALE: NTS DRAWN BY: JST
	11.e.	EAR O SEAL 33736 MGNEER 1/2/2021	A STREET AND	D-1 FOUNDATION DETAILS

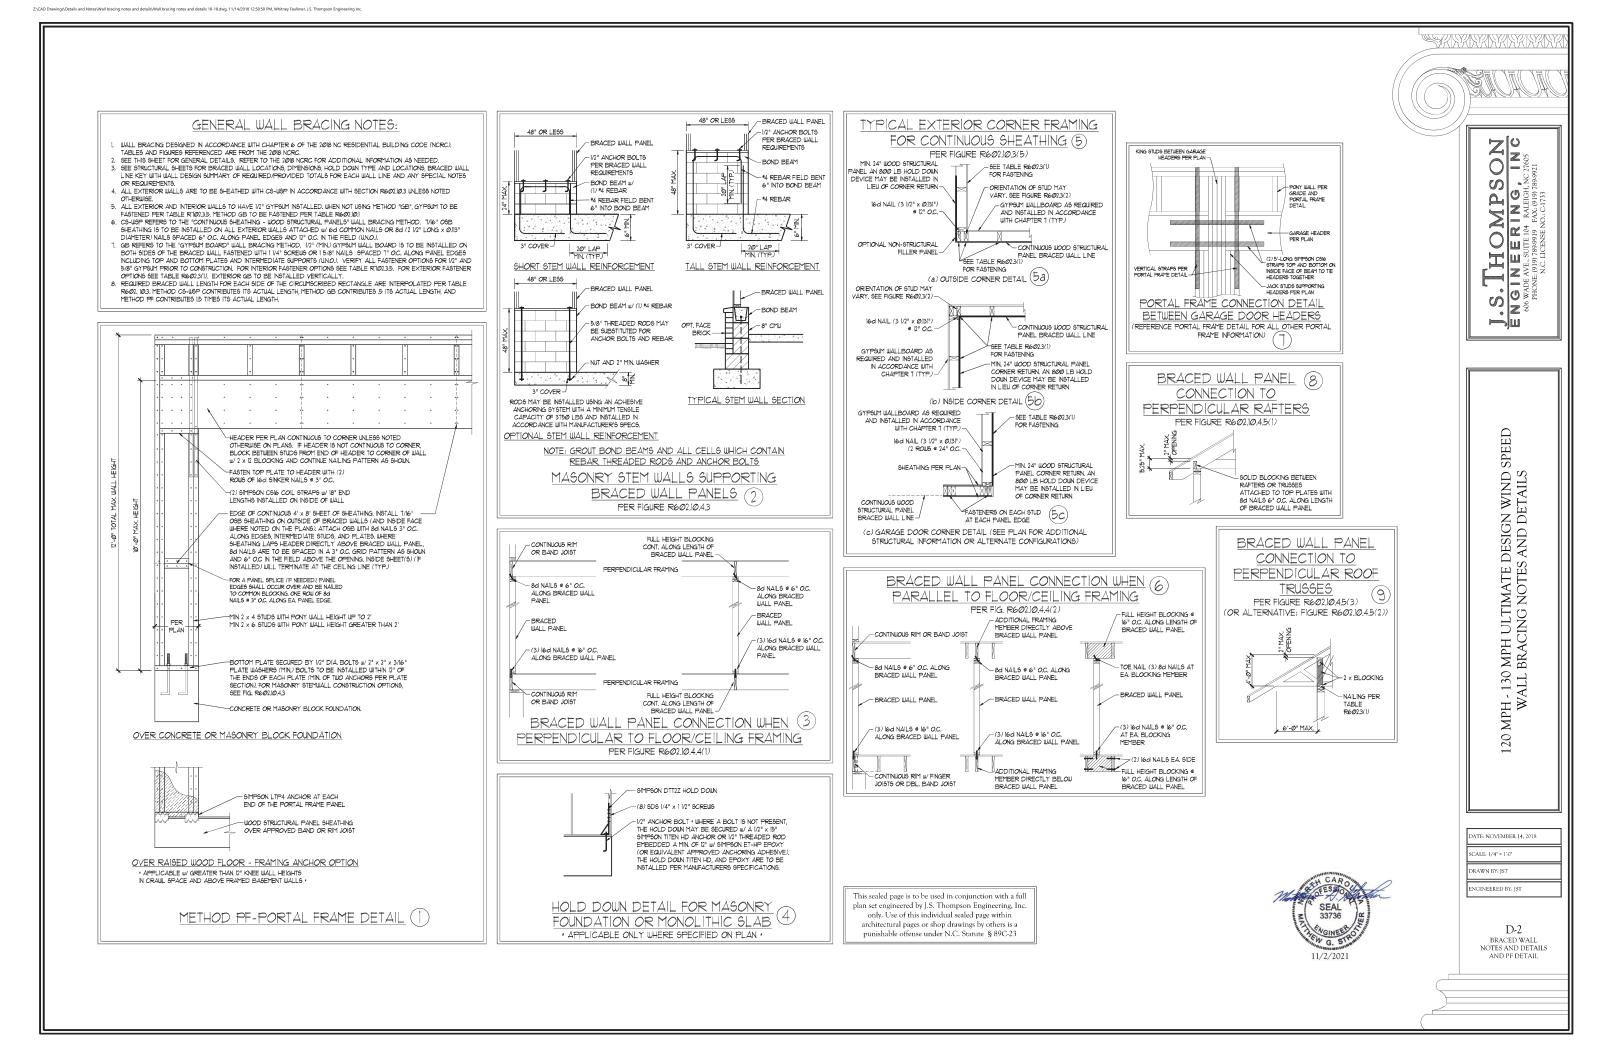

#### GENERAL NOTES

- ENGINEER'S SEAL APPLIES ONLY TO STRUCTURAL COMPONENTS INCLUDING ROOF RAFTERS, HIPS, VALLEYS, RIDGES, FLOORS, WALLS, BEAMS, HEADERS, COLUMNS, CANTILEVERS, OFFET LOAD BEARING WALLS, PIERS, GIRDER'S STEM AND FOOTING. ENGINEER'S SEAL DOES NOT CERTIFY DIMENSIONAL ACCURACY OF ARCHITECTURAL LAYOUT INCLUDING ROOF. ENGINEER'S SEAL DOES NOT APPLY TO I-JOIGT OR FLOOR/ROOF TRUSS LAYOUT DESIGN AND ACCURACY.
- 2. ALL CONSTRUCTION SHALL CONFORM TO THE LATEST REQUIREMENTS OF THE NORTH CAROLINA RESIDENTIAL CODE (NCRC), 20/8 EDITION, PLUS ALL LOCAL CODES AND REGULATIONS. THE STRUCTURAL ENGINEER IS NOT RESPONSIBLE FOR, AND WILL NOT HAVE CONTROL OF, CONSTRUCTION MEANS, METHODS, TECHNIQUES, SEQUENCES OR PROCEDURES, OR SAFETY PRECAUTIONS AND PROGRAMS IN CONNECTION WITH THE CONSTRUCTION WORK. NOR WILL THE ENGINEER BE RESPONSIBLE FOR THE CONTRACTORS FAILURE TO CARRY OUT THE CONSTRUCTION WORK IN ACCORDANCE WITH THE CONTRACT DOCUMENTS.
- 3. STRUCTURAL DESIGN BASED ON THE PROVISIONS OF THE NCRC, 2018 EDITION (R301.4 R301.7)

DESIGN CRITERIA:	LIVE LOAD (PSF)	DEAD LOAD (PSF)	DEFLECTION (IN)
ATTIC WITH LIMITED STORAGE	2Ø	10	L/240 (L/360 w/ BRITTLE FINISHES)
ATTIC WITHOUT STORAGE	10	10	L/36Ø
DECKS	4Ø	Ø	L/360
EXTERIOR BALCONIES	40	10	L/36Ø
FIRE ESCAPES	40	10	L/36Ø
HANDRAILS/GUARDRAILS	200 LB OR 50 (PLF)	Ø	L/36Ø
PASSENGER VEHICLE GARAGE	5Ø	Ø	L/360
ROOMS OTHER THAN SLEEPING ROOM	40	1Ø	L/360
SLEEPING ROOMS	3Ø	10	L/36Ø
STAIRS	4Ø	Ø	L/36Ø
WIND LOAD	(BASED ON TABLE R3012(-	4) WIND ZONE AND EXPOSURE)	
GROUND SNOW LOAD: Pg	20 (PSF)		

- 1-JOIST SYSTEMS DESIGNED WITH 12 PSF DEAD LOAD AND DEFLECTION (IN) OF L/480 - FLOOR TRUSS SYSTEMS DESIGNED WITH 15 PSF DEAD LOAD

- 4. FOR 115 AND 120 MPH WIND ZONES, FOUNDATION ANCHORAGE 15 TO COMPLY WITH SECTION R403.16 OF THE NCRC, 2018 EDITION, FOR 130 MPH, 140 MPH, AND 150 MPH WIND ZONES, FOUNDATION ANCHORAGE 15 TO COMPLY WITH SECTION 4504 OF THE NCRC, 2018 EDITION.
- 5. ENERGY EFFICIENCY COMPLIANCE AND INSULATION VALUES OF THE BUILDING TO BE IN ACCORDANCE WITH CHAPTER II OF THE NGRC, 2018 EDITION.

#### FOOTING AND FOUNDATION NOTES

- 1. FOUNDATION DESIGN BASED ON A MINIMUM ALLOUIABLE BEARING CAPACITY OF 2000 PSF. CONTACT GEOTECHNICAL ENGINEER IF BEARING CAPACITY IS NOT ACHIEVED.
- 2. FOR ALL CONCRETE 9LABS AND FOOTINGS, THE AREA WITHIN THE FREMETIER OF THE BUILDING ENVELOPE 9HALL HAVE ALL VEGETATION, TOP SOIL AND FOREIGN MATERIAL, REMOVED, FILL MATERIAL SHALL BE FREE OF VEGETATION AND FOREIGN MATERIAL. THE FILL SHALL BE COMPACTED TO ASSUME WIFORT SUPPORT OF THE \$LAB, AND EXCEPT WHERE APPROVED, THE FILL DEPTHS 9HALL NOT EXCEED 24 FOR CLEAN SAND OR GRAVEL. A 4' THICK BASED COURSE CONSISTING OF CLEAN GRADED SAND OR GRAVE. SHALL BE PLACED, A BASE COURSE! IS NOT RECURRED WHERE A CONCRETE \$LAB IS INSTALLED ON WELL-DRANED OR SAND. GRAVE. MALL BE PLACED, A BASE GROUP 1, ACCORDING TO THE UNITED SOIL CLASSFICATION SYSTEM IN ACCORDANCE WITH TABLE R4051 OF THE NCRC, 2018 EDITION.
- 3. PROPERLY DEWATER EXCAVATION FRIOR TO POURING CONCRETE WHEN BOTTOM OF CONCRETE SLAB IS AT OR BELOW WATER TABLE. IF APPLICABLE, 344 - I' DEEP CONTROL JOINTS ARE TO BE SAWED WITHIN 4 TO 12 HOURS OF CONCRETE FINISHING AND WALL LOCATIONS HAVE BEEN MARKED. ADJUST WHERE NECESSARY.
- 4. CONCRETE SHALL CONFORM TO SECTION READ/2 OF THE NORC 2018 EDITION. CONCRETE REINFORCING STEEL TO BE ASTM A&IS GRADE 68. WELDED WIRE FABRIC TO BE ASTM A/85. MAINTAIN A MINIMUM CONCRETE COVER AROUND RENFORCING STEEL OF 3" IN FOOTINGS AND 11/2" IN SLABS. FOR FORKED CONCRETE WALLS, CONCRETE COVER FOR REINFORCING STEEL MEASURED FROM THE UNDEF ACE OF THE WALL SHALL NOT BE LESS THAN 3/4". CONCRETE WALLS, CONCRETE COVER FOR REINFORCING STEEL MEASURED FROM THE UNDEF FACE OF THE WALL SHALL NOT BE LESS THAN 1/3" FOR % SARS OF SHALLES, AND NOT LESS THAN 3"FOR YEARSED RECHT THE OUTIDE FACE OF THE WALL SHALL NOT BE LESS THAN 1/3" FOR % SARS OF SHALLES, AND NOT LESS THAN 3"FOR % BARS OR LARGER.
- MASONRY UNITS TO CONFORM TO ACE 530/ASCE 5/TMS 402. MORTAR SHALL COMFORM TO ASTM C210.
- 6. THE UNSUPPORTED HEIGHT OF MASONRY PIERS SHALL NOT EXCEED FOUR TIMES THEIR LEAST DIMENSION FOR INFILLED HOLLOW CONCRETE MASONRY UNITS AND TEN TIMES THEIR LEAST DIMENSION FOR SOLID OR SOLID FILLED PIERS, PERS MAY BE FILLED SOLID WITH CONCRETE OR TITE M OR 5 MORTAR. PIERS AND WALLS SHALL BE CAPPED WITH & OR 50LID MASONRY.
- THE CENTER OF EACH OF THE PIERS SHALL BEAR IN THE MIDDLE THIRD OF ITS RESPECTIVE FOOTING, EACH GIRDER SHALL BEAR IN THE MIDDLE THIRD OF THE PIERS.
- 8. ALL CONCRETE AND MAGONRY FOUNDATION WALLS ARE TO BE CONSTRUCTED IN ACCORDANCE WITH THE PROVISIONS OF SECTION R404 OF THE NCRC, 208 EDITION OR IN ACCORDANCE WITH ACI 38, ACI 332, NCMA TR66-A OR ACE 530/ASCE 5/TH5 402, MAGONRY FOUNDATION WALLS ARE TO BE REINFORCED PER TABLE R404.1(1), R404.1(2), R404.1(3), OR R404.1(4) OF THE NCRC, 208 EDITION, CONCRETE FOUNDATION WALLS ARE TO BE REINFORCED PER TABLE R404.1(5), OF THE NCRC, 208 EDITION, STEP CONCRETE FOUNDATION WALLS TO 2 × 6 FRAMED WALLS AT 16" OC, WHERE GRADE FERMITS (MO).

FRAMING NOTES

- ALL FRAMING LUMBER SHALL BE 12 SPF MINIMUM (Fo = 815 PSI, Fv = 315 PSI, F = 1600000 PSI) UNLESS NOTED OTHERWISE (UNO). ALL TREATED LUMBER SHALL BE 12 SYP MINIMUM (Fo = 315 PSI, Fv = 115 PSI, E = 1600000 PSI) UNLESS NOTED OTHERWISE (UNO).
- 3. STRUCTURAL STEEL SHALL CONFORM TO THE FOLLOWING ASTM SPECIFICATIONS

A.	W AND WT SHAPES:	ASTM A992
B.	CHANNELS AND ANGLES:	ASTM A36
С.	PLATES AND BARS:	ASTM A36
D.	HOLLOW STRUCTURAL SECTIONS:	ASTM A500 GRADE B

- E. STEEL PIPE: ASTM A53, GRADE B, TYPE E OR S
- 4. STEEL BEAMS SHALL BE SUPPORTED AT EACH END WITH A MINIMUM BEARING LENGTH OF 3 1/2" AND FULL FLANGE WIDTH (UNO). PROVIDE SOLID BEARING FROM BEAM SUPPORT TO FOUNDATION. BEAMS SHALL BE ATTACHED AT THE BOTTOM FLANGE TO EACH SUPPORT AS FOLLOWS (UNO).

A, WOOD FRAMING:	(2) 1/2" DIA, x 4" LONG LAG SCREWS
B. CONCRETE	(2) 1/2" DIA, x 4" WEDGE ANCHORS
C. MASONRY (FULLY GROUTED)	(2) 1/2" DIA. x 4" LONG SIMPSON TITEN HD ANCHORS

LATERAL SUPPORT IS CONSIDERED ADEQUATE PROVIDING THE JOISTS ARE TOE NAILED TO THE 2X NAILER ON TOP OF THE STEEL BEAM, AND THE 2X NAILER IS SECURED TO THE TOP OF THE STEEL BEAM W (2) ROUS OF SELF TAPPING SCREUS & IS" OC. OR (2) ROUS OF I/S" DIAMETER BOLTS # IS" OC. IF I/2" BOLTS ARE USED TO FASTEN THE NAILER. THE STEEL BEAM SHALL BE FABRICATED W (2) ROUS OF 9/6" DIAMETER HOLES # IS" OC.

- SQUARES DENOTE POINT LOADS WHICH REQUIRE SOLID BLOCKING TO GIRDER OR FOUNDATION. SHADED SQUARES DENOTE POINT LOADS FROM ABOVE WHICH REQUIRE SOLID BLOCKING TO SUPPORTING MEMBER BELOW.
- 6. ALL LOAD BEARING HEADERS TO CONFORM TO TABLE R602.1(1) AND R602.1(2) OF THE NCRC, 2016 EDITION OR BE (2) 2 × 6 WITH (1) JACK AND (1) KING STUD EACH END (1NO), WHICHEVER 16 GREATER ALL HEADERS TO BE SECURED TO EACH JACK STUD WITH (4) 8d NAILS, ALL BEAMS TO BE SUPPORTED WITH (2) STUDS AT EACH BEARING POINT (UNO). INSTALL KING STUDS PER SECTION R602.15 OF THE NORTH CARCUNA RESIDENTIAL CODE, 2018 EDITION.
- ALL BEAMS, HEADERS, OR GIRDER TRUSSES PARALLEL TO WALL ARE TO BEAR FULLY ON (1) JACK OR (2) STUDS MINIMUM OR THE NUMBER OF JACKS OR STUDS NOTED. ALL BEAMS OR GIRDER TRUSSES PERPENDICULAR TO WALL AND SUPPORTED BY (3) STUDS OR LESS ARE TO HAVE 11/2" MINIMUM BEARING (UNO). ALL BEAMS OR GIRDER TRUSSES PERPENDICULAR TO WALL AND SUPPORTED BY MORE THAN (3) STUDS OR OTHER NOTED COLUMN ARE TO BEAR FULLY ON SUPPORT COLUMN FOR ENTIRE WALL DEPTH (UNO). BEAM ENDS THAT BUTT INTO ONE ANOTHER ARE TO EACH BEAR EQUAL LENGTHS (UNO).
- FLITCH BEAY'S SHALL BE BOLTED TOGETLERE USING 1/2" DIAMETER BOLTS (ASTM A3/01) WITH WASHERS PLACED AT THREADED END OF BOLT. BOLTS SHALL BE SPACED AT 24" CENTERS (MAXIMUM), AND STAGGERED AT TOP AND BOTTOM OF BEAM (2" EDGE DISTANCE), WITH (2) BOLTS LOCATED AT 6" FROM EACH END (MO).
- 9. ALL I-JOIGT OR TRUGG LAYOUTS ARE TO BE IN COMPLIANCE WITH THE OVERALL DESIGN SPECIFIED ON THE PLANS. ALL DEVIATIONS ARE TO BE BROUGHT TO THE ATTENTION OF THE ENGINEER OF RECORD PRIOR TO INSTALLATION.
- 10. BRACED WALL PANELS SHALL BE CONSTRUCTED ACCORDING TO THE NORTH CAROLINA RESIDENTIAL CODE 2016 EDITION WALL BRACING CRITERIA. THE AMOUNT, LENGTH, AND LOCATION OF BRACING SHALL COMPLY WITH ALL APPLICABLE TABLES IN SECTION R602.10.
- II. PROVIDE DOUBLE JOIST UNDER ALL WALLS PARALLEL TO FLOOR JOISTS. PROVIDE SUPPORT UNDER ALL WALLS PARALLEL TO FLOOR TRUSSES OR I-JOISTS FER MANUFACTURER'S SPECIFICATIONS. INSTALL BLOCKING BETWEEN JOISTS OR TRUSSES FOR POINT LOAD SUPPORT FOR ALL POINT LOADS ALONG OFFET LOAD LINES.
- 12. FOR ALL HEADERS SUPPORTING BRICK VENEER THAT ARE LESS THAN 8 "0" IN LENGTH, REST A 6" x 4" x 5/6" STEEL ANGLE WITH 6" MINIMUM EMBEDMENT AT SIDES FOR BRICK SUPPORT (UNIO). FOR ALL HEADERS 8"0" AND GREATER IN LENGTH, BOLT A 6" x 4" x 5/6" STEEL ANGLE TO HEADER WITH 1/2" LAG SCREWS AT 12" OC. STAGGERED FOR BRICK SUPPORT. FOR ALL BRICK SUPPORT AT ROOF LINES, BOLT A 6" x 4" x 5/6" STEEL ANGLE TO (2) 2 x 10 BLOCKING INSTALLED u/ (4) /20 INALS EA PLY BETWEEN WALL STUDES WITH (2) ROUS OF 1/2" LAG SCREWS AT 12" OC. STAGGERED AND IN ACCORDANCE WITH SECTION RT03821 OF THE NCRC, 2018 EDITION.
- 13. FOR STICK FRAMED ROOFS: CIRCLES DENOTE (3) 2 × 4 POSTS FOR ROOF MEMBER SUPPORT. HIP SPLICES ARE TO BE SPACED A MINIMUM OF 8'-0'. FASTEN YEMPERS WITH THREE ROUS OF 12d NAILS AT 16" O.C. FRAME DORMER WALLS ON TOP OF DOUBLE OR TRIPLE RAFTERS AS SHOUN (VINO).
- 14. FOR TRUSSED ROOPS, FRAME DORMER WALLS ON TOP OF 2 × 4 LADDER FRAMING AT 24" OC, BETWEEN ADJACENT ROOP TRUSSES, STICK FRAME OVER-FRAMED ROOP SECTIONS WITH 2 × 8 RIDGES, 2 × 6 RAFTERS AT 16" OC, AND FLAT 2 × 10 VALLEYS (UNO).

ALL 4 × 4 AND 6 × 6 POSTS TO BE INSTALLED WITH 100 LB CAPACITY UPLIFT CONNECTORS TOP AND BOTTOM (UNO) POSTS MAY BE SECURED USING ONE SIMPSON H& OR LTSU UPLIFT CONNECTOR FASTENED TO THE BAND AT THE BOTTOM AND THE BEAM AT THE TOP OF EACH POST. ONE IS' SECTION OF SIMPSON CSIG COLL STRAPPING WITH (8) 8d HDG NALLS AT EACH END MAY BE USED IN LIEU OF EACH TWIST STRAP IF DESIRED. FOR MASONRY OR CONCRETE FOUNDATION USE SIMPSON POST BASE.

This sealed page is to be used in conjunction with a full plan set engineered by J.S. Thompson Engineering, Inc. only. Use of this individual sealed page within architectural pages or shop drawings by others is a punishable offense under N.C. Statute § 89C-23

15,

