

Trenco
818 Soundside Rd
Edenton, NC 27932

Re: Master_Farmhouse
Mattamy; Shenandoah

The truss drawing(s) referenced below have been prepared by Truss Engineering Co. under my direct supervision based on the parameters provided by Builders FirstSource-Apex,NC.

Pages or sheets covered by this seal: I48785699 thru I48785717

My license renewal date for the state of North Carolina is December 31, 2021.

North Carolina COA: C-0844



November 13,2021

Johnson, Andrew

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

Job	Truss	Truss Type	Qty	Ply	Mattamy; Shenandoah	148785699
MASTER_FARMHOUSE	A01	COMMON	1	1		


Builders FirstSource (Apex, NC), Apex, NC - 27523,

8.430 s Aug 16 2021 MiTek Industries, Inc. Fri Nov 12 10:53:28 2021 Page 1

ID:x1XjwWBLqE?VCRreTaQN3tymvXu-W7NpHNuU1xg1ogsxW6axMqiXxv7bzO1z0KB20yJy1r

1-0-0	6-6-5	12-9-3	19-0-0	25-2-13	31-5-11	38-0-0	39-0-0
1-0-0	6-6-5	6-2-13	6-2-13	6-2-13	6-2-13	6-6-5	1-0-0

Scale = 1:72.8

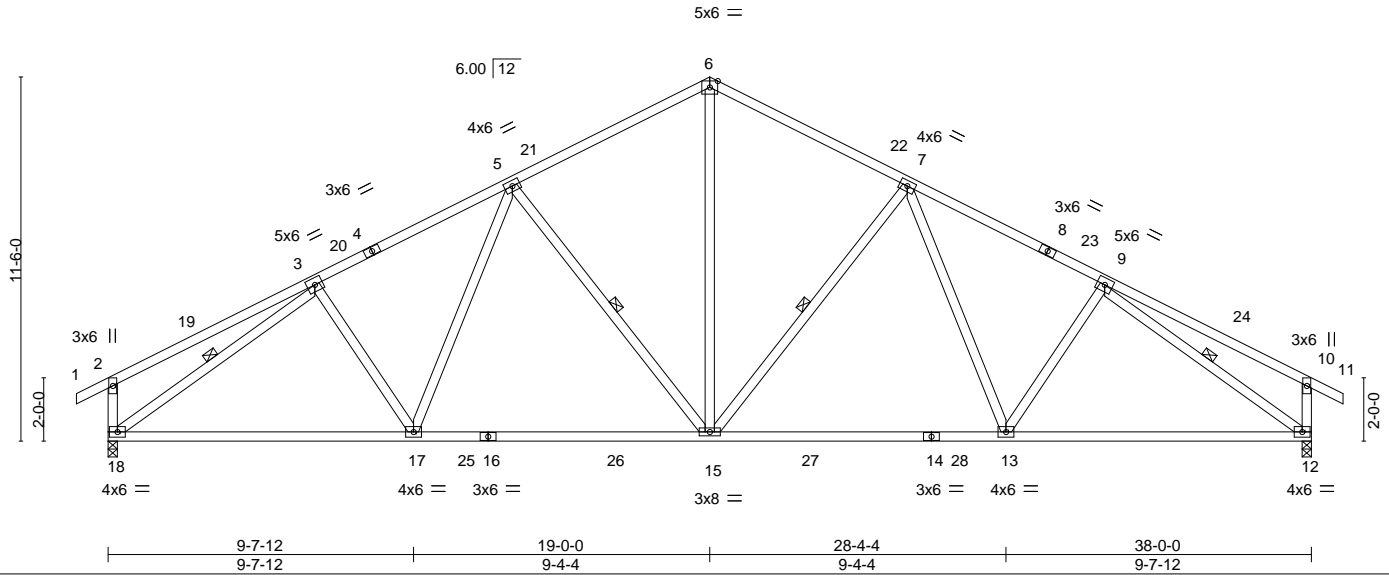

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.56	Vert(LL)	-0.25 13-15	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.95	Vert(CT)	-0.42 12-13	>999	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.69	Horz(CT)	0.09 12	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MS	Wind(LL)	0.05 15-17	>999	240	Weight: 238 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 3-11-8 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2 *Except* 14-16: 2x4 SP No.1	BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing.
WEBS 2x4 SP No.3	WEBS 1 Row at midpt 7-15, 9-12, 5-15, 3-18

REACTIONS. (size) 18=0-3-8, 12=0-3-8
 Max Horz 18=148(LC 10)
 Max Grav 18=1577(LC 1), 12=1577(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-18=-323/137, 3-5=-1927/139, 5-6=-1546/184, 6-7=-1546/184, 7-9=-1927/139, 10-12=-323/137
 BOT CHORD 17-18=-44/1634, 15-17=-6/1598, 13-15=0/1587, 12-13=-30/1626
 WEBS 6-15=-45/1030, 7-15=-528/112, 7-13=-12/286, 9-12=-1901/32, 5-15=-528/112, 5-17=-11/286, 3-18=-1901/32

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -1-0-0 to 2-9-10, Interior(1) 2-9-10 to 19-0-0, Exterior(2) 19-0-0 to 24-4-8, Interior(1) 24-4-8 to 39-0-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.



November 13, 2021


<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	<p>ENGINEERING BY</p> <p>TRENCO</p> <p>A MiTek Affiliate</p> <p>818 Soundside Road Edenton, NC 27932</p>
--	---

Job	Truss	Truss Type	Qty	Ply	Mattamy; Shenandoah
MASTER_FARMHOUSE	A01A	COMMON	6	1	148785700
					Job Reference (optional)

Builders FirstSource (Apex, NC), Apex, NC - 27523, 8.430 s Aug 16 2021 MiTek Industries, Inc. Fri Nov 12 10:53:29 2021 Page 1
 ID:x1XjjwWBLqE?VCRreTaQN3tymvXu_-JxBUjv6oFouQqR74p5Av2FiiJTtir5ABg4kbSyJy1q



Scale = 1:72.0

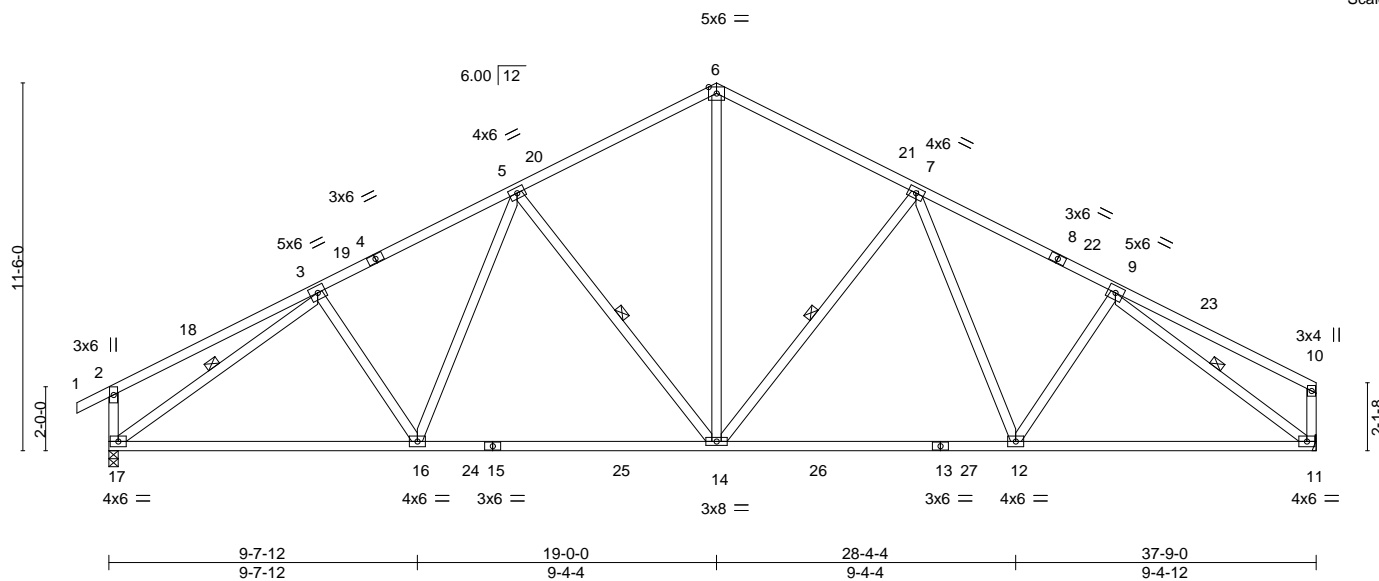


LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)		l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.56	Vert(LL) -0.25	14-16	>999	360		MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.95	Vert(CT) -0.42	16-17	>999	240			
BCLL 0.0 *	Rep Stress Incr YES	WB 0.69	Horz(CT) 0.09	11	n/a	n/a			
BCDL 10.0	Code IRC2015/TPI2014	Matrix-MS	Wind(LL) 0.05	14-16	>999	240		Weight: 236 lb	FT = 20%

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2	TOP CHORD	Structural wood sheathing directly applied or 3-11-10 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2 *Except* 13-15: 2x4 SP No.1	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 2-2-0 oc bracing: 16-17.
WEBS	2x4 SP No.3	WEBS	1 Row at midpt 7-14, 9-11, 5-14, 3-17

REACTIONS. (size) 17=0-3-8, 11=Mechanical
 Max Horz 17=153(LC 11)
 Max Grav 17=1568(LC 1), 11=1497(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-17=-323/137, 3-5=-1913/138, 5-6=-1529/183, 6-7=-1529/185, 7-9=-1886/144
 BOT CHORD 16-17=-75/1618, 14-16=-37/1579, 12-14=-18/1559, 11-12=-66/1572
 WEBS 6-14=-45/1015, 7-14=-509/112, 7-12=-13/261, 9-11=-1904/69, 5-14=-529/112,
 5-16=-11/287, 3-17=-1887/31

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -1-0-0 to 2-9-10, Interior(1) 2-9-10 to 19-0-0, Exterior(2) 19-0-0 to 24-4-8, Interior(1) 24-4-8 to 37-7-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Refer to girder(s) for truss to truss connections.

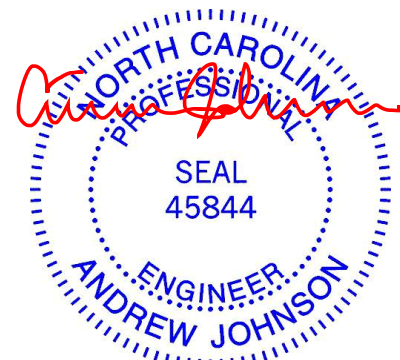

November 13, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932


Job MASTER_FARMHOUSE	Truss A01AT	Truss Type COFFER	Qty 5	Ply 1	Mattamy; Shenandoah 148785701
-------------------------	----------------	----------------------	----------	----------	----------------------------------

Builders FirstSource (Apex, NC),

Apex, NC - 27523,

8.430 s Aug 16 2021 MiTek Industries, Inc. Fri Nov 12 10:53:31 2021 Page 1

ID:x1XjwWBLqE?VCRreTaQN3tymvXu-wi3yvPwMKs3cf8bWBE8e_TK1h7CiAlwTf_ZrfLyJy1o



Scale = 1:76.0


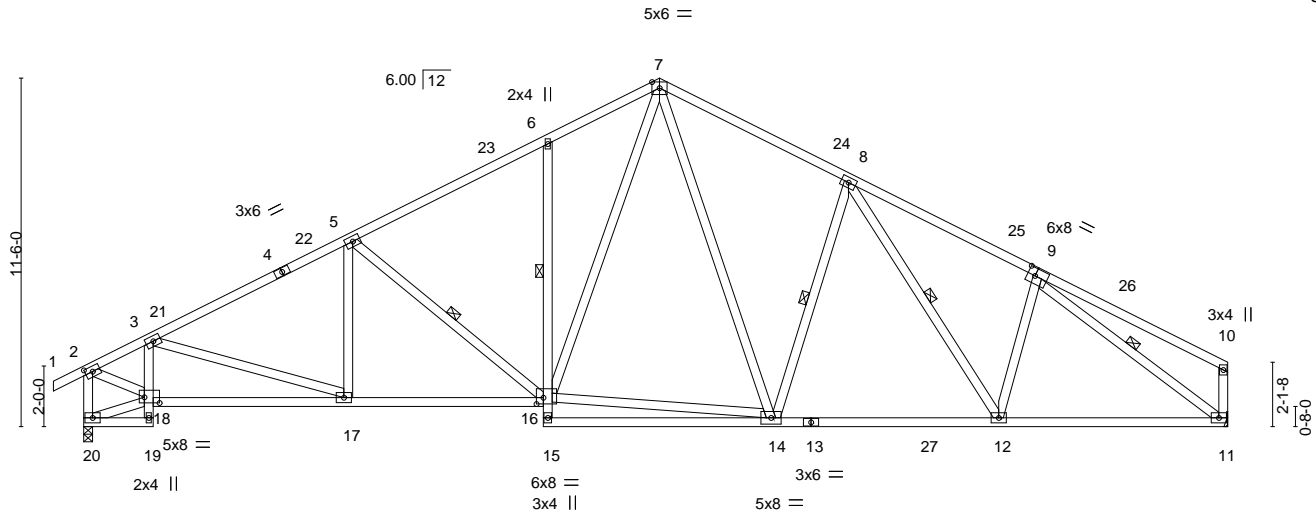


Plate Offsets (X,Y)-- [2:0-2-15,0-2-0], [9:0-3-0,0-3-0], [16:0-2-12,0-2-8], [18:0-6-0,0-2-4]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.53	Vert(LL)	-0.18 12-14	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.73	Vert(CT)	-0.29 12-14	>999	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.67	Horz(CT)	0.11 11	n/a	n/a		
BCDL 10.0	Code IRC2015/TP12014		Matrix-MS	Wind(LL)	0.05 16-17	>999	240	Weight: 266 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 3-5-13 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2 *Except* 3-19,6-15: 2x4 SP No.3	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing. Except: 1 Row at midpt 6-16
WEBS 2x4 SP No.3	WEBS 1 Row at midpt 5-16, 8-14, 8-12, 9-11

REACTIONS. (size) 11=Mechanical, 20=0-3-8
Max Horz 20=153(LC 9)
Max Grav 11=1497(LC 1), 20=1568(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1530/79, 3-5=-2201/108, 5-6=-1854/156, 6-7=-1802/234, 7-8=-1701/203,
8-9=-1879/167, 2-20=-1521/93
BOT CHORD 3-18=-694/80, 17-18=-104/1427, 16-17=-53/1893, 6-16=-317/138, 12-14=-17/1559,
11-12=-56/1590
WEBS 3-17=0/490, 5-16=-446/86, 14-16=0/1131, 7-16=-102/845, 7-14=-54/564, 8-14=-453/143,
9-11=-1933/44, 2-18=-37/1547

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -1-0-0 to 2-9-10, Interior(1) 2-9-10 to 19-0-0, Exterior(2) 19-0-0 to 24-4-8, Interior(1) 24-4-8 to 37-7-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) All plates are 4x6 MT20 unless otherwise indicated.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 6) Refer to girder(s) for truss to truss connections.



November 13, 2021

Job	Truss	Truss Type	Qty	Ply	Mattamy; Shenandoah	148785702
MASTER_FARMHOUSE	A01G	GABLE	2	1	Job Reference (optional)	

Builders FirstSource (Apex, NC),


Apex, NC - 27523,

8.430 s Aug 16 2021 MiTek Industries, Inc. Fri Nov 12 10:53:33 2021 Page 1

ID:x1XjwWBLqE?VCRReTaQN3tymvXu-s4BiK5ycsTJKuSivJfA63uPSlw2wenym6l2ykDyJy1m



Scale = 1:72.0

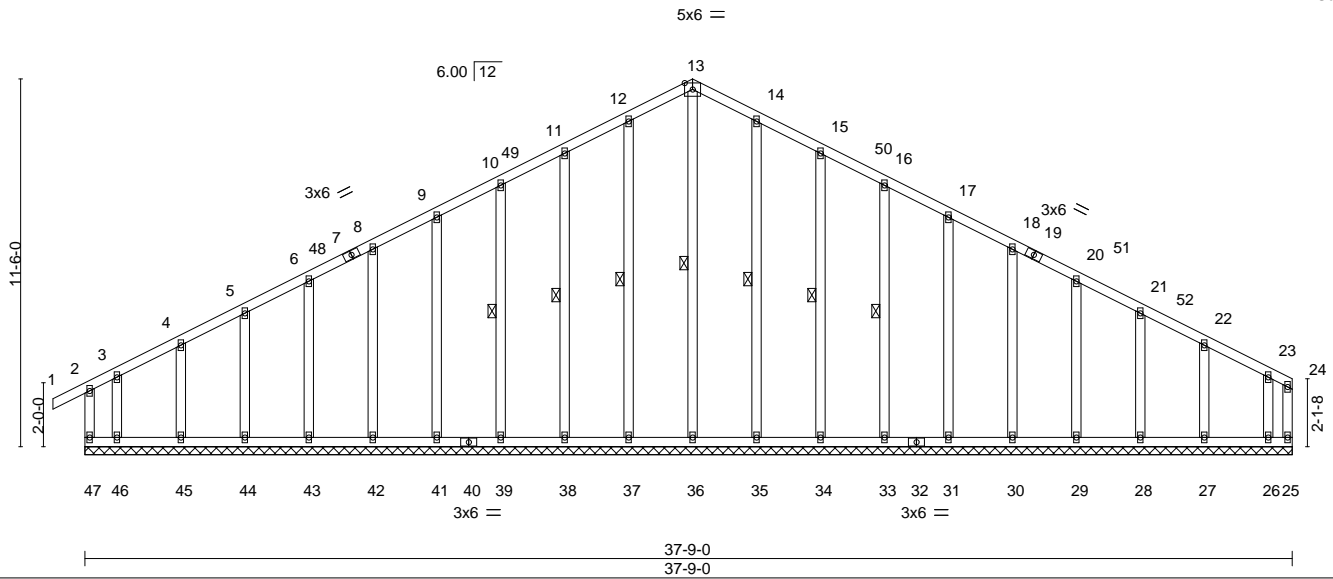

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.20	Vert(LL)	-0.00	1	n/r	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.11	Vert(CT)	-0.00	1	n/r		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.12	Horz(CT)	-0.00	25	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-R					Weight: 301 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 WEBS 2x4 SP No.3
 OTHERS 2x4 SP No.3

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
 WEBS 1 Row at midpt 13-36, 12-37, 11-38, 10-39, 14-35, 15-34, 16-33

REACTIONS. All bearings 37-9-0.
 (lb) - Max Horz 47=153(LC 9)
 Max Uplift All uplift 100 lb or less at joint(s) 38, 39, 41, 42, 43, 44, 45, 34, 33, 31, 30, 29, 28, 27 except 47=163(LC 8), 25=191(LC 11), 46=191(LC 9), 26=179(LC 8)
 Max Grav All reactions 250 lb or less at joint(s) 47, 25, 36, 37, 38, 39, 41, 42, 43, 44, 45, 46, 35, 34, 33, 31, 30, 29, 28, 27, 26

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 12-13=-125/271, 13-14=-125/266

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -1-0-0 to 3-0-0, Interior(1) 3-0-0 to 19-0-0, Exterior(2) 19-0-0 to 24-4-8, Interior(1) 24-4-8 to 37-7-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 38, 39, 41, 42, 43, 44, 45, 34, 33, 31, 30, 29, 28, 27 except (jt=lb) 47=163, 25=191, 46=191, 26=179.



November 13, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932


Job MASTER_FARMHOUSE	Truss A01T	Truss Type COFFER	Qty 1	Ply 1	Mattamy; Shenandoah	148785703
-------------------------	---------------	----------------------	----------	----------	---------------------	-----------

Builders FirstSource, Apex, NC 27523

ID: x1XjjwWBLqE?VCRreTaQN3tymvXu-0VRdQKQVQRO5ZukUIITLNqbiUXtq7EJl85ZSfDyJvCc
8.430 s Aug 16 2021 MITek Industries, Inc. Fri Nov 12 14:06:47 2021 Page 1



Scale = 1:76.3

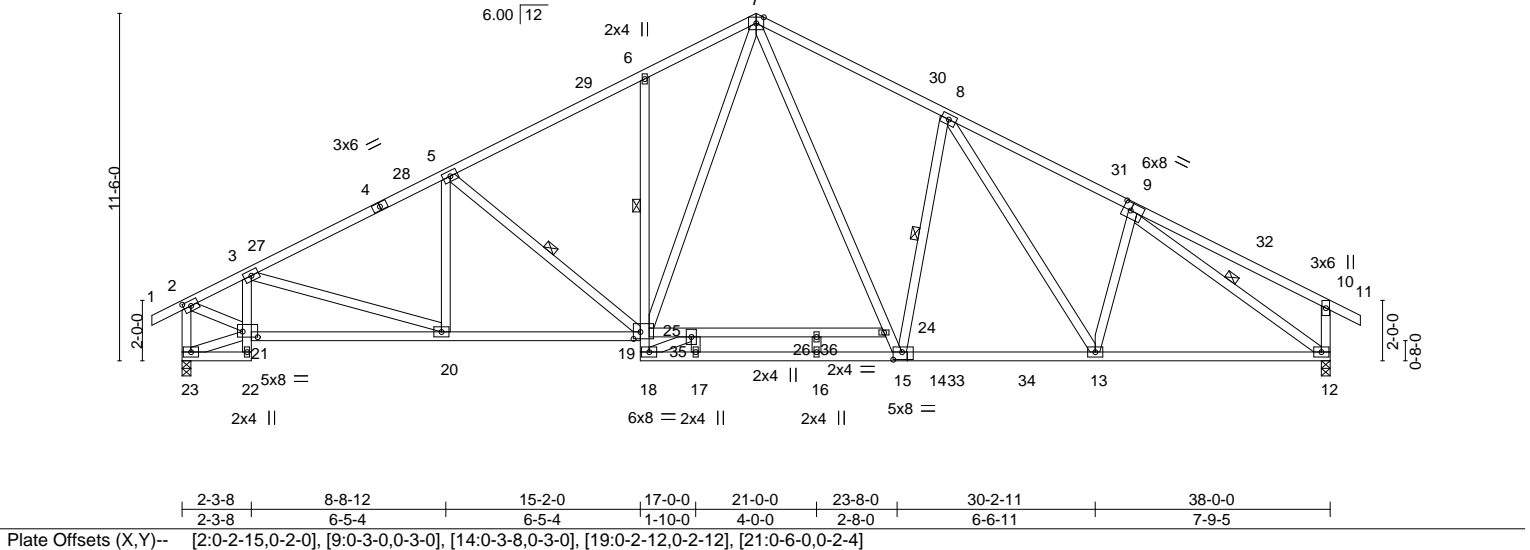

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.64	Vert(LL)	-0.17	16-17	>999	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.85	Vert(CT)	-0.30	19-20	>999		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.75	Horz(CT)	0.16	12	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MS	Wind(LL)	0.07	19-20	>999		
								Weight: 273 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 3-5-8 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2 *Except* 3-22,6-18: 2x4 SP No.3	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing. Except: 1 Row at midpt 6-19
WEBS 2x4 SP No.3 *Except* 19-24: 2x4 SP No.2	WEBS 1 Row at midpt 5-19, 8-15, 9-12

REACTIONS. (size) 12=0-3-8, 23=0-3-8
Max Horz 23=-148(LC 10)
Max Grav 12=1577(LC 1), 23=1577(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1538/68, 3-27=-2220/68, 4-27=-2202/85, 4-28=-2102/92, 5-28=-2061/104,
5-29=-1864/139, 6-29=-1733/155, 6-7=-1800/228, 7-30=-1704/213, 8-30=-1782/182,
8-31=-1785/161, 9-31=-1932/131, 2-23=-1529/90, 10-12=-323/144
BOT CHORD 3-21=-703/83, 20-21=-89/1434, 19-20=-19/1910, 18-19=0/501, 6-19=-313/138,
17-18=0/1204, 16-17=0/1204, 15-16=0/1204, 14-15=0/1593, 14-33=0/1593, 33-34=0/1593,
13-34=0/1593, 12-13=-19/1645
WEBS 3-20=0/538, 5-19=-452/86, 7-19=-85/829, 7-24=-75/655, 15-24=-85/676, 8-15=-486/150,
9-12=-1928/6, 2-21=-26/1555, 19-35=0/1140, 25-35=0/1142, 18-25=-1237/0

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -1-0-0 to 2-9-10, Interior(1) 2-9-10 to 19-0-0, Exterior(2) 19-0-0 to 24-4-8, Interior(1) 24-4-8 to 39-0-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - All plates are 4x6 MT20 unless otherwise indicated.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - All bearings are assumed to be User Defined crushing capacity of 565 psi.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - N/A
 - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S)
1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15



November 13, 2021

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MITek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ENGINEERING BY
TRENCO
A MITek Affiliate

818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Mattamy; Shenandoah	148785703
MASTER_FARMHOUSE	A01T	COFFER	1	1	Job Reference (optional)	

Builders FirstSource, Apex, NC 27523

8.430 s Aug 16 2021 MiTek Industries, Inc. Fri Nov 12 14:06:47 2021 Page 2
 ID:x1XjjwWBLqE?VCReTaQN3tymvXu-0VrdQKVCQR05ZukUIITLNgbiUXtq7EJI85ZSfDyJvCc

LOAD CASE(S)

- Uniform Loads (plf)
 Vert: 1-2=-60, 2-7=-60, 7-10=-60, 10-11=-60, 22-23=-20, 19-21=-20, 12-18=-20
- 2) Dead + 0.75 Roof Live (balanced) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-2=-50, 2-7=-50, 7-10=-50, 10-11=-50, 22-23=-20, 19-21=-20, 18-33=-20, 33-34=-50, 12-34=-20, 35-36=-30(F)
- 3) Dead + Uninhabitable Attic Without Storage: Lumber Increase=1.25, Plate Increase=1.25
 Uniform Loads (plf)
 Vert: 1-2=-20, 2-7=-20, 7-10=-20, 10-11=-20, 22-23=-40, 19-21=-40, 12-18=-40, 35-36=-40(F)
- 4) Dead + 0.6 C-C Wind (Pos. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=42, 2-27=22, 7-27=12, 7-30=22, 10-30=12, 10-11=8, 22-23=-12, 19-21=-12, 12-18=-12
 Horz: 1-2=-54, 2-27=-34, 7-27=-24, 7-30=34, 10-30=24, 10-11=20, 2-23=13, 10-12=24
- 5) Dead + 0.6 C-C Wind (Pos. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=8, 2-29=12, 7-29=22, 7-32=12, 10-32=22, 10-11=42, 22-23=-12, 19-21=-12, 12-18=-12
 Horz: 1-2=-20, 2-29=-24, 7-29=-34, 7-32=24, 10-32=34, 10-11=54, 2-23=-24, 10-12=-13
- 6) Dead + 0.6 C-C Wind (Neg. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=-13, 2-7=-32, 7-10=-32, 10-11=-27, 22-23=-20, 19-21=-20, 12-18=-20
 Horz: 1-2=-7, 2-7=12, 7-10=-12, 10-11=-7, 2-23=-15, 10-12=-22
- 7) Dead + 0.6 C-C Wind (Neg. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=-27, 2-7=-32, 7-10=-32, 10-11=-13, 22-23=-20, 19-21=-20, 12-18=-20
 Horz: 1-2=7, 2-7=12, 7-10=-12, 10-11=7, 2-23=22, 10-12=15
- 8) Dead + 0.6 MWFRS Wind (Pos. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=7, 2-7=-3, 7-10=7, 10-11=2, 22-23=-12, 19-21=-12, 12-18=-12
 Horz: 1-2=-19, 2-7=-9, 7-10=19, 10-11=14, 2-23=13, 10-12=16
- 9) Dead + 0.6 MWFRS Wind (Pos. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=2, 2-7=7, 7-10=-3, 10-11=7, 22-23=-12, 19-21=-12, 12-18=-12
 Horz: 1-2=-14, 2-7=-19, 7-10=9, 10-11=19, 2-23=-16, 10-12=-13
- 10) Dead + 0.6 MWFRS Wind (Neg. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=-15, 2-7=-20, 7-10=-10, 10-11=-6, 22-23=-20, 19-21=-20, 12-18=-20
 Horz: 1-2=-5, 2-7=-0, 7-10=10, 10-11=14, 2-23=21, 10-12=7
- 11) Dead + 0.6 MWFRS Wind (Neg. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=-6, 2-7=-10, 7-10=-20, 10-11=-15, 22-23=-20, 19-21=-20, 12-18=-20
 Horz: 1-2=-14, 2-7=-10, 7-10=0, 10-11=5, 2-23=-7, 10-12=-21
- 12) Dead + 0.6 MWFRS Wind (Pos. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=14, 2-28=19, 7-28=9, 7-10=2, 10-11=-3, 22-23=-12, 19-21=-12, 12-18=-12
 Horz: 1-2=-26, 2-28=-31, 7-28=-21, 7-10=14, 10-11=9, 2-23=11, 10-12=12
- 13) Dead + 0.6 MWFRS Wind (Pos. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=-3, 2-7=2, 7-31=9, 10-31=19, 10-11=14, 22-23=-12, 19-21=-12, 12-18=-12
 Horz: 1-2=-9, 2-7=-14, 7-31=21, 10-31=31, 10-11=26, 2-23=-12, 10-12=-11
- 14) Dead + 0.6 MWFRS Wind (Pos. Internal) 3rd Parallel: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=5, 2-7=9, 7-10=2, 10-11=-3, 22-23=-12, 19-21=-12, 12-18=-12
 Horz: 1-2=-17, 2-7=-21, 7-10=14, 10-11=9, 2-23=5, 10-12=12
- 15) Dead + 0.6 MWFRS Wind (Pos. Internal) 4th Parallel: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=-3, 2-7=2, 7-10=9, 10-11=5, 22-23=-12, 19-21=-12, 12-18=-12
 Horz: 1-2=-9, 2-7=-14, 7-10=21, 10-11=17, 2-23=-12, 10-12=-5
- 16) Dead + 0.6 MWFRS Wind (Neg. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=6, 2-28=2, 7-28=-7, 7-10=-15, 10-11=-11, 22-23=-20, 19-21=-20, 12-18=-20
 Horz: 1-2=-26, 2-28=-22, 7-28=-13, 7-10=5, 10-11=9, 2-23=19, 10-12=3
- 17) Dead + 0.6 MWFRS Wind (Neg. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=-11, 2-7=-15, 7-31=-7, 10-31=2, 10-11=6, 22-23=-20, 19-21=-20, 12-18=-20
 Horz: 1-2=-9, 2-7=-5, 7-31=13, 10-31=22, 10-11=26, 2-23=-3, 10-12=-19
- 18) Dead + Uninhabitable Attic Storage: Lumber Increase=1.25, Plate Increase=1.25
 Uniform Loads (plf)
 Vert: 1-2=-20, 2-7=-20, 7-10=-20, 10-11=-20, 22-23=-20, 19-21=-20, 18-33=-20, 33-34=-60, 12-34=-20, 35-36=-40(F)
- 19) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) Left): Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=-46, 2-7=-50, 7-10=-43, 10-11=-39, 22-23=-20, 19-21=-20, 18-33=-20, 33-34=-50, 12-34=-20, 35-36=-30(F)
 Horz: 1-2=-4, 2-7=-0, 7-10=7, 10-11=11, 2-23=16, 10-12=6
- 20) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) Right): Lumber Increase=1.60, Plate Increase=1.60

Continued on page 3

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Mattamy; Shenandoah	I48785703
MASTER_FARMHOUSE	A01T	COFFER	1	1	Job Reference (optional)	

Builders FirstSource, Apex, NC 27523

8.430 s Aug 16 2021 MiTek Industries, Inc. Fri Nov 12 14:06:47 2021 Page 3
 ID:x1XjjwWBLqE?VCRreTaQN3tymvXu-0VRdQKVKQRO5ZukUIITILNqbiUXtq7EJI85ZSfDyJvCc

LOAD CASE(S)

- Uniform Loads (plf)
 - Vert: 1-2=-39, 2-7=-43, 7-10=-50, 10-11=-46, 22-23=-20, 19-21=-20, 18-33=-20, 33-34=-50, 12-34=-20, 35-36=-30(F)
 - Horz: 1-2=-11, 2-7=-7, 7-10=0, 10-11=4, 2-23=-6, 10-12=-16
- 21) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60
 - Uniform Loads (plf)
 - Vert: 1-2=-30, 2-28=-34, 7-28=-41, 7-10=-46, 10-11=-43, 22-23=-20, 19-21=-20, 18-33=-20, 33-34=-50, 12-34=-20, 35-36=-30(F)
 - Horz: 1-2=-20, 2-28=-16, 7-28=-9, 7-10=4, 10-11=7, 2-23=15, 10-12=2
- 22) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60
 - Uniform Loads (plf)
 - Vert: 1-2=-43, 2-7=-46, 7-31=-41, 10-31=-34, 10-11=-30, 22-23=-20, 19-21=-20, 18-33=-20, 33-34=-50, 12-34=-20, 35-36=-30(F)
 - Horz: 1-2=-7, 2-7=-4, 7-31=9, 10-31=16, 10-11=20, 2-23=-2, 10-12=-15
- 23) 1st Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15
 - Uniform Loads (plf)
 - Vert: 1-2=-60, 2-7=-60, 7-10=-20, 10-11=-20, 22-23=-20, 19-21=-20, 12-18=-20
- 24) 2nd Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15
 - Uniform Loads (plf)
 - Vert: 1-2=-20, 2-7=-20, 7-10=-60, 10-11=-60, 22-23=-20, 19-21=-20, 12-18=-20
- 25) 3rd Dead + 0.75 Roof Live (unbalanced) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.15, Plate Increase=1.15
 - Uniform Loads (plf)
 - Vert: 1-2=-50, 2-7=-50, 7-10=-20, 10-11=-20, 22-23=-20, 19-21=-20, 18-33=-20, 33-34=-50, 12-34=-20, 35-36=-30(F)
- 26) 4th Dead + 0.75 Roof Live (unbalanced) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.15, Plate Increase=1.15
 - Uniform Loads (plf)
 - Vert: 1-2=-20, 2-7=-20, 7-10=-50, 10-11=-50, 22-23=-20, 19-21=-20, 18-33=-20, 33-34=-50, 12-34=-20, 35-36=-30(F)

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

Builders FirstSource, Apex, NC 27523

8:430 s Aug 16 2021 MITek Industries, Inc. Fri Nov 12 14:07:28 2021 Page 1
 ID:x1XjjwWBLqE?VCRreTaQN3tymvXu-JOQ71L_8n_FII17ABaXyXToi?3uoEnsKaz_7bLyJvBz



Scale = 1:75.7

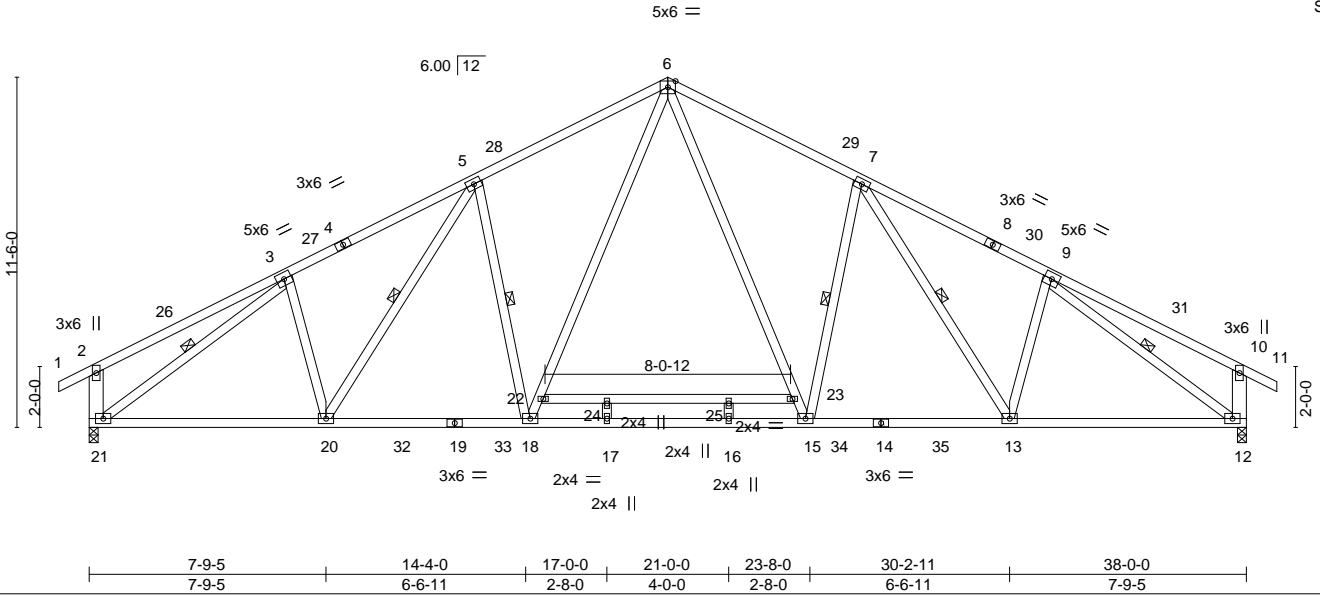

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.58	Vert(LL)	-0.38	16-17	>999	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.76	Vert(CT)	-0.56	16-17	>812		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.73	Horz(CT)	0.09	12	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MS	Wind(LL)	0.05	18-20	>999		
								Weight: 267 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 3-9-8 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2 *Except* 14-19: 2x4 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3 *Except* 2-21,10-12: 2x6 SP No.2, 22-23: 2x4 SP No.2	WEBS 1 Row at midpt 7-15, 7-13, 9-12, 5-18, 5-20, 3-21

REACTIONS. (size) 21=0-3-8, 12=0-3-8
 Max Horz 21=149(LC 11)
 Max Grav 21=1603(LC 2), 12=1603(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-21=-334/146, 3-27=-2004/127, 4-27=-1961/134, 4-5=-1936/158, 5-28=-1929/178,
 6-28=-1852/208, 6-29=-1852/208, 7-29=-1929/178, 7-8=-1936/158, 8-30=-1961/134,
 9-30=-2004/127, 10-12=-334/146
 BOT CHORD 20-21=-34/1719, 20-32=-2/1733, 19-32=-2/1733, 19-33=-2/1733, 18-33=-2/1733,
 17-18=0/1347, 16-17=0/1347, 15-16=0/1347, 15-34=0/1721, 14-34=0/1721, 14-35=0/1721,
 13-35=0/1721, 12-13=-19/1692
 WEBS 6-23=-57/778, 15-23=-70/730, 7-15=-469/151, 9-12=-2002/9, 18-22=-71/730,
 6-22=-57/778, 5-18=-469/151, 3-21=-2002/9

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCCL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -1-0-0 to 2-9-10, Interior(1) 2-9-10 to 19-0-0, Exterior(2) 19-0-0 to 24-4-8, Interior(1) 24-4-8 to 39-0-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - All plates are 4x6 MT20 unless otherwise indicated.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - All bearings are assumed to be User Defined crushing capacity of 565 psi.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - N/A

LOAD CASE(S)

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-2=-60, 2-6=-60, 6-10=-60, 10-11=-60, 12-21=-20



November 13, 2021

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MITek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Mattamy; Shenandoah	148785704
MASTER_FARMHOUSE	A02	COMMON	5	1	Job Reference (optional)	

Builders FirstSource, Apex, NC 27523

8.430 s Aug 16 2021 MiTek Industries, Inc. Fri Nov 12 14:07:28 2021 Page 2
 ID:x1XjjwWBLqE?VCRreTaQN3tymvXu-JOQ71L_8n_FII17ABaXyXToI?3uoEnsKaz_7bLyJvBz

LOAD CASE(S)

- 2) Dead + 0.75 Roof Live (balanced) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-2=-50, 2-6=-50, 6-10=-50, 10-11=-50, 21-32=-20, 32-33=-50, 33-34=-20, 34-35=-50, 12-35=-20, 22-23=-30
- 3) Dead + Uninhabitable Attic Without Storage: Lumber Increase=1.25, Plate Increase=1.25
 Uniform Loads (plf)
 Vert: 1-2=-20, 2-6=-20, 6-10=-20, 10-11=-20, 12-21=-40, 22-23=-40
- 4) Dead + 0.6 C-C Wind (Pos. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=42, 2-26=22, 6-26=12, 6-29=22, 10-29=12, 10-11=8, 12-21=-12
 Horz: 2-21=13, 1-2=-54, 2-26=-34, 6-26=-24, 6-29=34, 10-29=24, 10-11=20, 10-12=24
- 5) Dead + 0.6 C-C Wind (Pos. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=8, 2-28=12, 6-28=22, 6-31=12, 10-31=22, 10-11=42, 12-21=-12
 Horz: 2-21=-24, 1-2=-20, 2-28=-24, 6-28=-34, 6-31=24, 10-31=34, 10-11=54, 10-12=-13
- 6) Dead + 0.6 C-C Wind (Neg. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=-13, 2-6=-32, 6-10=-32, 10-11=-27, 12-21=-20
 Horz: 2-21=-15, 1-2=-7, 2-6=12, 6-10=-12, 10-11=-7, 10-12=-22
- 7) Dead + 0.6 C-C Wind (Neg. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=-27, 2-6=-32, 6-10=-32, 10-11=-13, 12-21=-20
 Horz: 2-21=22, 1-2=7, 2-6=12, 6-10=-12, 10-11=7, 10-12=15
- 8) Dead + 0.6 MWFRS Wind (Pos. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=7, 2-6=3, 6-10=7, 10-11=2, 12-21=-12
 Horz: 2-21=13, 1-2=-19, 2-6=-9, 6-10=19, 10-11=14, 10-12=16
- 9) Dead + 0.6 MWFRS Wind (Pos. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=2, 2-6=7, 6-10=-3, 10-11=7, 12-21=-12
 Horz: 2-21=-16, 1-2=-14, 2-6=-19, 6-10=9, 10-11=19, 10-12=-13
- 10) Dead + 0.6 MWFRS Wind (Neg. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=-15, 2-6=-20, 6-10=-10, 10-11=-6, 12-21=-20
 Horz: 2-21=21, 1-2=-5, 2-6=0, 6-10=10, 10-11=14, 10-12=7
- 11) Dead + 0.6 MWFRS Wind (Neg. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=-6, 2-6=-10, 6-10=-20, 10-11=-15, 12-21=-20
 Horz: 2-21=-7, 1-2=-14, 2-6=-10, 6-10=0, 10-11=5, 10-12=-21
- 12) Dead + 0.6 MWFRS Wind (Pos. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=14, 2-27=19, 6-27=9, 6-10=2, 10-11=-3, 12-21=-12
 Horz: 2-21=11, 1-2=-26, 2-27=-31, 6-27=-21, 6-10=14, 10-11=9, 10-12=12
- 13) Dead + 0.6 MWFRS Wind (Pos. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=-3, 2-6=2, 6-30=9, 10-30=19, 10-11=14, 12-21=-12
 Horz: 2-21=-12, 1-2=-9, 2-6=-14, 6-30=21, 10-30=31, 10-11=26, 10-12=-11
- 14) Dead + 0.6 MWFRS Wind (Pos. Internal) 3rd Parallel: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=5, 2-6=9, 6-10=2, 10-11=-3, 12-21=-12
 Horz: 2-21=5, 1-2=-17, 2-6=-21, 6-10=14, 10-11=9, 10-12=12
- 15) Dead + 0.6 MWFRS Wind (Pos. Internal) 4th Parallel: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=-3, 2-6=2, 6-10=9, 10-11=5, 12-21=-12
 Horz: 2-21=-12, 1-2=-9, 2-6=-14, 6-10=21, 10-11=17, 10-12=-5
- 16) Dead + 0.6 MWFRS Wind (Neg. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=6, 2-27=2, 6-27=-7, 6-10=-15, 10-11=-11, 12-21=-20
 Horz: 2-21=19, 1-2=-26, 2-27=-22, 6-27=-13, 6-10=5, 10-11=9, 10-12=3
- 17) Dead + 0.6 MWFRS Wind (Neg. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=-11, 2-6=-15, 6-30=-7, 10-30=2, 10-11=6, 12-21=-20
 Horz: 2-21=-3, 1-2=-9, 2-6=-5, 6-30=13, 10-30=22, 10-11=26, 10-12=-19
- 18) Dead + Uninhabitable Attic Storage: Lumber Increase=1.25, Plate Increase=1.25
 Uniform Loads (plf)
 Vert: 1-2=-20, 2-6=-20, 6-10=-20, 10-11=-20, 21-32=-20, 32-33=-60, 33-34=-20, 34-35=-60, 12-35=-20, 22-23=-40
- 19) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) Left): Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=-46, 2-6=-50, 6-10=-43, 10-11=-39, 21-32=-20, 32-33=-50, 33-34=-20, 34-35=-50, 12-35=-20, 22-23=-30
 Horz: 2-21=16, 1-2=-4, 2-6=0, 6-10=7, 10-11=11, 10-12=6
- 20) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) Right): Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=-39, 2-6=-43, 6-10=-50, 10-11=-46, 21-32=-20, 32-33=-50, 33-34=-20, 34-35=-50, 12-35=-20, 22-23=-30
 Horz: 2-21=-6, 1-2=-11, 2-6=-7, 6-10=0, 10-11=4, 10-12=-16

Continued on page 3

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Mattamy; Shenandoah	I48785704
MASTER_FARMHOUSE	A02	COMMON	5	1	Job Reference (optional)	

Builders FirstSource, Apex, NC 27523

8.430 s Aug 16 2021 MiTek Industries, Inc. Fri Nov 12 14:07:28 2021 Page 3
 ID:x1XjjwWBLqE?VCRReTaQN3tymvXu-JOQ71L_8n_FII17ABaXyXTol?3uoEnsKaz_7bLyJvBz

LOAD CASE(S)

- 21) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=-30, 2-27=-34, 6-27=-41, 6-10=-46, 10-11=-43, 21-32=-20, 32-33=-50, 33-34=-20, 34-35=-50, 12-35=-20, 22-23=-30
 Horz: 2-21=15, 1-2=-20, 2-27=-16, 6-27=-9, 6-10=4, 10-11=7, 10-12=2
- 22) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=-43, 2-6=-46, 6-30=-41, 10-30=-34, 10-11=-30, 21-32=-20, 32-33=-50, 33-34=-20, 34-35=-50, 12-35=-20, 22-23=-30
 Horz: 2-21=-2, 1-2=-7, 2-6=-4, 6-30=9, 10-30=16, 10-11=20, 10-12=-15
- 23) 1st Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-2=-60, 2-6=-60, 6-10=-20, 10-11=-20, 12-21=-20
- 24) 2nd Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-2=-20, 2-6=-20, 6-10=-60, 10-11=-60, 12-21=-20
- 25) 3rd Dead + 0.75 Roof Live (unbalanced) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-2=-50, 2-6=-50, 6-10=-20, 10-11=-20, 21-32=-20, 32-33=-50, 33-34=-20, 34-35=-50, 12-35=-20, 22-23=-30
- 26) 4th Dead + 0.75 Roof Live (unbalanced) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-2=-20, 2-6=-20, 6-10=-50, 10-11=-50, 21-32=-20, 32-33=-50, 33-34=-20, 34-35=-50, 12-35=-20, 22-23=-30

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Mattamy; Shenandoah	148785705
MASTER_FARMHOUSE	B01	COMMON	3	1	Job Reference (optional)	

Builders FirstSource (Apex, NC),

Apex, NC - 27523,

8.430 s Aug 16 2021 MiTek Industries, Inc. Fri Nov 12 10:53:38 2021 Page 1

ID:x1XjwWBLqE?VCRReTaQN3tymvXu-D2_bNo0lg0xc?Dds5CmHmx6EDxhaJ2dVGamjPRyJy1h



4x6 =

Scale = 1:35.4

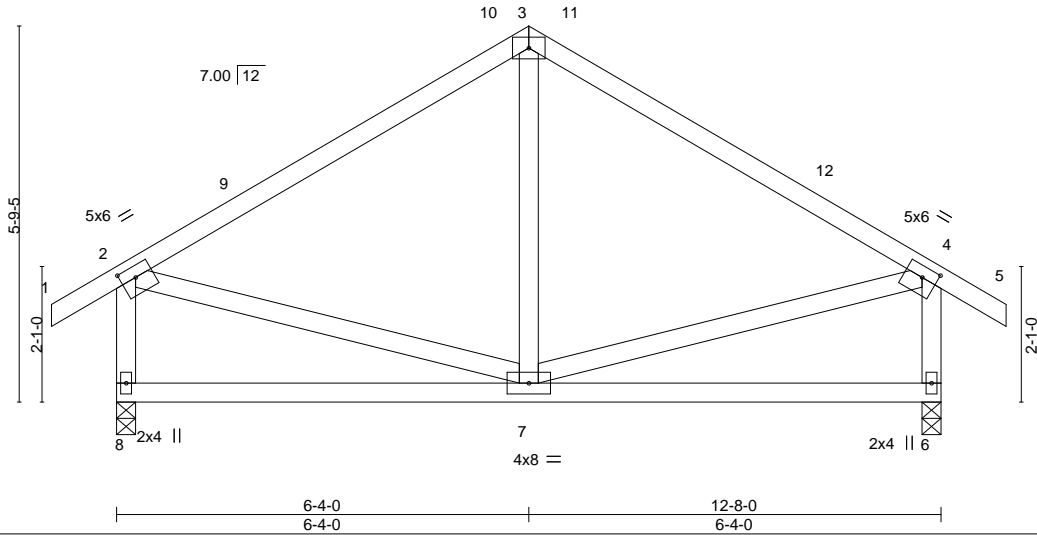


Plate Offsets (X,Y)--	[2:0-2-12,0-2-0], [4:0-2-12,0-2-0]
-----------------------	------------------------------------


LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.57	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.33	Vert(LL) -0.03 6-7 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.09	Vert(CT) -0.06 6-7 >999 240		
BCDL 10.0	Rep Stress Incr YES	Matrix-MS	Horz(CT) 0.00 6 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.00 7 >999 240	Weight: 75 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	

REACTIONS. (size) 8=0-3-8, 6=0-3-8
 Max Horz 8=-138(LC 10)
 Max Uplift 8=-15(LC 12), 6=-15(LC 13)
 Max Grav 8=564(LC 1), 6=564(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-8=-508/102, 2-3=-454/66, 3-4=-454/66, 4-6=-508/103
 WEBS 4-7=-4/259, 2-7=-3/258

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -1-0-0 to 2-0-0, Interior(1) 2-0-0 to 6-4-0, Exterior(2) 6-4-0 to 10-6-15, Interior(1) 10-6-15 to 13-8-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 8, 6.

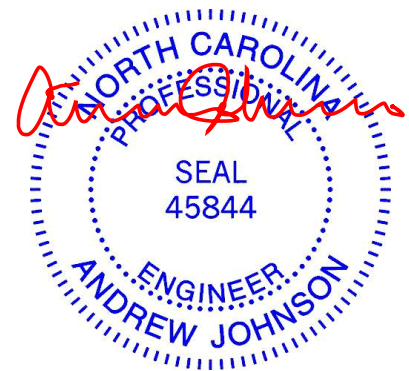


November 13, 2021

Job MASTER_FARMHOUSE	Truss B01-2PL	Truss Type COMMON	Qty 1	Ply 2	Mattamy; Shenandoah Job Reference (optional)	148785706
-------------------------	------------------	----------------------	----------	----------	---	-----------

Builders FirstSource (Apex, NC), Apex, NC - 27523, 8.430 s Aug 16 2021 MiTek Industries, Inc. Fri Nov 12 10:53:39 2021 Page 1

ID:x1XjwWBLqE?VCRReTaQN3tymvXu-hEYzb80NRJ3TcNC2fvHWJ9FTDL1T2RYeUEVGxyJy1g



4x6 ||

Scale = 1:35.4

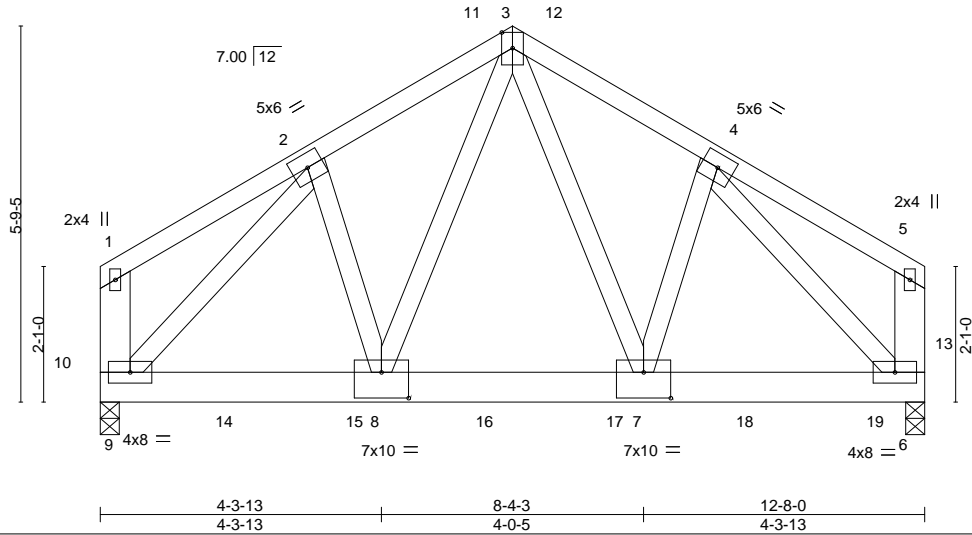


Plate Offsets (X,Y)--	[7:0-5-0,0-4-12], [8:0-5-0,0-4-12]
-----------------------	------------------------------------

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.30	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.36	Vert(LL) -0.03 7-8 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.37	Vert(CT) -0.06 7-8 >999 240		
BCDL 10.0	Rep Stress Incr NO	Matrix-MS	Horz(CT) 0.01 6 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.00 8 >999 240	Weight: 195 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x6 SP DSS	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.2 *Except* 1-9,5-6: 2x6 SP No.2	

REACTIONS. (size) 9=0-3-8, 6=0-3-8
 Max Horz 9=94(LC 4)
 Max Grav 9=4481(LC 1), 6=5363(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-9=-326/0, 1-2=-453/0, 2-3=-4012/0, 3-4=-4024/0, 4-5=-488/0, 5-6=-344/0
 BOT CHORD 8-9=0/3020, 7-8=0/2740, 6-7=0/3033
 WEBS 3-7=0/2064, 4-7=0/1426, 4-6=-4173/0, 3-8=0/2034, 2-8=0/1434, 2-9=-4199/0

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
 Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc, 2x4 - 1 row at 0-9-0 oc.
 Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-5-0 oc.
 Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 1477 lb down at 1-11-4, 1477 lb down at 3-11-4, 1477 lb down at 5-11-4, 1477 lb down at 7-11-4, and 1477 lb down at 9-11-4, and 1481 lb down at 11-11-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-3=-60, 3-5=-60, 6-9=-20
Concentrated Loads (lb)
Vert: 14=-1477(B) 15=-1477(B) 16=-1477(B) 17=-1477(B) 18=-1477(B) 19=-1481(B)




Job	Truss	Truss Type	Qty	Ply	Mattamy; Shenandoah	148785707
MASTER_FARMHOUSE	B01G	GABLE	1	1	Job Reference (optional)	

Builders FirstSource (Apex, NC),

Apex, NC - 27523,

8.430 s Aug 16 2021 MiTek Industries, Inc. Fri Nov 12 10:53:40 2021 Page 1

ID:x1XjjwWBLqE?VCRReTaQN3tymvXu-9Q6LoU1?CdBKEWnFDd0lrMCgulRgnyZojufquJy1f

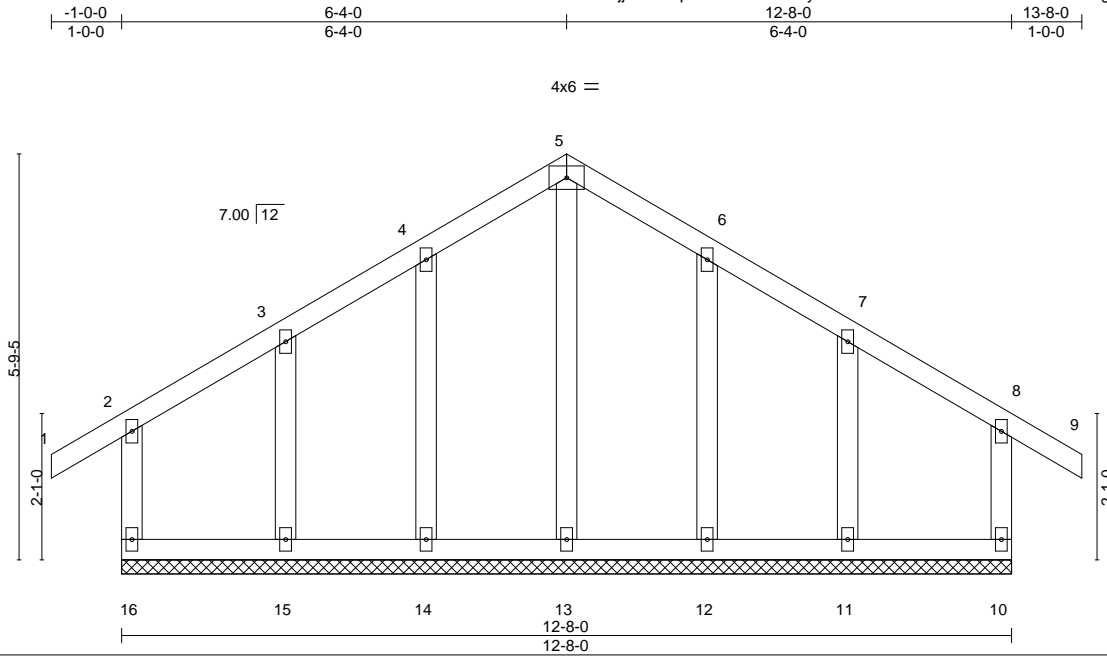

Scale = 1:32.8

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.17	Vert(LL)	-0.00	9	n/r	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.10	Vert(CT)	-0.00	9	n/r		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.06	Horz(CT)	-0.00	10	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-R					Weight: 78 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 WEBS 2x4 SP No.3
 OTHERS 2x4 SP No.3


BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS. All bearings 12-8-0.
 (lb) - Max Horz 16--138(LC 10)
 Max Uplift All uplift 100 lb or less at joint(s) 16, 10, 14, 15, 12, 11
 Max Grav All reactions 250 lb or less at joint(s) 16, 10, 13, 14, 15, 12, 11

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) -1-0-0 to 2-0-0, Exterior(2) 2-0-0 to 6-4-0, Corner(3) 6-4-0 to 9-4-0, Exterior(2) 9-4-0 to 13-8-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 16, 10, 14, 15, 12, 11.

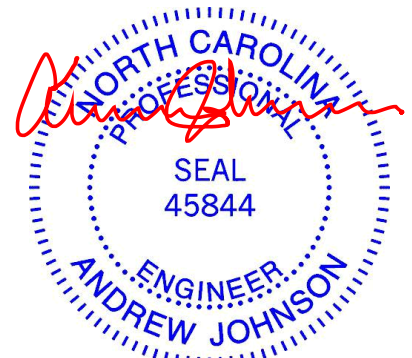

November 13, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	Mattamy; Shenandoah	148785708
MASTER_FARMHOUSE	BV01	VALLEY	1	1	Job Reference (optional)	

Builders FirstSource (Apex, NC),


Apex, NC - 27523,

8.430 s Aug 16 2021 MiTek Industries, Inc. Fri Nov 12 10:53:41 2021 Page 1

ID:x1XjwWBLqE?VCRreTaQN3tymvXu-ddgk?q2dzxJBsgMRnKJ_Oakqe9lqWQ1xyY_NomyJy1e



Scale = 1:19.2

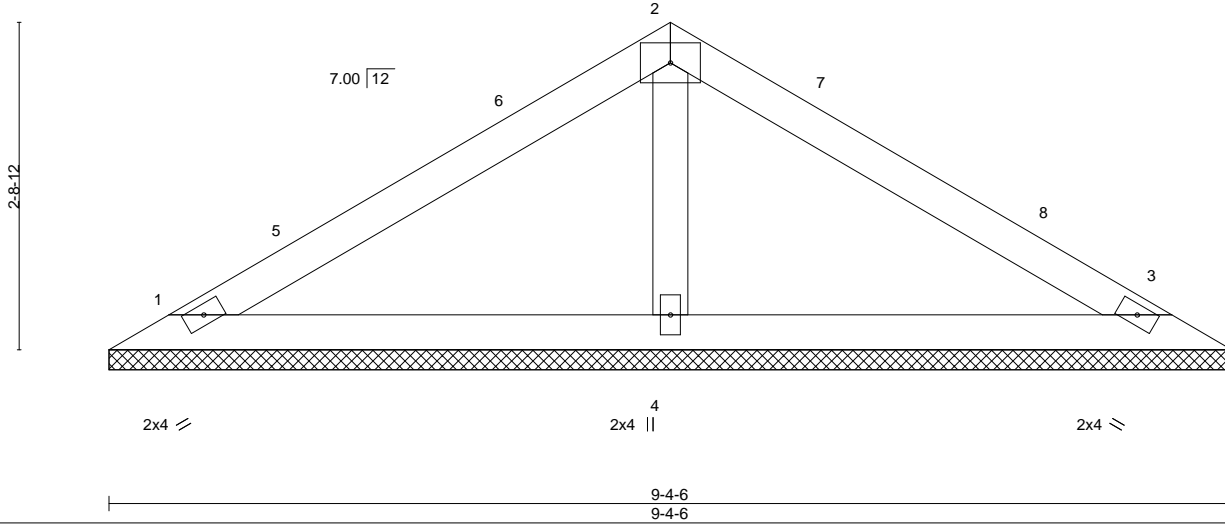

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.24	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.17	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.05	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-S					Weight: 31 lb	FT = 20%
	Code IRC2015/TPI2014							

LUMBER-
 TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 OTHERS 2x4 SP No.3

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 1=9-4-6, 3=9-4-6, 4=9-4-6
 Max Horz 1=-48(LC 8)
 Max Uplift 1=-15(LC 12), 3=-22(LC 13)
 Max Grav 1=157(LC 1), 3=157(LC 1), 4=349(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) 0-6-8 to 3-6-8, Interior(1) 3-6-8 to 4-8-3, Exterior(2) 4-8-3 to 7-8-3, Interior(1) 7-8-3 to 8-9-14 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Gable requires continuous bottom chord bearing.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.



November 13, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

Job MASTER_FARMHOUSE	Truss BV02	Truss Type VALLEY	Qty 1	Ply 1	Mattamy; Shenandoah Job Reference (optional)	148785709
-------------------------	---------------	----------------------	----------	----------	---	-----------

Builders FirstSource (Apex, NC),

Apex, NC - 27523,


8.430 s Aug 16 2021 MiTek Industries, Inc. Fri Nov 12 10:53:42 2021 Page 1

ID:x1XjwWBLqE?VCRReTaQN3tymvXu-5pE6DA3GkER2TqxdK2qDxnH1UY7nFtg5BCkxYCyJy1d



4x6 =

Scale = 1:13.4

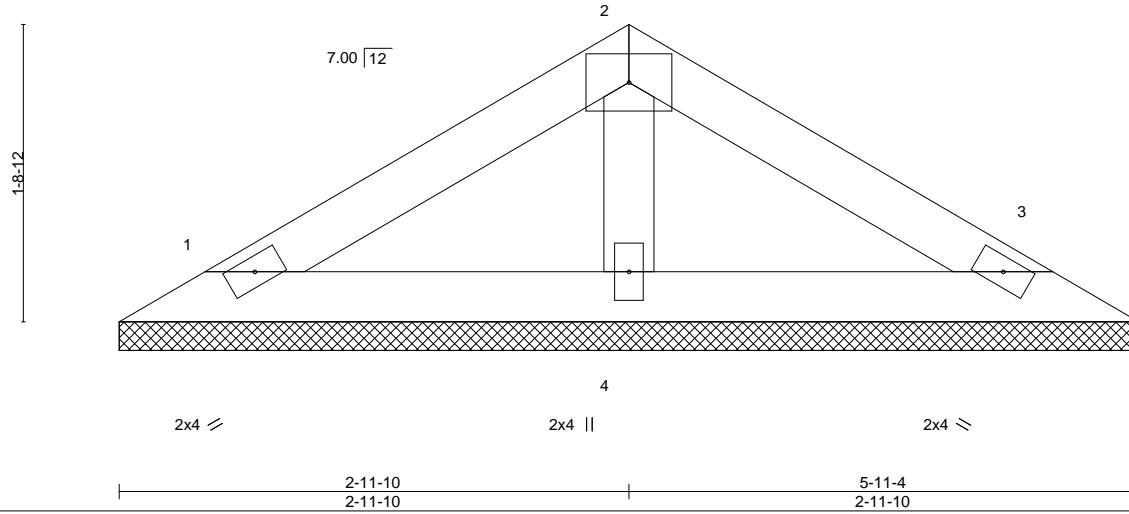

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.10	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.06	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-P					Weight: 19 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 OTHERS 2x4 SP No.3

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 5-11-4 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 1=5-11-4, 3=5-11-4, 4=5-11-4
 Max Horz 1=28(LC 11)
 Max Uplift 1=-13(LC 12), 3=-16(LC 13)
 Max Grav 1=102(LC 1), 3=102(LC 1), 4=186(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Gable requires continuous bottom chord bearing.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.



November 13, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component


Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

Job MASTER_FARMHOUSE	Truss C01-2PL	Truss Type COMMON	Qty 1	Ply 2	Mattamy; Shenandoah Job Reference (optional)	148785710
-------------------------	------------------	----------------------	----------	----------	---	-----------

Builders FirstSource (Apex, NC), Apex, NC - 27523, 8.430 s Aug 16 2021 MiTek Industries, Inc. Fri Nov 12 10:53:43 2021 Page 1



4x6 ||

Scale = 1:34.3

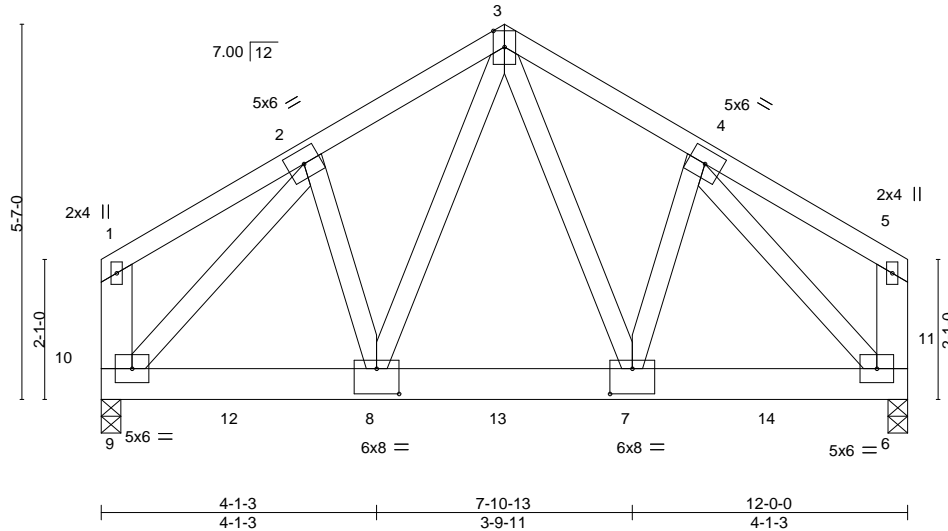


Plate Offsets (X,Y)--	[7:0-4-0,0-4-8], [8:0-4-0,0-4-8]
-----------------------	----------------------------------

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.23	Vert(LL)	-0.03	7-8	>999	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.32	Vert(CT)	-0.05	7-8	>999		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.33	Horz(CT)	0.01	6	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MS	Wind(LL)	0.00	8	>999		
								Weight: 187 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x6 SP DSS	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.2 *Except* 1-9,5-6: 2x6 SP No.2	

REACTIONS.	(size) 9=0-3-8, 6=0-3-8
	Max Horz 9=-90(LC 4)
	Max Grav 9=4168(LC 1), 6=4128(LC 1)

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	1-9=-296/0, 1-2=-398/0, 2-3=-3691/0, 3-4=-3697/0, 4-5=-396/0, 5-6=-295/0
BOT CHORD	8-9=0/2760, 7-8=0/2535, 6-7=0/2764
WEBS	3-7=0/1883, 4-7=0/1410, 4-6=-3945/0, 3-8=0/1867, 2-8=0/1407, 2-9=-3936/0

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc, 2x4 - 1 row at 0-9-0 oc.
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-6-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 1480 lb down at 1-11-4, 1480 lb down at 3-11-4, 1477 lb down at 5-11-4, and 1477 lb down at 7-11-4, and 1477 lb down at 9-11-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S)	Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15	
Uniform Loads (plf)	
Vert: 1-3=-60, 3-5=-60, 6-9=-20	
Concentrated Loads (lb)	
Vert: 7=-1477(B) 8=-1470(B) 12=-1470(B) 13=-1477(B) 14=-1477(B)	




Job	Truss	Truss Type	Qty	Ply	Mattamy; Shenandoah	148785711
MASTER_FARMHOUSE	C01G	GABLE	1	1	Job Reference (optional)	

Builders FirstSource (Apex, NC),


Apex, NC - 27523,

8.430 s Aug 16 2021 MiTek Industries, Inc. Fri Nov 12 10:53:44 2021 Page 1

ID:x1XjwWBLqE?VCRReTaQN3tymvXu-2CLses4WGshmj840STh0CMM1MohjncNeVD1d5yJy1b



Scale: 3/8"=1'

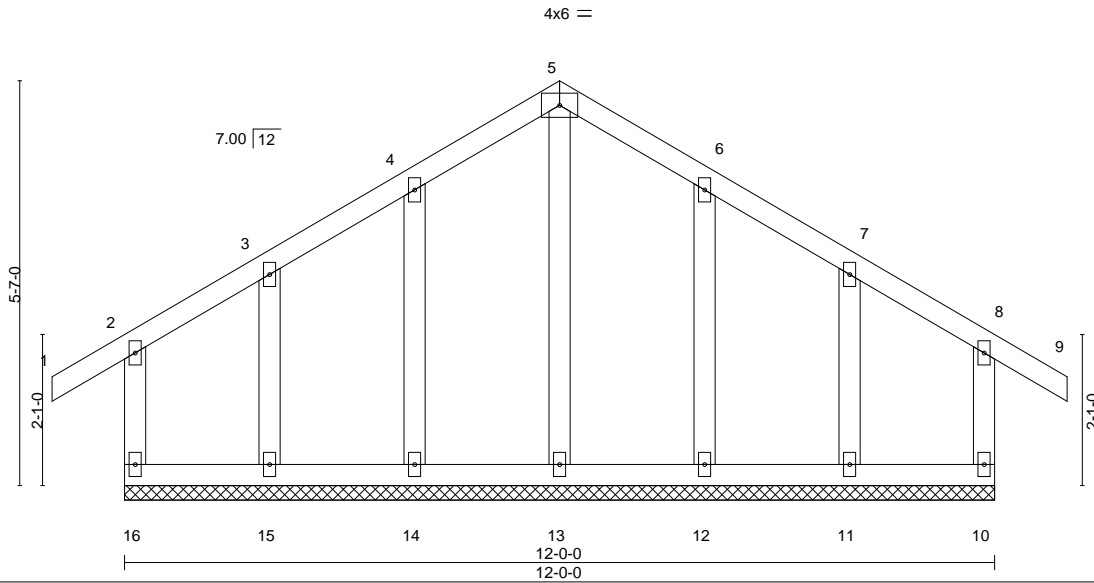

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.17	Vert(LL)	-0.00	9	n/r	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.10	Vert(CT)	-0.01	9	n/r		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.06	Horz(CT)	-0.00	10	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-R					Weight: 74 lb	FT = 20%

LUMBER-

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
WEBS	2x4 SP No.3
OTHERS	2x4 SP No.3

BRACING-


TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS. All bearings 12-0-0.
 (lb) - Max Horz 16=134(LC 11)
 Max Uplift All uplift 100 lb or less at joint(s) 16, 10, 14, 15, 12, 11
 Max Grav All reactions 250 lb or less at joint(s) 16, 10, 13, 14, 15, 12, 11

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) -1-0-0 to 2-0-0, Exterior(2) 2-0-0 to 6-0-0, Corner(3) 6-0-0 to 9-0-0, Exterior(2) 9-0-0 to 13-0-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 16, 10, 14, 15, 12, 11.

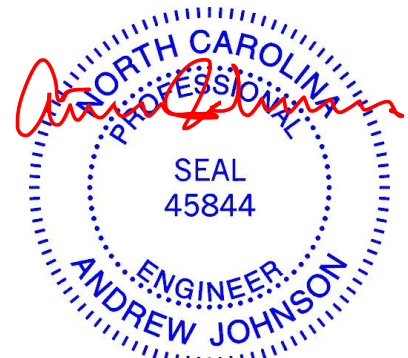

November 13, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932

Job MASTER_FARMHOUSE	Truss CV01	Truss Type VALLEY	Qty 1	Ply 1	Mattamy; Shenandoah Job Reference (optional)	148785712
-------------------------	---------------	----------------------	----------	----------	---	-----------

Builders FirstSource (Apex, NC),


Apex, NC - 27523,

8.430 s Aug 16 2021 MiTek Industries, Inc. Fri Nov 12 10:53:45 2021 Page 1

ID:x1XjwWBLqE?VCRerTaQN3tymvXu-WOvErB5819pdKlFC0AOWYQvWFm79SE6Xt9yb9XyJy1a



Scale = 1:17.8

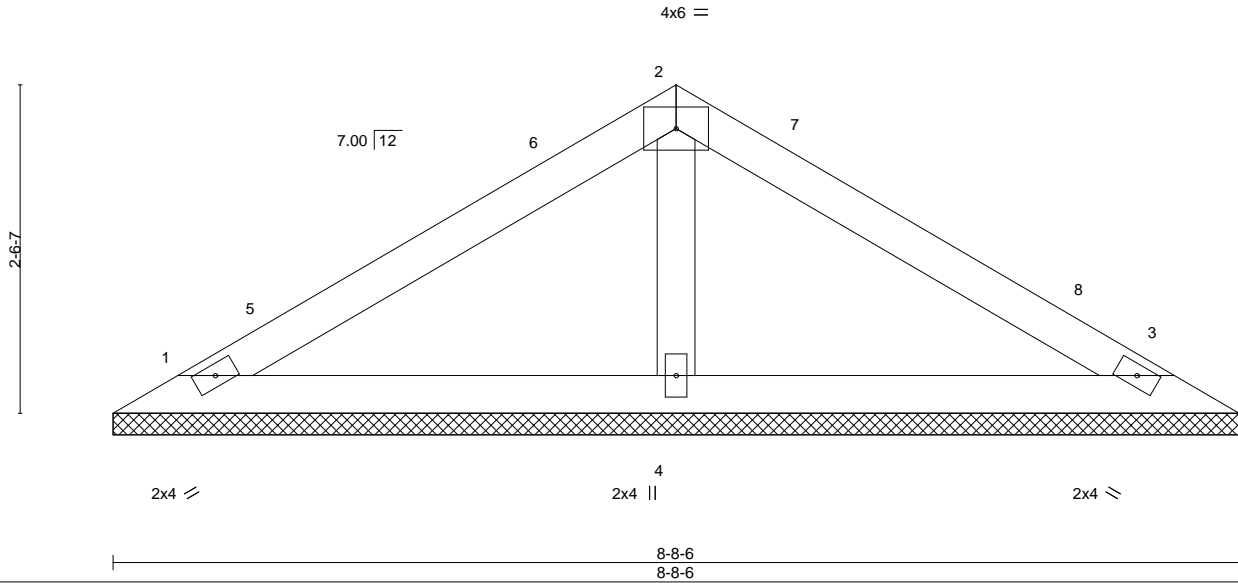

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.20	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.15	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.04	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-S					Weight: 29 lb	FT = 20%
	Code IRC2015/TPI2014							

LUMBER-
 TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 OTHERS 2x4 SP No.3

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 1=8-8-6, 3=8-8-6, 4=8-8-6
 Max Horz 1=-44(LC 8)
 Max Uplift 1=-14(LC 12), 3=-20(LC 13)
 Max Grav 1=144(LC 1), 3=144(LC 1), 4=321(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) 0-6-8 to 3-6-8, Interior(1) 3-6-8 to 4-4-3, Exterior(2) 4-4-3 to 7-4-3, Interior(1) 7-4-3 to 8-1-14 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Gable requires continuous bottom chord bearing.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.



November 13, 2021

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	<p>ENGINEERING BY TRENCO <small>A MiTek Affiliate</small></p> <p>818 Soundside Road Edenton, NC 27932</p>
--	---


Job MASTER_FARMHOUSE	Truss CV02	Truss Type VALLEY	Qty 1	Ply 1	Mattamy; Shenandoah Job Reference (optional)	148785713
-------------------------	---------------	----------------------	----------	----------	---	-----------

Builders FirstSource (Apex, NC),

Apex, NC - 27523,


8.430 s Aug 16 2021 MiTek Industries, Inc. Fri Nov 12 10:53:45 2021 Page 1

ID:x1XjwWBLqE?VCRReTaQN3tymvXu-WOvErB5819pdKlfc0AOwYQvYAm9kSETXt9yb9XyJy1a



4x6 =

Scale = 1:12.2

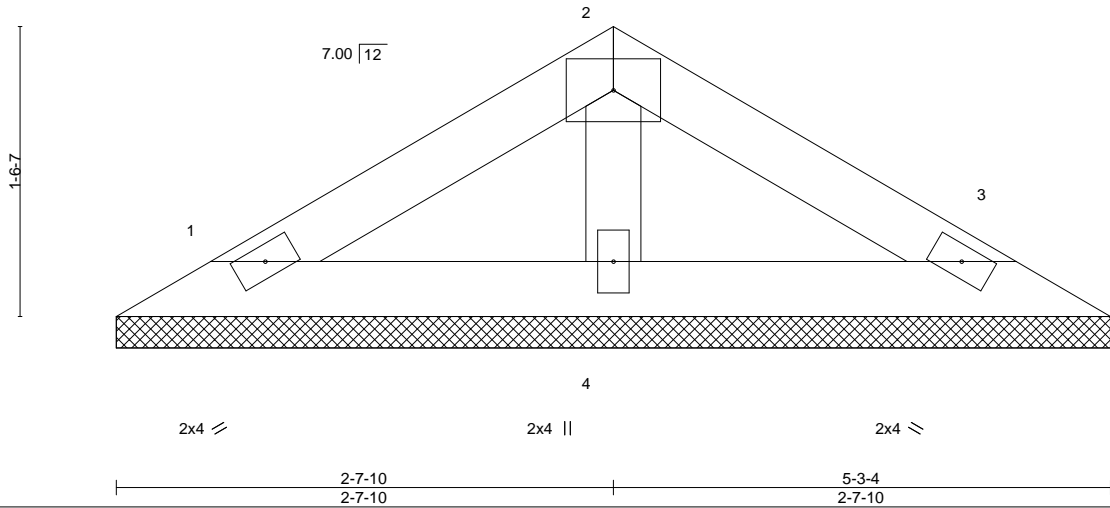

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.08	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.04	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.02	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-P					Weight: 17 lb	FT = 20%


LUMBER-
 TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 WEBS 2x4 SP No.3

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 5-3-4 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 1=5-3-4, 3=5-3-4, 4=5-3-4
 Max Horz 1=24(LC 11)
 Max Uplift 1=-11(LC 12), 3=-14(LC 13)
 Max Grav 1=88(LC 1), 3=88(LC 1), 4=160(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Gable requires continuous bottom chord bearing.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.

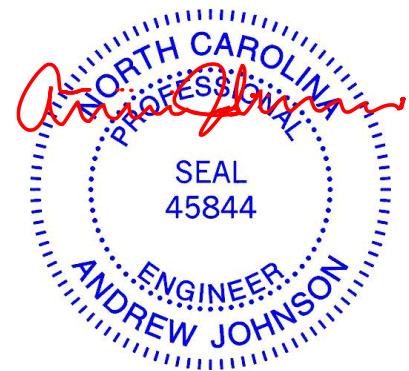

November 13, 2021

Job MASTER_FARMHOUSE	Truss D01	Truss Type ROOF TRUSS	Qty 3	Ply 1	Mattamy; Shenandoah Job Reference (optional)	148785714
-------------------------	--------------	--------------------------	----------	----------	---	-----------

Builders FirstSource (Apex, NC),

Apex, NC - 27523,

8.430 s Aug 16 2021 MiTek Industries, Inc. Fri Nov 12 10:53:46 2021 Page 1

ID:x1XjwWBLqE?VCRReTaQN3tymvXu-_aTd3X6moTyUyREPZtv95dSepARxBh2g5pi8hzyJy1Z



Scale = 1:19.3

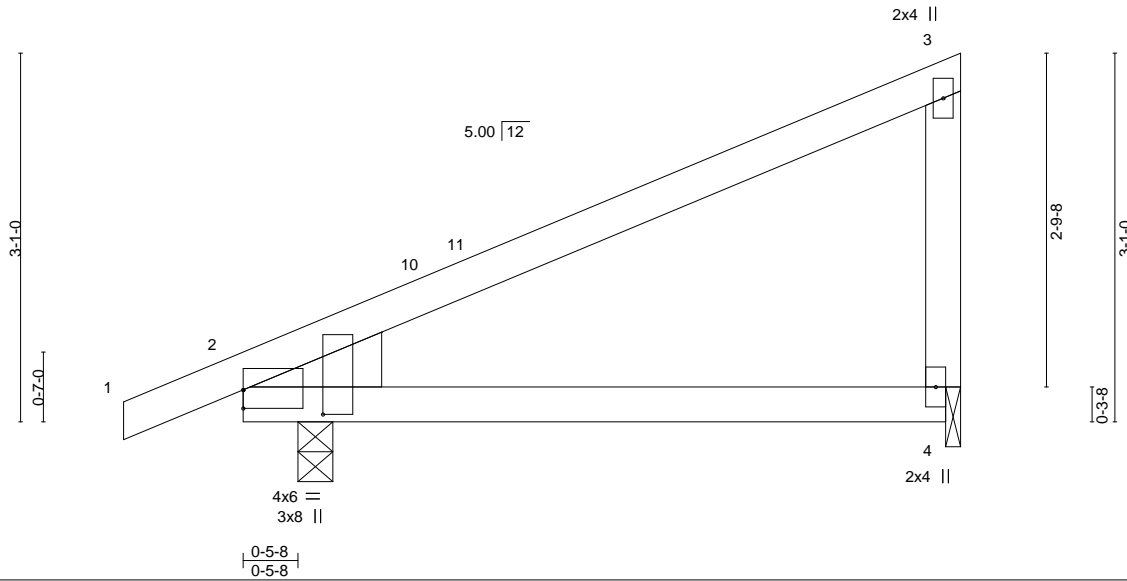


Plate Offsets (X,Y)--	[2:0-0-0,0-1-14], [2:0-2-7,0-8-0]
-----------------------	-----------------------------------

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.40	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.30	Vert(LL) -0.03 4-9 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.00	Vert(CT) -0.08 4-9 >888 240		
BCDL 10.0	Rep Stress Incr YES	Matrix-MP	Horz(CT) 0.01 2 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.04 4-9 >999 240	Weight: 26 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	
WEDGE	
Left: 2x6 SP No.2	

REACTIONS. (size) 2=0-3-8, 4=0-1-8
 Max Horz 2=93(LC 11)
 Max Uplift 2=-28(LC 12), 4=-26(LC 12)
 Max Grav 2=325(LC 1), 4=204(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -1-0-0 to 2-0-0, Interior(1) 2-0-0 to 5-10-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 4) Bearing at joint(s) 4 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - 5) Provide mechanical connection (by others) of truss to bearing plate at joint(s) 4.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 4.



November 13, 2021

Job MASTER_FARMHOUSE	Truss D01G	Truss Type ROOF TRUSS	Qty 1	Ply 1	Mattamy; Shenandoah Job Reference (optional)	148785715
-------------------------	---------------	--------------------------	----------	----------	---	-----------

Builders FirstSource (Apex, NC),

Apex, NC - 27523,

8.430 s Aug 16 2021 MiTek Industries, Inc. Fri Nov 12 10:53:47 2021 Page 1

ID:x1XjjwWBLqE?VCRreTaQN3tymvXu-Sn1?Gt7OZn4Labpb7bQOdr_tJZqAw8sqKTRhDQyJy1Y

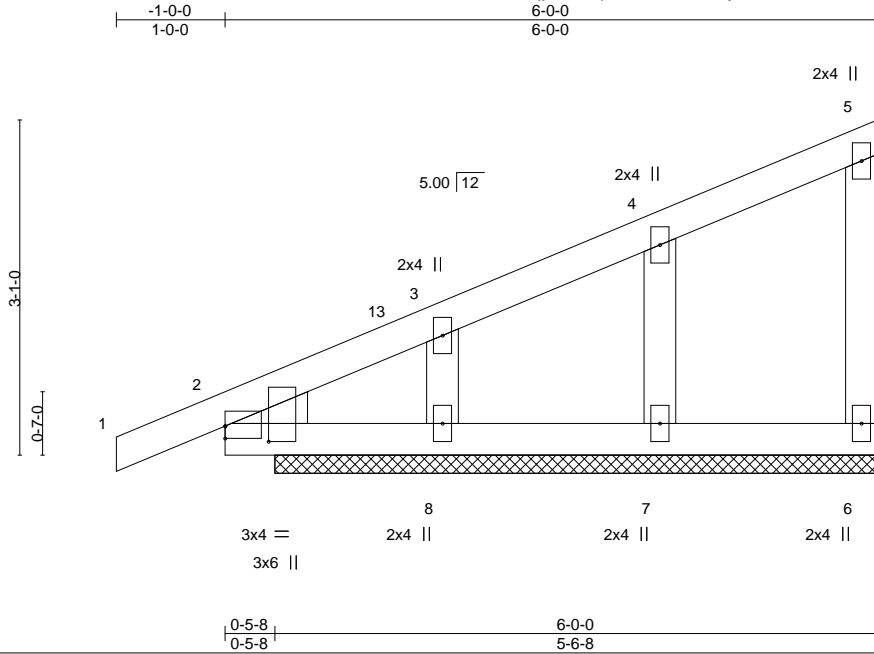


Plate Offsets (X,Y)--	[2:0-0-0,0-1-6], [2:0-1-11,0-4-13]
-----------------------	------------------------------------

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.10	Vert(LL)	-0.00	1	n/r	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.11	Vert(CT)	-0.00	1-2	n/r		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.03	Horz(CT)	-0.00	2	n/a		
BCDL 10.0	Code	IRC2015/TPI2014	Matrix-MP					Weight: 29 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	
OTHERS 2x4 SP No.3	
WEDGE	
Left: 2x4 SP No.3	

REACTIONS. All bearings 5-6-8.
 (lb) - Max Horz 2=93(LC 11)
 Max Uplift All uplift 100 lb or less at joint(s) 2, 6, 8, 7
 Max Grav All reactions 250 lb or less at joint(s) 2, 6, 8, 7, 2

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -1-0-0 to 2-0-0, Interior(1) 2-0-0 to 5-10-4 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 6, 8, 7, 2.
- 5) Non Standard bearing condition. Review required.



November 13, 2021


Job	Truss	Truss Type	Qty	Ply	Mattamy; Shenandoah	148785716
MASTER_FARMHOUSE	E01	COMMON	4	1	Job Reference (optional)	

Builders FirstSource (Apex, NC),

Apex, NC - 27523,

8.430 s Aug 16 2021 MiTek Industries, Inc. Fri Nov 12 10:53:48 2021 Page 1

ID:x1XjwWBLqE?VCRReTaQN3tymvXu-wzbNUD70K4CCBIOnhLxdA2Xzaz5ffa3zZ7BFmsyJy1X



Scale = 1:24.3


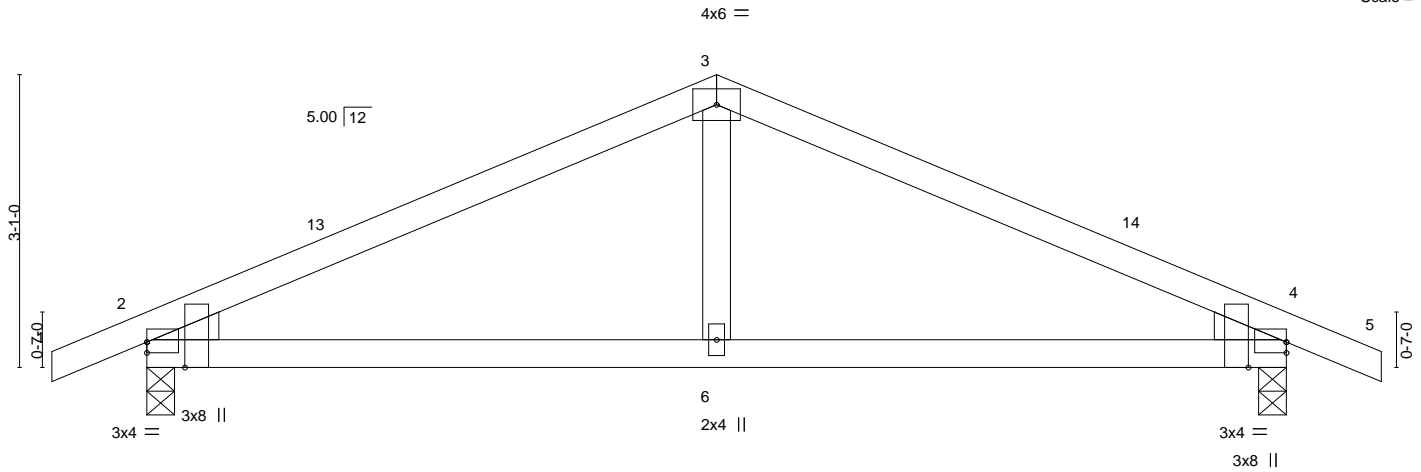


Plate Offsets (X,Y)--	[2:0-0-0,0-1-6], [2:0-3-3,Edge], [4:0-0-0,0-1-6], [4:0-3-3,Edge]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.39	Vert(LL) -0.04 6-12 >999 360	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.35	Vert(CT) -0.07 6-12 >999 240		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.10	Horz(CT) 0.01 2 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-MS	Wind(LL) 0.03 6-9 >999 240	Weight: 47 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 WEBS 2x4 SP No.3
 WEDGE
 Left: 2x4 SP No.3 , Right: 2x4 SP No.3

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 2=0-3-8, 4=0-3-8
 Max Horz 2=50(LC 12)
 Max Uplift 2=-25(LC 12), 4=-25(LC 13)
 Max Grav 2=540(LC 1), 4=540(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-686/89, 3-4=-686/85
 BOT CHORD 2-6=-5/578, 4-6=-5/578
 WEBS 3-6=0/251

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -1-0-0 to 2-0-0, Interior(1) 2-0-0 to 6-0-0, Exterior(2) 6-0-0 to 10-2-15, Interior(1) 10-2-15 to 13-0-0 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 4.



November 13, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Mattamy; Shenandoah	148785717
MASTER_FARMHOUSE	E01G	GABLE	1	1	Job Reference (optional)	

Builders FirstSource (Apex, NC), Apex, NC - 27523, 8.430 s Aug 16 2021 MiTek Industries, Inc. Fri Nov 12 10:53:49 2021 Page 1

ID:x1XjwWBLqE?VCReTaQN3tymvXu-O99lhZ8f4OK3pvzzF0SsjG4EMNWtO2N7onwollyJy1W



Scale = 1:22.4

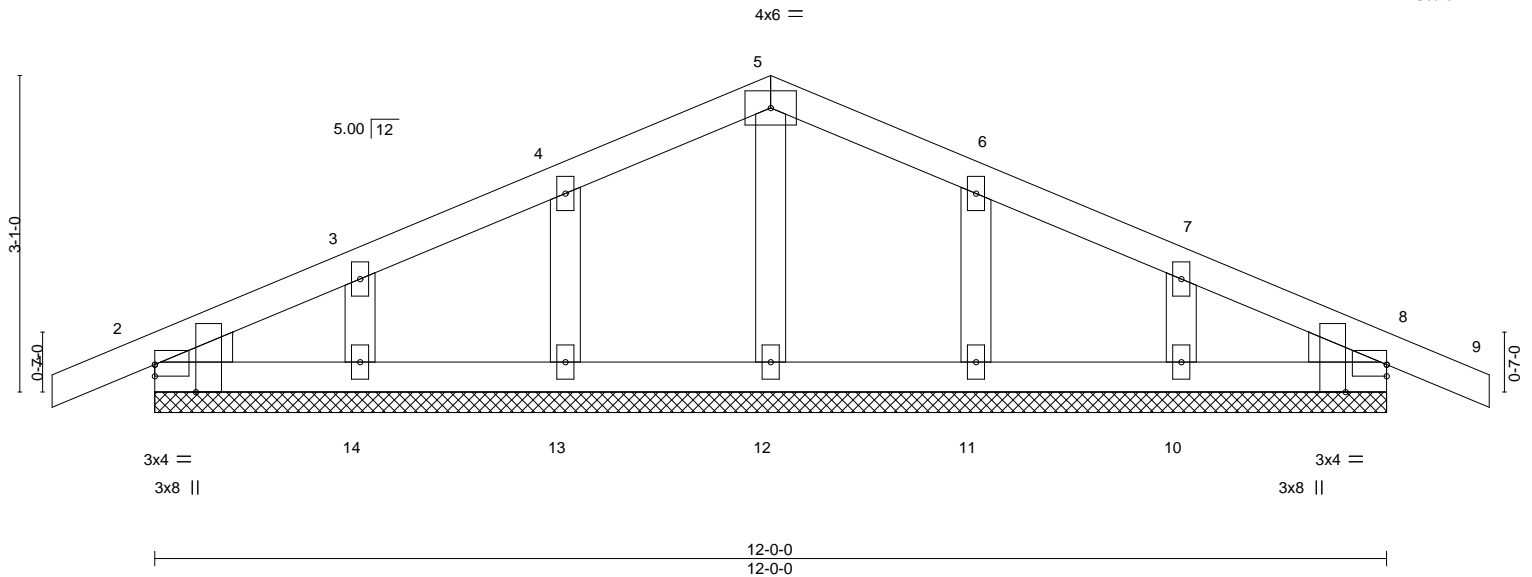


Plate Offsets (X, Y)-- [2:0-0-0,0-1-6], [2:0-3-3,Edge], [8:0-0-0,0-1-6], [8:0-3-3,Edge]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.06	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.03	Vert(LL) -0.00 9 n/r 120		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.03	Vert(CT) -0.00 9 n/r 120		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.00 8 n/a n/a		
	Code IRC2015/TPI2014			Weight: 54 lb	FT = 20%


LUMBER-
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.3
WEDGE
Left: 2x4 SP No.3 , Right: 2x4 SP No.3

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 12-0-0.
(lb) - Max Horz 2=50(LC 12)
Max Uplift All uplift 100 lb or less at joint(s) 2, 8, 13, 14, 11, 10
Max Grav All reactions 250 lb or less at joint(s) 2, 8, 12, 13, 14, 11, 10

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -1-0-0 to 2-0-0, Interior(1) 2-0-0 to 6-0-0, Exterior(2) 6-0-0 to 10-0-0, Interior(1) 10-0-0 to 13-0-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 8, 13, 14, 11, 10.

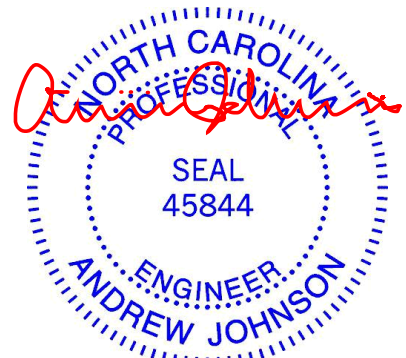

November 13, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ENGINEERING BY
TRENCO
A MiTek Affiliate
818 Soundside Road
Edenton, NC 27932

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0- 1/16" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

* Plate location details available in **MITek 20/20 software** or upon request.

PLATE SIZE

4 X 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING



Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur. Min size shown is for crushing only.

Industry Standards:

ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-89: Design Standard for Bracing, Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

6-4-8
dimensions shown in ft-in-sixteenths
(Drawings not to scale)



JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ESR1988
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MITteK® All Rights Reserved



MITek Engineering Reference Sheet: Mill-7473 rev. 5/19/2020



General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Rewriting pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.