NC Registered Firm # F-1078



ECS Southeast, LLP 6151 Raeford Road, Suite A Fayetteville, NC 28304 9104013288 9103230539

LETTER OF TRANSMITTAL

November 10, 2022 W.S. Wellons Realty PO Box 766					RE: ECS Job #	: 115		
Spring La	766 Permits: ake, NC 28390 Permits: Accounts Payable Location: Black Oak Place Spring Lake, NC 28390				3390			
		X	Field Reports	<u>X</u>	For you	r use	X	As requested
CC:	W.S. Wellons Realty - Jason Wellons							

ENCL: Field Report # 3 11/9/2022

Elousert

Jack Cowsert, P.E. Office Manager

Aaron Adair Team Leader

Disclaimer

^{1.} This report (and any attachments) shall not be reproduced except in full without prior written approval of ECS.

^{2.} The information in this report relates only to the activities performed on the report date.

^{3.} Where appropriate, this report includes statements as to compliance with applicable project drawings, and specifications for the activities, performed on this report date.

^{4.} Incomplete or non-conforming work will be reported for future resolution.

^{5.} The results of samples and/or specimens obtained or prepared for subsequent laboratory testing will be presented in separate reports/documents.


ECS	ECS Southeast, LLP 6151 Raeford Road, Suite A Fayetteville, NC 28304 (910) 401-3288 [Phone] (910) 323-0539 [Fax]		FIELD F Project No. Report No.			
Project	Wellons Realty Lot 115		Day & Date Weather	Wednesday 11/9/2022 63 °/ Sunny		
Location	Spring Lake, NC		On-Site Time	0.75		
Client	W.S. Wellons Realty	Lab Time Travel Time*	0.00			
Contractor	None Listed		Total Re Obs Time	<u>0.00</u> 0.75 0.00		
Remarks						
Trip Charges*	Tolls/Parking*	Mileage*	Time of	Arrival	Departure	
Chargeable Items				8:45A	9:30A	

ECS arrived on site, as requested, to check the bearing capacity of soils via hand auger/DCP method for stemwall backfill. Please see the attached sketch and data sheet for details.

A hand auger was used to advance the boreholes to different depths noted on the boring logs. Dynamic Cone Penetrometer (DCP) test were performed in the hand auger boreholes by a 1.5 inch diameter cone driven into the soil by a 15 pound ring weight with a free fall of 20 inches. The number of blows required to drive the cone into the soil a distance of 1.75 inches is termed the DCP Value and is indicated for each test on the hand auger.

A total of 1 hand auger/DCP evaluations were performed to a depth of approximately 3 feet below the current footing sub grade elevation. Test results indicated that the materials in place (at the locations and elevations tested) did appear to be suitable to support the design bearing capacity 2,000 psf.

ECS will return upon request.

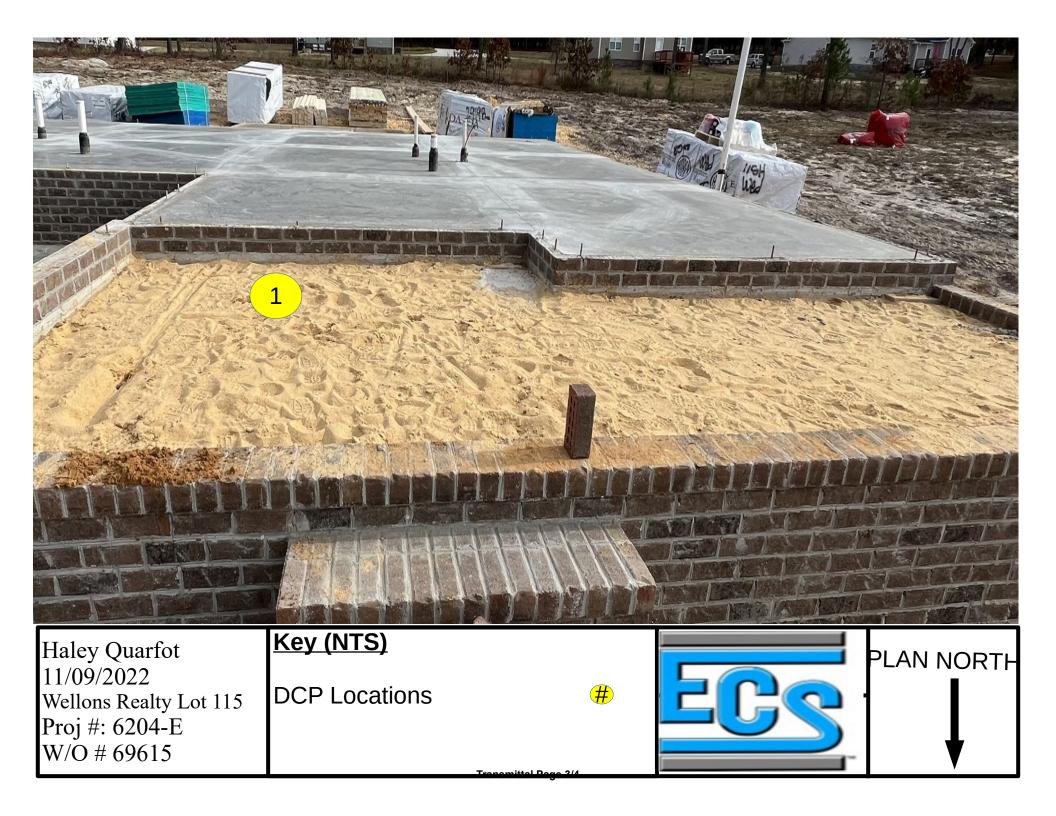

NC Registered Firm # F-1078

Report of Spread Footing - Foundation Observations



Project:Wellons Realty Lot 115Location:Black Oak Place
Spring Lake - Cumberland - NC - 28390

Project No.: 33:6204-E Day/Date: 11/9/2022

Contractor: None Listed

Footing Number	Location	Size (W x H x L)		Footing Bottom Elevation			Decemination of	Required Blow Counts	Desim
		Design	Actual	Design **		Description of Steel Placed	Subdrade	# of Blows / Increment	Design Bearing Pressure
1	Front Porch Stemwall Backfill	хх	хх	N/A	N/A			6 (0-)6,4,5 (-1)5,6,7 (-2) 5,6,9 (-3)15,16,18	2000

** SGE: Subgrade Elevation to be determined by surveyor.

By: Haley Quarfot

ECS Southeast, LLP

WO: 69615