

Trenco
818 Soundside Rd
Edenton, NC 27932

Re: J0822-4269
Lot 146 Hidden Lakes

The truss drawing(s) referenced below have been prepared by Truss Engineering Co. under my direct supervision based on the parameters provided by Comtech, Inc - Fayetteville.

Pages or sheets covered by this seal: I54207109 thru I54207118

My license renewal date for the state of North Carolina is December 31, 2022.

North Carolina COA: C-0844



September 14, 2022

Gilbert, Eric

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

Job J0822-4269	Truss ET1	Truss Type GABLE	Qty 1	Ply 1	Lot 146 Hidden Lakes I54207109
-------------------	--------------	---------------------	----------	----------	-----------------------------------


Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Wed Sep 14 14:14:34 2022 Page 1
ID:UOEEA0AAmG2Au0IN2O4Mtayem4r-OFV_aFF_Zq3eY5MJIOv0h4lh3i1WdWsil1d1TpydzbZ

0₁8

0₁8

Scale = 1:20.3

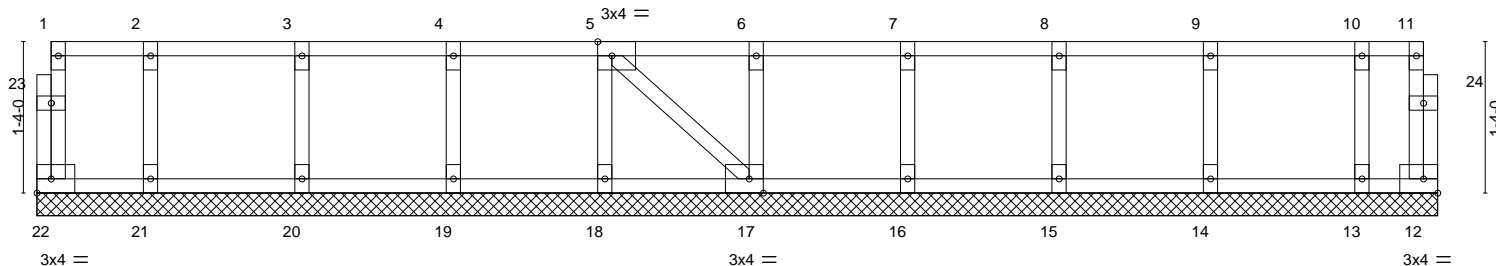

1-0-0	2-4-0	3-8-0	5-0-0	6-4-0	7-8-0	9-0-0	10-4-0	11-8-0	12-4-0
1-0-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	0-8-0

Plate Offsets (X,Y)-- [5:0-1-8,Edge], [17:0-1-8,Edge]					
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.06	Vert(LL) n/a - n/a 999	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.01	Vert(CT) n/a - n/a 999		
BCLL 0.0	Rep Stress Incr YES	WB 0.03	Horz(CT) 0.00 12 n/a n/a		
BCDL 5.0	Code IRC2015/TPI2014	Matrix-S		Weight: 59 lb	FT = 20%F, 11%E

LUMBER-

TOP CHORD 2x4 SP No.1(flat)
 BOT CHORD 2x4 SP No.1(flat)
 WEBS 2x4 SP No.3(flat)
 OTHERS 2x4 SP No.3(flat)

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

All bearings 12-4-0.
 (lb) - Max Grav All reactions 250 lb or less at joint(s) 22, 12, 21, 20, 19, 18, 17, 16, 15, 14, 13

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- All plates are 1.5x3 MT20 unless otherwise indicated.
- Plates checked for a plus or minus 1 degree rotation about its center.
- Gable requires continuous bottom chord bearing.
- Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- Gable studs spaced at 1-4-0 oc.
- Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.



September 14, 2022


Job	Truss	Truss Type	Qty	Ply	Lot 146 Hidden Lakes	I54207110
J0822-4269	ET2	GABLE	1	1		
Comtech, Inc. Fayetteville, NC - 28314,						Job Reference (optional)

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Wed Sep 14 14:14:36 2022 Page 1
ID:UOEEA0AaMG2Au0IN2O4MtayeM4r-Ledk?wGE5RJMnPWitpxUmVq1WWi_5QL?CL68XiydhbX

0-1r8

Scale = 1:30.4

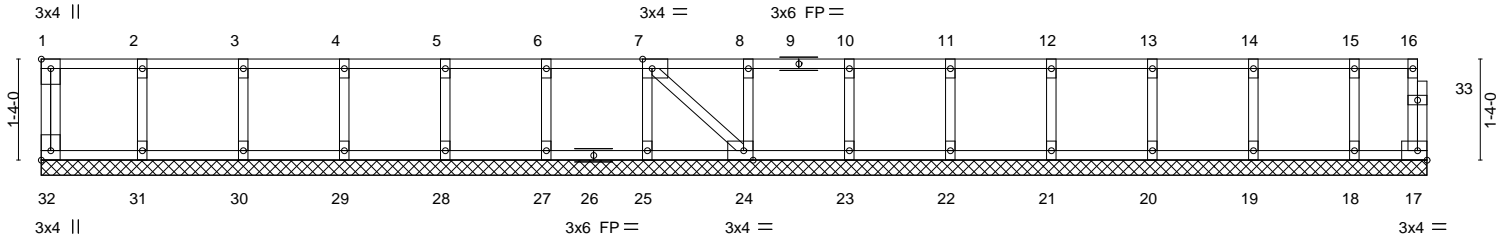

1-4-0	2-8-0	4-0-0	5-4-0	6-8-0	8-0-0	9-4-0	10-8-0	12-0-0	13-4-0	14-8-0	16-0-0	17-4-0	18-3-8
1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	0-11-8

Plate Offsets (X,Y)-- [1:Edge,0-1-8], [7:0-1-8,Edge], [24:0-1-8,Edge], [32:Edge,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.06	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.01	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.00	17	n/a		
BCDL 5.0	Code IRC2015/TPI2014		Matrix-S					Weight: 84 lb	FT = 20%F, 11%E

LUMBER-

TOP CHORD 2x4 SP No.1(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)
OTHERS 2x4 SP No.3(flat)

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

All bearings 18-3-8.

(lb) - Max Grav All reactions 250 lb or less at joint(s) 32, 17, 31, 30, 29, 28, 27, 25, 24, 23, 22, 21, 20, 19, 18

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- All plates are 1.5x3 MT20 unless otherwise indicated.
- Plates checked for a plus or minus 1 degree rotation about its center.
- Gable requires continuous bottom chord bearing.
- Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- Gable studs spaced at 1-4-0 oc.
- Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
- CAUTION, Do not erect truss backwards.



September 14, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 146 Hidden Lakes	I54207111
J0822-4269	F1	Floor	3	1		

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Wed Sep 14 14:14:38 2022 Page 1
 ID:UOEEAoAAmG2AuoIN2O4MtayeM4r-H0IVQcIUd3Z40Jg4_Ezyswv9cKAmZAVIgfbcbydhbV

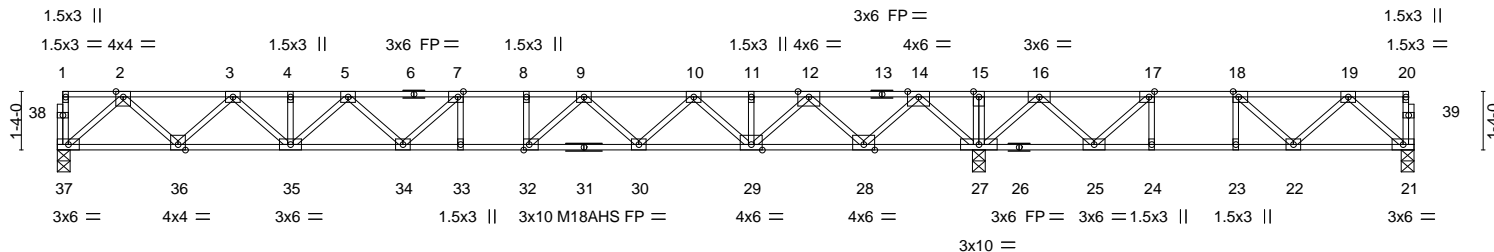

	21-0-0	30-11-0
	21-0-0	9-11-0
Plate Offsets (X, Y)--	[7:0-1-8,Edge], [17:0-1-8,Edge], [18:0-1-8,Edge], [32:0-1-8,Edge]	

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00		TC 0.92	Vert(LL) -0.32	33	>771	480		MT20	244/190
TCDL 10.0	Lumber DOL 1.00		BC 0.95	Vert(CT) -0.44	33	>569	360		M18AHS	186/179
BCLL 0.0	Rep Stress Incr YES		WB 0.69	Horz(CT) 0.07	27	n/a	n/a			
BCDL 5.0	Code IRC2015/TPI2014		Matrix-S							
									Weight: 162 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (size) 37=0-3-8, 27=0-3-8, 21=0-3-8
 Max Uplift 21=-133(LC 3)
 Max Grav 37=1017(LC 10), 27=2125(LC 1), 21=430(LC 4)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-1879/0, 3-4=-3155/0, 4-5=-3155/0, 5-7=-3785/0, 7-8=-3906/0, 8-9=-3906/0,
 9-10=-3227/0, 10-11=-2076/0, 11-12=-2076/0, 12-14=-260/184, 14-15=0/2520,
 15-16=0/2520, 16-17=-224/1413, 17-18=-671/831, 18-19=-603/380
 BOT CHORD 36-37=0/1105, 35-36=0/2622, 34-35=0/3611, 33-34=0/3906, 32-33=0/3906, 30-32=0/3657,
 29-30=0/2788, 28-29=0/1267, 27-28=-1137/0, 25-27=-1825/0, 24-25=-831/671,
 23-24=-831/671, 22-23=-831/671, 21-22=-129/457
 WEBS 2-37=-1469/0, 2-36=0/1076, 3-36=-1034/0, 3-35=0/724, 14-27=-1842/0, 14-28=0/1457,
 12-28=-1434/0, 12-29=0/1134, 10-29=-1001/0, 10-30=0/641, 5-35=-621/0, 5-34=-20/377,
 7-34=-420/202, 9-30=-636/0, 9-32=-49/665, 8-32=-268/0, 16-27=-1091/0, 16-25=0/862,
 17-25=-1104/0, 19-21=-607/171, 19-22=-349/203, 18-22=-92/612, 18-23=-363/0,
 17-24=0/393

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are MT20 plates unless otherwise indicated.
 - 3) All plates are 3x4 MT20 unless otherwise indicated.
 - 4) Plates checked for a plus or minus 1 degree rotation about its center.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 133 lb uplift at joint 21.
 - 6) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 7) CAUTION, Do not erect truss backwards.



September 14, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 146 Hidden Lakes	I54207112
J0822-4269	F2	Floor	1	1		

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Wed Sep 14 14:14:40 2022 Page 1
ID:UOEAAoAAmG2AuoIN2O4MtayeM4r-DP1FrIKI9gpnG0qT6f0QxL?Xl7t5144b7y4MgTydhbT

0-1-8



Scale: 1/4"=1'

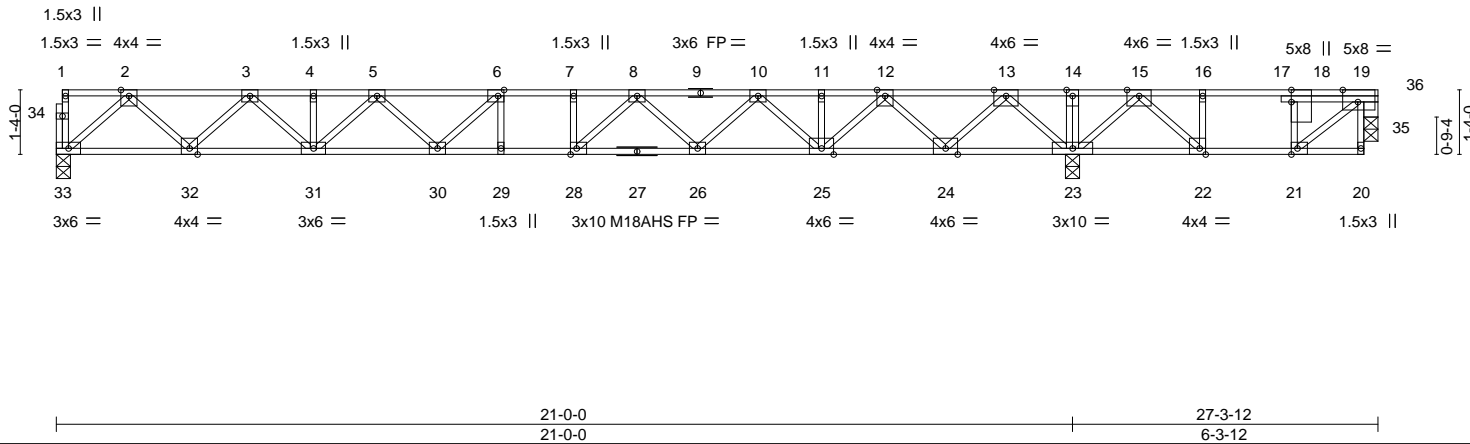


Plate Offsets (X,Y)--	[6:0-1-8,Edge], [18:0-3-0,0-0-0], [19:0-3-12,Edge], [21:0-1-8,Edge], [22:0-1-8,Edge], [28:0-1-8,Edge]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.78	Vert(LL) -0.30 29 >842 480	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.89	Vert(CT) -0.41 29 >618 360	M18AHS	186/179
BCLL 0.0	Rep Stress Incr YES	WB 0.69	Horz(CT) 0.07 23 n/a n/a		
BCDL 5.0	Code IRC2015/TPI2014	Matrix-S			
				Weight: 146 lb	FT = 20%F, 11%E


LUMBER-
TOP CHORD 2x4 SP 2400F 2.0E(flat)
BOT CHORD 2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)
OTHERS 4x4 SP No.2(flat)

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 23-24,22-23,21-22.

REACTIONS. (size) 33=0-3-8, 23=0-3-8, 36=0-3-8
Max Uplift 36=-315(LC 3)
Max Grav 33=1025(LC 10), 23=2032(LC 1), 36=181(LC 4)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1896/0, 3-4=-3192/0, 4-5=-3192/0, 5-6=-3838/0, 6-7=-3974/0, 7-8=-3974/0, 8-10=-3319/0, 10-11=-2183/0, 11-12=-2183/0, 12-13=-393/24, 13-14=0/2143, 14-15=0/2143, 15-16=-94/767, 16-18=-97/807, 18-19=-94/767
BOT CHORD 32-33=0/1115, 31-32=0/2648, 30-31=0/3655, 29-30=0/3974, 28-29=0/3974, 26-28=0/3737, 25-26=0/2886, 24-25=0/1387, 23-24=-783/0, 22-23=-1499/0, 21-22=-767/94
WEBS 18-21=-87/486, 19-21=-1012/98, 2-33=-1481/0, 2-32=0/1087, 3-32=-1045/0, 3-31=0/739, 5-31=-629/0, 5-30=-10/404, 6-30=-447/170, 13-23=-181/10, 13-24=0/1446, 12-24=-1397/0, 12-25=0/1095, 10-25=-969/0, 10-26=0/613, 8-26=-596/0, 8-28=-84/649, 7-28=-282/8, 15-23=-997/0, 15-22=0/1138, 16-22=-613/0, 19-36=-192/295

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are MT20 plates unless otherwise indicated.
 - 3) All plates are 3x4 MT20 unless otherwise indicated.
 - 4) Plates checked for a plus or minus 1 degree rotation about its center.
 - 5) Bearing at joint(s) 36 considers parallel to grain value using ANSII/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 315 lb uplift at joint 36.
 - 7) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 8) CAUTION, Do not erect truss backwards.

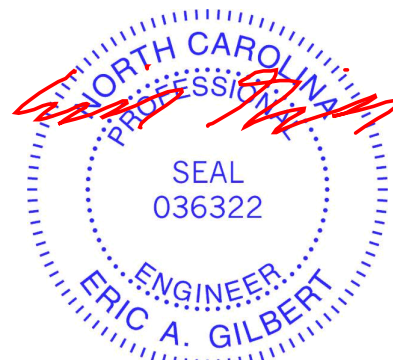

September 14, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932

Job J0822-4269	Truss F3	Truss Type Floor	Qty 2	Ply 1	Lot 146 Hidden Lakes Job Reference (optional)	I54207113
-------------------	-------------	---------------------	----------	----------	--	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Wed Sep 14 14:14:41 2022 Page 1
ID:UOEEAoAAmG2AuoIN2O4MtayeM4r-hbQd2eKNw_xetAPfgMXfTZGxaXBdmXYkMcpvCvydhbS

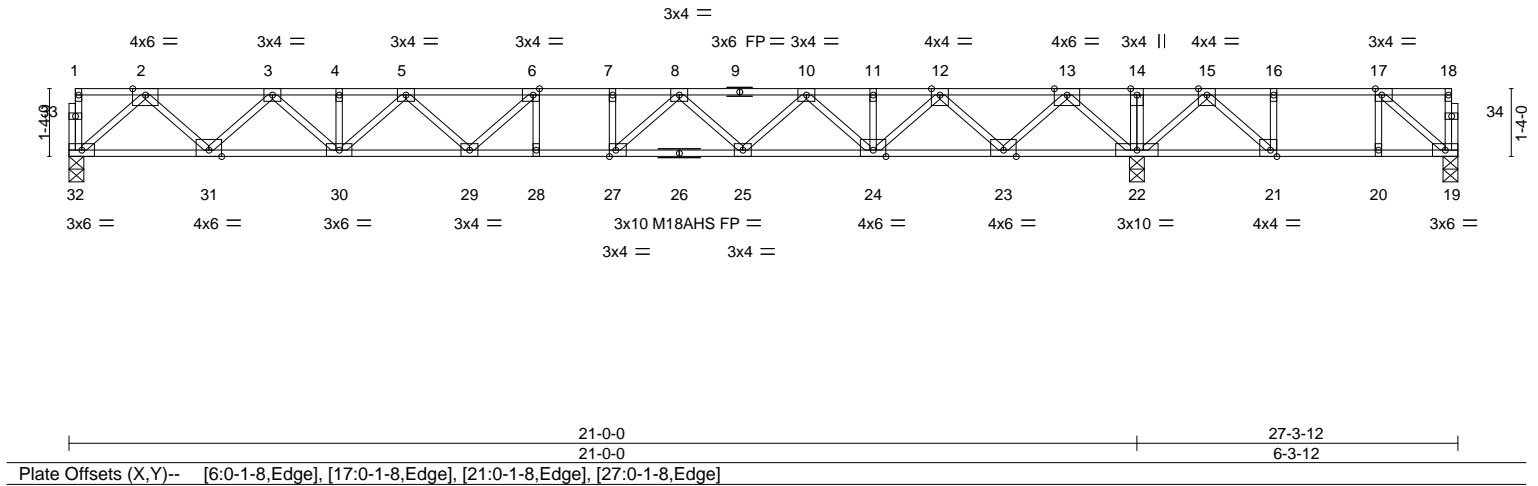

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00		TC 0.94	Vert(LL) -0.35	28	>725	480	MT20	244/190
TCDL 10.0	Lumber DOL 1.00		BC 0.94	Vert(CT) -0.47	28	>532	360	M18AHS	186/179
BCLL 0.0	Rep Stress Incr YES		WB 0.67	Horz(CT) 0.08	22	n/a	n/a		
BCDL 5.0	Code IRC2015/TPI2014		Matrix-S						
								Weight: 144 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1 (flat)	TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1 (flat)	BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing.
WEBS 2x4 SP No.3 (flat)	

REACTIONS. (size) 32=0-3-8, 22=0-3-8, 19=0-3-8
 Max Uplift 19=-208(LC 3)
 Max Grav 32=1053(LC 3), 22=1919(LC 1), 19=210(LC 4)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-1957/0, 3-4=-3312/0, 4-5=-3312/0, 5-6=-4019/0, 6-7=-4201/0, 7-8=-4201/0, 8-10=-3625/0, 10-11=-2545/0, 11-12=-2545/0, 12-13=-817/0, 13-14=0/1732, 14-15=0/1732, 15-16=-141/507, 16-17=-141/507
 BOT CHORD 31-32=0/1146, 30-31=0/2738, 29-30=0/3802, 28-29=0/4201, 27-28=0/4201, 25-27=0/4013, 24-25=0/3219, 23-24=0/1781, 22-23=-392/0, 21-22=-1105/0, 20-21=-507/141, 19-20=-507/141
 WEBS 2-32=-1524/0, 2-31=0/1128, 3-31=-1086/0, 3-30=0/780, 5-30=-666/0, 5-29=0/432, 6-29=-496/151, 13-22=-1784/0, 13-23=0/1416, 12-23=-1361/0, 12-24=0/1057, 10-24=-934/0, 10-25=0/581, 8-25=-560/0, 8-27=-125/614, 15-22=-897/0, 15-21=0/981, 16-21=-475/0, 17-19=-179/671

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are MT20 plates unless otherwise indicated.
 - 3) All plates are 1.5x3 MT20 unless otherwise indicated.
 - 4) Plates checked for a plus or minus 1 degree rotation about its center.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 208 lb uplift at joint 19.
 - 6) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 7) CAUTION, Do not erect truss backwards.



Job	Truss	Truss Type	Qty	Ply	Lot 146 Hidden Lakes	I54207114
J0822-4269	F4	Floor	1	1		
Job Reference (optional)						

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Wed Sep 14 14:14:43 2022 Page 1
ID:UOEEAAmG2AuoIN2O4MtayeM4r-e_YOTKdSbM7UY2nnZ7Z_d0JLs7ES1pwI0HoydhbQ




Plate Offsets (X,Y)--	[6:0-1-8,Edge], [7:0-1-8,Edge], [20:0-1-8,Edge], [21:0-1-8,Edge]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.92	Vert(LL) -0.29 28 >824 480	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 1.00	Vert(CT) -0.39 28-29 >602 360	M18AHS	186/179
BCLL 0.0	Rep Stress Incr YES	WB 0.63	Horz(CT) 0.06 22 n/a n/a	Weight: 144 lb FT = 20%F, 11%E	
BCDL 5.0	Code IRC2015/TPI2014	Matrix-S			

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (size) 32=0-3-8, 22=0-4-15, 19=0-3-8
Max Uplift 19=-138(LC 3)
Max Grav 32=991(LC 10), 22=1840(LC 1), 19=320(LC 4)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1822/0, 3-4=-3042/0, 4-5=-3042/0, 5-6=-3616/0, 6-7=-3700/0, 7-8=-3318/0, 8-9=-2378/0, 9-11=-2378/0, 11-12=-786/0, 12-13=0/1644, 13-14=0/1644, 14-15=-356/583, 15-16=-356/583, 16-17=-356/583
BOT CHORD 31-32=0/1075, 30-31=0/2538, 29-30=0/3473, 28-29=0/3700, 27-28=0/3700, 26-27=0/3700, 24-26=0/2971, 23-24=0/1683, 22-23=-376/0, 21-22=-1119/0, 20-21=-583/356, 19-20=-189/288
WEBS 2-32=-1429/0, 2-31=0/1038, 3-31=-996/0, 3-30=0/685, 5-30=-586/0, 5-29=-18/347, 6-29=400/216, 12-22=-1687/0, 12-23=0/1321, 11-23=-1271/0, 11-24=0/968, 8-24=-825/0, 8-26=0/562, 7-26=-710/0, 7-27=-101/258, 14-22=-873/0, 14-21=0/957, 15-21=-486/0, 17-19=-380/250, 17-20=-536/93, 16-20=-78/262

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are MT20 plates unless otherwise indicated.
 - 3) All plates are 1.5x3 MT20 unless otherwise indicated.
 - 4) Plates checked for a plus or minus 1 degree rotation about its center.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 138 lb uplift at joint 19.
 - 6) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 7) CAUTION, Do not erect truss backwards.

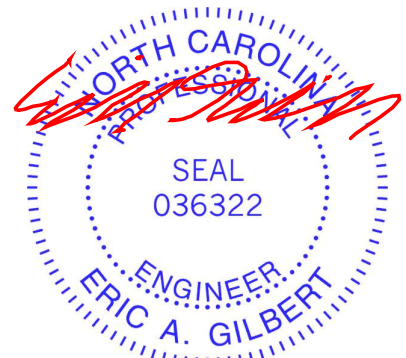

September 14, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 146 Hidden Lakes	154207115
J0822-4269	F5	Floor	5	1		

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Wed Sep 14 14:14:44 2022 Page 1
ID:UOEEAoAAmG2AuoIN2O4MtayeM4r-6A6mngNFDvJDke7ELV4M5B9BikD0zviA2a2ZpEydhpP

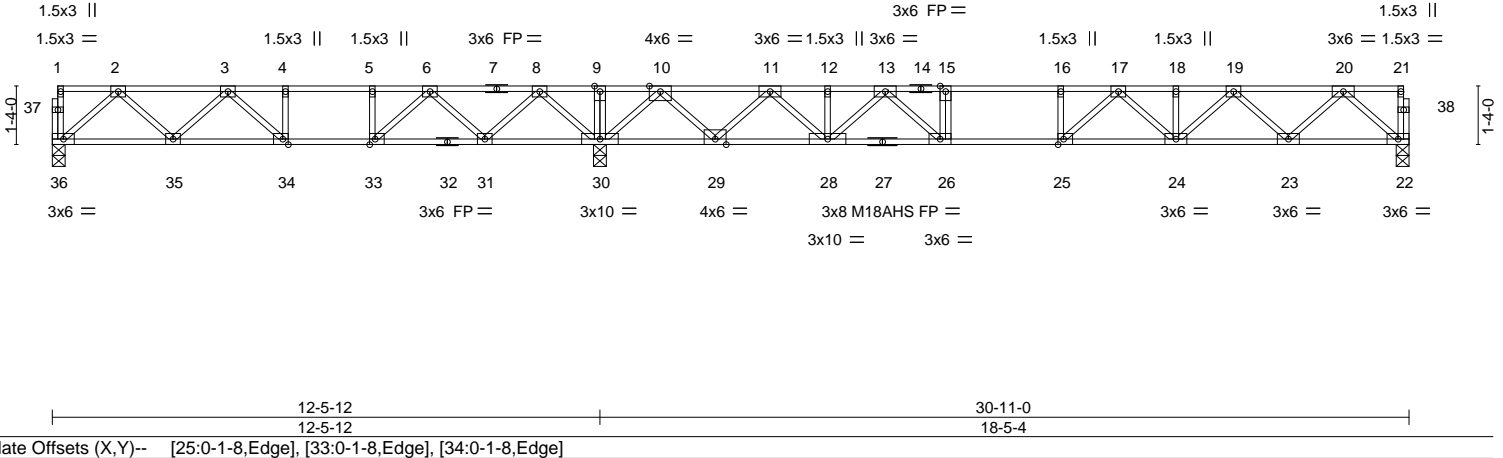

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.91	Vert(LL)	-0.28 24-25	>786	480	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.96	Vert(CT)	-0.38 24-25	>585	360	M18AHS	186/179
BCLL 0.0	Rep Stress Incr	YES	WB 0.58	Horz(CT)	0.05 22	n/a	n/a		
BCDL 5.0	Code IRC2015/TPI2014		Matrix-S						
								Weight: 161 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (size) 30=0-3-8, 36=0-3-8, 22=0-3-8
Max Grav 30=1987(LC 1), 36=594(LC 3), 22=900(LC 4)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-971/0, 3-4=-1303/292, 4-5=-1303/292, 5-6=-1303/292, 6-8=-485/899, 8-9=0/1877, 9-10=0/1877, 10-11=-543/186, 11-12=-2004/0, 12-13=-2004/0, 13-15=-3010/0, 15-16=-3010/0, 16-17=-3010/0, 17-18=-2676/0, 18-19=-2676/0, 19-20=-1624/0

BOT CHORD 35-36=0/628, 34-35=-70/1264, 33-34=-292/1303, 31-33=-627/966, 30-31=-1158/0, 29-30=-766/0, 28-29=0/1368, 26-28=0/2506, 25-26=0/3010, 24-25=0/2948, 23-24=0/2254, 22-23=0/972

WEBS 2-36=-834/0, 2-35=-18/476, 3-35=-408/111, 8-30=-1199/0, 8-31=0/804, 6-31=-837/0, 6-33=0/818, 3-34=-346/53, 5-33=-389/0, 20-22=-1292/0, 20-23=0/906, 19-23=-877/0, 19-24=0/573, 10-30=-1616/0, 10-29=0/1225, 11-29=-1181/0, 11-28=0/900, 13-28=-722/0, 13-26=0/905, 17-24=-370/0, 17-25=-216/353, 15-26=-439/0

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are MT20 plates unless otherwise indicated.
 - 3) All plates are 3x4 MT20 unless otherwise indicated.
 - 4) Plates checked for a plus or minus 1 degree rotation about its center.
 - 5) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 6) CAUTION, Do not erect truss backwards.





September 14, 2022

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	<p>818 Soundside Road Edenton, NC 27932</p>
--	---


Job	Truss	Truss Type	Qty	Ply	Lot 146 Hidden Lakes
J0822-4269	F6	Floor	6	1	I54207116
					Job Reference (optional)

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Wed Sep 14 14:14:45 2022 Page 1
ID:UOEEAaAmG2AuolN2O4Mtayem4r-aMg8u?NtzCR4MoiRvCbbePiW18idiRvKHEn7MhydhbO



Scale = 1:20.4

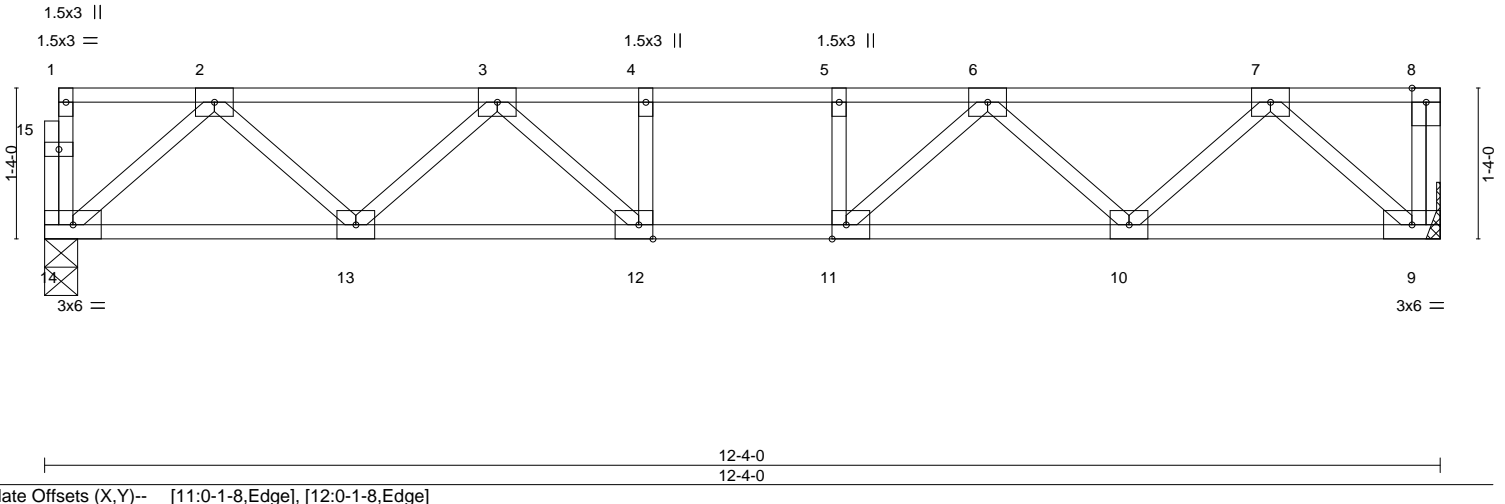

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL	1.00	TC 0.27	Vert(LL)	-0.06	10-11	>999	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.36	Vert(CT)	-0.08	10-11	>999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.27	Horz(CT)	0.02	9	n/a		
BCDL 5.0	Code IRC2015/TPI2014		Matrix-S						
								Weight: 66 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1 (flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1 (flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3 (flat)	

REACTIONS. (size) 14=0-3-8, 9=Mechanical
Max Grav 14=658(LC 1), 9=665(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1102/0, 3-4=-1638/0, 4-5=-1638/0, 5-6=-1638/0, 6-7=-1102/0
BOT CHORD 13-14=0/700, 12-13=0/1474, 11-12=0/1638, 10-11=0/1473, 9-10=0/701
WEBS 2-14=-930/0, 2-13=0/559, 3-13=-517/0, 7-9=-933/0, 7-10=0/559, 6-11=-516/0, 6-11=0/398, 3-12=0/398

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) Plates checked for a plus or minus 1 degree rotation about its center.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 6) CAUTION, Do not erect truss backwards.



September 14, 2022

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	<p>818 Soundside Road Edenton, NC 27932</p>
--	---

Job J0822-4269	Truss F7	Truss Type Floor	Qty 6	Ply 1	Lot 146 Hidden Lakes Job Reference (optional)	I54207117
-------------------	-------------	---------------------	----------	----------	--	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Wed Sep 14 14:14:46 2022 Page 1

ID:UOEEAoAAmG2AuoIN2O4MtayeM4r-2ZEW5LOWkWZx_xHdSw7qAcFbaYxpRrTVuXgu7ydhbN

1-3-0

2-3-8

0-1-8

Scale = 1:30.7

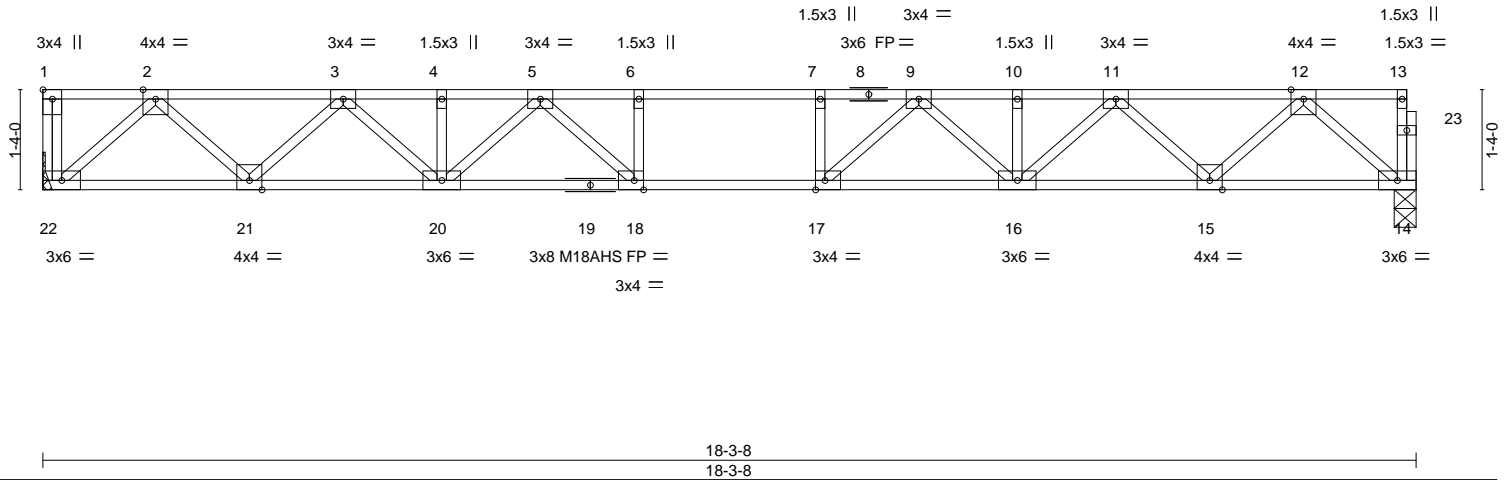


Plate Offsets (X,Y)--	[1:Edge,0-1-8], [17:0-1-8,Edge], [18:0-1-8,Edge]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.66	Vert(LL) -0.24 18-20 >885 480	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.81	Vert(CT) -0.33 18-20 >658 360	M18AHS	186/179
BCLL 0.0	Rep Stress Incr YES	WB 0.49	Horz(CT) 0.06 14 n/a n/a		
BCDL 5.0	Code IRC2015/TPI2014	Matrix-S		Weight: 96 lb	FT = 20%F, 11%E

LUMBER-

TOP CHORD 2x4 SP No.1(flat)
 BOT CHORD 2x4 SP No.1(flat)
 WEBS 2x4 SP No.3(flat)

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


(size) 22=Mechanical, 14=0-3-8
 Max Grav 22=992(LC 1), 14=986(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1812/0, 3-4=-3034/0, 4-5=-3034/0, 5-6=-3661/0, 6-7=-3661/0, 7-9=-3661/0, 9-10=-3034/0, 10-11=-3034/0, 11-12=-1811/0
 BOT CHORD 21-22=0/1071, 20-21=0/2523, 18-20=0/3407, 17-18=0/3661, 16-17=0/3407, 15-16=0/2523, 14-15=0/1071
 WEBS 2-22=-1426/0, 2-21=0/1030, 3-21=-989/0, 3-20=0/696, 12-14=-1423/0, 12-15=0/1030, 11-15=-989/0, 11-16=0/695, 9-16=-507/0, 9-17=-40/665, 5-20=-507/0, 5-18=-40/665, 6-18=-338/0, 7-17=-338/0

NOTES-

- Unbalanced floor live loads have been considered for this design.
- All plates are MT20 plates unless otherwise indicated.
- Plates checked for a plus or minus 1 degree rotation about its center.
- Refer to girder(s) for truss to truss connections.
- Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
- CAUTION, Do not erect truss backwards.

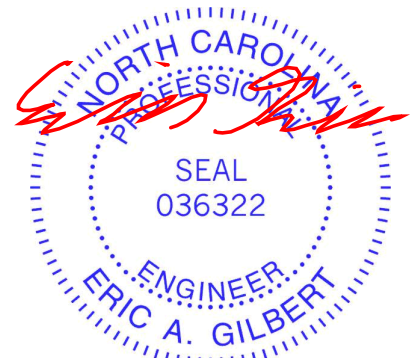

September 14, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 146 Hidden Lakes	I54207118
J0822-4269	FG1	Floor	1	1		

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Wed Sep 14 14:14:47 2022 Page 1
 ID:UOEEAoaAmG2AuolN2O4Mtayem4r-WlowJhP8Vqhoc5sp0de3jqnp9yLgAHCdkYGDQZydhbM



0-1-8
 Scale = 1:16.8

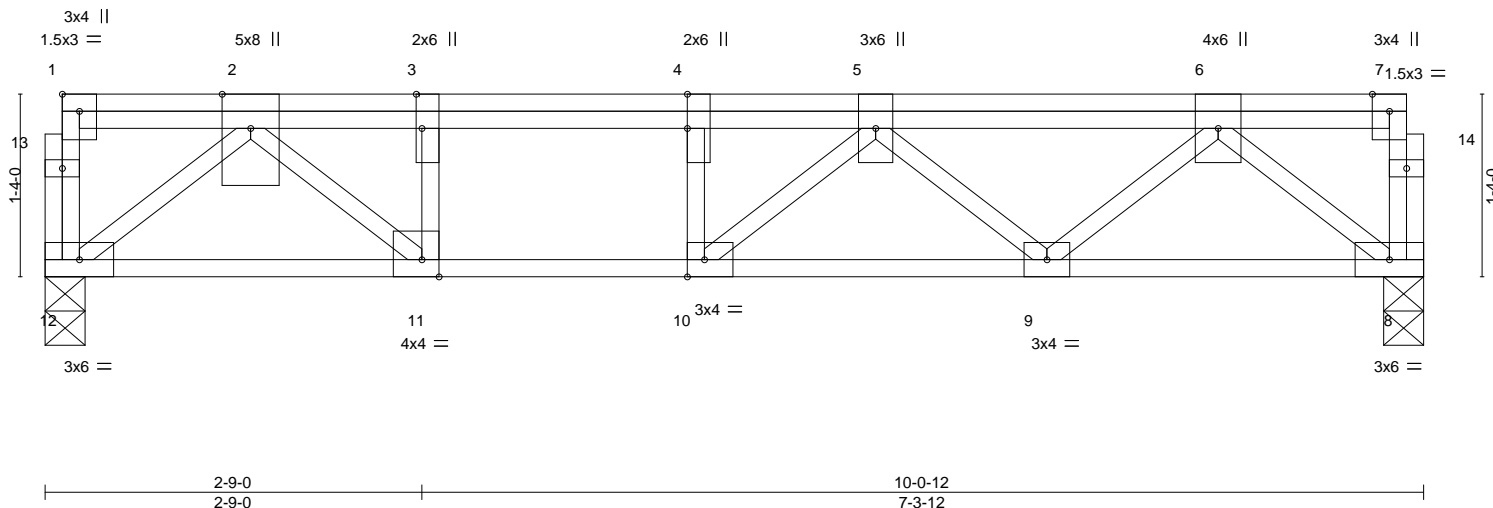


Plate Offsets (X,Y)--	[1:Edge,0-1-8], [3:0-3-0,Edge], [4:0-3-0,Edge], [10:0-1-8,Edge], [11:0-1-8,Edge]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.48	Vert(LL) -0.07 9-10 >999 480	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.58	Vert(CT) -0.10 9-10 >999 360		
BCLL 0.0	Rep Stress Incr NO	WB 0.54	Horz(CT) 0.02 8 n/a n/a		
BCDL 5.0	Code IRC2015/TPI2014	Matrix-S		Weight: 67 lb	FT = 20%F, 11%E


LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (size) 12=0-3-8, 8=0-3-8
 Max Grav 12=691(LC 1), 8=775(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-1549/0, 3-4=-1549/0, 4-5=-1549/0, 5-6=-1434/0
 BOT CHORD 11-12=0/713, 10-11=0/1549, 9-10=0/1949, 8-9=0/866
 WEBS 2-12=-922/0, 2-11=0/1124, 3-11=-659/0, 6-8=-1124/0, 6-9=0/771, 5-9=-698/0,
 5-10=-612/29, 4-10=-12/362

- NOTES-**
- Unbalanced floor live loads have been considered for this design.
 - Plates checked for a plus or minus 1 degree rotation about its center.
 - Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 400 lb down at 6-4-0 on top chord. The design/selection of such connection device(s) is the responsibility of others.
 - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).


LOAD CASE(S) Standard
 1) Dead + Floor Live (balanced): Lumber Increase=1.00, Plate Increase=1.00
 Uniform Loads (plf)
 Vert: 8-12=-10, 1-7=-100
 Concentrated Loads (lb)
 Vert: 5=400(B)

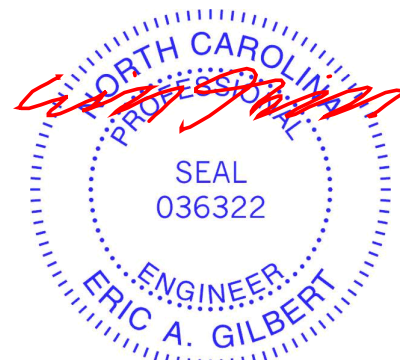


September 14, 2022

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.

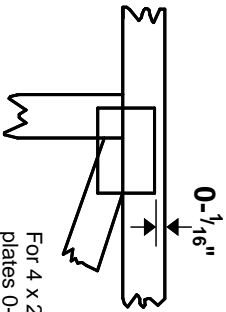

For 4 x 2 orientation, locate plates 0- 1/16" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

* Plate location details available in **MITek 20/20 software** or upon request.

PLATE SIZE

4 X 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING



Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur. Min size shown is for crushing only.

Industry Standards:

ANSI/TFP 1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-89: Design Standard for Bracing, Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

6-4-8
dimensions shown in ft-in-sixteenths
(Drawings not to scale)



JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ESR1988
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TFP 1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MITteK® All Rights Reserved



MITek Engineering Reference Sheet: MII-7473 rev. 5/19/2020



General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TFP 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TFP 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Rewriting pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TFP 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.