

ECS Southeast, LLP

6151 Raeford Road, Suite A Fayetteville, NC 28304 9104013288 9103230539

LETTER OF TRANSMITTAL

November 29, 2022

Precision Custom Homes

Raeford, NC 28376

CC:

ATTN: Shaun Gardner

RE: Liberty Meadows Lot 6

ECS Job # 33:6122-N

Permits:

Location: 128 Solomon Dr.

Cameron, NC 28326

Field Reports

X For your use

X As requested

Precision Custom Homes - Allen Peterson

Precision Custom Homes - Lauren Ceruti

ENCL: Field Report # 1 11/29/2022

ÑOV 29 2022

Office Manager

Jack Cowser

Aaron Adair Team Leader

Disclaimer

^{1.} This report (and any attachments) shall not be reproduced except in full without prior written approval of ECS.

^{2.} The information in this report relates only to the activities performed on the report date.

^{3.} Where appropriate, this report includes statements as to compliance with applicable project drawings, and specifications for the activities, performed on this report date.

^{4.} Incomplete or non-conforming work will be reported for future resolution.

^{5.} The results of samples and/or specimens obtained or prepared for subsequent laboratory testing will be presented in separate reports/documents.



ECS Southeast, LLP 6151 Raeford Road, Suite A Fayetteville, NC 28304 (910) 401-3288 [Phone] (910) 323-0539 [Fax]

Project Liberty Meadows Lot 6

Location Cameron, NC

Client Precision Custom Homes

Contractor Precision Custom Homes

FIELD REPORT

Project No. **33:6122-N**

Report No. 1

Day & Date **Tuesday 11/29/2022**

Weather 70 °/ Sunny

On-Site Time 1.25

Lab Time 0.00

Travel Time* 0.00

Total 1.25

Re Obs Time 0.00

Remarks

Trip Charges* Tolls/Parking* Mileage* Time of Arrival Departure

Chargeable Items 10:45A 12:00P

* Travel time and mileage will be billed in accordance with the contract.

Summary of Services Performed (field test data, locations, elevations & depths are estimates) & Individuals Contacted.

ECS arrived on site, as requested, to check the bearing capacity of soils via hand auger/DCP method for stem-wall backfill. Please see the attached sketch and data sheet for details.


A hand auger was used to advance the boreholes to different depths noted on the boring logs. Dynamic Cone Penetrometer (DCP) test were performed in the hand auger boreholes by a 1.5 inch diameter cone driven into the soil by a 15 pound ring weight with a free fall of 20 inches. The number of blows required to drive the cone into the soil a distance of 1.75 inches is termed the DCP Value and is indicated for each test on the hand auger.

A total of 3 hand auger/DCP evaluations were performed to a depth of approximately 3 feet below the current footing sub grade elevation. Test results indicated that the materials in place (at the locations and elevations tested) did appear to be suitable to support the design bearing capacity 2,000 psf.

ECS will return, as requested, for additional services.

Sharieff SULAIMAN 11/29/22 PROJ #6122-N

Attachments

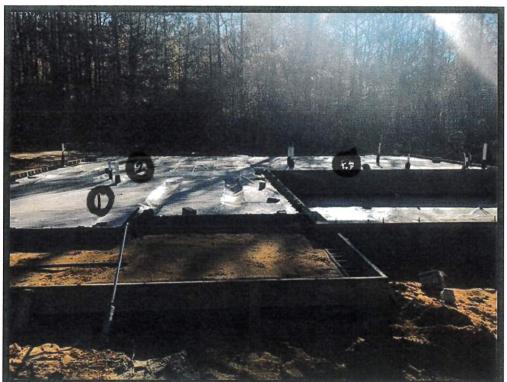

IMG_0030[1]

Figure 1

Key (NTS)

DCP LOCATIONS

NC Registered Firm # F-1078



Report of Spread Footing - Foundation Observations

Project:Liberty Meadows Lot 6Project No.:33:6122-NLocation:128 Solomon Dr.Day/Date:11/29/2022

Cameron - Harnett - NC - 28326

Contractor: Precision Custom Homes

Footing Number	Location	Size (W x H x L)		Footing Bottom Elevation			December 11 and a 5	Required Blow Counts	D
		Design	Actual	Design **	Depth of Undercut (in)	Description of Steel Placed	Sunarana	# of Blows / Increment	Design Bearing Pressure
1	South West	хх	хх	N/A	0,-1,-2,-3		sand (-2,-3)grey	6 (0)4-6-7(-1)7-7-13(-2)8- 8-8(-3)25+	2000
2	North West	хх	хх	N/A	0,-1,-2,-3		(-1,-2,-3)grey	6 (0)6-6-8(-1)7-7-11(-2)9- 11-10(-3)25+	2000
3	North East	хх	хх	N/A	0,-1,-2,-3		(0,-1,-2,-3) brown sand	6 (0)5-7-7(-1)13-12-13(-2) 13-17-21(-3)25+	2000

^{**} SGE: Subgrade Elevation to be determined by surveyor.

Ву:	Sulaiman Sharieff						
	ECS Southeast, LLP						

WO: 69877