

Trenco  
818 Soundside Rd  
Edenton, NC 27932

Re: PCK101  
MATTAMYHOMES/ALLEGHENY; LOT 101 PROVIDENCE CREEK

The truss drawing(s) referenced below have been prepared by Truss Engineering Co. under my direct supervision based on the parameters provided by Builders FirstSource-Apex,NC.

Pages or sheets covered by this seal: I53641773 thru I53641810

My license renewal date for the state of North Carolina is December 31, 2022.

North Carolina COA: C-0844



August 15, 2022

Gilbert, Eric

**IMPORTANT NOTE:** The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

Job PCK101	Truss A01G	Truss Type GABLE	Qty 1	Ply 1	MATTAMYHOMES/ALLEGHENY; LOT 101 PROVIDENCE CREEK 153641773
---------------	---------------	---------------------	----------	----------	---


Builders FirstSource (Apex, NC), Apex, NC - 27523,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Aug 12 12:37:55 2022 Page 1

ID: \_P7X\_GPFncKXXgca6LM05wyocTp-GOVmj0bcpKEA7\_fkcvSDHI?rG3LcRGLSqtVJfJyob6A

-1-0-0 25-0-0 49-9-0  
1-0-0 25-0-0 24-9-0

Scale = 1:85.9

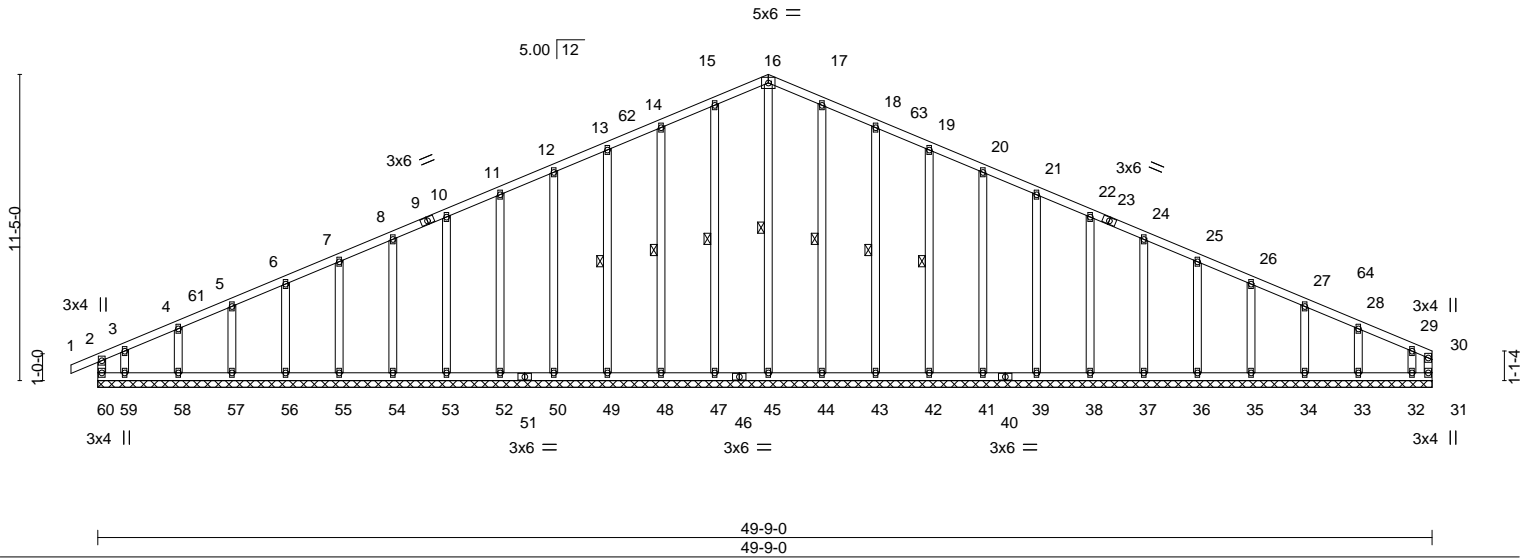

<b>LOADING</b> (psf)	<b>SPACING-</b> 2-0-0	<b>CSI.</b>	<b>DEFL.</b> in (loc) l/defl L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 20.0	Plate Grip DOL 1.15	TC 0.18	Vert(LL) -0.00 1 n/r 120	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.09	Vert(CT) -0.00 1 n/r 120		
BCLL 0.0 *	Rep Stress Incr NO	WB 0.14	Horz(CT) 0.01 31 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-R		Weight: 368 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.3  
OTHERS 2x4 SP No.3

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.  
WEBS 1 Row at midpt 16-45, 15-47, 14-48, 13-49, 17-44, 18-43, 19-42

**REACTIONS.** All bearings 49-9-0.  
(lb) - Max Horz 60=131(LC 12)  
Max Uplift All uplift 100 lb or less at joint(s) 60, 31, 47, 48, 49, 50, 52, 53, 54, 55, 56, 57, 58, 44, 43, 42, 41, 39, 38, 37, 36, 35, 34, 33 except 59=159(LC 12), 32=167(LC 13)  
Max Grav All reactions 250 lb or less at joint(s) 60, 31, 45, 47, 48, 49, 50, 52, 53, 54, 55, 56, 57, 58, 59, 44, 43, 42, 41, 39, 38, 37, 36, 35, 34, 33, 32

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 13-14=-94/275, 14-15=-105/307, 15-16=-115/333, 16-17=-115/325, 17-18=-105/299, 18-19=-94/267

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) -1-0-0 to 3-11-11, Exterior(2) 3-11-11 to 25-0-0, Corner(3) 25-0-0 to 29-11-11, Exterior(2) 29-11-11 to 49-7-4 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
  - 4) All plates are 2x4 MT20 unless otherwise indicated.
  - 5) Gable requires continuous bottom chord bearing.
  - 6) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
  - 7) Gable studs spaced at 2-0-0 oc.
  - 8) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 9) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - 10) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 60, 31, 47, 48, 49, 50, 52, 53, 54, 55, 56, 57, 58, 44, 43, 42, 41, 39, 38, 37, 36, 35, 34, 33 except (jt=lb) 59=159, 32=167.



August 15, 2022

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road  
Edenton, NC 27932

Job PCK101	Truss A02	Truss Type COMMON	Qty 9	Ply 1	MATTAMYHOMES/ALLEGHENY; LOT 101 PROVIDENCE CREEK 153641774
---------------	--------------	----------------------	----------	----------	---

Builders FirstSource, Apex, NC

ID: \_P7X\_GPFncXXgca6LM05wyocTp-WDIdQFujjRCsLBut?JTZCburj1NjTnHmXc5plyoaqn  
8.530 s May 26 2022 MITek Industries, Inc. Fri Aug 12 12:56:28 2022 Page 1



Scale = 1:84.4

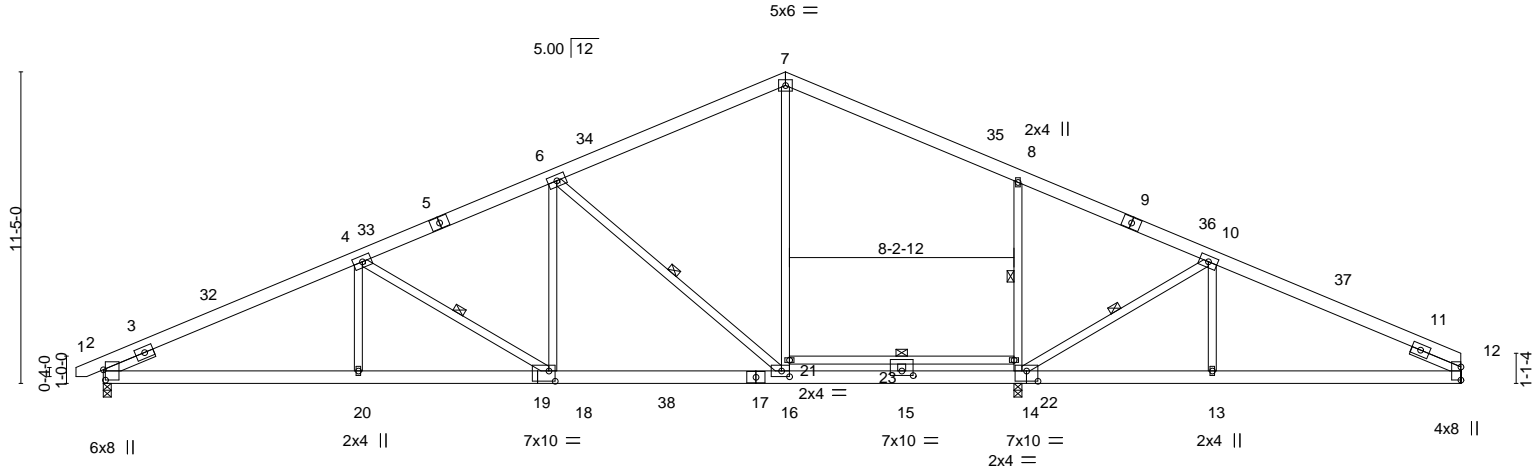


Plate Offsets (X,Y)--	[2:0-4-9,0-0-14], [14:0-5-0,0-4-8], [15:0-5-0,0-2-0], [16:0-3-8,0-2-8], [19:0-2-12,0-4-8]
-----------------------	---

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.85	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.89	Vert(LL) -0.18 16-18 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.85	Vert(CT) -0.38 16-18 >999 240		
BCDL 10.0	Rep Stress Incr NO	Matrix-MS	Horz(CT) 0.12 12 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.08 16-18 >999 240		
				Weight: 352 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.2	TOP CHORD Structural wood sheathing directly applied or 2-9-9 oc purlins.
BOT CHORD 2x6 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	WEBS 1 Row at midpt 4-18, 6-16, 10-14, 21-22, 8-14
SLIDER Left 2x4 SP No.3 1-11-12, Right 2x4 SP No.3 1-11-12	

**REACTIONS.** (size) 2=0-3-8, 14=0-3-8, 12=Mechanical  
 Max Horz 2=131(LC 12)  
 Max Uplift 2=-5(LC 12), 14=-51(LC 13)  
 Max Grav 2=1695(LC 1), 14=1076(LC 1), 12=1258(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 2-3=-1080/0, 3-32=-3037/55, 4-32=-2929/79, 4-33=-2551/91, 5-33=-2537/95,  
 5-6=-2427/124, 6-34=-1779/111, 7-34=-1687/146, 7-35=-1683/160, 8-35=-1781/125,  
 8-9=-1590/72, 9-36=-1664/43, 10-36=-1713/43, 10-37=-2019/59, 11-37=-2117/37,  
 11-12=-696/0  
 BOT CHORD 2-20=-14/2704, 19-20=-14/2704, 18-19=-14/2704, 18-38=0/2304, 17-38=0/2304,  
 16-17=0/2304, 15-16=0/1617, 14-15=0/1617, 13-14=0/1863, 12-13=0/1863  
 WEBS 4-20=0/252, 4-18=-526/113, 6-18=0/520, 6-16=-1050/104, 16-21=0/901, 7-21=0/983,  
 10-14=-575/153, 14-22=-547/169, 8-22=-568/171

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-9-10 to 4-2-1, Interior(1) 4-2-1 to 25-0-0, Exterior(2) 25-0-0 to 32-0-7, Interior(1) 32-0-7 to 49-9-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) All plates are 5x8 MT20 unless otherwise indicated.
  - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 5) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - 6) Refer to girder(s) for truss to truss connections.
  - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 5 lb uplift at joint 2 and 51 lb uplift at joint 14.
  - 8) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - 9) N/A
  - 10) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

**LOAD CASE(S)**

August 15, 2022

Continued on page 2

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**  
 Design valid for use only with MITek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



Job	Truss	Truss Type	Qty	Ply	MATTAMYHOMES/ALLEGHENY; LOT 101 PROVIDENCE CREEK 153641774
PCK101	A02	COMMON	9	1	Job Reference (optional)

Builders FirstSource, Apex, NC

8:530 s May 26 2022 MiTek Industries, Inc. Fri Aug 12 12:56:28 2022 Page 2  
ID: \_P7X\_GPFnckXXgca6LM05wyocTp-WDIdQFujRCsLbute?JTZCbunj1NjTnHmXc5plyoagqn

### LOAD CASE(S)

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-7=-60, 7-12=-60, 24-28=-20
- 2) Dead + 0.75 Roof Live (balanced) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-7=-50, 7-12=-50, 18-24=-20, 18-38=-50, 28-38=-20, 21-22=-30(F)
- 3) Dead + Uninhabitable Attic Without Storage: Lumber Increase=1.25, Plate Increase=1.25  
Uniform Loads (plf)  
Vert: 1-7=-20, 7-12=-20, 24-28=-40, 21-22=-40(F)
- 4) Dead + 0.6 C-C Wind (Pos. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-2=42, 2-32=22, 7-32=12, 7-35=22, 12-35=12, 24-28=-12  
Horz: 1-2=-54, 2-32=-34, 7-32=-24, 7-35=34, 12-35=24
- 5) Dead + 0.6 C-C Wind (Pos. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-2=8, 2-34=12, 7-34=22, 7-37=12, 12-37=22, 24-28=-12  
Horz: 1-2=-20, 2-34=-24, 7-34=-34, 7-37=24, 12-37=34
- 6) Dead + 0.6 C-C Wind (Neg. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-2=-13, 2-7=-32, 7-12=-32, 24-28=-20  
Horz: 1-2=-7, 2-7=12, 7-12=-12
- 7) Dead + 0.6 C-C Wind (Neg. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-2=-27, 2-7=-32, 7-12=-32, 24-28=-20  
Horz: 1-2=7, 2-7=12, 7-12=-12
- 8) Dead + 0.6 MWFRS Wind (Pos. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-2=20, 2-7=10, 7-12=8, 24-28=-12  
Horz: 1-2=-32, 2-7=-22, 7-12=20
- 9) Dead + 0.6 MWFRS Wind (Pos. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-2=4, 2-7=8, 7-12=10, 24-28=-12  
Horz: 1-2=-16, 2-7=-20, 7-12=22
- 10) Dead + 0.6 MWFRS Wind (Neg. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-2=-2, 2-7=-7, 7-12=-8, 24-28=-20  
Horz: 1-2=-18, 2-7=-13, 7-12=12
- 11) Dead + 0.6 MWFRS Wind (Neg. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-2=-4, 2-7=-8, 7-12=-7, 24-28=-20  
Horz: 1-2=-16, 2-7=-12, 7-12=13
- 12) Dead + 0.6 MWFRS Wind (Pos. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-2=14, 2-33=19, 7-33=9, 7-12=2, 24-28=-12  
Horz: 1-2=-26, 2-33=-31, 7-33=-21, 7-12=14
- 13) Dead + 0.6 MWFRS Wind (Pos. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-2=-3, 2-7=2, 7-36=9, 12-36=19, 24-28=-12  
Horz: 1-2=-9, 2-7=-14, 7-36=21, 12-36=31
- 14) Dead + 0.6 MWFRS Wind (Pos. Internal) 3rd Parallel: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-2=5, 2-7=9, 7-12=2, 24-28=-12  
Horz: 1-2=-17, 2-7=-21, 7-12=14
- 15) Dead + 0.6 MWFRS Wind (Pos. Internal) 4th Parallel: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-2=-3, 2-7=2, 7-12=9, 24-28=-12  
Horz: 1-2=-9, 2-7=-14, 7-12=21
- 16) Dead + 0.6 MWFRS Wind (Neg. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-2=6, 2-33=2, 7-33=-7, 7-12=-15, 24-28=-20  
Horz: 1-2=-26, 2-33=-22, 7-33=-13, 7-12=5
- 17) Dead + 0.6 MWFRS Wind (Neg. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-2=-11, 2-7=-15, 7-36=-7, 12-36=2, 24-28=-20  
Horz: 1-2=-9, 2-7=-5, 7-36=13, 12-36=22
- 18) Dead + Uninhabitable Attic Storage: Lumber Increase=1.25, Plate Increase=1.25  
Uniform Loads (plf)  
Vert: 1-7=-20, 7-12=-20, 18-24=-20, 18-38=-60, 28-38=-20, 21-22=-40(F)
- 19) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) Left): Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-2=-37, 2-7=-40, 7-12=-41, 18-24=-20, 18-38=-50, 28-38=-20, 21-22=-30(F)  
Horz: 1-2=-13, 2-7=-10, 7-12=9
- 20) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) Right): Lumber Increase=1.60, Plate Increase=1.60

Continued on page 3

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road  
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	MATTAMYHOMES/ALLEGHENY; LOT 101 PROVIDENCE CREEK
PCK101	A02	COMMON	9	1	I53641774
					Job Reference (optional)

Builders FirstSource, Apex, NC

8.530 s May 26 2022 MiTek Industries, Inc. Fri Aug 12 12:56:28 2022 Page 3  
 ID: \_P7X\_GPFnckXXgca6LM05wyocTp-WDIdQFUiJRCSLBut?JTZCbunj1NjTnHmXc5plyoaqn

**LOAD CASE(S)**

Uniform Loads (plf)

Vert: 1-2=-38, 2-7=-41, 7-12=-40, 18-24=-20, 18-38=-50, 28-38=-20, 21-22=-30(F)

Horz: 1-2=-12, 2-7=-9, 7-12=10

21) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 1-2=-30, 2-33=-34, 7-33=-41, 7-12=-46, 18-24=-20, 18-38=-50, 28-38=-20, 21-22=-30(F)

Horz: 1-2=-20, 2-33=-16, 7-33=-9, 7-12=4

22) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 1-2=-43, 2-7=-46, 7-36=-41, 12-36=-34, 18-24=-20, 18-38=-50, 28-38=-20, 21-22=-30(F)

Horz: 1-2=-7, 2-7=-4, 7-36=9, 12-36=16

23) 1st Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-7=-60, 7-12=-20, 24-28=-20

24) 2nd Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-7=-20, 7-12=-60, 24-28=-20

25) 3rd Dead + 0.75 Roof Live (unbalanced) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-7=-50, 7-12=-20, 18-24=-20, 18-38=-50, 28-38=-20, 21-22=-30(F)

26) 4th Dead + 0.75 Roof Live (unbalanced) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-7=-20, 7-12=-50, 18-24=-20, 18-38=-50, 28-38=-20, 21-22=-30(F)

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road  
 Edenton, NC 27932


Job PCK101	Truss A02A	Truss Type COMMON	Qty 1	Ply 1	MATTAMYHOMES/ALLEGHENY; LOT 101 PROVIDENCE CREEK 153641775
---------------	---------------	----------------------	----------	----------	---

Builders FirstSource (Apex, NC), Apex, NC - 27523, 8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Aug 12 12:37:58 2022 Page 1

ID: P7X\_GPFncXXgca6LM05wyocTp-gzBuL2eV6Fcl\_ROJ11PwwOdHDGHheVwuXrjNseyob67



Scale = 1:84.4

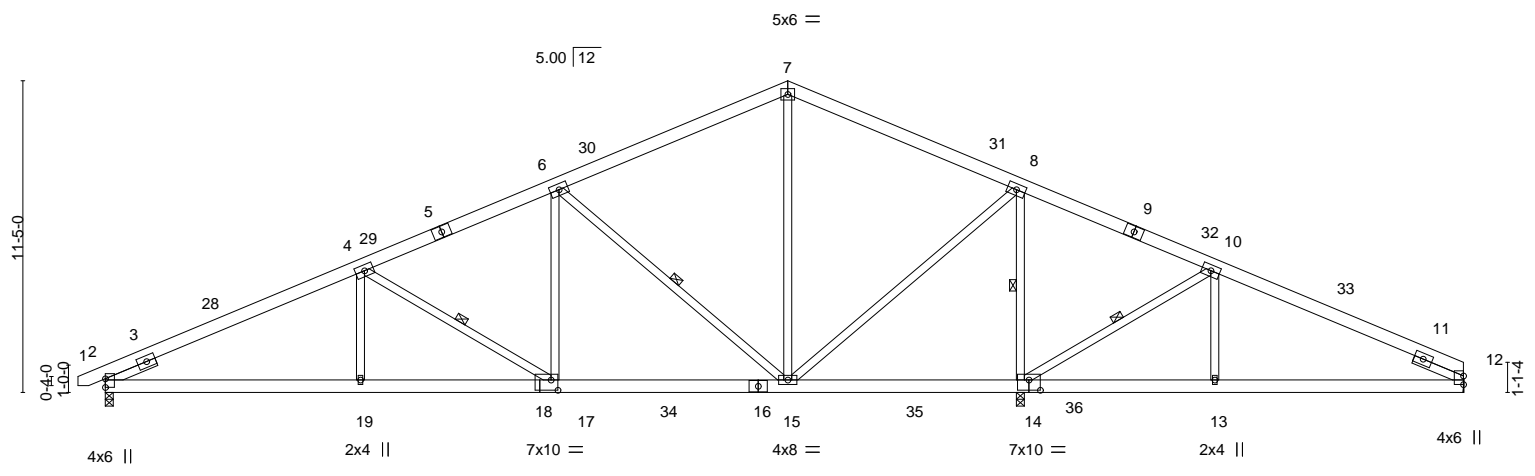

	9-4-3	16-5-11	25-0-0	33-6-4	40-7-11	49-9-0	49-9-4
	9-4-3	7-1-8	8-6-5	8-6-4	7-1-7	9-1-5	0-0-4

Plate Offsets (X,Y)-- [14:0-5-0,0-4-8], [18:0-3-0,0-4-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.45	Vert(LL)	-0.08 17-19	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.51	Vert(CT)	-0.17 17-19	>999	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.66	Horz(CT)	0.04 14	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MS	Wind(LL)	0.04 17-19	>999	240		

Weight: 355 lb FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.2	TOP CHORD Structural wood sheathing directly applied or 4-2-6 oc purlins.
BOT CHORD 2x6 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing. Except:
WEBS 2x4 SP No.3	6-0-0 oc bracing: 14-15.
SLIDER Left 2x4 SP No.3 1-11-12, Right 2x4 SP No.3 1-11-12	WEBS 1 Row at midpt 4-17, 6-15, 10-14, 8-14

**REACTIONS.** (size) 2=0-3-8, 14=0-3-8, 12=Mechanical  
 Max Horz 2=131(LC 12)  
 Max Uplift 2=-32(LC 12), 12=-88(LC 13)  
 Max Grav 2=1326(LC 1), 14=2229(LC 1), 12=547(LC 24)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 2-4=-2220/127, 4-6=-1631/161, 6-7=-823/189, 7-8=-822/199, 8-10=0/431, 10-12=-528/177  
 BOT CHORD 2-19=-66/1960, 17-19=-66/1960, 15-17=-18/1437, 14-15=-279/23, 13-14=-82/487, 12-13=-82/487  
 WEBS 4-19=0/292, 4-17=-624/105, 6-17=0/557, 6-15=-1038/105, 10-14=-772/90, 10-13=0/333, 8-14=-1659/104, 8-15=0/1183

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-9-10 to 4-2-1, Interior(1) 4-2-1 to 25-0-0, Exterior(2) 25-0-0 to 32-0-7, Interior(1) 32-0-7 to 49-9-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - All plates are 5x8 MT20 unless otherwise indicated.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - Refer to girder(s) for truss to truss connections.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 12.



August 15, 2022

<p><b>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.</b></p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see <b>ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information</b> available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	<p>ENGINEERING BY</p> <p><b>TRENCO</b></p> <p>A MiTek Affiliate</p> <p>818 Soundside Road Edenton, NC 27932</p>
--	---


Job	Truss	Truss Type	Qty	Ply	MATTAMYHOMES/ALLEGHENY; LOT 101 PROVIDENCE CREEK 153641776
PCK101	A03	COMMON	3	1	Job Reference (optional)

Builders FirstSource (Apex, NC),

Apex, NC - 27523,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Aug 12 12:37:59 2022 Page 1

ID: \_P7X\_GPFnckXXgca6LM05wyocTp-89IGZOf7tZkccbvVriw9Sb9PhgZLNyn2iVTwO4yob66



Scale = 1:84.4


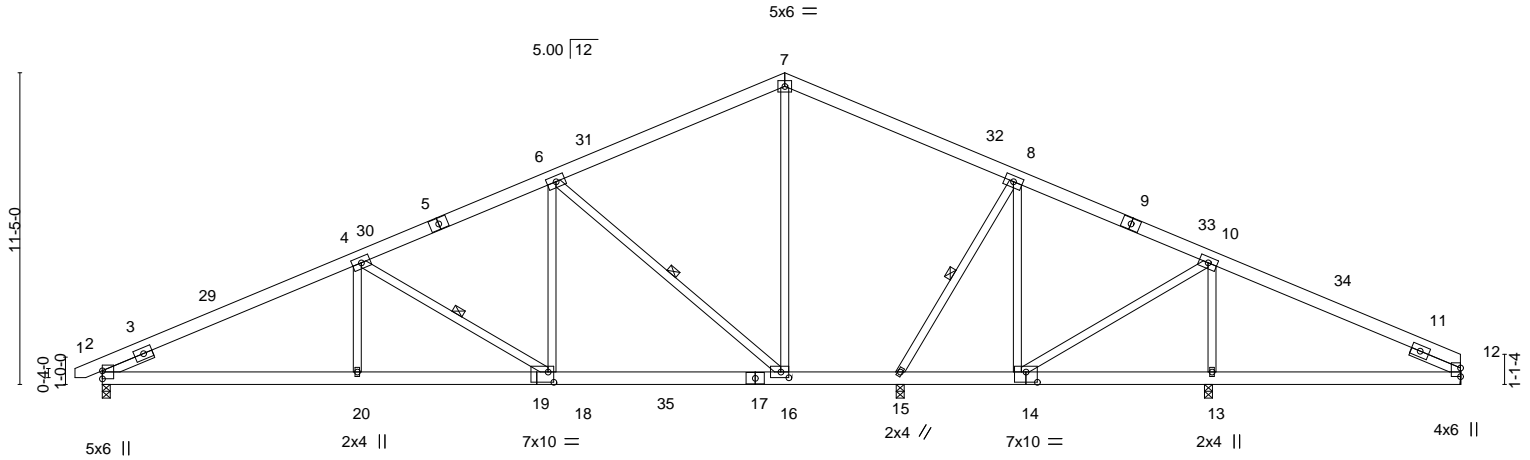


Plate Offsets (X,Y)-- [14:0-5-0,0-4-8], [16:0-3-8,0-2-8], [19:0-2-8,0-4-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.66	Vert(LL)	-0.17 16-18	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.74	Vert(CT)	-0.35 16-18	>999	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.69	Horz(CT)	0.08 13	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MS	Wind(LL)	0.08 16-18	>999	240		
								Weight: 351 lb	FT = 20%


**LUMBER-**  
 TOP CHORD 2x6 SP No.2  
 BOT CHORD 2x6 SP No.2  
 WEBS 2x4 SP No.3  
 SLIDER Left 2x4 SP No.3 1-11-12, Right 2x4 SP No.3 1-11-12

**BRACING-**  
 TOP CHORD Structural wood sheathing directly applied or 3-1-11 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
 WEBS 1 Row at midpt 4-18, 6-16, 8-15

**REACTIONS.** All bearings 0-3-8 except (jt=length) 12=Mechanical.  
 (lb) - Max Horz 2=131(LC 12)  
 Max Uplift All uplift 100 lb or less at joint(s) 2, 12, 15  
 Max Grav All reactions 250 lb or less at joint(s) except 2=1618(LC 1), 12=703(LC 1), 15=522(LC 24), 13=1241(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 2-4=-2865/92, 4-6=-2351/138, 6-7=-1514/162, 7-8=-1516/178, 8-10=-1538/147, 10-12=-873/161  
 BOT CHORD 2-20=-34/2548, 18-20=-34/2548, 16-18=0/2105, 15-16=0/1322, 14-15=0/1366, 13-14=-65/806, 12-13=-65/806  
 WEBS 4-20=0/252, 4-18=-535/112, 6-18=0/584, 6-16=-1078/102, 7-16=0/727, 10-14=0/757, 8-14=-431/32, 8-15=-330/176, 10-13=-1027/50

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-9-10 to 4-2-1, Interior(1) 4-2-1 to 25-0-0, Exterior(2) 25-0-0 to 32-0-7, Interior(1) 32-0-7 to 49-9-0 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) All plates are 5x8 MT20 unless otherwise indicated.
  - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 5) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - 6) Refer to girder(s) for truss to truss connections.
  - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 12, 15.

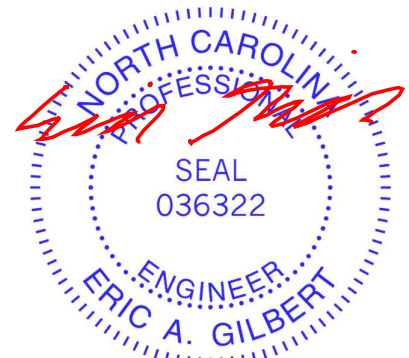

August 15, 2022

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road  
 Edenton, NC 27932

Job PCK101	Truss A04	Truss Type COMMON	Qty 2	Ply 1	MATTAMYHOMES/ALLEGHENY; LOT 101 PROVIDENCE CREEK 153641777
---------------	--------------	----------------------	----------	----------	---


Builders FirstSource (Apex, NC),

Apex, NC - 27523,



8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Aug 12 12:38:00 2022 Page 1

ID: \_P7X\_GPFnckXXgca6LM05wyocTp-cMJfmjflsetsSDIYhPSRO\_pibu4sp6PsB\_9CTwXyob65

Job Reference (optional)



Scale = 1:84.8

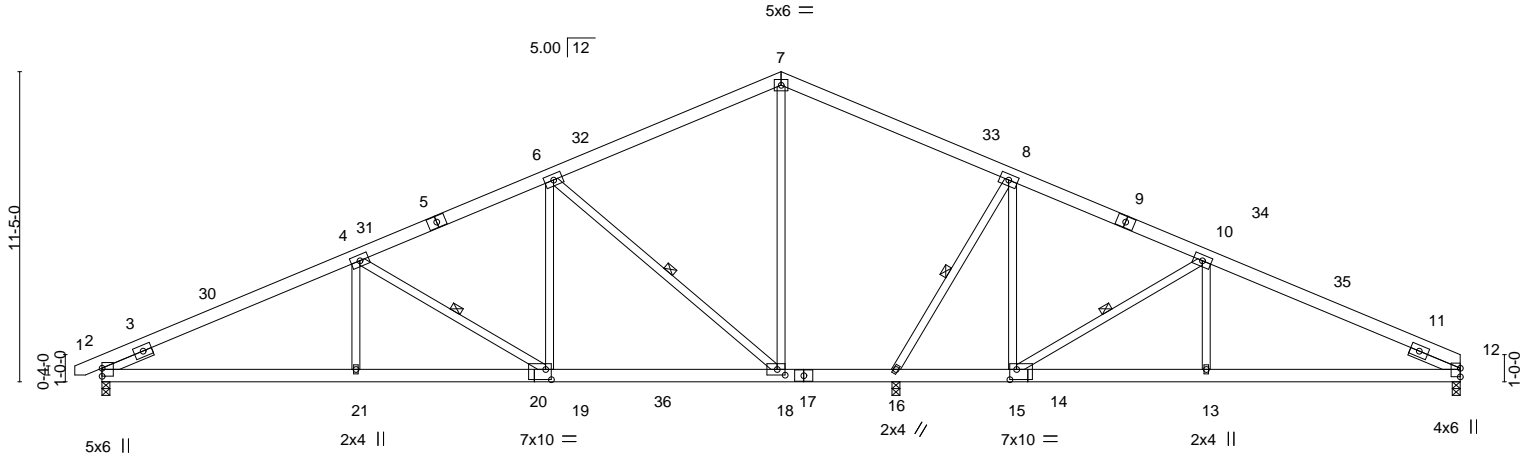


LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.63	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.92	Vert(LL) -0.19 18-19 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.70	Vert(CT) -0.40 18-19 >868 240		
BCDL 10.0	Rep Stress Incr YES	Matrix-MS	Horz(CT) 0.11 12 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.09 18-19 >999 240	Weight: 353 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.2	TOP CHORD Structural wood sheathing directly applied or 3-3-5 oc purlins.
BOT CHORD 2x6 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing. Except:
WEBS 2x4 SP No.3	2-2-0 oc bracing: 15-16.
SLIDER Left 2x4 SP No.3 1-11-12, Right 2x4 SP No.3 1-11-12	WEBS 1 Row at midpt 10-15, 6-18, 4-19, 8-16

**REACTIONS.** (size) 2=0-3-8, 12=0-3-8, 16=0-3-8  
 Max Horz 2=130(LC 12)  
 Max Uplift 2=19(LC 12)  
 Max Grav 2=1584(LC 1), 12=1352(LC 1), 16=1112(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 2-4=-2786/94, 4-6=-2271/140, 6-7=-1418/164, 7-8=-1423/180, 8-10=-1802/136, 10-12=-2396/112  
 BOT CHORD 2-21=40/2476, 19-21=-40/2476, 18-19=0/2031, 16-18=0/1244, 15-16=0/1604, 13-15=-18/2119, 12-13=-18/2119  
 WEBS 7-18=0/681, 8-15=-5/361, 10-15=-655/118, 10-13=0/322, 6-18=-1093/102, 6-19=0/598, 4-19=-537/112, 4-21=0/251, 8-16=-833/112

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-9-10 to 4-2-6, Interior(1) 4-2-6 to 25-0-0, Exterior(2) 25-0-0 to 32-0-14, Interior(1) 32-0-14 to 50-0-0 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - All plates are 5x8 MT20 unless otherwise indicated.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2.

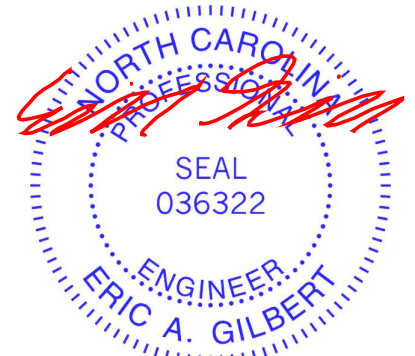

August 15, 2022

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road  
Edenton, NC 27932



Job	Truss	Truss Type	Qty	Ply	MATTAMYHOMES/ALLEGHENY; LOT 101 PROVIDENCE CREEK 153641778
PCK101	A05	COMMON	1	1	Job Reference (optional)

Builders FirstSource (Apex, NC),


Apex, NC - 27523,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Aug 12 12:38:01 2022 Page 1

ID: \_P7X\_GPFnckXXgca6LM05wyocTp-4Y11z3gNPA\_Jrv7tz9zdX0FmeTB2rs6KDpy1Tzyob64

-1-0-0	9-4-3	16-5-12	25-0-0	33-6-4	40-7-13	50-0-0	51-0-0
1-0-0	9-4-3	7-1-9	8-6-4	8-6-4	7-1-9	9-4-3	1-0-0

Scale = 1:86.6

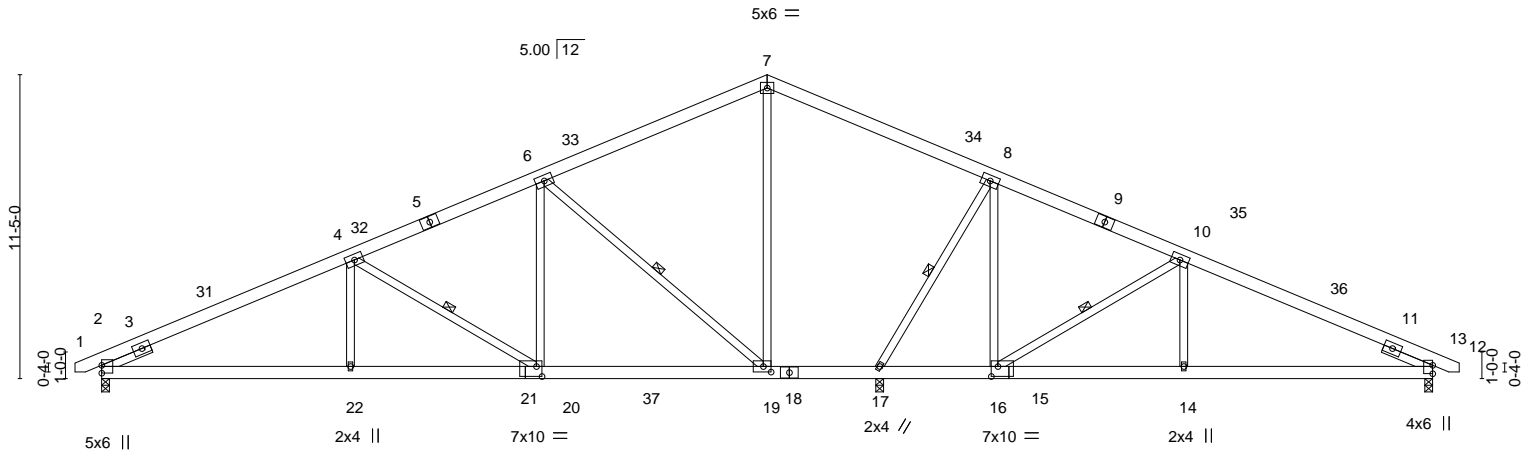

	9-4-3	16-5-12	25-0-0	29-2-12	33-6-4	40-7-13	50-0-0
	9-4-3	7-1-9	8-6-4	4-2-12	4-3-8	7-1-9	9-4-3


Plate Offsets (X, Y)--	[16:0-3-0,0-4-8], [19:0-3-8,0-2-8], [21:0-2-8,0-4-8]				
<b>LOADING</b> (psf)	<b>SPACING-</b> 2-0-0	<b>CSI.</b>	<b>DEFL.</b> in (loc) l/defl L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 20.0	Plate Grip DOL 1.15	TC 0.63	Vert(LL) -0.19 19-20 >999 360	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.92	Vert(CT) -0.40 19-20 >867 240		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.70	Horz(CT) 0.11 12 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-MS	Wind(LL) 0.09 19-20 >999 240		
				Weight: 355 lb	FT = 20%

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x6 SP No.2	TOP CHORD Structural wood sheathing directly applied or 3-3-5 oc purlins.
BOT CHORD 2x6 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing. Except:
WEBS 2x4 SP No.3	2-2-0 oc bracing: 16-17.
SLIDER Left 2x4 SP No.3 1-11-12, Right 2x4 SP No.3 1-11-12	WEBS 1 Row at midpt 10-16, 6-19, 4-20, 8-17

**REACTIONS.** (size) 2=0-3-8, 12=0-3-8, 17=0-3-8  
 Max Horz 2=127(LC 12)  
 Max Uplift 2=-20(LC 12)  
 Max Grav 2=1583(LC 1), 12=1401(LC 1), 17=1112(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 2-4=-2786/94, 4-6=-2270/140, 6-7=-1417/165, 7-8=-1423/180, 8-10=-1801/134, 10-12=-2392/104  
 BOT CHORD 2-22=-37/2476, 20-22=-37/2476, 19-20=0/2031, 17-19=0/1250, 16-17=0/1603, 14-16=0/2115, 12-14=0/2115  
 WEBS 7-19=0/681, 8-16=-5/361, 10-16=-651/118, 10-14=0/321, 6-19=-1093/102, 6-20=0/598, 4-20=-537/112, 4-22=0/251, 8-17=-833/112

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-9-10 to 4-2-6, Interior(1) 4-2-6 to 25-0-0, Exterior(2) 25-0-0 to 32-0-14, Interior(1) 32-0-14 to 50-9-10 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - All plates are 5x8 MT20 unless otherwise indicated.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2.

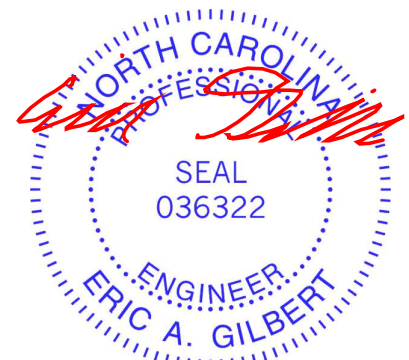

August 15, 2022

<p><b>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.</b></p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see <b>ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information</b> available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	<p>ENGINEERING BY</p> <p><b>TRENCO</b></p> <p>A MiTek Affiliate</p> <p>818 Soundside Road Edenton, NC 27932</p>
--	---


Job	Truss	Truss Type	Qty	Ply	MATTAMYHOMES/ALLEGHENY; LOT 101 PROVIDENCE CREEK 153641779
PCK101	A07	COMMON	2	1	Job Reference (optional)

Builders FirstSource (Apex, NC),


Apex, NC - 27523,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Aug 12 12:38:03 2022 Page 1

ID: \_P7X\_GPFncXXGca6LM05wyocTp-1x\_nOliexoE14DHG4a?5cRK6BHtLJmbdg7R8Xsyob62



Scale = 1:84.4

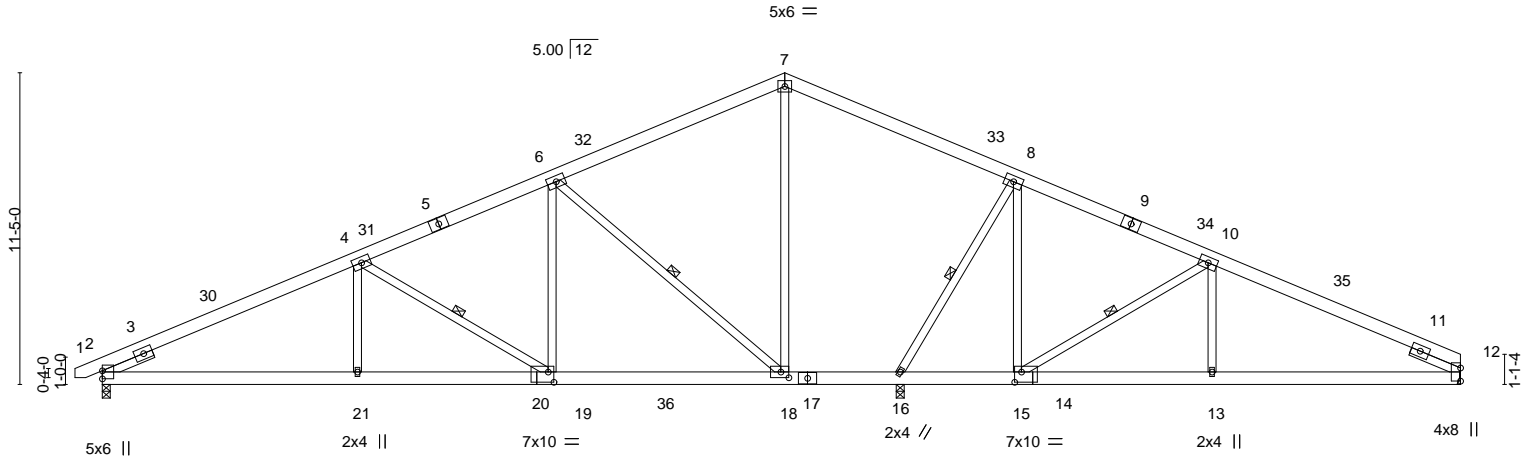

	9-4-3	16-5-12	25-0-0	29-2-12	33-6-4	40-7-13	49-9-0
	9-4-3	7-1-9	8-6-4	4-2-12	4-3-8	7-1-9	9-1-3
Plate Offsets (X, Y)--	[15:0-3-0,0-4-8], [18:0-3-8,0-2-8], [20:0-2-8,0-4-8]						

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.63	Vert(LL)	-0.20 18-19	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.93	Vert(CT)	-0.41 18-19	>852	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.70	Horz(CT)	0.12 12	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MS	Wind(LL)	0.09 18-19	>999	240		
								Weight: 351 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.2	TOP CHORD Structural wood sheathing directly applied or 3-3-7 oc purlins.
BOT CHORD 2x6 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing. Except:
WEBS 2x4 SP No.3	2-2-0 oc bracing: 15-16.
SLIDER Left 2x4 SP No.3 1-11-12, Right 2x4 SP No.3 1-11-12	WEBS 1 Row at midpt 10-15, 6-18, 4-19, 8-16

**REACTIONS.** (size) 2=0-3-8, 12=Mechanical, 16=0-3-8  
 Max Horz 2=131(LC 12)  
 Max Uplift 2=20(LC 12)  
 Max Grav 2=1580(LC 1), 12=1343(LC 1), 16=1105(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 2-4=-2778/94, 4-6=-2262/141, 6-7=-1407/165, 7-8=-1413/181, 8-10=-1779/137, 10-12=-2319/112  
 BOT CHORD 2-21=-42/2468, 19-21=-42/2468, 18-19=0/2023, 16-18=0/1233, 15-16=0/1586, 13-15=-21/2044, 12-13=-21/2044  
 WEBS 7-18=0/676, 8-15=-8/340, 10-15=-598/122, 10-13=0/302, 6-18=-1095/101, 6-19=0/600, 4-19=-537/112, 4-21=0/251, 8-16=-821/112

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-9-10 to 4-2-6, Interior(1) 4-2-6 to 25-0-0, Exterior(2) 25-0-0 to 32-0-14, Interior(1) 32-0-14 to 49-9-0 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - All plates are 5x8 MT20 unless otherwise indicated.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - Refer to girder(s) for truss to truss connections.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2.



August 15, 2022

<p><b>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.</b></p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see <b>ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information</b> available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	<p>ENGINEERING BY</p> <p><b>TRENCO</b></p> <p>A MiTek Affiliate</p> <p>818 Soundside Road Edenton, NC 27932</p>
--	---

Job PCK101	Truss A08	Truss Type COMMON	Qty 4	Ply 1	MATTAMYHOMES/ALLEGHENY; LOT 101 PROVIDENCE CREEK 153641780
---------------	--------------	----------------------	----------	----------	---


Builders FirstSource (Apex, NC),

Apex, NC - 27523,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Aug 12 12:38:04 2022 Page 1

ID: \_P7X\_GPFnckXXgca6LM05wyocTp-V7Y9c5iGi5MuiMrSeiWK9ftH3hDa2DqnvAh3lyob61

Job Reference (optional)



Scale = 1:82.7


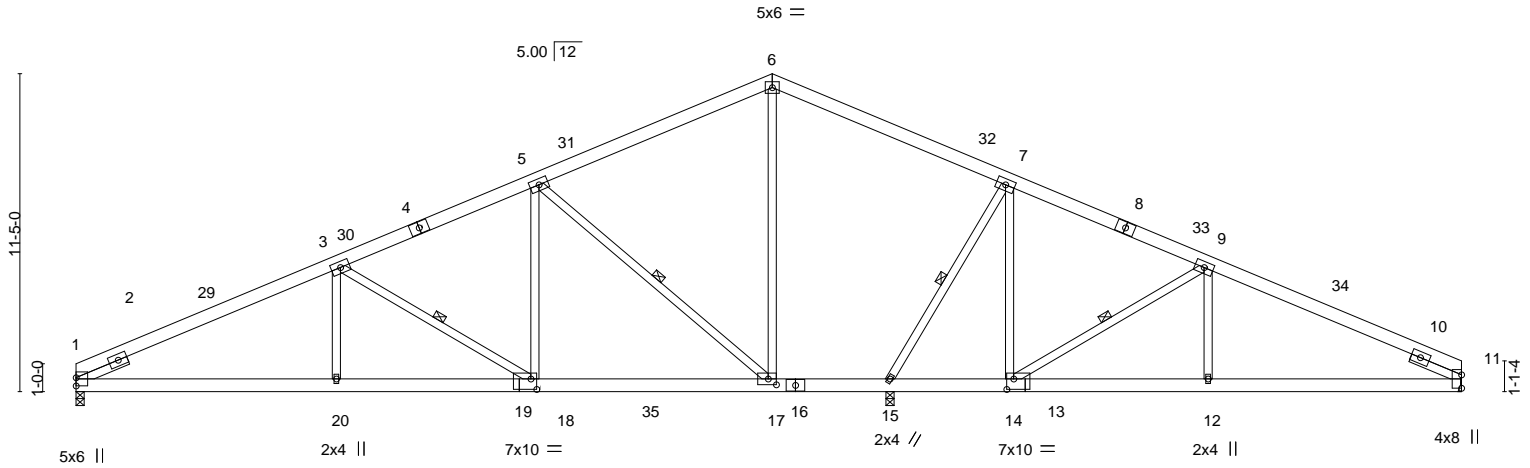


Plate Offsets (X,Y)-- [14:0-3-0,0-4-8], [17:0-3-8,0-2-8], [19:0-2-8,0-4-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.62	Vert(LL)	-0.20 17-18	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.93	Vert(CT)	-0.41 17-18	>852	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.70	Horz(CT)	0.12 11	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MS	Wind(LL)	0.09 17-18	>999	240		
								Weight: 349 lb	FT = 20%

**LUMBER-**  
 TOP CHORD 2x6 SP No.2  
 BOT CHORD 2x6 SP No.2  
 WEBS 2x4 SP No.3  
 SLIDER Left 2x4 SP No.3 1-11-12, Right 2x4 SP No.3 1-11-12

**BRACING-**  
 TOP CHORD Structural wood sheathing directly applied or 3-3-14 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing. Except:  
 2-2-0 oc bracing: 14-15.  
 WEBS 1 Row at midpt 9-14, 5-17, 3-18, 7-15

**REACTIONS.** (size) 1=0-3-8, 11=Mechanical, 15=0-3-8  
 Max Horz 1=123(LC 12)  
 Max Uplift 1=8(LC 12)  
 Max Grav 1=1531(LC 1), 11=1344(LC 1), 15=1105(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 1-3=-2783/105, 3-5=-2264/141, 5-6=-1408/165, 6-7=-1414/181, 7-9=-1780/137,  
 9-11=-2320/112  
 BOT CHORD 1-20=-43/2473, 18-20=-43/2473, 17-18=0/2025, 15-17=0/1234, 14-15=0/1587,  
 12-14=-21/2045, 11-12=-21/2045  
 WEBS 6-17=0/677, 7-14=-8/340, 9-14=-598/122, 9-12=0/302, 5-17=-1096/101, 5-18=0/600,  
 3-18=-541/112, 3-20=0/251, 7-15=-821/112

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) 0-0-0 to 5-0-0, Interior(1) 5-0-0 to 25-0-0, Exterior(2) 25-0-0 to 32-0-14, Interior(1) 32-0-14 to 49-9-0 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - All plates are 5x8 MT20 unless otherwise indicated.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - Refer to girder(s) for truss to truss connections.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1.



August 15, 2022

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road  
 Edenton, NC 27932

Job PCK101	Truss A09	Truss Type COMMON	Qty 2	Ply 1	MATTAMYHOMES/ALLEGHENY; LOT 101 PROVIDENCE CREEK 153641781
---------------	--------------	----------------------	----------	----------	---

Builders FirstSource (Apex, NC), Apex, NC - 27523,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Aug 12 12:38:05 2022 Page 1

ID: \_P7X\_GPFnckXXgca6LM05wyocTp-zJ6YpRjuTPUIKWQfC?1ZhsPSm5Z\_ng6w8RwEckyob60



Scale = 1:84.6


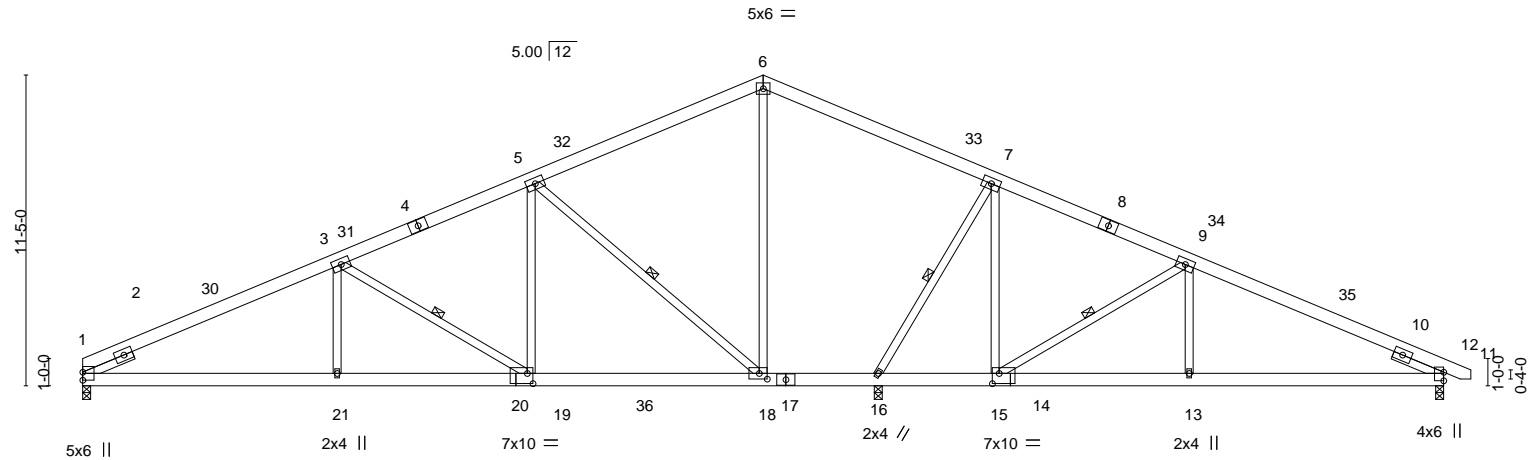


Plate Offsets (X,Y)-- [15:0-3-0,0-4-8], [18:0-3-8,0-2-8], [20:0-2-8,0-4-8]


<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in (loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 20.0	Plate Grip DOL	1.15	TC 0.62	Vert(LL)	-0.19 18-19	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.92	Vert(CT)	-0.40 18-19	>867	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.70	Horz(CT)	0.11 11	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MS	Wind(LL)	0.09 18-19	>999	240	Weight: 353 lb	FT = 20%

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x6 SP No.2	TOP CHORD Structural wood sheathing directly applied or 3-3-10 oc purlins.
BOT CHORD 2x6 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing. Except:
WEBS 2x4 SP No.3	2-2-0 oc bracing: 15-16.
SLIDER Left 2x4 SP No.3 1-11-12, Right 2x4 SP No.3 1-11-12	WEBS 1 Row at midpt 9-15, 5-18, 3-19, 7-16

**REACTIONS.** (size) 1=0-3-8, 11=0-3-8, 16=0-3-8  
 Max Horz 1=130(LC 17)  
 Max Uplift 1=8(LC 12)  
 Max Grav 1=1535(LC 1), 11=1402(LC 1), 16=1112(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 1-3=-2791/104, 3-5=-2273/140, 5-6=-1419/165, 6-7=-1424/180, 7-9=-1802/134, 9-11=-2393/104  
 BOT CHORD 1-21=-37/2481, 19-21=-37/2481, 18-19=0/2033, 16-18=0/1251, 15-16=0/1605, 13-15=0/2116, 11-13=0/2116  
 WEBS 6-18=0/682, 7-15=-5/361, 9-15=-651/118, 9-13=0/321, 5-18=-1094/102, 5-19=0/599, 3-19=-541/112, 3-21=0/252, 7-16=-833/112

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) 0-0-0 to 5-0-0, Interior(1) 5-0-0 to 25-0-0, Exterior(2) 25-0-0 to 32-0-14, Interior(1) 32-0-14 to 50-9-10 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - All plates are 5x8 MT20 unless otherwise indicated.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1.

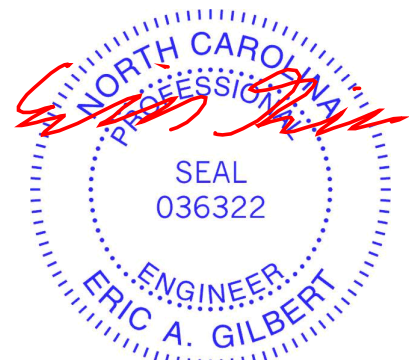


August 15, 2022

Job PCK101	Truss A10G	Truss Type GABLE	Qty 1	Ply 1	MATTAMYHOMES/ALLEGHENY; LOT 101 PROVIDENCE CREEK 153641782 Job Reference (optional)
---------------	---------------	---------------------	----------	----------	---


Builders FirstSource (Apex, NC), Apex, NC - 27523,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Aug 12 12:38:07 2022 Page 1

ID:\_P7X\_GPFncXXgca6LM05wyocTp-viEIE7I8\_0kTZqa1JQ31mHVvluSOFiJDbPLgdyob6\_



Scale = 1:86.5

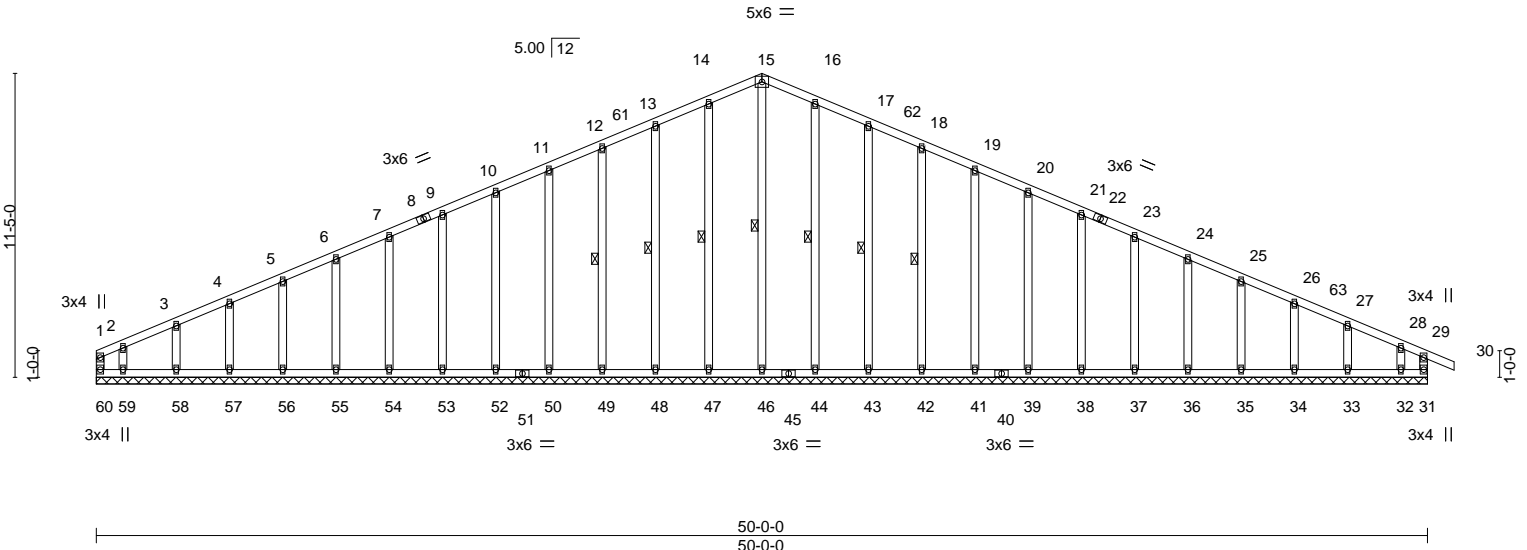


<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in (loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 20.0	Plate Grip DOL	1.15	TC 0.14	Vert(LL)	-0.00	30	n/r	MT20	244/190
BCDL 10.0	Lumber DOL	1.15	BC 0.09	Vert(CT)	-0.01	30	n/r		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.14	Horz(CT)	0.01	31	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-R					Weight: 369 lb	FT = 20%

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3	WEBS 1 Row at midpt 15-46, 14-47, 13-48, 12-49, 16-44, 17-43, 18-42
OTHERS 2x4 SP No.3	

**REACTIONS.** All bearings 50-0-0.  
 (lb) - Max Horz 60=131(LC 13)  
 Max Uplift All uplift 100 lb or less at joint(s) 60, 31, 47, 48, 49, 50, 52, 53, 54, 55, 56, 57, 58, 44, 43, 42, 41, 39, 38, 37, 36, 35, 34, 33 except 59=157(LC 12), 32=121(LC 13)  
 Max Grav All reactions 250 lb or less at joint(s) 60, 31, 46, 47, 48, 49, 50, 52, 53, 54, 55, 56, 57, 58, 59, 44, 43, 42, 41, 39, 38, 37, 36, 35, 34, 33, 32

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 12-13=-94/279, 13-14=-105/311, 14-15=-115/337, 15-16=-115/329, 16-17=-105/303, 17-18=-94/271

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) 0-1-12 to 5-0-0, Exterior(2) 5-0-0 to 25-0-0, Corner(3) 25-0-0 to 30-0-0, Exterior(2) 30-0-0 to 51-0-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
  - All plates are 2x4 MT20 unless otherwise indicated.
  - Gable requires continuous bottom chord bearing.
  - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
  - Gable studs spaced at 2-0-0 oc.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 60, 31, 47, 48, 49, 50, 52, 53, 54, 55, 56, 57, 58, 44, 43, 42, 41, 39, 38, 37, 36, 35, 34, 33 except (jt=lb) 59=157, 32=121.

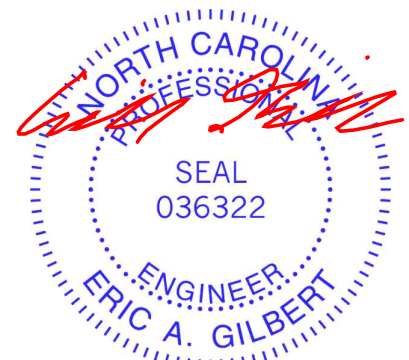

August 15, 2022

Job PCK101	Truss B01G	Truss Type GABLE	Qty 1	Ply 1	MATTAMYHOMES/ALLEGHENY; LOT 101 PROVIDENCE CREEK I53641783
---------------	---------------	---------------------	----------	----------	---

Builders FirstSource (Apex, NC),

Apex, NC - 27523,


8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Aug 12 12:38:09 2022 Page 1

ID: \_P7X\_GPFnckXXgca6LM05wyocTp-r4M2fomOWe\_Bp8kQRr6VsiaGci78jd0W32uRkVyob5y



4x6 =

Scale = 1:46.1

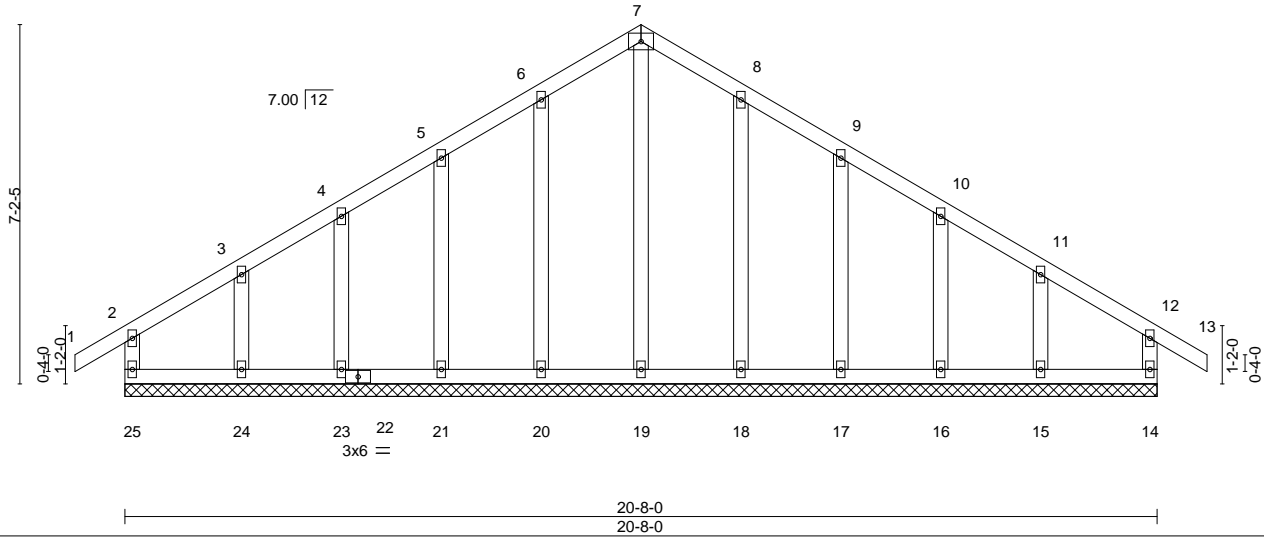

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.12	Vert(LL)	-0.00	13	n/r	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.07	Vert(CT)	-0.00	13	n/r		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.13	Horz(CT)	0.00	14	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-R					Weight: 127 lb	FT = 20%

**LUMBER-**  
 TOP CHORD 2x4 SP No.2  
 BOT CHORD 2x4 SP No.2  
 WEBS 2x4 SP No.3  
 OTHERS 2x4 SP No.3


**BRACING-**  
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
 BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

**REACTIONS.** All bearings 20-8-0.  
 (lb) - Max Horz 25=157(LC 11)  
 Max Uplift All uplift 100 lb or less at joint(s) 25, 14, 20, 21, 23, 24, 18, 17, 16, 15  
 Max Grav All reactions 250 lb or less at joint(s) 25, 14, 19, 20, 21, 23, 24, 18, 17, 16, 15

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) -0-11-15 to 3-9-10, Exterior(2) 3-9-10 to 10-4-0, Corner(3) 10-4-0 to 15-1-10, Exterior(2) 15-1-10 to 21-7-15 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 25, 14, 20, 21, 23, 24, 18, 17, 16, 15.

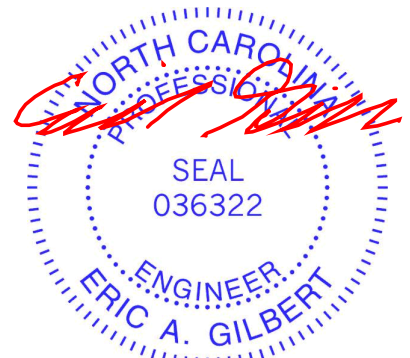

August 15, 2022

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road  
 Edenton, NC 27932

Job PCK101	Truss B02	Truss Type COMMON	Qty 2	Ply 1	MATTAMYHOMES/ALLEGHENY; LOT 101 PROVIDENCE CREEK 153641784
---------------	--------------	----------------------	----------	----------	---


Builders FirstSource (Apex, NC), Apex, NC - 27523, 8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Aug 12 12:38:10 2022 Page 1

ID: \_P7X\_GPFncXXgca6LM05wyocTp-JHvQs8n1Hx62QHJc?YdkOw6K16JeS\_OffHid\_Gyyob5x



4x6 =

Scale = 1:45.8

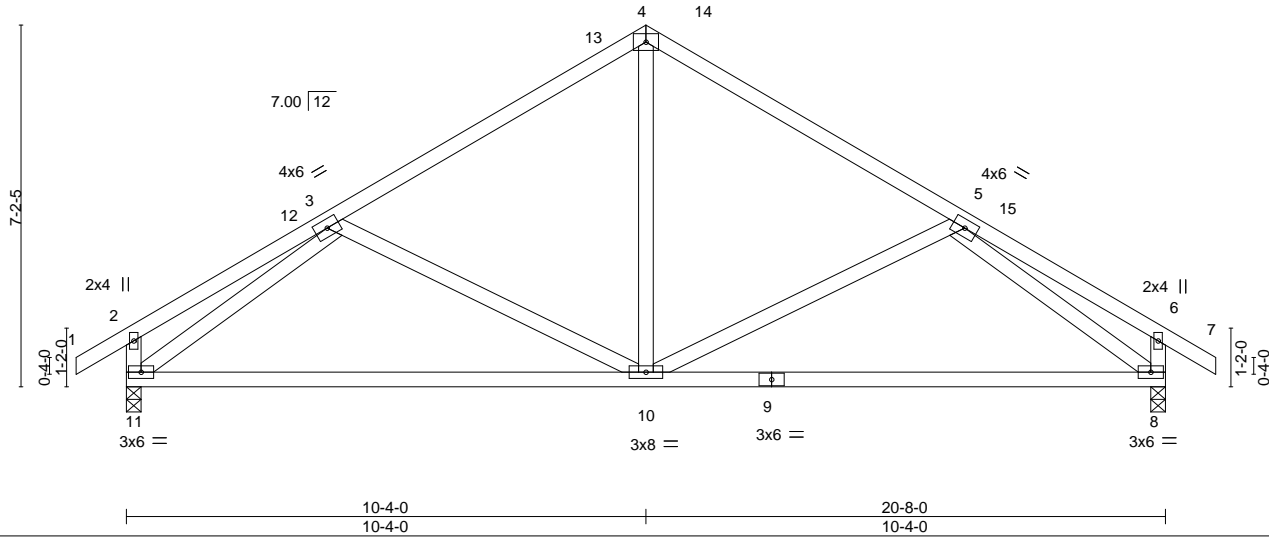


LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.53	Vert(LL)	-0.21	8-10	>999	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.76	Vert(CT)	-0.42	8-10	>580		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.46	Horz(CT)	0.02	8	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-MS	Wind(LL)	0.01	10	>999		
	Code IRC2015/TPI2014						Weight: 117 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 5-3-13 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2 *Except* 9-11: 2x4 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	

**REACTIONS.** (size) 11=0-3-8, 8=0-3-8  
 Max Horz 11=-157(LC 10)  
 Max Uplift 11=-21(LC 12), 8=-21(LC 13)  
 Max Grav 11=884(LC 1), 8=884(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 3-4=-848/82, 4-5=-848/82  
 BOT CHORD 10-11=-96/822, 8-10=-29/806  
 WEBS 4-10=0/485, 5-8=-902/114, 3-11=-903/113

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-11-15 to 4-0-7, Interior(1) 4-0-7 to 10-4-0, Exterior(2) 10-4-0 to 17-1-7, Interior(1) 17-1-7 to 21-7-15 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 11, 8.

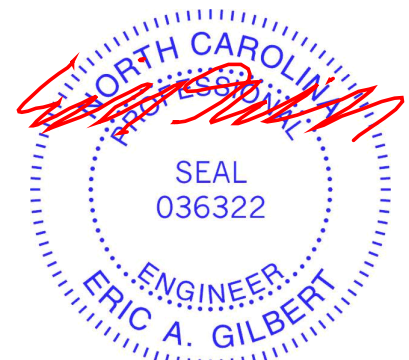


August 15, 2022

Job PCK101	Truss B03GR	Truss Type COMMON	Qty 1	Ply 2	MATTAMYHOMES/ALLEGHENY; LOT 101 PROVIDENCE CREEK 153641785
---------------	----------------	----------------------	----------	----------	---

Builders FirstSource (Apex, NC), Apex, NC - 27523, 8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Aug 12 12:38:11 2022 Page 1

ID: P7X\_GPFncKXXgca6LM05wyocTp-oTTp4Uof2FFv2RuoYG8zx7fSAVgGBKjpWMNyOyob5w



Scale = 1:65.8

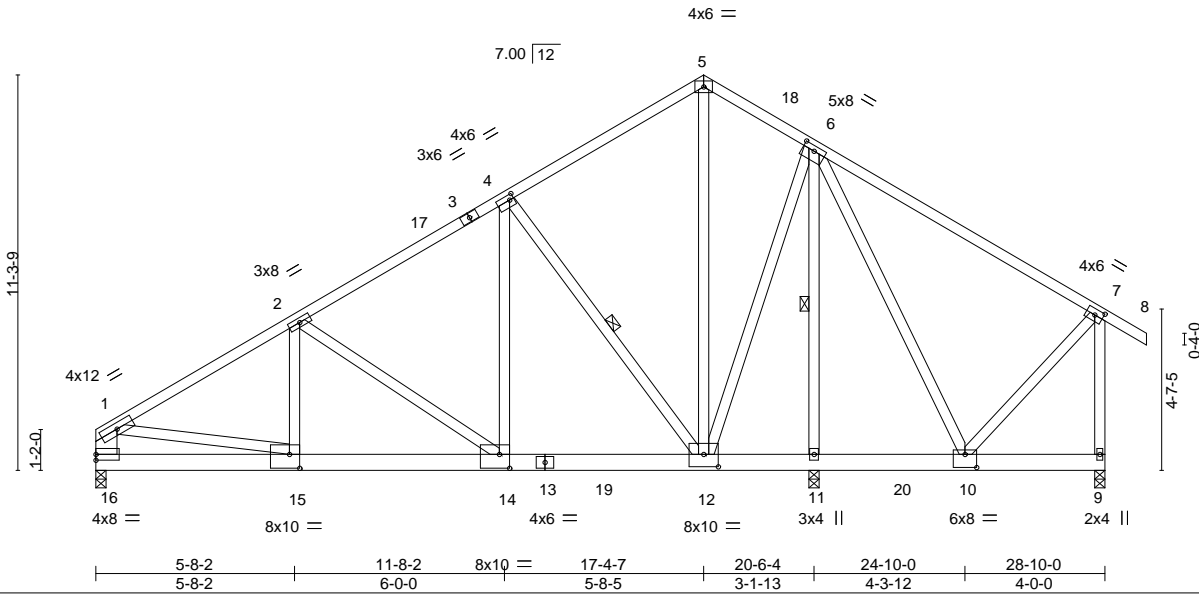


Plate Offsets (X,Y)--	[4:0-1-8,0-1-12], [6:0-4-0,0-1-12], [7:0-2-14,0-2-0], [10:0-4-0,0-4-8], [12:0-5-0,0-4-4], [14:0-3-8,0-4-12], [15:0-3-8,0-4-12]
-----------------------	--

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.69	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.67	Vert(LL) -0.13 14-15 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.95	Vert(CT) -0.26 14-15 >927 240		
BCDL 10.0	Rep Stress Incr NO	Matrix-MS	Horz(CT) 0.03 9 n/a n/a		
	Code IRC2015/TP12014		Wind(LL) 0.10 14-15 >999 240	Weight: 479 lb	FT = 20%


LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 3-9-15 oc purlins, except end verticals.
BOT CHORD 2x6 SP DSS	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.2 *Except* 1-16: 2x8 SP DSS, 6-11: 2x4 SP No.1	WEBS 1 Row at midpt 4-12, 6-11

**REACTIONS.** (size) 16=0-3-8 (req. 0-4-4), 9=0-3-8, 11=0-3-8 (req. 0-6-5)  
 Max Horz 16=263(LC 7)  
 Max Uplift 16=537(LC 8), 9=196(LC 9), 11=786(LC 9)  
 Max Grav 16=7226(LC 15), 9=2755(LC 20), 11=10671(LC 15)  
 SUPPLEMENTARY BEARING PLATES, SPECIAL ANCHORAGE, OR OTHER MEANS TO ALLOW FOR THE MINIMUM REQUIRED SUPPORT WIDTH (SUCH AS COLUMN CAPS, BEARING BLOCKS, ETC.) ARE THE RESPONSIBILITY OF THE TRUSS MANUFACTURER OR THE BUILDING DESIGNER.

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 1-16=-5486/427, 1-2=-8580/643, 2-4=-5816/456, 4-5=-2051/210, 5-6=-2055/230, 6-7=-1058/122, 7-9=-1615/111  
 BOT CHORD 15-16=-234/1616, 14-15=-614/7492, 12-14=-346/5083  
 WEBS 1-15=-386/5966, 2-15=-175/2725, 2-14=-2914/324, 4-14=-445/5911, 4-12=-5492/492, 5-12=-227/1841, 6-12=-373/5302, 6-11=-7558/585, 7-10=-21/1181, 6-10=-185/1897

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
 Top chords connected as follows: 2x8 - 2 rows staggered at 0-9-0 oc, 2x4 - 1 row at 0-9-0 oc.  
 Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-8-0 oc.  
 Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
  - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
  - Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - WARNING: Required bearing size at joint(s) 16, 11 greater than input bearing size.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 16=537, 9=196, 11=786.

**LOAD CASE(S)** Standard  
 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
 Uniform Loads (plf)  
 Vert: 1-5=-60, 5-7=-60, 7-8=-60, 9-16=-650(F=-630)

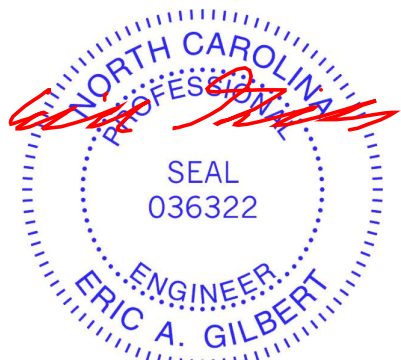

August 15, 2022

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**  
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

**ENGINEERING BY**  
**TRENCO**  
 A MiTek Affiliate  
 818 Soundside Road  
 Edenton, NC 27932



Job PCK101	Truss B04G	Truss Type GABLE	Qty 1	Ply 1	MATTAMYHOMES/ALLEGHENY; LOT 101 PROVIDENCE CREEK 153641786
---------------	---------------	---------------------	----------	----------	---

Builders FirstSource (Apex, NC),

Apex, NC - 27523,


8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Aug 12 12:38:12 2022 Page 1

ID: P7X\_GPFncKXXgca6LM05wyocTp-Gf1BHqpHpZNIgbT?6zfCTKck3v9lw\_tyI065Lqyob5v



4x6 =

Scale = 1:42.1

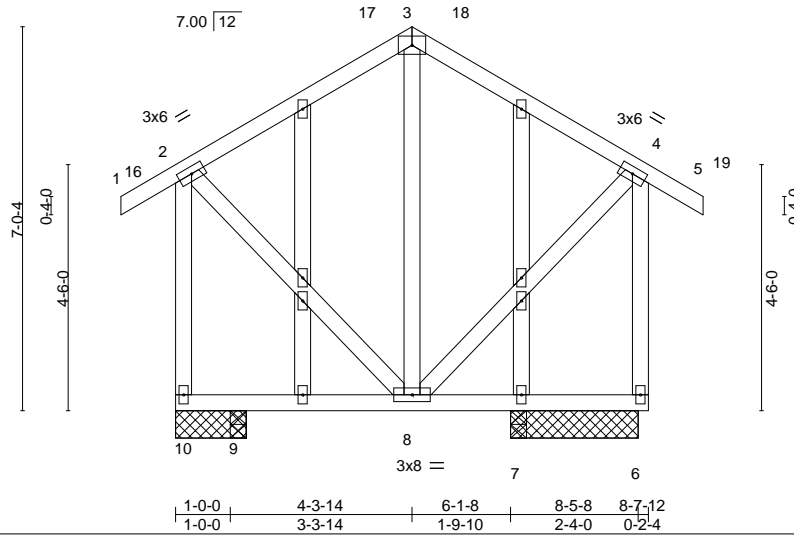

<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in (loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 20.0	Plate Grip DOL	1.15	TC 0.24	Vert(LL)	-0.00	8-9	>999	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.08	Vert(CT)	-0.01	8-9	>999		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.12	Horz(CT)	-0.00	6	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MS	Wind(LL)	0.00	8	>999		
								Weight: 85 lb	FT = 20%


**LUMBER-**  
TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.3  
OTHERS 2x4 SP No.3

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** All bearings 2-4-0 except (jt=length) 10=1-3-8, 9=0-3-8.  
(lb) - Max Horz 10=184(LC 10)  
Max Uplift All uplift 100 lb or less at joint(s) 10, 6  
Max Grav All reactions 250 lb or less at joint(s) 7, 7, 9 except 10=332(LC 1), 6=356(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-10=339/147, 4-6=338/149

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-11-15 to 3-9-10, Interior(1) 3-9-10 to 4-3-14, Exterior(2) 4-3-14 to 9-1-8, Interior(1) 9-1-8 to 9-7-11 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
  - 4) All plates are 2x4 MT20 unless otherwise indicated.
  - 5) Gable studs spaced at 2-0-0 oc.
  - 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 7) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 10, 6.

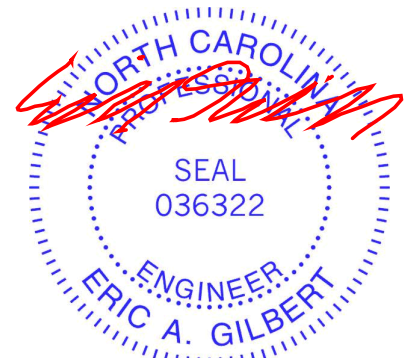

August 15, 2022

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road  
Edenton, NC 27932

Job PCK101	Truss B05G	Truss Type GABLE	Qty 1	Ply 1	MATTAMYHOMES/ALLEGHENY; LOT 101 PROVIDENCE CREEK I53641787
---------------	---------------	---------------------	----------	----------	---

Builders FirstSource (Apex, NC), Apex, NC - 27523,


8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Aug 12 12:38:13 2022 Page 1

ID: \_P7X\_GPFnckXXgca6LM05wyocTp-ksbZVApvasVcHI1BghAR0YkxvJWUfRG5zgstGyob5u



4x6 =

Scale = 1:27.2

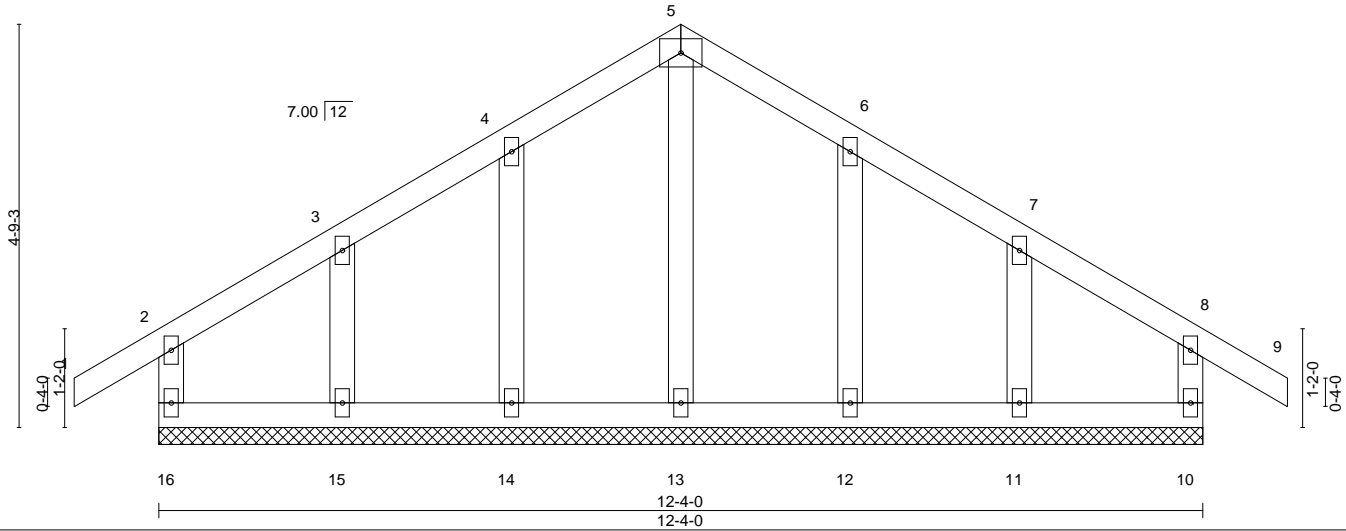

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.10	Vert(LL)	-0.00	9	n/r	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.04	Vert(CT)	-0.00	9	n/r		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.05	Horz(CT)	0.00	10	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-R					Weight: 66 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.3  
OTHERS 2x4 SP No.3


**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

**REACTIONS.** All bearings 12-4-0.  
(lb) - Max Horz 16--109(LC 10)  
Max Uplift All uplift 100 lb or less at joint(s) 16, 10, 14, 15, 12, 11  
Max Grav All reactions 250 lb or less at joint(s) 16, 10, 13, 14, 15, 12, 11

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) -0-11-15 to 3-9-10, Exterior(2) 3-9-10 to 6-2-0, Corner(3) 6-2-0 to 10-11-10, Exterior(2) 10-11-10 to 13-3-15 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 16, 10, 14, 15, 12, 11.

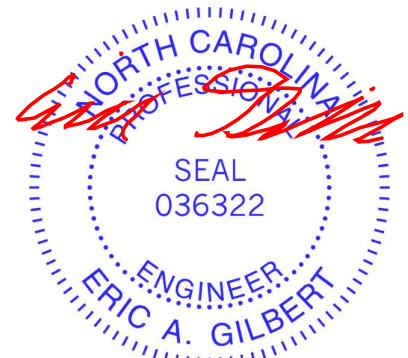

August 15, 2022

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road  
Edenton, NC 27932


Job PCK101	Truss B06GR	Truss Type COMMON	Qty 1	Ply 2	MATTAMYHOMES/ALLEGHENY; LOT 101 PROVIDENCE CREEK I53641788
---------------	----------------	----------------------	----------	----------	---

Builders FirstSource (Apex, NC),

Apex, NC - 27523,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Aug 12 12:38:14 2022 Page 1

ID: P7X\_GPFncXXGca6LM05wvocTp-C29xiWqXLAdTvvNEOhgZIH?ejhfOo8FCKbCPjyob5t

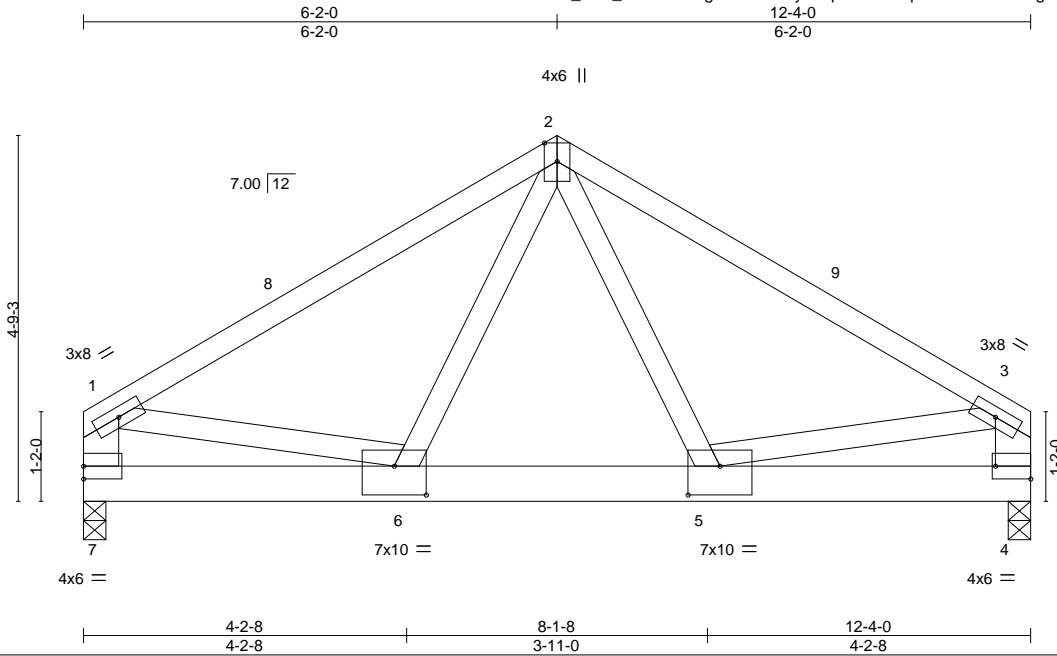

Scale = 1:30.0

Plate Offsets (X,Y)--	[4:Edge,0-2-0], [5:0-5-0,0-4-8], [6:0-5-0,0-4-8]				
<b>LOADING</b> (psf)	<b>SPACING-</b> 2-0-0	<b>CSI.</b>	<b>DEFL.</b> in (loc) l/defl L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 20.0	Plate Grip DOL 1.15	TC 0.55	Vert(LL) -0.04 5-6 >999 360	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.69	Vert(CT) -0.08 5-6 >999 240		
BCLL 0.0 *	Rep Stress Incr NO	WB 0.39	Horz(CT) 0.01 4 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-MS	Wind(LL) 0.03 5-6 >999 240	Weight: 156 lb	FT = 20%


<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 5-3-5 oc purlins, except end verticals.
BOT CHORD 2x6 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.2 *Except* 1-7,3-4: 2x6 SP No.2	

<b>REACTIONS.</b>	(size) 7=0-3-8, 4=0-3-8
	Max Horz 7=94(LC 7)
	Max Uplift 7=-349(LC 8), 4=-349(LC 9)
	Max Grav 7=4731(LC 15), 4=4711(LC 15)

<b>FORCES.</b>	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	1-7=-3313/264, 1-2=-4832/375, 2-3=-4845/375, 3-4=-3292/263
BOT CHORD	6-7=-143/900, 5-6=-215/3131, 4-5=-112/793
WEBS	2-5=-166/2455, 3-5=-227/3428, 2-6=-166/2483, 1-6=-226/3348

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc, 2x4 - 1 row at 0-9-0 oc.  
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-8-0 oc.  
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
  - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
  - Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 7=349, 4=349.

<b>LOAD CASE(S)</b> Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-2=-60, 2-3=-60, 4-7=-693(F=-673)

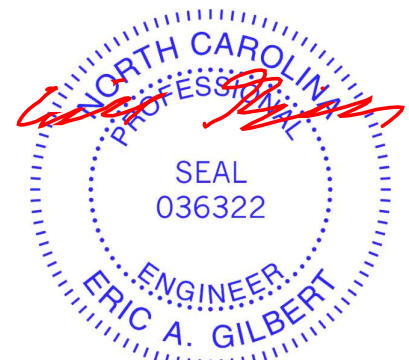

August 15, 2022

<p><b>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.</b></p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see <b>ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information</b> available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	<p>818 Soundside Road Edenton, NC 27932</p>
--	---


Job PCK101	Truss CV01	Truss Type MONO HIP	Qty 2	Ply 1	MATTAMYHOMES/ALLEGHENY; LOT 101 PROVIDENCE CREEK I53641789
---------------	---------------	------------------------	----------	----------	---

Builders FirstSource (Apex, NC),

Apex, NC - 27523,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Aug 12 12:38:15 2022 Page 1

ID: P7X\_GPFncXXgca6LM05wyocTp-gEjJvsr96UIKX3Ban6Dv5zqGZ78Z7LKOR\_Llx9yob5s

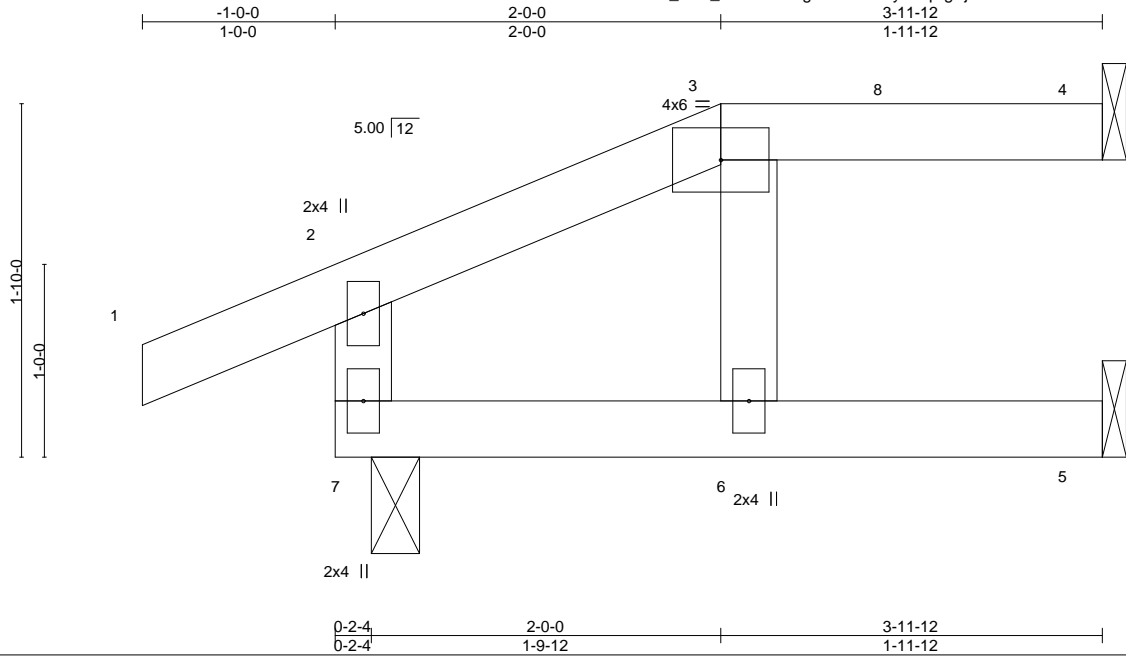

Scale: 1"=1'

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.16	Vert(LL)	-0.01	6	>999	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.20	Vert(CT)	-0.02	6	>999		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.01	Horz(CT)	0.02	4	n/a		
BCDL 10.0	Rep Stress Incr NO	Matrix-MP	Wind(LL)	0.01	6	>999		
	Code IRC2015/TPI2014						Weight: 16 lb	FT = 20%

**LUMBER-**  
 TOP CHORD 2x4 SP No.2  
 BOT CHORD 2x4 SP No.2  
 WEBS 2x4 SP No.3

**BRACING-**  
 TOP CHORD Structural wood sheathing directly applied or 3-11-12 oc purlins, except end verticals, and 2-0-0 oc purlins: 3-4.  
 BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

**REACTIONS.** (size) 7=0-3-0, 4=Mechanical, 5=Mechanical  
 Max Horz 7=38(LC 5)  
 Max Uplift 7=23(LC 8), 4=20(LC 5)  
 Max Grav 7=239(LC 1), 4=88(LC 1), 5=67(LC 3)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Refer to girder(s) for truss to truss connections.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 7, 4.
- 8) Girder carries hip end with 0-0-0 right side setback, 0-0-0 left side setback, and 2-6-0 end setback.
- 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 10) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

**LOAD CASE(S)** Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
 Uniform Loads (plf)  
 Vert: 1-2=-60, 2-3=-64(F=-4), 3-4=-64(F=-4), 5-7=-21(F=-1)



August 15, 2022

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road  
 Edenton, NC 27932

Job PCK101	Truss CV02	Truss Type JACK	Qty 3	Ply 1	MATTAMYHOMES/ALLEGHENY; LOT 101 PROVIDENCE CREEK I53641790
---------------	---------------	--------------------	----------	----------	---

Builders FirstSource (Apex, NC),


Apex, NC - 27523,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Aug 12 12:38:15 2022 Page 1

ID: P7X\_GPFnckXXgca6LM05wyocTp-gEJvsr96UIKX3Ban6Dv5zqFm7917LUOR\_Llx9yob5s



Scale = 1:16.2

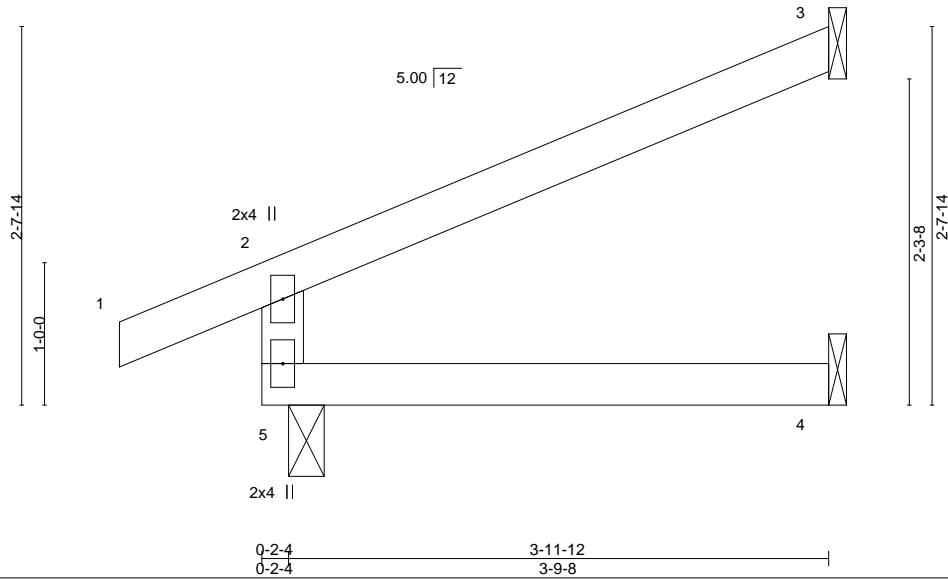

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.21	Vert(LL)	-0.01	4-5	>999	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.15	Vert(CT)	-0.02	4-5	>999		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.00	Horz(CT)	-0.01	3	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-MR	Wind(LL)	0.01	4-5	>999		
	Code IRC2015/TPI2014						Weight: 15 lb	FT = 20%

**LUMBER-**  
 TOP CHORD 2x4 SP No.2  
 BOT CHORD 2x4 SP No.2  
 WEBS 2x4 SP No.3

**BRACING-**  
 TOP CHORD Structural wood sheathing directly applied or 3-11-12 oc purlins, except end verticals.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 5=0-3-0, 3=Mechanical, 4=Mechanical  
 Max Horz 5=53(LC 12)  
 Max Uplift 5=-11(LC 12), 3=-43(LC 12)  
 Max Grav 5=230(LC 1), 3=99(LC 1), 4=71(LC 3)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**

- 1) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 3.



August 15, 2022

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road  
 Edenton, NC 27932


Job PCK101	Truss CV03	Truss Type JACK	Qty 2	Ply 1	MATTAMYHOMES/ALLEGHENY; LOT 101 PROVIDENCE CREEK I53641791
---------------	---------------	--------------------	----------	----------	---

Builders FirstSource (Apex, NC),


Apex, NC - 27523,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Aug 12 12:38:16 2022 Page 1

ID: \_P7X\_GPFnckXXgca6LM05wyocTp-8RHi7CsntntB8CmmLpk8eAMSAWXMsokYge4JUbyob5r



Scale: 1"=1'

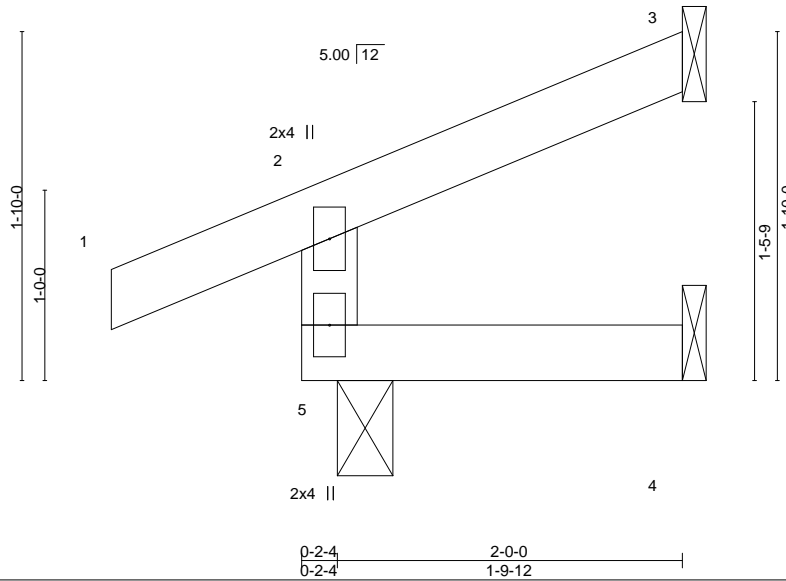

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 20.0	Plate Grip DOL	1.15	TC 0.10	Vert(LL)	-0.00	5	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.03	Vert(CT)	-0.00	4-5	>999	240		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.00	Horz(CT)	-0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MR	Wind(LL)	0.00	5	>999	240		
									Weight: 9 lb	FT = 20%

**LUMBER-**

TOP CHORD 2x4 SP No.2  
 BOT CHORD 2x4 SP No.2  
 WEBS 2x4 SP No.3

**BRACING-**

TOP CHORD Structural wood sheathing directly applied or 2-0-0 oc purlins, except end verticals.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.**

(size) 3=Mechanical, 4=Mechanical, 5=0-3-8  
 Max Horz 5=36(LC 5)  
 Max Uplift 3=22(LC 8), 5=16(LC 4)  
 Max Grav 3=38(LC 1), 4=33(LC 3), 5=164(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**

- 1) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 5.



August 15, 2022

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road  
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	MATTAMYHOMES/ALLEGHENY; LOT 101 PROVIDENCE CREEK I53641792
PCK101	CV04GR	HIP	1	1	Job Reference (optional)

Builders FirstSource (Apex, NC), Apex, NC - 27523,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Aug 12 12:38:17 2022 Page 1

ID: P7X\_GPFnckXXgca6LM05wyocTp-cdq4KXtQe5?2mMLyvWFNAOvQ?witbF6hulqs02yob5q



Scale = 1:22.8

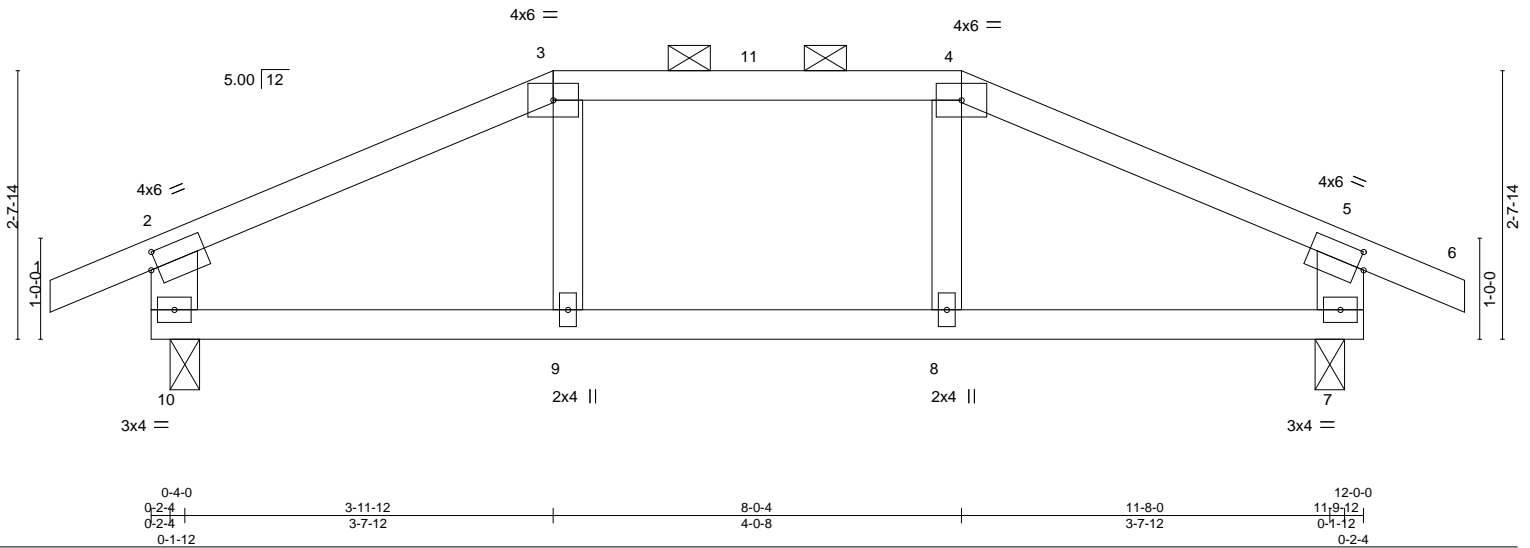


Plate Offsets (X, Y)--	[2:0-0-13,0-2-0], [5:0-0-13,0-2-0]
------------------------	------------------------------------

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.93	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.72	Vert(LL) -0.08 8-9 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.06	Vert(CT) -0.16 8-9 >861 240		
BCDL 10.0	Rep Stress Incr NO	Matrix-MR	Horz(CT) 0.01 7 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.05 8-9 >999 240	Weight: 49 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 4-7-5 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 3-4.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x6 SP No.2 *Except* 3-9,4-8: 2x4 SP No.3	

REACTIONS.	(size)
Max Horz	10=0-3-8, 7=0-3-8
Max Uplift	10=-66(LC 8), 7=-66(LC 9)
Max Grav	10=735(LC 1), 7=735(LC 1)

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-10=-619/94, 2-3=-832/75, 3-4=-677/81, 4-5=-832/75, 5-7=-619/94
BOT CHORD	9-10=-19/674, 8-9=-15/677, 7-8=-19/674

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
  - Provide adequate drainage to prevent water ponding.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 10, 7.
  - Girder carries hip end with 0-0-0 right side setback, 0-0-0 left side setback, and 3-11-12 end setback.
  - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
  - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S)	Standard
1) Dead + Roof Live (balanced):	Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)	
Vert:	1-2=-60, 2-3=-86(F=-26), 3-4=-86(F=-26), 4-5=-86(F=-26), 5-6=-60, 7-10=-29(F=-9)



August 15, 2022

Job PCK101	Truss CV05	Truss Type COMMON	Qty 2	Ply 1	MATTAMYHOMES/ALLEGHENY; LOT 101 PROVIDENCE CREEK I53641793
---------------	---------------	----------------------	----------	----------	---

Builders FirstSource (Apex, NC), Apex, NC - 27523,


8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Aug 12 12:38:17 2022 Page 1

ID: P7X\_GPFncXXgca6LM05wyocTp-cdq4KXtQe5?2mMLyvWFNAOvV5wpObEhhulqs02yob5q

12-0-0 13-0-0  
6-0-0 1-0-0

4x6 =

Scale: 1/2"=1'

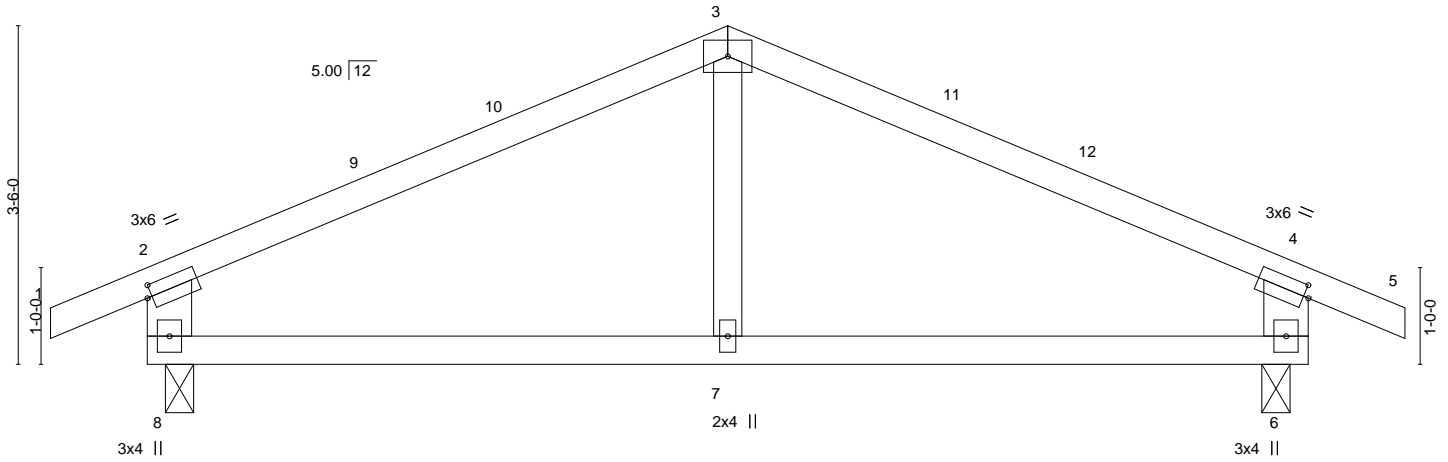

0'-2-4 6'-0-0 11'-9-12 12'-0-0  
0'-2-4 5'-9-12 5'-9-12 0'-2-4

Plate Offsets (X, Y)-- [2:0-0-10,0-1-8], [4:0-0-10,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.60	Vert(LL)	-0.03	6-7	>999	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.30	Vert(CT)	-0.08	6-7	>999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.08	Horz(CT)	0.01	6	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MR	Wind(LL)	0.01	7-8	>999		
								Weight: 48 lb	FT = 20%

**LUMBER-**

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x6 SP No.2 \*Except\*  
3-7: 2x4 SP No.3

**BRACING-**

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.**

(size) 8=0-3-8, 6=0-3-8  
Max Horz 8=-27(LC 17)  
Max Uplift 8=-32(LC 12), 6=-32(LC 13)  
Max Grav 8=535(LC 1), 6=535(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-8=-464/156, 2-3=-538/95, 3-4=-538/95, 4-6=-464/156  
BOT CHORD 7-8=-17/421, 6-7=-17/421

**NOTES-**

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -1-0-0 to 3-9-10, Interior(1) 3-9-10 to 6-0-0, Exterior(2) 6-0-0 to 13-0-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 8, 6.



August 15, 2022

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road  
Edenton, NC 27932



Job PCK101	Truss V01	Truss Type VALLEY	Qty 1	Ply 1	MATTAMYHOMES/ALLEGHENY; LOT 101 PROVIDENCE CREEK 153641794
---------------	--------------	----------------------	----------	----------	---


Builders FirstSource (Apex, NC),

Apex, NC - 27523,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Aug 12 12:38:18 2022 Page 1

ID: \_P7X\_GPFnckXXgca6LM05wyocTp-5pOSYtt2PP7vOWw9TEmcjbsmuKcdKibr7yZPYUyob5p

Job Reference (optional)



Scale = 1:18.9

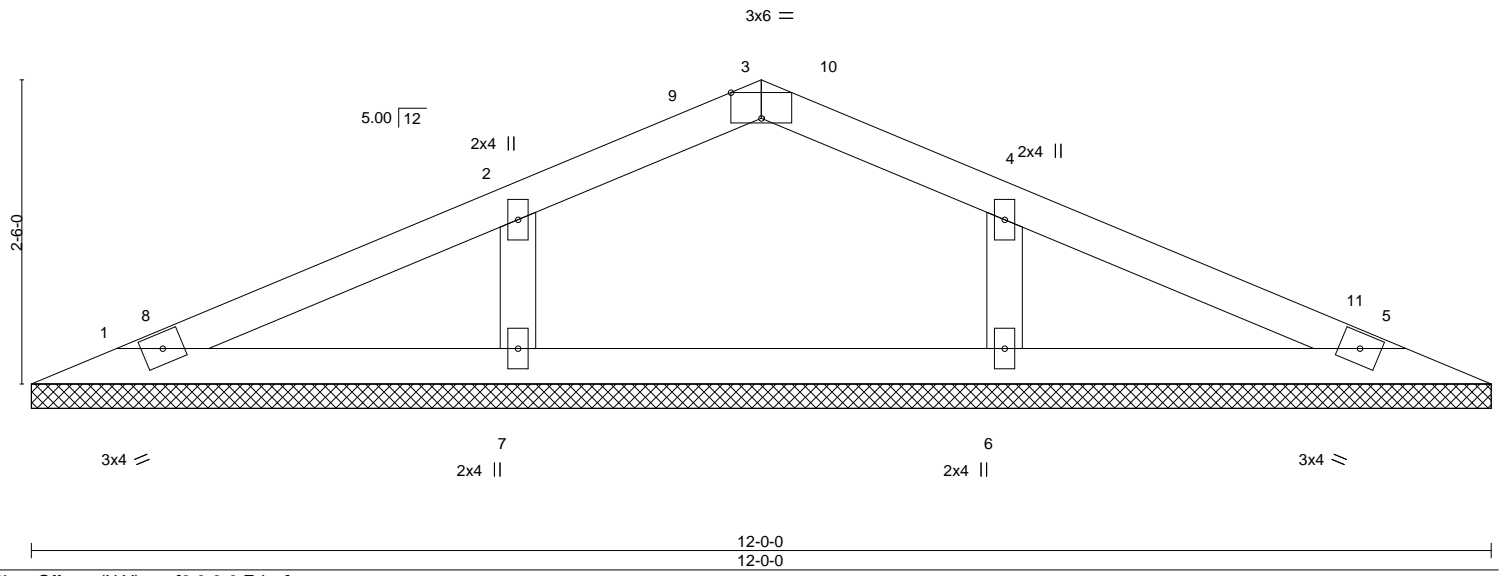



Plate Offsets (X,Y)--	[3:0-3:0,Edge]									
<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in	(loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 20.0	Plate Grip DOL	1.15	TC 0.21	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.11	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.04	Horz(CT)	0.00	5	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S						Weight: 38 lb	FT = 20%

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SP No.3	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
OTHERS 2x4 SP No.3	

**REACTIONS.** All bearings 12-0-0.  
 (lb) - Max Horz 1=29(LC 12)  
 Max Uplift All uplift 100 lb or less at joint(s) 5, 6, 7  
 Max Grav All reactions 250 lb or less at joint(s) 1, 5 except 6=291(LC 1), 7=291(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) 0-8-12 to 5-6-6, Interior(1) 5-6-6 to 6-0-0, Exterior(2) 6-0-0 to 10-9-10, Interior(1) 10-9-10 to 11-3-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Gable requires continuous bottom chord bearing.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 6, 7.

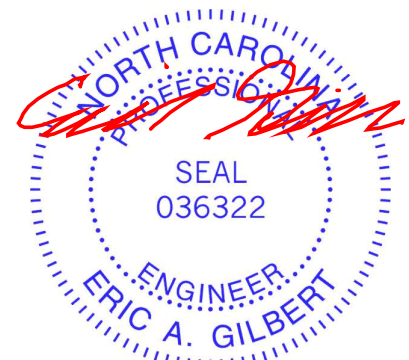

August 15, 2022

<p><b>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.</b></p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see <b>ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information</b> available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	<p>ENGINEERING BY</p> <p><b>TRENCO</b></p> <p>A MiTek Affiliate</p> <p>818 Soundside Road Edenton, NC 27932</p>
--	---


Job PCK101	Truss V02	Truss Type VALLEY	Qty 1	Ply 1	MATTAMYHOMES/ALLEGHENY; LOT 101 PROVIDENCE CREEK I53641795
---------------	--------------	----------------------	----------	----------	---

Builders FirstSource (Apex, NC),


Apex, NC - 27523,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Aug 12 12:38:19 2022 Page 1

ID: \_P7X\_GPFnckXXgca6LM05wyocTp-Z0yqlDugAifm?gVLOxHrGp\_xDkXm39s\_McJz4wyob5o



Scale = 1:14.6

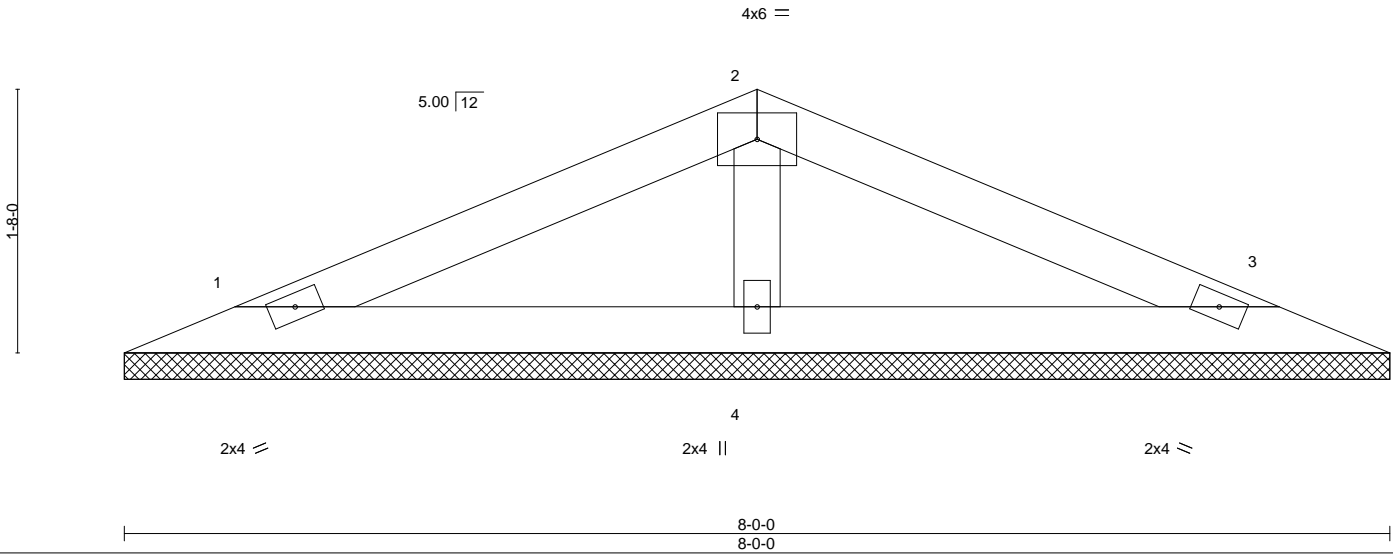

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.24	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.18	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.04	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-S					Weight: 24 lb	FT = 20%
	Code IRC2015/TPI2014							

**LUMBER-**  
 TOP CHORD 2x4 SP No.3  
 BOT CHORD 2x4 SP No.3  
 OTHERS 2x4 SP No.3


**BRACING-**  
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 1=8-0-0, 3=8-0-0, 4=8-0-0  
 Max Horz 1=18(LC 16)  
 Max Uplift 1=-12(LC 12), 3=-16(LC 13)  
 Max Grav 1=118(LC 23), 3=118(LC 24), 4=294(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Gable requires continuous bottom chord bearing.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.

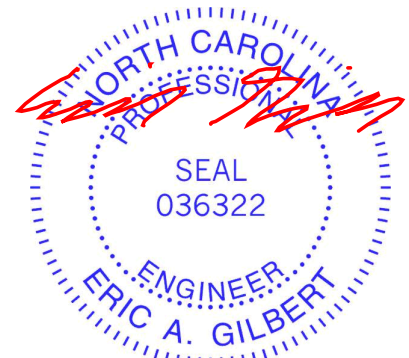

August 15, 2022

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road  
 Edenton, NC 27932

Job PCK101	Truss V03	Truss Type VALLEY	Qty 1	Ply 1	MATTAMYHOMES/ALLEGHENY; LOT 101 PROVIDENCE CREEK I53641796
---------------	--------------	----------------------	----------	----------	---

Builders FirstSource (Apex, NC), Apex, NC - 27523,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Aug 12 12:38:20 2022 Page 1

ID: \_P7X\_GPFncXXgca6LM05wyocTp-1CWczZvix0Nddq4Xafo4o0X928skocj7aG2WdMyob5n

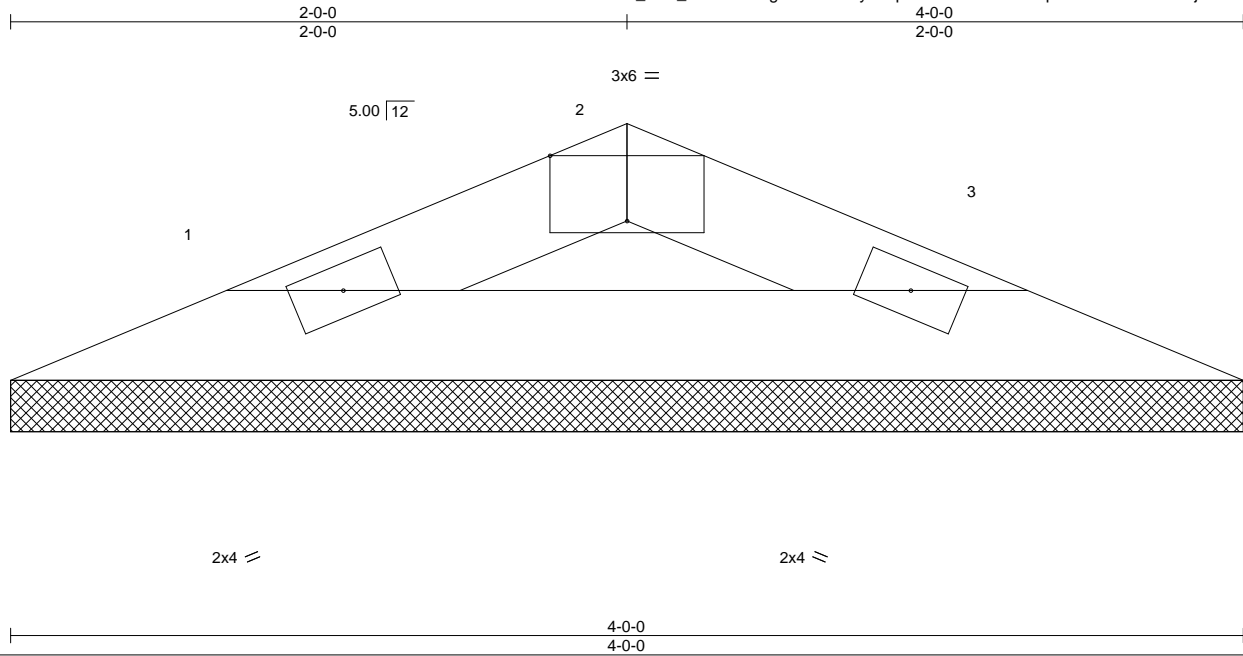

Scale = 1:7.5

PLATE OFFSETS (X,Y)--	[2:0-3:0,Edge]					PLATES	GRIP
<b>LOADING</b> (psf)	<b>SPACING-</b> 2-0-0	<b>CSI.</b>	<b>DEFL.</b> in (loc)	l/defl	L/d		
TCLL 20.0	Plate Grip DOL 1.15	TC 0.04	Vert(LL) n/a	-	n/a	999	
TCDL 10.0	Lumber DOL 1.15	BC 0.13	Vert(CT) n/a	-	n/a	999	
BCLL 0.0 *	Rep Stress Incr YES	WB 0.00	Horz(CT) 0.00	3	n/a	n/a	
BCDL 10.0	Code IRC2015/TPI2014	Matrix-P					
							Weight: 10 lb FT = 20%

**LUMBER-**  
 TOP CHORD 2x4 SP No.3  
 BOT CHORD 2x4 SP No.3


**BRACING-**  
 TOP CHORD Structural wood sheathing directly applied or 4-0-0 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 1=4-0-0, 3=4-0-0  
 Max Horz 1=7(LC 13)  
 Max Uplift 1=4(LC 12), 3=4(LC 13)  
 Max Grav 1=102(LC 1), 3=102(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Gable requires continuous bottom chord bearing.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.

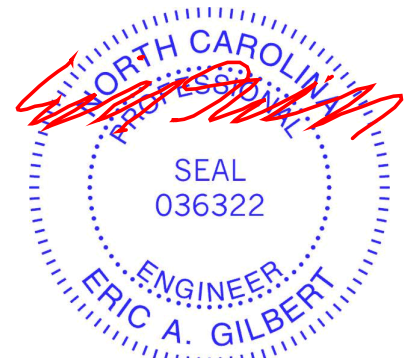

August 15, 2022

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road  
 Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	MATTAMYHOMES/ALLEGHENY; LOT 101 PROVIDENCE CREEK I53641797
PCK101	V04	GABLE	1	1	Job Reference (optional)

Builders FirstSource (Apex, NC),

Apex, NC - 27523,


8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Aug 12 12:38:21 2022 Page 1

ID: P7X\_GPFnckXXgca6LM05wyocTp-VO4bAvwwhKVUF\_fj8MJLE4F0XCIX0FHpw049pyob5m



4x6 =

Scale = 1:59.2

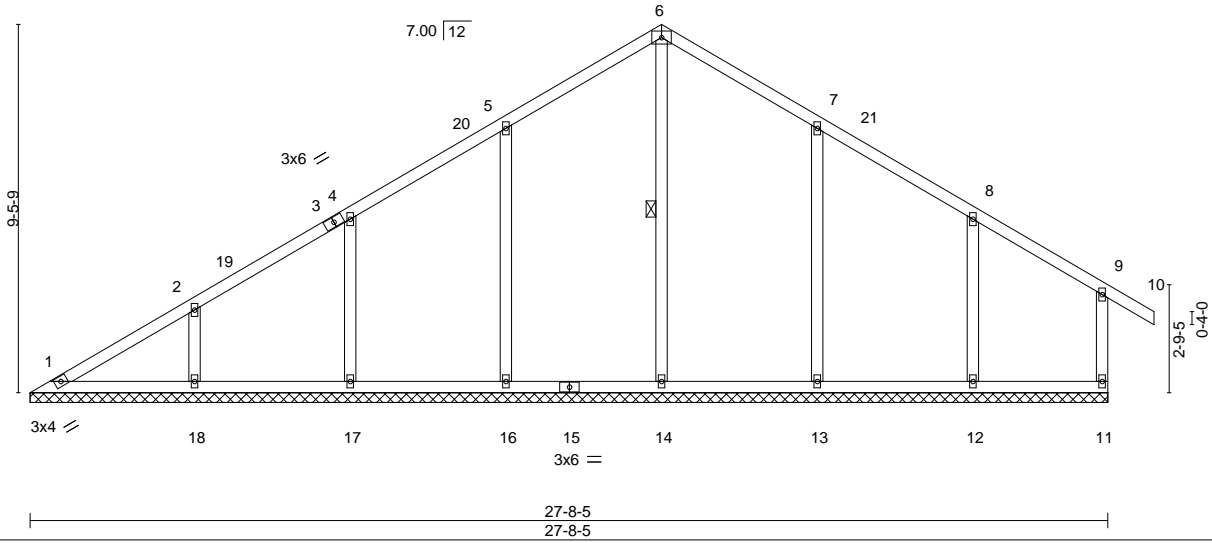

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.35	Vert(LL)	-0.00	10	n/r	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.18	Vert(CT)	-0.01	10	n/r		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.24	Horz(CT)	-0.00	11	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S					Weight: 142 lb	FT = 20%

**LUMBER-**

TOP CHORD 2x4 SP No.3 \*Except\*  
6-10: 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.3  
OTHERS 2x4 SP No.3

**BRACING-**

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
WEBS 1 Row at midpt 6-14

**REACTIONS.**


All bearings 27-8-5.  
(lb) - Max Horz 1=212(LC 11)  
Max Uplift All uplift 100 lb or less at joint(s) 11, 1, 16, 17, 18, 13, 12  
Max Grav All reactions 250 lb or less at joint(s) 11, 1 except 14=440(LC 19), 16=473(LC 19), 17=374(LC 19), 18=346(LC 23), 13=474(LC 20), 12=365(LC 20)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

WEBS 5-16=-264/126, 2-18=-259/121, 7-13=-266/126

**NOTES-**

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) 0-6-8 to 5-4-1, Interior(1) 5-4-1 to 16-2-11, Exterior(2) 16-2-11 to 21-0-5, Interior(1) 21-0-5 to 28-10-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 11, 1, 16, 17, 18, 13, 12.

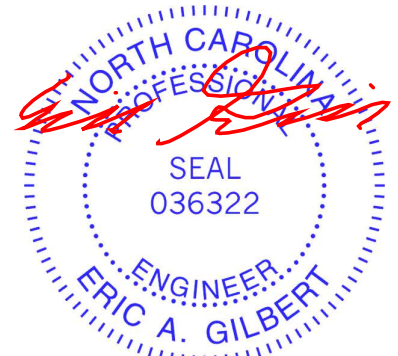

August 15, 2022

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road  
Edenton, NC 27932

Job PCK101	Truss V05	Truss Type GABLE	Qty 1	Ply 1	MATTAMYHOMES/ALLEGHENY; LOT 101 PROVIDENCE CREEK I53641798
---------------	--------------	---------------------	----------	----------	---

Builders FirstSource (Apex, NC), Apex, NC - 27523,


8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Aug 12 12:38:21 2022 Page 1

ID:\_P7X\_GPFncXXgca6LM05wyocTp-VO4bAvwwhKVUF\_fj8MJLE4F7XAQX14Hpwo49pyob5m



4x6 =

Scale = 1:55.1

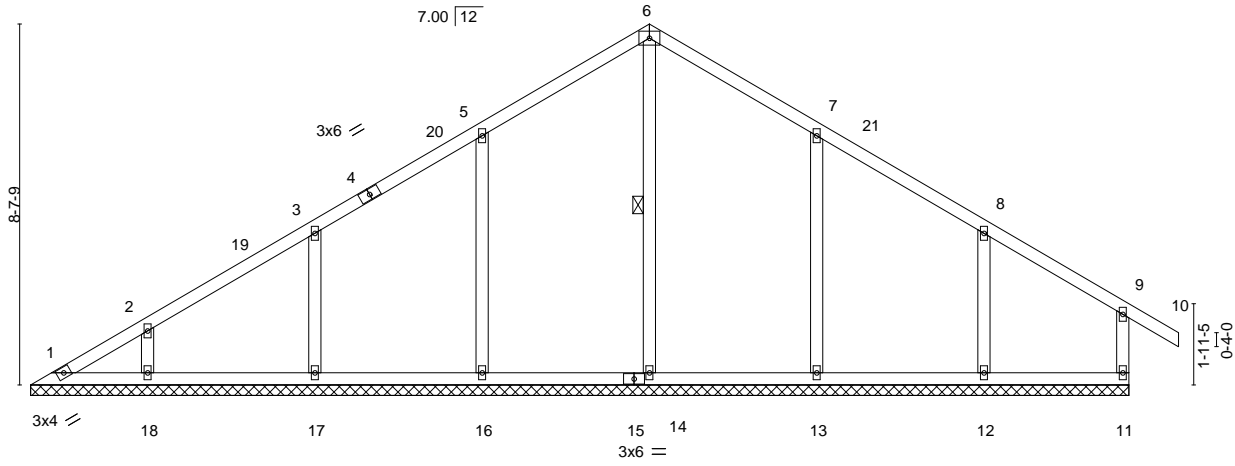

26-3-2  
26-3-2

<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in (loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 20.0	Plate Grip DOL	1.15	TC 0.34	Vert(LL)	-0.00	10	n/r	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.30	Vert(CT)	-0.01	10	n/r		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.19	Horz(CT)	0.00	11	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S						
								Weight: 129 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SP No.3 \*Except\*  
6-10: 2x4 SP No.2  
BOT CHORD 2x4 SP No.3 \*Except\*  
1-15: 2x4 SP No.2  
WEBS 2x4 SP No.3  
OTHERS 2x4 SP No.3


**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
WEBS 1 Row at midpt 6-14

**REACTIONS.** All bearings 26-3-2.  
(lb) - Max Horz 1=187(LC 11)  
Max Uplift All uplift 100 lb or less at joint(s) 11, 1, 16, 17, 18, 13, 12  
Max Grav All reactions 250 lb or less at joint(s) 11, 1 except 14=434(LC 22), 16=469(LC 19), 17=389(LC 19), 18=283(LC 23), 13=474(LC 20), 12=365(LC 20)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
WEBS 5-16=-261/125, 7-13=-266/126

**NOTES-**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) 0-6-8 to 5-4-1, Interior(1) 5-4-1 to 14-9-9, Exterior(2) 14-9-9 to 19-7-2, Interior(1) 19-7-2 to 27-5-6 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) All plates are 2x4 MT20 unless otherwise indicated.
- 4) Gable requires continuous bottom chord bearing.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 11, 1, 16, 17, 18, 13, 12.

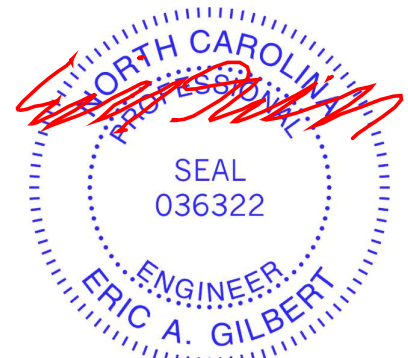

August 15, 2022

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road  
Edenton, NC 27932

Job PCK101	Truss V06	Truss Type GABLE	Qty 1	Ply 1	MATTAMYHOMES/ALLEGHENY; LOT 101 PROVIDENCE CREEK 153641799
---------------	--------------	---------------------	----------	----------	---


Builders FirstSource (Apex, NC),

Apex, NC - 27523,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Aug 12 12:38:22 2022 Page 1

ID: P7X\_GPFncXXgca6LM05wyocTp-zaezOFwYSddLs8Ewh4rYtRcRtxWwGTyQ2aXdhFyob5I

Job Reference (optional)

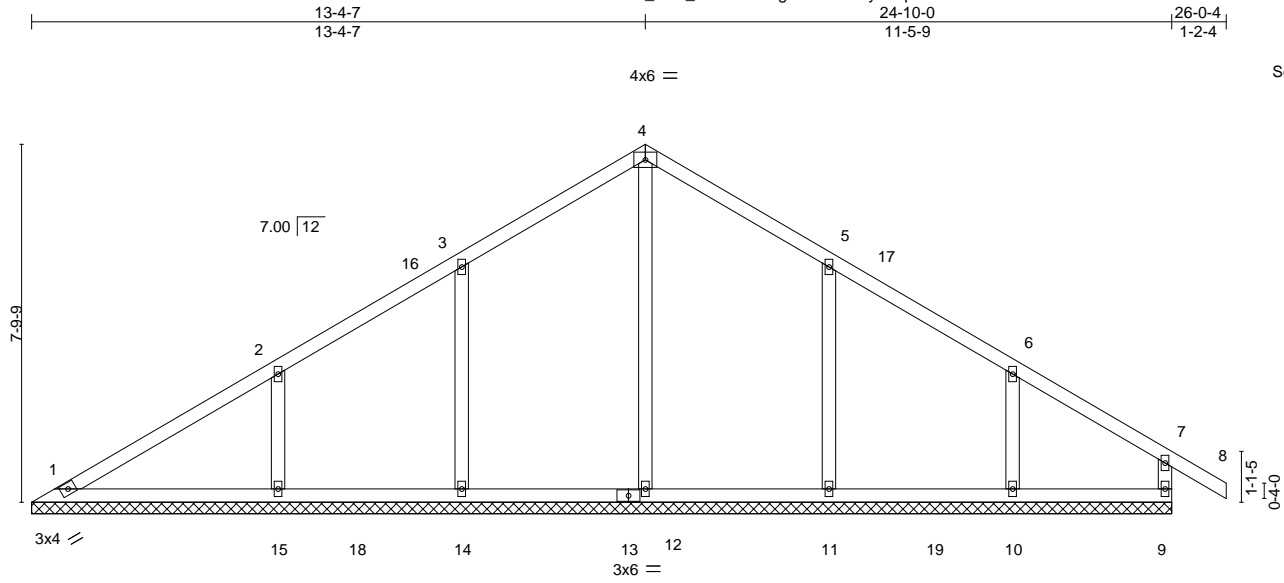

Scale = 1:50.2

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.28	Vert(LL)	-0.00	8	n/r	MT20	244/190
BCLL 10.0	Lumber DOL	1.15	BC 0.28	Vert(CT)	-0.01	8	n/r		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.24	Horz(CT)	0.00	9	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S					Weight: 115 lb	FT = 20%

**LUMBER-**

TOP CHORD 2x4 SP No.2  
 BOT CHORD 2x4 SP No.2 \*Except\*  
 9-13: 2x4 SP No.3  
 WEBS 2x4 SP No.2  
 OTHERS 2x4 SP No.3

**BRACING-**

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.**

All bearings 24-10-0.  
 (lb) - Max Horz 1=162(LC 11)  
 Max Uplift All uplift 100 lb or less at joint(s) 1, 9, 14, 15, 11, 10  
 Max Grav All reactions 250 lb or less at joint(s) 1, 9 except 12=424(LC 22), 14=430(LC 19), 15=428(LC 19), 11=461(LC 20), 10=320(LC 20)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

WEBS 2-15=302/141, 5-11=265/125

**NOTES-**

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) 0-6-8 to 5-4-7, Interior(1) 5-4-7 to 13-4-7, Exterior(2) 13-4-7 to 18-2-0, Interior(1) 18-2-0 to 26-0-3 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 9, 14, 15, 11, 10.



August 15, 2022

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road  
 Edenton, NC 27932


Job PCK101	Truss V07	Truss Type VALLEY	Qty 1	Ply 1	MATTAMYHOMES/ALLEGHENY; LOT 101 PROVIDENCE CREEK 153641800
---------------	--------------	----------------------	----------	----------	---

Builders FirstSource (Apex, NC),

Apex, NC - 27523,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Aug 12 12:38:23 2022 Page 1

ID: \_P7X\_GPFnckXXgca6LM05wyocTp-RnCLbxbADxICUHo6FnMnQf9duLse?x1aHEHADhyob5k

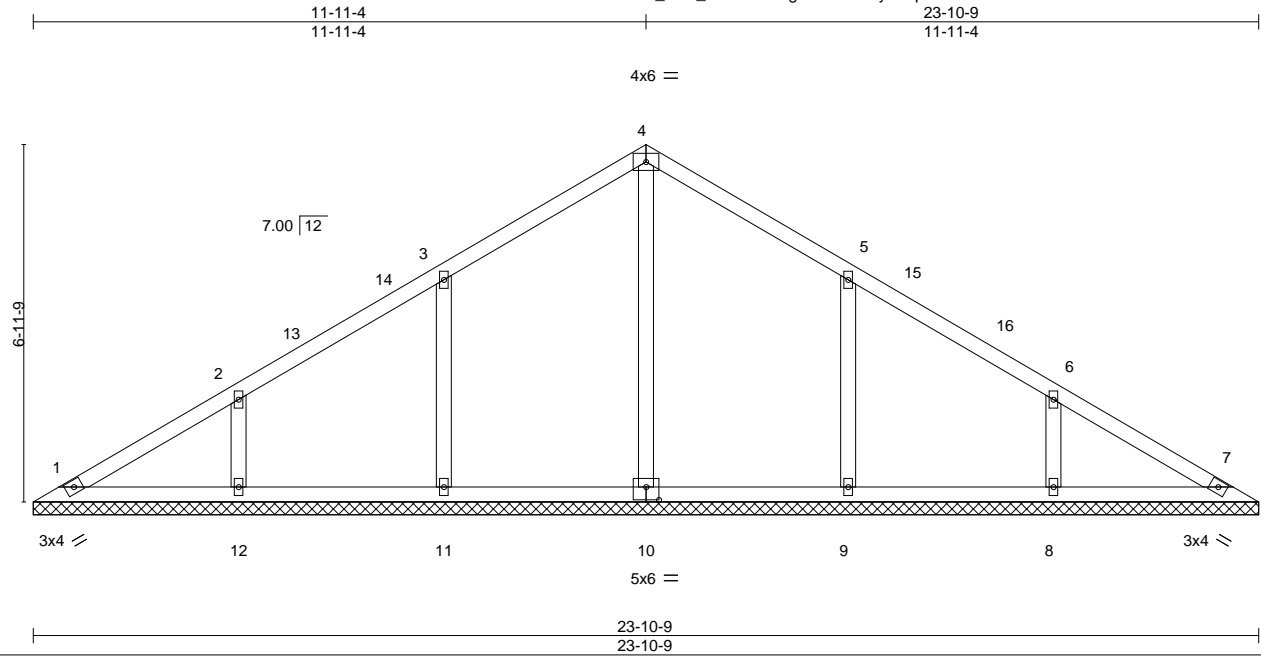

Scale = 1:144.9

Plate Offsets (X,Y)--	[10:0-3-0-0-3-0]				
<b>LOADING</b> (psf)	<b>SPACING-</b> 2-0-0	<b>CSI.</b>	<b>DEFL.</b> in (loc) l/defl L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 20.0	Plate Grip DOL 1.15	TC 0.20	Vert(LL) n/a - n/a 999	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.31	Vert(CT) n/a - n/a 999		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.16	Horz(CT) 0.00 7 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S		Weight: 102 lb	FT = 20%

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x4 SP No.3	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
OTHERS 2x4 SP No.3	

**REACTIONS.** All bearings 23-10-9.  
 (lb) - Max Horz 1=-131(LC 8)  
 Max Uplift All uplift 100 lb or less at joint(s) 1, 8, 9, 12, 11  
 Max Grav All reactions 250 lb or less at joint(s) 1, 7 except 10=386(LC 22), 8=330(LC 1), 9=393(LC 20), 12=330(LC 1), 11=394(LC 19)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 WEBS 5-9=-259/125, 3-11=-259/125

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) 0-6-8 to 5-4-1, Interior(1) 5-4-1 to 11-11-4, Exterior(2) 11-11-4 to 16-8-14, Interior(1) 16-8-14 to 23-4-1 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) All plates are 2x4 MT20 unless otherwise indicated.
  - 4) Gable requires continuous bottom chord bearing.
  - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 6) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 8, 9, 12, 11.




August 15, 2022

Job PCK101	Truss V08	Truss Type VALLEY	Qty 1	Ply 1	MATTAMYHOMES/ALLEGHENY; LOT 101 PROVIDENCE CREEK 153641801
---------------	--------------	----------------------	----------	----------	---

Builders FirstSource (Apex, NC), Apex, NC - 27523,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Aug 12 12:38:24 2022 Page 1  
ID: \_P7X\_GPFncKXXgca6LM05wyocTp-vzmjoxyp\_Ft36RNlpVt0zsimfIDdkPQjVu0km8yob5j

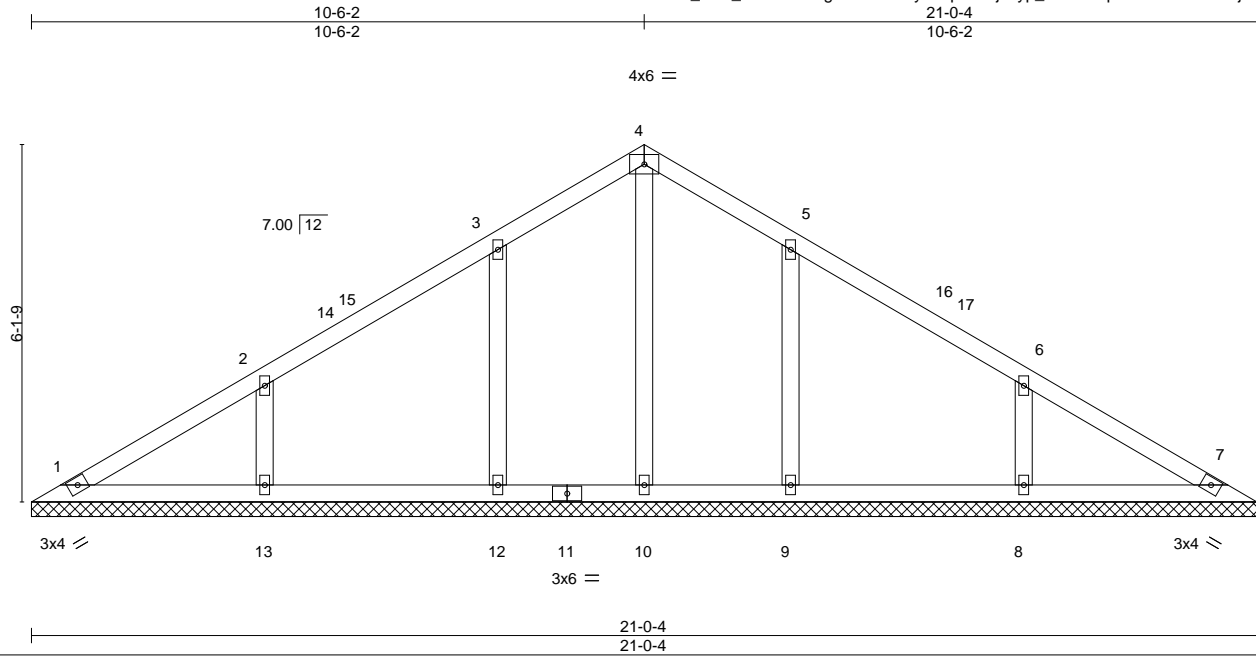


LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.32	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.20	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.08	Horz(CT)	0.00	7	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-S					Weight: 91 lb	FT = 20%
	Code IRC2015/TPI2014							

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.3	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x4 SP No.3	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
OTHERS 2x4 SP No.3	

**REACTIONS.** All bearings 21-0-4.  
 (lb) - Max Horz 1=-115(LC 8)  
 Max Uplift All uplift 100 lb or less at joint(s) 8, 9, 13, 12  
 Max Grav All reactions 250 lb or less at joint(s) 1, 7, 10 except 8=345(LC 20), 9=316(LC 20), 13=345(LC 19), 12=316(LC 19)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 WEBS 6-8=-256/121, 2-13=-256/121

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) 0-6-8 to 5-4-1, Interior(1) 5-4-1 to 10-6-2, Exterior(2) 10-6-2 to 15-3-12, Interior(1) 15-3-12 to 20-5-12 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) All plates are 2x4 MT20 unless otherwise indicated.
  - 4) Gable requires continuous bottom chord bearing.
  - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 6) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 8, 9, 13, 12.

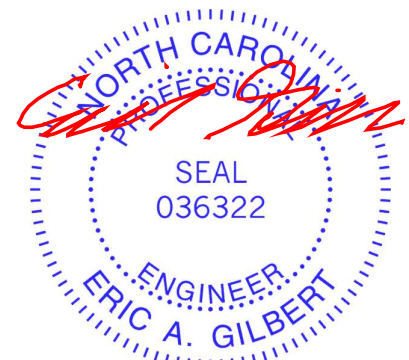

August 15, 2022



Job PCK101	Truss V09	Truss Type VALLEY	Qty 1	Ply 1	MATTAMYHOMES/ALLEGHENY; LOT 101 PROVIDENCE CREEK I53641802
---------------	--------------	----------------------	----------	----------	---


Builders FirstSource (Apex, NC),

Apex, NC - 27523,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Aug 12 12:38:25 2022 Page 1

ID: \_P7X\_GPFnckXXgca6LM05wyocTp-N9J50HzRIY?vjbyVNCOFV4Ex39ZnTsmskYmHlayob5i

Job Reference (optional)

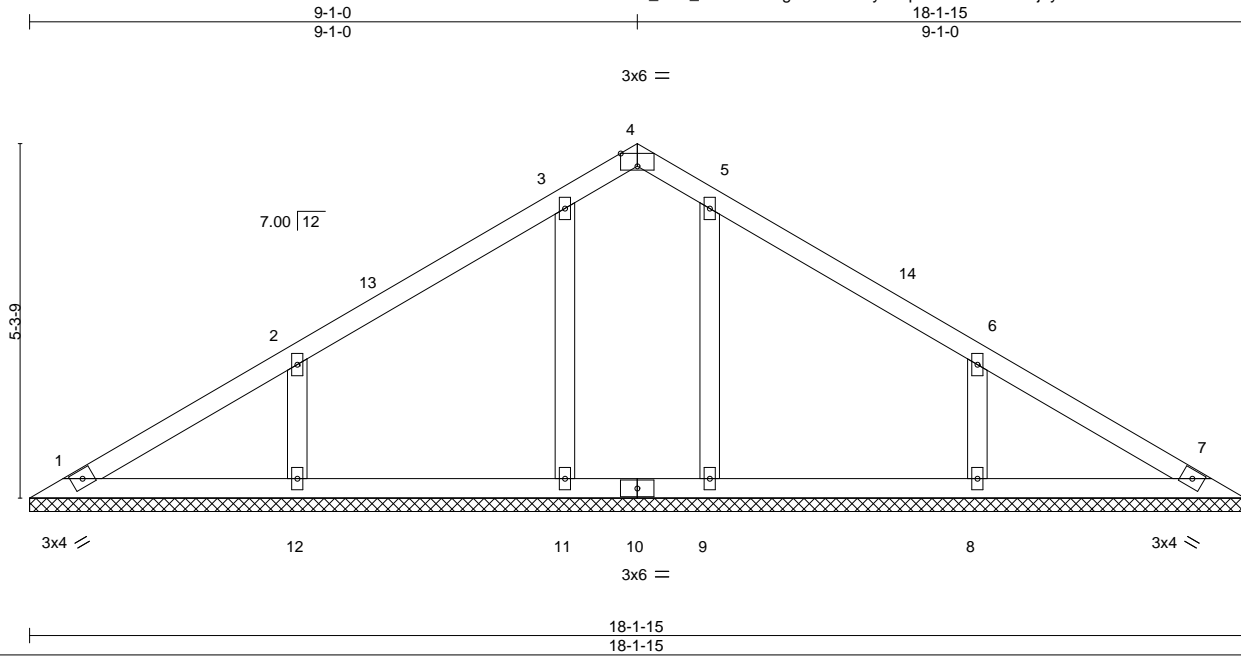

Scale = 1:34.4


Plate Offsets (X,Y)--	[4:0-3-0,Edge]								
<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in (loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 20.0	Plate Grip DOL	1.15	TC 0.35	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.20	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.08	Horz(CT)	0.00	7	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S					Weight: 74 lb	FT = 20%

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SP No.3	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x4 SP No.3	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
OTHERS 2x4 SP No.3	

**REACTIONS.** All bearings 18-1-15.  
 (lb) - Max Horz 1=98(LC 8)  
 Max Uplift All uplift 100 lb or less at joint(s) 8, 9, 12, 11  
 Max Grav All reactions 250 lb or less at joint(s) 1, 7 except 8=352(LC 20), 9=250(LC 24), 12=351(LC 19), 11=256(LC 19)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 WEBS 6-8=-260/126, 2-12=-259/125

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) 0-6-8 to 5-4-1, Interior(1) 5-4-1 to 9-1-0, Exterior(2) 9-1-0 to 14-1-15, Interior(1) 14-1-15 to 17-7-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) All plates are 2x4 MT20 unless otherwise indicated.
  - 4) Gable requires continuous bottom chord bearing.
  - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 6) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 8, 9, 12, 11.

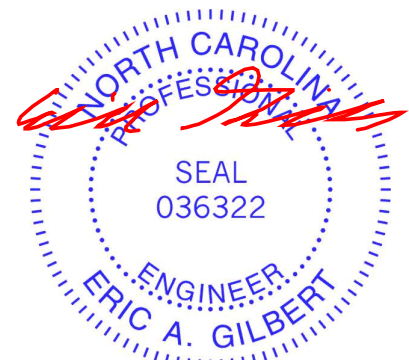

August 15, 2022

Job PCK101	Truss V10	Truss Type VALLEY	Qty 1	Ply 1	MATTAMYHOMES/ALLEGHENY; LOT 101 PROVIDENCE CREEK 153641803
---------------	--------------	----------------------	----------	----------	---

Builders FirstSource (Apex, NC),

Apex, NC - 27523,


8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Aug 12 12:38:26 2022 Page 1

ID: P7X\_GPFnckXXgca6LM05wyocTp-sMtUDcz3Ws7mLIXhvvU2Hn7DYxZCKG0zCVrq0yob5h



4x6 =

Scale = 1:28.9

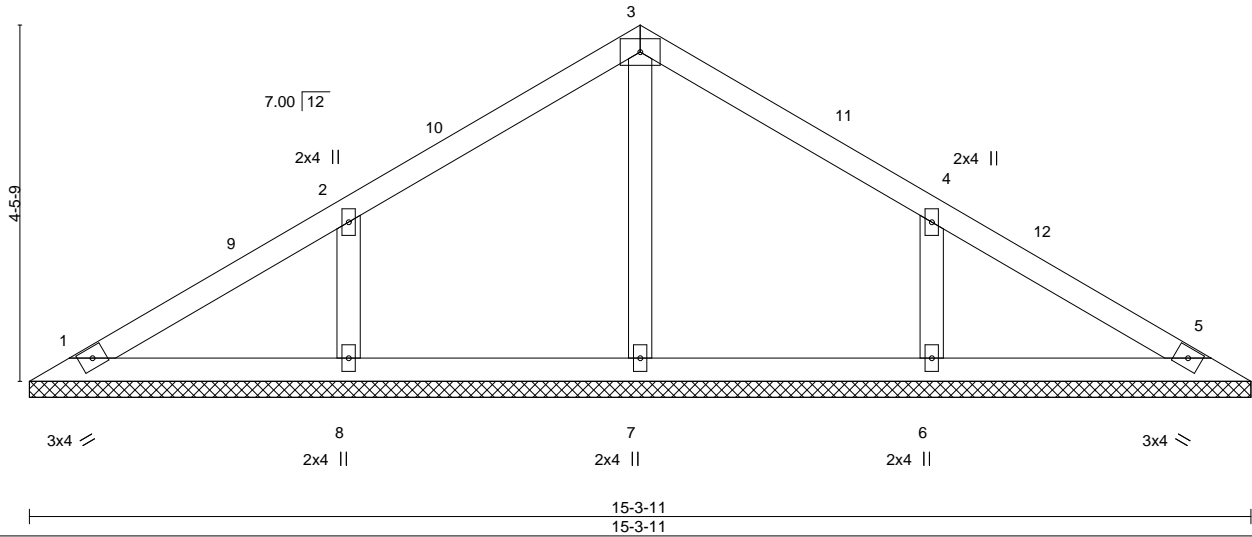

<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in (loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>	
TCLL 20.0	Plate Grip DOL	1.15	TC 0.32	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.11	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.06	Horz(CT)	0.00	5	n/a	n/a		
BCDL 10.0	Code	IRC2015/TPI2014	Matrix-S						Weight: 58 lb	FT = 20%


**LUMBER-**  
 TOP CHORD 2x4 SP No.3  
 BOT CHORD 2x4 SP No.2  
 OTHERS 2x4 SP No.3

**BRACING-**  
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** All bearings 15-3-11.  
 (lb) - Max Horz 1=82(LC 8)  
 Max Uplift All uplift 100 lb or less at joint(s) 1, 6, 8  
 Max Grav All reactions 250 lb or less at joint(s) 1, 5, 7 except 6=341(LC 20), 8=341(LC 19)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
**WEBS** 4-6=-255/120, 2-8=-255/121

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) 0-6-8 to 5-4-1, Interior(1) 5-4-1 to 7-7-13, Exterior(2) 7-7-13 to 12-5-7, Interior(1) 12-5-7 to 14-9-3 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Gable requires continuous bottom chord bearing.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 6, 8.

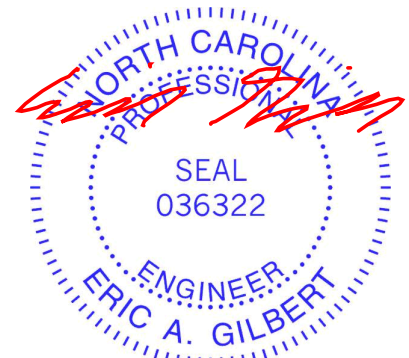

August 15, 2022

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**  
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ENGINEERING BY  
**TRENCO**  
 A MiTek Affiliate  
 818 Soundside Road  
 Edenton, NC 27932


Job PCK101	Truss V11	Truss Type VALLEY	Qty 1	Ply 1	MATTAMYHOMES/ALLEGHENY; LOT 101 PROVIDENCE CREEK I53641804
---------------	--------------	----------------------	----------	----------	---

Builders FirstSource (Apex, NC),

Apex, NC - 27523,


8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Aug 12 12:38:27 2022 Page 1

ID: \_P7X\_GPFnckXXgca6LM05wyocTp-KYRsRy\_hHAGdzv6tUdQjaVKI5yG2xnm9BsFOMTyob5g



4x6 =

Scale = 1:23.5

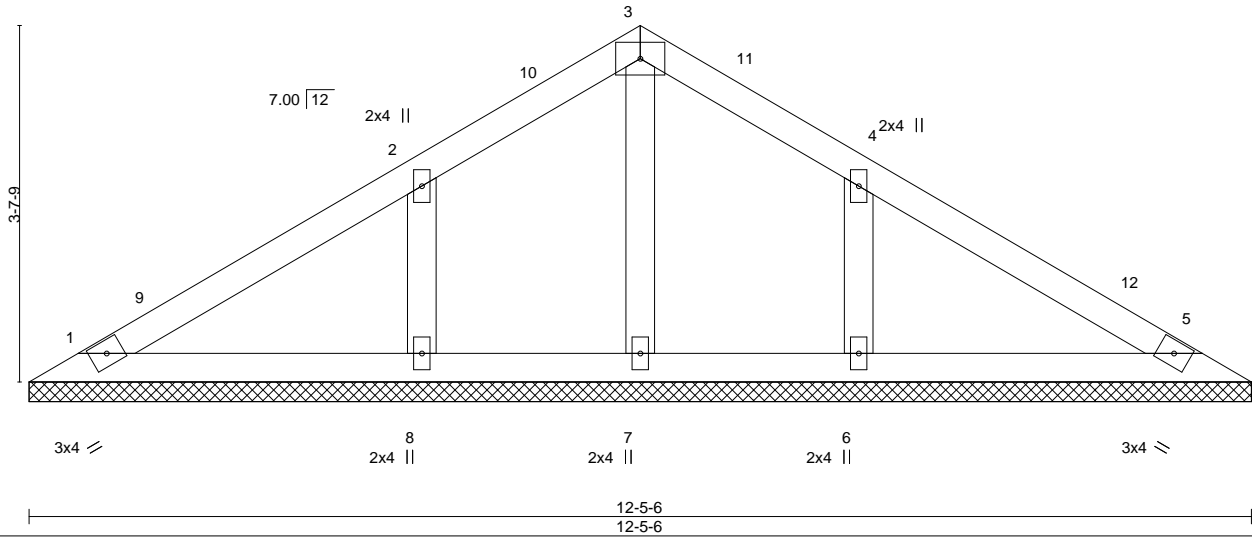

<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in (loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 20.0	Plate Grip DOL	1.15	TC 0.25	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.09	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.04	Horz(CT)	0.00	5	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S					Weight: 48 lb	FT = 20%

**LUMBER-**  
 TOP CHORD 2x4 SP No.3  
 BOT CHORD 2x4 SP No.2  
 OTHERS 2x4 SP No.3

**BRACING-**  
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** All bearings 12-5-6.  
 (lb) - Max Horz 1=65(LC 8)  
 Max Uplift All uplift 100 lb or less at joint(s) 6, 8  
 Max Grav All reactions 250 lb or less at joint(s) 1, 5, 7 except 6=298(LC 20), 8=298(LC 19)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) 0-6-8 to 5-4-1, Interior(1) 5-4-1 to 6-2-11, Exterior(2) 6-2-11 to 11-0-5, Interior(1) 11-0-5 to 11-10-15 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Gable requires continuous bottom chord bearing.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 6, 8.



August 15, 2022

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road  
 Edenton, NC 27932

Job PCK101	Truss V12	Truss Type VALLEY	Qty 1	Ply 1	MATTAMYHOMES/ALLEGHENY; LOT 101 PROVIDENCE CREEK I53641805
---------------	--------------	----------------------	----------	----------	---

Builders FirstSource (Apex, NC), Apex, NC - 27523,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Aug 12 12:38:28 2022 Page 1

ID: \_P7X\_GPFnckXXgca6LM05wyocTp-ok?Eel?J2TOUa3h42Kyy7isSMMbDgE1JQW\_xvvyob5f

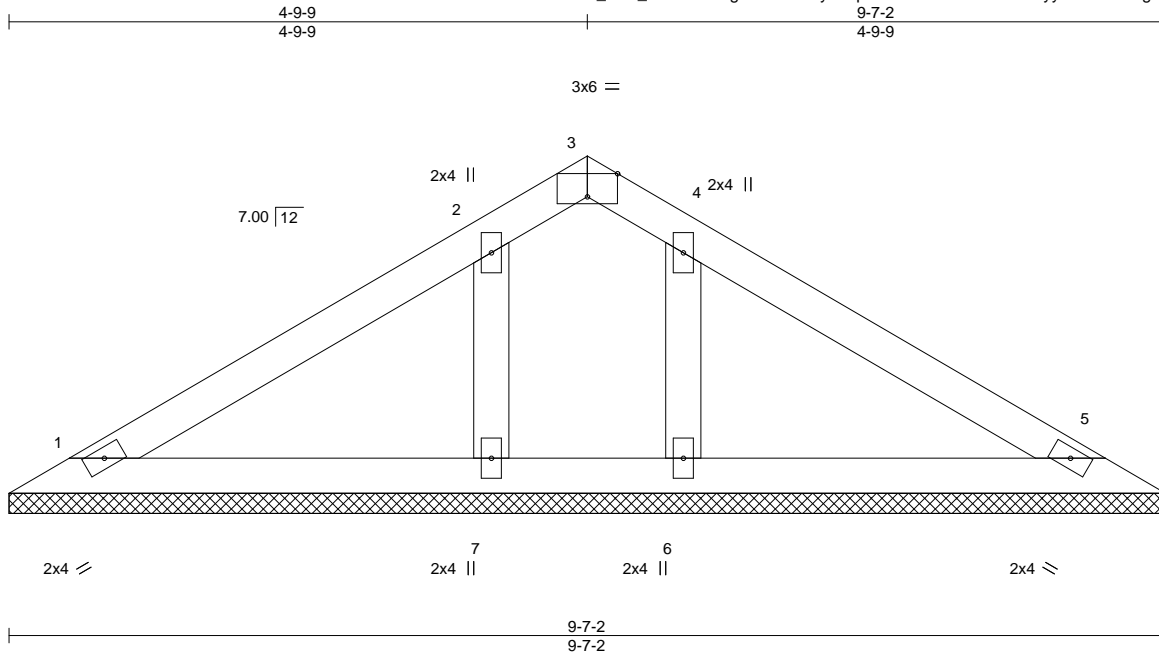

Scale = 1:19.1

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.28	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.16	Vert(LL) n/a - n/a 999		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.04	Vert(CT) n/a - n/a 999		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.00 5 n/a n/a		
	Code IRC2015/TPI2014			Weight: 34 lb	FT = 20%

**LUMBER-**  
 TOP CHORD 2x4 SP No.3  
 BOT CHORD 2x4 SP No.3  
 OTHERS 2x4 SP No.3

**BRACING-**  
 TOP CHORD Structural wood sheathing directly applied or 9-7-2 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

**REACTIONS.** All bearings 9-7-2.  
 (lb) - Max Horz 1=49(LC 10)  
 Max Uplift All uplift 100 lb or less at joint(s) 6, 7  
 Max Grav All reactions 250 lb or less at joint(s) 1, 5 except 6=272(LC 24), 7=272(LC 23)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 6, 7.



August 15, 2022

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road  
 Edenton, NC 27932


Job PCK101	Truss V13	Truss Type VALLEY	Qty 1	Ply 1	MATTAMYHOMES/ALLEGHENY; LOT 101 PROVIDENCE CREEK 153641806
---------------	--------------	----------------------	----------	----------	---

Builders FirstSource (Apex, NC),

Apex, NC - 27523,


8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Aug 12 12:38:28 2022 Page 1

ID:\_P7X\_GPFncXXgca6LM05wyocTp-ok?Eel?J2TOUa3h42Kyy7isTtMbXgEFJQW\_xvvyob5f



4x6 =

Scale = 1:14.3

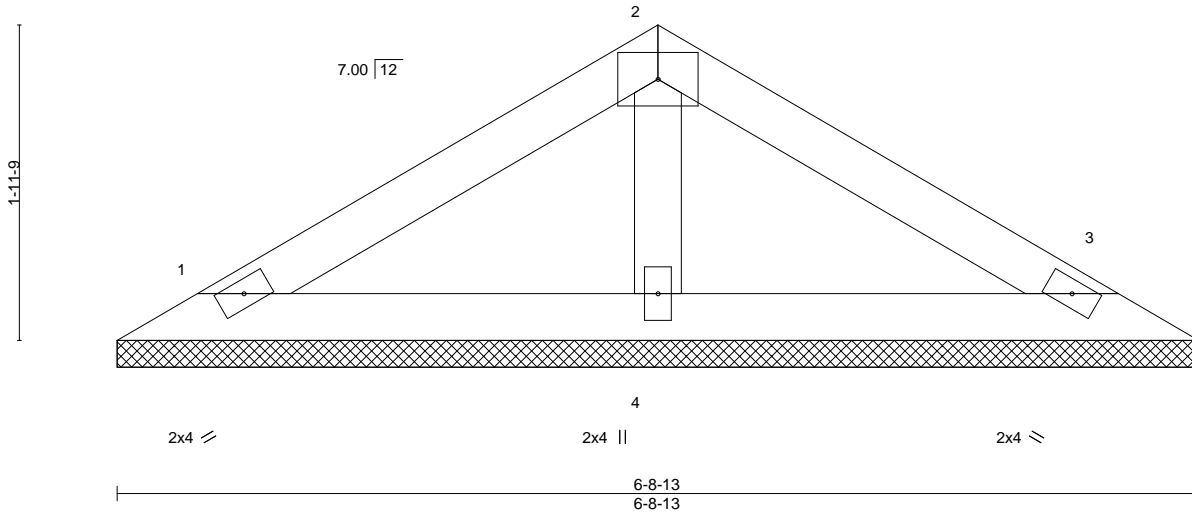

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.25	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.14	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.03	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-P						
	Code IRC2015/TPI2014						Weight: 22 lb	FT = 20%

**LUMBER-**  
 TOP CHORD 2x4 SP No.3  
 BOT CHORD 2x4 SP No.3  
 OTHERS 2x4 SP No.3


**BRACING-**  
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 1=6-8-13, 3=6-8-13, 4=6-8-13  
 Max Horz 1=33(LC 8)  
 Max Uplift 1=-15(LC 12), 3=-19(LC 13)  
 Max Grav 1=117(LC 1), 3=117(LC 1), 4=218(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Gable requires continuous bottom chord bearing.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.

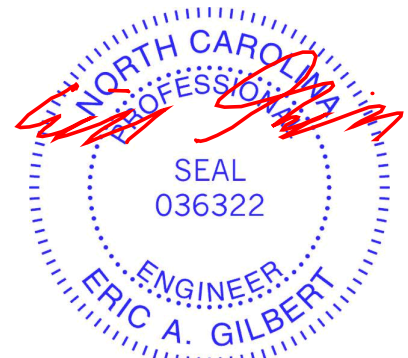

August 15, 2022

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road  
 Edenton, NC 27932

Job PCK101	Truss V14	Truss Type VALLEY	Qty 1	Ply 1	MATTAMYHOMES/ALLEGHENY; LOT 101 PROVIDENCE CREEK I53641807
---------------	--------------	----------------------	----------	----------	---


Builders FirstSource (Apex, NC),

Apex, NC - 27523,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Aug 12 12:38:29 2022 Page 1

ID: \_P7X\_GPFnckXXgca6LM05wyocTp-GxZcse0xpnWLCGGc2TBgwPhdmxRPhySfAKVRLyob5e

Job Reference (optional)

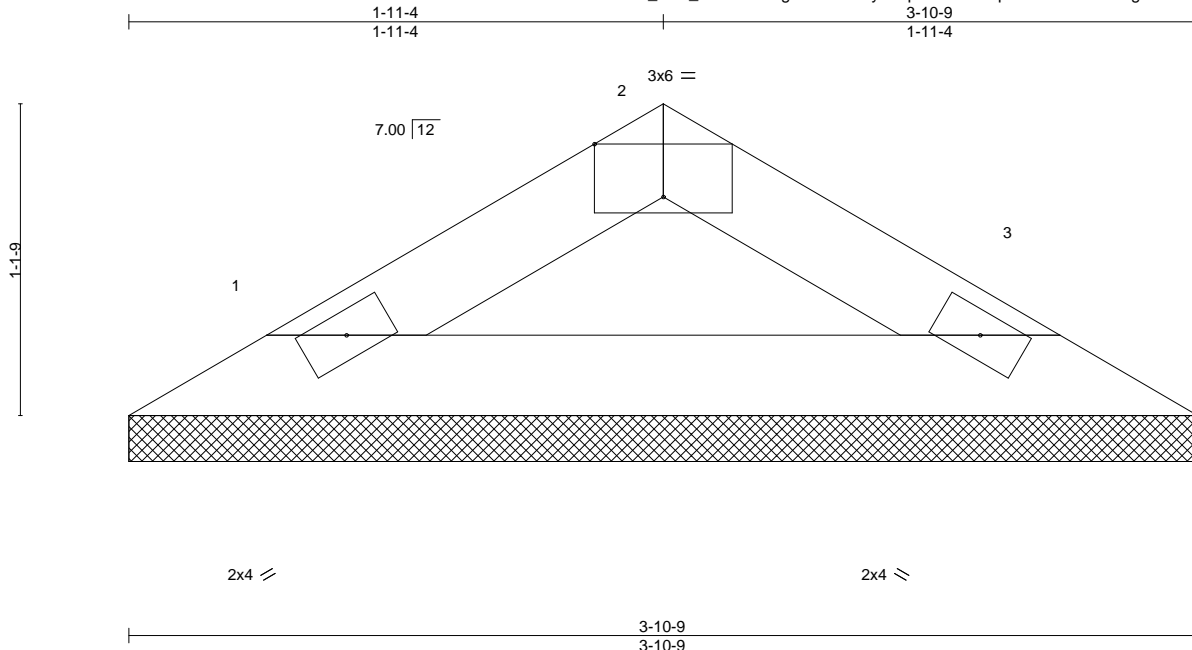

Scale = 1:8.4

Plate Offsets (X,Y)--	[2:0-3-0,Edge]					PLATES	GRIP
<b>LOADING</b> (psf)	<b>SPACING-</b> 2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in (loc)	l/defl	L/d	
TCLL 20.0	Plate Grip DOL 1.15	TC 0.05	Vert(LL)	n/a	-	n/a	999
TCDL 10.0	Lumber DOL 1.15	BC 0.16	Vert(CT)	n/a	-	n/a	999
BCLL 0.0 *	Rep Stress Incr YES	WB 0.00	Horz(CT)	0.00	3	n/a	n/a
BCDL 10.0	Code IRC2015/TPI2014	Matrix-P					
							Weight: 11 lb FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.3	TOP CHORD Structural wood sheathing directly applied or 3-10-9 oc purlins.
BOT CHORD 2x4 SP No.3	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 1=3-10-9, 3=3-10-9  
 Max Horz 1=-16(LC 8)  
 Max Uplift 1=-3(LC 12), 3=-3(LC 13)  
 Max Grav 1=112(LC 1), 3=112(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Gable requires continuous bottom chord bearing.
  - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 5) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.



Job PCK101	Truss V15	Truss Type VALLEY	Qty 1	Ply 1	MATTAMYHOMES/ALLEGHENY; LOT 101 PROVIDENCE CREEK I53641808
---------------	--------------	----------------------	----------	----------	---

Builders FirstSource (Apex, NC), Apex, NC - 27523,

8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Aug 12 12:38:30 2022 Page 1

ID: \_P7X\_GPFncKXXgca6LM05wyocTp-k77\_3\_1Za5eCqMrS9L\_QC7xozAHg88XcuqT2znyob5d



3x6 =

Scale = 1:19.4

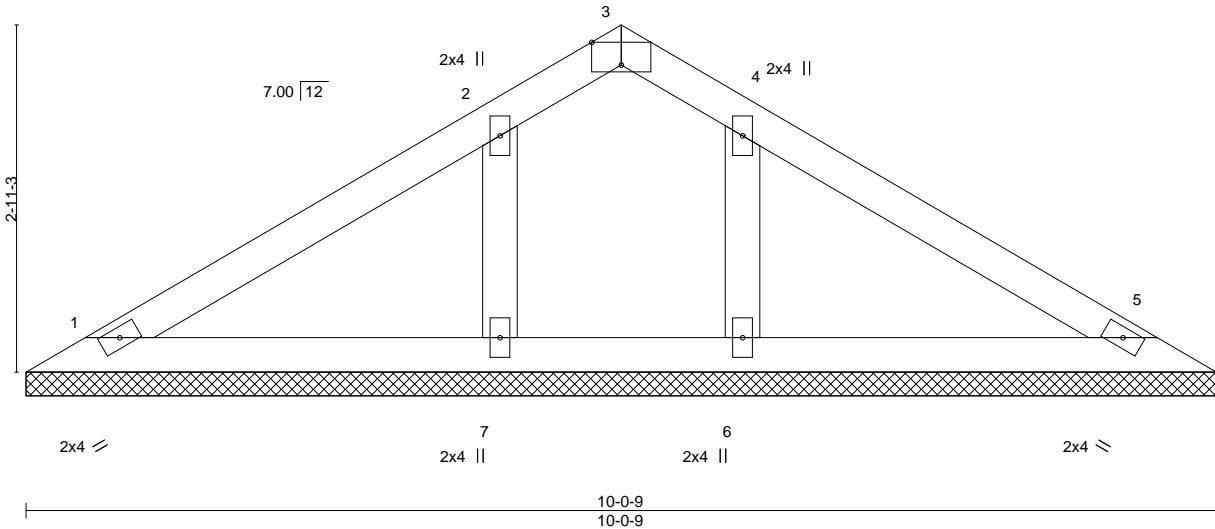


Plate Offsets (X,Y)--	[3:0-3-0,Edge]								
<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in (loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 20.0	Plate Grip DOL	1.15	TC 0.27	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.16	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.04	Horz(CT)	0.00	5	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S					Weight: 36 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SP No.3  
BOT CHORD 2x4 SP No.3  
OTHERS 2x4 SP No.3


**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 10-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

**REACTIONS.** All bearings 10-0-9.  
(lb) - Max Horz 1=-52(LC 8)  
Max Uplift All uplift 100 lb or less at joint(s) 6, 7  
Max Grav All reactions 250 lb or less at joint(s) 1, 5 except 6=276(LC 24), 7=279(LC 19)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 6, 7.

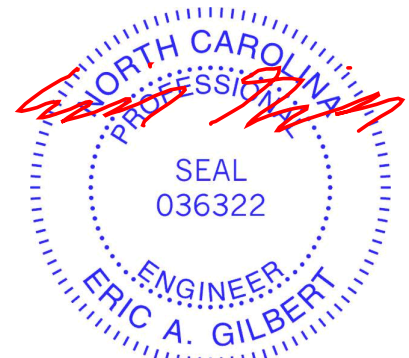

August 15, 2022

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road  
Edenton, NC 27932

Job PCK101	Truss V16	Truss Type VALLEY	Qty 1	Ply 1	MATTAMYHOMES/ALLEGHENY; LOT 101 PROVIDENCE CREEK I53641809
---------------	--------------	----------------------	----------	----------	---

Builders FirstSource (Apex, NC), Apex, NC - 27523,


8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Aug 12 12:38:30 2022 Page 1

ID: \_P7X\_GPFnckXXgca6LM05wyocTp-k77\_3\_1Za5eCqMrS9L\_QC7xpyAHg88gcuqT2znyob5d



4x6 =

Scale = 1:15.0

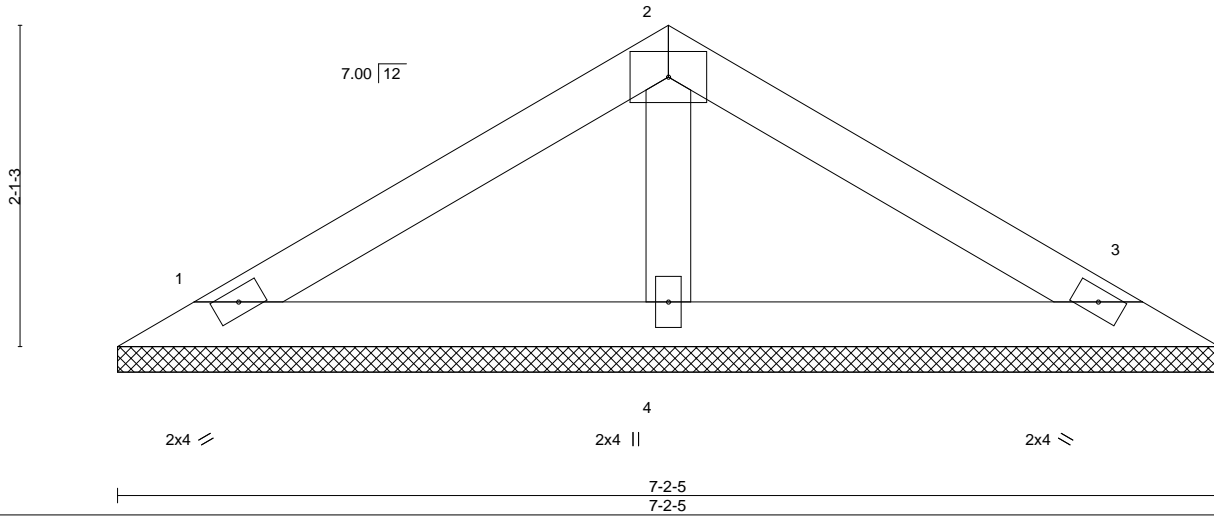

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.21	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.16	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.03	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-S						
	Code IRC2015/TPI2014						Weight: 24 lb	FT = 20%

**LUMBER-**  
 TOP CHORD 2x4 SP No.3  
 BOT CHORD 2x4 SP No.3  
 OTHERS 2x4 SP No.3


**BRACING-**  
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 1=7-2-5, 3=7-2-5, 4=7-2-5  
 Max Horz 1=-35(LC 8)  
 Max Uplift 1=-11(LC 12), 3=-16(LC 13)  
 Max Grav 1=115(LC 23), 3=115(LC 24), 4=259(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Gable requires continuous bottom chord bearing.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.

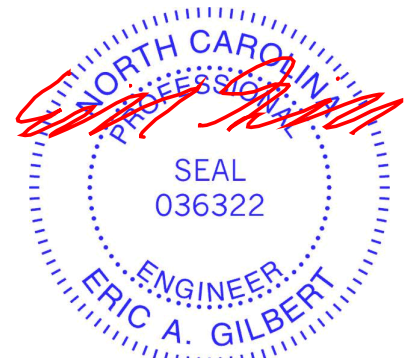

August 15, 2022

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road  
 Edenton, NC 27932



Job PCK101	Truss V17	Truss Type VALLEY	Qty 1	Ply 1	MATTAMYHOMES/ALLEGHENY; LOT 101 PROVIDENCE CREEK I53641810
---------------	--------------	----------------------	----------	----------	---

Builders FirstSource (Apex, NC), Apex, NC - 27523, 8.530 s Dec 6 2021 MiTek Industries, Inc. Fri Aug 12 12:38:31 2022 Page 1  
 ID: \_P7X\_GPFncXXgca6LM05wyocTp-CJhNGK1CLOm3RWQejTVfILU0nZc\_tbSi6UDbWEyob5c

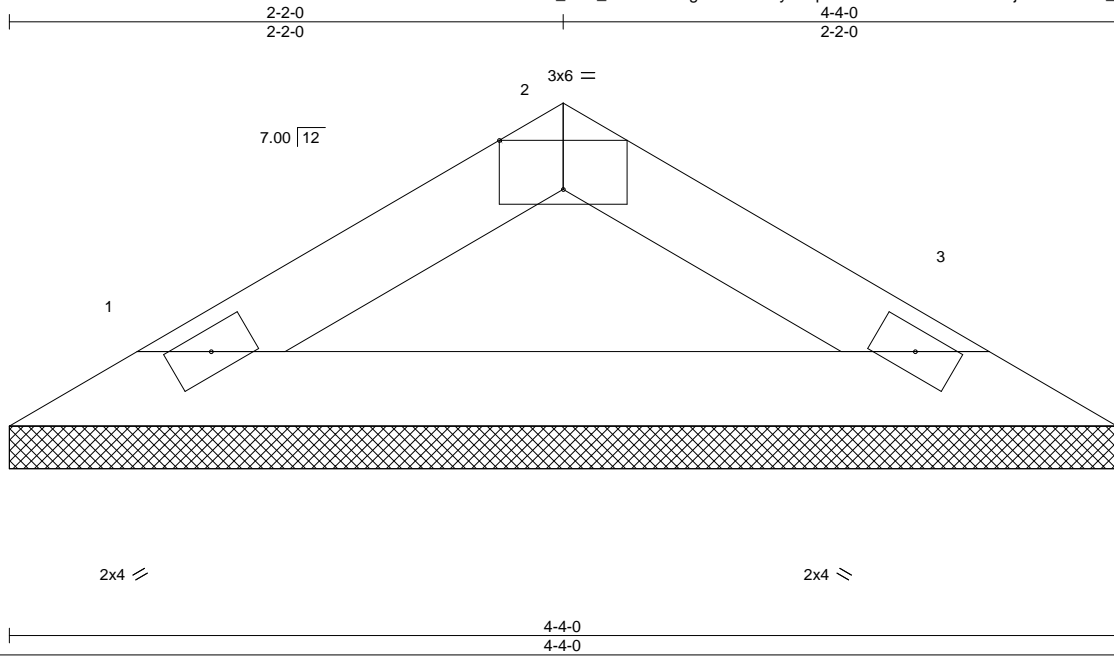

Scale = 1:9.0

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.07	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.22	Vert(LL) n/a - n/a 999		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.00	Vert(CT) n/a - n/a 999		
BCDL 10.0	Rep Stress Incr YES	Matrix-P	Horz(CT) 0.00 3 n/a n/a		
	Code IRC2015/TPI2014			Weight: 12 lb	FT = 20%

**LUMBER-**  
 TOP CHORD 2x4 SP No.3  
 BOT CHORD 2x4 SP No.3

**BRACING-**  
 TOP CHORD Structural wood sheathing directly applied or 4-4-0 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 1=4-4-0, 3=4-4-0  
 Max Horz 1=-19(LC 8)  
 Max Uplift 1=-4(LC 12), 3=-4(LC 13)  
 Max Grav 1=130(LC 1), 3=130(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Gable requires continuous bottom chord bearing.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.



August 15, 2022

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road  
 Edenton, NC 27932

# Symbols

## PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0- 1/16" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

\* Plate location details available in **MITek 20/20 software** or upon request.

## PLATE SIZE

4 X 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

## LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

## BEARING



Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur. Min size shown is for crushing only.

### Industry Standards:

ANSI/TFP 1: National Design Specification for Metal Plate Connected Wood Truss Construction.  
DSB-89: Design Standard for Bracing, Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate  
BCSI: Connected Wood Trusses.

# Numbering System

6-4-8  
dimensions shown in ft-in-sixteenths  
(Drawings not to scale)



**JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.**

**CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.**

## PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ESR1988  
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TFP 1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MITteK® All Rights Reserved



MITek Engineering Reference Sheet: MII-7473 rev. 5/19/2020



# General Safety Notes

## Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TFP 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TFP 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Rewriting pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TFP 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.