

A3 Must have 1 3/4" minimum joist bearing at ends

For information on lateral load capacities refer to literature or local dealership.



A7



A7P

CONNECTION OF MULTIPLE PIECES OF TOP-LOADED BEAMS

LVL & PSL (1 3/4" Width Pieces)

- Minimum of 2 rows 16d (3 1/2") nails at 12" o.c.
- Minimum of 3 rows 16d (3 1/2") nails at 12" o.c. for 14", 16", 18" beams.
- Multiple pieces of LVL & PSL can be nailed or bolted together to form a header or beam of the required size, up to a maximum with of 7 inches. Minimum of 2 rows 1/2" bolts at 24" o.c. staggered.



L6 For side-loaded multiple member beams, additional nailing or bolting may be required. See current Joist literature.

LVL HANGER NAILS INSTALLATION



FILL ALL NAIL HOLES USING 16D COMMON (0.162 X 3 1/2") NAILS. DO NOT USE AIR GUN NAILS OR N10D NAILS.

LOAD BEARING CANTILEVER



E1

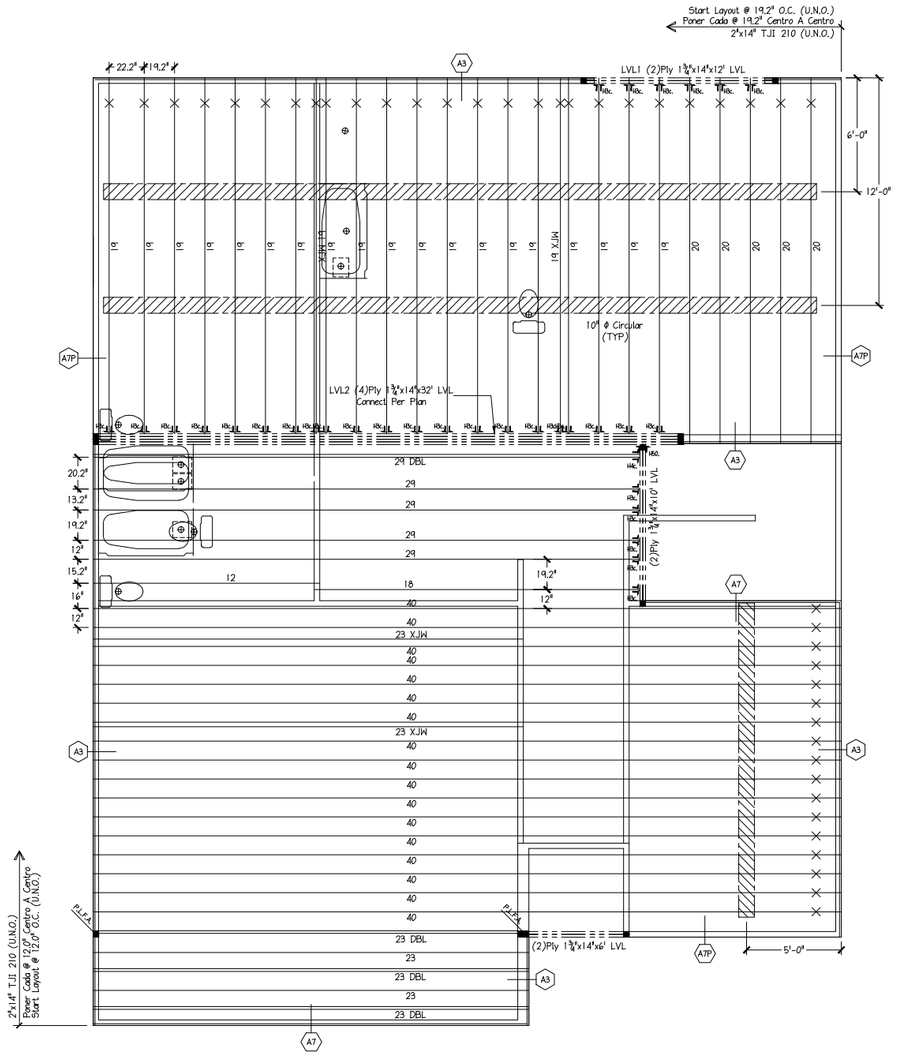

ELEVATION: CRAFTSMAN, COLONIAL, FARMHOUSE

2ND FLOOR I-JOIST PLACEMENT PLAN

MATTAMY HOMES - VOYAGEUR

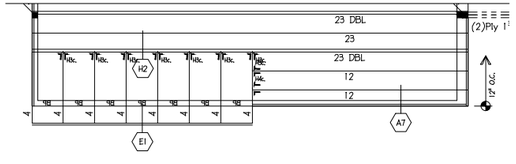

ELEVATION: TUDOR

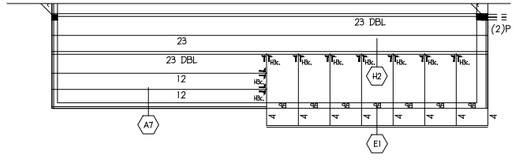

ELEVATION: FRENCH COUNTRY

POINT LOAD FROM ABOVE (P.L.F.A.)

P.L.F.A. USE SOLID BLOCKING TO TRANSFER LOAD FROM ABOVE TO FOUNDATION

DO NOT CUT ORANGE END
NO CORTE EL COLOR NARANJA

"X" INDICATES ORANGE END
"X" INDICAR EL COLOR NARANJA

SCALE: 1/4" = 1'-0" 0 5' 10'

ENGINEERED WOOD MATERIAL LIST

MATTAMY HOMES

VOYAGEUR

2ND FLOOR I-JOIST PLACEMENT PLAN

BASE - ELEVATION: CRAFTSMAN, COLONIAL, FARMHOUSE

MARK	QTY	CUT LENGTH	DESCRIPTION (Holes)
11	5	11'-0"	2" x 14" TJI 210
12	1	12'-0"	2" x 14" TJI 210
18	1	18'-0"	2" x 14" TJI 210
19a	21	19'-0"	2" x 14" TJI 210 (2)
20a	5	20'-0"	2" x 14" TJI 210 (2)
23	10	23'-0"	2" x 14" TJI 210
29	6	29'-0"	2" x 14" TJI 210
40a	17	40'-0"	2" x 14" TJI 210 (1) [Total 1668']

11' JOISTS=RIM

BEAMS AND HEADERS

LVL	2	6'-0"	1 3/4" x 14" LVL 2.0E (Flush)
LVL	2	10'-0"	1 3/4" x 14" LVL 2.0E (Flush)
LVL1	2	12'-0"	1 3/4" x 14" LVL 2.0E (Flush)
LVL2	4	32'-0"	1 3/4" x 14" LVL 2.0E (Flush)

ACCESSORIES & OTHER MATERIALS (Simpson Hangers)

ITEM	QTY	UNIT	DESCRIPTION
14" Rim	126	LF	1 7/8"x14" TJ Rim 11 pcs@12' or 8 pcs@16'
H4c	1	PCS	MIU4.28/14 Double Face Mnt Hanger
H50	1	PCS	HHUS410 3 1/2" Face Mnt -Brn Hgr
H3c	32	PCS	IUS2.06/14 Single Face Mnt Hanger
10CUT14C	69	HOLE	10" Circular Cutout
TJLAYOUT	1	PCS	TJI Placement Layout
TJGUIDE	1	PCS	TJI Installation Guide

ELEVATION: TUDOR

MARK	QTY	CUT LENGTH	DESCRIPTION (Holes)
4	+8	4'-0"	2" x 14" TJI 210
12	+2	12'-0"	2" x 14" TJI 210
23	-3	23'-0"	2" x 14" TJI 210 [Total -13']
H3c	+8	PCS	IUS2.06/14 Single Face Mnt Hanger
H4c	+1	PCS	MIU4.28/14 Double Face Mnt Hanger
BP	+7	1'-10"	14" Blocking Panel [Total 13']

OPT. FRENCH COUNTRY

MARK	QTY	CUT LENGTH	DESCRIPTION (Holes)
4	+8	4'-0"	2" x 14" TJI 210
12	+2	12'-0"	2" x 14" TJI 210
23	-3	23'-0"	2" x 14" TJI 210 [Total -13']
H3c	+9	PCS	IUS2.06/14 Single Face Mnt Hanger
BP	+7	1'-10"	14" Blocking Panel [Total 13']

SEE MATERIAL LIST FOR DEPTH, SERIES & LENGTH

30 TJH 90 P.S.L. 63 LVL — INDICATES I-JOIST; INDICATES TIMBERSTRAND HDR, LSL; INDICATES PICO-LAM, LVL; INDICATES PARALLAM, PSL; INDICATES GLULAM, GLL

(B) INDICATES A SECTION FROM THE INSTALLATION GUIDE DETAIL IS ALSO SHOWN ON THIS SHEET

LB,M,A. LOAD BEARING WALL ABOVE
BLKG. BEAM BY OTHERS
EXTRA EXTRA JOIST ADDED
XJH EXTRA JOIST (1) UNDER WALL
DBL DOUBLE JOIST (2)
TRPL TRIPLE JOIST (3)
BP I-JOIST BLOCKING PANEL
PLY.S PLYWOOD SHEATHING BOARD
P.L.F.A. CONCENTRATED POINT LOAD FROM ABOVE
DROP BEAM
FLUSH BEAM

THIS SHOP DRAWING IS BASED ON THE FOLLOWING

PROJECT LOCATION :
PROJECT NUMBER :
ARCHITECT DWGS BY :
ARCH DWGS DATE :
ARCH LATEST REVISION :
CHECKED BY :
STRUCTURAL REVIEW BY :
DATE :

REV	BY	DATE / DESC.
SD	JDS	11/11/21

DESIGN DATA

LIVE 40 PSF
DEAD 10 PSF
TOTAL LOAD = 50 PSF

STRESS DURATION = 100%
DEFLECTION CRITERIA : (L/480)

COPYRIGHT 2020 Builders FirstSource (ULC) LP. ALL RIGHTS RESERVED. THIS DRAWING IS THE EXCLUSIVE PROPERTY OF BUILDERS FIRSTSOURCE (ULC) LP. AND CANNOT BE REPRODUCED IN ANY FORM WITHOUT PRIOR WRITTEN PERMISSION FROM BUILDERS FIRSTSOURCE (ULC) LP.

Builders FirstSource

THESE TRUSS DRAWINGS ARE NOT TO BE USED FOR CONSTRUCTION UNLESS BEARING THE MANUFACTURER'S SEAL. (EXCEPTION IS APPROPRIATE USAGE FOR FLOOR SHEATHING TO BE GLUED AND NAILED TO I-JOIST PANEL DEPENDS ON CONFIRM TILE FLOORS, SHOULD BE SUPPORTED ON TILE COUNCIL OF AMERICA (TCA) SPECIFICATIONS. BUILDER TO VERIFY LOCATION OF FLOORING DROPS AND SHIFT JOISTS A MINIMUM OF 2 INCHES. ALL CEILING JOISTS AND RAFTER SPACING TO BEAR ON LOAD BEARING WALLS OR BEAMS DESIGNED TO SUPPORT THE LOADS IMPOSED. DO NOT CUT OR NOTCH TRUSSES. REFER TO TRUSS DESIGN DRAWINGS FOR LOCATION AND SIZE OF ALL PERMITTED OPENINGS. TO BEAR ON LOAD BEARING WALLS OR BEAMS DESIGNED TO SUPPORT THE LOADS IMPOSED. DO NOT CUT OR NOTCH TRUSSES. REFER TO TRUSS DESIGN DRAWINGS FOR LOCATION AND SIZE OF ALL PERMITTED OPENINGS. TO ATTACH GABLE LOADING, USE HEADERS SIZED FOR THE APPROPRIATE ACCUMULATION.

| | | |