



ROOF & FLOOR TRUSSES & BEAMS

Reilly Road Industrial Park
Fayetteville, N.C. 28309
Phone: (910) 864-8787
Fax: (910) 864-4444

Bearing reactions less than or equal to 3000# are deemed to comply with the prescriptive Code requirements. The contractor shall refer to the attached Tables (derived from the prescriptive Code requirements) to determine the minimum foundation size and number of wood studs required to support reactions greater than 3000# but not greater than 15000#. A registered design professional shall be retained to design the support system for any reaction that exceeds those specified in the attached Tables. A registered design professional shall be retained to design the support system for all reactions that exceed 15000#.

Signature
Neil Baggett


LOAD CHART FOR JACK STUDS

(BASED ON TABLES R502.5(1) & (b))
NUMBER OF JACK STUDS REQUIRED @ EA END OF HEADER/GIRDER

END REACTION (UP TO)	REQ'D STUDS FOR (1)PLY HEADER	END REACTION (UP TO)	REQ'D STUDS FOR (1)PLY HEADER	END REACTION (UP TO)	REQ'D STUDS FOR (1)PLY HEADER
1700	1	2550	1	3400	1
3400	2	5100	2	6800	2
5100	3	7650	3	10200	3
6800	4	10200	4	13600	4
8500	5	12750	5	17000	5
10200	6	15300	6		
11900	7				
13600	8				
15300	9				

PRECISION CUSTOM HOMES & RENOVATIONS	HARNETT	Lot 16 Liberty Meadows	Floor	9/7/2022	Neil Baggett	Neil Baggett
BUILDER	JOB NAME	PLAN	SEAL DATE	QUOTE #	JOB #	
Precision Custom Homes & Renovations	Lot 16 Liberty Meadows	Taggart 3.0	6/22/2022	Quote #	J1021-6183	
COUNTY	ADDRESS	MODEL	DATE REV.	DRAWN BY	SALESMAN	
Harnett	Lot 16 Liberty Meadows	Floor	9/7/2022	Neil Baggett	Neil Baggett	

THIS IS A TRUSS PLACEMENT DIAGRAM ONLY.
These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult BCSI-B1 and BCSI-B3 provided with the truss delivery package or online @ sbcindustry.com

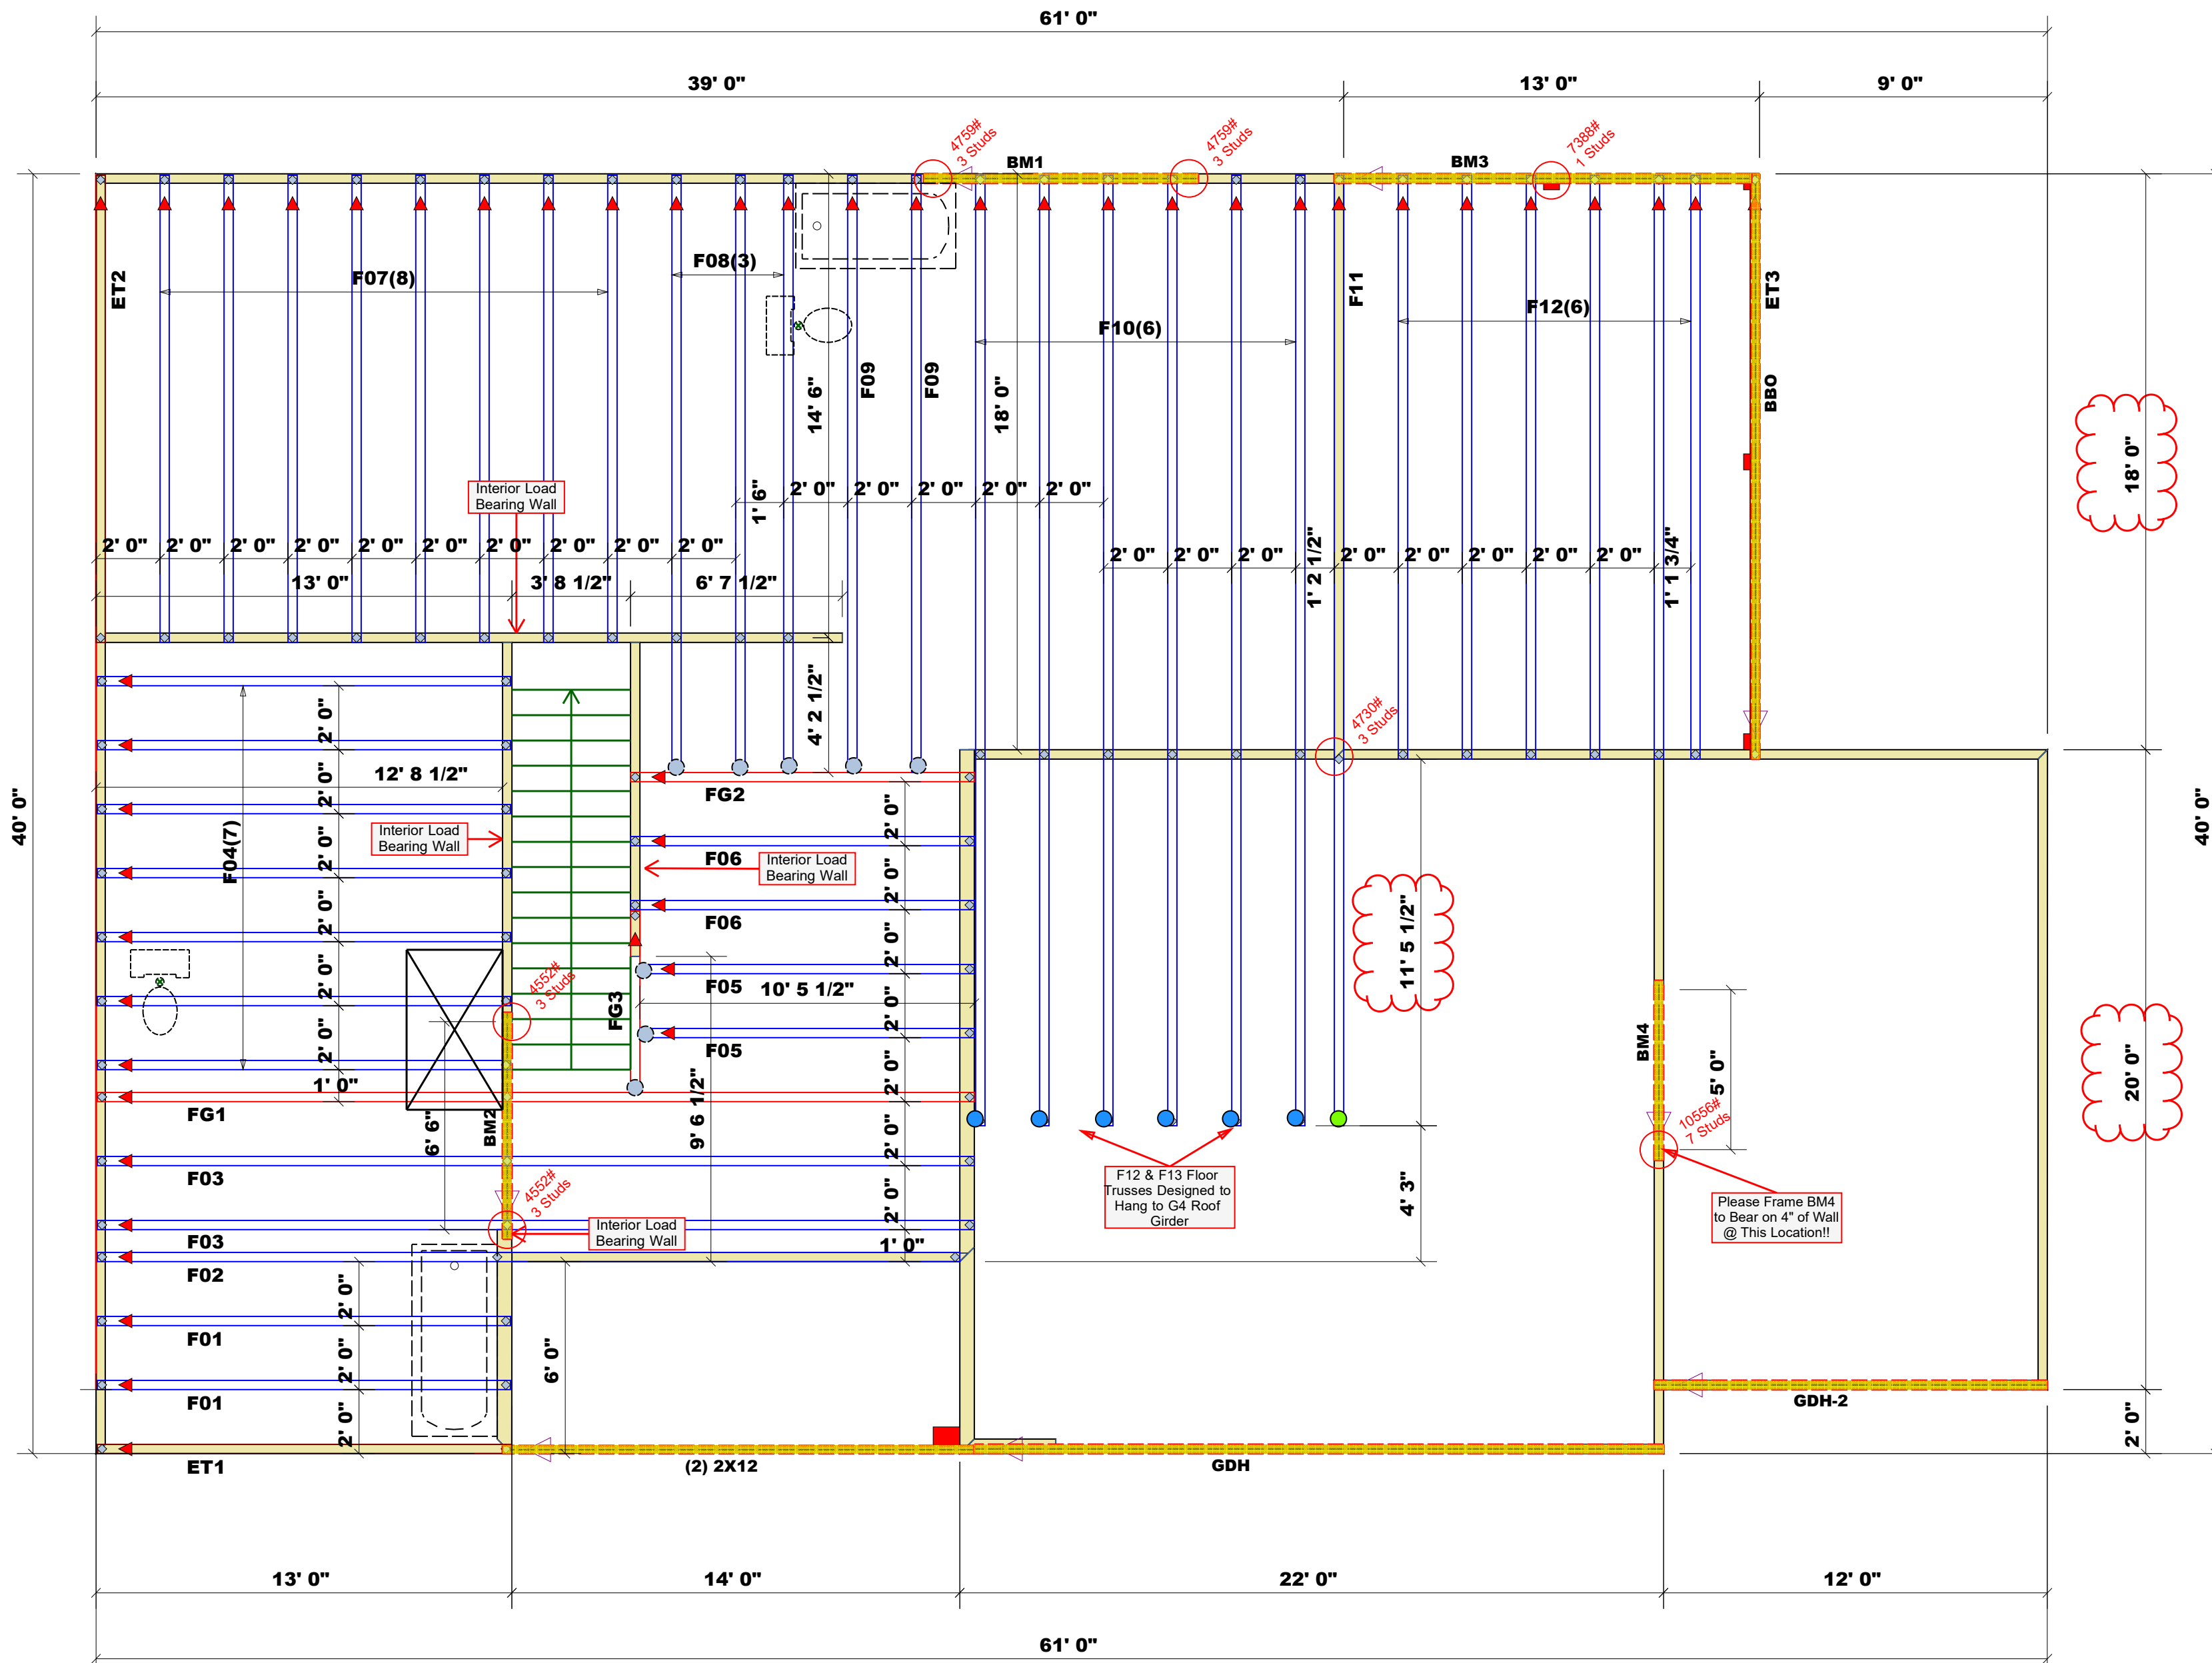

Roof Area = 3053.4 sq.ft.
Ridge Line = 109.61 ft.
Hip Line = 0 ft.
Horiz. OH = 148.42 ft.
Raked OH = 217.79 ft.
Decking = 105 sheets

Dimension Notes

- All exterior wall to wall dimensions are to face of stud unless noted otherwise
- All interior wall dimensions are to face of stud unless noted otherwise
- All exterior wall to truss dimensions are to face of stud unless noted otherwise

▲ = Indicates Left End of Truss (Reference Engineered Truss Drawing)
Do Not Erect Trusses Backwards

1 Truss Placement Plan
Scale: 1/4"=1'

Hatch Legend

- Padded HVAC
- 2nd Floor Walls @ 8' 1 1/2"
- Drop Beam

Connector Information					Nail Information	
Sym	Product	Manuf	Qty	Supported Member	Header	Truss
●	HUS410	USP	6	Varies	16d/3-1/2"	16d/3-1/2"
●	THD410	USP	1	Varies	16d/3-1/2"	10d/3"
●	MSH422	USP	8	Varies	10d/3"	10d/3"
●	HUS26	USP	13	Varies	16d/3-1/2"	16d/3-1/2"
●	JUS26	USP	6	Varies	10d/3"	10d/3"
●	THD26-2	USP	1	Varies	16d/3-1/2"	10d/3"

All Truss Reactions are Less than 3,000 lbs. Unless Noted Otherwise.

○ -- Denotes Reaction Greater than 3,000 lbs. Reaction / # of Studs

Products

PlotID	Length	Product	Plies	Net Qty	Fab Type
BM3	14' 0"	1-3/4"x 9-1/4" LVL Kerto-S	2	2	FF
BM1	9' 0"	1-3/4"x 9-1/4" LVL Kerto-S	2	2	FF
BM2	8' 0"	1-3/4"x 9-1/4" LVL Kerto-S	2	2	FF
BM4	6' 0"	1-3/4"x 9-1/4" LVL Kerto-S	2	2	FF
GDH	22' 0"	1-3/4"x 11-7/8" LVL Kerto-S	2	2	FF
GDH-2	13' 0"	1-3/4"x 11-7/8" LVL Kerto-S	2	2	FF

All Walls Shown Are Considered Load Bearing

Plumbing Drop Notes

- Plumbing drop locations shown are NOT exact.
- Contractor to verify ALL plumbing drop locations prior to setting Floor Trusses.
- Adjust spacing as needed not to exceed 24"oc.



ROOF & FLOOR TRUSSES & BEAMS

Reilly Road Industrial Park
Fayetteville, N.C. 28309
Phone: (910) 864-8787
Fax: (910) 864-4444


Bearing reactions less than or equal to 3000# are deemed to comply with the prescriptive Code requirements. The contractor shall refer to the attached Tables (derived from the prescriptive Code requirements) to determine the minimum foundation size and number of wood studs required to support reactions greater than 3000# but not greater than 15000#. A registered design professional shall be retained to design the support system for any reaction that exceeds those specified in the attached Tables. A registered design professional shall be retained to design the support system for all reactions that exceed 15000#.

Signature _____
Neil Baggett

LOAD CHART FOR JACK STUDS

(BASED ON TABLES R502.5(1) & (b))
NUMBER OF JACK STUDS REQUIRED @ EA END OF HEADER/GIRDER

END REACTION (UP TO)	REQ'D STUDS FOR (1)PLY HEADER	END REACTION (UP TO)	REQ'D STUDS FOR (2)PLY HEADER	END REACTION (UP TO)	REQ'D STUDS FOR (4)PLY HEADER
1700	1	2550	1	3400	1
3400	2	5100	2	6800	2
5100	3	7650	3	10200	3
6800	4	10200	4	13600	4
8500	5	12750	5	17000	5
10200	6	15300	6		
11900	7				
13600	8				
15300	9				

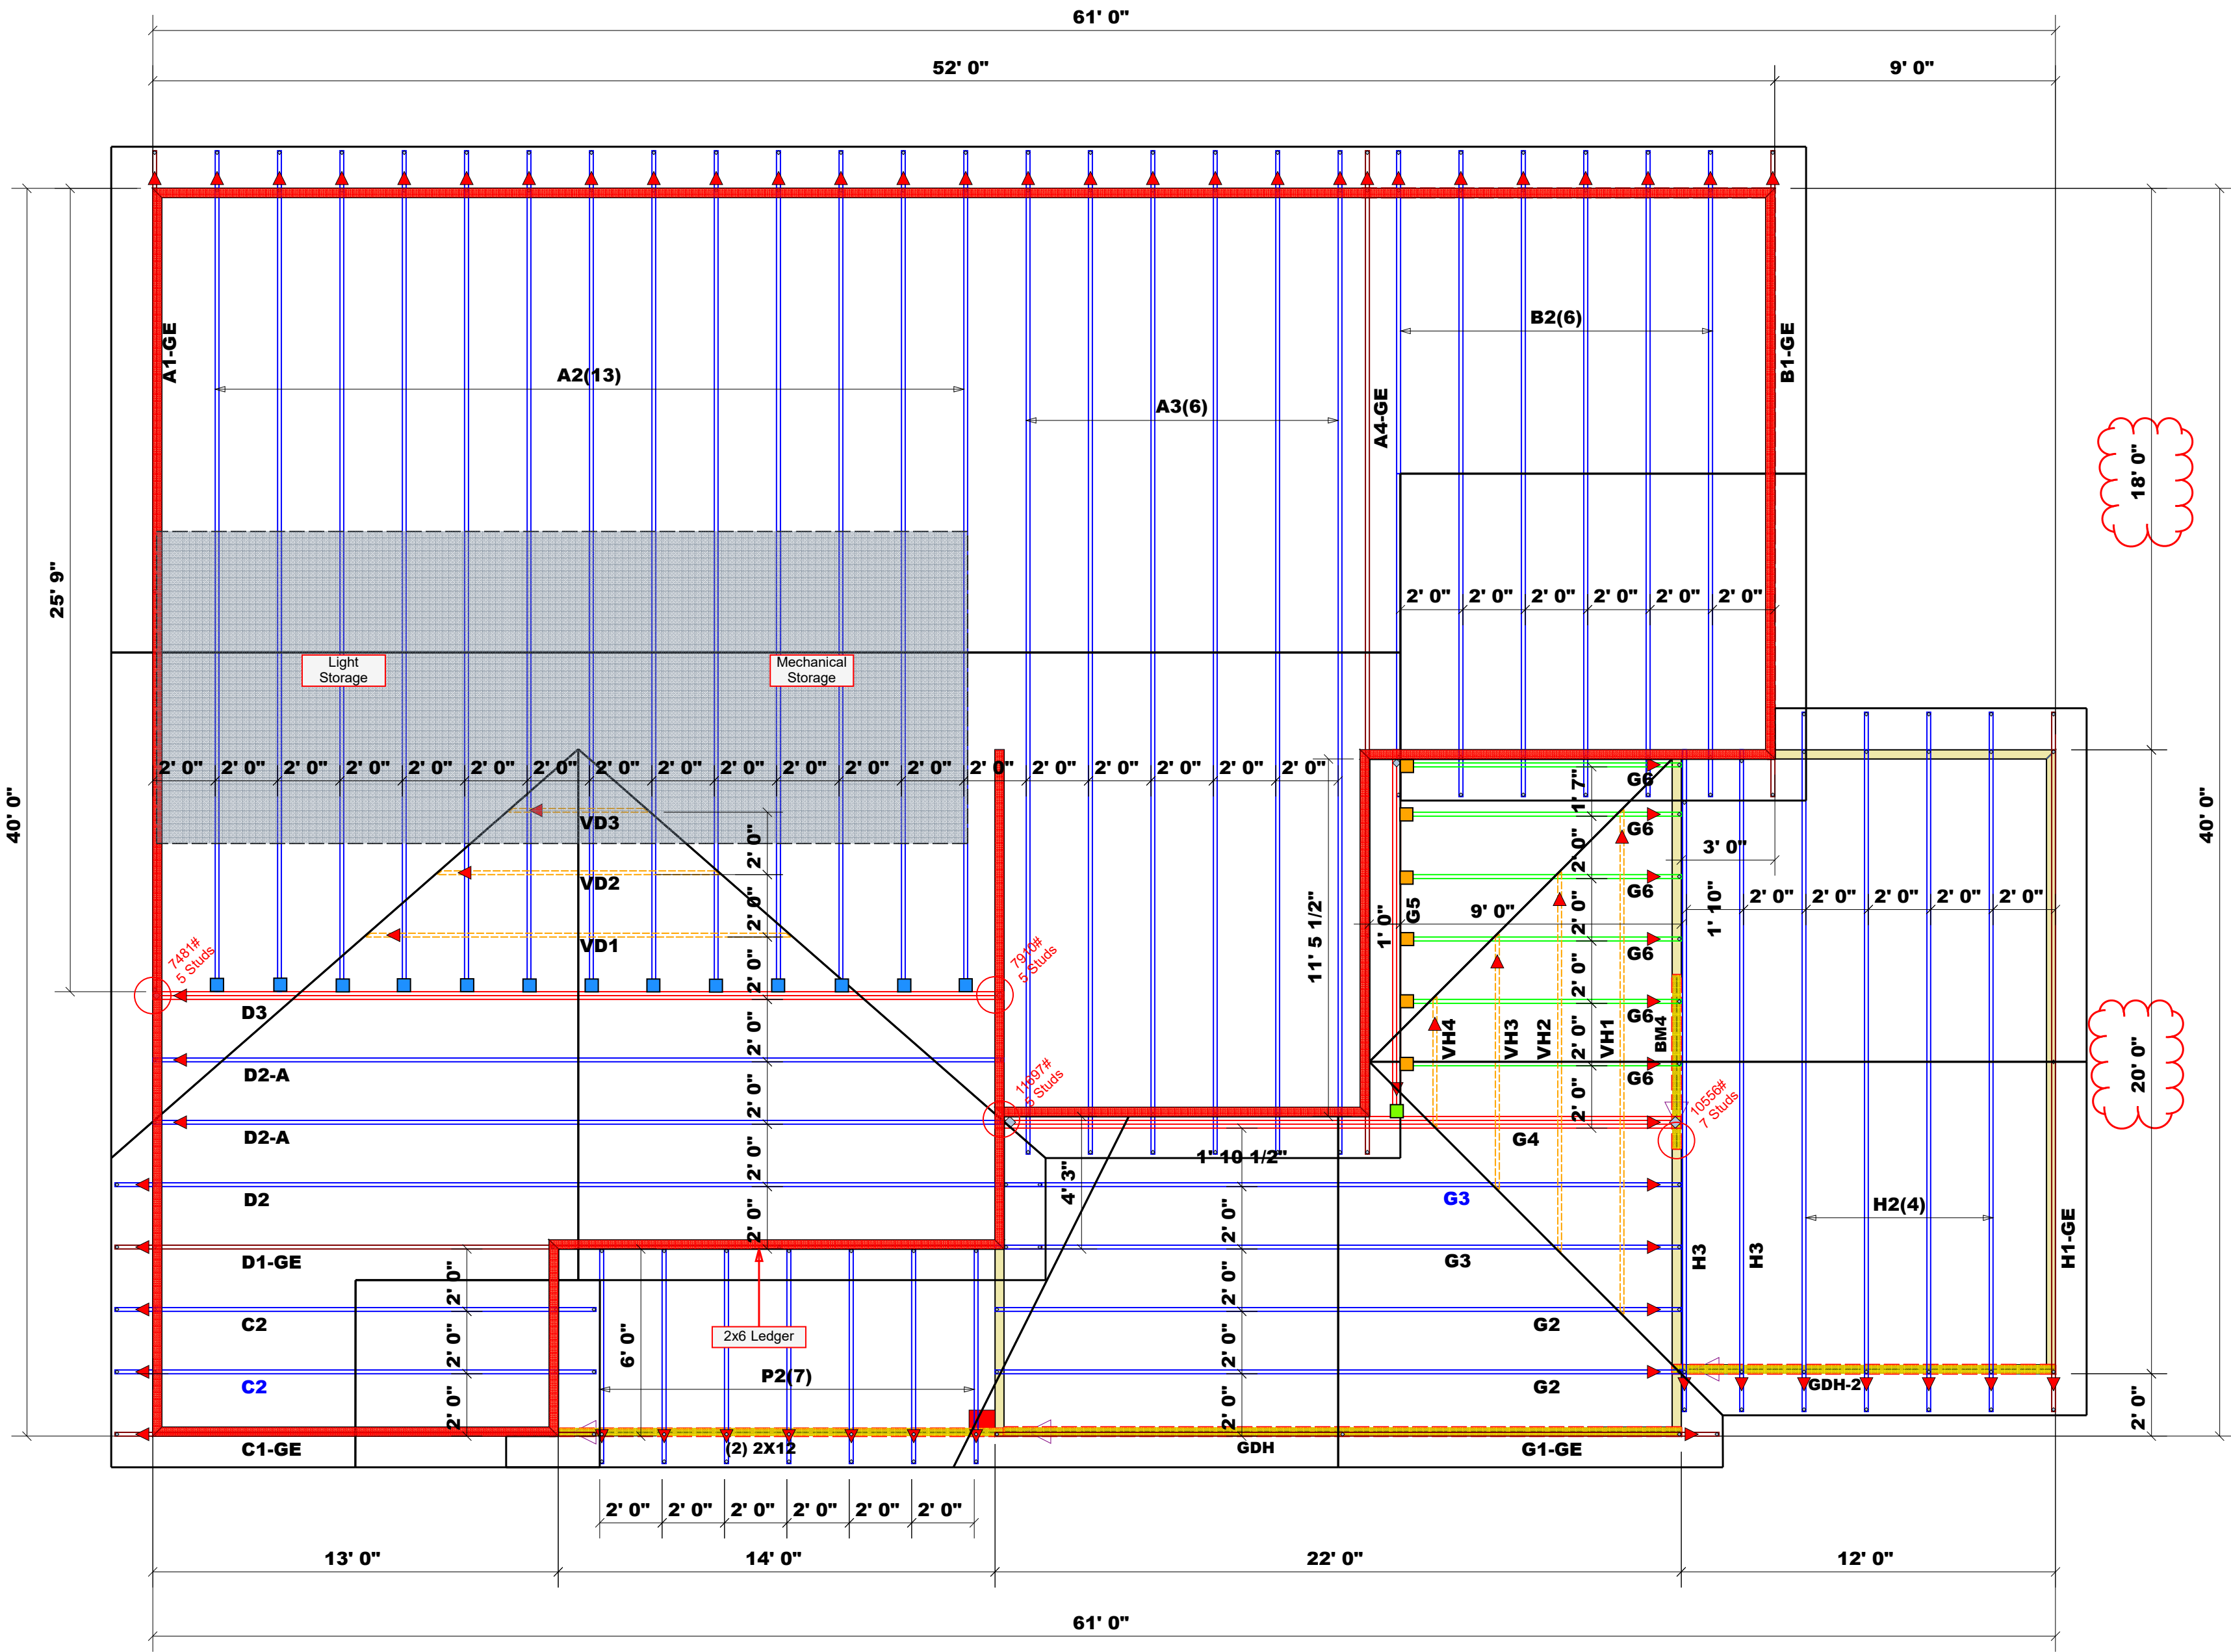

Roof Area = 3086.2 sq.ft.
Ridge Line = 111.61 ft.
Hip Line = 0 ft.
Horiz. OH = 152.42 ft.
Raked OH = 217.79 ft.
Decking = 106 sheets

Dimension Notes

- All exterior wall to wall dimensions are to face of stud unless noted otherwise
- All interior wall dimensions are to face of stud unless noted otherwise
- All exterior wall to truss dimensions are to face of stud unless noted otherwise

▲ = Indicates Left End of Truss (Reference Engineered Truss Drawing)
Do Not Erect Trusses Backwards

① Truss Placement Plan
Scale: 1/4"=1'

Hatch Legend

- Padded HVAC
- 2nd Floor Walls @ 8' 1 1/2"
- Drop Beam

Plumbing Drop Notes

- Plumbing drop locations shown are NOT exact.
- Contractor to verify ALL plumbing drop locations prior to setting Floor Trusses.
- Adjust spacing as needed not to exceed 24"oc.

All Walls Shown Are Considered Load Bearing

Connector Information				Nail Information	
Sym	Product	Manuf	Qty	Supported Member	Header / Truss
●	HUS410	USP	6	Varies	16d/3-1/2" / 16d/3-1/2"
●	THD410	USP	1	Varies	16d/3-1/2" / 10d/3"
●	MSH422	USP	8	Varies	10d/3" / 10d/3"
●	HUS26	USP	13	Varies	16d/3-1/2" / 16d/3-1/2"
●	JUS26	USP	6	Varies	10d/3" / 10d/3"
●	THD26-2	USP	1	Varies	16d/3-1/2" / 10d/3"

All Truss Reactions are Less than 3,000 lbs. Unless Noted Otherwise.

○ -- Denotes Reaction Greater than 3,000 lbs. Reaction / # of Studs

Products					
PlotID	Length	Product	Plies	Net Qty	Fab Type
BM3	14' 0"	1-3/4"x 9-1/4" LVL Kerto-S	2	2	FF
BM2	8' 0"	1-3/4"x 9-1/4" LVL Kerto-S	2	2	FF
BM4	6' 0"	1-3/4"x 9-1/4" LVL Kerto-S	2	2	FF
GDH	22' 0"	1-3/4"x 11-7/8" LVL Kerto-S	2	2	FF
GDH-2	13' 0"	1-3/4"x 11-7/8" LVL Kerto-S	2	2	FF
BM1	9' 0"	1-3/4"x 11-7/8" LVL Kerto-S	2	2	FF

BUILDER	JOB NAME	PLAN	SEAL DATE	QUOTE #	JOB #
Precision Custom Homes & Renovations	Lot 16 Liberty Meadows	Taggart 3.0	6/22/2022	Quote #	J1021-6182
Harnett	Lot 16 Liberty Meadows	Roof	9/7/2022	Neil Baggett	Neil Baggett
COUNTY	ADDRESS	MODEL	DATE REV.	DRAWN BY	SALESMAN
Harnett	Lot 16 Liberty Meadows	Roof	9/7/2022	Neil Baggett	Neil Baggett

THIS IS A TRUSS PLACEMENT DIAGRAM ONLY.
These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult BCSI-B1 and BCSI-B3 provided with the truss delivery package or online @ sbcindustry.com