

NOVEMBER 2014

BUILT UP STORAGE / HVAC PLATFORM DETAIL


I9017214-1



TRUSS MUST BE DESIGNED FOR 20 PSF ATTIC STORAGE LOAD APPLIED ALONG BOTTOM CHORD, OR A SPECIFIC HVAC LOAD. REFER TO INDIVIDUAL TRUSS DESIGN DRAWING TO VERIFY.

NOTE - WEIGHT OF HVAC UNIT NOT TO EXCEED 200 LBS SUPPORTED OVER AT LEAST THREE (3) TRUSSES.

REFER TO INDIVIDUAL TRUSS DESIGN DRAWING FOR PLATE SIZES, LUMBER GRADES AND LOADS. TRUSS CONFIGURATION IS SHOWN FOR ILLUSTRATION PURPOSES ONLY. ACTUAL TRUSS MAY VARY.

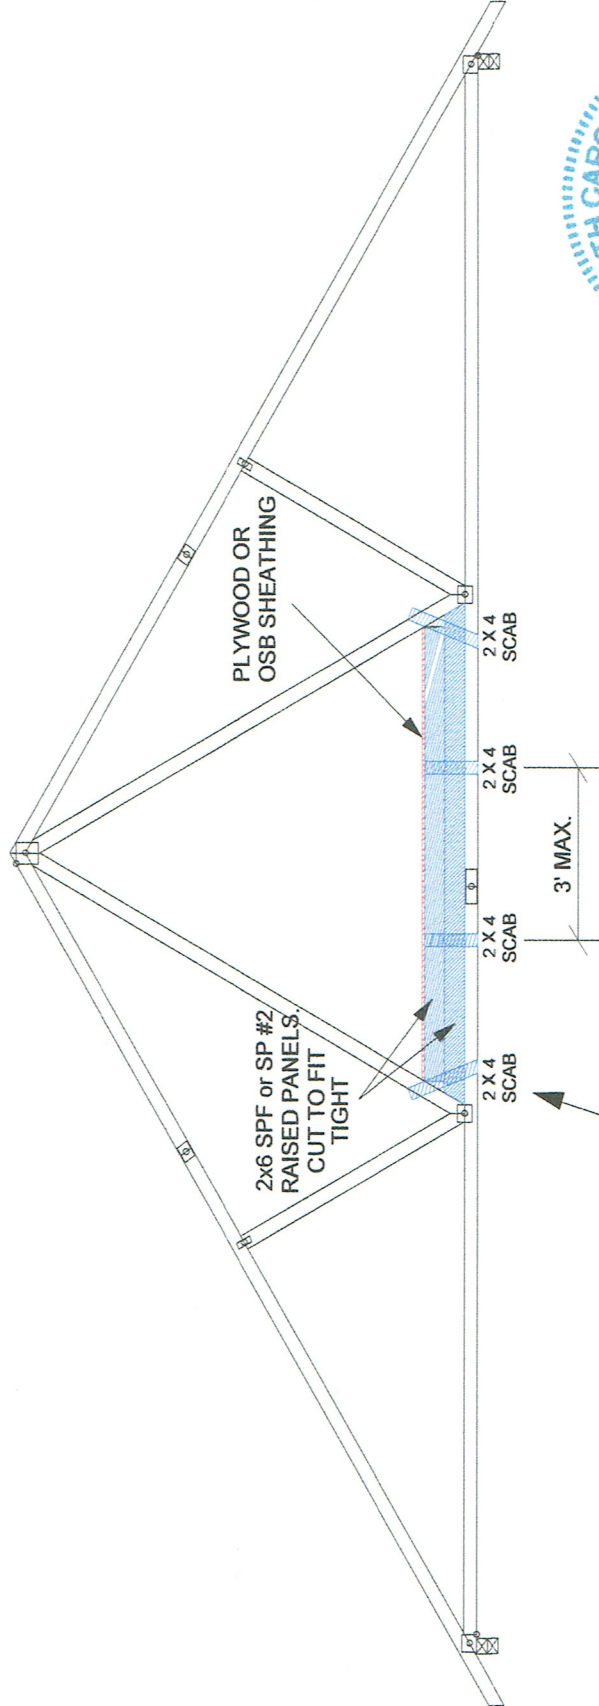

APPLY 2x4 SP or SPF No.2 SCABS TO EACH SIDE OF TRUSS. ATTACH EACH SCAB WITH A MINIMUM OF (3) - 10d (3" X 0.131") NAILS INTO EACH MEMBER.



COL.# P-1038
November 20, 2014

NOTE - THIS DETAIL ASSUMES:
1) BOTTOM EDGE OF BOTTOM CHORD IS RESTRAINED AND BRACED WITH A RIGID CEILING.
2) TRUSS IS SINGLE PLY AND SPACED NO MORE THAN 24" OC.