

# PLANS DESIGNED TO THE 2018 NORTH CAROLINA STATE RESIDENTIAL BUILDING CODE

MEAN ROOF HEIGHT: 18'-10"  
HEIGHT TO RIDGE: 25'-6"

CLIMATE ZONE	ZONE 3A	ZONE 4A	ZONE 5A
FENESTRATION U-FACTOR	0.35	0.35	0.35
SKYLIGHT U-FACTOR	0.55	0.55	0.55
GLAZED FENESTRATION SHGC	0.30	0.30	0.30
CEILING R-VALUE	38 or 30ci	38 or 30ci	38 or 30ci
FLOOR R-VALUE	19	19	19
BASEMENT WALL R-VALUE	5/13	5/13	5/13
CLAB R-VALUE	0	0	0
CRAWL SPACE WALL R-VALUE	5/13	5/13	5/13

\* 10/13 MEANS R-10 SHEATHING INSULATION OR R-13 CAVITY INSULATION  
 \*\* CLAB R-VALUE  
 \*\*\* MEANS R-10 SHEATHING INSULATION OR R-13 CAVITY INSULATION  
 \*\* INSULATION DEPTH WITH MONOLITHIC SLAB 24" OR FROM INSPECTION GAP TO BOTTOM OF FOOTING WITH INSULATION DEPTH WITH SLAB 24" OR TO BOTTOM OF FOUNDATION WALL  
 DESIGNED FOR WIND SPEED OF 120 MPH, 3 SECOND GUST FOR 93 FASTEST WIND EXPOSURE "B"

## ROOF VENTILATION

### SECTION R806.1 Ventilation required. Enclosed attics and enclosed rafter spaces

shall have cross ventilation for each separate space by ventilating openings protected against the entrance of rain or snow. Ventilation openings shall have a least dimension of 1/16 inch (1.6 mm) minimum and 1/4 inch (6.4 mm) maximum. Ventilation openings having a larger than 1/4 inch (6.4 mm) shall be provided with corrosion-resistant wire cloth screening, hardware cloth, or similar material with openings having a least dimension of 1/16 inch (1.6 mm) minimum and 1/4 inch (6.4 mm) maximum. Openings in roof framing members shall conform to the requirements of Section R802.7.

**R806.2 Minimum area.** The total net free ventilating area shall not be less than 1/150 of the area of the space ventilated except that ventilation of the total area to 1/300 is permitted provided that at least 50 percent and not more than 80 percent of the required ventilating area is provided by ventilators located in the upper portion of the space to be ventilated at least 3 feet (914 mm) above the eave or cornice vents with the balance of the required ventilation provided by eave or cornice vents. As an alternative, the net free cross-ventilation area may be reduced to 1/300 when a Class I or II vapor retarder is installed on the warm-in-winter side of the ceiling.

**Exceptions:**  
1. Enclosed attic/rafter spaces requiring less than 1 square foot (0.0929 m2) of ventilation may be vented with continuous soffit ventilation only.  
2. Enclosed attic/rafter spaces over unconditioned space may be vented with continuous soffit vent only.

SQUARE FOOTAGE OF ROOF TO BE VENTED = 2,253 SQ.FT.

NET FREE CROSS VENTILATION NEEDED:

WITHOUT 50% TO 80% OF VENTING 3'-0" ABOVE EAVE = 15.02 SQ.FT.

WITH 50% TO 80% OF VENTING 3'-0" ABOVE EAVE, OR WITH CLASS I OR II VAPOR RETARDER ON WARM-IN-WINTER SIDE OF CEILING = 7.51 SQ.FT.

## GUARD RAIL NOTES

### SECTION R312

**R312.1 Where required.** Guards shall be located along open-sided walking surfaces, including stairs, ramps and landings, that are located more than 30 inches (762 mm) measured vertically to the floor or grade below at any point within 36 inches (914 mm) horizontally to the edge of the open side. Insect screening shall not be considered as a guard.

**R312.2 Height.** Required guards at open-sided walking surfaces, including stairs, porches, balconies or landings, shall be not less than 36 inches (914 mm) high measured vertically above the adjacent walking surface, adjacent fixed seating or the line connecting the leading edges of the treads.

**Exceptions:**  
1. Guards on the open sides of stairs shall have a height not less than 34 inches (864 mm) measured vertically from a line connecting the leading edges of the treads.  
2. Where the top of the guard also serves as a handrail on the open sides of stairs, the top of the guard shall not be less than 34 inches (864 mm) and not more than 38 inches (965 mm) measured vertically from a line connecting the leading edges of the treads.

**R312.3 Opening limitations.** Required guards shall not have openings from the walking surface to the required guard height which allow passage of a sphere 4 inches (102 mm) in diameter.

**Exceptions:**  
1. The triangular openings at the open side of a stair, formed by the riser, tread and bottom rail of a guard, shall not allow passage of a sphere 6 inches (153 mm) in diameter.  
2. Guards on the open sides of stairs shall not have openings which allow passage of a sphere 43/8 inches (111 mm) in diameter.

## AIR LEAKAGE


### Section N1102.4

**N1102.4.1 Building thermal envelope.** The building thermal envelope shall be durably sealed with an air barrier system to limit infiltration. The sealing methods between dissimilar materials shall allow for differential expansion and contraction. For all homes, where present, the following shall be caulked, gasketed, weatherstripped or otherwise sealed with an air barrier material or solid material consistent with Appendix E-2.4 of this code:

1. Blocking and sealing floor/ceiling systems and under knee walls open to unconditioned or exterior space.  
2. Capping and sealing shafts or chases, including flue shafts.  
3. Capping and sealing soffit or dropped ceiling areas.

## REAR ELEVATION


SCALE 1/4" = 1'-0"

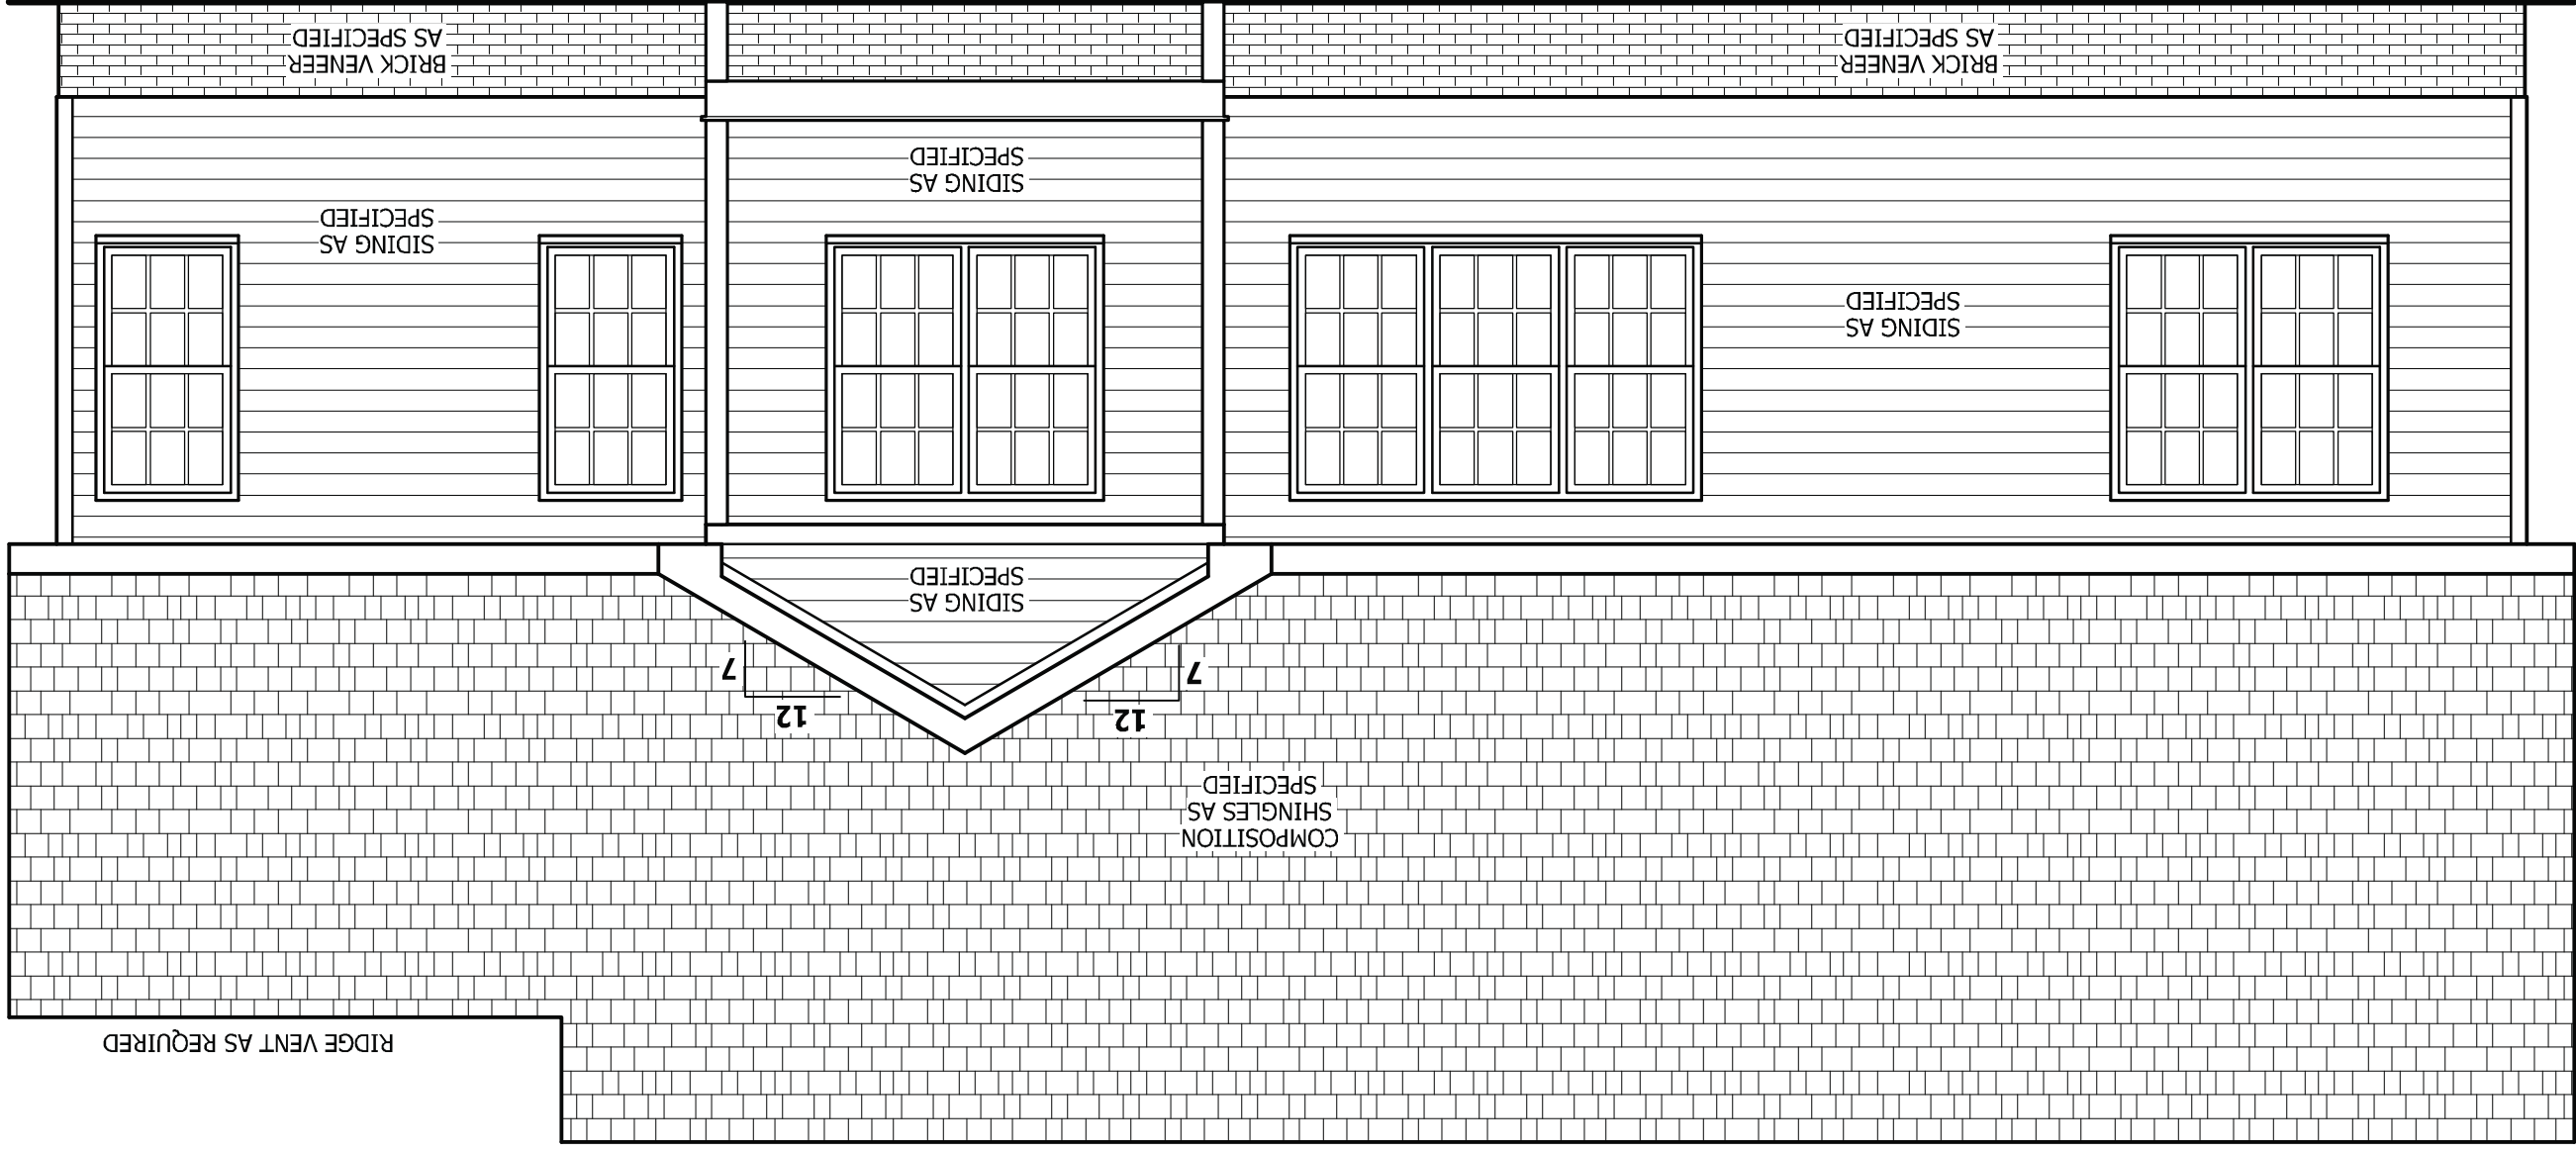

TOP OF PLATE  
WINDOW HEIGHT  
7'-6"  
9'-1 1/2"  
FIRST FLOOR PLATE HEIGHT  
SUB FLOOR

## FRONT ELEVATION

SCALE 1/4" = 1'-0"

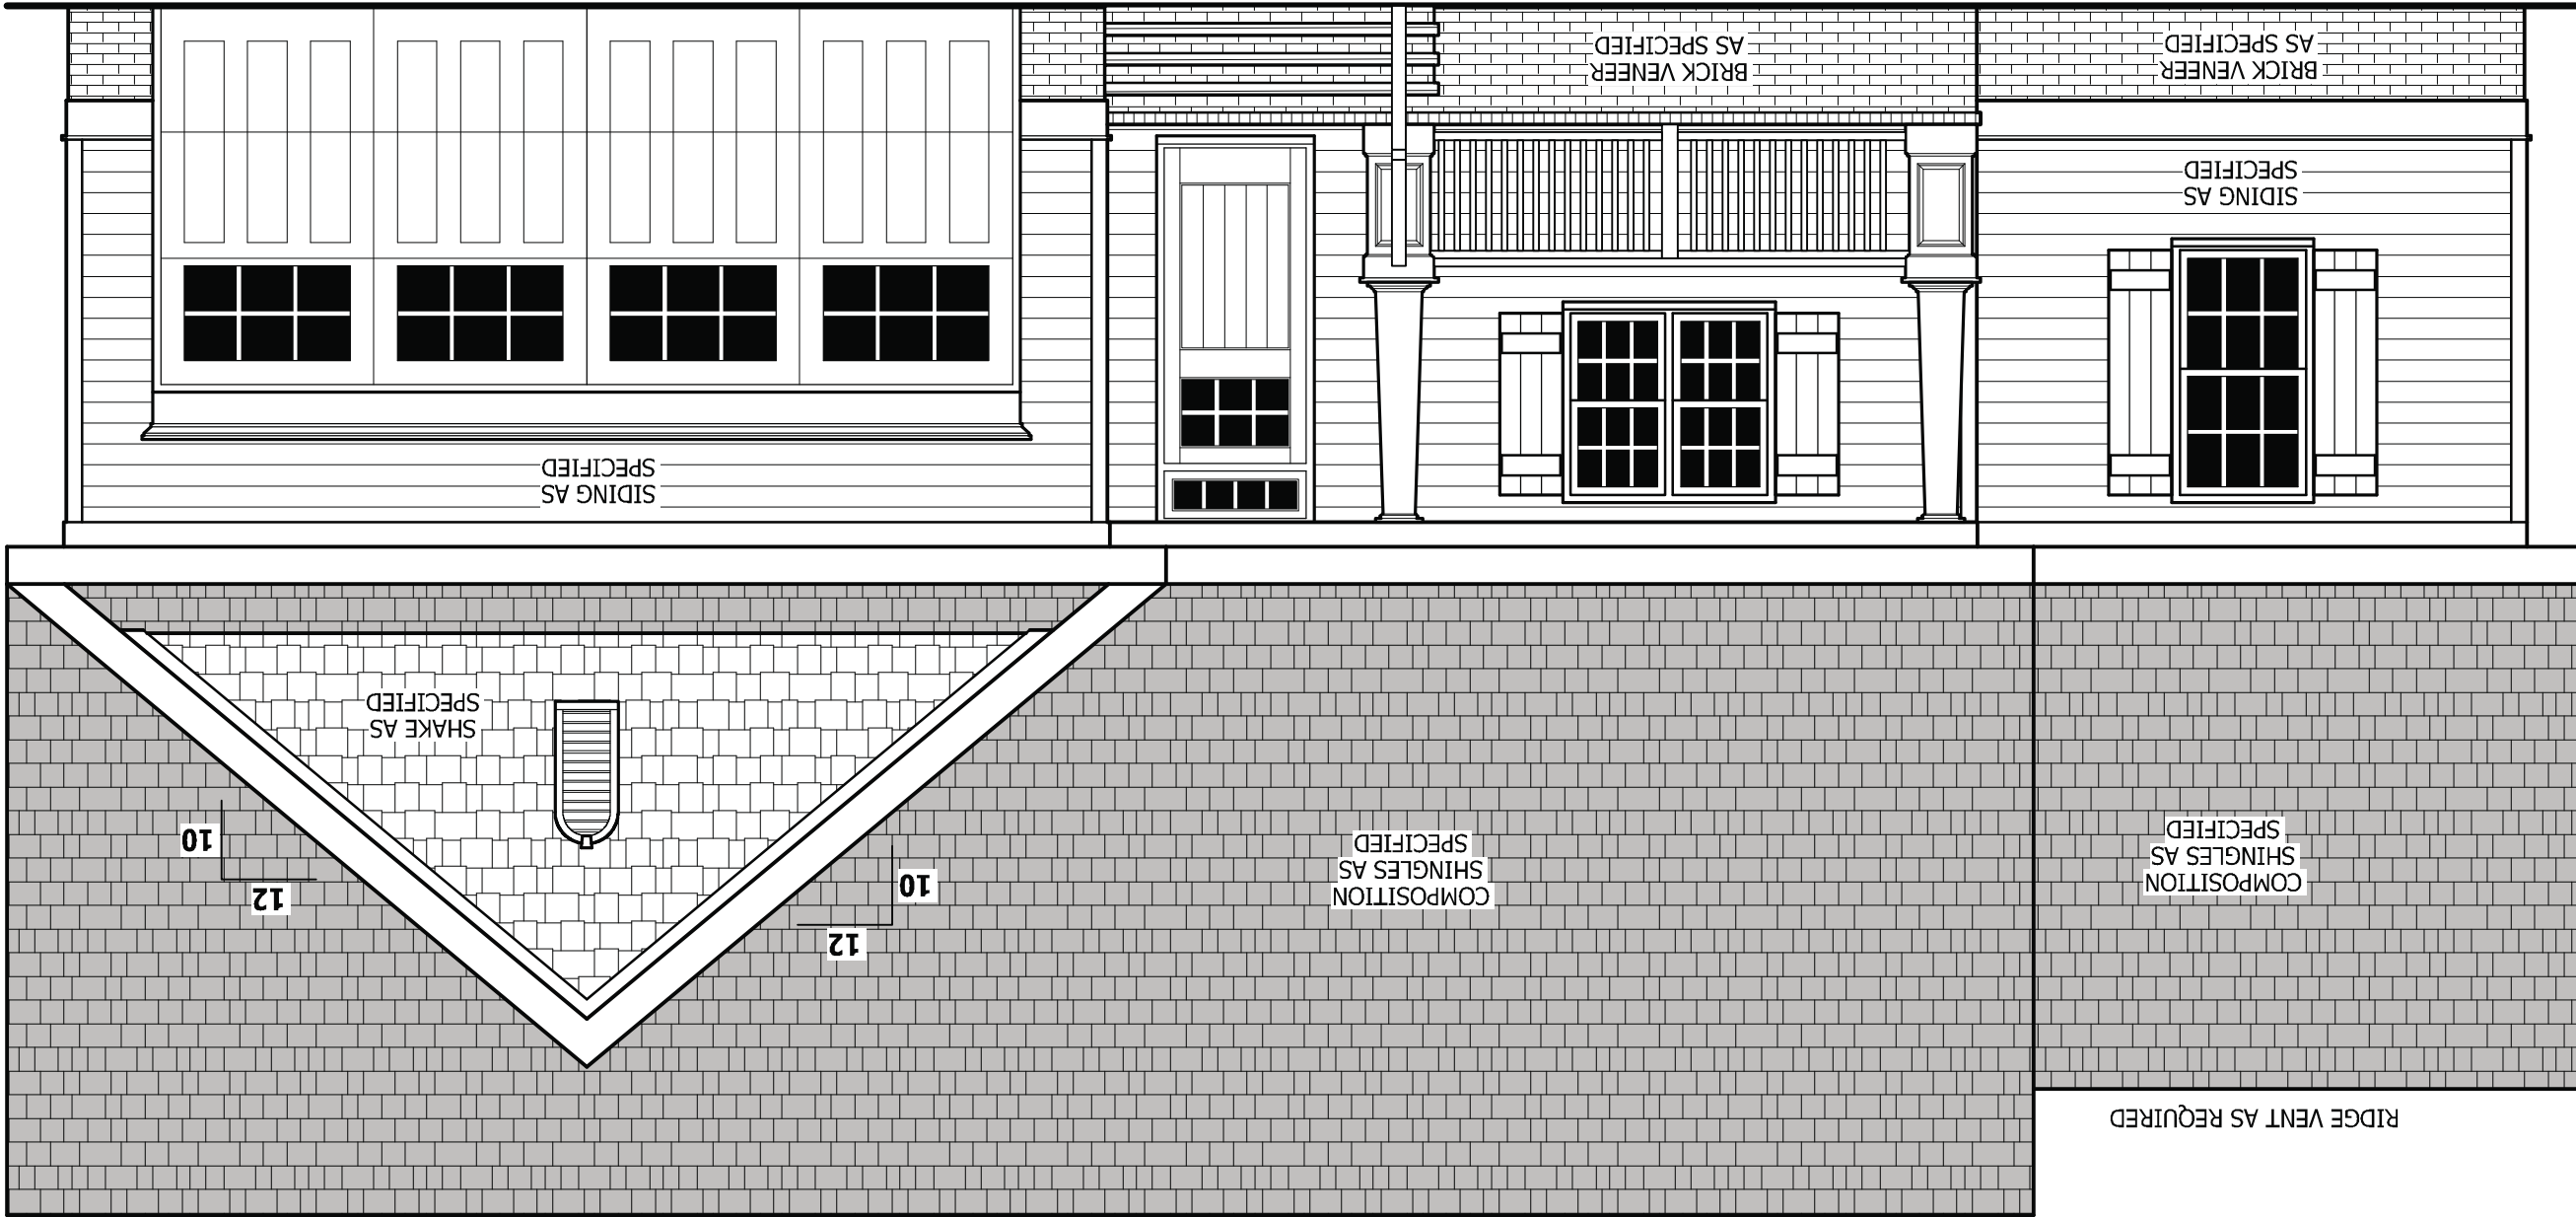

TOP OF PLATE  
WINDOW HEIGHT  
7'-6"  
9'-1 1/2"  
FIRST FLOOR PLATE HEIGHT  
SUB FLOOR



PAGE 1 OF 9  
200111B  
1/22/2020  
Haynes Home Plans, Inc.  
© Copyright 2014

HEATED	
FIRST FLOOR	1608 SQ.FT.
TOTAL	1608 SQ.FT.
UNHEATED	
REAR PORCH	51 SQ.FT.
GARAGE	484 SQ.FT.
FRONT PORCH	110 SQ.FT.
TOTAL	645 SQ.FT.

# HAYNES

HOME PLANS, INC.  
P.O. Box 102, White Forest, NC 27888 919-435-6180 Fax: 1-866-491-0096

On Top Building Company, LLC  
2393 Twin Acres Road  
Clayton, NC


## FRONT & REAR ELEVATIONS

# Amherst

PURCHASER MUST VERIFY ALL DIMENSIONS AND CONDITIONS BEFORE CONSTRUCTION BEGINS. HAYNES HOME PLANS, INC. ASSUMES NO LIABILITY FOR CONTRACTORS PRACTICES AND PROCEDURES. CODES AND CONDITIONS MAY VARY WITH LOCAL, A LOCAL DESIGNER, ARCHITECT OR ENGINEER SHOULD BE CONSULTED BEFORE CONSTRUCTION. THESE DRAWINGS ARE INTENTED FOR SERVICE AND AS SUCH SHALL REMAIN PROPERTY OF THE DESIGNER.


### RIGHT SIDE ELEVATION

SCALE 1/4" = 1'-0"

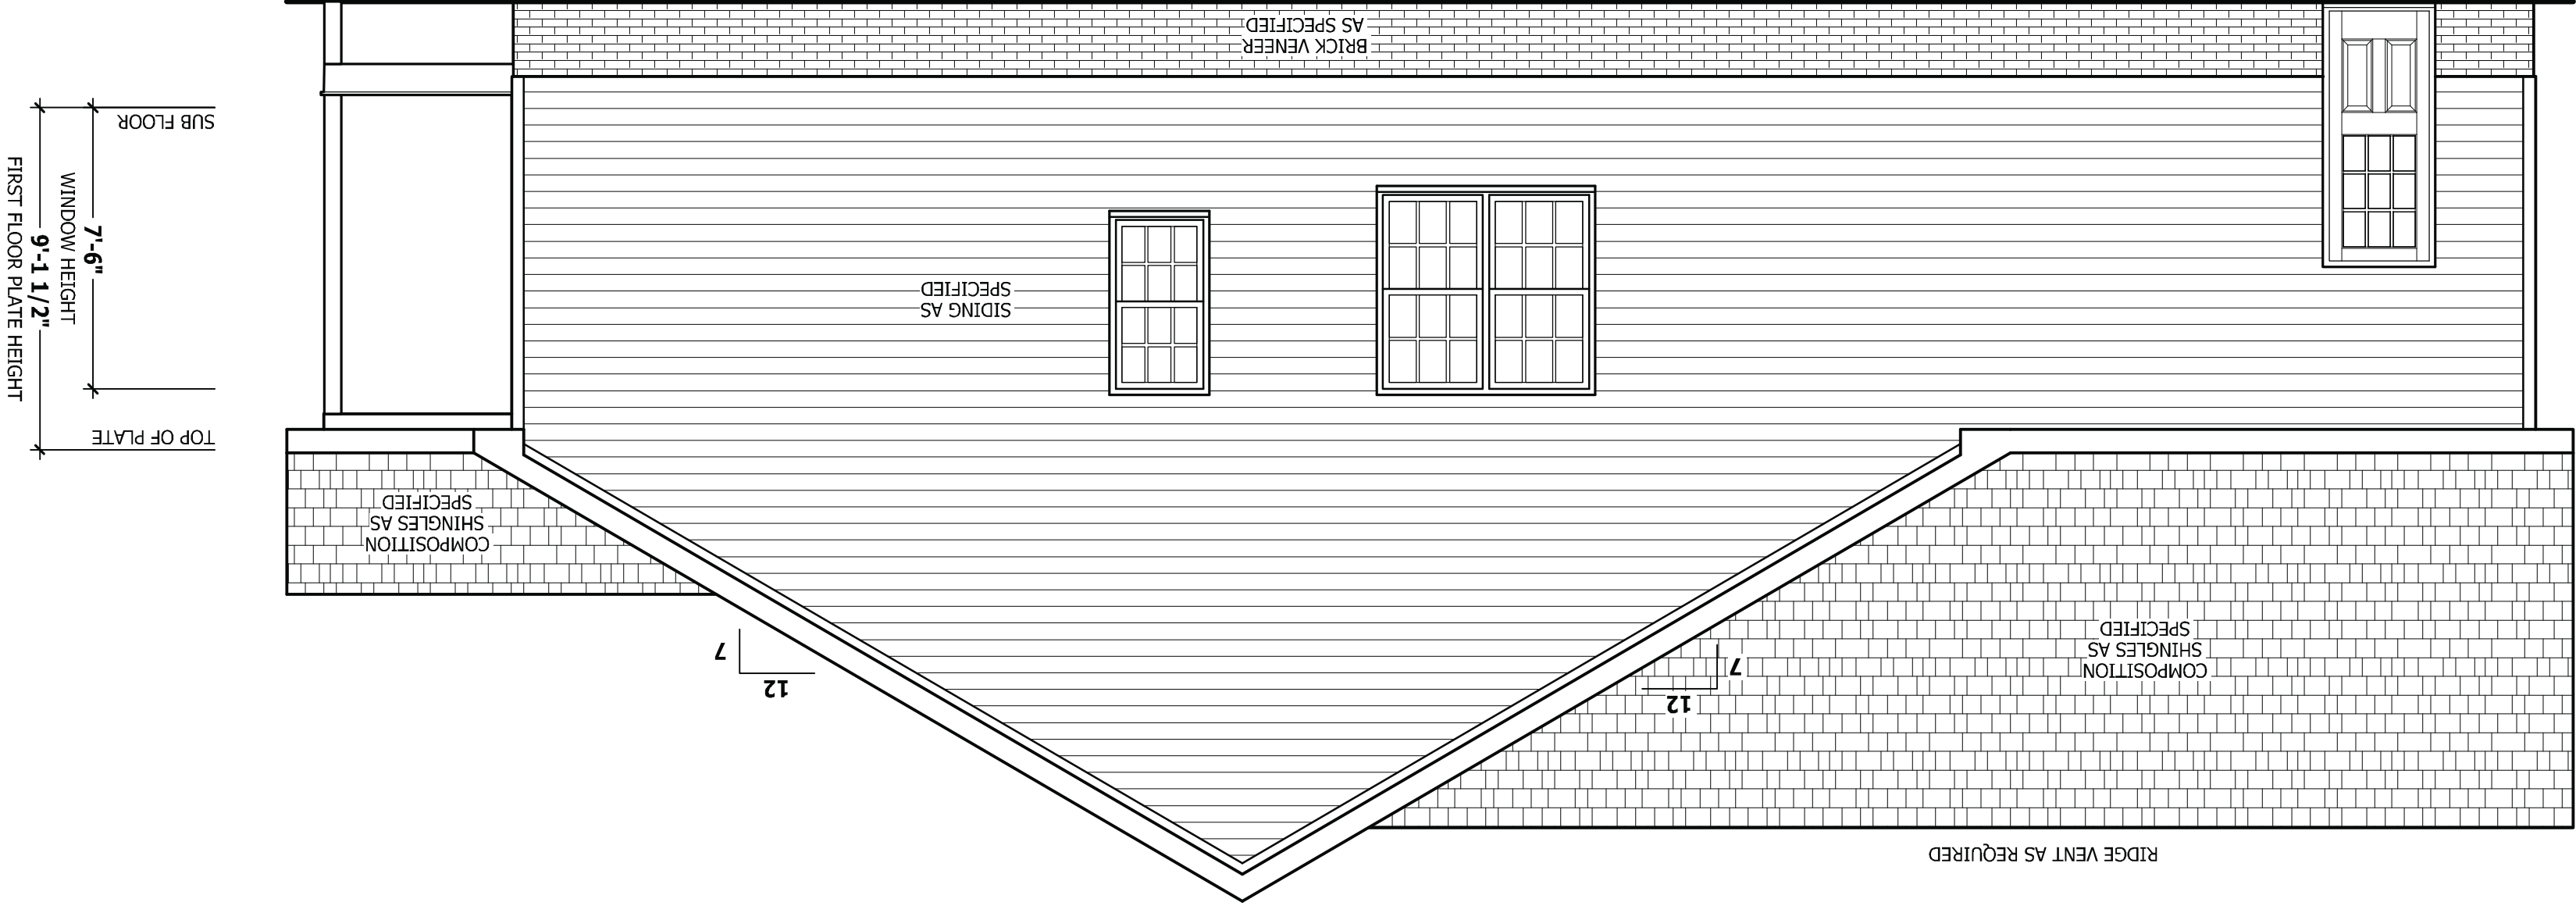

### LEFT SIDE ELEVATION

SCALE 1/4" = 1'-0"

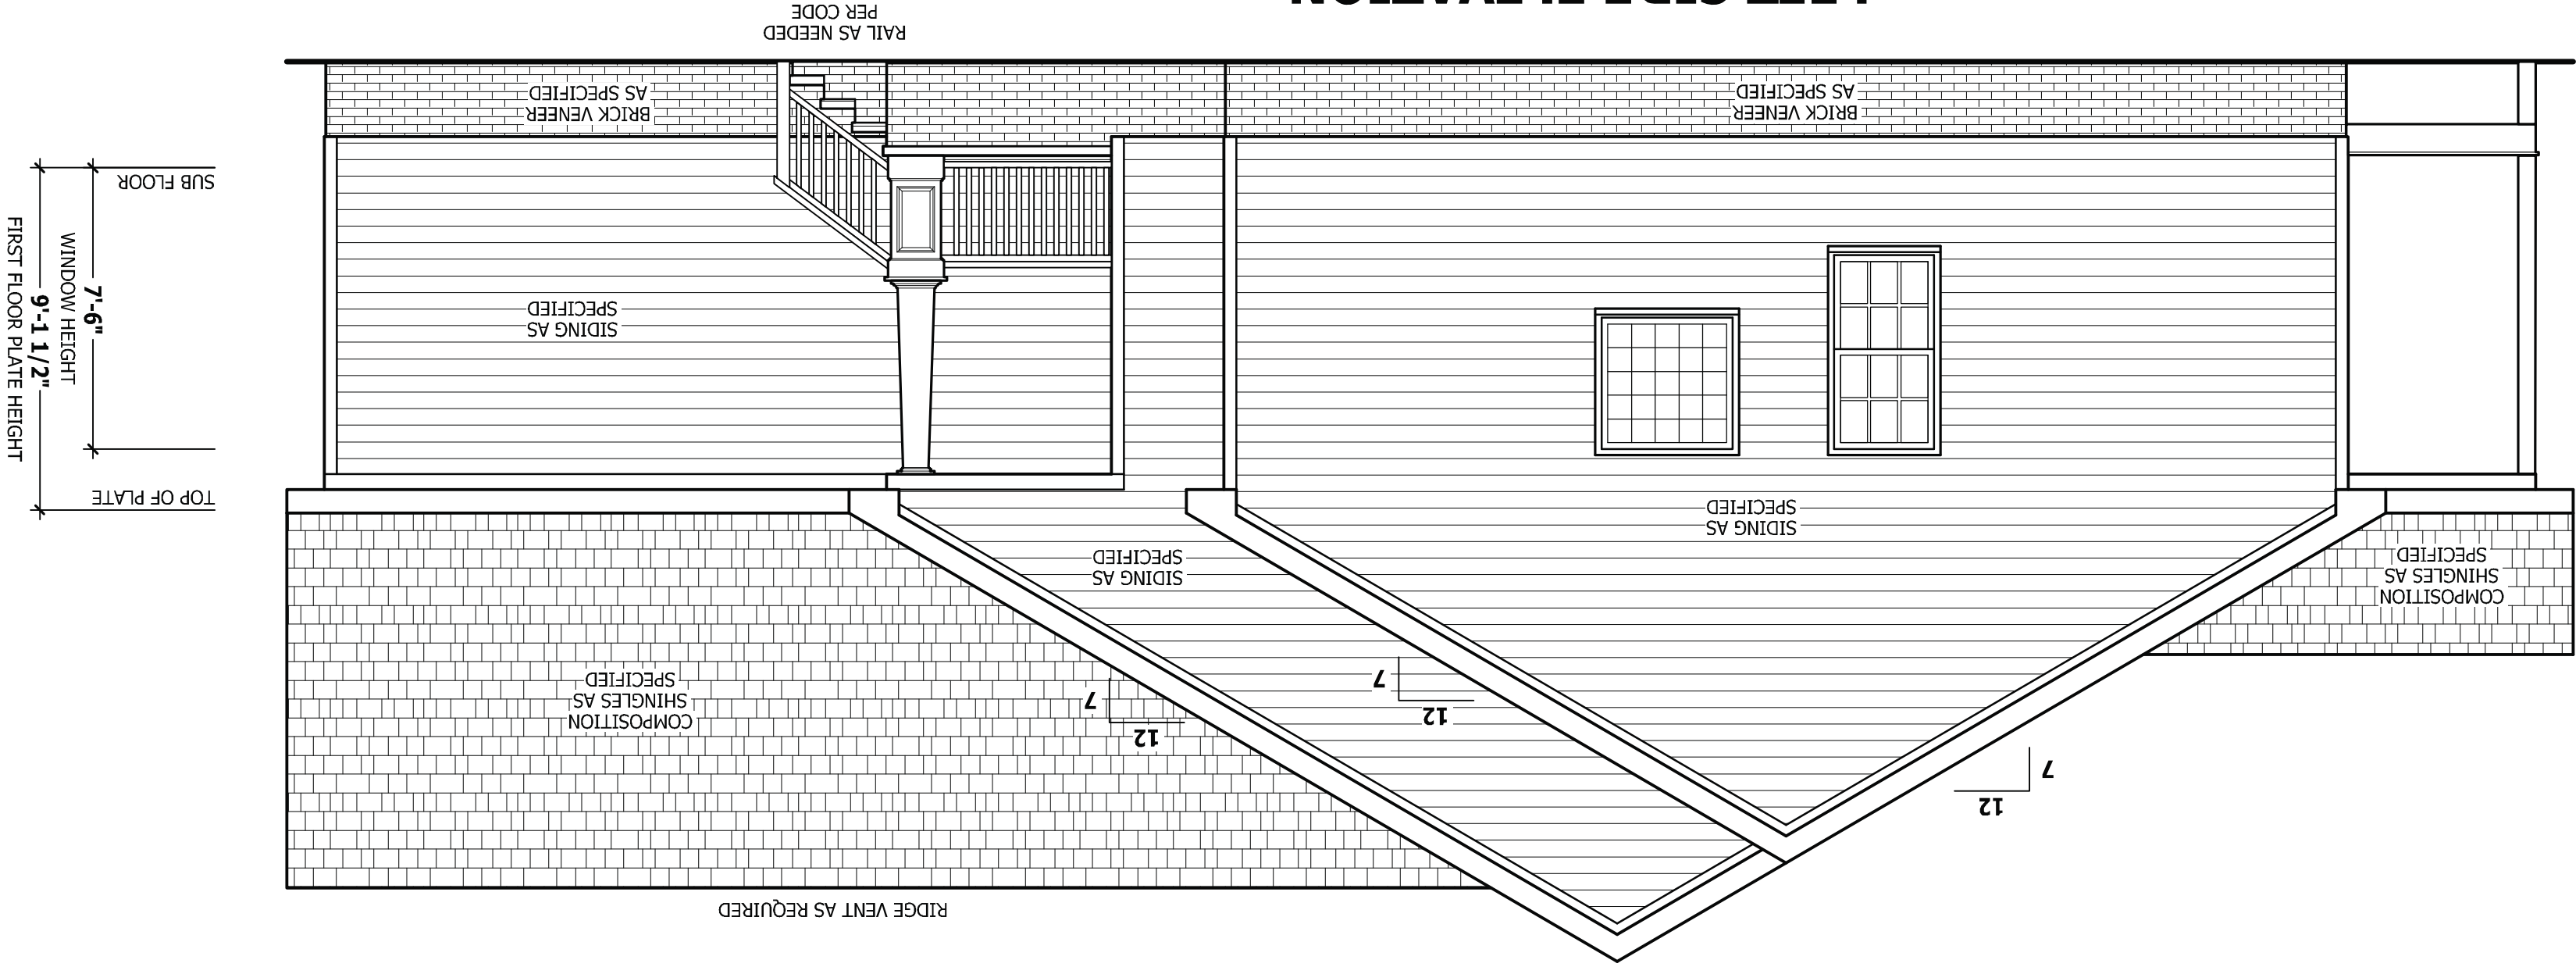

SQUARE FOOTAGE	
HEATED	1608 SQ. FT.
FIRST FLOOR	1608 SQ. FT.
UNHEATED	110 SQ. FT.
REAR PORCH	488 SQ. FT.
GARAGE	51 SQ. FT.
TOTAL	645 SQ. FT.

**HAYNES**  
HOME PLANS, INC.  
P.O. Box 702, White Forest, NC 27388 919-435-6180 Fax: 1-866-491-0096

**On Top Building Company, LLC**  
2393 Twin Acres Road  
Clayton, NC

**LEFT & RIGHT ELEVATIONS**  
**Amherst**

PURCHASER MUST VERIFY ALL DIMENSIONS AND CONDITIONS BEFORE CONSTRUCTION BEGINS. HAYNES HOME PLANS, INC. ASSUMES NO LIABILITY FOR CONTRACTORS PRACTICES AND PROCEDURES. CODES AND CONDITIONS MAY VARY WITH LOCATION. A LOCAL DESIGNER, ARCHITECT OR ENGINEER SHOULD BE CONSULTED BEFORE CONSTRUCTION. THESE DRAWINGS ARE INTENTED FOR SERVICE AND AS SUCH SHALL REMAIN PROPERTY OF THE DESIGNER.







<b>SQUARE FOOTAGE</b>	<b>HEATED</b>	1608 SQ.FT.
<b>UNHEATED</b>	<b>FIRST FLOOR</b>	1608 SQ.FT.
<b>TOTAL</b>	<b>TOTAL</b>	1608 SQ.FT.
<b>FRONT PORCH</b>		110 SQ.FT.
<b>GARAGE</b>		484 SQ.FT.
<b>REAR PORCH</b>		51 SQ.FT.
<b>TOTAL</b>		645 SQ.FT.

**1.** Concealed areas not located over the main structure including porches, areas behind knee walls, dormers, bay windows, etc.

are not required to have access.

2. Pull down stair treads, stringers, handrails, and hardware may protrude into the net clear opening.

**SECTION R807**

**R807.1 Attic access.** An attic access opening shall be provided to attic areas that exceed 400 square feet (37.16 m2) and have a vertical height of 60 inches (1524 mm) or greater. The net clear opening shall not be less than 20 inches by 30 inches (508 mm by 762 mm) and shall be located in a hallway or other readily accessible location. A 30-inch (762 mm) minimum unobstructed headroom in the attic space shall be provided at some point above the access opening. See Section M1305.1.3 for access requirements where mechanical equipment is located in attics.

**Exceptions:**

**ATTIC ACCESS**

**R807.1 Attic access.** An attic access opening shall be provided to attic areas that exceed 400 square feet (37.16 m2) and have a vertical height of 60 inches (1524 mm) or greater. The net clear opening shall not be less than 20 inches by 30 inches (508 mm by 762 mm) and shall be located in a hallway or other readily accessible location. A 30-inch (762 mm) minimum unobstructed headroom in the attic space shall be provided at some point above the access opening. See Section M1305.1.3 for access requirements where mechanical equipment is located in attics.

**DUCT PENETRATIONS.** Ducts in the garage and ducts penetrating the walls or ceilings separating the dwelling from the garage shall be constructed of a minimum No. 26 gage (0.48 mm) sheet steel or other approved material and shall have no openings into the garage.

**OTHER PENETRATIONS.** Penetrations through the separation required in Section R302.6 shall be protected as required by Section R302.11, Item 4.

**SEPARATION / GARAGE DWELLING**

**WALLS.** A minimum 1/2" gypsum board must be installed on all walls supporting floor/ceiling assemblies used for separation required by this section.

**STAIRS.** A minimum of 1/2" gypsum board must be installed on the underside and exposed sides of all stairways.

**CEILINGS.** A minimum of 1/2" gypsum must be installed on the garage ceiling if there are no habitable rooms above the garage. If there are habitable rooms above the garage a minimum of 5/8" type X gypsum board must be installed on the garage ceiling.

**OPENING PENETRATIONS.** Openings between the garage and residence shall be equipped with solid wood doors not less than 1 3/8 inches (35 mm) in thickness, solid or honeycomb core steel doors not less than 1 3/8 inches (35 mm) thick, or 20-minute fire-rated doors.

**DUCT PENETRATIONS.** Ducts in the garage and ducts penetrating the walls or ceilings separating the dwelling from the garage shall be constructed of a minimum No. 26 gage (0.48 mm) sheet steel or other approved material and shall have no openings into the garage.

**OTHER PENETRATIONS.** Penetrations through the separation required in Section R302.6 shall be protected as required by Section R302.11, Item 4.

**WALL THICKNESSES**

**Exterior walls and walls adjacent to a garage area** are drawn as 6" or as noted 2 X 6 are drawn as 6" to include 1/2" sheathing or gypsum. Subtract 1/2" for stud face.

**Interior walls** are drawn as 3 1/2" or as noted 2 X 6 are drawn as 5 1/2", and do not include gypsum.

**SEPARATION / GARAGE DWELLING**

**WALLS.** A minimum 1/2" gypsum board must be installed on all walls supporting floor/ceiling assemblies used for separation required by this section.


**STAIRS.** A minimum of 1/2" gypsum board must be installed on the underside and exposed sides of all stairways.

**CEILINGS.** A minimum of 1/2" gypsum must be installed on the garage ceiling if there are no habitable rooms above the garage. If there are habitable rooms above the garage a minimum of 5/8" type X gypsum board must be installed on the garage ceiling.

**OPENING PENETRATIONS.** Openings between the garage and residence shall be equipped with solid wood doors not less than 1 3/8 inches (35 mm) in thickness, solid or honeycomb core steel doors not less than 1 3/8 inches (35 mm) thick, or 20-minute fire-rated doors.

**DUCT PENETRATIONS.** Ducts in the garage and ducts penetrating the walls or ceilings separating the dwelling from the garage shall be constructed of a minimum No. 26 gage (0.48 mm) sheet steel or other approved material and shall have no openings into the garage.

**OTHER PENETRATIONS.** Penetrations through the separation required in Section R302.6 shall be protected as required by Section R302.11, Item 4.

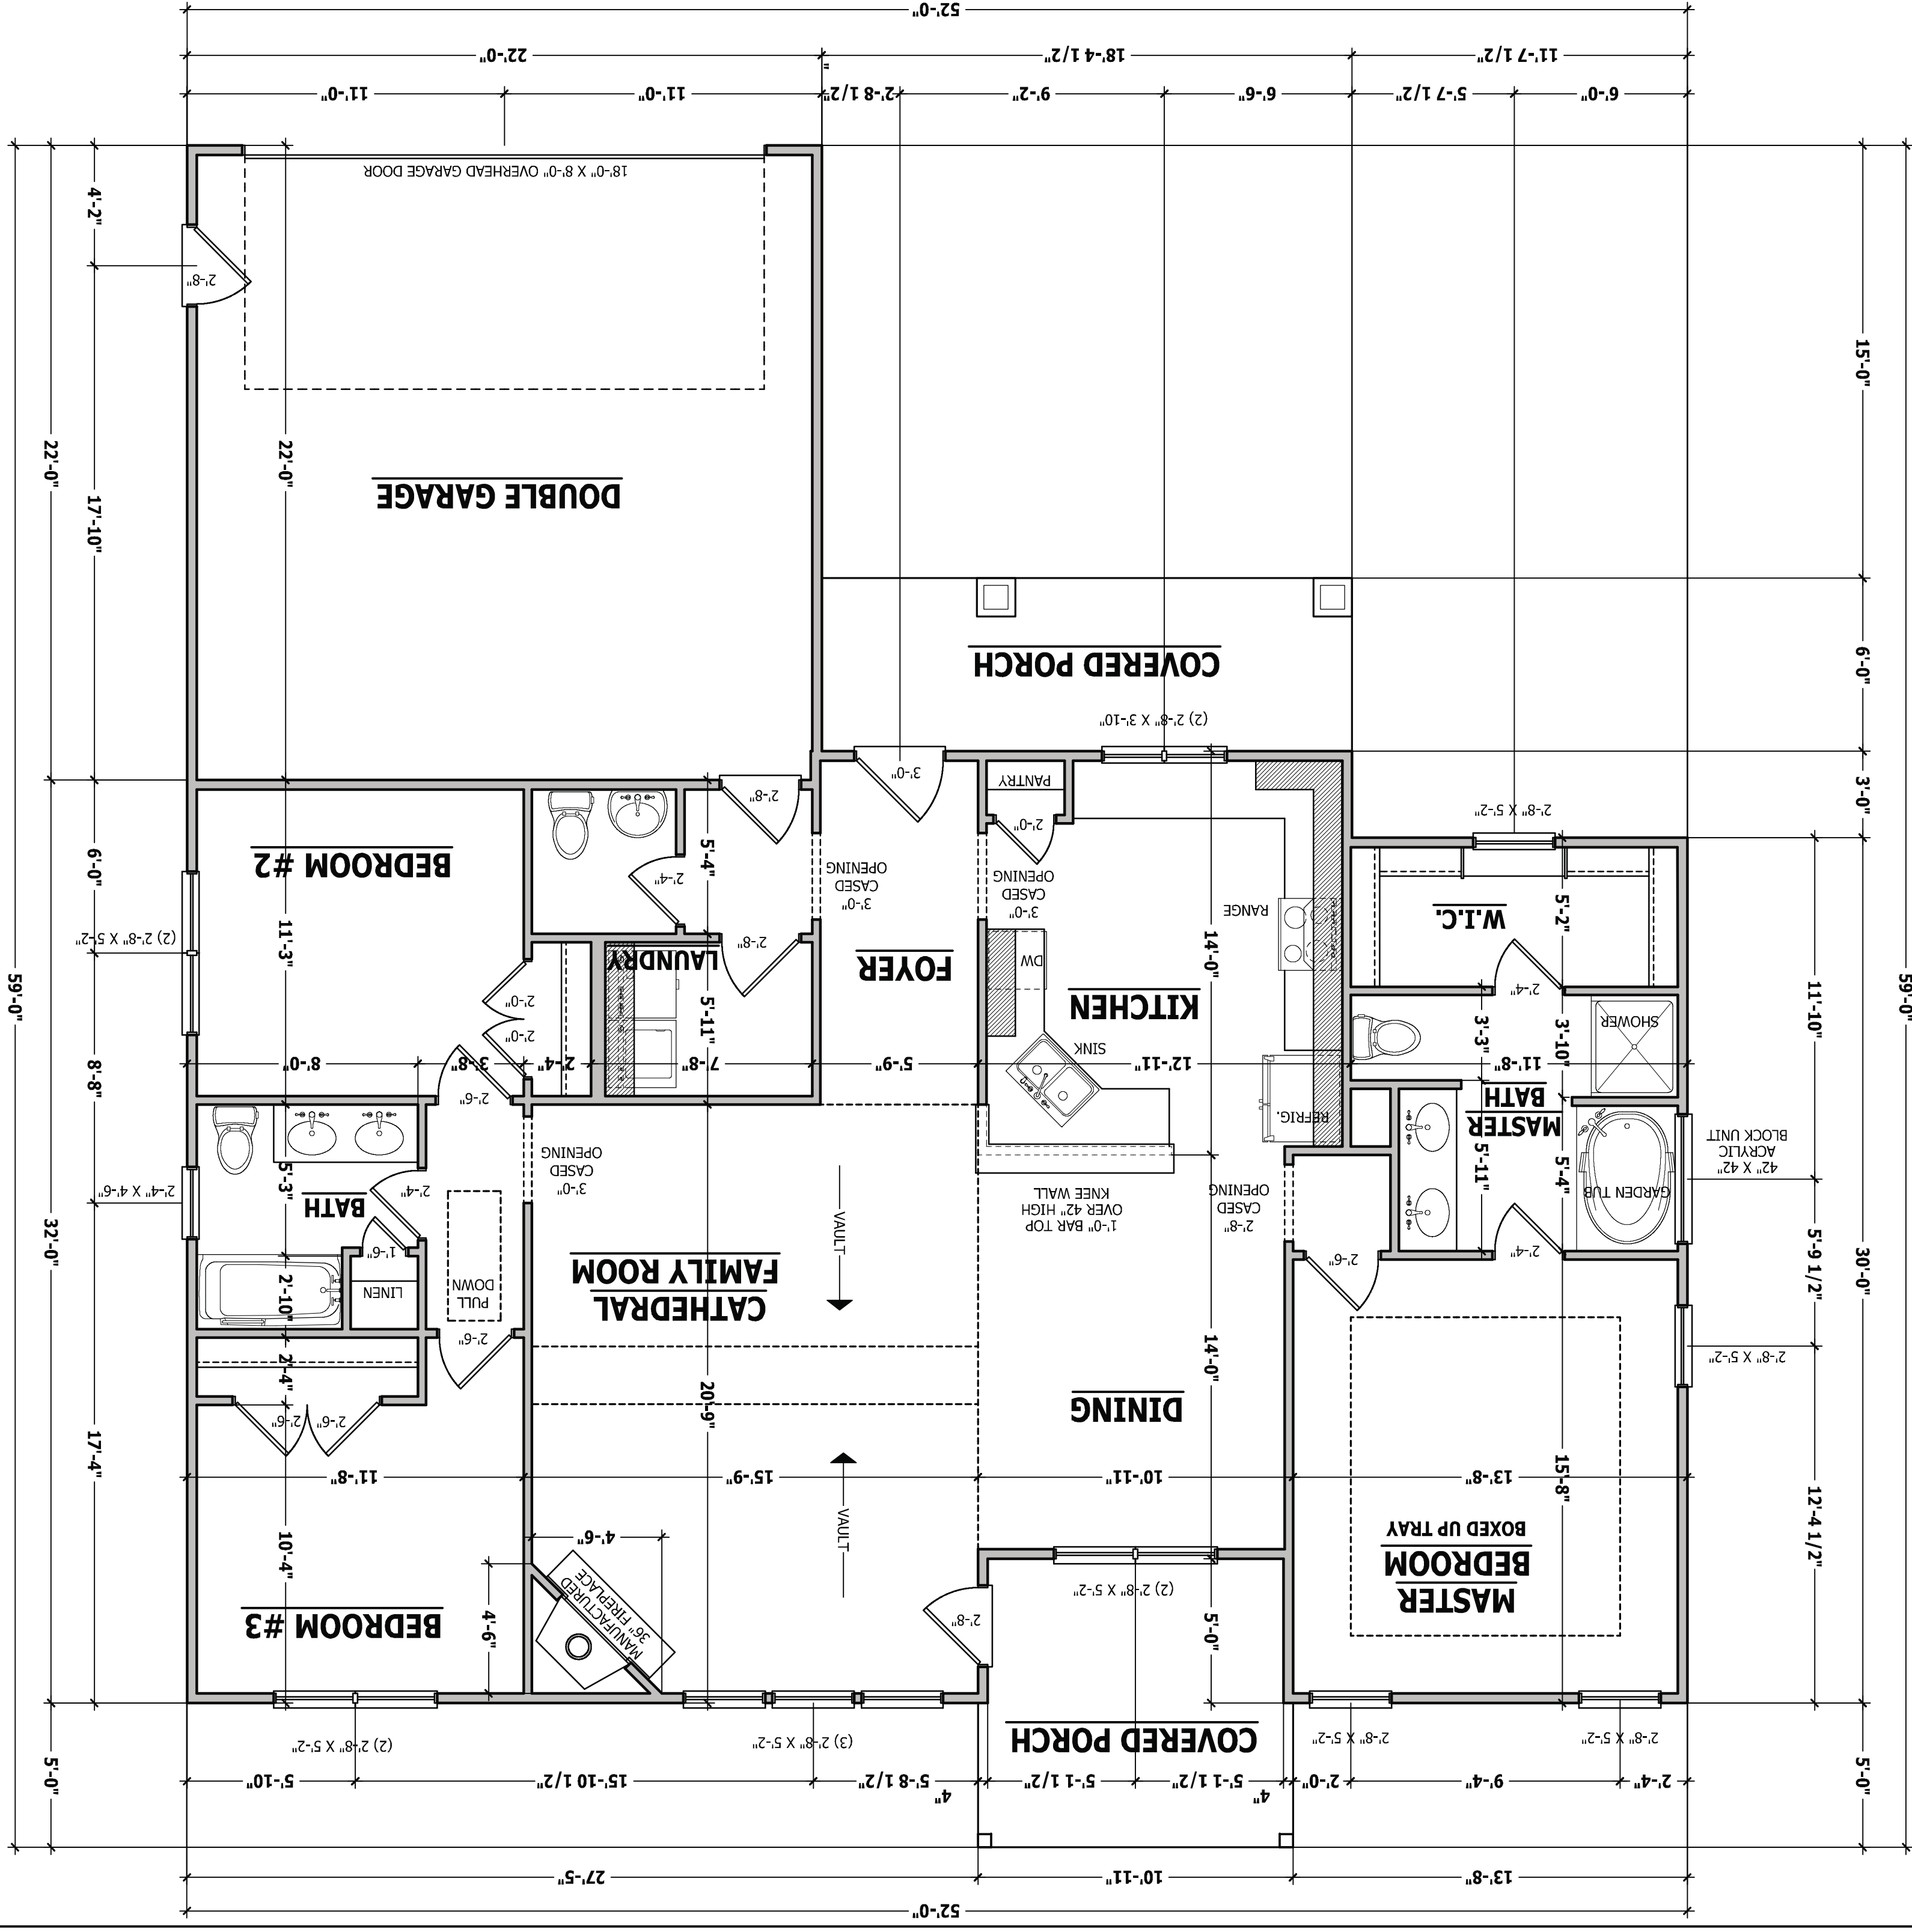

**FIRST FLOOR PLAN**

SCALE 1/4" = 1'-0"

<b>SQUARE FOOTAGE</b>	<b>HEATED</b>	1608 SQ.FT.
<b>UNHEATED</b>	<b>FIRST FLOOR</b>	1608 SQ.FT.
<b>TOTAL</b>	<b>TOTAL</b>	1608 SQ.FT.
<b>FRONT PORCH</b>		110 SQ.FT.
<b>GARAGE</b>		484 SQ.FT.
<b>REAR PORCH</b>		51 SQ.FT.
<b>TOTAL</b>		645 SQ.FT.

**HAYNES**

**HOME PLANS, INC.**

P.O. Box 702, White Forest, NC 27888 919-435-6180 Fax: 1-866-491-0096

**On Top Building Company, LLC**

2393 Twin Acres Road

Clayton, NC

**FIRST FLOOR PLAN**

**Amherst**

PURCHASER MUST VERIFY ALL DIMENSIONS AND CONDITIONS BEFORE CONSTRUCTION BEGINS. HAYNES HOME PLANS, INC. ASSUMES NO LIABILITY FOR CONTRACTORS PRACTICES AND PROCEDURES. CODES AND CONDITIONS MAY VARY WITH LOCATION. A LOCAL DESIGNER, ARCHITECT OR ENGINEER SHOULD BE CONSULTED BEFORE CONSTRUCTION. THESE DRAWINGS ARE INTENDED FOR SERVICE AND AS SUCH SHALL REMAIN PROPERTY OF THE DESIGNER.



**ROOF TRUSS REQUIREMENTS**

TRUSS DESIGN. Trusses to be designed and engineered in accordance with these drawings. Any variation with these drawings must be brought to Haynes Home Plan, Inc. attention before construction begins.

**KNEE WALL AND CEILING HEIGHTS.** All finished knee wall heights and ceiling heights are shown furred down 10" from roof decking for insulation. If for any reason the truss manufacturer fails to meet or exceed designated heel heights, finished knee wall heights, or finished ceiling heights shown on these drawings the finished square footage may vary. Any discrepancy must be brought to Haynes Home Plans, Inc. attention, so a suitable solution can be reached before construction begins. Any variation due to these conditions not being met is the responsibility of the truss manufacturer.



**ANCHORAGE:** All required anchors for trusses due to uplift or bearing shall meet the requirements as specified on the truss schematics.

**BEARING.** All trusses shall be designed for bearing on SPF #2 plates or ledgers unless noted otherwise.

**Plate Heights & Floor Systems.** See elevation page(s) for plate heights and floor system thicknesses.

● HEEL HEIGHT ABOVE  
● FIRST FLOOR PLATE  
● HEEL HEIGHT ABOVE SECOND FLOOR PLATE

**ROOF PLAN**  
SCALE 1/4" = 1'-0"

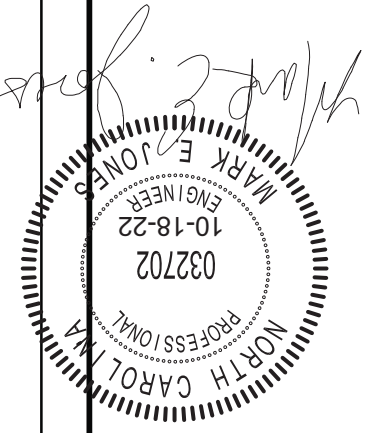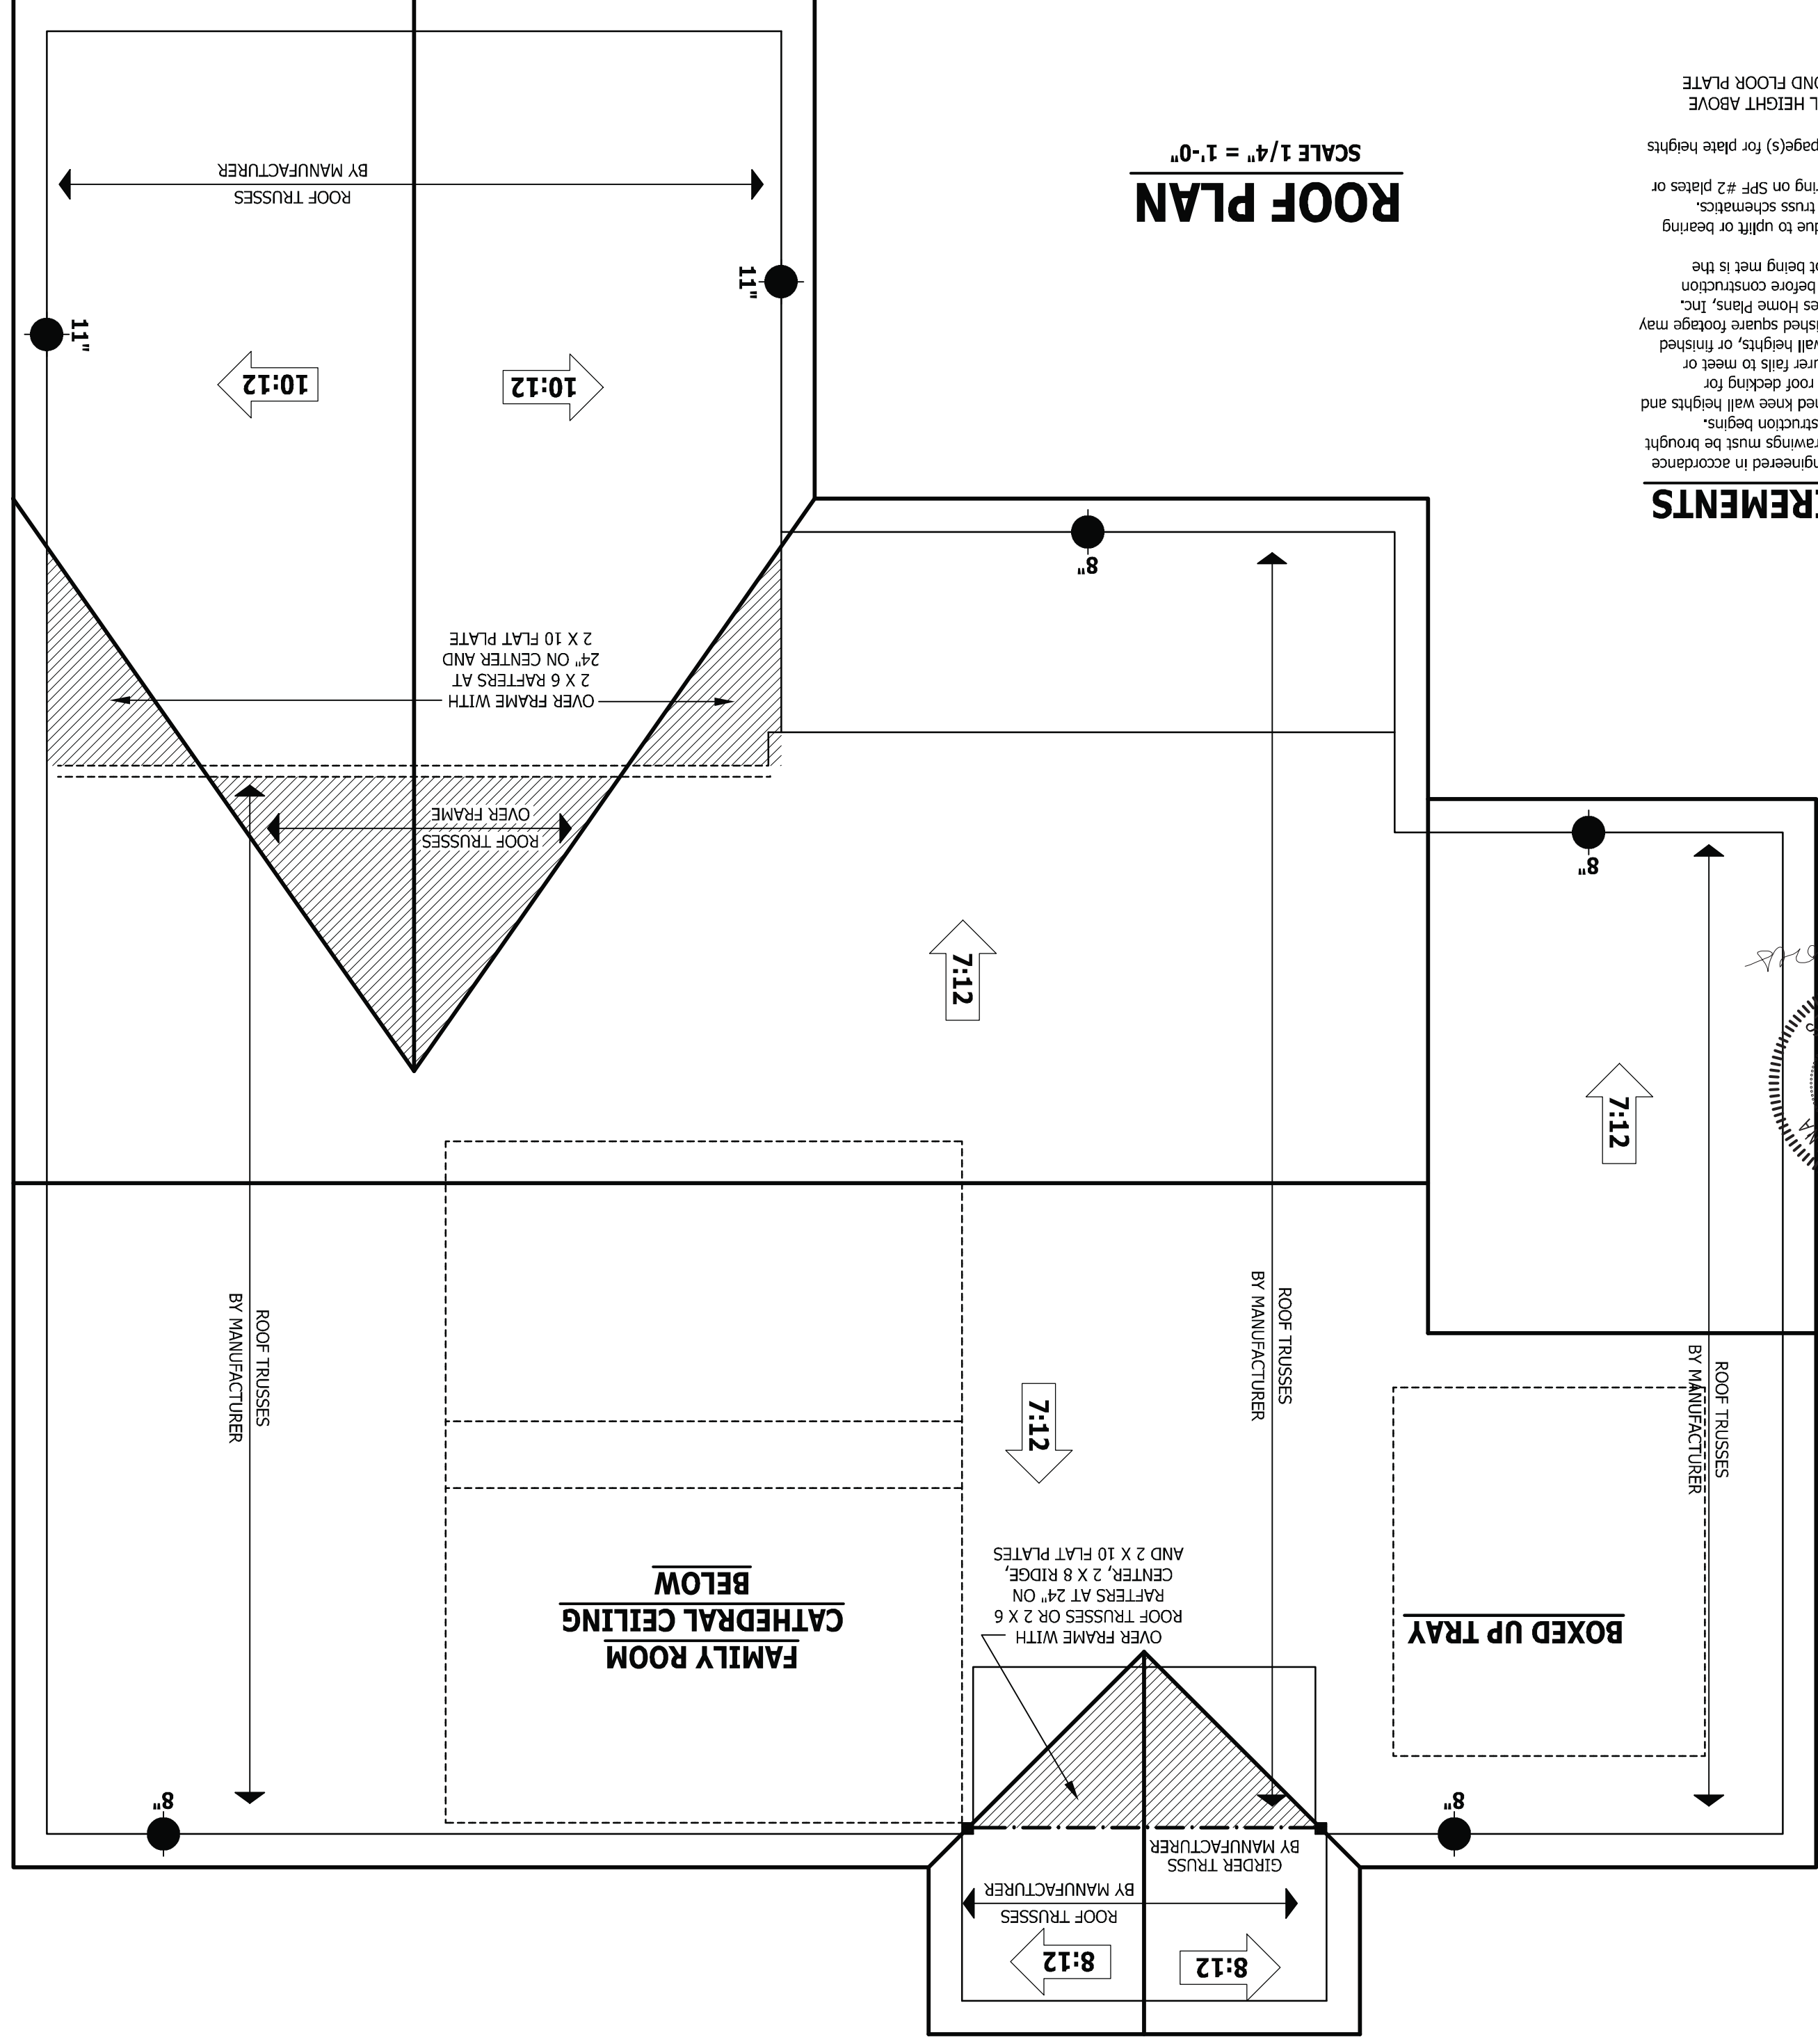

**SQUARE FOOTAGE**

HEATED	1608 SQ.FT.
FIRST FLOOR	1608 SQ.FT.
TOTAL	1608 SQ.FT.
UNHEATED	110 SQ.FT.
ROOM PORCH	484 SQ.FT.
GARAGE	51 SQ.FT.
REAR PORCH	645 SQ.FT.
TOTAL	2399 SQ.FT.

**HAYNES HOME PLANS, INC.**  
P.O. Box 102, White Forest, NC 27888 919-435-6180 Fax: 1-866-491-0396

**On Top Building Company, LLC**  
2393 Twin Acres Road  
Clayton, NC

**ROOF PLAN**  
**Amherst**

BUYER MUST VERIFY ALL DIMENSIONS AND CONDITIONS BEFORE CONSTRUCTION BEGINS. HAYNES HOME PLANS, INC. ASSUMES NO LIABILITY FOR CONTRACTORS PRACTICES AND PROCEDURES. CODES AND CONDITIONS MAY VARY WITH LOCATION. A LOCAL DESIGNER, ARCHITECT OR ENGINEER SHOULD BE CONSULTED BEFORE CONSTRUCTION. THESE DRAWINGS ARE INTENDED FOR SERVICE AND AS SUCH SHALL REMAIN THE PROPERTY OF THE DESIGNER.



