

Trenco
818 Soundside Rd
Edenton, NC 27932

Re: Master_French_Country
MATTAMY/DALTON/FRENCH COUNTRY

The truss drawing(s) referenced below have been prepared by Truss Engineering Co. under my direct supervision based on the parameters provided by Builders FirstSource-Apex,NC.

Pages or sheets covered by this seal: I54477003 thru I54477029

My license renewal date for the state of North Carolina is December 31, 2022.

North Carolina COA: C-0844




September 30,2022

Gilbert, Eric

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

Job	Truss	Truss Type	Qty	Ply	MATTAMY/DALTON/FRENCH COUNTRY
MASTER_FRENCH_COUNTRY	101G	GABLE	1	1	154477003
Builders FirstSource (Apex, NC), Apex, NC - 27523,					

8.530 s Aug 11 2022 MiTek Industries, Inc. Thu Sep 29 15:30:27 2022 Page 1
 ID:3TtRaskrdZOKr4jVkpWDepyhbi-a6?xklK1TKz_ocNz365Z7QDv8XtnuvLkSvR47lyYk4Q

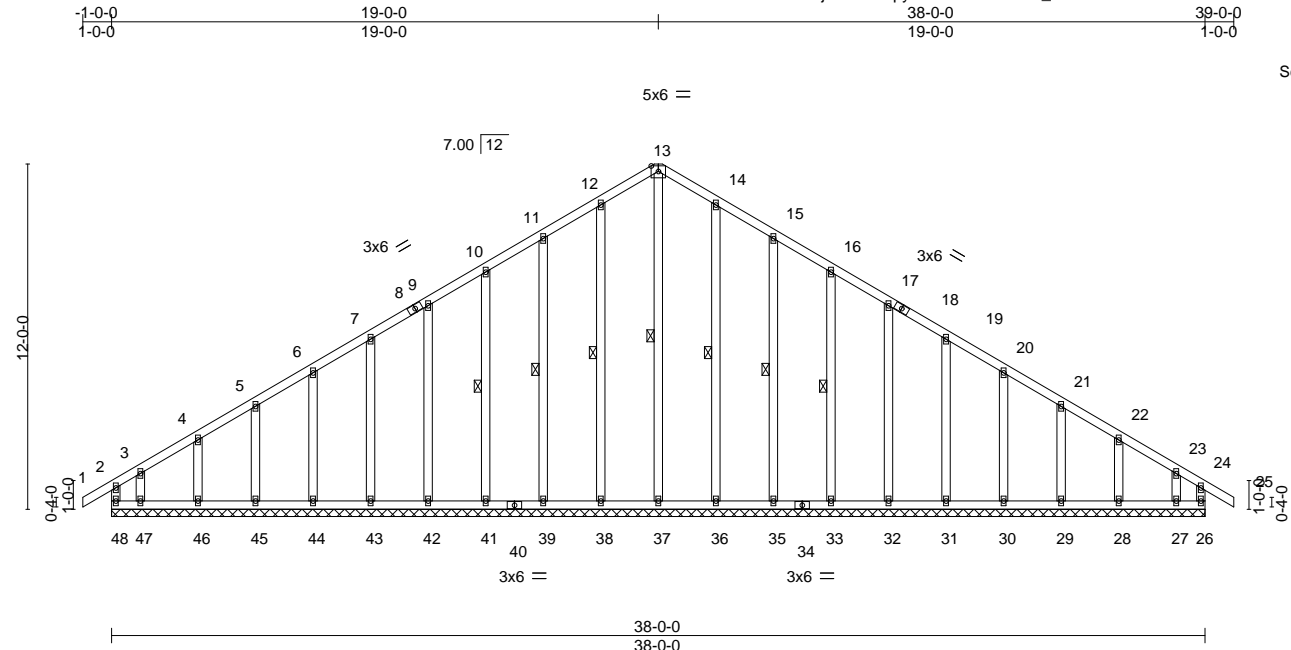

Scale = 1:80.1


LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.21	Vert(LL)	-0.00	25	n/r	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.11	Vert(CT)	-0.01	25	n/r		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.16	Horz(CT)	0.01	26	n/a		
BCDL 10.0	Rep Stress Incr NO	Matrix-R					Weight: 297 lb	FT = 20%
	Code IRC2015/TPI2014							

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3	WEBS 1 Row at midpt 13-37, 12-38, 11-39, 10-41, 14-36, 15-35, 16-33
OTHERS 2x4 SP No.3	

REACTIONS. All bearings 38-0-0.
 (lb) - Max Horz 48=-252(LC 10)
 Max Uplift All uplift 100 lb or less at joint(s) 26, 38, 39, 41, 42, 43, 44, 45, 46, 36, 35, 33, 32, 31, 30, 29, 28 except 48=-179(LC 8), 47=-182(LC 12), 27=-150(LC 13)
 Max Grav All reactions 250 lb or less at joint(s) 26, 37, 38, 39, 41, 42, 43, 44, 45, 46, 47, 36, 35, 33, 32, 31, 30, 29, 28, 27 except 48=256(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 12-13=-234/276, 13-14=-234/276


- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) -0-11-15 to 3-9-10, Exterior(2) 3-9-10 to 19-0-0, Corner(3) 19-0-0 to 23-9-10, Exterior(2) 23-9-10 to 38-11-15 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 26, 38, 39, 41, 42, 43, 44, 45, 46, 36, 35, 33, 32, 31, 30, 29, 28 except (jt=lb) 48=179, 47=182, 27=150.




September 30, 2022

Job	Truss	Truss Type	Qty	Ply	MATTAMY/DALTON/FRENCH COUNTRY	154477004
MASTER_FRENCH_COUNTR	102	COMMON	5	1		

Builders FirstSource (Apex, NC), Apex, NC - 27523, 8.530 s Aug 11 2022 MiTek Industries, Inc. Thu Sep 29 15:30:29 2022 Page 1
 ID:3TtRaskrdZOKr4jVkpWDEpyhbii-WV7i9_MI?x Dh1wXLAX71CrIAmKMQMlr0vDwBBAYk4O



Scale = 1:78.6

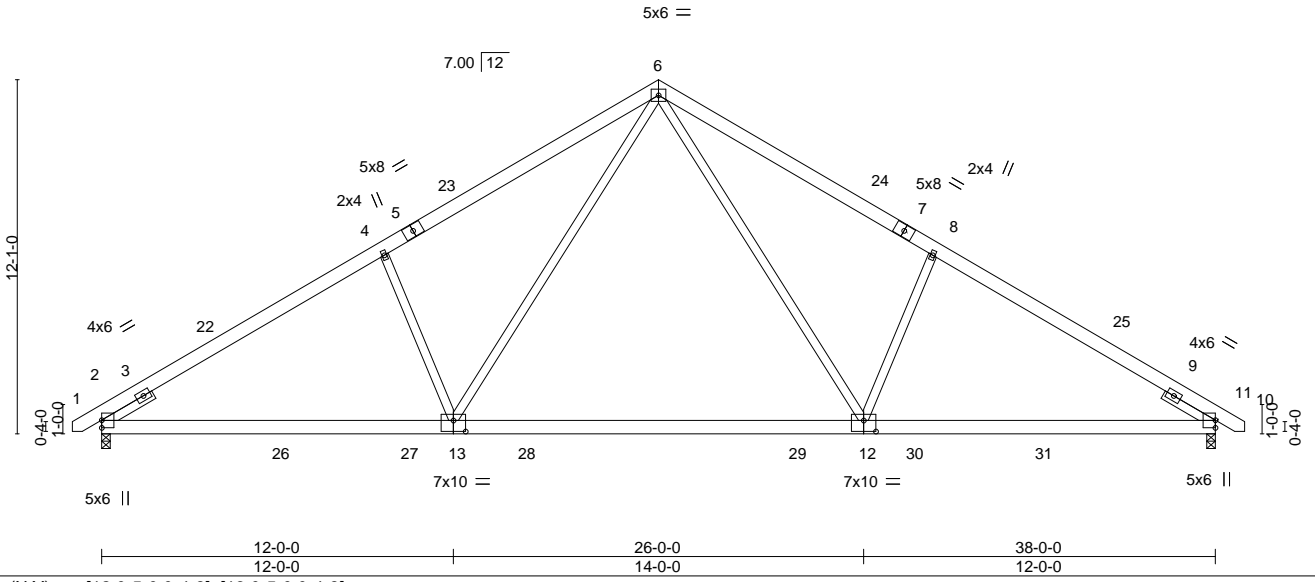

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.53	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.93	Vert(LL) -0.43 12-13 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.41	Vert(CT) -0.69 12-13 >660 240		
BCDL 10.0	Rep Stress Incr YES	Matrix-MS	Horz(CT) 0.07 10 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.05 13-16 >999 240	Weight: 261 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.2	TOP CHORD Structural wood sheathing directly applied or 4-1-13 oc purlins.
BOT CHORD 2x6 SP No.2	BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing.
WEBS 2x4 SP No.2 *Except* 8-12,4-13: 2x4 SP No.3	
SLIDER Left 2x4 SP No.3 1-11-12, Right 2x4 SP No.3 1-11-12	

REACTIONS. (size) 2=0-3-8, 10=0-3-8
 Max Horz 2=228(LC 11)
 Max Grav 2=1708(LC 19), 10=1708(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-4=-2508/105, 4-6=-2374/189, 6-8=-2375/189, 8-10=-2508/105
 BOT CHORD 2-13=0/2225, 12-13=0/1453, 10-12=0/2054
 WEBS 6-12=-58/1136, 8-12=-512/212, 6-13=-58/1135, 4-13=-512/212

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-10-0 to 3-11-10, Interior(1) 3-11-10 to 19-0-0, Exterior(2) 19-0-0 to 25-9-7, Interior(1) 25-9-7 to 38-10-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.




September 30, 2022

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE. Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	<p>ENGINEERING BY TRENCO A MiTek Affiliate</p> <p>818 Soundside Road Edenton, NC 27932</p>
--	--

Job	Truss	Truss Type	Qty	Ply	MATTAMY/DALTON/FRENCH COUNTRY	154477005
MASTER_FRENCH_COUNTRY	402T	COFFER	5	1		

Builders FirstSource (Apex, NC), Apex, NC - 27523, 8.530 s Aug 11 2022 MiTek Industries, Inc. Thu Sep 29 15:30:30 2022 Page 1
 ID:3T1RaskrdZOKr4jvkPWDepyhbi-_hh4MKNwmFLYf46YkEeGk2rLekj555IA8tfkdyYk4N



Scale = 1:82.8


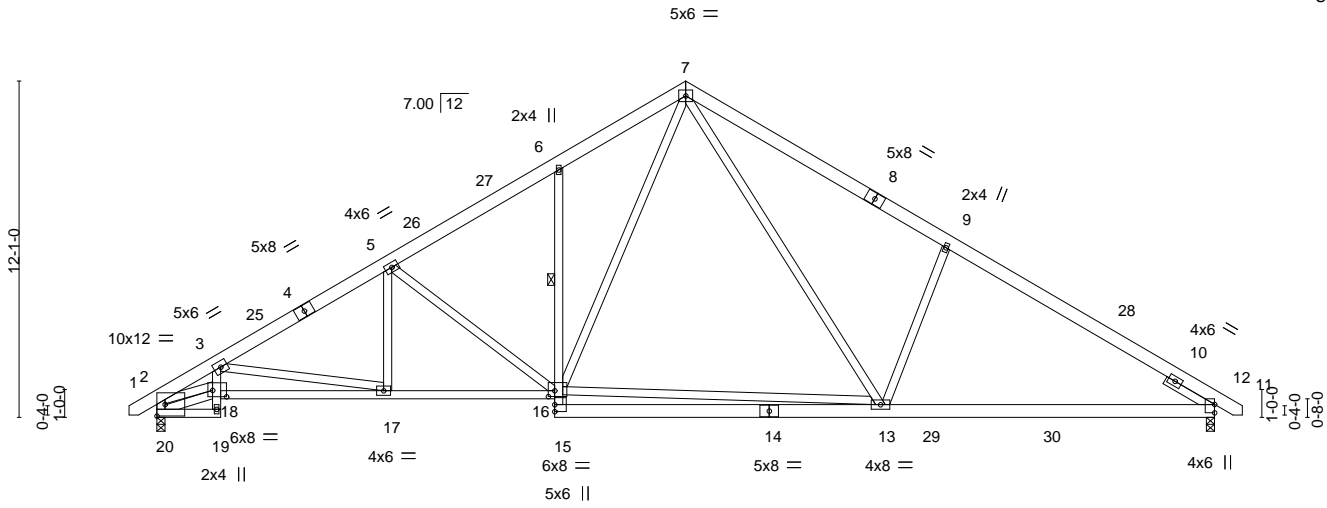


Plate Offsets (X,Y)--	[16:0-2-12,0-2-8], [18:0-6-0,0-2-12]
-----------------------	--------------------------------------


LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.52	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.83	Vert(LL) -0.15 13-15 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.85	Vert(CT) -0.34 13-15 >999 240		
BCDL 10.0	Rep Stress Incr YES	Matrix-MS	Horz(CT) 0.12 11 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.06 16-17 >999 240	Weight: 298 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.2	TOP CHORD Structural wood sheathing directly applied or 4-4-7 oc purlins, except end verticals.
BOT CHORD 2x6 SP No.2 *Except* 19-20,16-18: 2x4 SP No.2, 3-19,6-15: 2x4 SP No.3	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing. Except: 1 Row at midpt 6-16
WEBS 2x4 SP No.3	
SLIDER Right 2x4 SP No.3 1-11-12	

REACTIONS. (size) 11=0-3-8, 20=0-3-8
 Max Horz 20=-242(LC 10)
 Max Grav 11=1564(LC 1), 20=1573(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-2663/70, 3-5=-2477/85, 5-6=-1983/133, 6-7=-1919/217, 7-9=-2082/195, 9-11=-2250/109, 2-20=-1540/72
 BOT CHORD 17-18=-162/2457, 16-17=0/2110, 6-16=-294/128, 13-15=0/382, 11-13=0/1845
 WEBS 3-17=-354/172, 5-16=-620/111, 13-16=0/908, 7-16=-73/922, 7-13=-80/927, 9-13=-530/212, 2-18=-36/2041, 5-17=0/323

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-10-0 to 3-11-10, Interior(1) 3-11-10 to 19-0-0, Exterior(2) 19-0-0 to 25-9-7, Interior(1) 25-9-7 to 38-10-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.

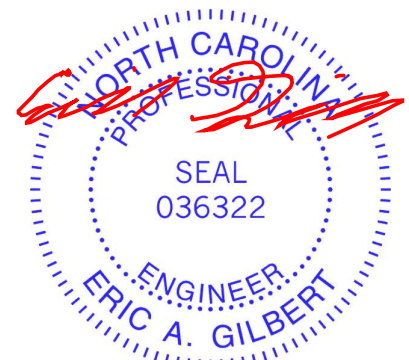


September 30, 2022

Job	Truss	Truss Type	Qty	Ply	MATTAMY/DALTON/FRENCH COUNTRY	IS4477006
MASTER_FRENCH_COUNTRY	A03	COMMON	4	1	Job Reference (optional)	

Builders FirstSource, Apex, NC 27523

8.530 s May 26 2022 MITek Industries, Inc. Thu Sep 29 16:44:07 2022 Page 1
 ID:3TtRaskrdZOKr4jVkpWDepyhii-V96?VJEUaVbRF1whJENJxGH8kFKYVrNJqa7zG6yYj?M

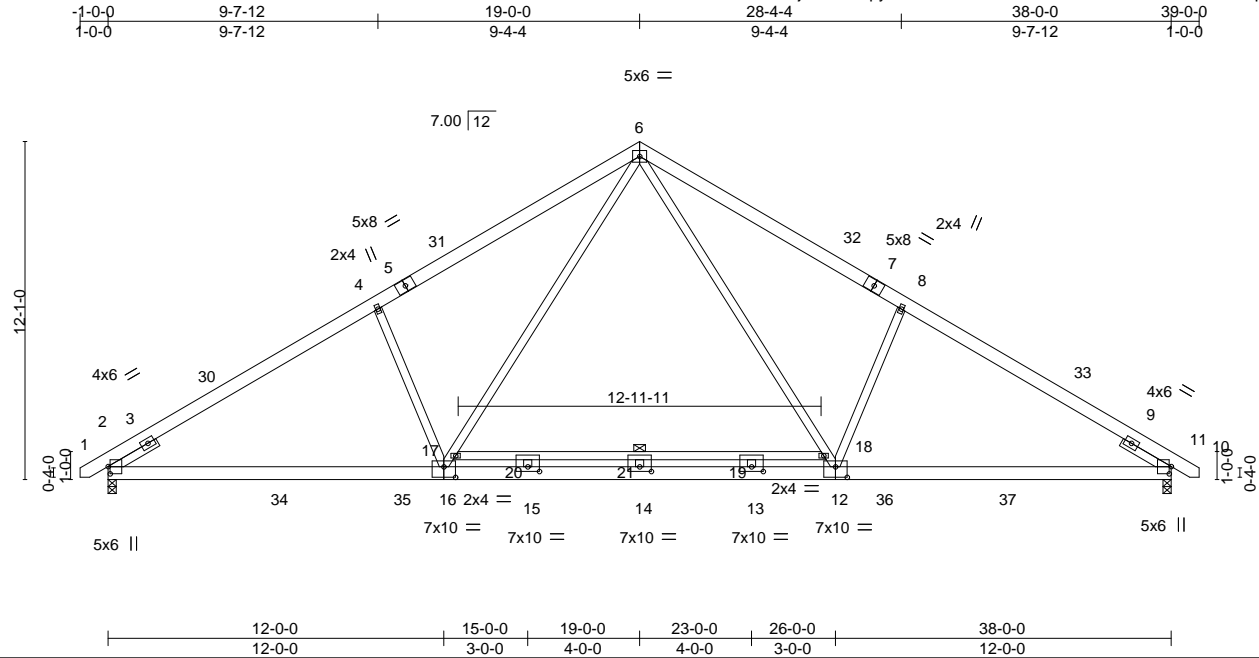

Scale = 1:82.4

Plate Offsets (X,Y)--	[2:0-3-2,0-0-14], [10:0-3-2,0-0-14], [12:0-5-0,0-4-8], [13:0-5-0,0-2-0], [14:0-5-0,0-2-0], [15:0-5-0,0-2-0], [16:0-5-0,0-4-8]
-----------------------	---

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.66	Vert(LL)	-0.61	14	>752	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.51	Vert(CT)	-0.80	14	>568		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.49	Horz(CT)	0.06	10	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MS	Wind(LL)	0.05	16-24	>999		
								Weight: 282 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.2	TOP CHORD Structural wood sheathing directly applied or 3-11-13 oc purlins.
BOT CHORD 2x6 SP DSS	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3 *Except*	WEBS 1 Row at midpt 17-18
6-12,6-16,17-18: 2x4 SP No.2	
SLIDER Left 2x4 SP No.3 1-11-12, Right 2x4 SP No.3 1-11-12	


REACTIONS. (size) 2=0-3-8, 10=0-3-8
 Max Horz 2=228(LC 11)
 Max Grav 2=1772(LC 19), 10=1772(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-1091/0, 3-30=-2625/72, 4-30=-2442/106, 4-5=-2491/138, 5-31=-2424/139,
 6-31=-2365/190, 6-32=-2365/190, 7-32=-2424/139, 7-8=-2491/138, 8-33=-2442/106,
 9-33=-2625/72, 9-10=-1091/0
 BOT CHORD 2-34=0/2325, 34-35=0/2325, 16-35=0/2325, 15-16=0/1697, 14-15=0/1697, 13-14=0/1697,
 12-13=0/1697, 12-36=0/2154, 36-37=0/2154, 10-37=0/2154
 WEBS 6-18=-58/1208, 12-18=-62/1085, 8-12=-513/209, 16-17=-62/1086, 6-17=-58/1208,
 4-16=-513/209

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCCL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-10-0 to 3-11-10, Interior(1) 3-11-10 to 19-0-0, Exterior(2) 19-0-0 to 25-9-7, Interior(1) 25-9-7 to 38-10-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 5) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 6) N/A
 - 7) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S)

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-6=-60, 6-11=-60, 22-26=-20
- 2) Dead + 0.75 Roof Live (balanced) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.15, Plate Increase=1.15

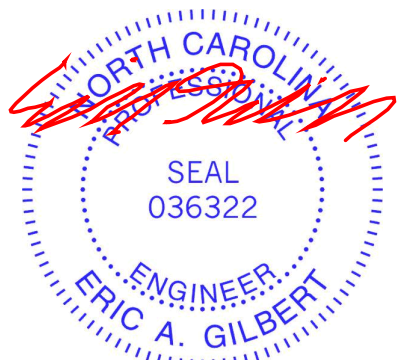

September 30, 2022

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MITek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ENGINEERING BY
TRENCO
 A MITek Affiliate
 818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	MATTAMY/DALTON/FRENCH COUNTRY	IS4477006
MASTER_FRENCH_COUNTRY	A03	COMMON	4	1	Job Reference (optional)	

Builders FirstSource, Apex, NC 27523

8.530 s May 26 2022 MiTek Industries, Inc. Thu Sep 29 16:44:07 2022 Page 2
ID:3TtRaskrdZOKr4jVkpWDeptyhbii-V96?VJEUaWbRF1whJENJxGH8kFKYVrNjqa7zG6yYjM

LOAD CASE(S)

- Uniform Loads (plf)
Vert: 1-6=-50, 6-11=-50, 22-34=-20, 34-35=-50, 35-36=-20, 36-37=-50, 26-37=-20, 17-18=-30(F)
- 3) Dead + Uninhabitable Attic Without Storage: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-6=-20, 6-11=-20, 22-26=-40, 17-18=-40(F)
- 4) Dead + 0.6 C-C Wind (Pos. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=32, 2-30=17, 6-30=12, 6-32=17, 10-32=12, 10-11=8, 22-26=-12
Horz: 1-2=-44, 2-30=-29, 6-30=-24, 6-32=29, 10-32=24, 10-11=20
- 5) Dead + 0.6 C-C Wind (Pos. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=8, 2-31=12, 6-31=17, 6-33=12, 10-33=17, 10-11=32, 22-26=-12
Horz: 1-2=-20, 2-31=-24, 6-31=-29, 6-33=24, 10-33=29, 10-11=44
- 6) Dead + 0.6 C-C Wind (Neg. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-0, 2-6=-44, 6-10=-44, 10-11=-40, 22-26=-20
Horz: 1-2=-20, 2-6=24, 6-10=-24, 10-11=-20
- 7) Dead + 0.6 C-C Wind (Neg. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-40, 2-6=-44, 6-10=-44, 10-11=-0, 22-26=-20
Horz: 1-2=20, 2-6=24, 6-10=-24, 10-11=20
- 8) Dead + 0.6 MWFRS Wind (Pos. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-4, 2-6=-14, 6-10=5, 10-11=1, 22-26=-12
Horz: 1-2=-8, 2-6=2, 6-10=17, 10-11=13
- 9) Dead + 0.6 MWFRS Wind (Pos. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=1, 2-6=5, 6-10=-14, 10-11=-4, 22-26=-12
Horz: 1-2=-13, 2-6=-17, 6-10=-2, 10-11=8
- 10) Dead + 0.6 MWFRS Wind (Neg. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-27, 2-6=-31, 6-10=-11, 10-11=-7, 22-26=-20
Horz: 1-2=7, 2-6=11, 6-10=9, 10-11=13
- 11) Dead + 0.6 MWFRS Wind (Neg. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-7, 2-6=-11, 6-10=-31, 10-11=-27, 22-26=-20
Horz: 1-2=-13, 2-6=9, 6-10=-11, 10-11=-7
- 12) Dead + 0.6 MWFRS Wind (Pos. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-14, 2-4=19, 4-6=9, 6-10=2, 10-11=-3, 22-26=-12
Horz: 1-2=-26, 2-4=-31, 4-6=-21, 6-10=14, 10-11=9
- 13) Dead + 0.6 MWFRS Wind (Pos. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-3, 2-6=2, 6-8=9, 8-10=19, 10-11=14, 22-26=-12
Horz: 1-2=-9, 2-6=-14, 6-8=21, 8-10=31, 10-11=26
- 14) Dead + 0.6 MWFRS Wind (Pos. Internal) 3rd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=5, 2-6=9, 6-10=2, 10-11=-3, 22-26=-12
Horz: 1-2=-17, 2-6=-21, 6-10=14, 10-11=9
- 15) Dead + 0.6 MWFRS Wind (Pos. Internal) 4th Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-3, 2-6=2, 6-10=9, 10-11=5, 22-26=-12
Horz: 1-2=-9, 2-6=-14, 6-10=21, 10-11=17
- 16) Dead + 0.6 MWFRS Wind (Neg. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=6, 2-4=2, 4-6=-7, 6-10=-15, 10-11=-11, 22-26=-20
Horz: 1-2=-26, 2-4=-22, 4-6=-13, 6-10=5, 10-11=9
- 17) Dead + 0.6 MWFRS Wind (Neg. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-11, 2-6=-15, 6-8=-7, 8-10=2, 10-11=6, 22-26=-20
Horz: 1-2=-9, 2-6=-5, 6-8=13, 8-10=22, 10-11=26
- 18) Dead + Uninhabitable Attic Storage: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-6=-20, 6-11=-20, 22-34=-20, 34-35=-60, 35-36=-20, 36-37=-60, 26-37=-20, 17-18=-40(F)
- 19) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) Left): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-55, 2-6=-58, 6-10=-44, 10-11=-40, 22-34=-20, 34-35=-50, 35-36=-20, 36-37=-50, 26-37=-20, 17-18=-30(F)
Horz: 1-2=5, 2-6=8, 6-10=6, 10-11=10
- 20) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) Right): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-40, 2-6=-44, 6-10=-58, 10-11=-55, 22-34=-20, 34-35=-50, 35-36=-20, 36-37=-50, 26-37=-20, 17-18=-30(F)
Horz: 1-2=-10, 2-6=-6, 6-10=-8, 10-11=-5

Continued on page 3

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	MATTAMY/DALTON/FRENCH COUNTRY	IS4477006
MASTER_FRENCH_COUNTRY	A03	COMMON	4	1	Job Reference (optional)	

Builders FirstSource, Apex, NC 27523

8.530 s May 26 2022 MiTek Industries, Inc. Thu Sep 29 16:44:07 2022 Page 3
 ID:3TtRaskrdZOKr4jVvkPWDepyhbi-V96?VJEUaVbRF1whJENJxGH8kFKYVrNJqa7zG6yYj?M

LOAD CASE(S)

- 21) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=-30, 2-4=-34, 4-6=-41, 6-10=-46, 10-11=-43, 22-34=-20, 34-35=-50, 35-36=-20, 36-37=-50, 26-37=-20, 17-18=-30(F)
 Horz: 1-2=-20, 2-4=-16, 4-6=-9, 6-10=4, 10-11=7
- 22) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=-43, 2-6=-46, 6-8=-41, 8-10=-34, 10-11=-30, 22-34=-20, 34-35=-50, 35-36=-20, 36-37=-50, 26-37=-20, 17-18=-30(F)
 Horz: 1-2=-7, 2-6=-4, 6-8=9, 8-10=16, 10-11=20
- 23) 1st Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-6=-60, 6-11=-20, 22-26=-20
- 24) 2nd Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-6=-20, 6-11=-60, 22-26=-20
- 25) 3rd Dead + 0.75 Roof Live (unbalanced) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-6=-50, 6-11=-20, 22-34=-20, 34-35=-50, 35-36=-20, 36-37=-50, 26-37=-20, 17-18=-30(F)
- 26) 4th Dead + 0.75 Roof Live (unbalanced) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-6=-20, 6-11=-50, 22-34=-20, 34-35=-50, 35-36=-20, 36-37=-50, 26-37=-20, 17-18=-30(F)

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	MATTAMY/DALTON/FRENCH COUNTRY	154477007
MASTER_FRENCH_COUNTRY	A04	COMMON	1	1	Job Reference (optional)	

Builders FirstSource, Apex, NC 27523

8,530 s May 26 2022 MiTek Industries, Inc. Thu Sep 29 16:44:17 2022 Page 1
 ID:3TtRaskrdZOKr4jVrkPWDepyhbi-D4jmckMIDbrOSZhcVYfKNhtsHkvrNpn77YVcXyYj?C

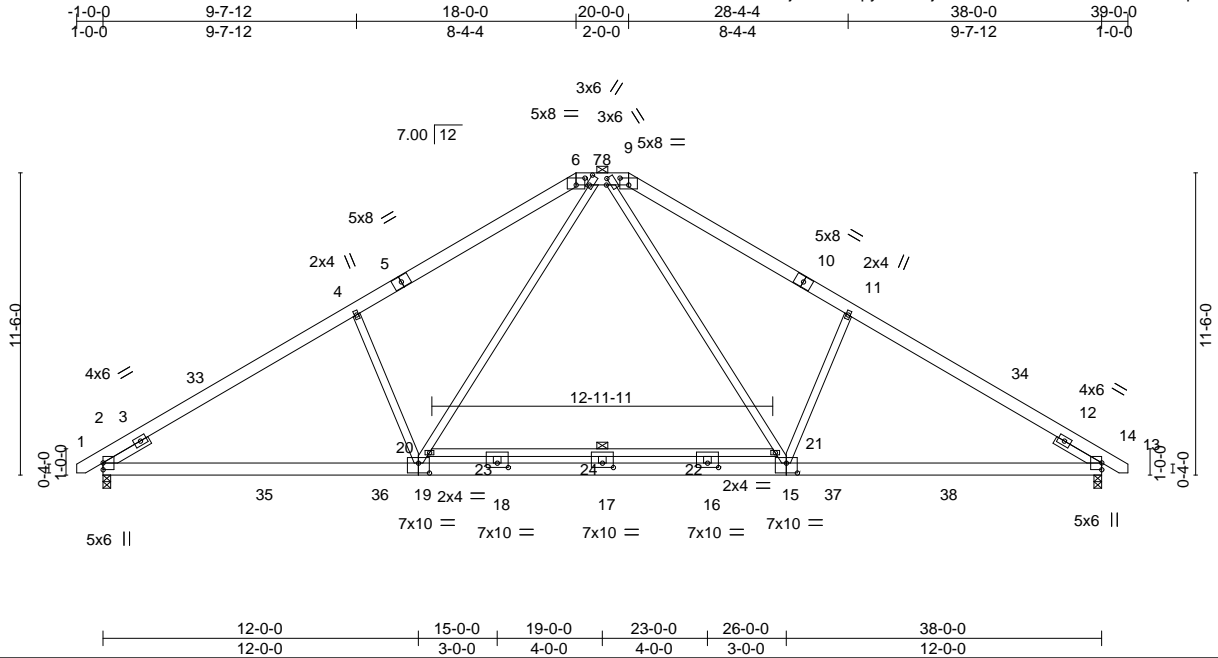

Scale = 1:87.7

Plate Offsets (X,Y)--	[6:0-4-0,0-3-3], [7:0-4-10,0-1-4], [8:0-2-6,0-1-12], [9:0-4-0,0-3-3], [15:0-5-0,0-4-8], [16:0-5-0,0-2-0], [17:0-5-0,0-2-0], [18:0-5-0,0-2-0], [19:0-5-0,0-4-8]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.62	Vert(LL) -0.61 17 >746 360	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.51	Vert(CT) -0.81 17 >564 240		
BCLL 0.0 *	Rep Stress Incr NO	WB 0.49	Horz(CT) 0.06 13 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-MS	Wind(LL) 0.05 19-27 >999 240		
				Weight: 280 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.2
 BOT CHORD 2x6 SP DSS
 WEBS 2x4 SP No.3 *Except*
 8-15,7-19,20-21: 2x4 SP No.2
 SLIDER Left 2x4 SP No.3 1-11-12, Right 2x4 SP No.3 1-11-12

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-0-10 oc purlins, except 2-0-0 oc purlins (4-5-4 max.): 6-9.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
 WEBS 1 Row at midpt 20-21

REACTIONS.

(size) 2=0-3-8, 13=0-3-8
 Max Horz 2=-217(LC 10)
 Max Grav 2=1757(LC 19), 13=1757(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1054/0, 3-33=-2590/81, 4-33=-2487/115, 4-5=-2451/145, 5-6=-2340/191, 9-10=-2341/191, 10-11=-2452/145, 11-34=-2487/115, 12-34=-2590/81, 12-13=-1054/0, 6-7=-2037/207, 7-8=-1413/195, 8-9=-2037/207
 BOT CHORD 2-35=0/2282, 35-36=0/2282, 19-36=0/2282, 18-19=0/1673, 17-18=0/1673, 16-17=0/1673, 15-16=0/1673, 15-37=0/2120, 37-38=0/2120, 13-38=0/2120
 WEBS 8-21=-54/1190, 15-21=-57/1062, 11-15=-487/204, 19-20=-58/1062, 7-20=-53/1189, 4-19=-487/204

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-10-0 to 3-11-10, Interior(1) 3-11-10 to 18-0-0, Exterior(2) 18-0-0 to 26-9-7, Interior(1) 26-9-7 to 38-10-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 6) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 7) N/A
- 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 9) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S)

1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-6=-60, 9-14=-60, 25-29=-20, 6-9=-60



September 30, 2022

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	MATTAMY/DALTON/FRENCH COUNTRY	154477007
MASTER_FRENCH_COUNTRY	A04	COMMON	1	1	Job Reference (optional)	

Builders FirstSource, Apex, NC 27523

8,530 s May 26 2022 MiTek Industries, Inc. Thu Sep 29 16:44:17 2022 Page 2
ID:3TtRaskrdZOKr4jVkpPWDepyhbi-D4jmckMIDbr0SZhvcKYfKNhtsHkvrNpn77YVcXyYj?C

LOAD CASE(S)

- 2) Dead + 0.75 Roof Live (balanced) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-6=-50, 9-14=-50, 25-35=-20, 35-36=-50, 36-37=-20, 37-38=-50, 29-38=-20, 20-21=-30(F), 6-9=-50
- 3) Dead + Uninhabitable Attic Without Storage: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-6=-20, 9-14=-20, 25-29=-40, 20-21=-40(F), 6-9=-20
- 4) Dead + 0.6 C-C Wind (Pos. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=32, 2-33=17, 6-33=12, 9-10=17, 10-13=12, 13-14=8, 25-29=-12, 6-9=20
Horz: 1-2=-44, 2-33=-29, 6-33=-24, 9-10=29, 10-13=24, 13-14=20
- 5) Dead + 0.6 C-C Wind (Pos. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=8, 2-5=12, 5-6=17, 9-34=12, 13-34=17, 13-14=32, 25-29=-12, 6-9=20
Horz: 1-2=-20, 2-5=-24, 5-6=-29, 9-34=24, 13-34=29, 13-14=44
- 6) Dead + 0.6 C-C Wind (Neg. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=0, 2-6=-44, 9-13=-44, 13-14=-40, 25-29=-20, 6-9=-29
Horz: 1-2=-20, 2-6=24, 9-13=-24, 13-14=20
- 7) Dead + 0.6 C-C Wind (Neg. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-40, 2-6=-44, 9-13=-44, 13-14=0, 25-29=-20, 6-9=-29
Horz: 1-2=20, 2-6=24, 9-13=-24, 13-14=20
- 8) Dead + 0.6 MWFRS Wind (Pos. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-4, 2-6=-14, 9-13=5, 13-14=1, 25-29=-12, 6-9=19
Horz: 1-2=-8, 2-6=2, 9-13=17, 13-14=13
- 9) Dead + 0.6 MWFRS Wind (Pos. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=1, 2-6=5, 9-13=-14, 13-14=-4, 25-29=-12, 6-9=19
Horz: 1-2=-13, 2-6=-17, 9-13=-2, 13-14=8
- 10) Dead + 0.6 MWFRS Wind (Neg. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-27, 2-6=-31, 9-13=-11, 13-14=-7, 25-29=-20, 6-9=2
Horz: 1-2=7, 2-6=11, 9-13=9, 13-14=13
- 11) Dead + 0.6 MWFRS Wind (Neg. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-7, 2-6=-11, 9-13=-31, 13-14=-27, 25-29=-20, 6-9=2
Horz: 1-2=-13, 2-6=-9, 9-13=-11, 13-14=-7
- 12) Dead + 0.6 MWFRS Wind (Pos. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=14, 2-4=19, 4-6=9, 9-13=2, 13-14=-3, 25-29=-12, 6-9=2
Horz: 1-2=-26, 2-4=-31, 4-6=-21, 9-13=14, 13-14=9
- 13) Dead + 0.6 MWFRS Wind (Pos. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-3, 2-6=2, 9-11=9, 11-13=19, 13-14=14, 25-29=-12, 6-9=2
Horz: 1-2=-9, 2-6=-14, 9-11=21, 11-13=31, 13-14=26
- 14) Dead + 0.6 MWFRS Wind (Pos. Internal) 3rd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=5, 2-6=9, 9-13=2, 13-14=-3, 25-29=-12, 6-9=2
Horz: 1-2=-17, 2-6=-21, 9-13=14, 13-14=9
- 15) Dead + 0.6 MWFRS Wind (Pos. Internal) 4th Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-3, 2-6=2, 9-13=9, 13-14=5, 25-29=-12, 6-9=2
Horz: 1-2=-9, 2-6=-14, 9-13=21, 13-14=17
- 16) Dead + 0.6 MWFRS Wind (Neg. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=6, 2-4=2, 4-6=-7, 9-13=-15, 13-14=-11, 25-29=-20, 6-9=-15
Horz: 1-2=-26, 2-4=-22, 4-6=-13, 9-13=5, 13-14=9
- 17) Dead + 0.6 MWFRS Wind (Neg. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-11, 2-6=-15, 9-11=-7, 11-13=2, 13-14=6, 25-29=-20, 6-9=-15
Horz: 1-2=-9, 2-6=-5, 9-11=13, 11-13=22, 13-14=26
- 18) Dead + Uninhabitable Attic Storage: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-6=-20, 9-14=-20, 25-35=-20, 35-36=-60, 36-37=-20, 37-38=-60, 29-38=-20, 20-21=-40(F), 6-9=-20
- 19) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) Left): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-55, 2-6=-58, 9-13=-44, 13-14=-40, 25-35=-20, 35-36=-50, 36-37=-20, 37-38=-50, 29-38=-20, 20-21=-30(F), 6-9=-34
Horz: 1-2=5, 2-6=8, 9-13=6, 13-14=10
- 20) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) Right): Lumber Increase=1.60, Plate Increase=1.60

Continued on page 3

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	MATTAMY/DALTON/FRENCH COUNTRY	IS4477007
MASTER_FRENCH_COUNTRY	A04	COMMON	1	1	Job Reference (optional)	

Builders FirstSource, Apex, NC 27523

8,530 s May 26 2022 MiTek Industries, Inc. Thu Sep 29 16:44:17 2022 Page 3
 ID:3TtRaskrdZOKr4jVkpWDEpyhbii-D4jmckMIDbr0SZhcvKYfKNhtsHkvrNpn77YVcXyYj?C

LOAD CASE(S)

- Uniform Loads (plf)
 - Vert: 1-2=-40, 2-6=-44, 9-13=-58, 13-14=-55, 25-35=-20, 35-36=-50, 36-37=-20, 37-38=-50, 29-38=-20, 20-21=-30(F), 6-9=-34
 - Horz: 1-2=-10, 2-6=-6, 9-13=-8, 13-14=-5
- 21) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60
 - Uniform Loads (plf)
 - Vert: 1-2=-30, 2-4=-34, 4-6=-41, 9-13=-46, 13-14=-43, 25-35=-20, 35-36=-50, 36-37=-20, 37-38=-50, 29-38=-20, 20-21=-30(F), 6-9=-46
 - Horz: 1-2=-20, 2-4=-16, 4-6=-9, 9-13=4, 13-14=7
- 22) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60
 - Uniform Loads (plf)
 - Vert: 1-2=-43, 2-6=-46, 9-11=-41, 11-13=-34, 13-14=-30, 25-35=-20, 35-36=-50, 36-37=-20, 37-38=-50, 29-38=-20, 20-21=-30(F), 6-9=-46
 - Horz: 1-2=-7, 2-6=-4, 9-11=9, 11-13=16, 13-14=20
- 23) 1st Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15
 - Uniform Loads (plf)
 - Vert: 1-6=-60, 9-14=-20, 25-29=-20, 6-9=-60
- 24) 2nd Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15
 - Uniform Loads (plf)
 - Vert: 1-6=-20, 9-14=-60, 25-29=-20, 6-9=-60
- 25) 3rd Dead + 0.75 Roof Live (unbalanced) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.15, Plate Increase=1.15
 - Uniform Loads (plf)
 - Vert: 1-6=-50, 9-14=-20, 25-35=-20, 35-36=-50, 36-37=-20, 37-38=-50, 29-38=-20, 20-21=-30(F), 6-9=-50
- 26) 4th Dead + 0.75 Roof Live (unbalanced) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.15, Plate Increase=1.15
 - Uniform Loads (plf)
 - Vert: 1-6=-20, 9-14=-50, 25-35=-20, 35-36=-50, 36-37=-20, 37-38=-50, 29-38=-20, 20-21=-30(F), 6-9=-50

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	MATTAMY/DALTON/FRENCH COUNTRY	154477008
MASTER_FRENCH_COUNTRY	A05	COMMON	1	1	Job Reference (optional)	

Builders FirstSource, Apex, NC 27523

8,530 s May 26 2022 MITek Industries, Inc. Thu Sep 29 16:44:29 2022 Page 1
 ID:3TtRaskrdZOKr4jVkpWDepyhbi-sORJ7qVHOHMJuPbwcrnTqvBuR7pafovYu?S71qyYj?0



Scale = 1:84.1

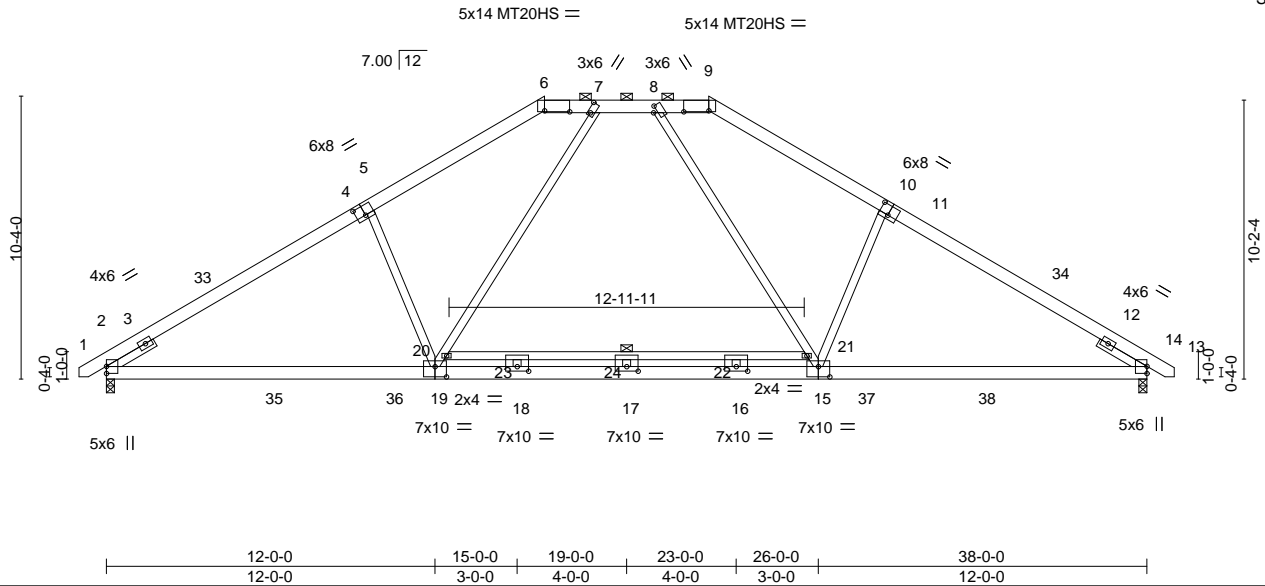


Plate Offsets (X,Y)--	[4:0-4-0,0-4-4], [6:0-11-0,0-0-7], [7:0-4-10,0-1-4], [8:0-2-6,0-1-12], [9:0-11-0,0-0-7], [11:0-4-0,0-4-4], [15:0-5-0,0-4-8], [16:0-5-0,0-2-0], [17:0-5-0,0-2-0], [18:0-5-0,0-2-0], [19:0-5-0,0-4-8]
-----------------------	---

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.71	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.52	Vert(LL) -0.68 17 >668 360	MT20HS	187/143
BCLL 0.0 *	Lumber DOL 1.15	WB 0.48	Vert(CT) -0.94 17 >487 240		
BCDL 10.0	Rep Stress Incr NO	Matrix-MS	Horz(CT) 0.04 13 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.08 19-27 >999 240	Weight: 273 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.2 *Except* 6-9: 2x6 SP DSS	TOP CHORD Structural wood sheathing directly applied or 3-9-1 oc purlins, except 2-0-0 oc purlins (4-11-2 max.): 6-9.
BOT CHORD 2x6 SP DSS	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3 *Except* 8-15,7-19,20-21: 2x4 SP No.2	WEBS 1 Row at midpt 20-21
SLIDER Left 2x4 SP No.3 1-11-12, Right 2x4 SP No.3 1-11-12	

REACTIONS. (size) 2=0-3-8, 13=0-3-8
 Max Horz 2=-192(LC 10)
 Max Grav 2=1726(LC 19), 13=1726(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-949/0, 3-33=-2522/104, 4-33=-2396/136, 4-5=-2322/138, 5-6=-2333/200,
 9-10=-2333/200, 10-11=-2322/138, 11-34=-2396/136, 12-34=-2522/104, 12-13=-949/0,
 6-7=-1986/202, 7-8=-1531/200, 8-9=-1986/202
 BOT CHORD 2-35=-11/2170, 35-36=-11/2170, 19-36=-11/2170, 18-19=0/1686, 17-18=0/1686,
 16-17=0/1686, 15-16=0/1686, 15-37=-15/2070, 37-38=-15/2070, 13-38=-15/2070
 WEBS 8-21=-49/1007, 15-21=-53/896, 10-15=-355/199, 19-20=-53/897, 7-20=-48/1007,
 5-19=-355/199

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-10-0 to 3-11-10, Interior(1) 3-11-10 to 16-0-0, Exterior(2) 16-0-0 to 28-9-7, Interior(1) 28-9-7 to 38-10-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - All plates are MT20 plates unless otherwise indicated.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - N/A
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).



LOAD CASE(S)

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MITek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



Job	Truss	Truss Type	Qty	Ply	MATTAMY/DALTON/FRENCH COUNTRY	154477008
MASTER_FRENCH_COUNTRY	A05	COMMON	1	1	Job Reference (optional)	

Builders FirstSource, Apex, NC 27523

8.530 s May 26 2022 MiTek Industries, Inc. Thu Sep 29 16:44:29 2022 Page 2
ID:3TtRaskrdZOKr4jVkpWDepyhbi-sORJ7qVHOHMJuPbwcmmTqvBuR7pafovYu?S71qyYj?0

LOAD CASE(S)

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-6=-60, 9-14=-60, 25-29=-20, 6-9=-60
- 2) Dead + 0.75 Roof Live (balanced) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-6=-50, 9-14=-50, 25-35=-20, 35-36=-50, 36-37=-20, 37-38=-50, 29-38=-20, 20-21=-30(F), 6-9=-50
- 3) Dead + Uninhabitable Attic Without Storage: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-6=-20, 9-14=-20, 25-29=-40, 20-21=-40(F), 6-9=-20
- 4) Dead + 0.6 C-C Wind (Pos. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=32, 2-33=17, 6-33=12, 9-11=17, 11-13=12, 13-14=8, 25-29=-12, 6-9=20
Horz: 1-2=-44, 2-33=-29, 6-33=-24, 9-11=29, 11-13=24, 13-14=20, 6-7=32, 8-9=-32
- 5) Dead + 0.6 C-C Wind (Pos. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=8, 2-4=12, 4-6=17, 9-34=12, 13-34=17, 13-14=32, 25-29=-12, 6-9=20
Horz: 1-2=-20, 2-4=-24, 4-6=-29, 9-34=24, 13-34=29, 13-14=44, 6-7=32, 8-9=-32
- 6) Dead + 0.6 C-C Wind (Neg. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-0, 2-6=-44, 9-13=-44, 13-14=-40, 25-29=-20, 6-9=-29
Horz: 1-2=-20, 2-6=24, 9-13=-24, 13-14=-20, 6-7=-9, 8-9=9
- 7) Dead + 0.6 C-C Wind (Neg. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-40, 2-6=-44, 9-13=-44, 13-14=-0, 25-29=-20, 6-9=-29
Horz: 1-2=20, 2-6=24, 9-13=-24, 13-14=20, 6-7=-9, 8-9=9
- 8) Dead + 0.6 MWFRS Wind (Pos. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-4, 2-6=-14, 9-13=5, 13-14=1, 25-29=-12, 6-9=19
Horz: 1-2=-8, 2-6=2, 9-13=17, 13-14=13, 6-7=31, 8-9=-31
- 9) Dead + 0.6 MWFRS Wind (Pos. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=1, 2-6=5, 9-13=-14, 13-14=-4, 25-29=-12, 6-9=19
Horz: 1-2=-13, 2-6=-17, 9-13=-2, 13-14=8, 6-7=31, 8-9=-31
- 10) Dead + 0.6 MWFRS Wind (Neg. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-27, 2-6=-31, 9-13=-11, 13-14=-7, 25-29=-20, 6-9=2
Horz: 1-2=7, 2-6=11, 9-13=9, 13-14=13, 6-7=22, 8-9=-22
- 11) Dead + 0.6 MWFRS Wind (Neg. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-7, 2-6=-11, 9-13=-31, 13-14=-27, 25-29=-20, 6-9=2
Horz: 1-2=-13, 2-6=-9, 9-13=-11, 13-14=-7, 6-7=22, 8-9=-22
- 12) Dead + 0.6 MWFRS Wind (Pos. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=14, 2-5=19, 5-6=9, 9-13=2, 13-14=-3, 25-29=-12, 6-9=2
Horz: 1-2=-26, 2-5=-31, 5-6=-21, 9-13=14, 13-14=9, 6-7=14, 8-9=-14
- 13) Dead + 0.6 MWFRS Wind (Pos. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-3, 2-6=2, 9-10=9, 10-13=19, 13-14=14, 25-29=-12, 6-9=2
Horz: 1-2=-9, 2-6=-14, 9-10=21, 10-13=31, 13-14=26, 6-7=14, 8-9=-14
- 14) Dead + 0.6 MWFRS Wind (Pos. Internal) 3rd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=5, 2-6=9, 9-13=2, 13-14=-3, 25-29=-12, 6-9=2
Horz: 1-2=-17, 2-6=-21, 9-13=14, 13-14=9, 6-7=14, 8-9=-14
- 15) Dead + 0.6 MWFRS Wind (Pos. Internal) 4th Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-3, 2-6=2, 9-13=9, 13-14=5, 25-29=-12, 6-9=2
Horz: 1-2=-9, 2-6=-14, 9-13=21, 13-14=17, 6-7=14, 8-9=-14
- 16) Dead + 0.6 MWFRS Wind (Neg. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=6, 2-5=2, 5-6=-7, 9-13=-15, 13-14=-11, 25-29=-20, 6-9=-15
Horz: 1-2=-26, 2-5=-22, 5-6=-13, 9-13=5, 13-14=9, 6-7=5, 8-9=-5
- 17) Dead + 0.6 MWFRS Wind (Neg. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-11, 2-6=-15, 9-10=-7, 10-13=2, 13-14=6, 25-29=-20, 6-9=-15
Horz: 1-2=-9, 2-6=-5, 9-10=13, 10-13=22, 13-14=26, 6-7=5, 8-9=-5
- 18) Dead + Uninhabitable Attic Storage: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-6=-20, 9-14=-20, 25-35=-20, 35-36=-60, 36-37=-20, 37-38=-60, 29-38=-20, 20-21=-40(F), 6-9=-20
- 19) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) Left): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-55, 2-6=-58, 9-13=-44, 13-14=-40, 25-35=-20, 35-36=-50, 36-37=-20, 37-38=-50, 29-38=-20, 20-21=-30(F), 6-9=-34
Horz: 1-2=5, 2-6=8, 9-13=6, 13-14=10, 6-7=16, 8-9=-16

Continued on page 3

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	MATTAMY/DALTON/FRENCH COUNTRY	IS4477008
MASTER_FRENCH_COUNTRY	A05	COMMON	1	1	Job Reference (optional)	

Builders FirstSource, Apex, NC 27523

8.530 s May 26 2022 MiTek Industries, Inc. Thu Sep 29 16:44:29 2022 Page 3
 ID:3TtRaskrdZOKr4JvKpWDepyhbii-sORJ7qVHOHMJuPbwcrmTqvBuR7pafovYu?S71qyYj?0

LOAD CASE(S)

- 20) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) Right): Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=-40, 2-6=-44, 9-13=-58, 13-14=-55, 25-35=-20, 35-36=-50, 36-37=-20, 37-38=-50, 29-38=-20, 20-21=-30(F), 6-9=-34
 Horz: 1-2=-10, 2-6=-6, 9-13=-8, 13-14=-5, 6-7=16, 8-9=-16
- 21) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=-30, 2-5=-34, 5-6=-41, 9-13=-46, 13-14=-43, 25-35=-20, 35-36=-50, 36-37=-20, 37-38=-50, 29-38=-20, 20-21=-30(F), 6-9=-46
 Horz: 1-2=-20, 2-5=-16, 5-6=-9, 9-13=4, 13-14=7, 6-7=4, 8-9=-4
- 22) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60
 Uniform Loads (plf)
 Vert: 1-2=-43, 2-6=-46, 9-10=-41, 10-13=-34, 13-14=-30, 25-35=-20, 35-36=-50, 36-37=-20, 37-38=-50, 29-38=-20, 20-21=-30(F), 6-9=-46
 Horz: 1-2=-7, 2-6=-4, 9-10=9, 10-13=16, 13-14=20, 6-7=4, 8-9=-4
- 23) 1st Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-6=-60, 9-14=-20, 25-29=-20, 6-9=-60
- 24) 2nd Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-6=-20, 9-14=-60, 25-29=-20, 6-9=-60
- 25) 3rd Dead + 0.75 Roof Live (unbalanced) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-6=-50, 9-14=-20, 25-35=-20, 35-36=-50, 36-37=-20, 37-38=-50, 29-38=-20, 20-21=-30(F), 6-9=-50
- 26) 4th Dead + 0.75 Roof Live (unbalanced) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-6=-20, 9-14=-50, 25-35=-20, 35-36=-50, 36-37=-20, 37-38=-50, 29-38=-20, 20-21=-30(F), 6-9=-50

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	MATTAMY/DALTON/FRENCH COUNTRY	154477009
MASTER_FRENCH_COUNTRY	A06	COMMON	1	1	Job Reference (optional)	

Builders FirstSource, Apex, NC 27523

8.530 s May 26 2022 MiTek Industries, Inc. Thu Sep 29 16:44:38 2022 Page 1
 ID:3TtRaskrdZOKr4jVvkPWDepyhbi-57Uj0vcwH2V2ToneeEQaho3TVlrxGmztYu86rpyY_t



Scale = 1:77.5

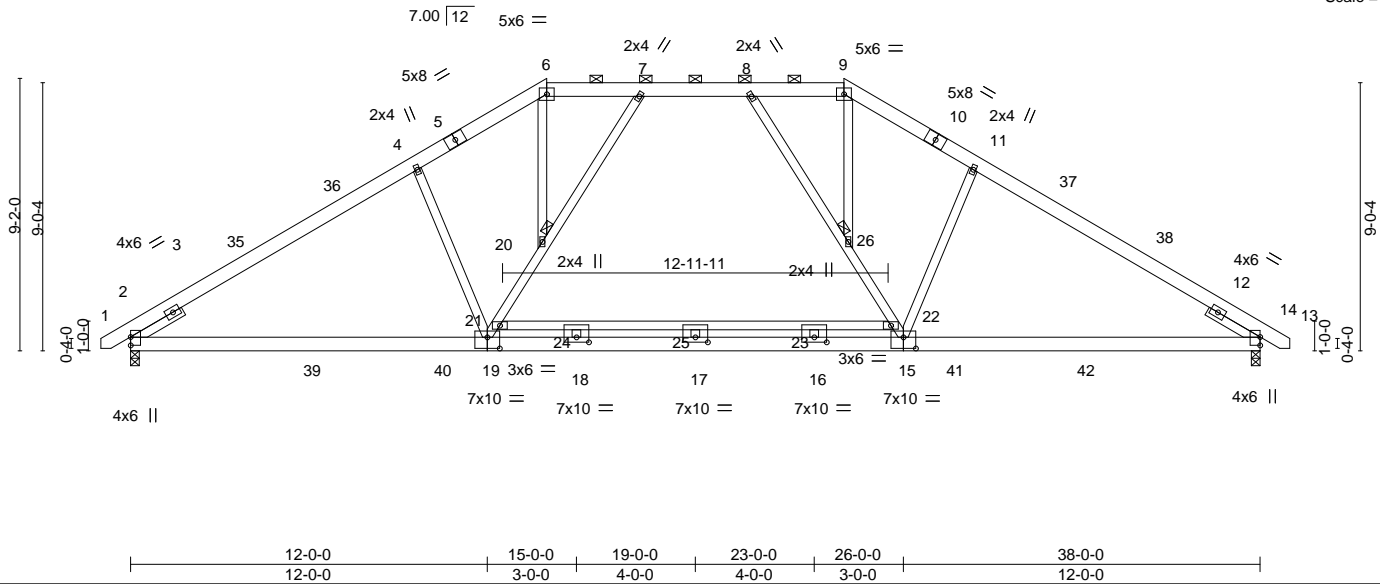


Plate Offsets (X,Y)--	[15:0-5-0,0-4-8], [16:0-5-0,0-2-0], [17:0-5-0,0-2-0], [18:0-5-0,0-2-0], [19:0-5-0,0-4-8]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.56	Vert(LL) -0.21 17 >999 360	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.76	Vert(CT) -0.49 17 >931 240		
BCLL 0.0 *	Rep Stress Incr NO	WB 0.94	Horz(CT) 0.04 13 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-MS	Wind(LL) 0.09 19-29 >999 240		
				Weight: 283 lb	FT = 20%


LUMBER-	BRACING-
TOP CHORD 2x6 SP No.2	TOP CHORD Structural wood sheathing directly applied or 4-2-15 oc purlins, except 2-0-0 oc purlins (4-10-12 max.); 6-9.
BOT CHORD 2x6 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3 *Except*	JOINTS 1 Brace at Jt(s): 20, 26
SLIDER 8-15,7-19: 2x4 SP No.1, 21-22: 2x4 SP No.2 Left 2x4 SP No.3 1-11-12, Right 2x4 SP No.3 1-11-12	

REACTIONS. (size) 2=0-3-8, 13=0-3-8
 Max Horz 2=-169(LC 10)
 Max Grav 2=1570(LC 1), 13=1570(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-949/0, 3-35=-2219/113, 35-36=-2081/121, 4-36=-2043/147, 4-5=-2006/173, 5-6=-1888/195, 9-10=-1888/195, 10-11=-2006/173, 11-37=-2043/147, 37-38=-2081/121, 12-38=-2219/113, 12-13=-949/0, 6-7=-1696/185, 7-8=-1679/210, 8-9=-1696/185
 BOT CHORD 2-39=-17/1798, 39-40=-17/1798, 19-40=-17/1798, 18-19=-23/840, 17-18=-23/840, 16-17=-23/840, 15-16=-23/840, 15-41=-21/1798, 41-42=-21/1798, 13-42=-21/1798
 WEBS 22-26=-51/600, 15-22=-38/926, 11-15=-288/200, 19-21=-40/929, 20-21=-51/600, 4-19=-288/200, 6-20=-36/535, 21-24=-63/838, 24-25=-63/838, 23-25=-63/838, 22-23=-63/838, 9-26=-36/535

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCCL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-10-0 to 3-11-10, Interior(1) 3-11-10 to 14-0-0, Exterior(2) 14-0-0 to 20-8-14, Interior(1) 20-8-14 to 24-0-0, Exterior(2) 24-0-0 to 30-9-7, Interior(1) 30-9-7 to 38-10-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - N/A
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S)
 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-6=-60, 9-14=-60, 27-31=-20, 6-9=-60

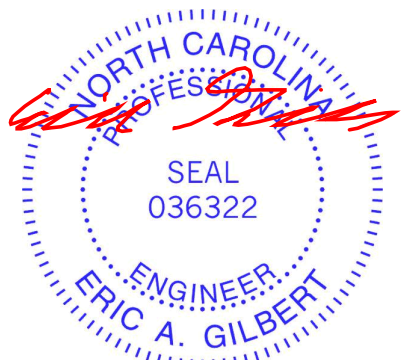

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, information, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



Job	Truss	Truss Type	Qty	Ply	MATTAMY/DALTON/FRENCH COUNTRY	IS4477009
MASTER_FRENCH_COUNTRY	A06	COMMON	1	1	Job Reference (optional)	

Builders FirstSource, Apex, NC 27523

8.530 s May 26 2022 MiTek Industries, Inc. Thu Sep 29 16:44:38 2022 Page 2
ID:3TtRaskrdZOKr4jVkpWVDepyhbi-57Uj0vcwH2V2ToneeEQaho3TVlrxGmztYu86rpyYj_t

LOAD CASE(S)

- 2) Dead + 0.75 Roof Live (balanced) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-6=-50, 9-14=-50, 27-39=-20, 39-40=-50, 40-41=-20, 41-42=-50, 31-42=-20, 6-9=-50
- 3) Dead + Uninhabitable Attic Without Storage: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-6=-20, 9-14=-20, 27-31=-40, 6-9=-20
- 4) Dead + 0.6 C-C Wind (Pos. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=32, 2-35=17, 6-35=12, 9-37=17, 13-37=12, 13-14=8, 27-31=-12, 6-8=20, 8-9=15
Horz: 1-2=-44, 2-35=-29, 6-35=-24, 9-37=29, 13-37=24, 13-14=20
Drag: 6-7=0, 8-9=-0
- 5) Dead + 0.6 C-C Wind (Pos. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=8, 2-36=12, 6-36=17, 9-38=12, 13-38=17, 13-14=32, 27-31=-12, 6-7=15, 7-9=20
Horz: 1-2=-20, 2-36=-24, 6-36=-29, 9-38=24, 13-38=29, 13-14=44
Drag: 6-7=0, 8-9=-0
- 6) Dead + 0.6 C-C Wind (Neg. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-0, 2-6=-44, 9-13=-44, 13-14=-40, 27-31=-20, 6-9=-29
Horz: 1-2=-20, 2-6=24, 9-13=-24, 13-14=-20
Drag: 6-7=-0, 8-9=0
- 7) Dead + 0.6 C-C Wind (Neg. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-40, 2-6=-44, 9-13=-44, 13-14=-0, 27-31=-20, 6-9=-29
Horz: 1-2=20, 2-6=24, 9-13=-24, 13-14=20
Drag: 6-7=-0, 8-9=0
- 8) Dead + 0.6 MWFRS Wind (Pos. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-4, 2-6=-14, 9-13=5, 13-14=1, 27-31=-12, 6-9=19
Horz: 1-2=-8, 2-6=2, 9-13=17, 13-14=13
Drag: 6-7=0, 8-9=-0
- 9) Dead + 0.6 MWFRS Wind (Pos. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=1, 2-6=5, 9-13=-14, 13-14=-4, 27-31=-12, 6-9=19
Horz: 1-2=-13, 2-6=-17, 9-13=-2, 13-14=8
Drag: 6-7=0, 8-9=-0
- 10) Dead + 0.6 MWFRS Wind (Neg. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-27, 2-6=-31, 9-13=-11, 13-14=-7, 27-31=-20, 6-9=2
Horz: 1-2=7, 2-6=11, 9-13=9, 13-14=13
Drag: 6-7=0, 8-9=-0
- 11) Dead + 0.6 MWFRS Wind (Neg. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-7, 2-6=-11, 9-13=-31, 13-14=-27, 27-31=-20, 6-9=2
Horz: 1-2=-13, 2-6=-9, 9-13=-11, 13-14=-7
Drag: 6-7=0, 8-9=-0
- 12) Dead + 0.6 MWFRS Wind (Pos. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=14, 2-4=19, 4-6=9, 9-13=2, 13-14=-3, 27-31=-12, 6-9=2
Horz: 1-2=-26, 2-4=-31, 4-6=-21, 9-13=14, 13-14=9
Drag: 6-7=0, 8-9=-0
- 13) Dead + 0.6 MWFRS Wind (Pos. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-3, 2-6=2, 9-11=9, 11-13=19, 13-14=14, 27-31=-12, 6-9=2
Horz: 1-2=-9, 2-6=-14, 9-11=21, 11-13=31, 13-14=26
Drag: 6-7=0, 8-9=-0
- 14) Dead + 0.6 MWFRS Wind (Pos. Internal) 3rd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=5, 2-6=9, 9-13=2, 13-14=-3, 27-31=-12, 6-9=2
Horz: 1-2=-17, 2-6=-21, 9-13=14, 13-14=9
Drag: 6-7=0, 8-9=-0
- 15) Dead + 0.6 MWFRS Wind (Pos. Internal) 4th Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-3, 2-6=2, 9-13=9, 13-14=5, 27-31=-12, 6-9=2
Horz: 1-2=-9, 2-6=-14, 9-13=21, 13-14=17
Drag: 6-7=0, 8-9=-0
- 16) Dead + 0.6 MWFRS Wind (Neg. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=6, 2-4=2, 4-6=-7, 9-13=-15, 13-14=-11, 27-31=-20, 6-9=-15
Horz: 1-2=-26, 2-4=-22, 4-6=-13, 9-13=5, 13-14=9
Drag: 6-7=0, 8-9=-0
- 17) Dead + 0.6 MWFRS Wind (Neg. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60

Continued on page 3

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	MATTAMY/DALTON/FRENCH COUNTRY	IS4477009
MASTER_FRENCH_COUNTRY	A06	COMMON	1	1	Job Reference (optional)	

Builders FirstSource, Apex, NC 27523

8.530 s May 26 2022 MiTek Industries, Inc. Thu Sep 29 16:44:38 2022 Page 3
 ID:3TtRskrdZOKr4jVkpPWDepyhbi-57Uj0vcwH2V2ToneeEQaho3TVIrxGmztYu86rpyY_t

LOAD CASE(S)

Uniform Loads (plf)

Vert: 1-2=-11, 2-6=-15, 9-11=-7, 11-13=2, 13-14=6, 27-31=-20, 6-9=-15
 Horz: 1-2=-9, 2-6=-5, 9-11=13, 11-13=22, 13-14=26
 Drag: 6-7=0, 8-9=0

18) Dead + Uninhabitable Attic Storage: Lumber Increase=1.25, Plate Increase=1.25

Uniform Loads (plf)

Vert: 1-6=-20, 9-14=-20, 27-39=-20, 39-40=-60, 40-41=-20, 41-42=-60, 31-42=-20, 6-9=-20

19) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) Left): Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 1-2=-55, 2-6=-58, 9-13=-44, 13-14=-40, 27-39=-20, 39-40=-50, 40-41=-20, 41-42=-50, 31-42=-20, 6-9=-34
 Horz: 1-2=5, 2-6=8, 9-13=6, 13-14=10
 Drag: 6-7=0, 8-9=0

20) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) Right): Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 1-2=-40, 2-6=-44, 9-13=-58, 13-14=-55, 27-39=-20, 39-40=-50, 40-41=-20, 41-42=-50, 31-42=-20, 6-9=-34
 Horz: 1-2=-10, 2-6=-6, 9-13=-8, 13-14=-5
 Drag: 6-7=0, 8-9=0

21) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 1-2=-30, 2-4=-34, 4-6=-41, 9-13=-46, 13-14=-43, 27-39=-20, 39-40=-50, 40-41=-20, 41-42=-50, 31-42=-20, 6-9=-46
 Horz: 1-2=-20, 2-4=16, 4-6=-9, 9-13=4, 13-14=7
 Drag: 6-7=0, 8-9=0

22) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 1-2=-43, 2-6=-46, 9-11=-41, 11-13=-34, 13-14=-30, 27-39=-20, 39-40=-50, 40-41=-20, 41-42=-50, 31-42=-20, 6-9=-46
 Horz: 1-2=-7, 2-6=-4, 9-11=9, 11-13=16, 13-14=20
 Drag: 6-7=0, 8-9=0

23) 1st Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-6=-60, 9-14=-20, 27-31=-20, 6-9=-60

24) 2nd Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-6=-20, 9-14=-60, 27-31=-20, 6-9=-60

25) 3rd Dead + 0.75 Roof Live (unbalanced) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-6=-50, 9-14=-20, 27-39=-20, 39-40=-50, 40-41=-20, 41-42=-50, 31-42=-20, 6-9=-50

26) 4th Dead + 0.75 Roof Live (unbalanced) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-6=-20, 9-14=-50, 27-39=-20, 39-40=-50, 40-41=-20, 41-42=-50, 31-42=-20, 6-9=-50

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	MATTAMY/DALTON/FRENCH COUNTRY	154477010
MASTER_FRENCH_COUNTRY	A07	COMMON	1	1	Job Reference (optional)	

Builders FirstSource, Apex, NC 27523

8.530 s May 26 2022 MITek Industries, Inc. Thu Sep 29 16:44:48 2022 Page 1
ID:3TtRaskrdZOKr4jVKPWDePyhbii-p25U6KkCw6ldgKYZDLcw5vUBfnFWcJnLFSZeBEyYj_j



Scale = 1:71.0

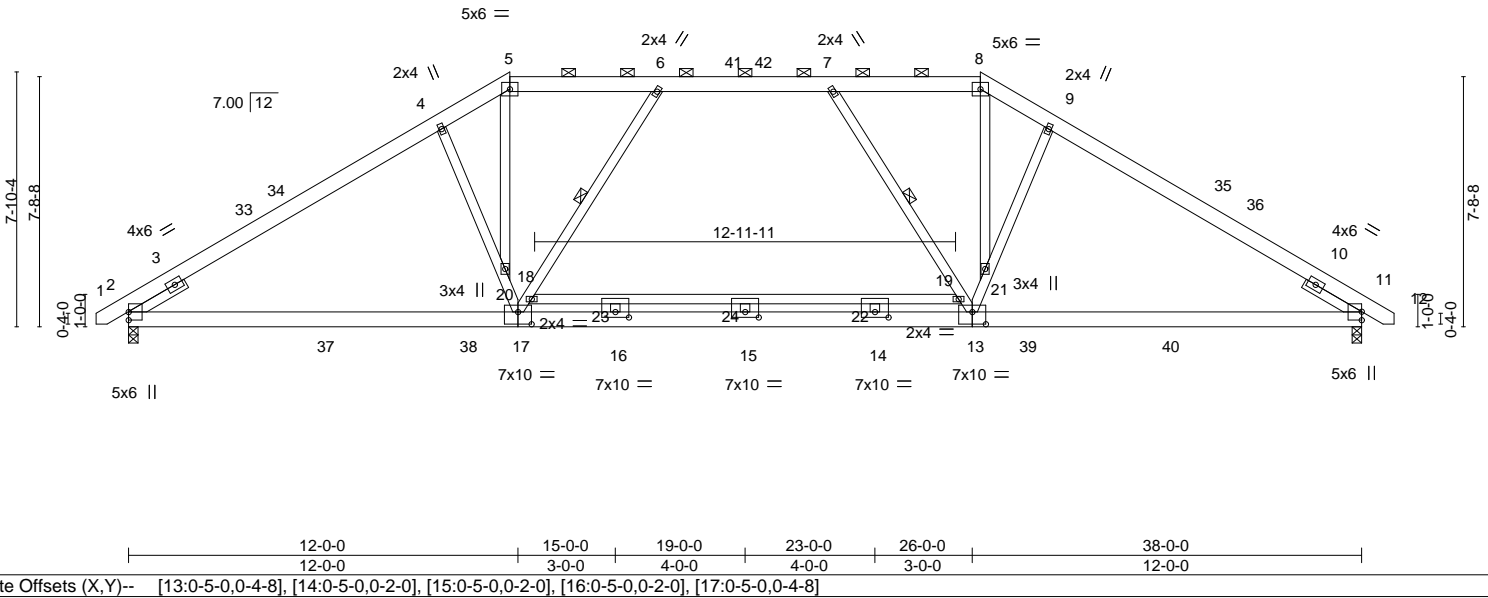

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.52	Vert(LL)	-0.19	15	>999	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.81	Vert(CT)	-0.42	15	>999		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.79	Horz(CT)	0.06	11	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MS	Wind(LL)	0.08	17-27	>999		
								Weight: 279 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.2	TOP CHORD Structural wood sheathing directly applied or 4-2-12 oc purlins, except
BOT CHORD 2x6 SP No.2	2-0-0 oc purlins (5-0-9 max.): 5-8.
WEBS 2x4 SP No.2 *Except*	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
5-18,8-19,14-22,16-23,15-24: 2x4 SP No.3	WEBS 1 Row at midpt 7-13, 6-17
SLIDER Left 2x4 SP No.3 1-11-12, Right 2x4 SP No.3 1-11-12	

REACTIONS. (size) 2=0-3-8, 11=0-3-8
Max Horz 2=-143(LC 10)
Max Grav 2=1570(LC 1), 11=1570(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-961/0, 3-33=-2227/121, 33-34=-2119/127, 4-34=-2092/154, 4-5=-2052/193,
8-9=-2052/193, 9-35=-2092/154, 35-36=-2119/127, 10-36=-2227/121, 10-11=-961/0,
5-6=-1769/160, 6-41=-1947/210, 41-42=-1947/210, 7-42=-1947/210, 7-8=-1769/160
BOT CHORD 2-37=-21/1807, 37-38=-21/1807, 17-38=-21/1807, 16-17=0/1835, 15-16=0/1835,
14-15=0/1835, 13-14=0/1835, 13-39=-25/1807, 39-40=-25/1807, 11-40=-25/1807
WEBS 7-21=-472/216, 13-21=-427/205, 13-19=-29/641, 9-19=-257/224, 17-20=-427/207,
6-20=-472/216, 4-18=-256/223, 17-18=-29/641, 5-18=-77/722, 8-19=-77/722

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-10-0 to 3-11-10, Interior(1) 3-11-10 to 11-9-0, Exterior(2) 11-9-0 to 18-6-7, Interior(1) 18-6-7 to 26-3-0, Exterior(2) 26-3-0 to 33-0-7, Interior(1) 33-0-7 to 38-10-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 6) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 7) N/A
 - 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S)
1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-5=-60, 8-12=-60, 25-29=-20, 5-8=-60



September 30, 2022

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MITek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	MATTAMY/DALTON/FRENCH COUNTRY	IS4477010
MASTER_FRENCH_COUNTRY	A07	COMMON	1	1	Job Reference (optional)	

Builders FirstSource, Apex, NC 27523

8.530 s May 26 2022 MiTek Industries, Inc. Thu Sep 29 16:44:48 2022 Page 2
ID:3TtRaskrdZOKr4jVkpPWDepyhbiip25U6KkCw6ldgKYZDLcw5vUBfnFWcJnLFSZeBEyYj_j

LOAD CASE(S)

- 2) Dead + 0.75 Roof Live (balanced) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-5=-50, 8-12=-50, 25-37=-20, 37-38=-50, 38-39=-20, 39-40=-50, 29-40=-20, 5-8=-50
- 3) Dead + Uninhabitable Attic Without Storage: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-5=-20, 8-12=-20, 25-29=-40, 5-8=-20
- 4) Dead + 0.6 C-C Wind (Pos. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=32, 2-33=17, 5-33=12, 8-35=17, 11-35=12, 11-12=8, 25-29=-12, 5-41=20, 8-41=15
Horz: 1-2=-44, 2-33=-29, 5-33=-24, 8-35=29, 11-35=24, 11-12=20
Drag: 5-6=0, 7-8=0
- 5) Dead + 0.6 C-C Wind (Pos. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=8, 2-34=12, 5-34=17, 8-36=12, 11-36=17, 11-12=32, 25-29=-12, 5-42=15, 8-42=20
Horz: 1-2=-20, 2-34=-24, 5-34=-29, 8-36=24, 11-36=29, 11-12=44
Drag: 5-6=0, 7-8=0
- 6) Dead + 0.6 C-C Wind (Neg. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-0, 2-5=-44, 8-11=-44, 11-12=-40, 25-29=-20, 5-8=-29
Horz: 1-2=-20, 2-5=24, 8-11=-24, 11-12=-20
Drag: 5-6=0, 7-8=0
- 7) Dead + 0.6 C-C Wind (Neg. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-40, 2-5=-44, 8-11=-44, 11-12=-0, 25-29=-20, 5-8=-29
Horz: 1-2=20, 2-5=24, 8-11=-24, 11-12=20
Drag: 5-6=0, 7-8=0
- 8) Dead + 0.6 MWFRS Wind (Pos. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-4, 2-5=-14, 8-11=5, 11-12=1, 25-29=-12, 5-8=19
Horz: 1-2=-8, 2-5=2, 8-11=17, 11-12=13
Drag: 5-6=0, 7-8=0
- 9) Dead + 0.6 MWFRS Wind (Pos. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=1, 2-5=5, 8-11=-14, 11-12=-4, 25-29=-12, 5-8=19
Horz: 1-2=-13, 2-5=-17, 8-11=-2, 11-12=8
Drag: 5-6=0, 7-8=0
- 10) Dead + 0.6 MWFRS Wind (Neg. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-27, 2-5=-31, 8-11=-11, 11-12=-7, 25-29=-20, 5-8=2
Horz: 1-2=7, 2-5=11, 8-11=9, 11-12=13
Drag: 5-6=0, 7-8=0
- 11) Dead + 0.6 MWFRS Wind (Neg. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-7, 2-5=-11, 8-11=-31, 11-12=-27, 25-29=-20, 5-8=2
Horz: 1-2=-13, 2-5=-9, 8-11=-11, 11-12=-7
Drag: 5-6=0, 7-8=0
- 12) Dead + 0.6 MWFRS Wind (Pos. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=14, 2-4=19, 4-5=9, 8-11=2, 11-12=-3, 25-29=-12, 5-8=2
Horz: 1-2=-26, 2-4=-31, 4-5=-21, 8-11=14, 11-12=9
Drag: 5-6=0, 7-8=0
- 13) Dead + 0.6 MWFRS Wind (Pos. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-3, 2-5=2, 8-9=9, 9-11=19, 11-12=14, 25-29=-12, 5-8=2
Horz: 1-2=-9, 2-5=-14, 8-9=21, 9-11=31, 11-12=26
Drag: 5-6=0, 7-8=0
- 14) Dead + 0.6 MWFRS Wind (Pos. Internal) 3rd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=5, 2-5=9, 8-11=2, 11-12=-3, 25-29=-12, 5-8=2
Horz: 1-2=-17, 2-5=-21, 8-11=14, 11-12=9
Drag: 5-6=0, 7-8=0
- 15) Dead + 0.6 MWFRS Wind (Pos. Internal) 4th Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-3, 2-5=2, 8-11=9, 11-12=5, 25-29=-12, 5-8=2
Horz: 1-2=-9, 2-5=-14, 8-11=21, 11-12=17
Drag: 5-6=0, 7-8=0
- 16) Dead + 0.6 MWFRS Wind (Neg. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=6, 2-4=2, 4-5=-7, 8-11=-15, 11-12=-11, 25-29=-20, 5-8=-15
Horz: 1-2=-26, 2-4=-22, 4-5=-13, 8-11=5, 11-12=9
Drag: 5-6=0, 7-8=0
- 17) Dead + 0.6 MWFRS Wind (Neg. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60

Continued on page 3

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	MATTAMY/DALTON/FRENCH COUNTRY	IS4477010
MASTER_FRENCH_COUNTRY	A07	COMMON	1	1	Job Reference (optional)	

Builders FirstSource, Apex, NC 27523

8.530 s May 26 2022 MiTek Industries, Inc. Thu Sep 29 16:44:48 2022 Page 3
 ID:3TtRaskrdZOKr4jVkpWDepyhbiip25U6KkCw6ldgKYZDLcw5vUBfnFWcJnLFSZeBEyYj_j

LOAD CASE(S)

Uniform Loads (plf)

Vert: 1-2=-11, 2-5=-15, 8-9=-7, 9-11=2, 11-12=6, 25-29=-20, 5-8=-15

Horz: 1-2=-9, 2-5=-5, 8-9=13, 9-11=22, 11-12=26

Drag: 5-6=0, 7-8=0

18) Dead + Uninhabitable Attic Storage: Lumber Increase=1.25, Plate Increase=1.25

Uniform Loads (plf)

Vert: 1-5=-20, 8-12=-20, 25-37=-20, 37-38=-60, 38-39=-20, 39-40=-60, 29-40=-20, 5-8=-20

19) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) Left): Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 1-2=-55, 2-5=-58, 8-11=-44, 11-12=-40, 25-37=-20, 37-38=-50, 38-39=-20, 39-40=-50, 29-40=-20, 5-8=-34

Horz: 1-2=5, 2-5=8, 8-11=6, 11-12=10

Drag: 5-6=0, 7-8=0

20) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) Right): Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 1-2=-40, 2-5=-44, 8-11=-58, 11-12=-55, 25-37=-20, 37-38=-50, 38-39=-20, 39-40=-50, 29-40=-20, 5-8=-34

Horz: 1-2=-10, 2-5=-6, 8-11=-8, 11-12=-5

Drag: 5-6=0, 7-8=0

21) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 1-2=-30, 2-4=-34, 4-5=-41, 8-11=-46, 11-12=-43, 25-37=-20, 37-38=-50, 38-39=-20, 39-40=-50, 29-40=-20, 5-8=-46

Horz: 1-2=-20, 2-4=-16, 4-5=-9, 8-11=4, 11-12=7

Drag: 5-6=0, 7-8=0

22) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 1-2=-43, 2-5=-46, 8-9=-41, 9-11=-34, 11-12=-30, 25-37=-20, 37-38=-50, 38-39=-20, 39-40=-50, 29-40=-20, 5-8=-46

Horz: 1-2=-7, 2-5=-4, 8-9=9, 9-11=16, 11-12=20

Drag: 5-6=0, 7-8=0

23) 1st Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-5=-60, 8-12=-20, 25-29=-20, 5-8=-60

24) 2nd Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-5=-20, 8-12=-60, 25-29=-20, 5-8=-60

25) 3rd Dead + 0.75 Roof Live (unbalanced) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-5=-50, 8-12=-20, 25-37=-20, 37-38=-50, 38-39=-20, 39-40=-50, 29-40=-20, 5-8=-50

26) 4th Dead + 0.75 Roof Live (unbalanced) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-5=-20, 8-12=-50, 25-37=-20, 37-38=-50, 38-39=-20, 39-40=-50, 29-40=-20, 5-8=-50

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	MATTAMY/DALTON/FRENCH COUNTRY	154477011
MASTER_FRENCH_COUNTR	1X08	HIP	1	1	Job Reference (optional)	

Builders FirstSource (Apex, NC),

Apex, NC - 27523,

8.530 s Aug 11 2022 MiTek Industries, Inc. Thu Sep 29 15:30:38 2022 Page 1

ID:3TtRaskrdZOKr4jVkpPWDepyhbi-IEA523TxiuMQclj4Cwn83kAfTySoyoqL_7b909yYk4F



Scale = 1:70.9

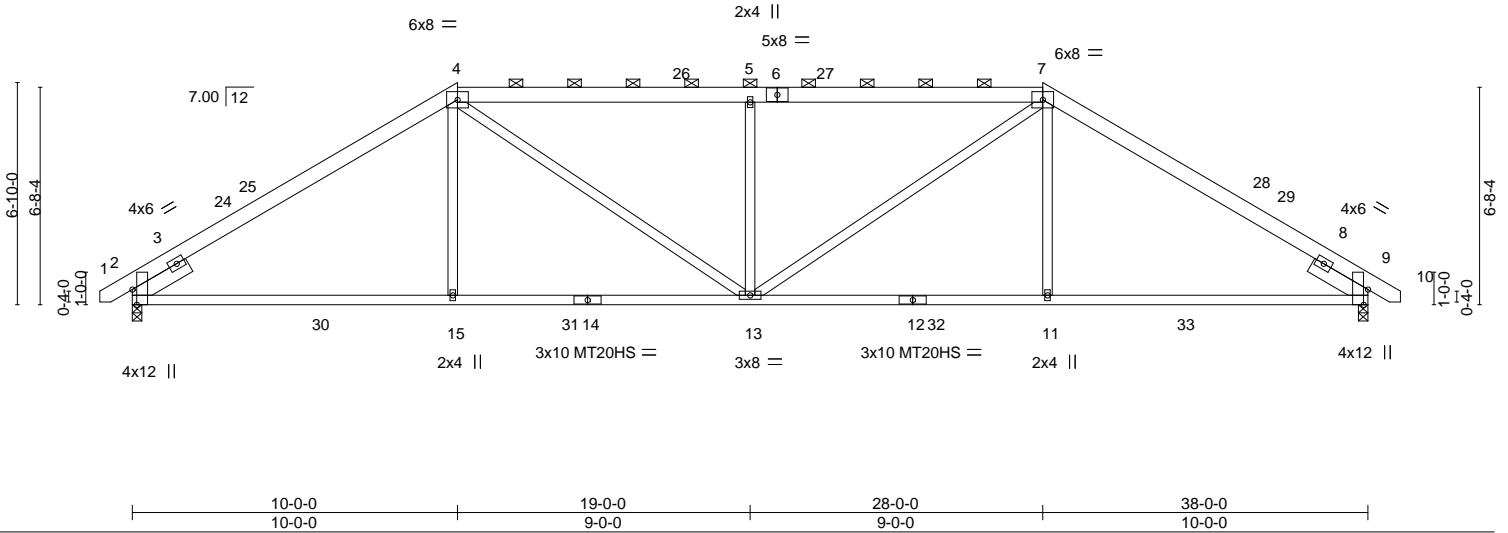



Plate Offsets (X,Y)--	[2:0-5-10,Edge], [9:0-5-10,Edge]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.72	Vert(LL) -0.18 11-13 >999 360	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.85	Vert(CT) -0.37 11-13 >999 240	MT20HS	187/143
BCLL 0.0 *	Rep Stress Incr YES	WB 0.49	Horz(CT) 0.12 9 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-MS	Wind(LL) 0.11 11-13 >999 240	Weight: 227 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.2	TOP CHORD Structural wood sheathing directly applied or 3-3-7 oc purlins, except 2-0-0 oc purlins (4-2-15 max.): 4-7.
BOT CHORD 2x4 SP No.1 *Except* 12-14: 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	
SLIDER Left 2x6 SP No.2 1-11-12, Right 2x6 SP No.2 1-11-12	

REACTIONS. (size) 2=0-3-8, 9=0-3-8
 Max Horz 2=123(LC 11)
 Max Uplift 2=-71(LC 12), 9=-71(LC 13)
 Max Grav 2=1602(LC 2), 9=1602(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-4=-2344/148, 4-5=-2439/200, 5-7=-2439/200, 7-9=-2344/148
 BOT CHORD 2-15=-47/1922, 13-15=-50/1913, 11-13=-9/1913, 9-11=-7/1922
 WEBS 4-15=0/437, 7-11=0/437, 5-13=-644/208, 4-13=-163/829, 7-13=-163/829

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) 0-10-0 to 3-11-10, Interior(1) 3-11-10 to 10-0-0, Exterior(2) 10-0-0 to 16-9-7, Interior(1) 16-9-7 to 28-0-0, Exterior(2) 28-0-0 to 34-9-7, Interior(1) 34-9-7 to 38-10-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) All plates are MT20 plates unless otherwise indicated.
 - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 9.
 - 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.




September 30, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ENGINEERING BY
TRENCO
 A MiTek Affiliate
 818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	MATTAMY/DALTON/FRENCH COUNTRY	154477012
MASTER_FRENCH_COUNTR	409	HIP	1	1		

Builders FirstSource (Apex, NC), Apex, NC - 27523, 8.530 s Aug 11 2022 MiTek Industries, Inc. Thu Sep 29 15:30:40 2022 Page 1
 ID:3TtRaskrdZOKr4jVkpWDepyhbiidlsTIUBPKc7sctTKLqc89FyMm7YQideRR4G42yYk4D



Scale = 1:70.9

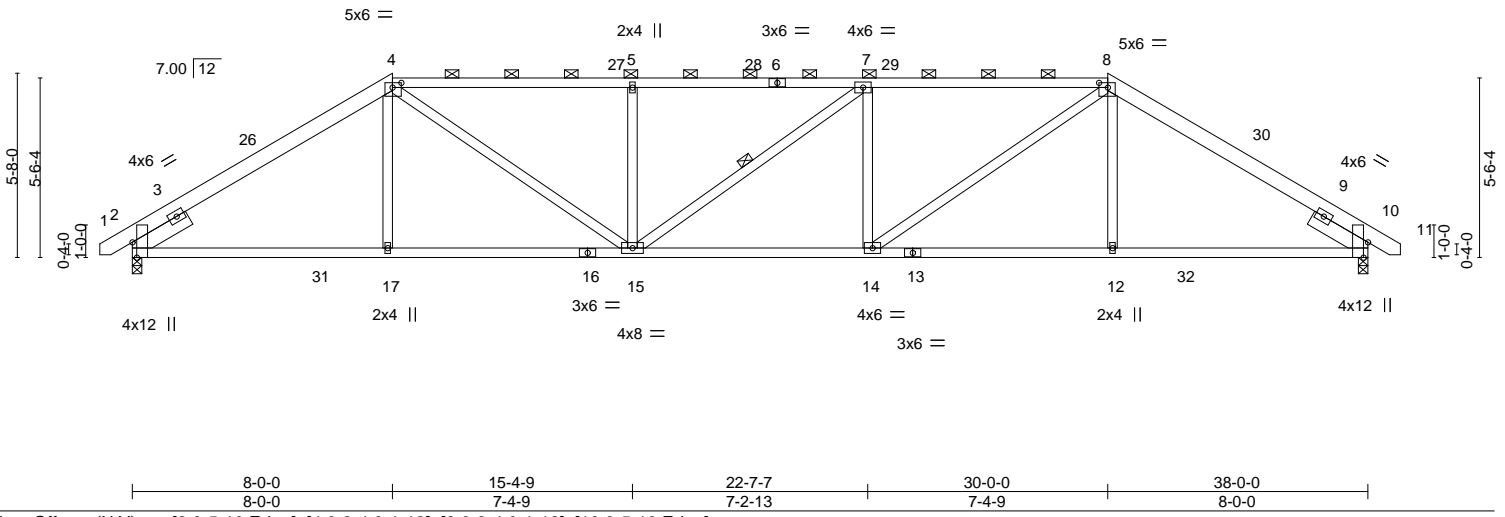


Plate Offsets (X, Y)--	[2:0-5-10,Edge], [4:0-3-4,0-1-12], [8:0-3-4,0-1-12], [10:0-5-10,Edge]
------------------------	---

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.95	Vert(LL)	-0.17	14-15	>999	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.89	Vert(CT)	-0.38	15-17	>999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.47	Horz(CT)	0.14	10	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MS	Wind(LL)	0.13	12-14	>999	Weight: 216 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.2 *Except* 4-6,6-8: 2x4 SP No.1	TOP CHORD Structural wood sheathing directly applied or 3-2-15 oc purlins, except
BOT CHORD 2x4 SP No.2	2-0-0 oc purlins (2-2-0 max.): 4-8.
WEBS 2x4 SP No.3	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
SLIDER Left 2x6 SP No.2 1-11-12, Right 2x6 SP No.2 1-11-12	WEBS 1 Row at midpt 7-15

REACTIONS. (size) 2=0-3-8, 10=0-3-8
 Max Horz 2=101(LC 11)
 Max Uplift 2=-73(LC 12), 10=-73(LC 13)
 Max Grav 2=1570(LC 1), 10=1570(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-4=-2284/147, 4-5=-2729/206, 5-7=-2729/206, 7-8=-2729/206, 8-10=-2284/147
 BOT CHORD 2-17=-87/1865, 15-17=-90/1861, 14-15=-104/2729, 12-14=-20/1861, 10-12=-17/1865
 WEBS 4-17=0/278, 4-15=-150/1138, 5-15=-471/150, 7-14=-501/172, 8-14=-151/1138, 8-12=0/278

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-10-0 to 3-11-10, Interior(1) 3-11-10 to 8-0-0, Exterior(2) 8-0-0 to 14-9-7, Interior(1) 14-9-7 to 30-0-0, Exterior(2) 30-0-0 to 36-9-7, Interior(1) 36-9-7 to 38-10-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 10.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



September 30, 2022


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ENGINEERING BY
TRENCO
 A MiTek Affiliate
 818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	MATTAMY/DALTON/FRENCH COUNTRY	154477013
MASTER_FRENCH_COUNTR	1X10	HIP	1	1	Job Reference (optional)	

Builders FirstSource (Apex, NC), Apex, NC - 27523, 8.530 s Aug 11 2022 MiTek Industries, Inc. Thu Sep 29 15:30:41 2022 Page 1

ID:3T1RaskrdZOKr4jVkpWDepyhbi-APrEg5VpAdk_TmStt2LrhNoAnAUa92qng5qqdUyYk4C



Scale = 1:70.6


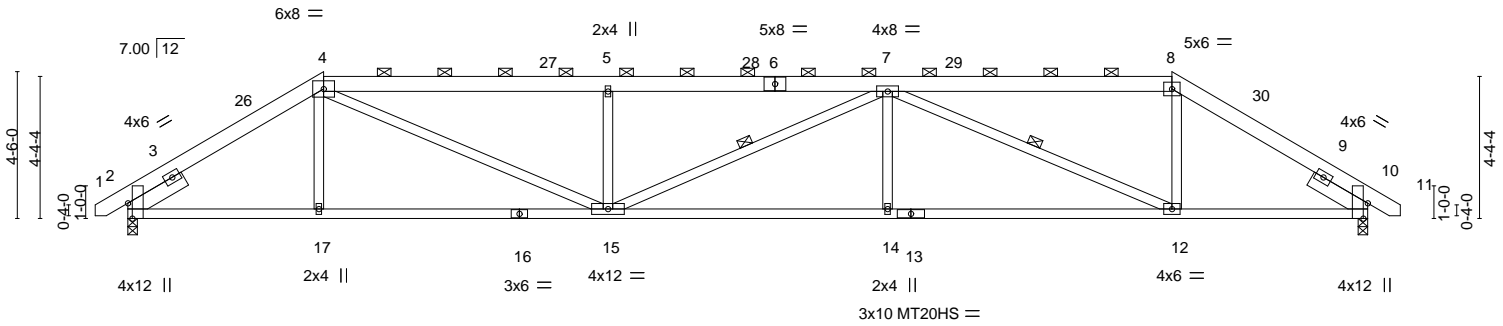


Plate Offsets (X,Y)--	[2:0-5-10,Edge], [10:0-5-10,Edge]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.72	Vert(LL) -0.25 14-15 >999 360	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.78	Vert(CT) -0.54 14-15 >841 240	MT20HS	187/143
BCLL 0.0 *	Rep Stress Incr YES	WB 0.92	Horz(CT) 0.15 10 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-MS	Wind(LL) 0.18 14-15 >999 240	Weight: 228 lb	FT = 20%


LUMBER-
 TOP CHORD 2x6 SP No.2
 BOT CHORD 2x4 SP No.1
 WEBS 2x4 SP No.3
 SLIDER Left 2x6 SP No.2 1-11-12, Right 2x6 SP No.2 1-11-12

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 3-1-13 oc purlins, except 2-0-0 oc purlins (2-11-6 max.): 4-8.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
 WEBS 1 Row at midpt 7-15, 7-12

REACTIONS. (size) 2=0-3-8, 10=0-3-8
 Max Horz 2=77(LC 11)
 Max Uplift 2=-75(LC 12), 10=-75(LC 13)
 Max Grav 2=1570(LC 1), 10=1570(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-4=-2348/142, 4-5=-3569/229, 5-7=-3567/228, 7-8=-1908/153, 8-10=-2351/142
 BOT CHORD 2-17=-115/1935, 15-17=-119/1931, 14-15=-207/3559, 12-14=-207/3559, 10-12=-45/1938
 WEBS 4-17=0/268, 4-15=-202/1858, 5-15=-579/177, 7-14=0/357, 7-12=-1869/205, 8-12=0/864

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-10-0 to 3-11-10, Interior(1) 3-11-10 to 6-0-0, Exterior(2) 6-0-0 to 12-9-7, Interior(1) 12-9-7 to 32-0-0, Exterior(2) 32-0-0 to 38-10-0 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - All plates are MT20 plates unless otherwise indicated.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 10.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

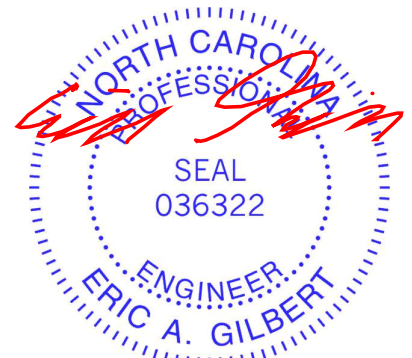

September 30, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	MATTAMY/DALTON/FRENCH COUNTRY	154477014
MASTER_FRENCH_COUNTRY	11GR	HIP	1	1		


Builders FirstSource (Apex, NC), Apex, NC - 27523,

8.530 s Aug 11 2022 MiTek Industries, Inc. Thu Sep 29 15:30:43 2022 Page 1

ID:3TtRaskrdZOKr4jVkpWDepyhbi-6Bz_5mX4iF_ij3b2?TNjmotXNzAFd_747PjwhMyYk4A



Scale = 1:67.9

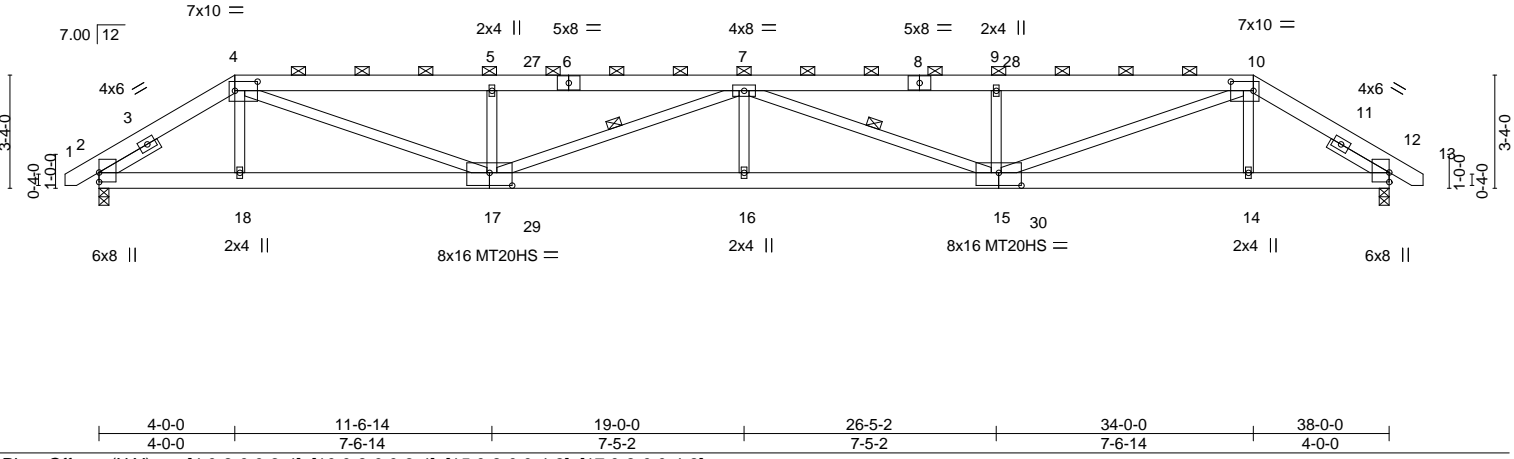

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	20.0	Plate Grip DOL	2-0-0	TC	0.65	Vert(LL)	-0.49 16-17 >932 360	MT20	244/190		
TCDL	10.0	Lumber DOL	1.15	BC	0.83	Vert(CT)	-0.98 16-17 >463 240	MT20HS	187/143		
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.81	Horz(CT)	0.14 12 n/a n/a			Weight: 255 lb	FT = 20%
BCDL	10.0	Code IRC2015/TPI2014		Matrix-MS		Wind(LL)	0.37 16-17 >999 240				

LUMBER-
TOP CHORD 2x6 SP DSS *Except*
 1-4,10-13: 2x6 SP No.2
BOT CHORD 2x6 SP DSS
WEBS 2x4 SP No.2 *Except*
 4-17,7-17,7-15,10-15: 2x4 SP No.1
SLIDER Left 2x4 SP No.2 1-11-12, Right 2x4 SP No.2 1-11-12


BRACING-
TOP CHORD Structural wood sheathing directly applied or 3-1-0 oc purlins, except 2-0-0 oc purlins (2-9-12 max.): 4-10.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 7-17, 7-15

REACTIONS. (size) 12=0-3-8, 2=0-3-8
 Max Horz 2=-56(LC 6)
 Max Uplift 12=-146(LC 9), 2=-144(LC 8)
 Max Grav 12=2388(LC 1), 2=2360(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-4=-3591/259, 4-5=-7533/605, 5-7=-7547/609, 7-9=-7611/614, 9-10=-7597/610,
 10-12=-3656/265
BOT CHORD 2-18=-231/2985, 17-18=-226/2980, 16-17=-703/8873, 15-16=-703/8873, 14-15=-182/3034,
 12-14=-187/3038
WEBS 4-17=-447/4905, 5-17=-538/161, 7-17=-1441/177, 7-16=0/444, 7-15=-1372/171,
 9-15=-555/162, 10-15=-449/4916

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - All plates are MT20 plates unless otherwise indicated.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 12=146, 2=144.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 577 lb down and 49 lb up at 12-8-0, and 577 lb down and 49 lb up at 26-0-0 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
 - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

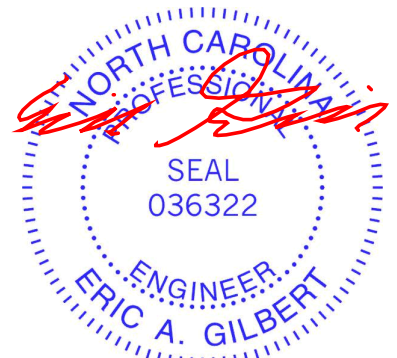

September 30, 2022

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	MATTAMY/DALTON/FRENCH COUNTRY	I54477014
MASTER_FRENCH_COUNTRY	K11GR	HIP	1	1	Job Reference (optional)	

Builders FirstSource (Apex, NC), Apex, NC - 27523,

8.530 s Aug 11 2022 MiTek Industries, Inc. Thu Sep 29 15:30:43 2022 Page 2
 ID:3TtRaskrdZOKr4jVkpWDepyhii-6Bz_5mX4iF_ij3b2?TNJmotXNzAFd_?47PJwhMyYk4A

LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-4=-60, 4-27=-60, 27-28=-86(F=-26), 10-28=-60, 10-13=-60, 23-29=-20, 29-30=-29(F=-8), 19-30=-20

Concentrated Loads (lb)

Vert: 29=-577(F) 30=-577(F)

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	MATTAMY/DALTON/FRENCH COUNTRY	I54477015
MASTER_FRENCH_COUNTRY	12	MONO TRUSS	6	1		

Builders FirstSource (Apex, NC), Apex, NC - 27523,

8.530 s Aug 11 2022 MiTek Industries, Inc. Thu Sep 29 15:30:43 2022 Page 1
 ID:3TtRaskrdZOKr4jVkpWDEpyhbii-6Bz_5mX4iF_ij3b2?TNJmotf1zLHdAj47PjwhMyYk4A

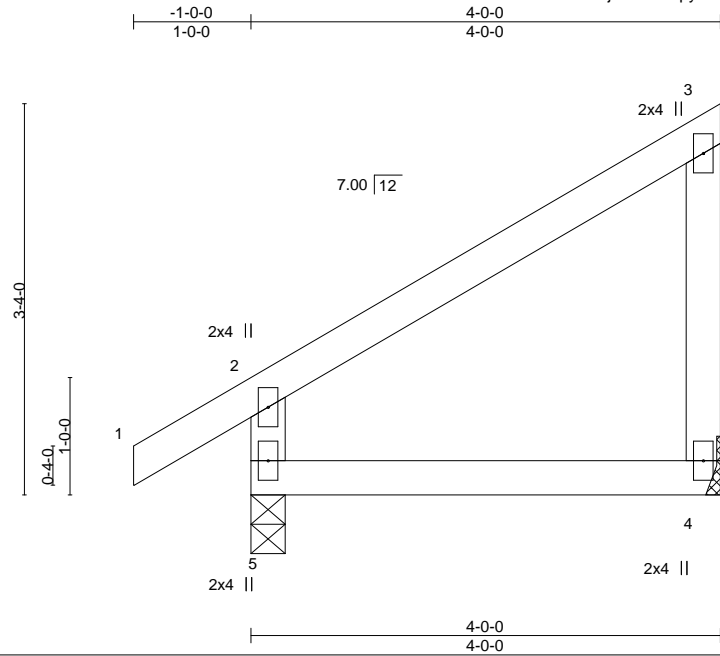

Scale = 1:19.6

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.16	Vert(LL)	-0.01 4-5	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.12	Vert(CT)	-0.02 4-5	>999	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00 4	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MR	Wind(LL)	0.00 4-5	>999	240	Weight: 20 lb	FT = 20%


LUMBER-
 TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 WEBS 2x4 SP No.3

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 4-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 5=0-3-8, 4=Mechanical
 Max Horz 5=96(LC 11)
 Max Uplift 5=-14(LC 12), 4=-27(LC 12)
 Max Grav 5=227(LC 1), 4=153(LC 19)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 4.

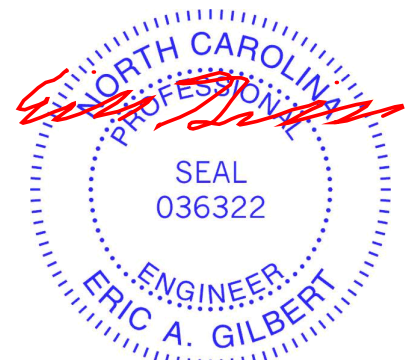

September 30, 2022


Job	Truss	Truss Type	Qty	Ply	MATTAMY/DALTON/FRENCH COUNTRY
MASTER_FRENCH_COUNTRY	13GR	MONO TRUSS	2	1	I54477016
					Job Reference (optional)

Builders FirstSource (Apex, NC),

Apex, NC - 27523,

8.530 s Aug 11 2022 MiTek Industries, Inc. Thu Sep 29 15:30:44 2022 Page 1

ID:3TtRaskrdZOKr4jVkpWDepyhbi-aOXNi6YiTY6ZKDAEZAuYJ?QpkNc0MdzEM22UDpyYk49

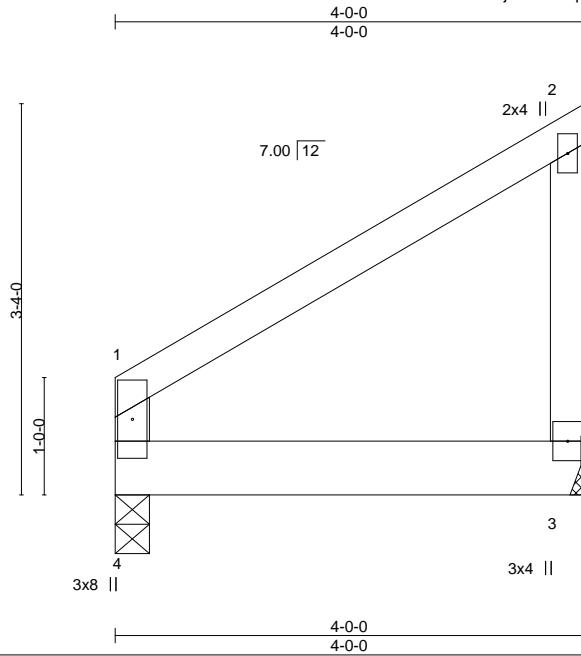

Scale = 1:19.6

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.22	Vert(LL)	-0.01	3-4	>999	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.41	Vert(CT)	-0.03	3-4	>999		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.00	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Rep Stress Incr NO	Matrix-MR	Wind(LL)	0.01	3-4	>999		
	Code IRC2015/TPI2014						Weight: 21 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SP No.2
 BOT CHORD 2x6 SP No.2
 WEBS 2x4 SP No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 4-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 4=0-3-8, 3=Mechanical
 Max Horz 4=85(LC 5)
 Max Uplift 4=31(LC 8), 3=60(LC 8)
 Max Grav 4=558(LC 16), 3=577(LC 15)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 3.
- 6) Girder carries tie-in span(s): 12-8-0 from 0-0-0 to 4-0-0
- 7) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 3-4=-228(F=-208), 1-2=-60



September 30, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	MATTAMY/DALTON/FRENCH COUNTRY	154477017
MASTER_FRENCH_COUNTRY	01G	GABLE	1	1		

Builders FirstSource (Apex, NC), Apex, NC - 27523,

8.530 s Aug 11 2022 MiTek Industries, Inc. Thu Sep 29 15:30:45 2022 Page 1
 ID:3TtRaskrdZOKr4jVkpWDepyhii-2a5IWSYKESQyNIQ6uQnrDz0Nn2154YNbio1mFyYk48



Scale = 1:27.7

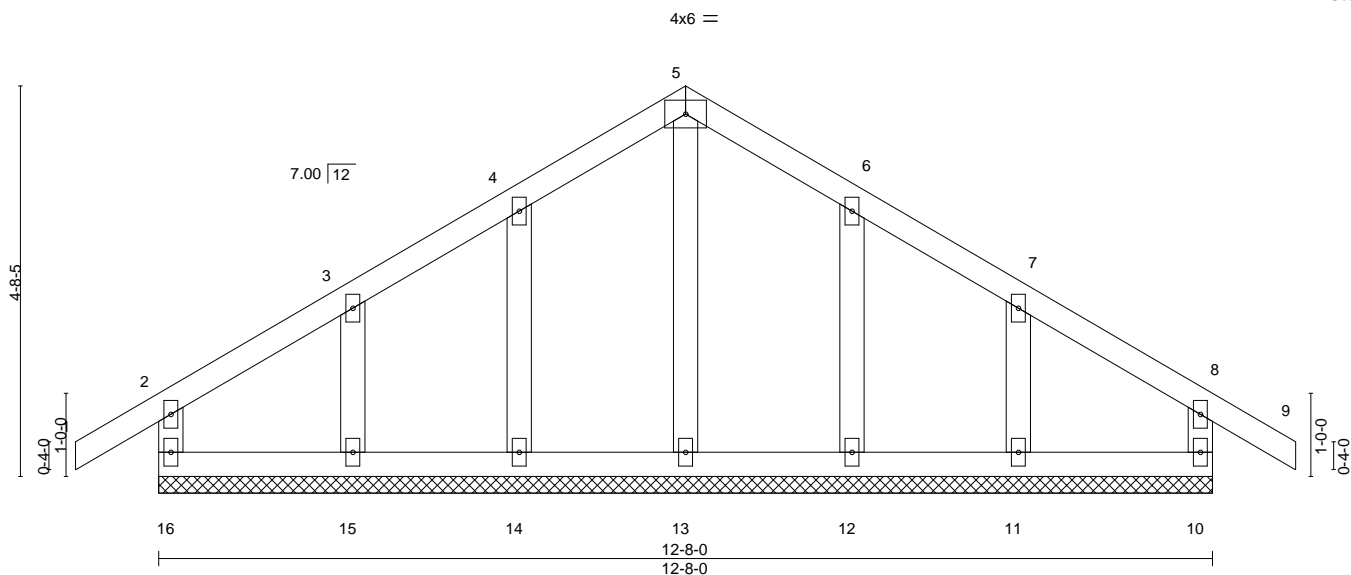

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.10	Vert(LL)	-0.00	9	n/r	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.04	Vert(CT)	-0.00	9	n/r		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.04	Horz(CT)	0.00	10	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-R					Weight: 67 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 WEBS 2x4 SP No.3
 OTHERS 2x4 SP No.3

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS. All bearings 12-8-0.
 (lb) - Max Horz 16=107(LC 11)
 Max Uplift All uplift 100 lb or less at joint(s) 16, 10, 14, 15, 12, 11
 Max Grav All reactions 250 lb or less at joint(s) 16, 10, 13, 14, 15, 12, 11

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) -0-11-15 to 3-9-10, Exterior(2) 3-9-10 to 6-4-0, Corner(3) 6-4-0 to 11-1-10, Exterior(2) 11-1-10 to 13-7-15 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 16, 10, 14, 15, 12, 11.




September 30, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ENGINEERING BY
TRENCO
 A MiTek Affiliate
 818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	MATTAMY/DALTON/FRENCH COUNTRY	154477018
MASTER_FRENCH_COUNTRY	002	COMMON	3	1		

Builders FirstSource (Apex, NC), Apex, NC - 27523, 8.530 s Aug 11 2022 MiTek Industries, Inc. Thu Sep 29 15:30:46 2022 Page 1
 ID:3TtRaskrdZOKr4jVkpWDepyhbi-Wmf7joZy?AMHaXKcgbx00QV0MBJ8qWzXpMXalhyYk47

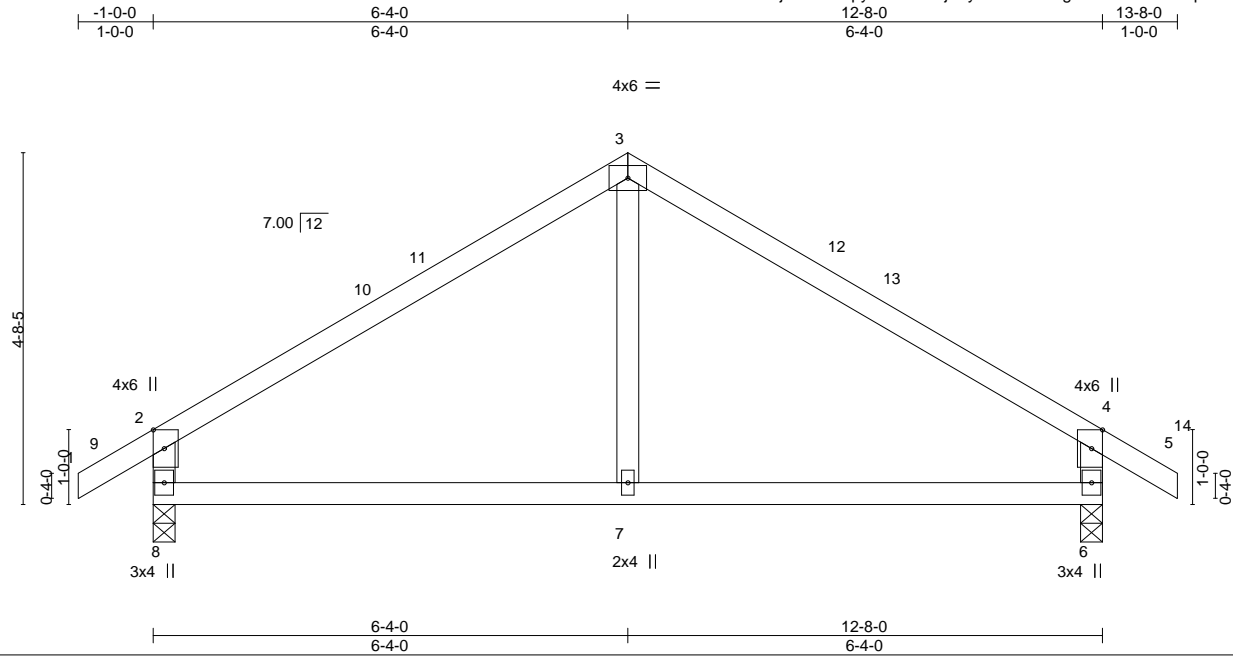

Scale = 1:30.7

Plate Offsets (X, Y)--	[2:0-3-0,Edge], [4:0-3-0,Edge]
------------------------	--------------------------------

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.79	Vert(LL)	-0.04	6-7	>999	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.30	Vert(CT)	-0.08	6-7	>999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.10	Horz(CT)	0.01	6	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MR	Wind(LL)	-0.02	7-8	>999	Weight: 52 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	

REACTIONS. (size) 8=0-3-8, 6=0-3-8
 Max Horz 8=107(LC 11)
 Max Uplift 8=-27(LC 12), 6=-27(LC 13)
 Max Grav 8=564(LC 1), 6=564(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-8=-497/115, 2-3=-536/67, 3-4=-536/67, 4-6=-497/115
 BOT CHORD 7-8=0/370, 6-7=0/370
 WEBS 3-7=0/253


- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-11-15 to 3-9-10, Interior(1) 3-9-10 to 6-4-0, Exterior(2) 6-4-0 to 13-1-7, Interior(1) 13-1-7 to 13-7-15 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 8, 6.



September 30, 2022

Job	Truss	Truss Type	Qty	Ply	MATTAMY/DALTON/FRENCH COUNTRY	154477019
MASTER_FRENCH_COUNTRY	303	COMMON	2	1		
Builders FirstSource (Apex, NC), Apex, NC - 27523,						Job Reference (optional)

8.530 s Aug 11 2022 MiTek Industries, Inc. Thu Sep 29 15:30:47 2022 Page 1
 ID:3TtRaskrdZOKr4jVkpPWDePyhbii-7zDVx8aamTU8BhvpEJSFwe2CVbelZzHg20H8q8yYk46

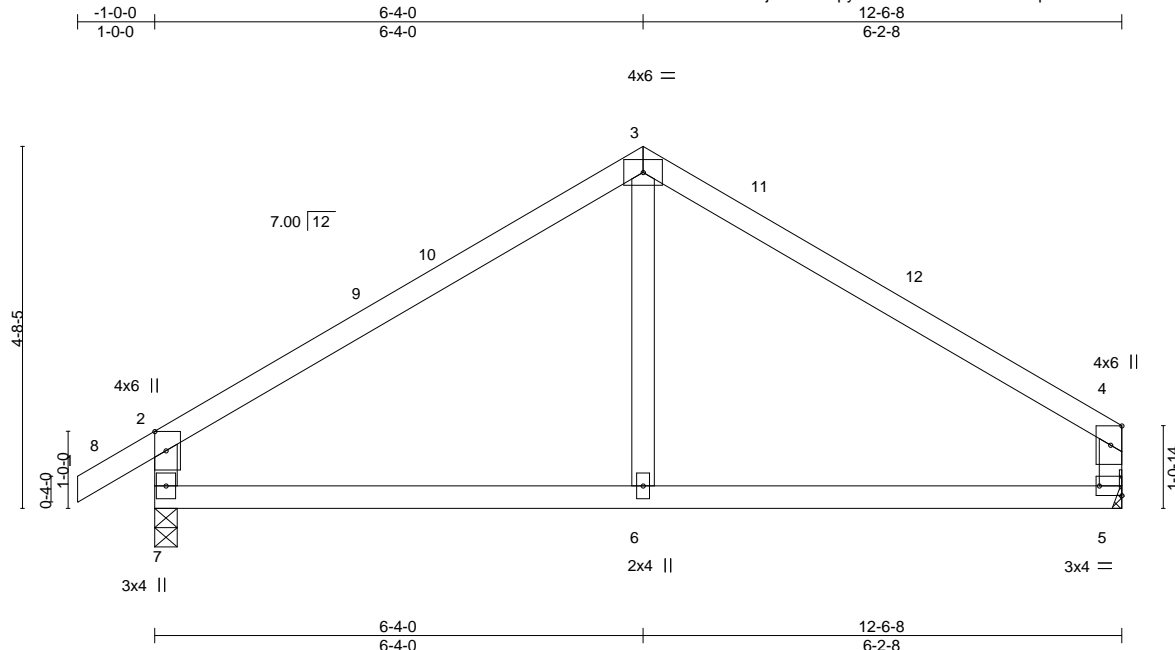

Scale = 1:29.9

Plate Offsets (X, Y)--	[2:0-3-0,Edge], [4:0-3-0,Edge], [5:Edge,0-1-8]
------------------------	--


LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.76	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.34	Vert(LL) -0.04 6-7 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.09	Vert(CT) -0.09 6-7 >999 240		
BCDL 10.0	Rep Stress Incr YES	Matrix-MR	Horz(CT) 0.01 5 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.02 6-7 >999 240	Weight: 50 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	

REACTIONS. (size) 7=0-3-8, 5=Mechanical
 Max Horz 7=103(LC 9)
 Max Uplift 7=-27(LC 12), 5=-10(LC 13)
 Max Grav 7=562(LC 1), 5=487(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-7=-491/115, 2-3=-527/67, 3-4=-520/69, 4-5=-410/76
 BOT CHORD 6-7=-7/363, 5-6=-7/363

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-11-15 to 3-9-10, Interior(1) 3-9-10 to 6-4-0, Exterior(2) 6-4-0 to 12-4-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Refer to girder(s) for truss to truss connections.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 7, 5.



September 30, 2022


Job	Truss	Truss Type	Qty	Ply	MATTAMY/DALTON/FRENCH COUNTRY	154477020
MASTER_FRENCH_COUNTRY	04G	GABLE	1	1	Job Reference (optional)	

Builders FirstSource (Apex, NC),


Apex, NC - 27523,

8.530 s Aug 11 2022 MiTek Industries, Inc. Thu Sep 29 15:30:48 2022 Page 1

ID:3TtRaskrdZOKr4jVkpWDepyhii-T9mt8UbCXnc?prU?o0zUTrbXc_3oIRlpHgOhMayYk45



Scale = 1:26.6

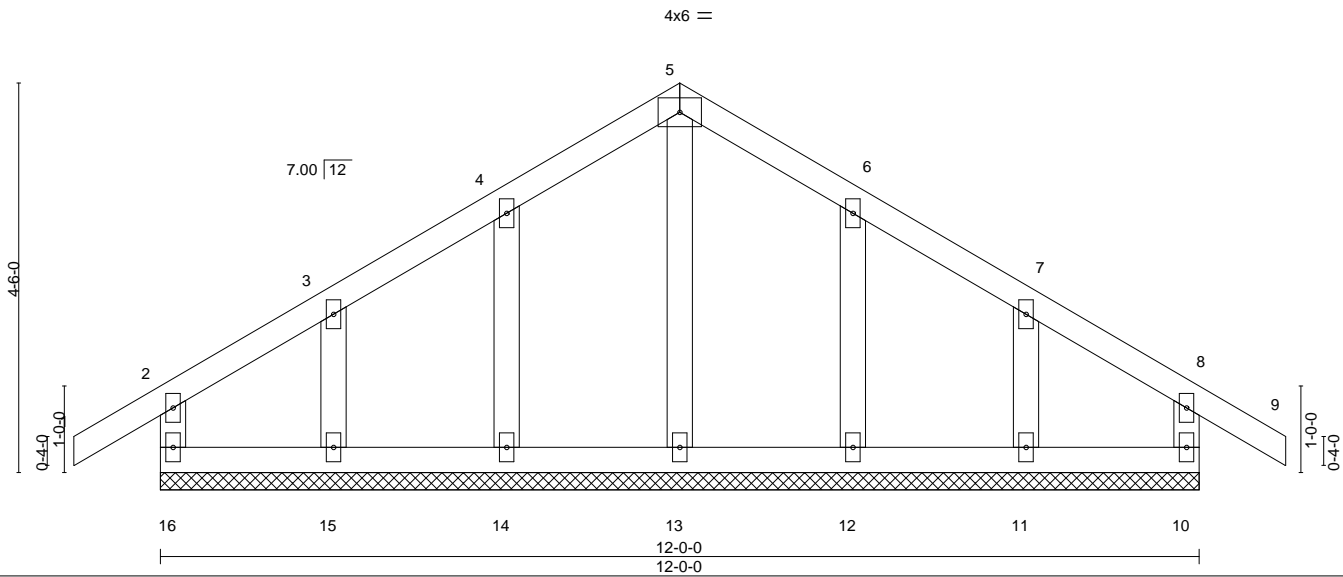


LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.10	Vert(LL)	-0.00	9	n/r	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.04	Vert(CT)	-0.00	9	n/r		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.04	Horz(CT)	0.00	10	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-R					Weight: 63 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3	
OTHERS 2x4 SP No.3	

REACTIONS. All bearings 12-0-0.
 (lb) - Max Horz 16=103(LC 10)
 Max Uplift All uplift 100 lb or less at joint(s) 16, 10, 14, 15, 12, 11
 Max Grav All reactions 250 lb or less at joint(s) 16, 10, 13, 14, 15, 12, 11

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) 0-11-15 to 4-0-0, Exterior(2) 4-0-0 to 6-0-0, Corner(3) 6-0-0 to 10-9-10, Exterior(2) 10-9-10 to 12-11-15 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 16, 10, 14, 15, 12, 11.




September 30, 2022

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	<p>ENGINEERING BY</p> <p>TRENCO</p> <p>A MiTek Affiliate</p> <p>818 Soundside Road Edenton, NC 27932</p>
--	---

Job	Truss	Truss Type	Qty	Ply	MATTAMY/DALTON/FRENCH COUNTRY	154477021
MASTER_FRENCH_COUNTRY	05	COMMON	2	1		

Builders FirstSource (Apex, NC), Apex, NC - 27523, 8.530 s Aug 11 2022 MiTek Industries, Inc. Thu Sep 29 15:30:49 2022 Page 1
 ID:3TtRaskrdZOKr4jvKpWDepyhbi-xLKFMqbqj5ksR_3BLkUj037Z3OKY1stzWKmFvOyYk44

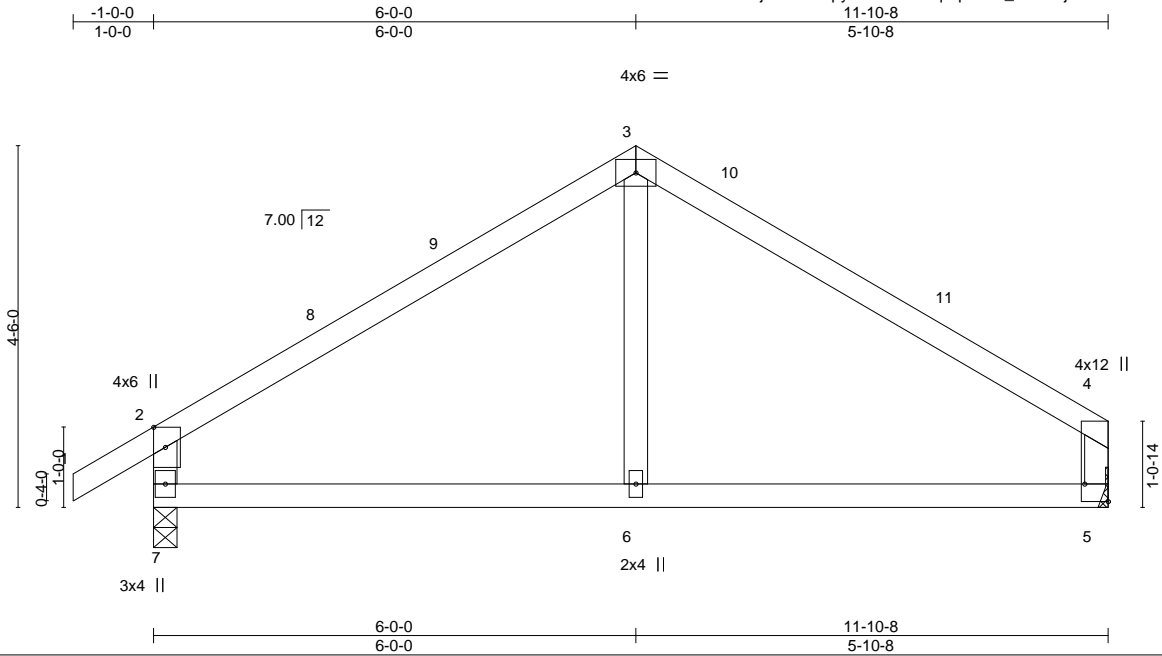

Scale = 1:28.7

Plate Offsets (X,Y)-- [2:0-3-0,Edge], [4:Edge,0-3-8]


LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.70	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.32	Vert(LL) -0.03 6-7 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.09	Vert(CT) -0.08 6-7 >999 240		
BCDL 10.0	Rep Stress Incr YES	Matrix-MR	Horz(CT) 0.01 5 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.02 6-7 >999 240	Weight: 48 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	

REACTIONS. (size) 7=0-3-8, 5=Mechanical
 Max Horz 7=99(LC 9)
 Max Uplift 7=-27(LC 12), 5=-10(LC 13)
 Max Grav 7=535(LC 1), 5=460(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-7=-467/113, 2-3=-492/65, 3-4=-485/67, 4-5=-385/74
 BOT CHORD 6-7=-9/337, 5-6=-9/337

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-11-15 to 3-9-10, Interior(1) 3-9-10 to 6-0-0, Exterior(2) 6-0-0 to 11-8-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Refer to girder(s) for truss to truss connections.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 7, 5.



September 30, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ENGINEERING BY
TRENCO
 A MiTek Affiliate
 818 Soundside Road
 Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	MATTAMY/DALTON/FRENCH COUNTRY	154477022
MASTER_FRENCH_COUNTRY#01		MONO TRUSS	1	1		
					Job Reference (optional)	

Builders FirstSource (Apex, NC),

Apex, NC - 27523,

8.530 s Aug 11 2022 MiTek Industries, Inc. Thu Sep 29 15:30:50 2022 Page 1

ID:3TtRaskrdZOKr4jVkpWDepyhbi-PYueZAcT3Osj28eOvR?yYGgt6olJmKS6k_VoRSyYk43

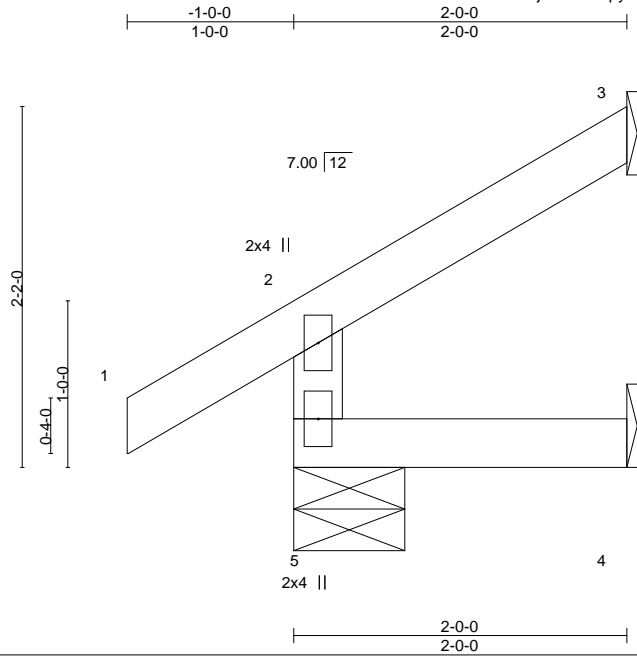

Scale = 1:13.8

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 20.0	Plate Grip DOL	1.15	TC 0.10	Vert(LL)	-0.00	5	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.03	Vert(CT)	-0.00	4-5	>999	240		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.00	Horz(CT)	-0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MR	Wind(LL)	0.00	5	>999	240		
								Weight: 9 lb	FT = 20%	

LUMBER-
 TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 WEBS 2x4 SP No.3


BRACING-
 TOP CHORD Structural wood sheathing directly applied or 2-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 5=0-8-0, 4=Mechanical, 3=Mechanical
 Max Horz 5=39(LC 8)
 Max Uplift 5=3(LC 8), 3=-28(LC 8)
 Max Grav 5=163(LC 1), 4=33(LC 3), 3=42(LC 15)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 3.

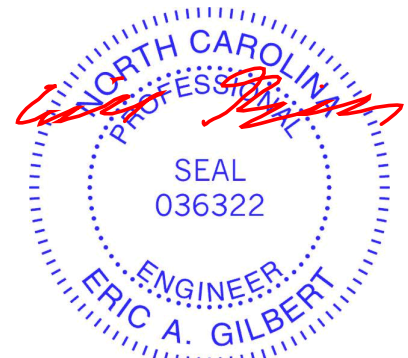

September 30, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	MATTAMY/DALTON/FRENCH COUNTRY
MASTER_FRENCH_COUNTRY#02		MONO TRUSS	1	1	154477023
					Job Reference (optional)

Builders FirstSource (Apex, NC),

Apex, NC - 27523,

8.530 s Aug 11 2022 MiTek Industries, Inc. Thu Sep 29 15:30:50 2022 Page 1

ID:3TtRaskrdZOKr4jVkpWDepyhbi-PYueZAcT3Osj28eOvR?yYGgtJoI8mKS6k_VoRSyYk43

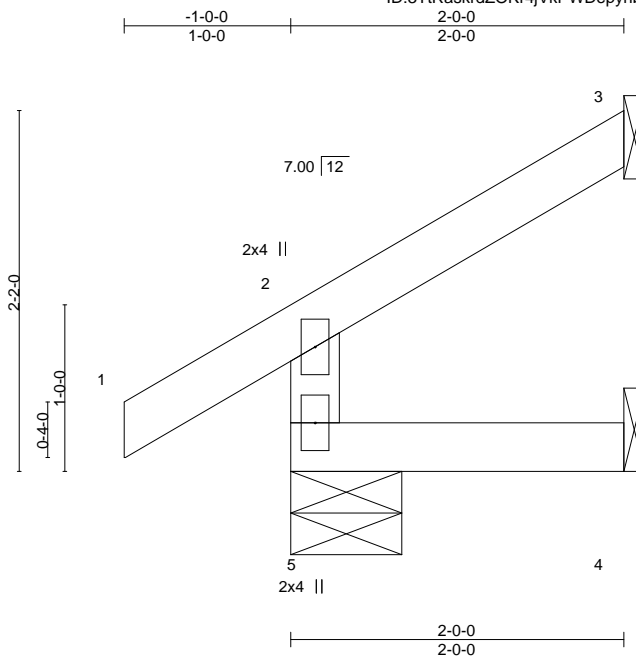

Scale = 1:13.8

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.09	Vert(LL)	-0.00	5	>999	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.04	Vert(CT)	-0.00	4-5	>999		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.00	Horz(CT)	-0.00	3	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-MR	Wind(LL)	0.00	5	>999		
	Code IRC2015/TPI2014						Weight: 9 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

(size) 5=0-8-0, 4=Mechanical, 3=Mechanical
 Max Horz 5=39(LC 12)
 Max Uplift 5=3(LC 12), 3=28(LC 12)
 Max Grav 5=163(LC 1), 4=33(LC 3), 3=42(LC 19)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 3.

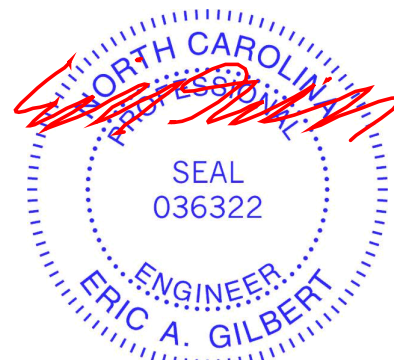

September 30, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	MATTAMY/DALTON/FRENCH COUNTRY	154477024
MASTER_FRENCH_COUNTRY	703GR	JACK	1	1		
Builders FirstSource (Apex, NC), Apex, NC - 27523,						8.530 s Aug 11 2022 MiTek Industries, Inc. Thu Sep 29 15:30:51 2022 Page 1
						ID:3TtRaskrdZOKr4jVkpWDepyhbi-tkS0mVd5qi_aglDaT8WB5UC?yC12VnVGzeFLzvyYk42
						Job Reference (optional)

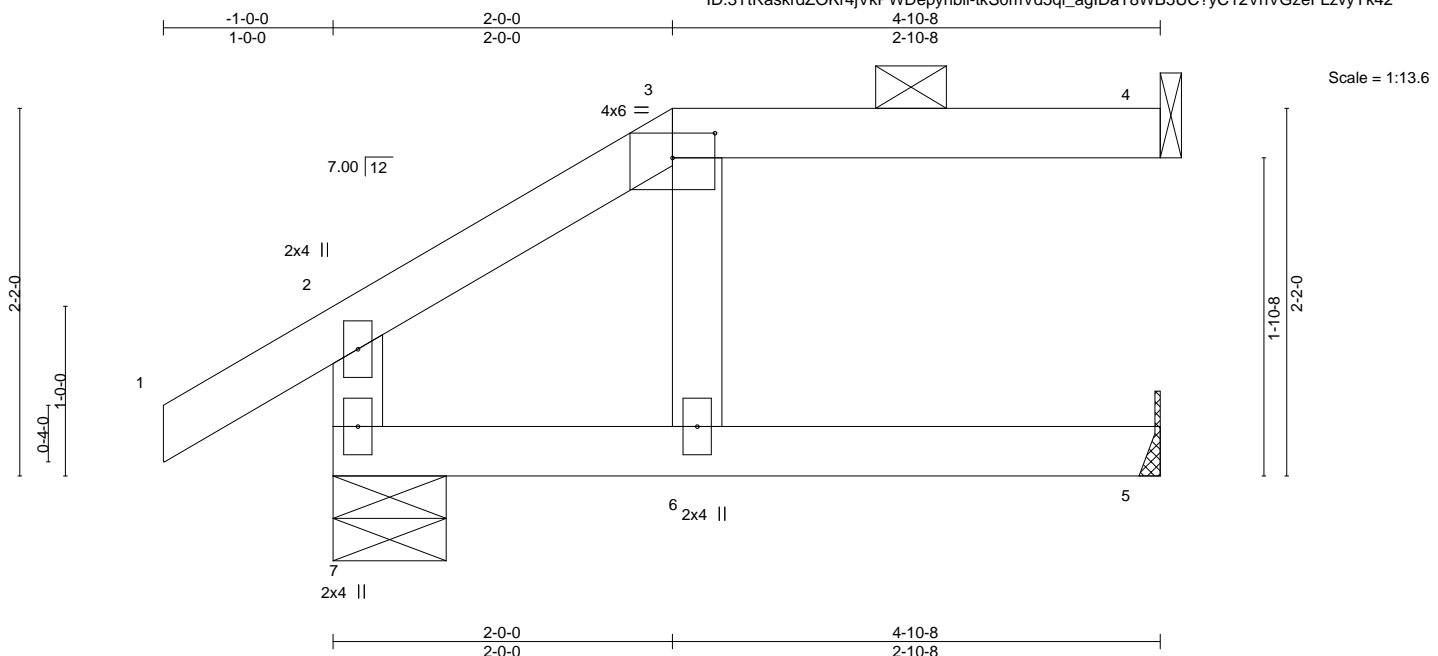


Plate Offsets (X,Y)--	[3:0-3:0,0-1-12]
-----------------------	------------------

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.29	Vert(LL)	-0.03	6	>999	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.32	Vert(CT)	-0.05	5-6	>999		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.01	Horz(CT)	0.06	4	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MP	Wind(LL)	0.02	6	>999		
								Weight: 20 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 4-10-8 oc purlins, except end verticals, and 2-0-0 oc purlins: 3-4.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3	


REACTIONS. (size) 7=0-8-0, 5=Mechanical, 4=Mechanical
 Max Horz 7=46(LC 8)
 Max Uplift 7=-13(LC 8), 4=-28(LC 5)
 Max Grav 7=273(LC 1), 5=84(LC 3), 4=115(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 6) Refer to girder(s) for truss to truss connections.
 - 7) Refer to girder(s) for truss to truss connections.
 - 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 7, 4.
 - 9) Girder carries hip end with 0-0-0 right side setback, 0-0-0 left side setback, and 2-6-0 end setback.
 - 10) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - 11) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-2=-60, 2-3=-63(F=-3), 5-7=-21(F=-1), 3-4=-63(F=-3)



September 30, 2022


Job	Truss	Truss Type	Qty	Ply	MATTAMY/DALTON/FRENCH COUNTRY	I54477025
MASTER_FRENCH_COUNTRY	TR04	JACK	1	1		

Builders FirstSource (Apex, NC),

Apex, NC - 27523,

8.530 s Aug 11 2022 MiTek Industries, Inc. Thu Sep 29 15:30:52 2022 Page 1

ID:3T1RaskrdZOKr4jVkpWDepyhbi-Lw00_rejb07QISnm1s2Qdhl83cNWEEyPCI_vVLYk41

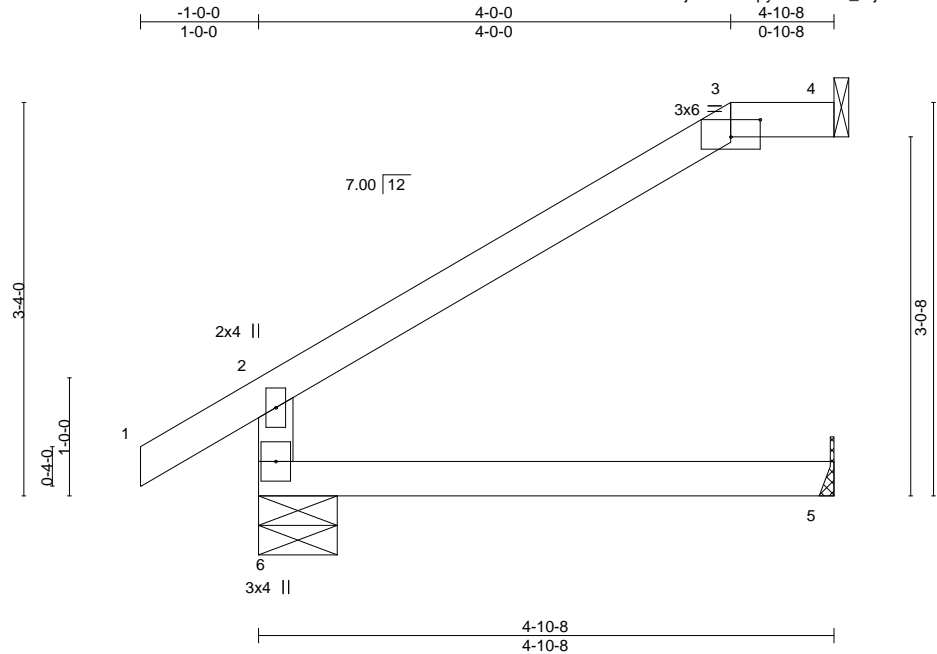

Scale = 1:19.5


Plate Offsets (X,Y)--	[3:0-3-0,0-1-12]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.33	Vert(LL) -0.02 5-6 >999 360	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.24	Vert(CT) -0.05 5-6 >999 240		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.00	Horz(CT) 0.05 4 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-MR	Wind(LL) 0.02 5-6 >999 240	Weight: 18 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 4-10-8 oc purlins, except end verticals, and 2-0-0 oc purlins: 3-4.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	

REACTIONS. (size) 6=0-8-0, 5=Mechanical, 4=Mechanical
 Max Horz 6=79(LC 12)
 Max Uplift 6=-4(LC 12), 4=-46(LC 12)
 Max Grav 6=264(LC 1), 5=88(LC 3), 4=125(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 6) Refer to girder(s) for truss to truss connections.
 - 7) Refer to girder(s) for truss to truss connections.
 - 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 6, 4.
 - 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



September 30, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ENGINEERING BY
TRENCO
 A MiTek Affiliate
 818 Soundside Road
 Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	MATTAMY/DALTON/FRENCH COUNTRY	154477026
MASTER_FRENCH_COUNTRY	705	JACK	1	1		
					Job Reference (optional)	

Builders FirstSource (Apex, NC),


Apex, NC - 27523,

8.530 s Aug 11 2022 MiTek Industries, Inc. Thu Sep 29 15:30:53 2022 Page 1

ID:3TtRaskrdZOKr4jVkpWDePyhbii-p7amBBfLMJFHvcMzaZZfAvJf?jzhBZQykS2nyYk40



Scale = 1:22.1

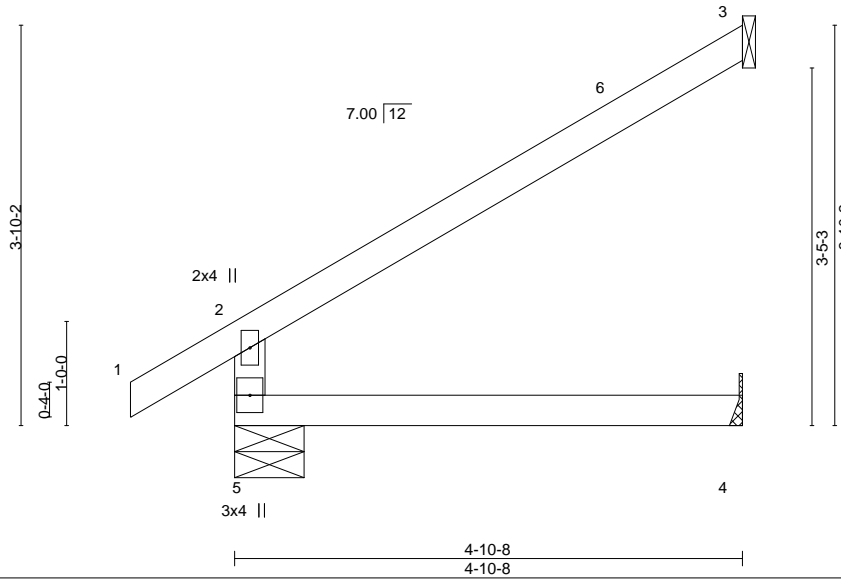

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.34	Vert(LL)	-0.02 4-5	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.24	Vert(CT)	-0.05 4-5	>999	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.03 3	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MR	Wind(LL)	0.03 4-5	>999	240	Weight: 18 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 WEBS 2x4 SP No.3

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 4-10-8 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 5=0-8-0, 3=Mechanical, 4=Mechanical
 Max Horz 5=93(LC 12)
 Max Uplift 3=64(LC 12)
 Max Grav 5=264(LC 1), 3=130(LC 19), 4=88(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-11-15 to 3-9-10, Interior(1) 3-9-10 to 4-9-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3.



September 30, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component


Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	MATTAMY/DALTON/FRENCH COUNTRY	154477027
MASTER_FRENCH_COUNTRY	706GR	MONO HIP	1	1		

Builders FirstSource (Apex, NC), Apex, NC - 27523, 8.530 s Aug 11 2022 MiTek Industries, Inc. Thu Sep 29 15:30:54 2022 Page 1
 ID:3TtRaskrdZOKr4jVkpWDepyhbi-HJ88PXfz6dN8Xmx98H4uj6qPIP2ki6dffcT0aEyYk4?

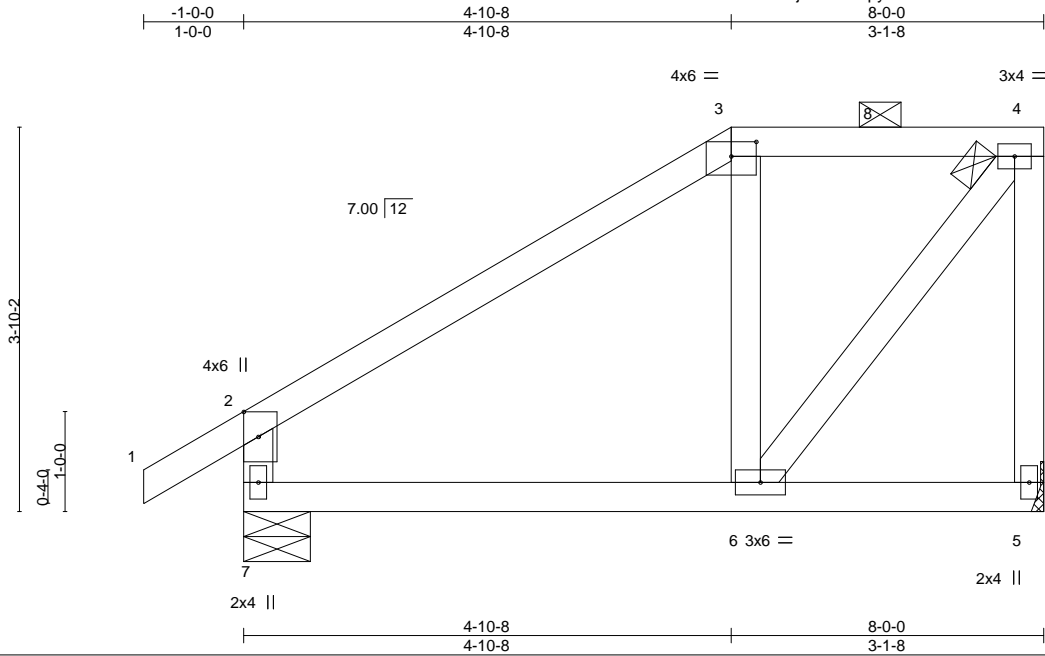

Scale = 1:23.0

Plate Offsets (X, Y)--	[2:0-3-0,Edge], [3:0-3-0,0-1-12]
------------------------	----------------------------------

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.70	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.26	Vert(LL) -0.01 6-7 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.18	Vert(CT) -0.04 6-7 >999 240		
BCDL 10.0	Rep Stress Incr NO	Matrix-MS	Horz(CT) 0.00 5 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.01 6 >999 240	Weight: 44 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 3-4.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	

REACTIONS. (size) 7=0-8-0, 5=Mechanical
 Max Horz 7=189(LC 5)
 Max Uplift 7=-52(LC 8), 5=-96(LC 5)
 Max Grav 7=581(LC 1), 5=502(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-7=-500/113, 2-3=-468/48, 3-4=-292/98, 4-5=-469/118
 BOT CHORD 6-7=-93/321
 WEBS 4-6=-115/476

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 6) Refer to girder(s) for truss to truss connections.
 - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 7, 5.
 - 8) Girder carries hip end with 0-0-0 right side setback, 0-0-0 left side setback, and 4-10-8 end setback.
 - 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - 10) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).


LOAD CASE(S) Standard
 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-2=-60, 2-3=-99(F=-39), 3-4=-99(F=-39), 5-7=-33(F=-13)




September 30, 2022

Job	Truss	Truss Type	Qty	Ply	MATTAMY/DALTON/FRENCH COUNTRY	154477028
MASTER_FRENCH_COUNTRY#07		KINGPOST	4	1		

Builders FirstSource (Apex, NC), Apex, NC - 27523, 8.530 s Aug 11 2022 MiTek Industries, Inc. Thu Sep 29 15:30:54 2022 Page 1
 ID:3T1RaskrdZOKr4jVkpWDepyhbi-HJ88PXfz6dN8Xmx98H4uj6qTqP?di7nifcT0aEyYk4?



Scale = 1:22.4

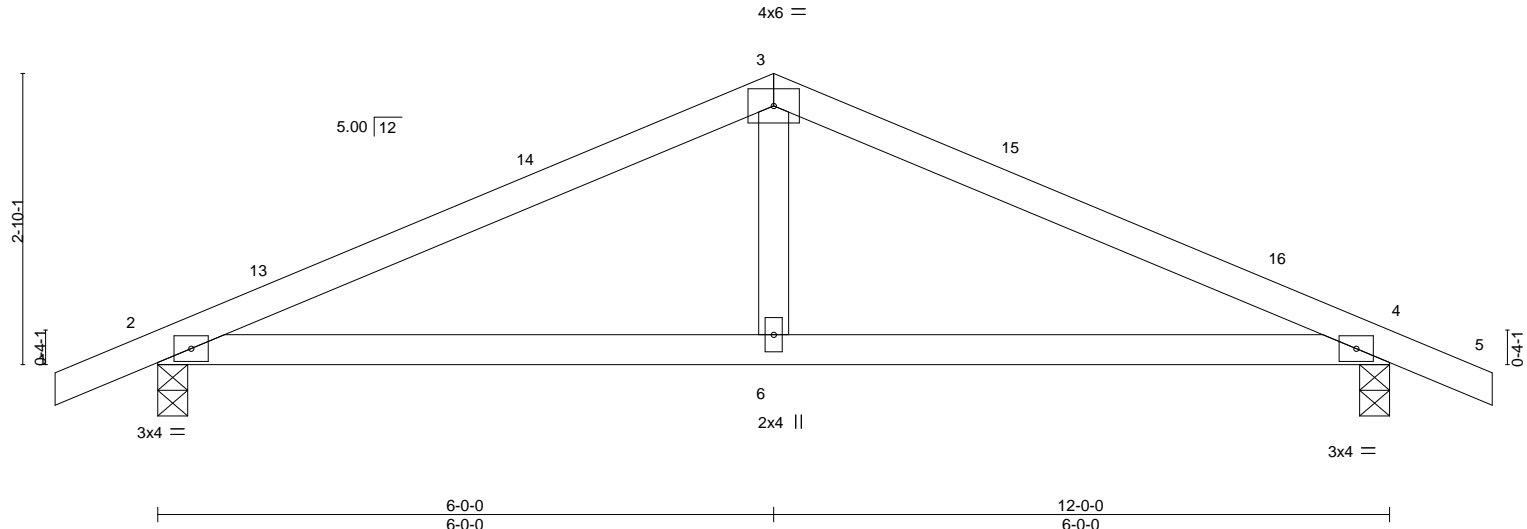

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.44	Vert(LL)	-0.05 6-12	>999	360	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.46	Vert(CT)	-0.09 6-12	>999	240		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.11	Horz(CT)	0.01 4	n/a	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-MS	Wind(LL)	0.04 6-9	>999	240		
	Code IRC2015/TPI2014						Weight: 44 lb	FT = 20%


LUMBER-
 TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 WEBS 2x4 SP No.3

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 2=0-3-8, 4=0-3-8
 Max Horz 2=-39(LC 13)
 Max Uplift 2=-32(LC 12), 4=-32(LC 13)
 Max Grav 2=540(LC 1), 4=540(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-763/109, 3-4=-763/109
 BOT CHORD 2-6=-24/652, 4-6=-24/652
 WEBS 3-6=0/280

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -1-0-0 to 3-9-10, Interior(1) 3-9-10 to 6-0-0, Exterior(2) 6-0-0 to 10-9-10, Interior(1) 10-9-10 to 13-0-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 4.



September 30, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601


ENGINEERING BY
TRENCO
 A MITEK AFFILIATE

818 Soundside Road
 Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	MATTAMY/DALTON/FRENCH COUNTRY	154477029
MASTER_FRENCH_COUNTRY	707G	GABLE	1	1	Job Reference (optional)	

Builders FirstSource (Apex, NC), Apex, NC - 27523,

8.530 s Aug 11 2022 MiTek Industries, Inc. Thu Sep 29 15:30:55 2022 Page 1
ID:3T1RaskrdZOKr4jVkpWDePyhbii-mViXctgtxV?9vWLi_b7FKNiIpRARbkruGDZ6gyYk4_



Scale = 1:22.4

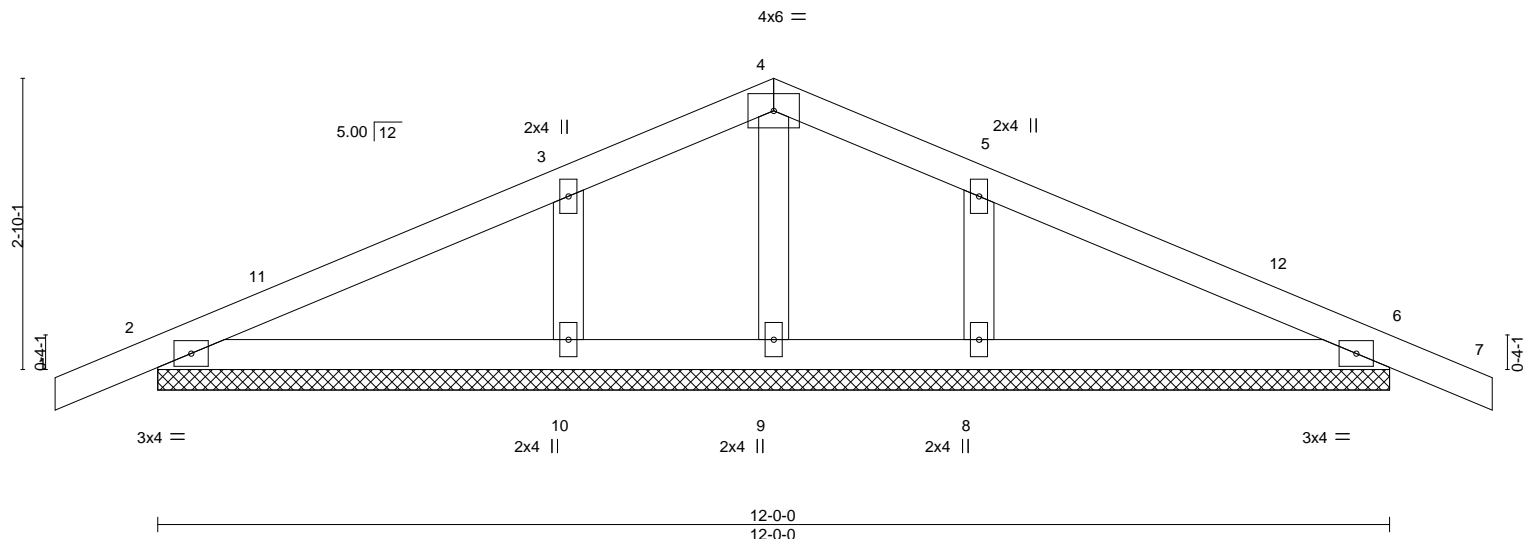

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.17	Vert(LL)	0.00	7	n/r	MT20	244/190
BCLL 10.0	Lumber DOL	1.15	BC 0.12	Vert(CT)	0.01	7	n/r		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.06	Horz(CT)	0.00	6	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S					Weight: 48 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
OTHERS 2x4 SP No.3	

REACTIONS. All bearings 12-0-0.
 (lb) - Max Horz 2=-39(LC 13)
 Max Uplift All uplift 100 lb or less at joint(s) 2, 6, 10, 8
 Max Grav All reactions 250 lb or less at joint(s) 2, 6, 9 except 10=321(LC 1), 8=321(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-


- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) -1-0-0 to 4-0-0, Exterior(2) 4-0-0 to 6-0-0, Corner(3) 6-0-0 to 10-9-10, Exterior(2) 10-9-10 to 13-0-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 4) Gable requires continuous bottom chord bearing.
- 5) Gable studs spaced at 2-0-0 oc.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 6, 10, 8.




September 30, 2022

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.

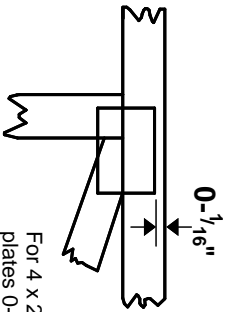

For 4 x 2 orientation, locate plates 0- 1/16" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

* Plate location details available in **MITek 20/20 software** or upon request.

PLATE SIZE

4 X 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING



Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur. Min size shown is for crushing only.

Industry Standards:

ANSI/TFP 1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-89: Design Standard for Bracing, Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

6-4-8
dimensions shown in ft-in-sixteenths
(Drawings not to scale)



JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ESR1988
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TFP 1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MITteK® All Rights Reserved



MITek Engineering Reference Sheet: MII-7473 rev. 5/19/2020



General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TFP 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TFP 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TFP 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.