

RE: J0922-4909
 Southern Touch / 1 Hales Farm/ Harnett

Trenco
 818 Soundside Rd
 Edenton, NC 27932

Site Information:

Customer: Project Name: J0922-4909
 Lot/Block: Model:
 Address: Subdivision:
 City: State:

General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):

Design Code: IRC2015/TPI2014 Design Program: MiTek 20/20 8.4
 Wind Code: ASCE 7-10 Wind Speed: 130 mph
 Roof Load: 40.0 psf Floor Load: N/A psf

This package includes 19 individual, dated Truss Design Drawings and 0 Additional Drawings.

| No. | Seal# | Truss Name | Date |
|-----|-----------|------------|-----------|
| 1 | I51368511 | A1 | 4/14/2022 |
| 2 | I51368512 | A1GE | 4/14/2022 |
| 3 | I51368513 | A2 | 4/14/2022 |
| 4 | I51368514 | B1 | 4/14/2022 |
| 5 | I51368515 | B1GE | 4/14/2022 |
| 6 | I51368516 | B2 | 4/14/2022 |
| 7 | I51368517 | M1 | 4/14/2022 |
| 8 | I51368518 | M1GE | 4/14/2022 |
| 9 | I51368519 | M2 | 4/14/2022 |
| 10 | I51368520 | M2GE | 4/14/2022 |
| 11 | I51368521 | P1 | 4/14/2022 |
| 12 | I51368522 | P1GE | 4/14/2022 |
| 13 | I51368523 | V1AGE | 4/14/2022 |
| 14 | I51368524 | V1GE | 4/14/2022 |
| 15 | I51368525 | V2 | 4/14/2022 |
| 16 | I51368526 | V3 | 4/14/2022 |
| 17 | I51368527 | V4 | 4/14/2022 |
| 18 | I51368528 | V5 | 4/14/2022 |
| 19 | I51368529 | V6 | 4/14/2022 |

The truss drawing(s) referenced above have been prepared by Truss Engineering Co. under my direct supervision based on the parameters provided by Comtech, Inc - Fayetteville.

Truss Design Engineer's Name: Gilbert, Eric

My license renewal date for the state of North Carolina is December 31, 2022.

North Carolina COA: C-0844

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to TRENCO. Any project specific information included is for TRENCO customers file reference purpose only, and was not taken into account in the preparation of these designs. TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.



April 14, 2022

| | | | | | | |
|------------|-------|------------|-----|-----|--|-----------|
| Job | Truss | Truss Type | Qty | Ply | Southern Touch / 1 Hales Farm/ Harnett | 151368511 |
| J0922-4909 | A1 | FINK | 9 | 1 | Job Reference (optional) | |


Comtech, Inc., Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Wed Apr 13 16:15:28 2022 Page 1

ID:lwPOH6hK8JepTt6SXqQOJcyzm6C-7U7_uz8hOD6GHJ98HdlYMzfaxw6fOpZuUZcXNtZr4SD

0-10-8 8-3-10 15-9-0 23-2-6 31-6-0 32-4-8
 0-10-8 8-3-10 7-5-6 7-5-6 8-3-10 0-10-8

Scale = 1:55.9

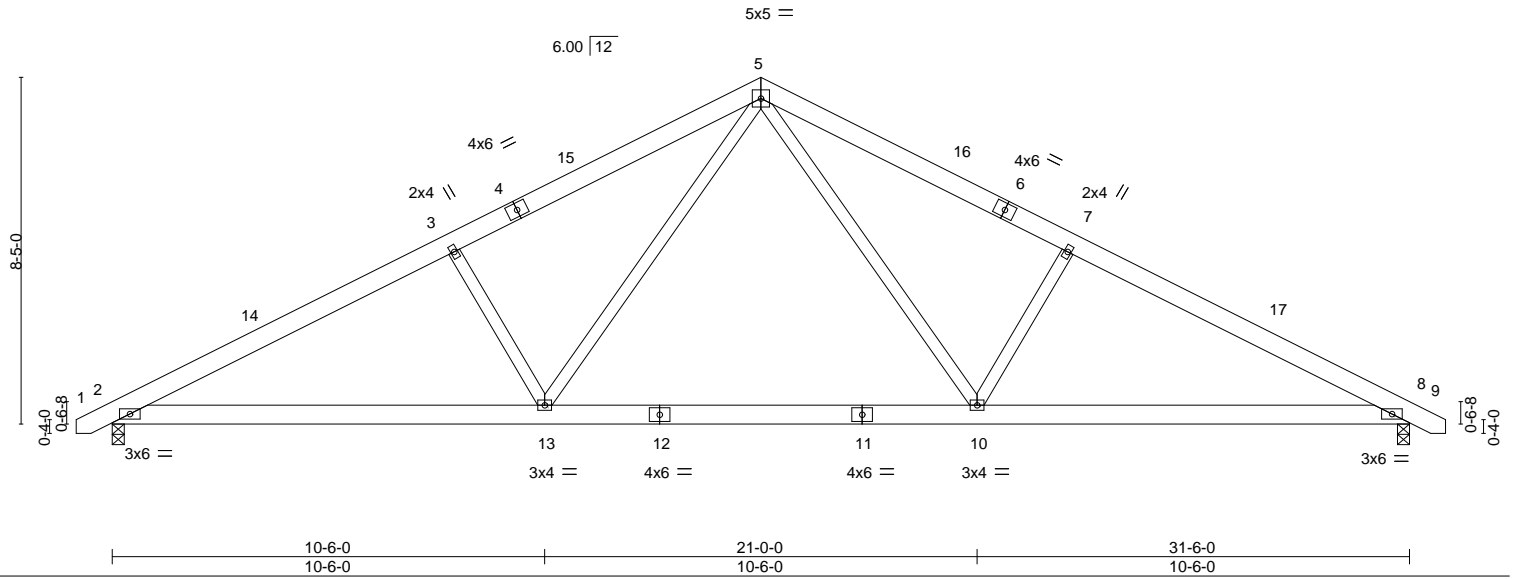

| | | | | | |
|----------------------|----------------------|-------------|-------------------------------|----------------|-------------|
| LOADING (psf) | SPACING- | CSI. | DEFL. | PLATES | GRIP |
| TCLL 20.0 | 2-0-0 | TC 0.28 | in (loc) l/defl L/d | MT20 | 244/190 |
| TCDL 10.0 | Plate Grip DOL 1.15 | BC 0.47 | Vert(LL) -0.20 10-13 >999 360 | | |
| BCLL 0.0 * | Lumber DOL 1.15 | WB 0.23 | Vert(CT) -0.28 10-13 >999 240 | | |
| BCDL 10.0 | Rep Stress Incr YES | Matrix-S | Horz(CT) 0.05 8 n/a n/a | | |
| | Code IRC2015/TPI2014 | | Wind(LL) 0.05 2-13 >999 240 | Weight: 201 lb | FT = 20% |

LUMBER-

TOP CHORD 2x6 SP No.1
 BOT CHORD 2x6 SP No.1
 WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-11-8 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 2=0-3-8, 8=0-3-8
 Max Horz 2=107(LC 11)
 Max Uplift 2=-87(LC 12), 8=-87(LC 13)
 Max Grav 2=1299(LC 1), 8=1299(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-2184/486, 3-5=-1985/517, 5-7=-1985/517, 7-8=-2184/486
 BOT CHORD 2-13=-311/1910, 10-13=-102/1255, 8-10=-320/1870
 WEBS 3-13=-466/285, 5-13=-144/841, 5-10=-144/841, 7-10=-466/285

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-8-6 to 3-8-7, Interior(1) 3-8-7 to 15-9-0, Exterior(2) 15-9-0 to 20-1-13, Interior(1) 20-1-13 to 32-2-6 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 87 lb uplift at joint 2 and 87 lb uplift at joint 8.



April 14, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

| | | | | | | |
|------------|-------|------------|-----|-----|--|-----------|
| Job | Truss | Truss Type | Qty | Ply | Southern Touch / 1 Hales Farm/ Harnett | 151368512 |
| J0922-4909 | A1GE | GABLE | 2 | 1 | Job Reference (optional) | |

Comtech, Inc., Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Wed Apr 13 16:15:30 2022 Page 1

ID:lwPOH6hK8Jeptt6SXqQOJcyzm6C-4sFkJfAxwqN_XdJXP2n0ROk_2jvGskMAxs5eSmzR4SB

0-10-8 15-9-0 31-6-0 32-4-8
0-10-8 15-9-0 15-9-0 0-10-8

Scale = 1:56.5

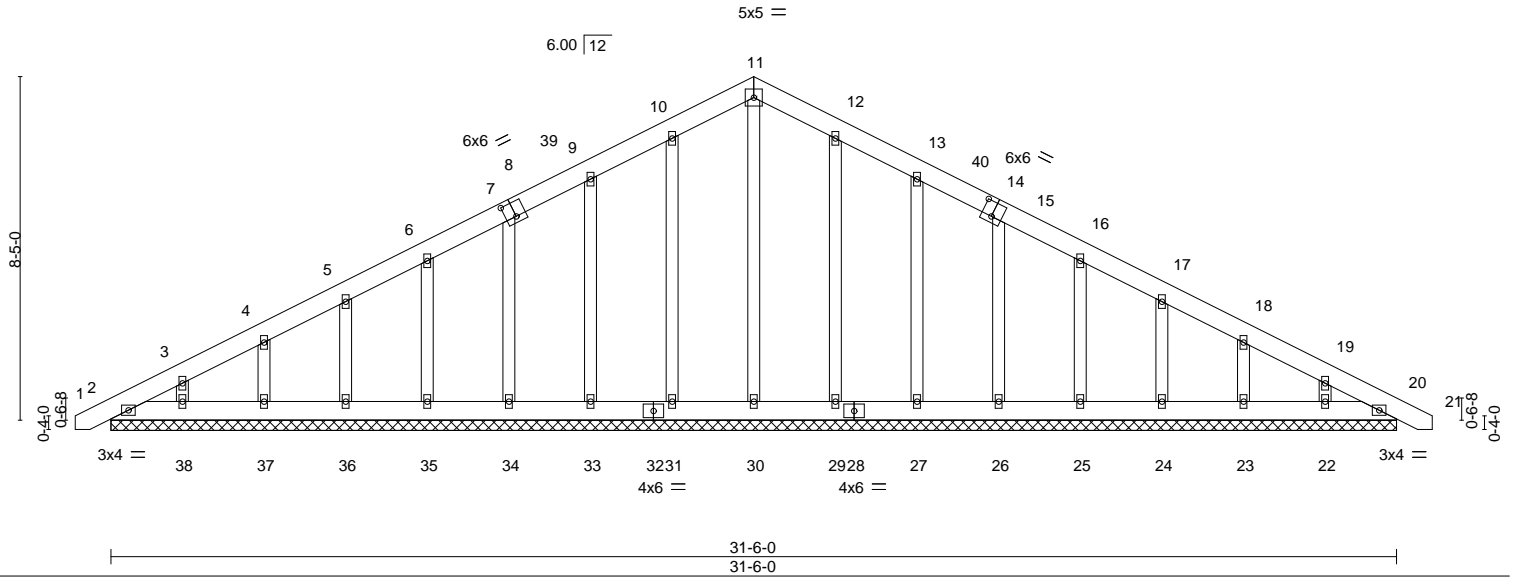


Plate Offsets (X,Y)-- [8:0-3-0,0-4-4], [14:0-3-0,0-4-4]

| LOADING (psf) | SPACING- | CSI. | DEFL. | in (loc) | l/defl | L/d | PLATES | GRIP |
|---------------|----------------------|----------|---------------|----------|--------|-----|----------------|----------|
| TCLL 20.0 | Plate Grip DOL 1.15 | TC 0.05 | Vert(LL) 0.00 | 20 | n/r | 120 | MT20 | 244/190 |
| TCDL 10.0 | Lumber DOL 1.15 | BC 0.02 | Vert(CT) 0.00 | 20 | n/r | 120 | | |
| BCLL 0.0 * | Rep Stress Incr YES | WB 0.14 | Horz(CT) 0.00 | 20 | n/a | n/a | | |
| BCDL 10.0 | Code IRC2015/TPI2014 | Matrix-S | | | | | | |
| | | | | | | | Weight: 246 lb | FT = 20% |

LUMBER-
TOP CHORD 2x6 SP No.1
BOT CHORD 2x6 SP No.1
OTHERS 2x4 SP No.2

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 31-6-0.
(lb) - Max Horz 2=166(LC 16)
Max Uplift All uplift 100 lb or less at joint(s) 2, 20, 31, 33, 34, 35, 36, 37, 38, 29, 27, 26, 25, 24, 23, 22
Max Grav All reactions 250 lb or less at joint(s) 2, 20, 30, 31, 33, 34, 35, 36, 37, 38, 29, 27, 26, 25, 24, 23, 22

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 9-10=-94/277, 10-11=-110/321, 11-12=-110/323, 12-13=-94/280

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) -0-8-6 to 3-9-0, Exterior(2) 3-9-0 to 15-9-0, Corner(3) 15-9-0 to 20-1-13, Exterior(2) 20-1-13 to 32-2-6 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 20, 31, 33, 34, 35, 36, 37, 38, 29, 27, 26, 25, 24, 23, 22.



April 14, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932

| | | | | | | |
|------------|-------|--------------|-----|-----|--|-----------|
| Job | Truss | Truss Type | Qty | Ply | Southern Touch / 1 Hales Farm/ Harnett | 151368513 |
| J0922-4909 | A2 | ROOF SPECIAL | 4 | 1 | Job Reference (optional) | |

Comtech, Inc., Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Wed Apr 13 16:15:31 2022 Page 1

ID:lwPOH6hK8Jeptt6SXqQOJcym6C-Y3o6W?AZh8Vr8ntjzllFzbH6n765bAxKAWqB_CzR4SA



Scale = 1:60.1


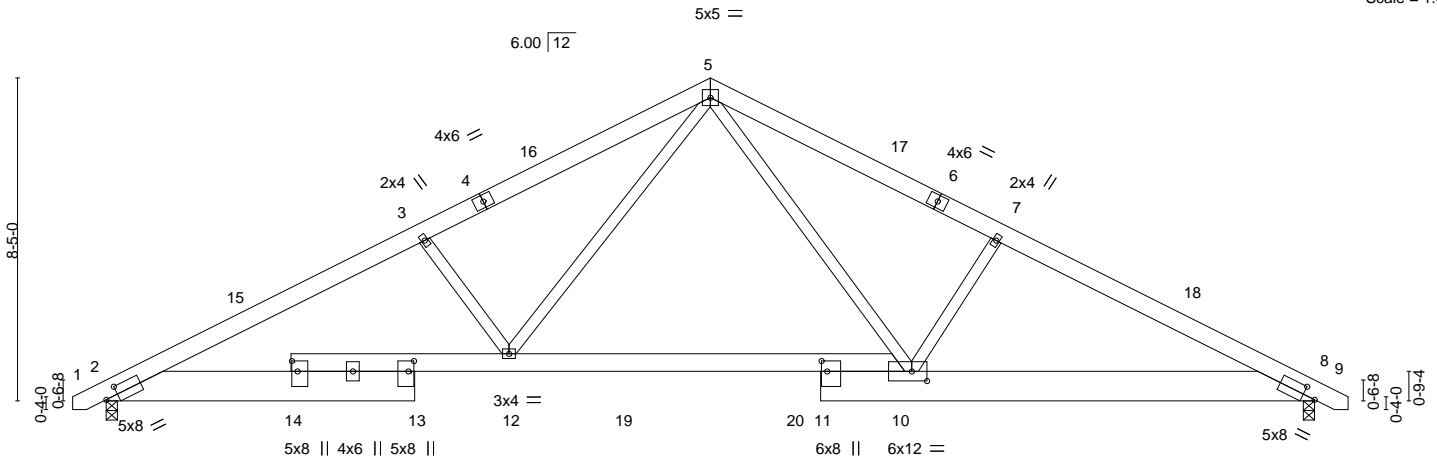


Plate Offsets (X,Y)-- [2:0-3-15,0-2-10], [8:0-3-15,0-2-10], [10:0-4-12,0-3-0], [11:0-3-4,0-1-12], [13:0-3-4,0-1-12], [14:0-3-4,0-1-12]

| | | | | | | | | | |
|----------------------|----------------------|-------|-------------|--------------|-------------|--------|-----|----------------|-------------|
| LOADING (psf) | SPACING- | 2-0-0 | CSI. | DEFL. | in (loc) | l/defl | L/d | PLATES | GRIP |
| TCLL 20.0 | Plate Grip DOL | 1.15 | TC 0.24 | Vert(LL) | -0.17 10-12 | >999 | 360 | MT20 | 244/190 |
| TCDL 10.0 | Lumber DOL | 1.15 | BC 0.62 | Vert(CT) | -0.28 10-12 | >999 | 240 | | |
| BCLL 0.0 * | Rep Stress Incr | YES | WB 0.25 | Horz(CT) | 0.06 8 | n/a | n/a | | |
| BCDL 10.0 | Code IRC2015/TPI2014 | | Matrix-S | Wind(LL) | 0.06 10-12 | >999 | 240 | Weight: 244 lb | FT = 20% |

LUMBER-

TOP CHORD 2x6 SP No.1
 BOT CHORD 2x10 SP No.1 *Except*
 10-14: 2x6 SP No.1
 WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-8-15 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 2=0-3-8, 8=0-3-8
 Max Horz 2=107(LC 11)
 Max Uplift 2=-88(LC 12), 8=-88(LC 13)
 Max Grav 2=1299(LC 1), 8=1299(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-2535/552, 3-5=-2263/555, 5-7=-2167/507, 7-8=-2403/507
 BOT CHORD 2-12=-363/2197, 10-12=-123/1378, 8-10=-344/2077
 WEBS 5-12=-183/1008, 5-10=-120/928, 7-10=-468/286, 3-12=-460/283

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-8-6 to 3-8-7, Interior(1) 3-8-7 to 15-9-0, Exterior(2) 15-9-0 to 20-1-13, Interior(1) 20-1-13 to 32-2-6 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 8.



April 14, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

| | | | | | | |
|------------|-------|------------|-----|-----|--|-----------|
| Job | Truss | Truss Type | Qty | Ply | Southern Touch / 1 Hales Farm/ Harnett | I51368514 |
| J0922-4909 | B1 | FINK | 2 | 1 | Job Reference (optional) | |

Comtech, Inc, Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Wed Apr 13 16:15:32 2022 Page 1

ID:lwPOH6hK8Jeptt6SXqQJcym6C-0FMUkKBSSdimxSwWtpUWppJKXZCKfJTPAakXfzR4S9

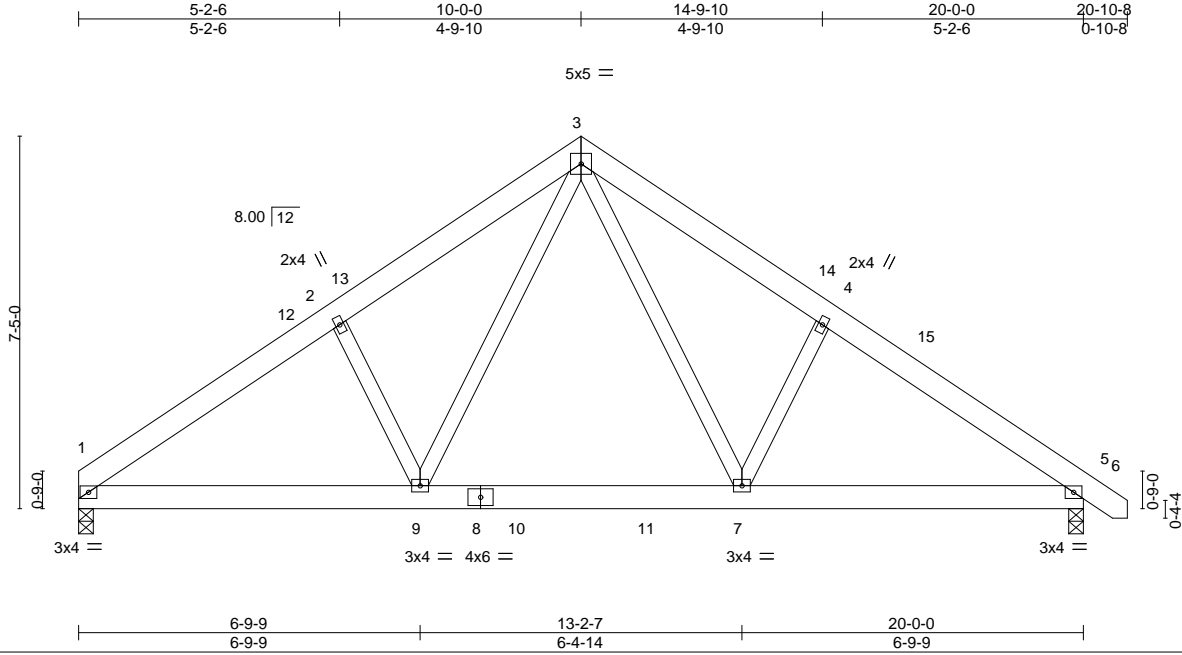

Scale = 1:45.9

| | | | | | | | | | |
|----------------------|----------------------|-------------|--------------|-------|-------|--------|-----|----------------|-------------|
| LOADING (psf) | SPACING- | CSI. | DEFL. | in | (loc) | l/defl | L/d | PLATES | GRIP |
| TCLL 20.0 | 2-0-0 | TC 0.10 | Vert(LL) | -0.03 | 7-9 | >999 | 360 | MT20 | 244/190 |
| TCDL 10.0 | Plate Grip DOL 1.15 | BC 0.18 | Vert(CT) | -0.05 | 7-9 | >999 | 240 | | |
| BCLL 0.0 * | Lumber DOL 1.15 | WB 0.11 | Horz(CT) | 0.01 | 5 | n/a | n/a | | |
| BCDL 10.0 | Rep Stress Incr YES | Matrix-S | Wind(LL) | 0.01 | 9 | >999 | 240 | | |
| | Code IRC2015/TPI2014 | | | | | | | Weight: 139 lb | FT = 20% |

LUMBER-

TOP CHORD 2x6 SP No.1
 BOT CHORD 2x6 SP No.1
 WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


(size) 1=0-3-8, 5=0-3-8
 Max Horz 1=-170(LC 10)
 Max Uplift 1=-41(LC 12), 5=-53(LC 13)
 Max Grav 1=789(LC 19), 5=842(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-1088/255, 2-3=-1007/323, 3-4=-1007/311, 4-5=-1100/245
 BOT CHORD 1-9=-113/948, 7-9=0/631, 5-7=-111/835
 WEBS 2-9=-300/206, 3-9=-117/492, 3-7=-114/487, 4-7=-299/202

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TC DL=6.0psf; BC DL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-1-12 to 4-6-9, Interior(1) 4-6-9 to 10-0-0, Exterior(2) 10-0-0 to 14-4-13, Interior(1) 14-4-13 to 20-8-12 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BC DL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5.

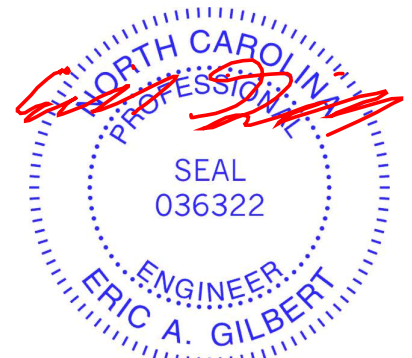

April 14, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

| | | | | | | |
|------------|-------|------------|-----|-----|--|-----------|
| Job | Truss | Truss Type | Qty | Ply | Southern Touch / 1 Hales Farm/ Harnett | I51368515 |
| J0922-4909 | B1GE | GABLE | 1 | 1 | Job Reference (optional) | |

Comtech, Inc, Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Wed Apr 13 16:15:33 2022 Page 1
ID:IwPOH6hK8Jeptt6SXqQOJcyzm6C-URwtXgCpDIIZO5164AKJ30MVaxxw36sddqJl35zR4S8

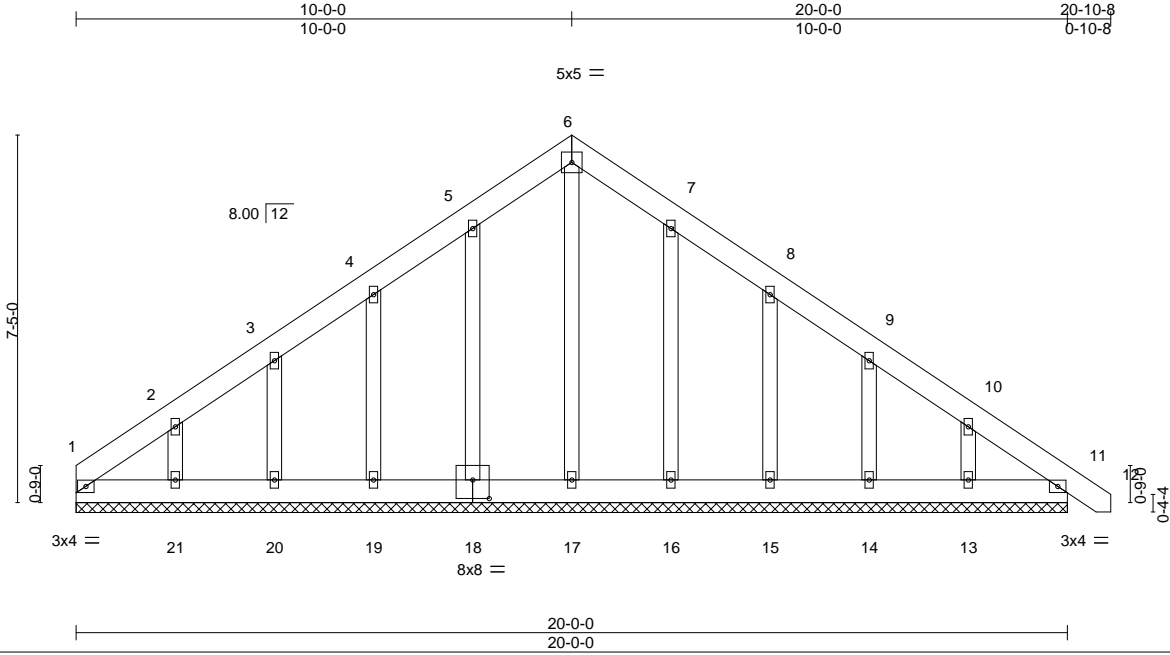

Scale = 1:46.5

Plate Offsets (X,Y)-- [18:0-4-0,0-4-8]

| LOADING (psf) | SPACING- | CSI. | DEFL. | in | (loc) | l/defl | L/d | PLATES | GRIP |
|---------------|----------------------|----------|----------|------|-------|--------|-----|----------------|----------|
| TCLL 20.0 | Plate Grip DOL 1.15 | TC 0.03 | Vert(LL) | 0.00 | 11 | n/r | 120 | MT20 | 244/190 |
| TCDL 10.0 | Lumber DOL 1.15 | BC 0.02 | Vert(CT) | 0.00 | 11 | n/r | 120 | | |
| BCLL 0.0 * | Rep Stress Incr YES | WB 0.09 | Horz(CT) | 0.00 | 11 | n/a | n/a | | |
| BCDL 10.0 | Code IRC2015/TPI2014 | Matrix-S | | | | | | | |
| | | | | | | | | Weight: 154 lb | FT = 20% |


LUMBER-
 TOP CHORD 2x6 SP No.1
 BOT CHORD 2x6 SP No.1
 OTHERS 2x4 SP No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 20-0-0.
 (lb) - Max Horz 1=-212(LC 8)
 Max Uplift All uplift 100 lb or less at joint(s) 1, 11, 18, 19, 20, 16, 15, 14 except 21=-122(LC 12), 13=-111(LC 13)
 Max Grav All reactions 250 lb or less at joint(s) 1, 11, 17, 18, 19, 20, 21, 16, 15, 14, 13

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) 0-0-0 to 4-4-13, Exterior(2) 4-4-13 to 10-0-0, Corner(3) 10-0-0 to 14-4-13, Exterior(2) 14-4-13 to 20-8-12 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 11, 18, 19, 20, 16, 15, 14 except (jt=lb) 21=122, 13=111.

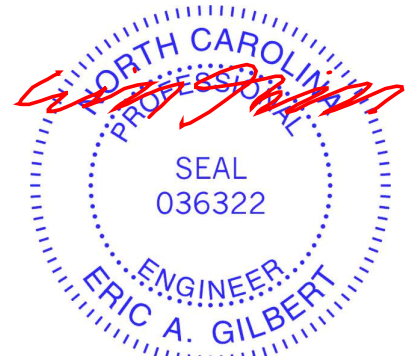

April 14, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

| | | | | | | |
|------------|-------|------------|-----|-----|--|-----------|
| Job | Truss | Truss Type | Qty | Ply | Southern Touch / 1 Hales Farm/ Harnett | 151368516 |
| J0922-4909 | B2 | FINK | 1 | 3 | Job Reference (optional) | |

Comtech, Inc., Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Wed Apr 13 16:15:34 2022 Page 1
ID:lwPOH6hK8Jeptt6SXqQJcyzm6C-ydUF90DS_3tQ?EcletrybEudwKBGoPkmsU3rbXzR4S7

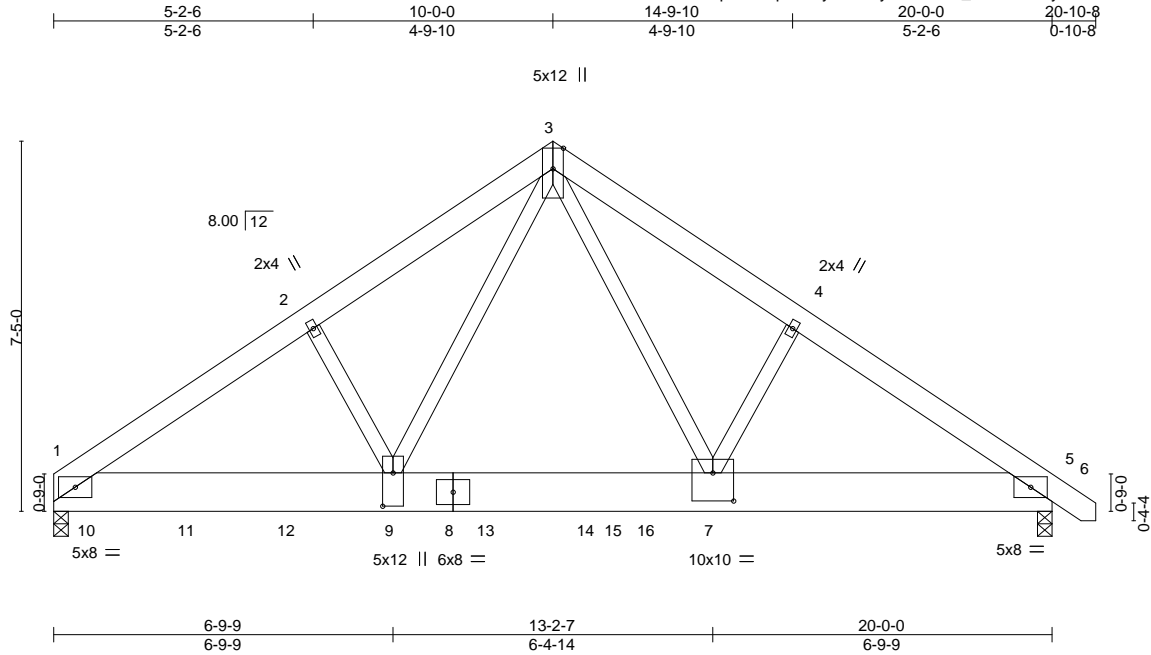

Scale = 1:46.2

Plate Offsets (X,Y)-- [7:0-5-0,0-6-12], [9:0-8-0,0-2-8]

| LOADING (psf) | SPACING- | CSI. | DEFL. | in (loc) | l/defl | L/d | PLATES | GRIP |
|---------------|----------------------|----------|----------------|----------|--------|-----|----------------|----------|
| TCLL 20.0 | Plate Grip DOL 1.15 | TC 0.25 | Vert(LL) -0.10 | 7-9 | >999 | 360 | MT20 | 244/190 |
| TCDL 10.0 | Lumber DOL 1.15 | BC 0.40 | Vert(CT) -0.18 | 7-9 | >999 | 240 | | |
| BCLL 0.0 * | Rep Stress Incr NO | WB 0.76 | Horz(CT) 0.03 | 5 | n/a | n/a | | |
| BCDL 10.0 | Code IRC2015/TPI2014 | Matrix-S | Wind(LL) 0.04 | 7-9 | >999 | 240 | Weight: 506 lb | FT = 20% |

LUMBER-

TOP CHORD 2x6 SP No.1
BOT CHORD 2x10 SP 2400F 2.0E
WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=0-3-8, 5=0-3-8
Max Horz 1=-168(LC 6)
Max Uplift 1=-267(LC 8), 5=-384(LC 9)
Max Grav 1=11894(LC 14), 5=6778(LC 2)


FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-13645/496, 2-3=-13542/549, 3-4=-11759/730, 4-5=-11950/679
BOT CHORD 1-9=-413/11133, 7-9=-264/7241, 5-7=-488/9646
WEBS 2-9=-98/377, 3-9=-198/10062, 3-7=-554/5937, 4-7=-58/442

NOTES-

- 3-ply truss to be connected together as follows:
Top chords connected with 10d (0.131"x3") nails as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
Bottom chords connected with 10d (0.148"x3") nails as follows: 2x10 - 5 rows staggered at 0-4-0 oc.
Web connected with 10d (0.131"x3") nails as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); Lumber DOL=1.60 plate grip DOL=1.60
- Concentrated loads from layout are not present in Load Case(s): #3 Dead + Uninhabitable Attic Without Storage; #4 Dead + 0.6 MWFRS Wind (Pos. Internal) Left; #5 Dead + 0.6 MWFRS Wind (Pos. Internal) Right; #6 Dead + 0.6 MWFRS Wind (Neg. Internal) Left; #7 Dead + 0.6 MWFRS Wind (Neg. Internal) Right; #8 Dead + 0.6 MWFRS Wind (Pos. Internal) 1st Parallel; #9 Dead + 0.6 MWFRS Wind (Pos. Internal) 2nd Parallel; #10 Dead + 0.6 MWFRS Wind (Pos. Internal) 3rd Parallel; #11 Dead + 0.6 MWFRS Wind (Pos. Internal) 4th Parallel; #12 Dead + 0.6 MWFRS Wind (Neg. Internal) 1st Parallel; #13 Dead + 0.6 MWFRS Wind (Neg. Internal) 2nd Parallel; #18 Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) Left); #19 Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) Right); #20 Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel); #21 Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel).
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

Continued on page 2

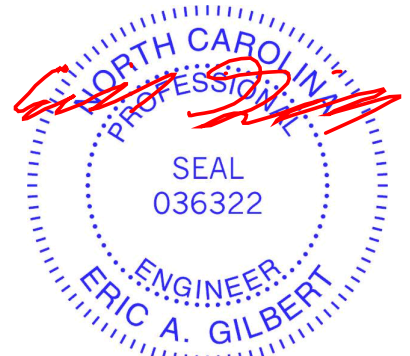

April 14, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSITPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932

| | | | | | | |
|------------|-------|------------|-----|----------|--|-----------|
| Job | Truss | Truss Type | Qty | Ply | Southern Touch / 1 Hales Farm/ Harnett | I51368516 |
| J0922-4909 | B2 | FINK | 1 | 3 | Job Reference (optional) | |

Comtech, Inc, Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Wed Apr 13 16:15:34 2022 Page 2
ID:lWPOH6hK8Jeptt6SXqQOJcym6C-ydUF90DS_3tQ?EcletrybEudwKBGoPkmsU3rbXzR4S7

NOTES-

- 7) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=267, 5=384.
- 9) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 5239 lb down and 556 lb up at 11-10-4, 2406 lb down at 0-7-12, 2401 lb down at 2-7-12, 2401 lb down at 4-7-12, 2401 lb down at 6-7-12, and 2401 lb down at 8-7-12, and 2401 lb down at 10-7-12 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-5=-20, 1-3=-60, 3-6=-60

Concentrated Loads (lb)

Vert: 9=-634(B) 10=-639(B) 11=-634(B) 12=-634(B) 13=-634(B) 14=-634(B) 16=-5177(B)

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932

| | | | | | | |
|------------|-------|------------|-----|-----|--|-----------|
| Job | Truss | Truss Type | Qty | Ply | Southern Touch / 1 Hales Farm/ Harnett | 151368517 |
| J0922-4909 | M1 | Monopitch | 7 | 1 | Job Reference (optional) | |

Comtech, Inc, Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Wed Apr 13 16:15:35 2022 Page 1

ID:lWPOH6hK8Jeptt6SXqQOJcyzm6C-Qq2dMME4IN?HdOBUCbNB8RRqakTZX0vv58oP7zzR4S6

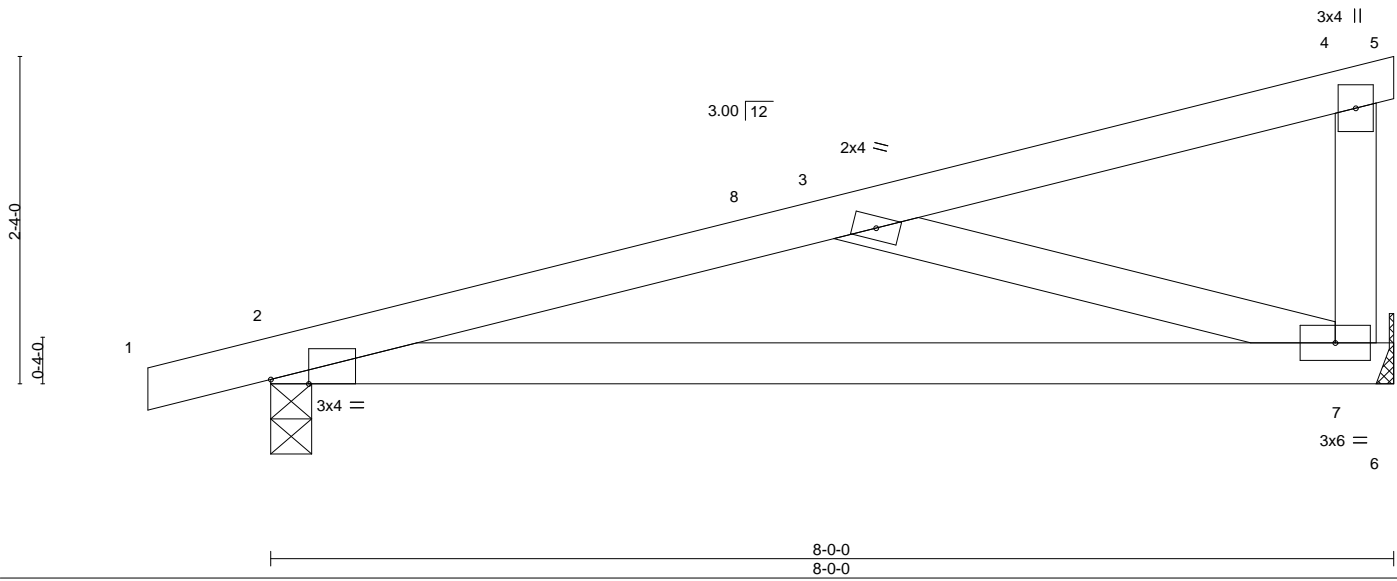


Plate Offsets (X,Y)-- [2:0-3-4,Edge]

| LOADING (psf) | SPACING- | CSI. | DEFL. | in (loc) | l/defl | L/d | PLATES | GRIP |
|---------------|----------------------|----------|----------------|----------|--------|-----|---------------|----------|
| TCLL 20.0 | Plate Grip DOL 1.15 | TC 0.12 | Vert(LL) -0.17 | 2-7 | >526 | 360 | MT20 | 244/190 |
| TCDL 10.0 | Lumber DOL 1.15 | BC 0.58 | Vert(CT) -0.35 | 2-7 | >263 | 240 | | |
| BCLL 0.0 * | Rep Stress Incr YES | WB 0.12 | Horz(CT) 0.01 | 7 | n/a | n/a | | |
| BCDL 10.0 | Code IRC2015/TPI2014 | Matrix-P | Wind(LL) 0.00 | 2 | **** | 240 | Weight: 34 lb | FT = 20% |


LUMBER-
 TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 WEBS 2x4 SP No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 9-9-11 oc bracing.

REACTIONS. (size) 7=Mechanical, 2=0-3-8
 Max Horz 2=75(LC 8)
 Max Uplift 7=-41(LC 12), 2=-63(LC 8)
 Max Grav 7=310(LC 1), 2=369(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-520/298
 BOT CHORD 2-7=-373/477
 WEBS 3-7=-495/387

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-10-8 to 3-6-5, Interior(1) 3-6-5 to 8-0-0 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 7, 2.

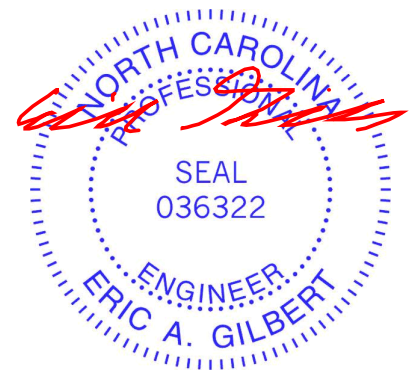

April 14, 2022


| | | | | | | |
|------------|-------|------------|-----|-----|--|-----------|
| Job | Truss | Truss Type | Qty | Ply | Southern Touch / 1 Hales Farm/ Harnett | 151368518 |
| J0922-4909 | M1GE | GABLE | 1 | 1 | Job Reference (optional) | |

Comtech, Inc., Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Wed Apr 13 16:15:36 2022 Page 1
ID:lwPOH6hK8Jeptt6SXqQJcym6C-u0c?aiEiWg78FYmhlUQgf_z98xSGUE3KoYyqZzR4S5



Scale = 1:16.4

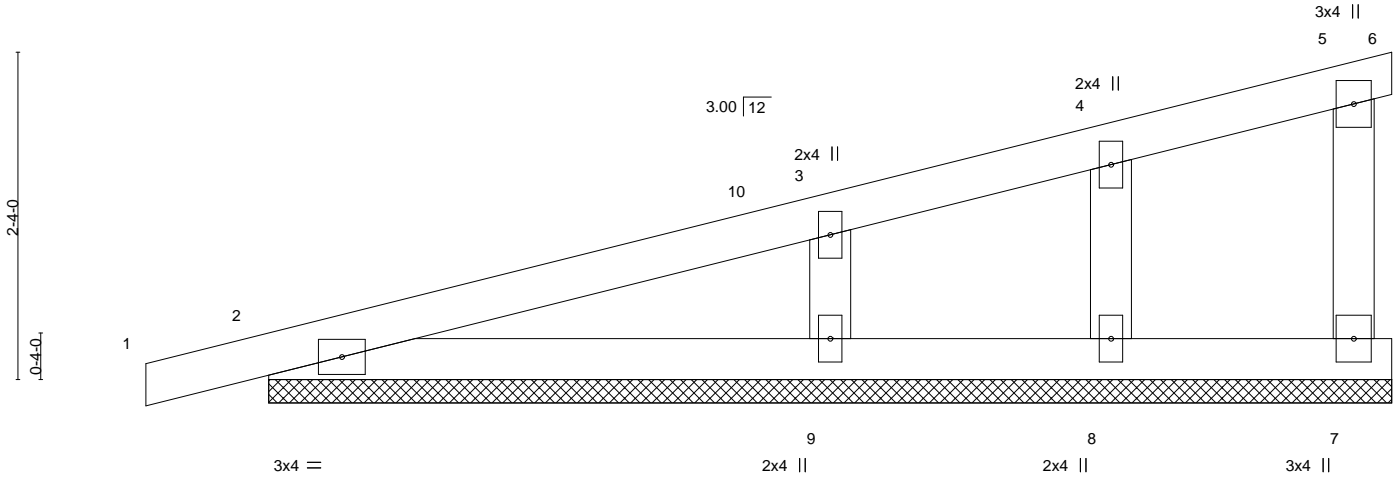


| | | | | | | | | | | |
|----------------------|----------------------|-------|-------------|--------------|-------|-------|--------|-----|---------------|-------------|
| LOADING (psf) | SPACING- | 2-0-0 | CSI. | DEFL. | in | (loc) | l/defl | L/d | PLATES | GRIP |
| TCLL 20.0 | Plate Grip DOL | 1.15 | TC 0.14 | Vert(LL) | -0.00 | 1 | n/r | 120 | MT20 | 244/190 |
| TCDL 10.0 | Lumber DOL | 1.15 | BC 0.09 | Vert(CT) | 0.00 | 1 | n/r | 120 | | |
| BCLL 0.0 * | Rep Stress Incr | YES | WB 0.05 | Horz(CT) | -0.00 | 6 | n/a | n/a | | |
| BCDL 10.0 | Code IRC2015/TPI2014 | | Matrix-P | | | | | | Weight: 31 lb | FT = 20% |

| | |
|-----------------------|---|
| LUMBER- | BRACING- |
| TOP CHORD 2x4 SP No.1 | TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals. |
| BOT CHORD 2x4 SP No.1 | BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing. |
| WEBS 2x4 SP No.2 | |
| OTHERS 2x4 SP No.2 | |

REACTIONS. All bearings 8-0-0.
(lb) - Max Horz 2=107(LC 8)
Max Uplift All uplift 100 lb or less at joint(s) 6, 7, 2, 8 except 9=-101(LC 12)
Max Grav All reactions 250 lb or less at joint(s) 6, 7, 2, 8 except 9=316(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 3-9=-234/302

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BC DL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) -0-10-8 to 3-6-5, Exterior(2) 3-6-5 to 8-0-0 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 3) Gable requires continuous bottom chord bearing.
 - 4) Gable studs spaced at 2-0-0 oc.
 - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 6) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 6, 7, 2, 8 except (jt=lb) 9=101.

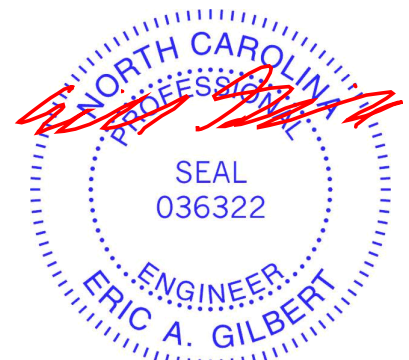

April 14, 2022

| | | | | | | |
|------------|-------|------------|-----|-----|--|-----------|
| Job | Truss | Truss Type | Qty | Ply | Southern Touch / 1 Hales Farm/ Harnett | I51368519 |
| J0922-4909 | M2 | MONOPITCH | 7 | 1 | Job Reference (optional) | |


Comtech, Inc., Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Wed Apr 13 16:15:37 2022 Page 1

ID:lwPOH6hK8Jeptt6SXqQOJcyzm6C-NCANn2FKH_F?siLTJ0PfdSvW6fYF4?xJCYSHVCSzR4S4



Scale = 1:12.9

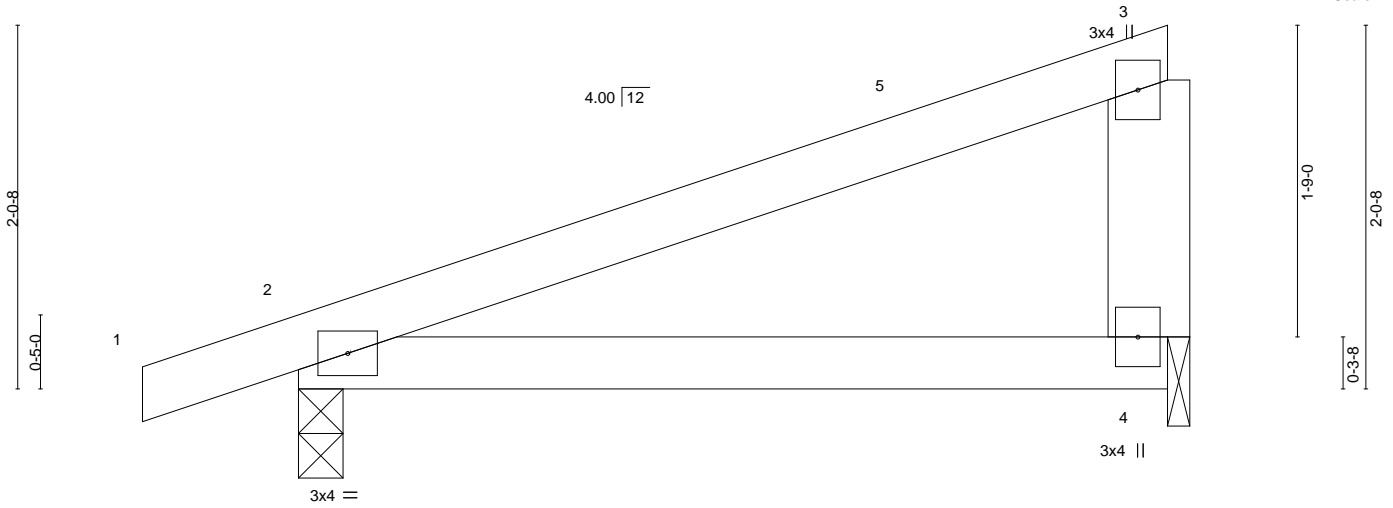

| LOADING (psf) | SPACING- | 2-0-0 | CSI. | DEFL. | in | (loc) | l/defl | L/d | PLATES | GRIP |
|---------------|----------------------|-------|----------|----------|-------|-------|--------|-----|---------------|----------|
| TCLL 20.0 | Plate Grip DOL | 1.15 | TC 0.28 | Vert(LL) | -0.02 | 2-4 | >999 | 360 | MT20 | 244/190 |
| TCDL 10.0 | Lumber DOL | 1.15 | BC 0.20 | Vert(CT) | -0.05 | 2-4 | >999 | 240 | | |
| BCLL 0.0 * | Rep Stress Incr | YES | WB 0.00 | Horz(CT) | 0.00 | | n/a | n/a | | |
| BCDL 10.0 | Code IRC2015/TPI2014 | | Matrix-P | Wind(LL) | 0.05 | 2-4 | >999 | 240 | Weight: 20 lb | FT = 20% |

LUMBER-

TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 WEBS 2x6 SP No.1

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

(size) 2=0-3-0, 4=0-1-8
 Max Horz 2=64(LC 8)
 Max Uplift 2=102(LC 8), 4=-78(LC 8)
 Max Grav 2=252(LC 1), 4=179(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-10-8 to 3-6-5, Interior(1) 3-6-5 to 4-9-4 zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Bearing at joint(s) 4 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 5) Provide mechanical connection (by others) of truss to bearing plate at joint(s) 4.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4 except (jt=lb) 2=102.

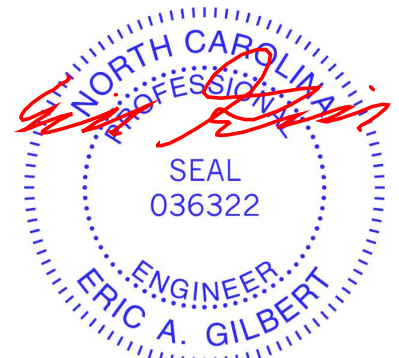

April 14, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

| | | | | | | |
|------------|-------|------------|-----|-----|--|-----------|
| Job | Truss | Truss Type | Qty | Ply | Southern Touch / 1 Hales Farm/ Harnett | 151368520 |
| J0922-4909 | M2GE | GABLE | 1 | 1 | Job Reference (optional) | |

Comtech, Inc., Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Wed Apr 13 16:15:37 2022 Page 1
 ID:lwPOH6hK8Jeppt6SXqQOJcyzm6C-NCANn2FKH_F?siLJ0PfdSWA9YII?xgCYSHVCszR4S4

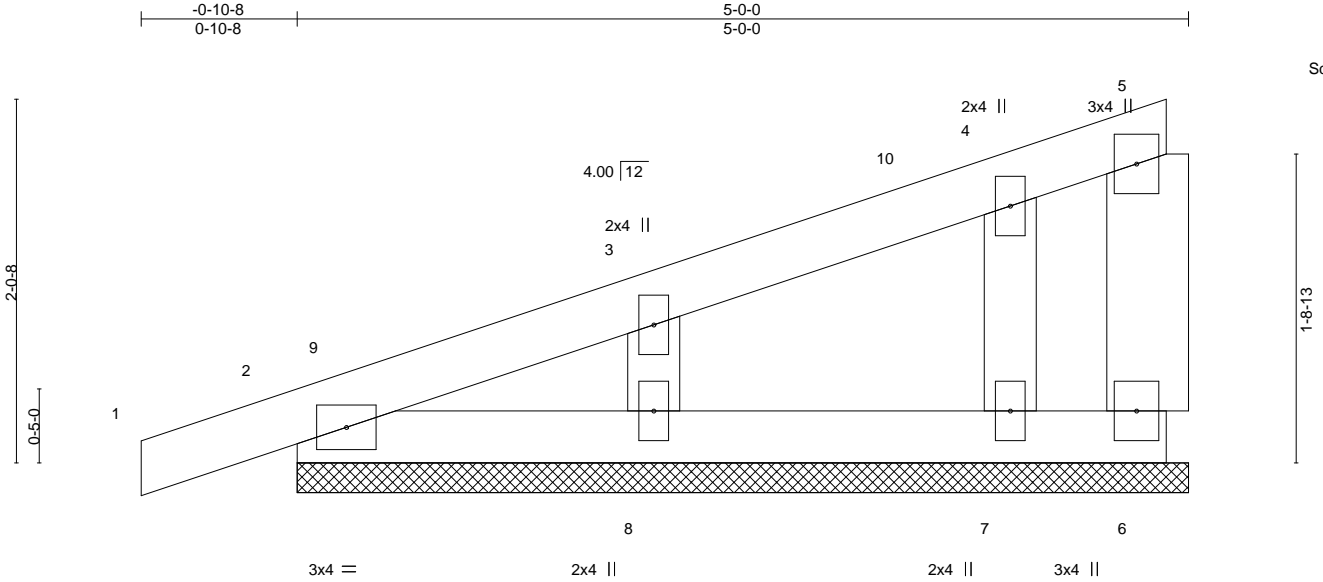

Scale = 1:12.9

| | | | | | | | | | | |
|----------------------|-----------------|-----------------|-------------|--------------|------|-------|--------|-----|---------------|-------------|
| LOADING (psf) | SPACING- | 2-0-0 | CSI. | DEFL. | in | (loc) | l/defl | L/d | PLATES | GRIP |
| TCLL 20.0 | Plate Grip DOL | 1.15 | TC 0.06 | Vert(LL) | 0.00 | 1 | n/r | 120 | MT20 | 244/190 |
| TCDL 10.0 | Lumber DOL | 1.15 | BC 0.03 | Vert(CT) | 0.00 | 1 | n/r | 120 | | |
| BCLL 0.0 * | Rep Stress Incr | YES | WB 0.04 | Horz(CT) | 0.00 | | n/a | n/a | | |
| BCDL 10.0 | Code | IRC2015/TPI2014 | Matrix-P | | | | | | Weight: 22 lb | FT = 20% |

LUMBER-

TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 WEBS 2x6 SP No.1
 OTHERS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

All bearings 5-0-0.
 (lb) - Max Horz 2=91(LC 8)
 Max Uplift All uplift 100 lb or less at joint(s) 6, 2, 8, 7
 Max Grav All reactions 250 lb or less at joint(s) 6, 2, 8, 7

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) -0-10-8 to 3-6-5, Exterior(2) 3-6-5 to 4-9-4 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) Gable requires continuous bottom chord bearing.
- 4) Gable studs spaced at 2-0-0 oc.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 6, 2, 8, 7.

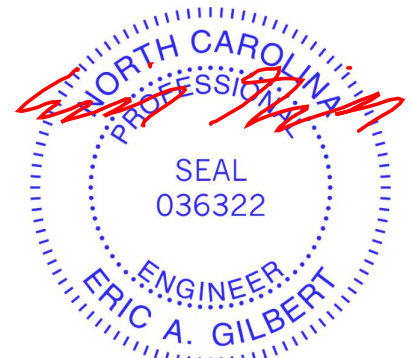

April 14, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

| | | | | | | |
|------------|-------|------------|-----|-----|--|-----------|
| Job | Truss | Truss Type | Qty | Ply | Southern Touch / 1 Hales Farm/ Harnett | 151368521 |
| J0922-4909 | P1 | COMMON | 5 | 1 | Job Reference (optional) | |

Comtech, Inc., Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Wed Apr 13 16:15:38 2022 Page 1
ID:lwPOH6hK8Jeptt6SXqQOJcyzm6C-rPkm?OGy2INrUsw3tjwul43l_ybHkOIMn613klzR4S3



Scale = 1:21.4

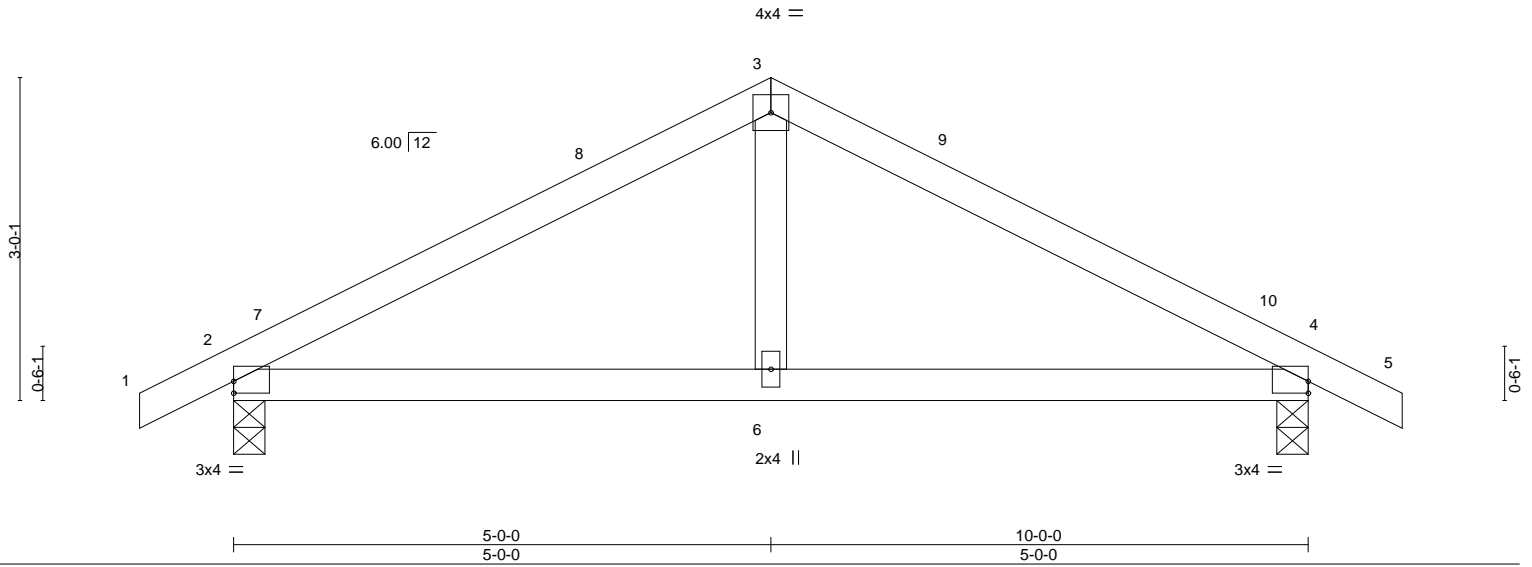


Plate Offsets (X,Y)-- [2:0-0-0,0-1-5], [4:0-0-0,0-1-5]

| LOADING (psf) | SPACING- | | CSI. | DEFL. | in | (loc) | l/defl | L/d | PLATES | GRIP |
|---------------|----------------------|-------|----------|----------------|-----|-------|--------|-----|---------------|----------|
| TCLL 20.0 | Plate Grip DOL 1.15 | 2-0-0 | TC 0.24 | Vert(LL) 0.04 | 2-6 | >999 | 240 | | MT20 | 244/190 |
| TCDL 10.0 | Lumber DOL 1.15 | | BC 0.20 | Vert(CT) -0.03 | 4-6 | >999 | 240 | | | |
| BCLL 0.0 * | Rep Stress Incr YES | | WB 0.05 | Horz(CT) 0.01 | 4 | n/a | n/a | | | |
| BCDL 10.0 | Code IRC2015/TPI2014 | | Matrix-S | | | | | | Weight: 38 lb | FT = 20% |

LUMBER-

TOP CHORD 2x4 SP No.1
BOT CHORD 2x4 SP No.1
WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 9-8-3 oc bracing.

REACTIONS.


(size) 2=0-3-8, 4=0-3-8
Max Horz 2=38(LC 11)
Max Uplift 2=-89(LC 9), 4=-89(LC 8)
Max Grav 2=450(LC 1), 4=450(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-518/572, 3-4=-518/572
BOT CHORD 2-6=-392/392, 4-6=-392/392
WEBS 3-6=-311/234

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-10-8 to 3-6-5, Interior(1) 3-6-5 to 5-0-0, Exterior(2) 5-0-0 to 9-4-13, Interior(1) 9-4-13 to 10-10-8 zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 4.

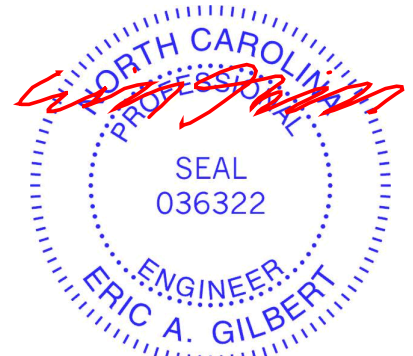

April 14, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932

| | | | | | | |
|------------|-------|----------------------|-----|-----|--|-----------|
| Job | Truss | Truss Type | Qty | Ply | Southern Touch / 1 Hales Farm/ Harnett | 151368522 |
| J0922-4909 | P1GE | COMMON SUPPORTED GAB | 1 | 1 | Job Reference (optional) | |

Comtech, Inc., Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Wed Apr 13 16:15:39 2022 Page 1

ID:lwPOH6hK8Jeptt6SXqQJcyzm6C-JbH8CkHaobVi60VGRRR7IHcTILwPTRuV0mncGIZR4S2



Scale = 1:21.4

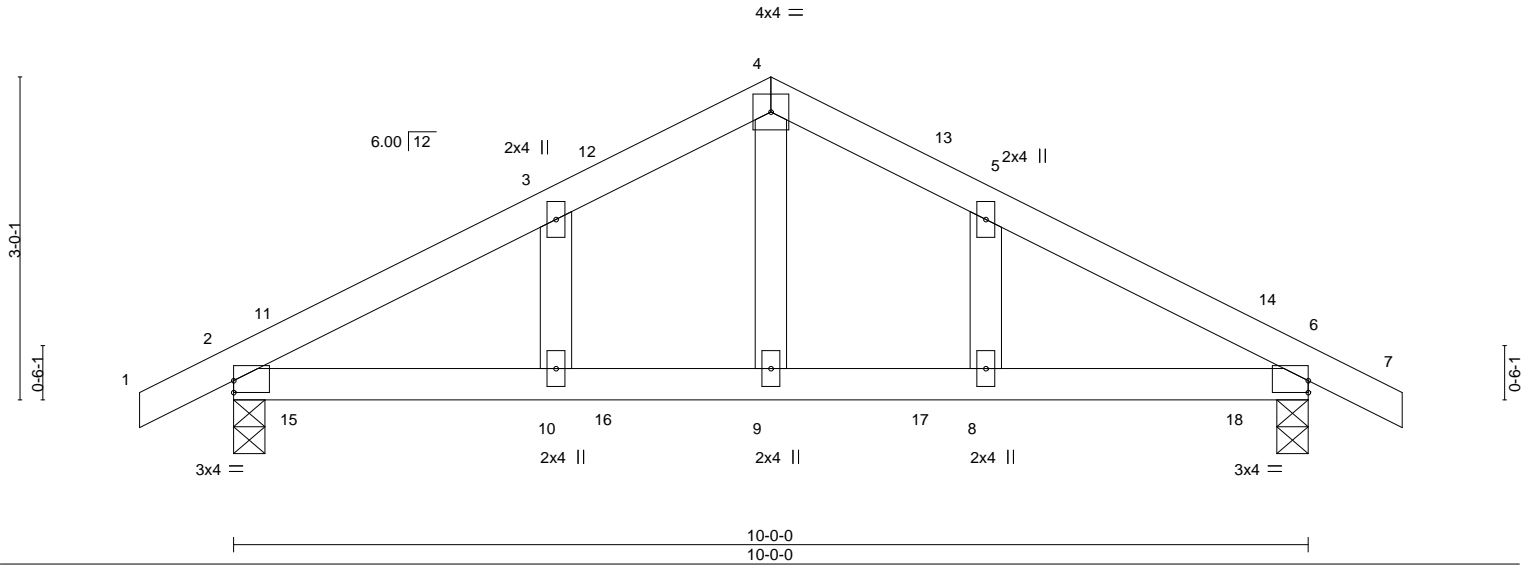


Plate Offsets (X,Y)-- [2:0-0-0,0-1-5], [6:0-0-0,0-1-5]

| LOADING (psf) | SPACING- | CSI. | DEFL. | in (loc) | l/defl | L/d | PLATES | GRIP |
|---------------|----------------------|----------|----------------|----------|--------|-----|---------------|----------|
| TCLL 20.0 | Plate Grip DOL 1.15 | TC 0.24 | Vert(LL) -0.02 | 10 | >999 | 360 | MT20 | 244/190 |
| TCDL 10.0 | Lumber DOL 1.15 | BC 0.27 | Vert(CT) -0.03 | 2-10 | >999 | 240 | | |
| BCLL 0.0 * | Rep Stress Incr YES | WB 0.06 | Horz(CT) -0.01 | 6 | n/a | n/a | | |
| BCDL 10.0 | Code IRC2015/TPI2014 | Matrix-S | Wind(LL) 0.05 | 2-10 | >999 | 240 | Weight: 43 lb | FT = 20% |


LUMBER-
 TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 OTHERS 2x4 SP No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 8-1-12 oc bracing.

REACTIONS. (size) 2=0-3-8, 6=0-3-8
 Max Horz 2=59(LC 12)
 Max Uplift 2=-117(LC 9), 6=-117(LC 8)
 Max Grav 2=450(LC 1), 6=450(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-514/746, 3-4=-448/794, 4-5=-448/794, 5-6=-514/746
 BOT CHORD 2-10=-515/397, 9-10=-515/397, 8-9=-515/397, 6-8=-515/397
 WEBS 4-9=-435/200

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) -0-10-8 to 3-6-5, Exterior(2) 3-6-5 to 5-0-0, Corner(3) 5-0-0 to 9-4-13, Exterior(2) 9-4-13 to 10-10-8 zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=117, 6=117.

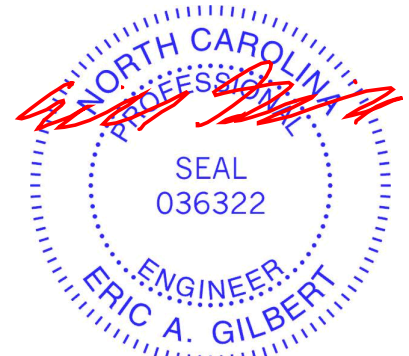

April 14, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

| | | | | | | |
|------------|-------|------------|-----|-----|--|-----------|
| Job | Truss | Truss Type | Qty | Ply | Southern Touch / 1 Hales Farm/ Harnett | 151368523 |
| J0922-4909 | V1AGE | GABLE | 1 | 1 | Job Reference (optional) | |

Comtech, Inc, Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Wed Apr 13 16:15:40 2022 Page 1

ID:lwPOH6hK8Jeptt6SXqQOJcyzm6C-nnrWP4HCZvdZj94S_ByMrV8g9IKACIYfEQWApBzR4S1

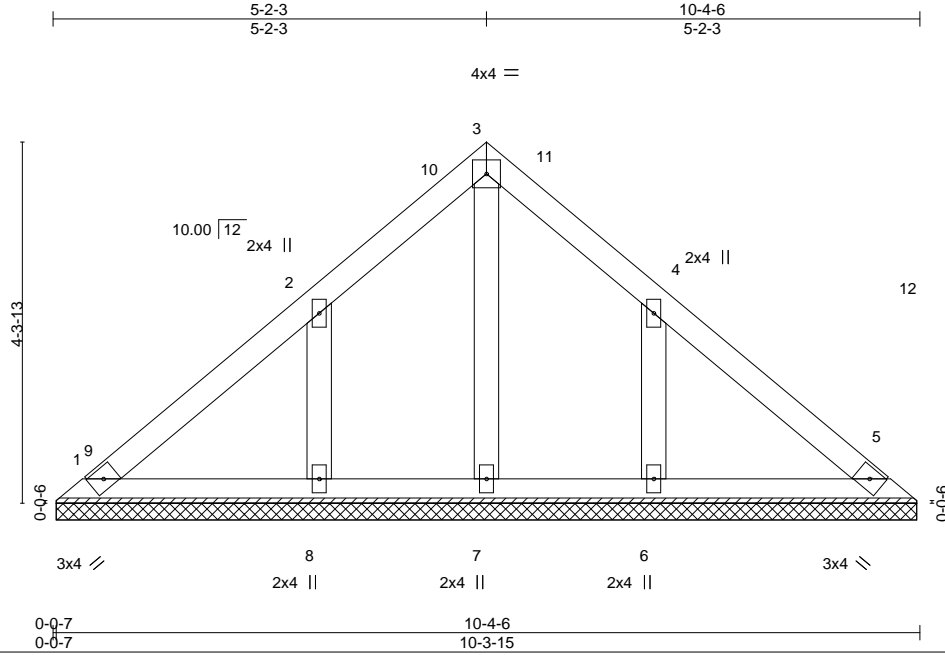

Scale = 1:27.5

Plate Offsets (X,Y)-- [4:0-0-0,0-0-0]

| LOADING (psf) | SPACING- | 2-0-0 | CSI. | DEFL. | in (loc) | l/defl | L/d | PLATES | GRIP |
|---------------|-----------------|-----------------|----------|----------|----------|--------|-----|---------------|----------|
| TCLL 20.0 | Plate Grip DOL | 1.15 | TC 0.07 | Vert(LL) | n/a | - | n/a | MT20 | 244/190 |
| TCDL 10.0 | Lumber DOL | 1.15 | BC 0.04 | Vert(CT) | n/a | - | n/a | | |
| BCLL 0.0 * | Rep Stress Incr | YES | WB 0.03 | Horz(CT) | 0.00 | 5 | n/a | | |
| BCDL 10.0 | Code | IRC2015/TPI2014 | Matrix-S | | | | | Weight: 46 lb | FT = 20% |

LUMBER-
 TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 OTHERS 2x4 SP No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6'-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10'-0-0 oc bracing.

REACTIONS. All bearings 10-3-7.
 (lb) - Max Horz 1=-119(LC 8)
 Max Uplift All uplift 100 lb or less at joint(s) 1 except 8=-165(LC 12), 6=-164(LC 13)
 Max Grav All reactions 250 lb or less at joint(s) 1, 5, 7 except 8=274(LC 19), 6=273(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) 0-4-13 to 4-9-10, Interior(1) 4-9-10 to 5-2-3, Exterior(2) 5-2-3 to 9-7-0, Interior(1) 9-7-0 to 9-11-9 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3'-6" tall by 2'-0" wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1 except (jt=lb) 8=165, 6=164.



April 14, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

| | | | | | | |
|------------|-------|------------|-----|-----|--|-----------|
| Job | Truss | Truss Type | Qty | Ply | Southern Touch / 1 Hales Farm/ Harnett | I51368524 |
| J0922-4909 | V1GE | GABLE | 1 | 1 | Job Reference (optional) | |

Comtech, Inc, Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Wed Apr 13 16:15:41 2022 Page 1
 ID:IwPOH6hK8Jeptt6SXqQOJcym6C-F_PudPlrKDIQLJeeYrTbNihsQ9f1xk1oT4GjLdzR4S0
 15-6-11 7-9-6

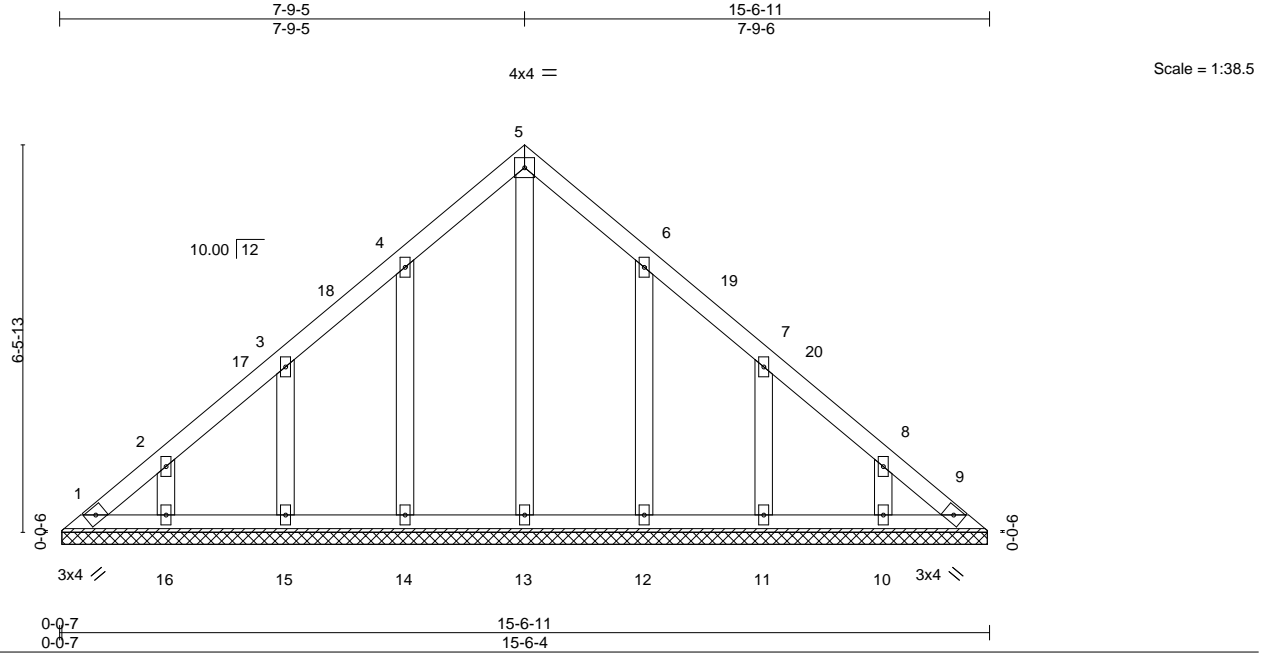

| | | | | | |
|----------------------|----------------------|-------------|-------------------------|---------------|-------------|
| LOADING (psf) | SPACING- | CSI. | DEFL. | PLATES | GRIP |
| TCLL 20.0 | 2-0-0 | TC 0.04 | in (loc) l/defl L/d | MT20 | 244/190 |
| TCDL 10.0 | Plate Grip DOL 1.15 | BC 0.02 | Vert(LL) n/a - n/a 999 | | |
| BCLL 0.0 * | Lumber DOL 1.15 | WB 0.08 | Vert(CT) n/a - n/a 999 | | |
| BCDL 10.0 | Rep Stress Incr YES | Matrix-S | Horz(CT) 0.00 9 n/a n/a | Weight: 83 lb | FT = 20% |
| | Code IRC2015/TPI2014 | | | | |

LUMBER-

TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 OTHERS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

All bearings 15-5-13.
 (lb) - Max Horz 1=184(LC 11)
 Max Uplift All uplift 100 lb or less at joint(s) 1, 9 except 14=-114(LC 12), 15=-113(LC 12), 16=-103(LC 12), 12=-112(LC 13), 11=-114(LC 13), 10=-103(LC 13)
 Max Grav All reactions 250 lb or less at joint(s) 1, 9, 13, 14, 15, 16, 12, 11, 10

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) 0-4-13 to 4-9-10, Interior(1) 4-9-10 to 7-9-5, Exterior(2) 7-9-5 to 12-2-2, Interior(1) 12-2-2 to 15-1-14 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 9 except (jt=lb) 14=114, 15=113, 16=103, 12=112, 11=114, 10=103.



April 14, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

| | | | | | | |
|------------|-------|------------|-----|-----|--|-----------|
| Job | Truss | Truss Type | Qty | Ply | Southern Touch / 1 Hales Farm/ Harnett | I51368525 |
| J0922-4909 | V2 | VALLEY | 1 | 1 | Job Reference (optional) | |

Comtech, Inc, Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Wed Apr 13 16:15:42 2022 Page 1
ID:lwPOH6hK8Jeptt6SXqQOJcyzm6C-jAzGqJt5WtHzTDr6Z?qwwE?kZ_wgBQxik?Gt3zR4S?

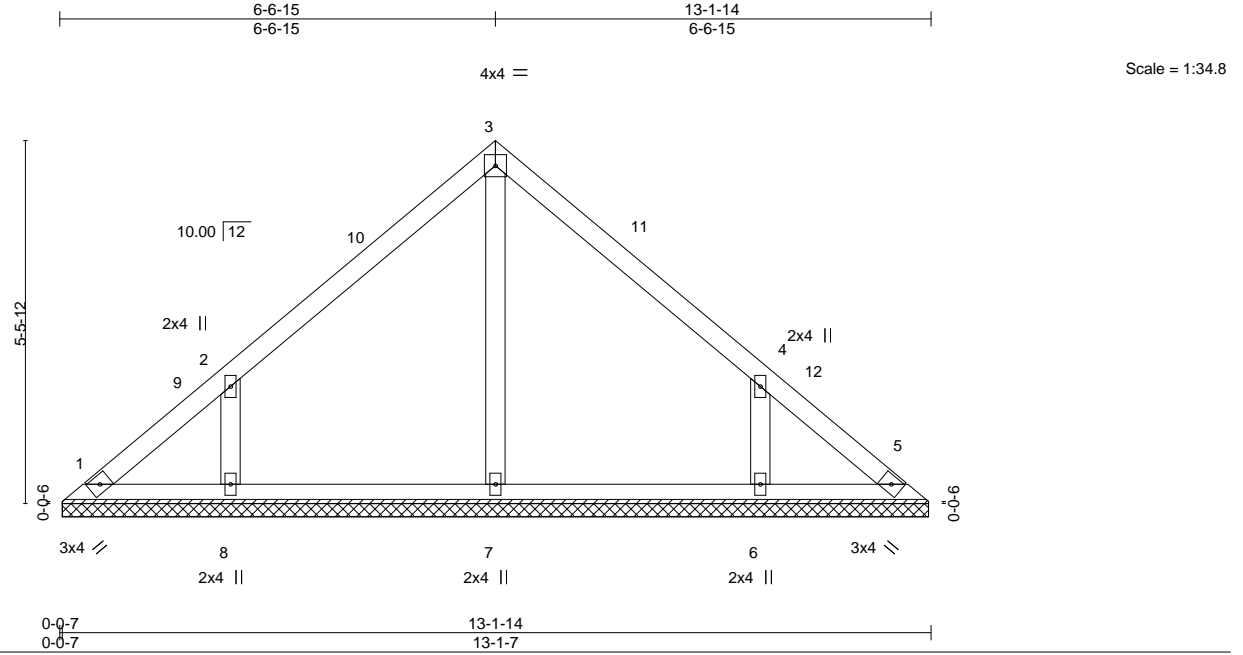


Plate Offsets (X,Y)-- [4:0-0-0,0-0-0]

| LOADING (psf) | SPACING- | CSL | DEFL. | in (loc) | l/defl | L/d | PLATES | GRIP |
|---------------|----------------------|----------|---------------|----------|--------|-----|---------------|----------|
| TCLL 20.0 | Plate Grip DOL 1.15 | TC 0.13 | Vert(LL) n/a | - | n/a | 999 | MT20 | 244/190 |
| TCDL 10.0 | Lumber DOL 1.15 | BC 0.09 | Vert(CT) n/a | - | n/a | 999 | | |
| BCLL 0.0 * | Rep Stress Incr YES | WB 0.07 | Horz(CT) 0.00 | 5 | n/a | n/a | | |
| BCDL 10.0 | Code IRC2015/TPI2014 | Matrix-S | | | | | Weight: 55 lb | FT = 20% |


LUMBER-
TOP CHORD 2x4 SP No.1
BOT CHORD 2x4 SP No.1
OTHERS 2x4 SP No.2

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 13-0-15.
(lb) - Max Horz 1=123(LC 8)
Max Uplift All uplift 100 lb or less at joint(s) 1, 5 except 8=125(LC 12), 6=125(LC 13)
Max Grav All reactions 250 lb or less at joint(s) 1, 5, 7 except 8=333(LC 19), 6=333(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 2-8=-315/239, 4-6=-315/239

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-4-13 to 4-9-10, Interior(1) 4-9-10 to 6-6-15, Exterior(2) 6-6-15 to 10-11-12, Interior(1) 10-11-12 to 12-9-1 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5 except (jt=lb) 8=125, 6=125.

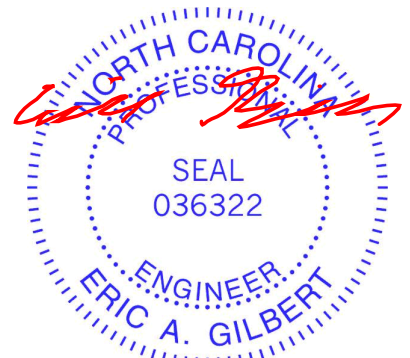

April 14, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932

| | | | | | | |
|------------|-------|------------|-----|-----|--|-----------|
| Job | Truss | Truss Type | Qty | Ply | Southern Touch / 1 Hales Farm/ Harnett | 151368526 |
| J0922-4909 | V3 | VALLEY | 1 | 1 | Job Reference (optional) | |

Comtech, Inc., Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Wed Apr 13 16:15:43 2022 Page 1

ID:lwPOH6hK8Jeppt6SXqQOJcym6C-BMXf25K5sq?8ado1gGW3S7mANzKAPf15xOlqPWzR4S_

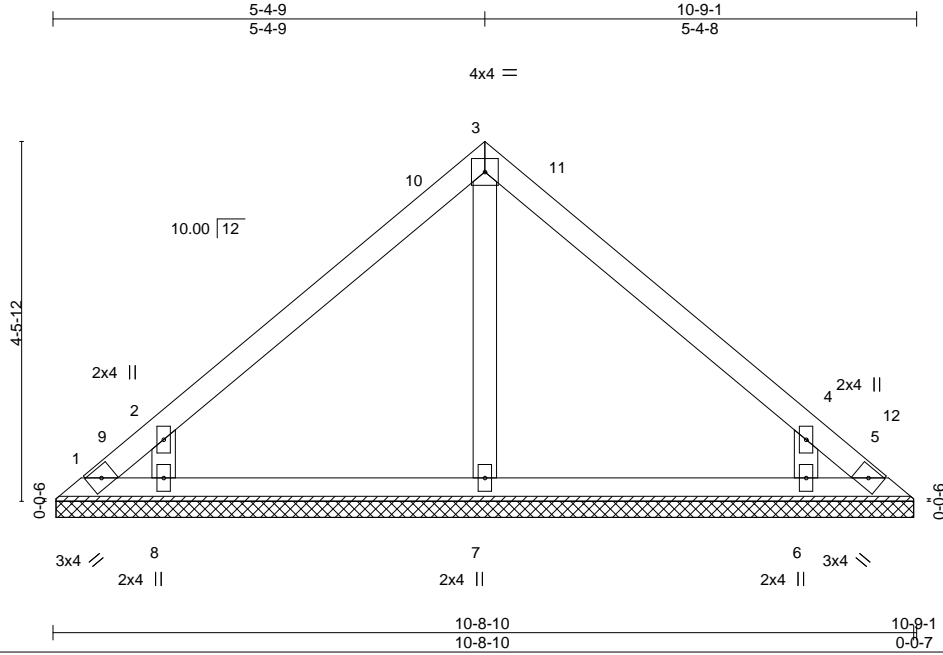

Scale = 1:28.7

Plate Offsets (X,Y)-- [4:0-0-0-0-0-0]

| LOADING (psf) | SPACING- | CSI. | DEFL. | in (loc) | l/defl | L/d | PLATES | GRIP |
|---------------|----------------------|----------|---------------|----------|--------|-----|---------------|----------|
| TCLL 20.0 | Plate Grip DOL 1.15 | TC 0.14 | Vert(LL) n/a | - | n/a | 999 | MT20 | 244/190 |
| TCDL 10.0 | Lumber DOL 1.15 | BC 0.09 | Vert(CT) n/a | - | n/a | 999 | | |
| BCLL 0.0 * | Rep Stress Incr YES | WB 0.05 | Horz(CT) 0.00 | 5 | n/a | n/a | | |
| BCDL 10.0 | Code IRC2015/TPI2014 | Matrix-S | | | | | Weight: 43 lb | FT = 20% |

LUMBER-
 TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 OTHERS 2x4 SP No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6'-0" oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10'-0" oc bracing.

REACTIONS. All bearings 10-8-3.
 (lb) - Max Horz 1=99(LC 8)
 Max Uplift All uplift 100 lb or less at joint(s) 1, 5 except 8=135(LC 12), 6=135(LC 13)
 Max Grav All reactions 250 lb or less at joint(s) 1, 5, 7 except 8=350(LC 19), 6=349(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 WEBS 2-8=-348/281, 4-6=-349/281

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-4-13 to 4-9-10, Interior(1) 4-9-10 to 5-4-9, Exterior(2) 5-4-9 to 9-9-5, Interior(1) 9-9-5 to 10-4-4 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5 except (jt=lb) 8=135, 6=135.



April 14, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

| | | | | | | |
|------------|-------|------------|-----|-----|--|-----------|
| Job | Truss | Truss Type | Qty | Ply | Southern Touch / 1 Hales Farm/ Harnett | 151368527 |
| J0922-4909 | V4 | VALLEY | 1 | 1 | Job Reference (optional) | |


Comtech, Inc, Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Wed Apr 13 16:15:44 2022 Page 1

ID:lwPOH6hK8Jeptt6SXqQQJcym6C-fZ51FRLjd87?CnNDD_1!LJK_Mg886aE92UNxyzR4Rz



Scale = 1:23.3

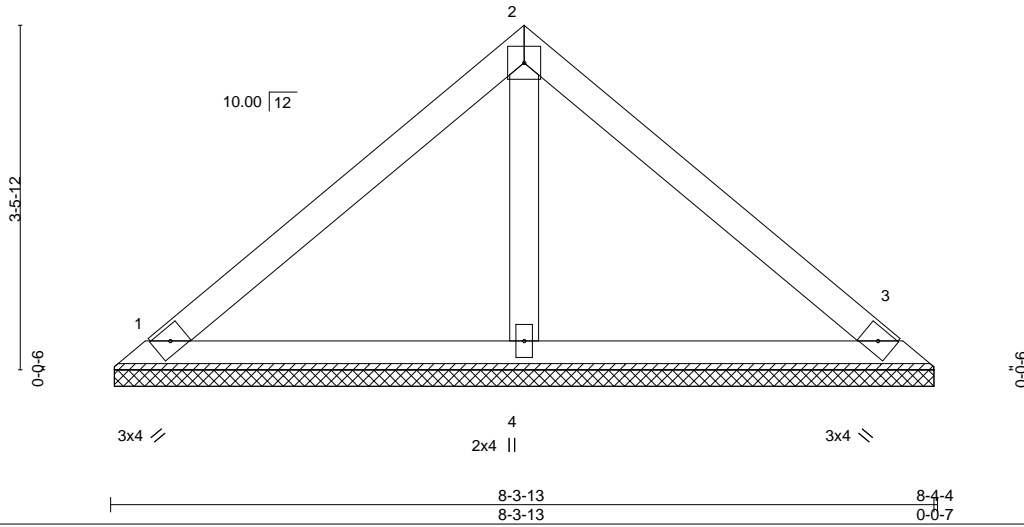

| | | | | | | | | | |
|----------------------|----------------------|-------------|--------------|------|-------|--------|-----|---------------|-------------|
| LOADING (psf) | SPACING- | CSI. | DEFL. | in | (loc) | l/defl | L/d | PLATES | GRIP |
| TCLL 20.0 | 2-0-0 | TC 0.21 | Vert(LL) | n/a | - | n/a | 999 | MT20 | 244/190 |
| TCDL 10.0 | Plate Grip DOL 1.15 | BC 0.11 | Vert(CT) | n/a | - | n/a | 999 | | |
| BCLL 0.0 * | Lumber DOL 1.15 | WB 0.03 | Horz(CT) | 0.00 | 3 | n/a | n/a | | |
| BCDL 10.0 | Rep Stress Incr YES | Matrix-P | | | | | | Weight: 31 lb | FT = 20% |
| | Code IRC2015/TPI2014 | | | | | | | | |

LUMBER-

TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 OTHERS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=8-3-6, 3=8-3-6, 4=8-3-6
 Max Horz 1=75(LC 9)
 Max Uplift 1=-26(LC 13), 3=-33(LC 13)
 Max Grav 1=175(LC 1), 3=175(LC 1), 4=255(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.



April 14, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

| | | | | | | |
|------------|-------|------------|-----|-----|--|-----------|
| Job | Truss | Truss Type | Qty | Ply | Southern Touch / 1 Hales Farm/ Harnett | 151368528 |
| J0922-4909 | V5 | VALLEY | 1 | 1 | Job Reference (optional) | |


Comtech, Inc., Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Wed Apr 13 16:15:45 2022 Page 1

ID:lwPOH6hK8Jeptt6SXqQOJcyzm6C-8lfPTnLLORFsqxyPnhYXYsXYm1FY4OOiEwTOzR4Ry



Scale = 1:17.4

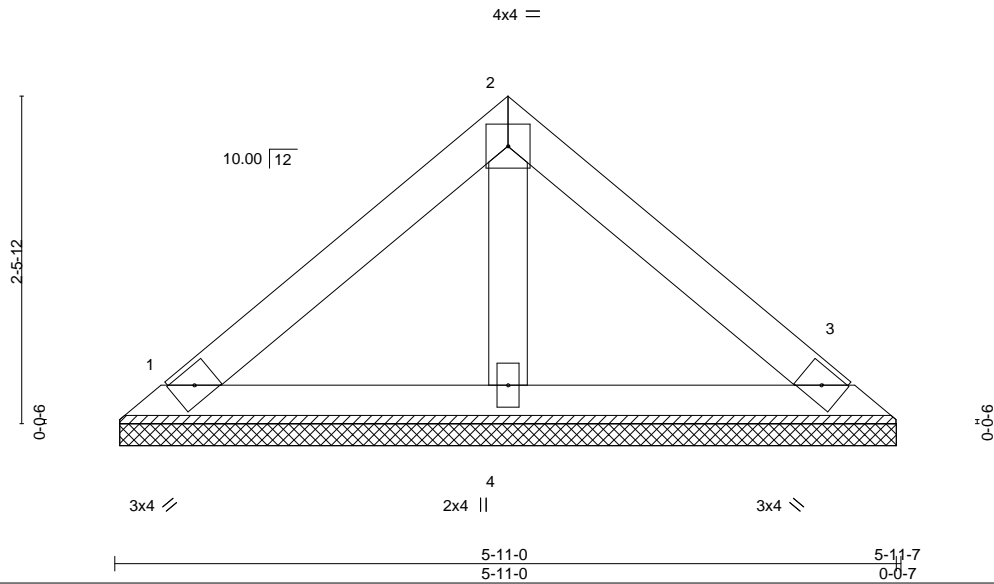

| | | | | | | | | | |
|----------------------|----------------------|-------------|---------------|----|-------|--------|-----|---------------|-------------|
| LOADING (psf) | SPACING- | CSI. | DEFL. | in | (loc) | l/defl | L/d | PLATES | GRIP |
| TCLL 20.0 | Plate Grip DOL 1.15 | TC 0.09 | Vert(LL) n/a | - | n/a | 999 | | MT20 | 244/190 |
| TCDL 10.0 | Lumber DOL 1.15 | BC 0.05 | Vert(CT) n/a | - | n/a | 999 | | | |
| BCLL 0.0 * | Rep Stress Incr YES | WB 0.01 | Horz(CT) 0.00 | 3 | n/a | n/a | | | |
| BCDL 10.0 | Code IRC2015/TPI2014 | Matrix-P | | | | | | Weight: 21 lb | FT = 20% |

LUMBER-

TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 OTHERS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-11-7 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

(size) 1=5-10-9, 3=5-10-9, 4=5-10-9
 Max Horz 1=51(LC 9)
 Max Uplift 1=18(LC 13), 3=-23(LC 13)
 Max Grav 1=119(LC 1), 3=119(LC 1), 4=174(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.

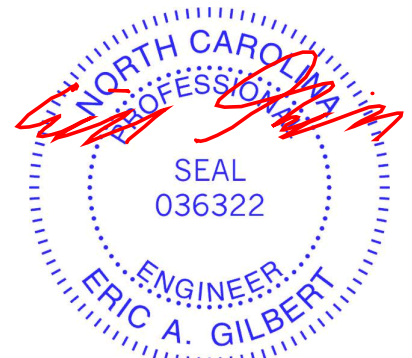

April 14, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

| | | | | | | |
|------------|-------|------------|-----|-----|--|-----------|
| Job | Truss | Truss Type | Qty | Ply | Southern Touch / 1 Hales Farm/ Harnett | 151368529 |
| J0922-4909 | V6 | VALLEY | 1 | 1 | Job Reference (optional) | |


Comtech, Inc., Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Wed Apr 13 16:15:46 2022 Page 1

ID:lwPOH6hK8Jeptt6SXqQJcyzm6C-cxCng7Mz9IOjS4XcLP3m4mOjLAMFc?YXdMzU?rzR4Rx



Scale = 1:10.2

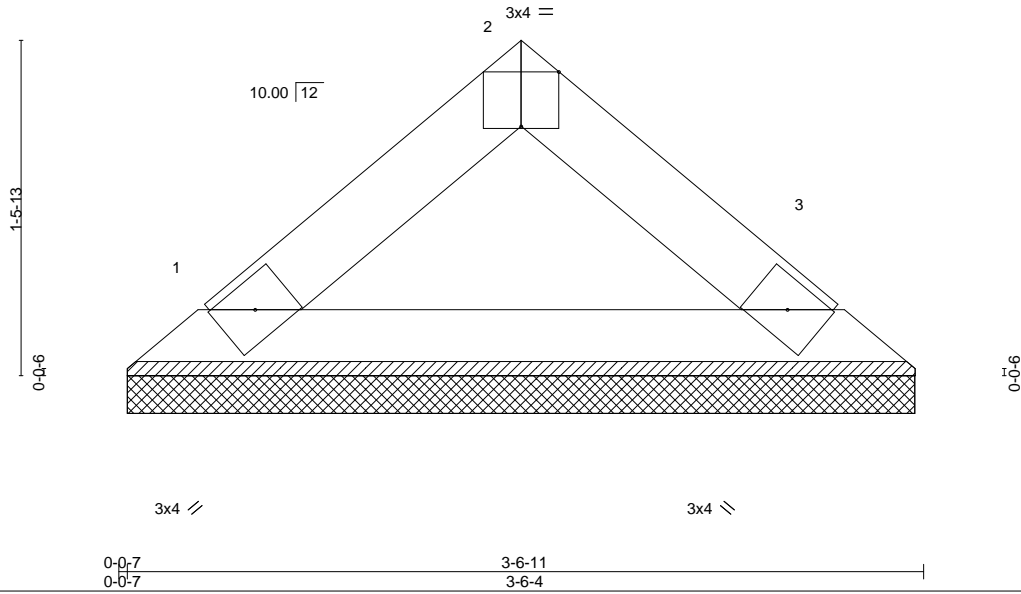

| LOADING (psf) | | SPACING- | | CSI. | | DEFL. | | | | PLATES | | GRIP | |
|---------------|-------|-----------------|-----------------|----------|------|----------|------|---|-----|--------|------------------------|---------|--|
| TCLL | 20.0 | Plate Grip DOL | 1.15 | TC | 0.03 | Vert(LL) | n/a | - | n/a | 999 | MT20 | 244/190 | |
| TCDL | 10.0 | Lumber DOL | 1.15 | BC | 0.06 | Vert(CT) | n/a | - | n/a | 999 | Weight: 11 lb FT = 20% | | |
| BCLL | 0.0 * | Rep Stress Incr | YES | WB | 0.00 | Horz(CT) | 0.00 | 3 | n/a | n/a | | | |
| BCDL | 10.0 | Code | IRC2015/TPI2014 | Matrix-P | | | | | | | | | |


LUMBER-
 TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 3-6-11 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 1=3-5-12, 3=3-5-12
 Max Horz 1=-27(LC 10)
 Max Uplift 1=-5(LC 12), 3=-5(LC 13)
 Max Grav 1=110(LC 1), 3=110(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.
 - Non Standard bearing condition. Review required.

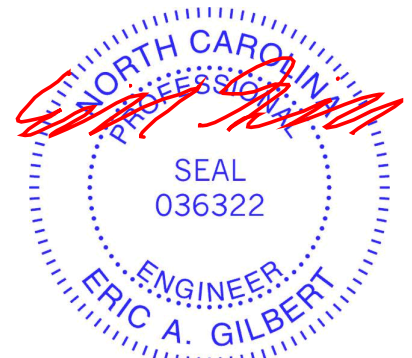

April 14, 2022


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.

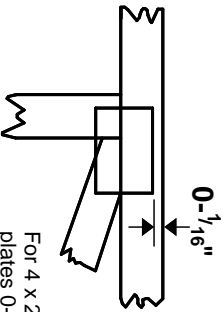

For 4 x 2 orientation, locate plates 0- 1/16" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

* Plate location details available in **MITek 20/20 software** or upon request.

PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur. Min size shown is for crushing only.

Industry Standards:

ANSI/TFP 1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-89: Design Standard for Bracing, Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

6-4-8
dimensions shown in ft-in-sixteenths
(Drawings not to scale)

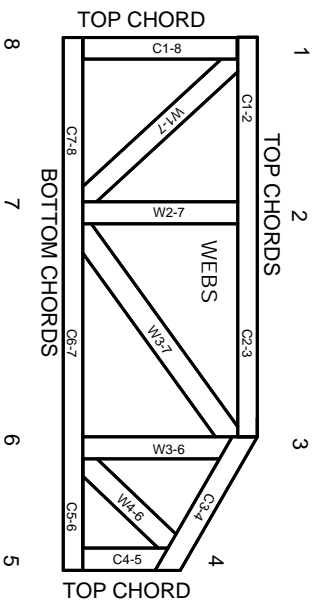

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ESR1988
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TFP 1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MITteK® All Rights Reserved



MITek Engineering Reference Sheet: MII-7473 rev. 5/19/2020



General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TFP 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TFP 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TFP 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.