

Trenco
818 Soundside Rd
Edenton, NC 27932

Re: J0922-4905
Southern Touch/9 Forest Grove/Harnett

The truss drawing(s) referenced below have been prepared by Truss Engineering Co. under my direct supervision based on the parameters provided by Comtech, Inc - Fayetteville.

Pages or sheets covered by this seal: I54650011 thru I54650018

My license renewal date for the state of North Carolina is December 31, 2022.

North Carolina COA: C-0844



October 12, 2022

Johnson, Andrew


IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

Job J0922-4905	Truss A1	Truss Type GABLE	Qty 1	Ply 1	Southern Touch/9 Forest Grove/Harnett 154650011
-------------------	-------------	---------------------	----------	----------	--

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Oct 11 08:12:18 2022 Page 1

ID:AFkd_HROst7l38Sk76BQjAyUkX_-vn8YJE9oOGB4oJJUxWvFinS7U0xMUJ?Ql6QdOAYUYHB



4x12 ||

Scale = 1:67.1

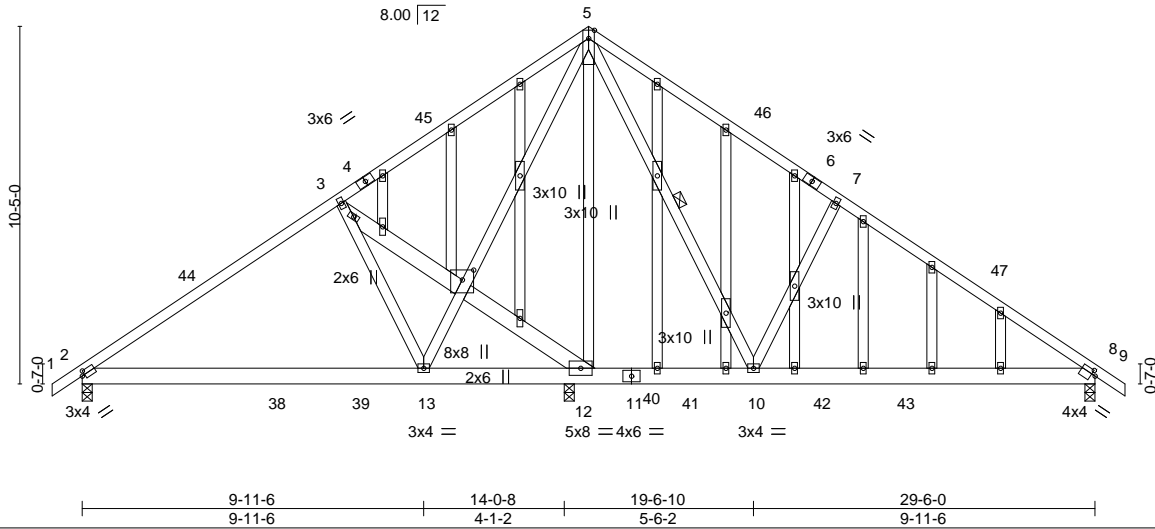


Plate Offsets (X,Y)--	[2:0-1-0,0-1-8], [8:0-1-5,0-1-8], [15:0-3-7,0-3-15]
-----------------------	---

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.54	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.46	Vert(LL) -0.11 2-13 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.54	Vert(CT) -0.22 2-13 >772 240		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.03 8 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.18 8-10 >998 240	Weight: 271 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1	TOP CHORD Structural wood sheathing directly applied or 4-5-8 oc purlins.
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied or 9-2-13 oc bracing.
WEBS 2x4 SP No.2 *Except*	WEBS 1 Row at midpt 5-10
14-15,12-15: 2x6 SP No.1	
OTHERS 2x4 SP No.2	

REACTIONS. (size) 2=0-3-8, 8=0-3-8, 12=0-3-8
 Max Horz 2=-312(LC 10)
 Max Uplift 2=-248(LC 12), 8=-252(LC 13), 12=-11(LC 12)
 Max Grav 2=1161(LC 19), 8=1156(LC 2), 12=192(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-1520/576, 3-5=-1357/666, 5-7=-1389/937, 7-8=-1553/847
 BOT CHORD 2-13=-329/1339, 12-13=-165/840, 10-12=-165/840, 8-10=-566/1195
 WEBS 3-13=-471/376, 5-13=-251/712, 5-10=-641/658, 7-10=-470/376


- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) 0-10-8 to 3-6-5, Interior(1) 3-6-5 to 14-9-0, Exterior(2) 14-9-0 to 19-1-13, Interior(1) 19-1-13 to 30-4-8 zone; porch right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 248 lb uplift at joint 2, 252 lb uplift at joint 8 and 11 lb uplift at joint 12.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



Job J0922-4905	Truss A2	Truss Type FINK	Qty 2	Ply 1	Southern Touch/9 Forest Grove/Harnett 154650012
-------------------	-------------	--------------------	----------	----------	--

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Oct 11 08:12:20 2022 Page 1
ID:AFkd_HROst7138Sk?6BQjAyUkX_-r9GJjwB2wuSo2dTt3xxjnCXsZqdryGOjCQvkT2yUYH9



4x6 ||

Scale: 3/16"=1'

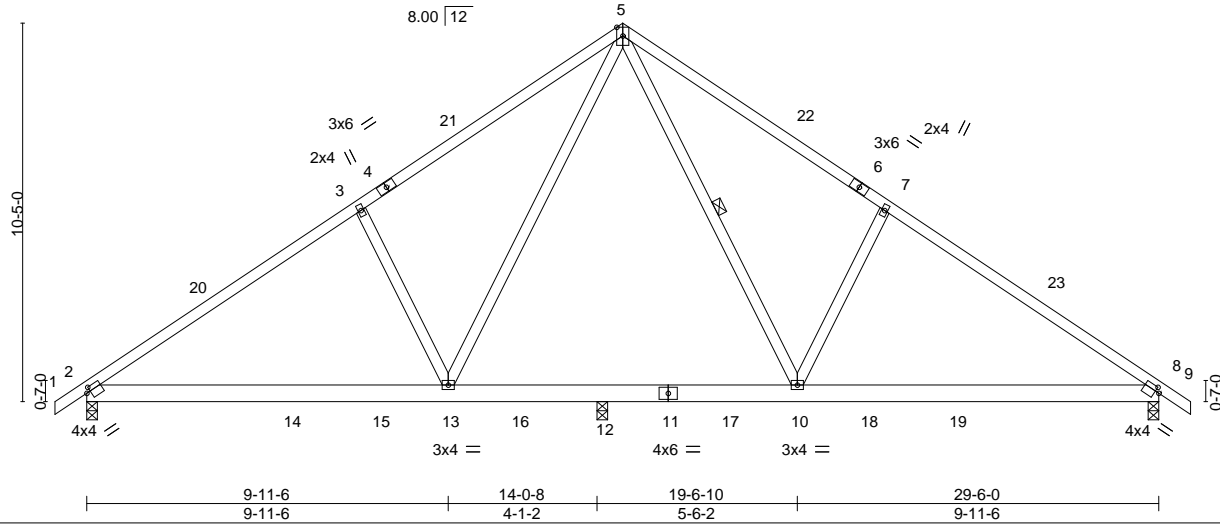


Plate Offsets (X,Y)--	[2:0-1-5,0-1-8], [8:0-1-5,0-1-8]
-----------------------	----------------------------------

LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.54	Vert(LL) -0.11 2-13 >999 360	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.46	Vert(CT) -0.22 2-13 >756 240		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.36	Horz(CT) 0.03 8 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S	Wind(LL) 0.18 8-10 >999 240	Weight: 173 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1	TOP CHORD Structural wood sheathing directly applied or 4-5-8 oc purlins.
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied or 9-2-13 oc bracing.
WEBS 2x4 SP No.2	WEBS 1 Row at midpt 5-10

REACTIONS. (size) 2=0-3-8, 8=0-3-8, 12=0-3-8
 Max Horz 2=-250(LC 10)
 Max Uplift 2=-80(LC 12), 8=-107(LC 8), 12=-12(LC 9)
 Max Grav 2=1168(LC 19), 8=1162(LC 2), 12=316(LC 18)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-1537/572, 3-5=-1374/661, 5-7=-1400/938, 7-8=-1563/847
 BOT CHORD 2-13=-325/1318, 12-13=-164/828, 10-12=-164/828, 8-10=-566/1204
 WEBS 3-13=-471/281, 5-13=-118/710, 5-10=-645/659, 7-10=-470/286


- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-10-8 to 3-6-5, Interior(1) 3-6-5 to 14-9-0, Exterior(2) 14-9-0 to 19-1-13, Interior(1) 19-1-13 to 30-4-8 zone; porch right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 80 lb uplift at joint 2, 107 lb uplift at joint 8 and 12 lb uplift at joint 12.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



Job J0922-4905	Truss A3	Truss Type Roof Special	Qty 8	Ply 1	Southern Touch/9 Forest Grove/Harnett 154650013
-------------------	-------------	----------------------------	----------	----------	--

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Oct 11 08:12:21 2022 Page 1
ID:AFkd_HROst7I38Sk?6BQjAyUkX_-JMqhxFCbhBaffn23ceSyJP4dQD11hi9tR4fl?VyUYH8



4x6 =

Scale = 1:64.8

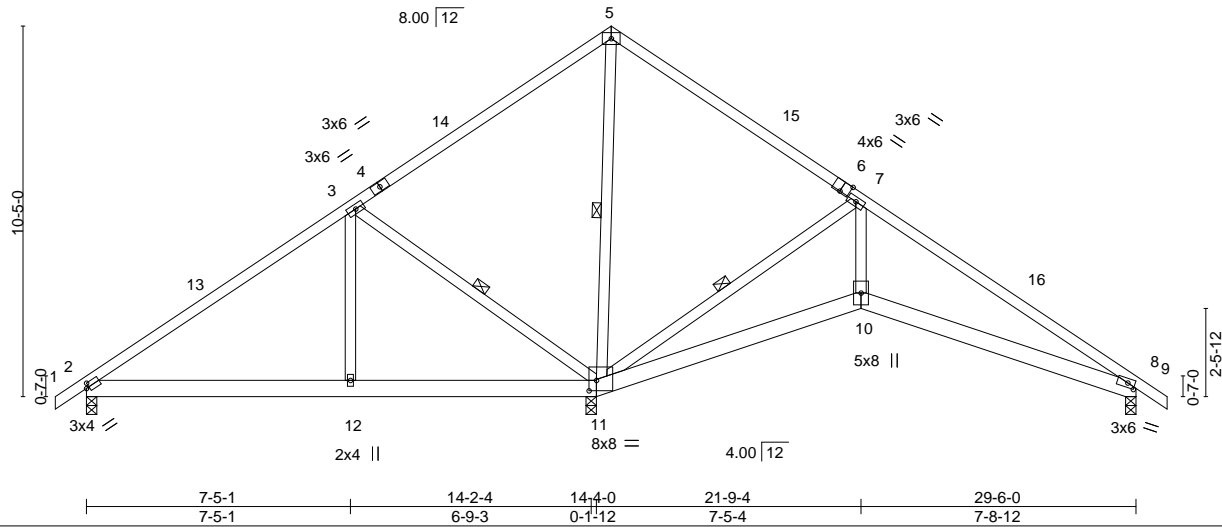


Plate Offsets (X, Y)--	[2:0-1-0,0-1-8], [6:0-3-0,Edge], [8:0-2-7,0-1-8], [11:0-2-8,0-3-8]
------------------------	--


LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.56	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.25	Vert(LL) -0.03 8-10 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.39	Vert(CT) -0.08 8-10 >999 240		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.03 8 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.03 8-10 >999 240	Weight: 178 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.2	WEBS 1 Row at midpt 3-11, 5-11, 7-11

REACTIONS. (size) 2=0-3-8, 11=0-3-8, 8=0-3-8
 Max Horz 2=250(LC 11)
 Max Uplift 2=-51(LC 12), 11=-48(LC 12), 8=-59(LC 13)
 Max Grav 2=479(LC 23), 11=1686(LC 1), 8=424(LC 24)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-435/196, 3-5=0/564, 5-7=0/515, 7-8=-474/49
 BOT CHORD 2-12=-191/271, 11-12=-191/271, 10-11=0/328, 8-10=0/338
 WEBS 3-12=0/334, 3-11=-707/243, 5-11=-860/89, 7-11=-760/188, 7-10=0/424

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-10-8 to 3-6-5, Interior(1) 3-6-5 to 14-9-0, Exterior(2) 14-9-0 to 19-1-13, Interior(1) 19-1-13 to 30-4-8 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Bearing at joint(s) 8 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 51 lb uplift at joint 2, 48 lb uplift at joint 11 and 59 lb uplift at joint 8.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

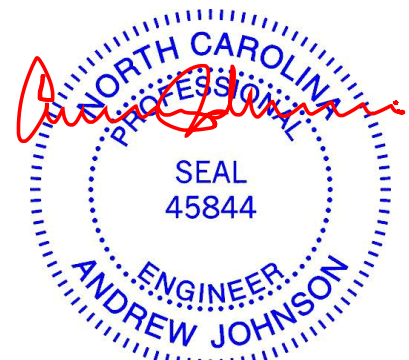


October 12, 2022

Job J0922-4905	Truss A4	Truss Type COMMON	Qty 8	Ply 1	Southern Touch/9 Forest Grove/Harnett 154650014
-------------------	-------------	----------------------	----------	----------	--

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Oct 11 08:12:22 2022 Page 1

ID:AFkd_HROst7138Sk?6BQjAyUkX_-nYO38bCJSViWHxdFAMzBsdchhdGWQ3G0gkOrYxyUYH7



3x4 =

Scale = 1:64.8

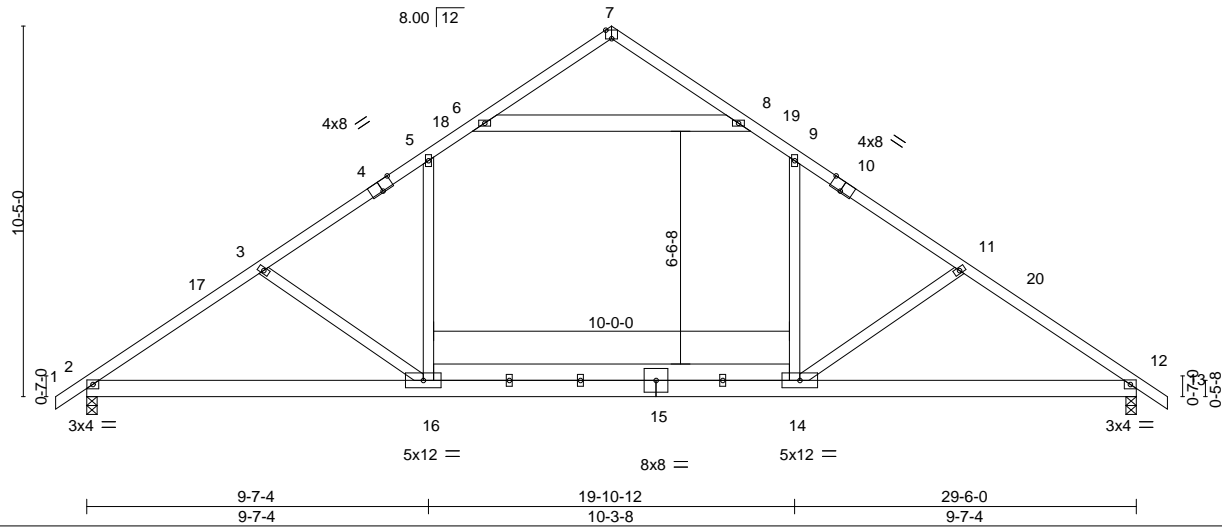


Plate Offsets (X, Y)--	[4:0-4-0,Edge], [7:0-2-0,Edge], [10:0-4-0,Edge]
------------------------	---

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.97	Vert(LL)	-0.40	14-16	>869	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.64	Vert(CT)	-0.55	14-16	>638		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.78	Horz(CT)	0.04	12	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S	Wind(LL)	0.34	2-16	>999		
								Weight: 202 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1	TOP CHORD Structural wood sheathing directly applied.
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.2 *Except* 6-8: 2x6 SP No.1	

REACTIONS.	(size)
2=0-3-8, 12=0-3-8	
Max Horz	2=250(LC 11)
Max Uplift	2=-76(LC 12), 12=-76(LC 13)
Max Grav	2=1375(LC 19), 12=1375(LC 20)

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-3=-2008/376, 3-5=-1803/339, 5-6=-1302/352, 8-9=-1302/352, 9-11=-1803/339, 11-12=-2008/376
BOT CHORD	2-16=-203/1746, 14-16=-43/1439, 12-14=-197/1597
WEBS	9-14=0/666, 11-14=-389/197, 5-16=0/666, 3-16=-389/197, 6-8=-1447/347

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-10-8 to 3-6-5, Interior(1) 3-6-5 to 14-9-0, Exterior(2) 14-9-0 to 19-1-13, Interior(1) 19-1-13 to 30-4-8 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - All plates are 2x4 MT20 unless otherwise indicated.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 76 lb uplift at joint 2 and 76 lb uplift at joint 12.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ENGINEERING BY

 A MiTek Affiliate

818 Soundside Road
 Edenton, NC 27932

Job J0922-4905	Truss A5	Truss Type FINK	Qty 9	Ply 1	Southern Touch/9 Forest Grove/Harnett 154650015
-------------------	-------------	--------------------	----------	----------	--

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Oct 11 08:12:23 2022 Page 1

ID:AFkd_HROst7138Sk?6BQjAyUkX_-GkxRMxDxDpqqNv5BRk3UQOq9zF1eW9dKAuO8O4NyUYH6



4x6 ||

Scale: 3/16"=1'

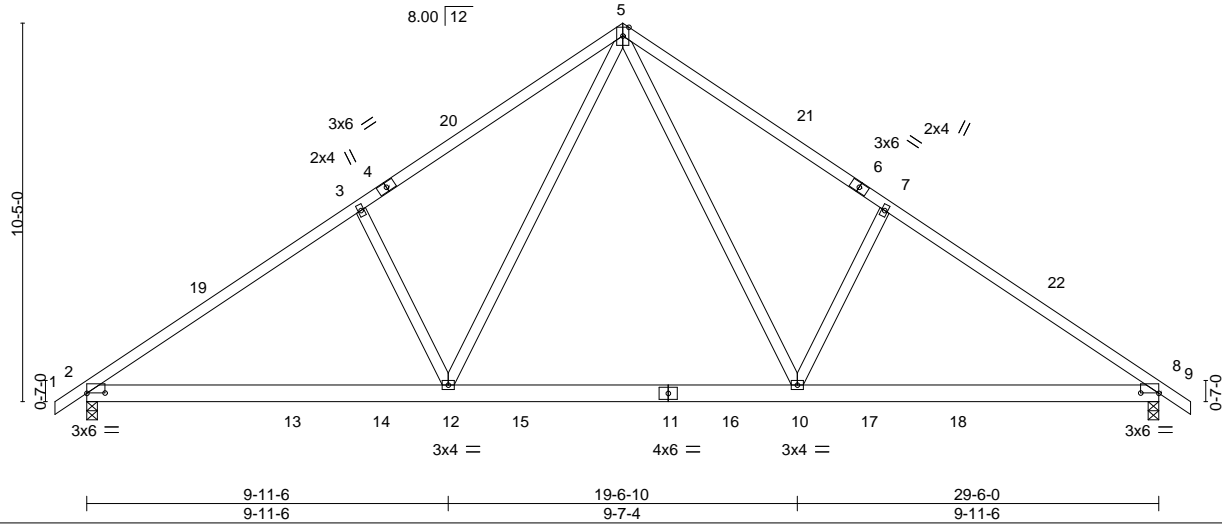


Plate Offsets (X,Y)--	[2:0-6-0,0-0-2], [8:0-6-0,0-0-2]
-----------------------	----------------------------------

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.54	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.46	Vert(LL) -0.13 10-12 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.35	Vert(CT) -0.19 10-12 >999 240		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.03 8 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.05 2-12 >999 240	Weight: 173 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1	TOP CHORD Structural wood sheathing directly applied or 4-1-2 oc purlins.
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.2	

REACTIONS. (size) 2=0-3-8, 8=0-3-8
 Max Horz 2=-250(LC 10)
 Max Uplift 2=-76(LC 12), 8=-76(LC 13)
 Max Grav 2=1383(LC 19), 8=1383(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-1920/352, 3-5=-1772/443, 5-7=-1772/443, 7-8=-1920/352
 BOT CHORD 2-12=-146/1653, 10-12=0/1081, 8-10=-155/1486
 WEBS 3-12=-464/286, 5-12=-159/916, 5-10=-159/916, 7-10=-464/286


- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-10-8 to 3-6-5, Interior(1) 3-6-5 to 14-9-0, Exterior(2) 14-9-0 to 19-1-13, Interior(1) 19-1-13 to 30-4-8 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 76 lb uplift at joint 2 and 76 lb uplift at joint 8.
 - 6) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



Job J0922-4905	Truss A6	Truss Type FINK	Qty 2	Ply 1	Southern Touch/9 Forest Grove/Harnett 154650016
-------------------	-------------	--------------------	----------	----------	--

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Oct 11 08:12:24 2022 Page 1
ID:AFkd_HROst7l38Sk?6BQjAyUkX_-kxVqZHEZ_6yEXEmeln0fx2i8yR_Au43J72ycpyUYH5



4x6 ||

Scale: 3/16"=1'

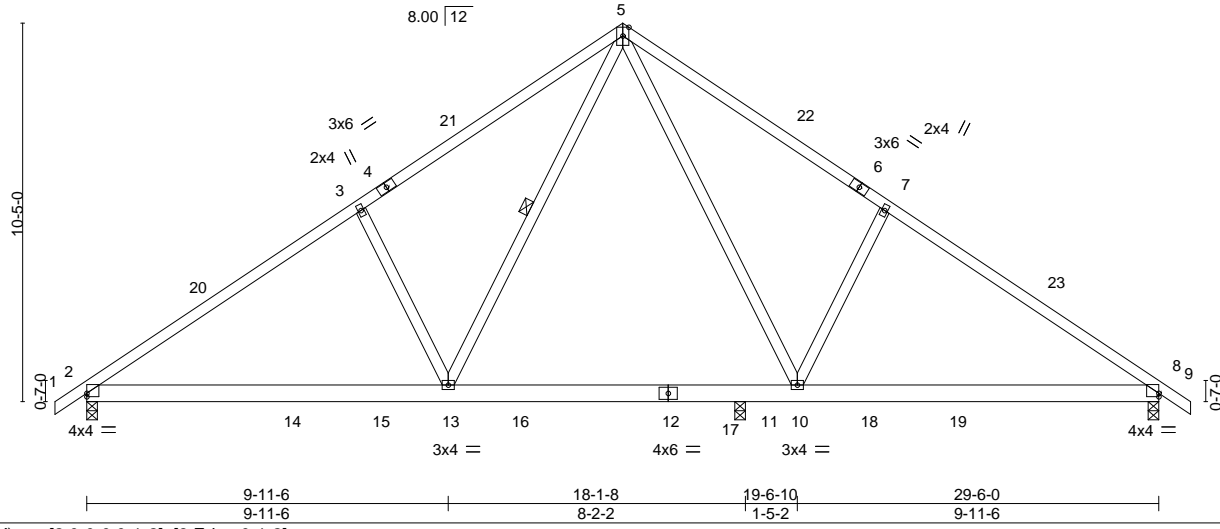


Plate Offsets (X,Y)--	[2:0-0-0,0-1-2], [8:Edge,0-1-2]
-----------------------	---------------------------------


LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.54	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.50	Vert(LL) -0.11 8-10 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.38	Vert(CT) -0.23 8-10 >589 240		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.02 8 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.17 2-13 >999 240	Weight: 173 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1	TOP CHORD Structural wood sheathing directly applied or 4-8-6 oc purlins.
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied or 9-10-6 oc bracing.
WEBS 2x4 SP No.2	WEBS 1 Row at midpt 5-13

REACTIONS. (size) 2=0-3-8, 8=0-3-8, 11=0-3-8
 Max Horz 2=-250(LC 10)
 Max Uplift 2=-100(LC 9), 8=-69(LC 13), 11=-90(LC 9)
 Max Grav 2=1079(LC 2), 8=992(LC 20), 11=601(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-1430/763, 3-5=-1267/854, 5-7=-1076/449, 7-8=-1215/358
 BOT CHORD 2-13=-488/1159, 11-13=-79/703, 10-11=-79/703, 8-10=-158/903
 WEBS 3-13=-474/288, 5-13=-681/728, 5-10=-104/390, 7-10=-481/288

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-10-8 to 3-6-5, Interior(1) 3-6-5 to 14-9-0, Exterior(2) 14-9-0 to 19-1-13, Interior(1) 19-1-13 to 30-4-8 zone; porch left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint 2, 69 lb uplift at joint 8 and 90 lb uplift at joint 11.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

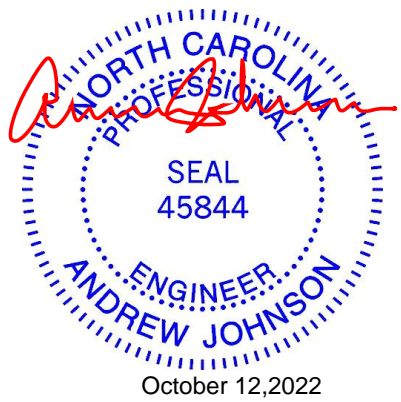


Job J0922-4905	Truss A6GE	Truss Type GABLE	Qty 1	Ply 1	Southern Touch/9 Forest Grove/Harnett I54650017
-------------------	---------------	---------------------	----------	----------	--


Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Oct 11 08:12:25 2022 Page 1

ID:AFkd_HROst7I38Sk?6BQjAyUkX_-C73CndFBIQ458OLqrUXuUFEQ7rReda3SMidV8GyUYH4



Scale = 1:62.5

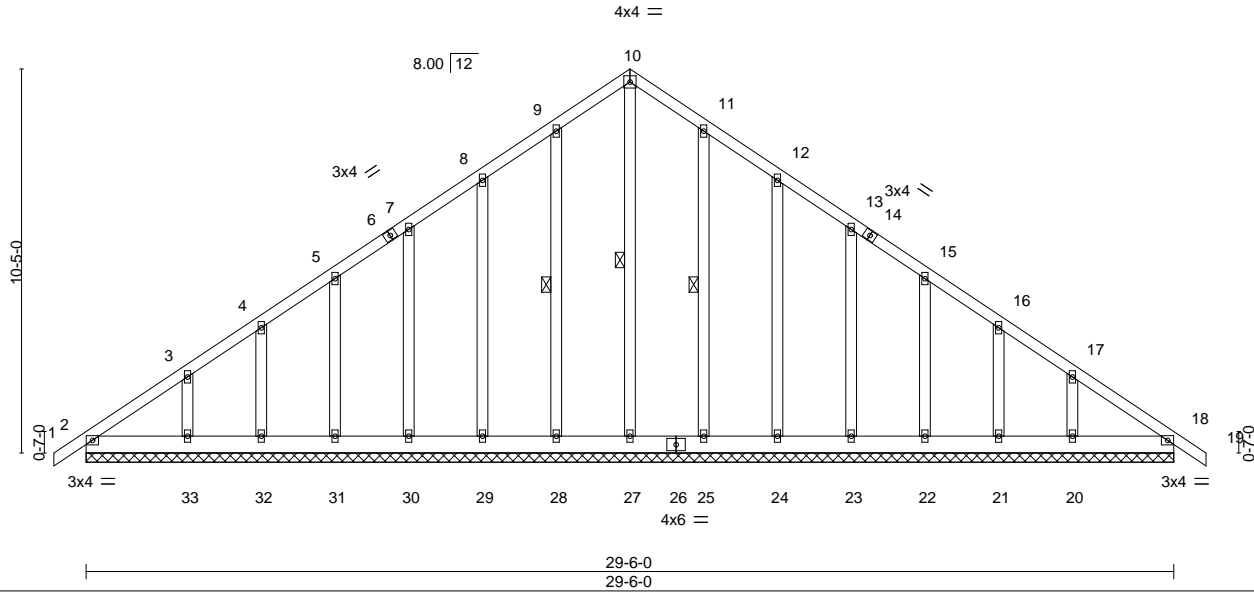

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.06	Vert(LL)	0.00	18	n/r	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.03	Vert(CT)	0.00	18	n/r		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.14	Horz(CT)	0.01	18	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S						
								Weight: 229 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
OTHERS 2x4 SP No.2	WEBS 1 Row at midpt 10-27, 9-28, 11-25

REACTIONS. All bearings 29-6-0.
 (lb) - Max Horz 2=-312(LC 10)
 Max Uplift All uplift 100 lb or less at joint(s) 2, 18, 28, 29, 30, 31, 32, 25, 24, 23, 22, 21 except 33=-136(LC 12), 20=-133(LC 13)
 Max Grav All reactions 250 lb or less at joint(s) 2, 18, 27, 28, 29, 30, 31, 32, 33, 25, 24, 23, 22, 21, 20

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-311/224, 9-10=-231/259, 10-11=-231/259, 17-18=-257/175
 BOT CHORD 2-33=-171/264, 32-33=-171/264, 31-32=-171/264, 30-31=-171/264, 29-30=-171/264, 28-29=-171/264, 27-28=-171/264, 25-27=-171/264, 24-25=-171/264, 23-24=-171/264, 22-23=-171/264, 21-22=-171/264, 20-21=-171/264, 18-20=-171/264

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) 0-10-8 to 3-6-5, Exterior(2) 3-6-5 to 14-9-0, Corner(3) 14-9-0 to 19-1-13, Exterior(2) 19-1-13 to 30-4-8 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 4) All plates are 2x4 MT20 unless otherwise indicated.
 - 5) Gable requires continuous bottom chord bearing.
 - 6) Gable studs spaced at 2-0-0 oc.
 - 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 8) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 18, 28, 29, 30, 31, 32, 25, 24, 23, 22, 21 except (jt=lb) 33=136, 20=133.
 - 10) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.




Job J0922-4905	Truss B1GE	Truss Type COMMON SUPPORTED GAB	Qty 1	Ply 1	Southern Touch/9 Forest Grove/Harnett 154650018
-------------------	---------------	------------------------------------	----------	----------	--

Comtech, Inc. Fayetteville, NC - 28314,


8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Oct 11 08:12:27 2022 Page 1

ID:AFkd_HROst7l38Sk?6BQjAyUkX_-8WByBJGRG1KpOIVDzvZMZgKn0e7K5W3lp06cD8yUYH2



4x4 =

Scale = 1:32.8

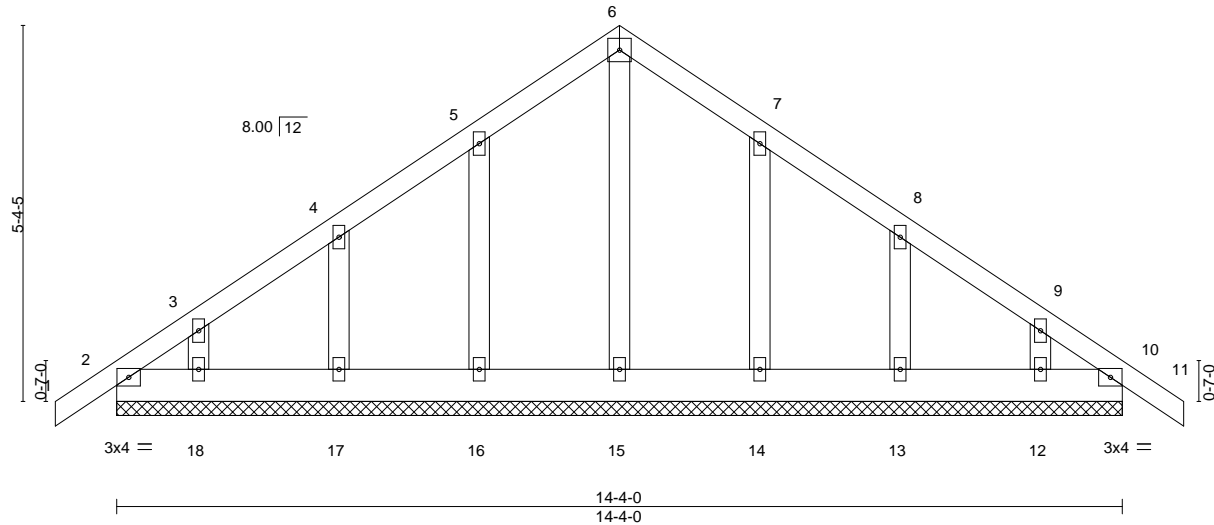

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.04	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.02	Vert(LL) -0.00 10 n/r 120		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.04	Vert(CT) -0.00 11 n/r 120		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.00 10 n/a n/a	Weight: 87 lb	FT = 20%
	Code IRC2015/TPI2014				

LUMBER-
 TOP CHORD 2x4 SP No.1
 BOT CHORD 2x6 SP No.1
 OTHERS 2x4 SP No.2


BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 14-4-0.
 (lb) - Max Horz 2=161(LC 11)
 Max Uplift All uplift 100 lb or less at joint(s) 2, 10, 16, 17, 18, 14, 13, 12
 Max Grav All reactions 250 lb or less at joint(s) 2, 10, 15, 16, 17, 18, 14, 13, 12

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=130mph Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) 0-10-8 to 3-6-5, Exterior(2) 3-6-5 to 7-2-0, Corner(3) 7-2-0 to 11-6-13, Exterior(2) 11-6-13 to 15-2-8 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 4) All plates are 2x4 MT20 unless otherwise indicated.
- 5) Gable requires continuous bottom chord bearing.
- 6) Gable studs spaced at 2-0-0 oc.
- 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 8) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 10, 16, 17, 18, 14, 13, 12.
- 10) Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 10.
- 11) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

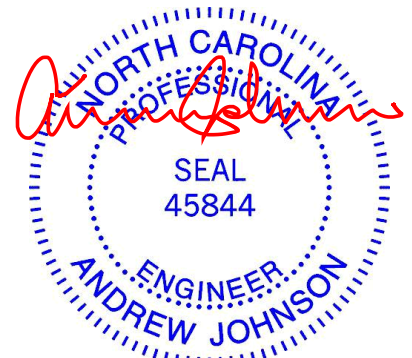

October 12, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component


Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.

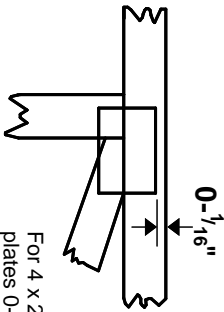

For 4 x 2 orientation, locate plates 0- 1/16" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

* Plate location details available in **MITek 20/20 software or upon request.**

PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur. Min size shown is for crushing only.

Industry Standards:

ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-89: Design Standard for Bracing, Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate
BCSI: Connected Wood Trusses.

Numbering System

6-4-8
dimensions shown in ft-in-sixteenths
(Drawings not to scale)

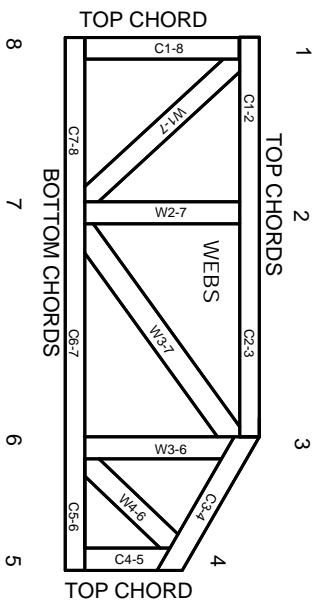

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ESR1988
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MITteK® All Rights Reserved



MITek Engineering Reference Sheet: Mill-7473 rev. 5/19/2020



General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.