
Harnett County Department of Public Health

Improvement Permit

A building permit cannot be issued with only an Improvement Permit
SAMEE + D. PROPERTY LOCATION: De 2011 Epwin Chapel 125
ISSUED TO: TATAL TYPE FISHER SUBDIVISION LOT # C
NEW REPAIR EXPANSION Site Improvements required prior to Construction Authorization Issuance:
Type of Structure: 5FD + BANN STUBIO
Proposed Wastewater System Type: 25% REDUCTIONS
Projected Daily Flow: 480 GPD
Number of bedrooms: 9 Number of Occupants: 8 max
Basement Ves No
Pump Required: Tes No May be required based on final location and elevations of facilities
Type of Water Supply: Community Public Well Distance from wellfeet Permit valid for: Five years
Permit conditions:
A A A ROPE
Authorized State Agent: Date: 11-4-22 SEE ATTACHED SITE SKETCH
The issuance of this permit by the Health Department in no way guarantees the issuance of other permits. The permit holder is responsible for checking with appropriate governing bodies in meeting their requirements. This
site is subject to revocation if the site plan, plat, or the intended use changes. The Improvement Permit shall not be affected by a change in ownership of the site. This permit is subject to compliance with the provisions of
the Laws and Rules for Sewage Treatment and Disposal and to conditions of this permit.
Construction Authorization
(Required for Building Permit)
The construction and installation requirements of Rules .1950, .1952, .1954, .1955, .1956, .1957, .1958, and .1959 are incorporated by references into this permit and shall be met. Systems shall be installed in accordance
with the attached system layout.
5-0-0-0-0-0-0-0-0-0-0-0-0-0-0-0-0-0-0-0
ISSUED TO: JAMES + Page fisher PROPERTY LOCATION: SA ZOII Enwin Chapel PAD SUBDIVISION LOT # Z
SUBDIVISION LOT # Z
Facility Type: SFD+ Brow STDATO New Expansion Repair
Basement? Yes No Basement Fixtures? Yes No
(See note below, if applicable)
Pup to 25% RED (Repair)
Installation Requirements/Conditions Number of trenches 4
Septic Tank Size 1200 gallons Exact length of each trench 100 feet Trench Spacing: 7 Feet on Center
Pump Tank Size 1200 gallons Trenches shall be installed on contour at a Soil Cover: inches
Maximum Trench Depth of: 18-20 max inches (Maximum soil cover shall not exceed
(Trench bottoms shall be level to $\pm \frac{1}{4}$ " 36" above the trench bottom)
and the second s
in all directions)
Pump Requirements:ft. TDH vsGPM
Aggregate Depth: Z inches above pipe
Conditions: 3 BM SFD + 1 BM STUDED IN BAND 12 inches total
WATER LINES (INCLUDING IRRIGATION) MUST BE 10FT. FROM ANY PART OF SEPTIC SYSTEM OR REPAIR AREA.
NO UTILITIES ALLOWED IN INITIAL OR REPAIR DRAIN FIELD AREA.
**If applicable: I understand the system type specified is different from the type specified on the application. I accept the specifications of this permit.
Owner/Legal Representative Signature: Date:
This Construction Authorization is subject to revocation if the site plan, plat, or the intended use changes. The Construction Authorization shall not be transferred when there is a change in ownership of the site. This
CCC ATTACHED CITY CHETCH
C 11 1 - 10 1895
Authorized State Agent. Date: 11-4-22
Authorized State Agent: Date: 11-4-22 Construction Authorization Expiration Date: 11-4-27

Harnett County Department of Public Health Site Sketch

Property Location: SN 7011 From CHAPEL 120			
Property Location: SN 7011 From CHAPEL 12D Issued To: NAMER + PAGE FISHER Subdivision		Lot #	Z
Authorized State Agent James & Manhon For 17843	Date: _	11-4-22	3

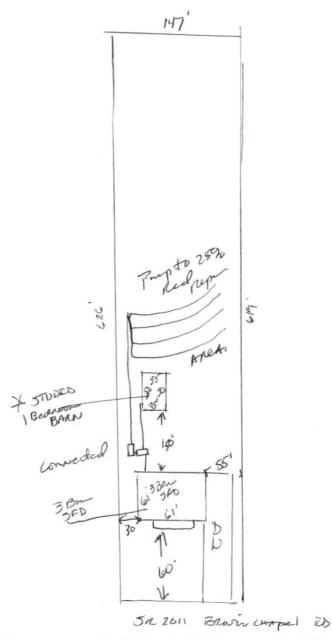

This drawing is for illustrative purposes only. System installation must meet all pertinent laws, rules, and regulations.