



Kempsville Sanford Component Plant
298 Harvey Faulk Rd
Sanford, NC 27332

Phone #:919-775-1450



Builder: DRB HOMES NC

Model: CAMERON 6 - 90 FaNC

THE PLACEMENT PLAN NOTES:

1. The Placement Plan is a diagram for truss installation. It is not an engineered drawing and has not been reviewed by an engineer. The Owner/Building Designer is responsible for obtaining an engineer's review if one is required by the local jurisdiction.
2. The responsibilities of the Owner, Contractor, Building Designer, Component Designer and Component Manufacturer shall be as set forth in ANSI/TPI 1. Capitalized terms shall be as defined in ANSI/TP 1 unless otherwise indicated.
3. Each Component is designed as an individual component utilizing information provided by others. The Owner/Building Designer is responsible for reviewing all Component Submittal Packages and individual Component Design Drawings for compliance with the Construction Documents and compatibility with the overall Building design.
4. Contractor will not proceed with component installation until the Owner/Building Designer has reviewed the Component Submittal Package. Questions on the suitability of any Component will be resolved by the Building Designer.
5. The Building Designer and Contractor are responsible for all temporary and permanent bracing.
6. The Placement Plan assumes the building is dimensionally correct, structurally sound, and in a suitable condition to support each Component during installation and thereafter, including but not limited to installation of all bearing points. Proper design and construction of all structural components, including foundations, headers, beams, walls and columns are the responsibility of the Owner, Building Designer and Contractor.
7. Do not cut, drill, or modify any Component without first consulting the Component Manufacturer or Building Designer. Damaged Components shall not be installed unless directed by the Building Designer or approved by the Component Manufacturer.
8. Components must be handled and installed following all applicable safety standards and best practices, including but not limited to BCSI, OSHA, TPI and local codes. Failure to properly handle, brace or otherwise install Component can result in serious injury or death.



** DAMAGED COMPONENTS SHOULD NOT BE INSTALLED UNLESS TOLD TO BY THE COMPONENT PLANT.

** FRAMER MUST REFER TO PLANS WHILE SETTING COMPONENTS.

** TRIANGULAR SYMBOL NEAR END OF TRUSS INDICATES LEFT END OF TRUSS AS SHOWN ON INDIVIDUAL TRUSS DRAWINGS.

** PLUMBING DROPS NOTED ARE IN THE APPROXIMATE LOCATIONS PER PLAN. BUILDER TO VERIFY LOCATIONS BEFORE SETTING TRUSSES.

** REFER TO FINAL TRUSS ENGINEERING SHEETS FOR PLY TO PLY CONNECTIONS.

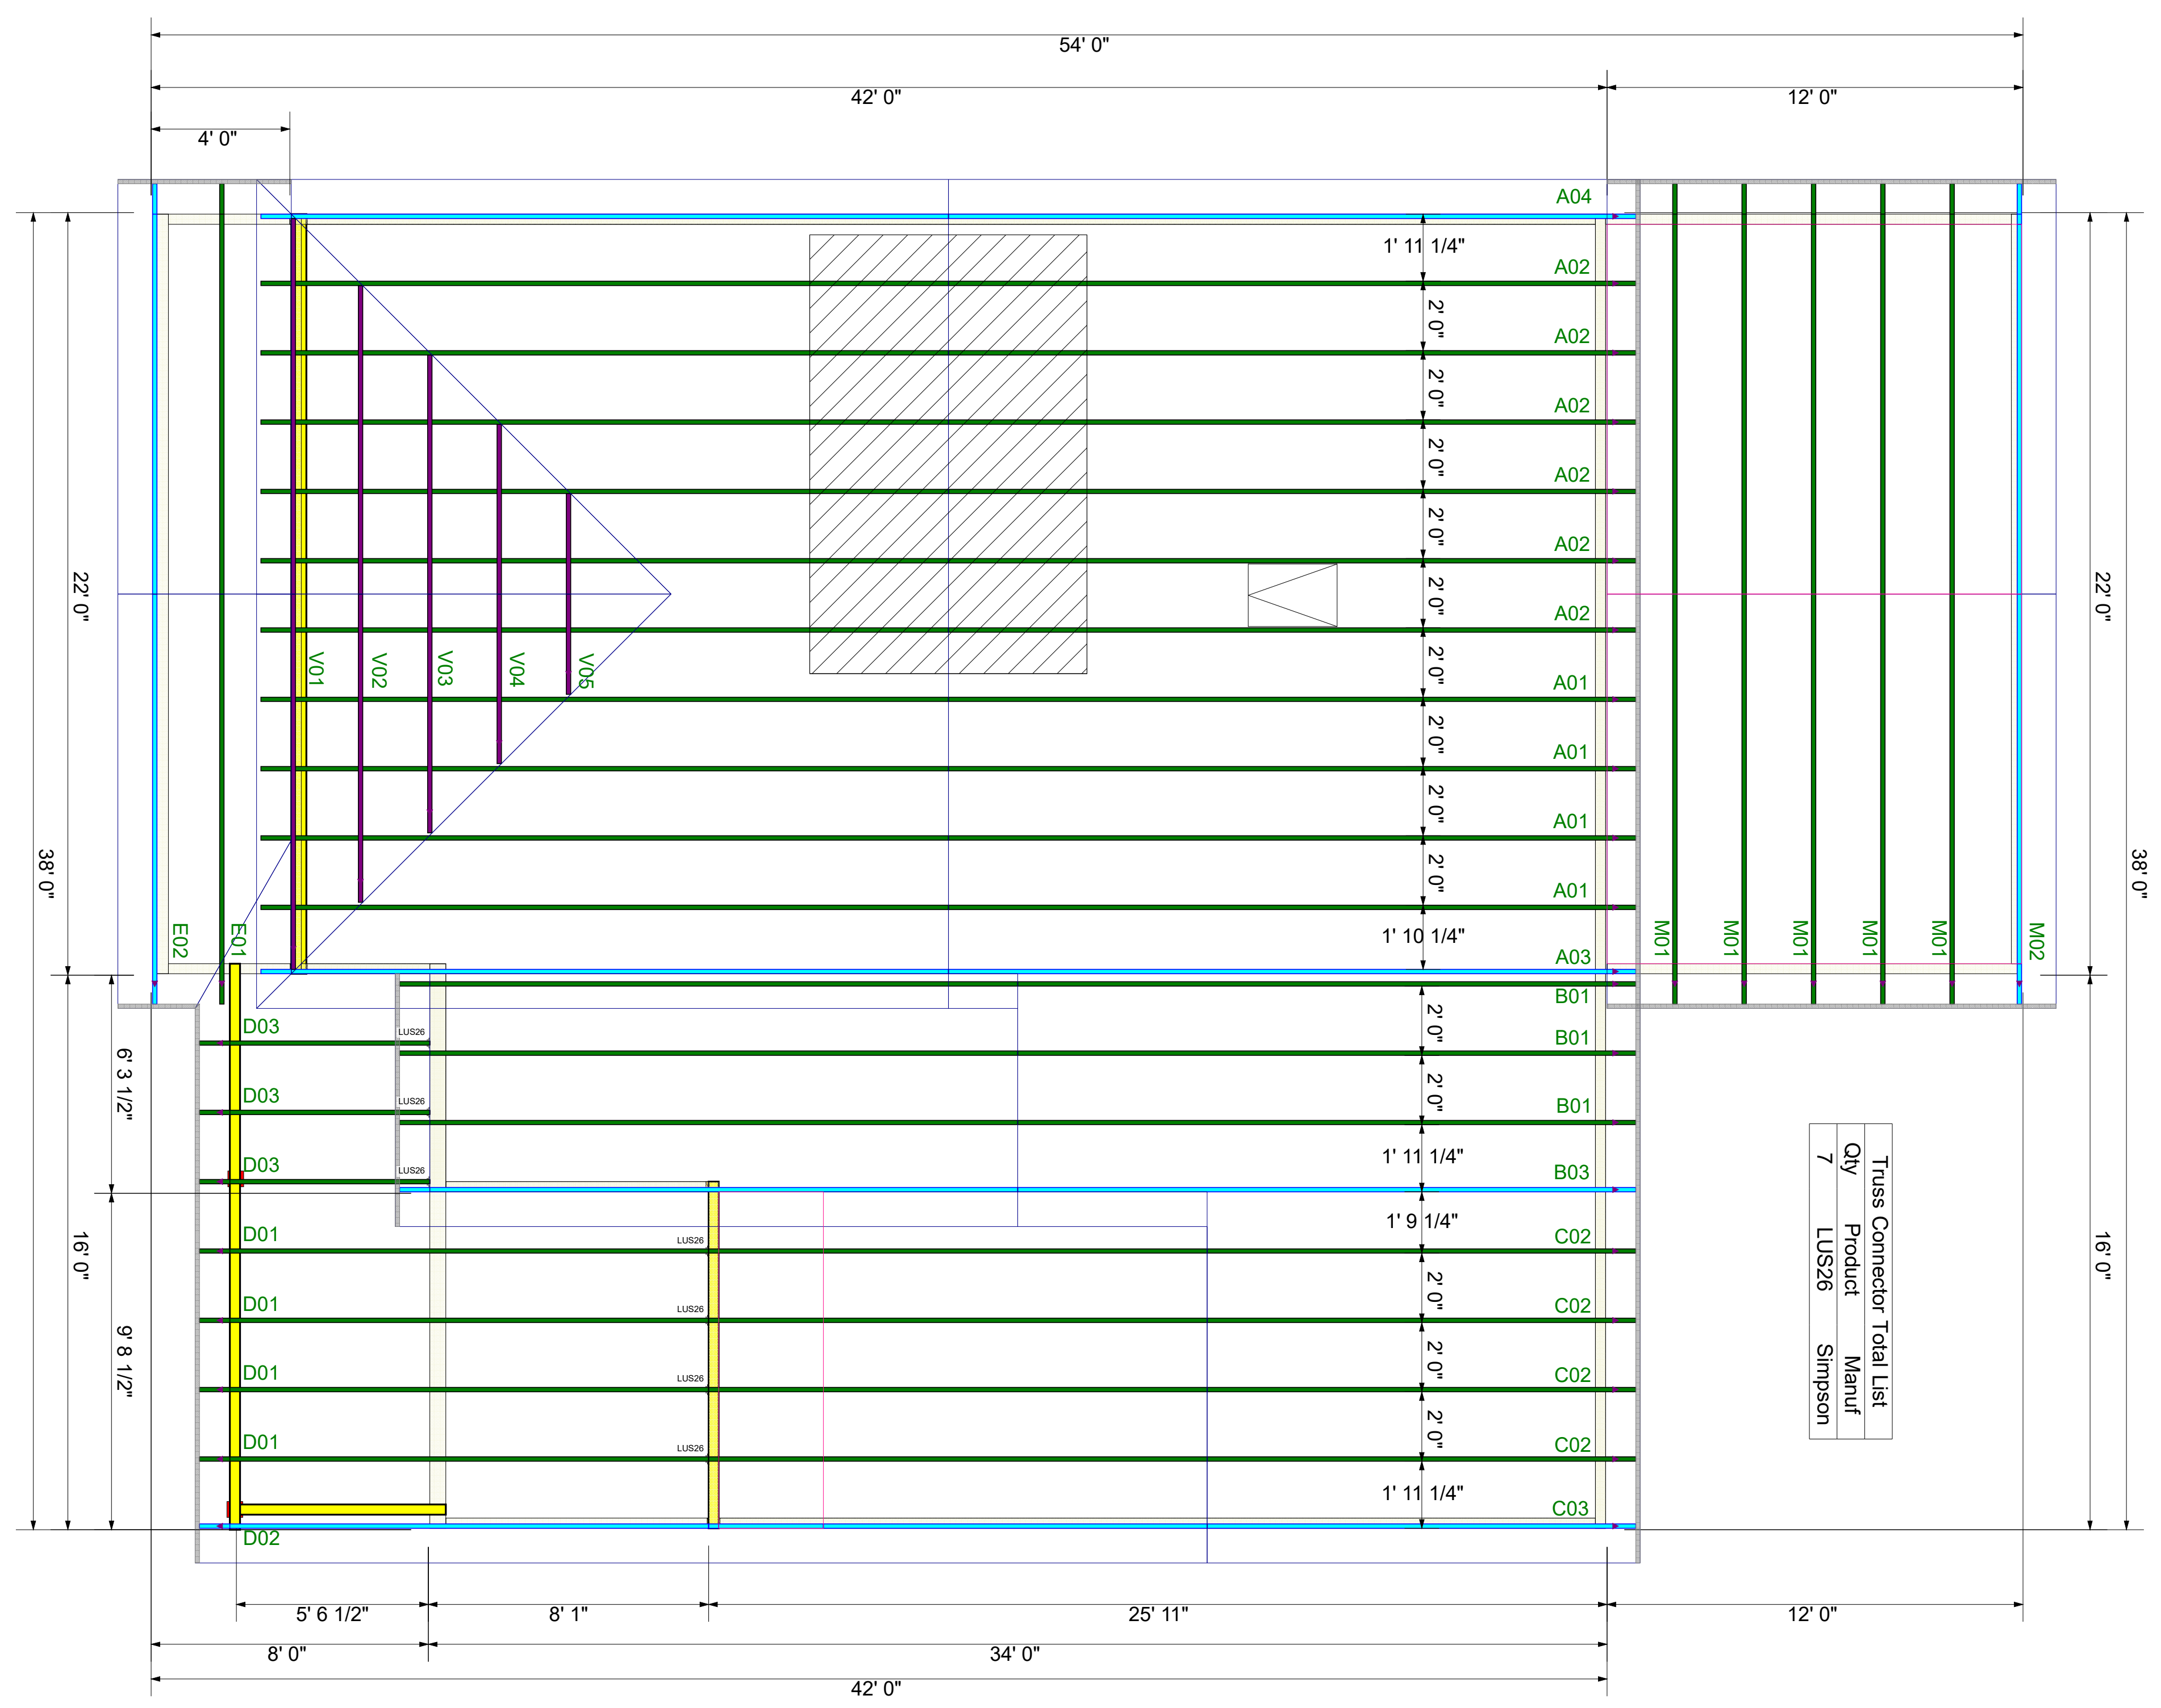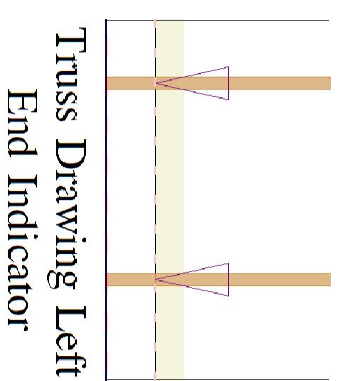

Truss Connector Total List		
Qty	Product	Manuf
7	LUS26	Simpson

** GIRDERS MUST BE FULLY CONNECTED TOGETHER PRIOR TO ADDING ANY LOADS.

** DIMENSIONS ARE READ AS: FOOT-INCH-SIXTEENTH.

** TRUSS TO TRUSS CONNECTIONS ARE TOE-NAILED, UNLESS NOTED OTHERWISE.

Scale:	NTS
Date:	10/5/2022
Designer:	ND
Project Number:	22090049
Sheet Number:	1/1

DRB HOMES

CAMERON 6 - 90 FaNC

**COMPONENT
PLACEMENT PLAN**



THIS IS A TRUSS PLACEMENT DIAGRAM ONLY. These trusses are designed as individual components to be incorporated into the building design at the specification of the building designer. See Individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor systems and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding the bracing, consult "Bracing of Wood Truss" available from the Truss Plate Institute, 583 D'Onifrio Drive: Madison, WI 53179

Revisions	
Name	Name
00/00/00	Name
00/00/00	Name
00/00/00	Name
00/00/00	Name

Trenco

818 Soundside Rd
Edenton, NC 27932

Re: 22090049
DRB HOMES - 90 FaNC

The truss drawing(s) referenced below have been prepared by Truss Engineering Co. under my direct supervision based on the parameters provided by Carter Components (Sanford, NC)).

Pages or sheets covered by this seal: I54555834 thru I54555853

My license renewal date for the state of North Carolina is December 31, 2022.

North Carolina COA: C-0844



October 5, 2022

Gilbert, Eric


IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

Job 22090049	Truss A01	Truss Type Common	Qty 4	Ply 1	DRB HOMES - 90 FaNC Job Reference (optional)	I54555834
-----------------	--------------	----------------------	----------	----------	---	-----------

Carter Components (Sanford), Sanford, NC - 27332,

Run: 8.53 S Sep 22 2022 Print: 8.530 S Sep 22 2022 MiTek Industries, Inc. Wed Oct 05 07:40:07
ID:bD4xs?Y6N8EeiWi69pl1?yGMN6-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKwRCDoi7J4zJC?F

Page: 1

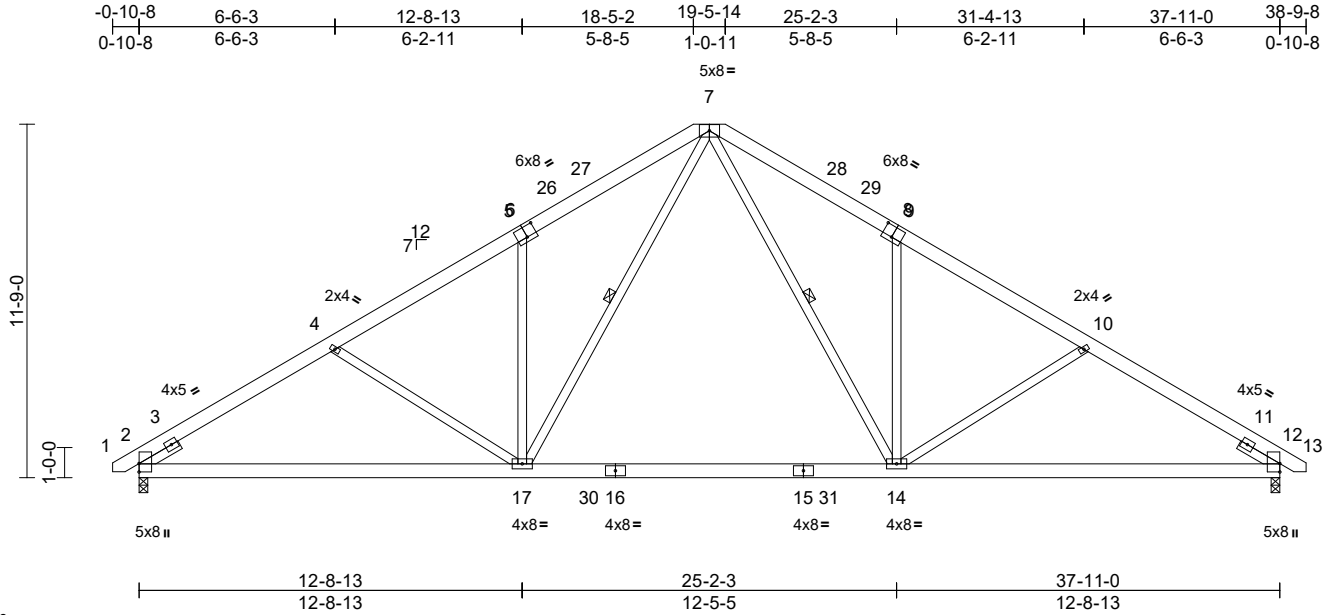

Scale = 1:76.6

Plate Offsets (X, Y): [6:0-4-0,0-4-4], [8:0-4-0,0-4-4]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.40	Vert(LL)	-0.31	14-17	>999	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.83	Vert(CT)	-0.47	14-17	>960	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.56	Horz(CT)	0.07	12	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 282 lb	FT = 20%

LUMBER
TOP CHORD 2x6 SP No.2
BOT CHORD 2x6 SP No.2
WEBS 2x4 SP No.3 *Except* 17-7,14-7:2x4 SP No.2
SLIDER Left 2x4 SP No.3 -- 1-6-0, Right 2x4 SP No.3 -- 1-6-0

BRACING
TOP CHORD Structural wood sheathing directly applied or 4-1-11 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 7-17, 7-14

REACTIONS (size) 2=0-3-8, 12=0-3-8
Max Horiz 2=-265 (LC 12)
Max Uplift 2=-151 (LC 14), 12=-151 (LC 15)
Max Grav 2=1783 (LC 24), 12=1783 (LC 25)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/20, 2-4=-2588/259, 4-5=-2321/228, 5-7=-2355/367, 7-9=-2354/367, 9-10=-2321/228, 10-12=-2589/259, 12-13=0/20
BOT CHORD 2-17=-297/2334, 14-17=-16/1512, 12-14=-130/2136
WEBS 5-17=-477/249, 7-17=-236/1197, 4-17=-296/201, 7-14=-236/1197, 9-14=-477/248, 10-14=-297/202

NOTES
1) Unbalanced roof live loads have been considered for this design.

- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-8-1 to 3-1-7, Interior (1) 3-1-7 to 15-2-0, Exterior(2R) 15-2-0 to 22-9-0, Interior (1) 22-9-0 to 34-9-9, Exterior(2E) 34-9-9 to 38-7-1 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 2 and 12. This connection is for uplift only and does not consider lateral forces.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



October 5, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932

Job 22090049	Truss A02	Truss Type Common	Qty 6	Ply 1	DRB HOMES - 90 FaNC Job Reference (optional)	I54555835
-----------------	--------------	----------------------	----------	----------	---	-----------

Carter Components (Sanford), Sanford, NC - 27332,

Run: 8.53 S Sep 22 2022 Print: 8.530 S Sep 22 2022 MiTek Industries, Inc. Wed Oct 05 07:40:09
ID:bD4xs?Y6N8EeiWl69pl1?yGMN6-RfC?PsB70Hq3NSgPqnl8w3ulTXbGKwRcDoi7J4zJC?f

Page: 1

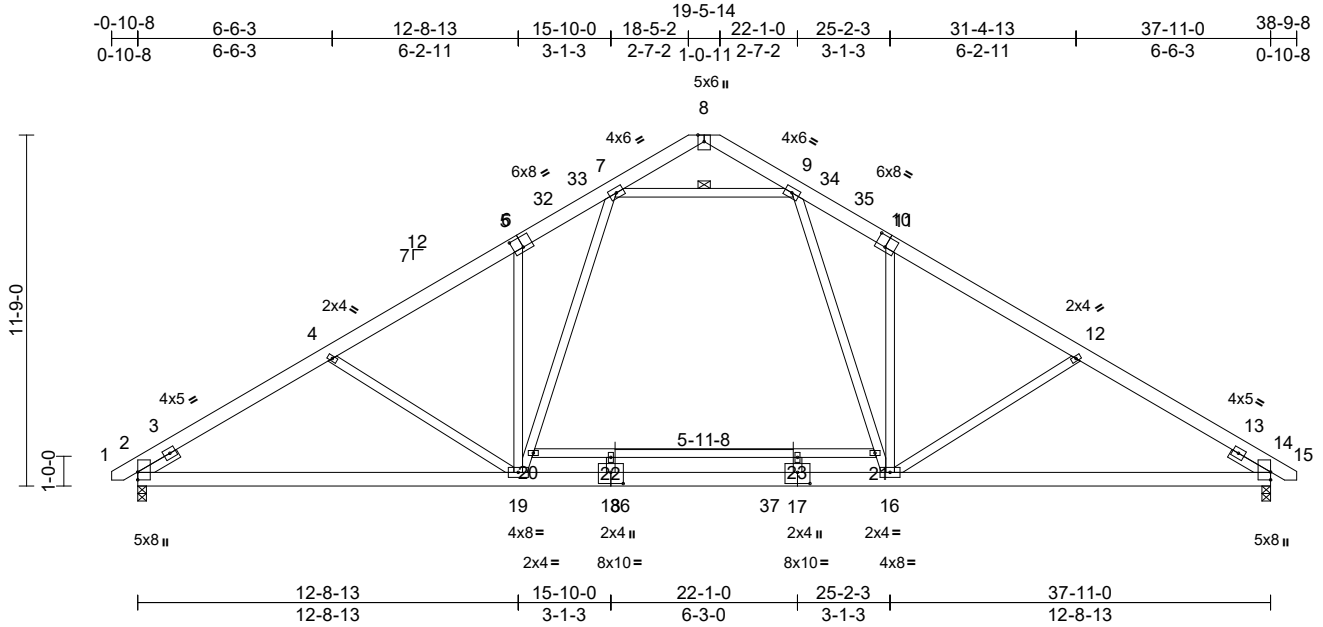

Scale = 1:77.1

Plate Offsets (X, Y): [6:0-4-0,0-4-4], [10:0-4-0,0-4-4], [17:0-5-0,0-4-8], [18:0-5-0,0-4-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.51	Vert(LL)	-0.21	19-26	>999	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.78	Vert(CT)	-0.46	17-18	>999	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.63	Horz(CT)	0.08	14	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 301 lb	FT = 20%

LUMBER
TOP CHORD 2x6 SP No.2
BOT CHORD 2x6 SP No.2
WEBS 2x4 SP No.3 *Except* 20-21:2x4 SP No.2
SLIDER Left 2x4 SP No.3 -- 1-6-0, Right 2x4 SP No.3 -- 1-6-0

BRACING
TOP CHORD Structural wood sheathing directly applied or 3-10-3 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 7-9

REACTIONS (size) 2=0-3-8, 14=0-3-8
Max Horiz 2=-265 (LC 12)
Max Uplift 2=-50 (LC 14), 14=-53 (LC 15)
Max Grav 2=1658 (LC 1), 14=1655 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/20, 2-4=-2495/62, 4-5=-2200/20, 5-7=-2240/155, 7-8=-315/105, 8-9=-318/103, 9-11=-2229/164, 11-12=-2195/26, 12-14=-2490/68, 14-15=0/20
BOT CHORD 2-19=-177/2063, 16-19=0/1500, 14-16=-23/2051
WEBS 5-19=-542/282, 19-20=-151/1048, 7-20=-135/1056, 4-19=-293/238, 9-21=-151/1039, 16-21=-165/1032, 11-16=-535/288, 12-16=-295/238, 20-22=-3/73, 22-23=-3/73, 21-23=-3/73, 18-22=0/36, 17-23=0/33, 7-9=-1380/87

NOTES
1) Unbalanced roof live loads have been considered for this design.

- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-8-1 to 3-1-7, Interior (1) 3-1-7 to 15-2-0, Exterior(2R) 15-2-0 to 22-9-0, Interior (1) 22-9-0 to 34-9-9, Exterior(2E) 34-9-9 to 38-7-1 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- 200.0lb AC unit load placed on the bottom chord, 18-8-0 from left end, supported at two points, 5-0-0 apart.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 2 and 14. This connection is for uplift only and does not consider lateral forces.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



October 5, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSITPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932

Job 22090049	Truss A03	Truss Type Common Structural Gable	Qty 1	Ply 1	DRB HOMES - 90 FaNC Job Reference (optional)	I54555836
-----------------	--------------	---------------------------------------	----------	----------	---	-----------

Carter Components (Sanford), Sanford, NC - 27332,

Run: 8.53 S Sep 22 2022 Print: 8.530 S Sep 22 2022 MiTek Industries, Inc. Wed Oct 05 07:40:10
ID:9knqKob6Z3xFTU7aZooqMLyGMKT-RFC?PsB70Hq3NSgPqnL8w3uITXbGKwRCDoi7J4zJC?f

Page: 1

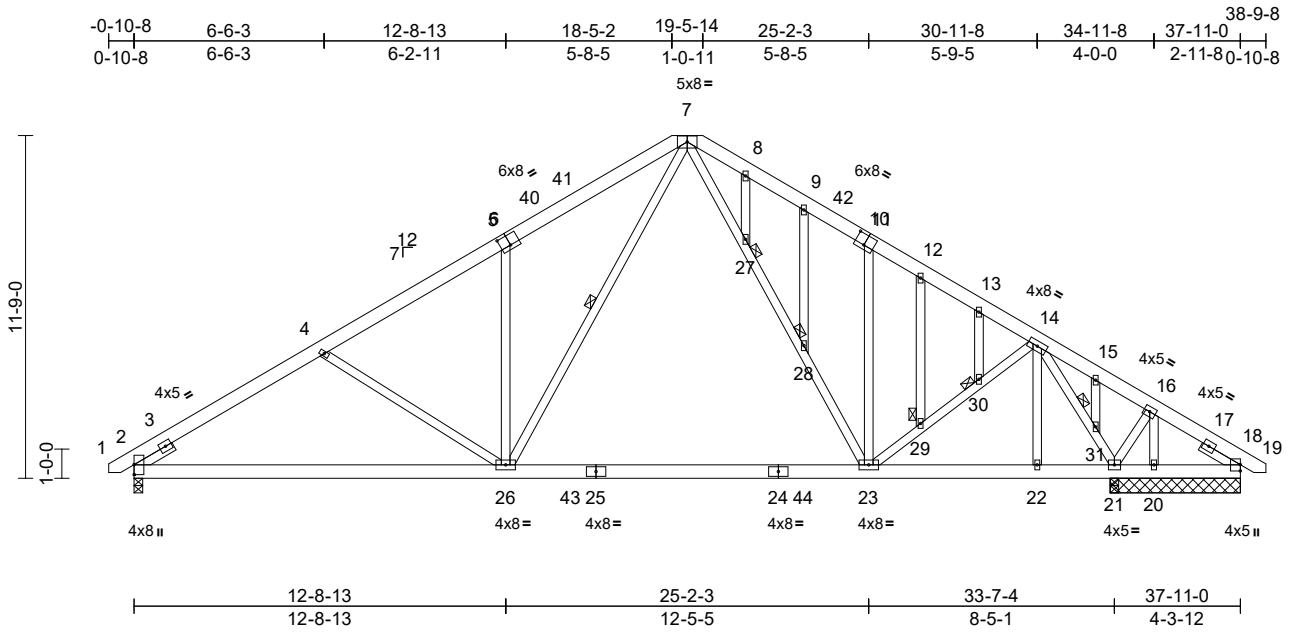

Scale = 1:79
Plate Offsets (X, Y): [6:0-4-0,0-4-4], [10:0-4-0,0-4-4]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in (loc)	l/defl	L/d	PLATES	GRIP		
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.30	Vert(LL)	-0.27	23-26	>999	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.80	Vert(CT)	-0.41	23-26	>973	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.55	Horz(CT)	0.04	21	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 326 lb	FT = 20%

LUMBER
TOP CHORD 2x6 SP No.2
BOT CHORD 2x6 SP No.2
WEBS 2x4 SP No.3 *Except* 26-7,23-7:2x4 SP No.2
OTHERS 2x4 SP No.3
SLIDER Left 2x4 SP No.3 -- 1-6-0, Right 2x4 SP No.3 -- 1-6-0

BRACING
TOP CHORD Structural wood sheathing directly applied or 4-9-2 oc purlins.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 1 Row at midpt 7-26, 14-21
JOINTS 1 Brace at Jt(s): 27, 28, 29, 30

REACTIONS (size) 2=0-3-8, 18=4-5-8, 20=4-5-8, 21=4-5-8, 36=4-5-8
Max Horiz 2=-265 (LC 12)
Max Uplift 2=-139 (LC 14), 18=-57 (LC 36), 20=-260 (LC 24), 21=-195 (LC 15), 36=-57 (LC 36)
Max Grav 2=1556 (LC 24), 18=76 (LC 35), 20=42 (LC 14), 21=2245 (LC 25), 36=76 (LC 35)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/20, 2-4=-2186/237, 4-5=-1904/191, 5-7=-1940/342, 7-8=-1373/297, 8-9=-1417/280, 9-11=-1472/267, 11-12=-1332/169, 12-13=-1388/156, 13-14=-1428/143, 14-15=-24/385, 15-16=-42/437, 16-18=-42/291, 18-19=0/20
BOT CHORD 2-26=-279/1998, 23-26=0/1134, 22-23=0/542, 21-22=0/542, 20-21=-207/73, 18-20=-207/73

WEBS 5-26=-477/247, 7-26=-229/1229, 4-26=-328/205, 7-27=-177/437, 27-28=-170/431, 23-28=-165/420, 11-23=-453/219, 23-29=-12/872, 29-30=-13/855, 14-30=-15/874, 8-27=-16/13, 9-28=-14/5, 12-29=0/32, 13-30=-33/4, 14-22=-94/34, 15-31=-199/20, 16-20=-21/192, 14-31=-1684/139, 21-31=-1857/157, 16-21=-276/105

- NOTES**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-8-1 to 3-1-7, Interior (1) 3-1-7 to 15-2-0, Exterior(2R) 15-2-0 to 22-11-8, Interior (1) 22-11-8 to 34-9-9, Exterior(2E) 34-9-9 to 38-7-1 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 4) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
 - 5) Unbalanced snow loads have been considered for this design.
 - 6) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
 - 7) All plates are 2x4 MT20 unless otherwise indicated.
 - 8) Gable studs spaced at 2-0-0 oc.

- 9) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 10) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.



October 5, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSITPI Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932

Job 22090049	Truss A04	Truss Type Common Supported Gable	Qty 1	Ply 1	DRB HOMES - 90 FaNC Job Reference (optional)	I54555837
-----------------	--------------	--------------------------------------	----------	----------	---	-----------

Carter Components (Sanford), Sanford, NC - 27332,

Run: 8.53 S Sep 22 2022 Print: 8.530 S Sep 22 2022 MiTek Industries, Inc. Wed Oct 05 07:40:11
ID:hussyWcpnt6fYOYKURLMl2yGMJ9-RfC?PsB70Hq3NSgPqnL9w3uITXbGKwRcDoi7J4zJC?f

Page: 1

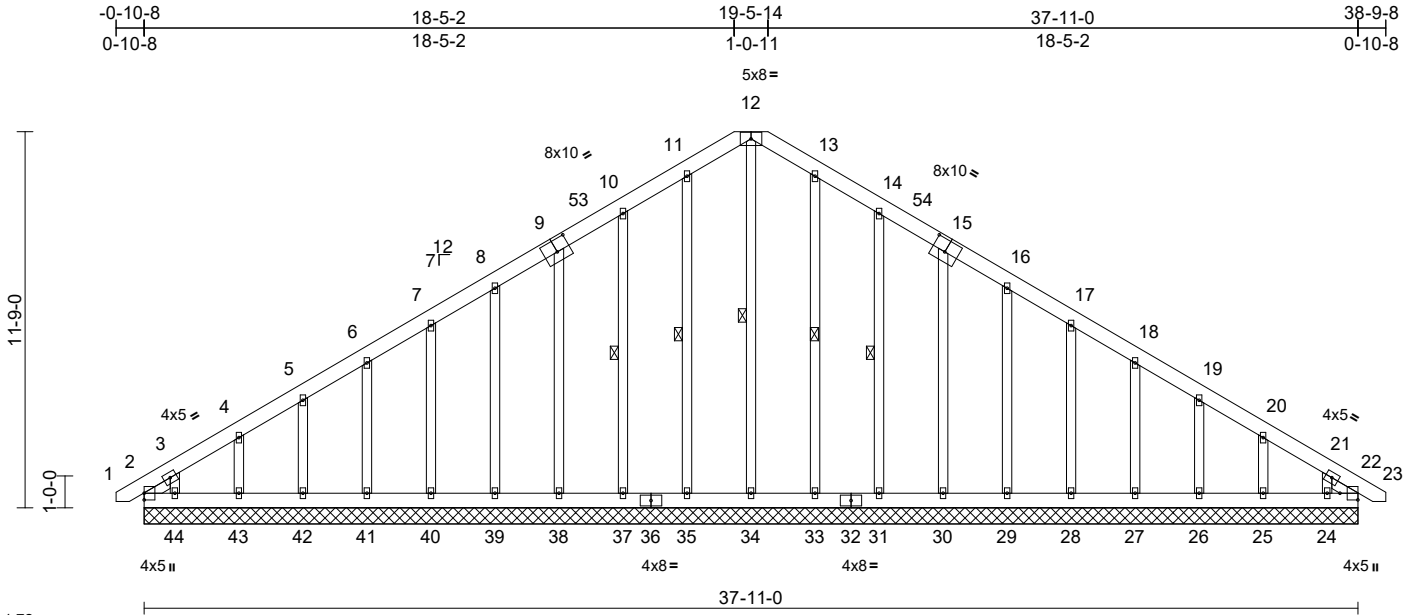

Scale = 1:72

Plate Offsets (X, Y): [9:0-5-0,0-4-8], [15:0-5-0,0-4-8], [22:Edge,0-6-12]

Loading	(psf)	Spacing	1-11-4	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.05	Vert(LL)	n/a	-	n/a	999	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.03	Vert(CT)	n/a	-	n/a	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.15	Horz(CT)	0.01	22	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 358 lb	FT = 20%

LUMBER		Max Grav	WEBS
TOP CHORD	2x6 SP No.2	2=233 (LC 14), 22=172 (LC 15), 24=154 (LC 25), 25=165 (LC 25), 26=161 (LC 25), 27=161 (LC 25), 28=162 (LC 25), 29=154 (LC 25), 30=164 (LC 22), 31=228 (LC 22), 33=232 (LC 22), 34=191 (LC 27), 35=232 (LC 21), 37=228 (LC 21), 38=164 (LC 21), 39=154 (LC 24), 40=162 (LC 24), 41=161 (LC 24), 42=161 (LC 24), 43=165 (LC 24), 44=186 (LC 24), 45=233 (LC 14), 49=172 (LC 15)	12-34=161/47, 11-35=193/47, 10-37=189/83, 9-38=125/73, 8-39=115/67, 7-40=123/73, 6-41=123/72, 5-42=122/71, 4-43=128/78, 3-44=114/129, 13-33=193/39, 14-31=189/86, 15-30=125/74, 16-29=115/66, 17-28=123/73, 18-27=123/72, 19-26=122/71, 20-25=127/77, 21-24=92/109
BOT CHORD	2x6 SP No.2		
OTHERS	2x4 SP No.3 *Except* 34-12:2x4 SP No.2		
SLIDER	Left 2x4 SP No.3 -- 0-11-6, Right 2x4 SP No.3 -- 0-11-6		

BRACING	
TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	1 Row at midpt 12-34, 11-35, 10-37, 13-33, 14-31

REACTIONS	(size)
Max Horiz	2=-260 (LC 12), 45=-260 (LC 12)
Max Uplift	2=-149 (LC 12), 22=-58 (LC 13), 24=-132 (LC 15), 25=-50 (LC 15), 26=-49 (LC 15), 27=-49 (LC 15), 28=-49 (LC 15), 29=-43 (LC 15), 30=-50 (LC 15), 31=-63 (LC 15), 33=-15 (LC 15), 35=-24 (LC 14), 37=-60 (LC 14), 38=-50 (LC 14), 39=-43 (LC 14), 40=-49 (LC 14), 41=-49 (LC 14), 42=-49 (LC 14), 43=-50 (LC 14), 44=-161 (LC 14), 45=-149 (LC 12), 49=-58 (LC 13)

FORCES	(lb) - Maximum Compression/Maximum Tension
TOP CHORD	1-2=0/20, 2-3=-182/142, 3-4=-222/186, 4-5=-187/167, 5-6=-163/150, 6-7=-149/139, 7-8=-136/140, 8-10=-122/193, 10-11=-135/225, 11-12=-149/245, 12-13=-149/245, 13-14=-135/216, 14-16=-105/165, 16-17=-62/78, 17-18=-72/49, 18-19=-82/55, 19-20=-108/72, 20-21=-158/91, 21-22=-138/77, 22-23=0/20
BOT CHORD	2-44=-88/183, 43-44=-88/183, 42-43=-88/183, 41-42=-88/183, 40-41=-88/183, 39-40=-88/183, 38-39=-88/183, 37-38=-88/184, 35-37=-88/184, 34-35=-88/184, 33-34=-88/184, 31-33=-88/184, 30-31=-88/184, 29-30=-86/182, 28-29=-86/182, 27-28=-86/182, 26-27=-86/182, 25-26=-86/182, 24-25=-86/182, 22-24=-86/182

NOTES
1) Unbalanced roof live loads have been considered for this design.



October 5, 2022

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932

Job 22090049	Truss A04	Truss Type Common Supported Gable	Qty 1	Ply 1	DRB HOMES - 90 FaNC Job Reference (optional)	I54555837
-----------------	--------------	--------------------------------------	----------	----------	---	-----------

Carter Components (Sanford), Sanford, NC - 27332,

Run: 8.53 S Sep 22 2022 Print: 8.530 S Sep 22 2022 MiTek Industries, Inc. Wed Oct 05 07:40:11
ID:husayWcpnt6IYOYkURLMl2yGMJ9-RfC?PsB70Hq3NSgPqnL9w3ulTXbGKWrCDoi7J4zJC?F

Page: 2

- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust)
Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft;
Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior
zone and C-C Corner(3E) -0-8-1 to 2-11-8, Exterior(2N)
2-11-8 to 14-11-8, Corner(3R) 14-11-8 to 22-11-8,
Exterior(2N) 22-11-8 to 34-9-9, Corner(3E) 34-9-9 to
38-7-1 zone; cantilever left and right exposed ; end
vertical left and right exposed;C-C for members and
forces & MWFRS for reactions shown; Lumber
DOL=1.60 plate grip DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss
only. For studs exposed to wind (normal to the face),
see Standard Industry Gable End Details as applicable,
or consult qualified building designer as per ANSI/TPI 1.
- 4) TCELL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15
Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate
DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9;
Cs=1.00; Ct=1.10
- 5) Unbalanced snow loads have been considered for this
design.
- 6) This truss has been designed for greater of min roof live
load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on
overhangs non-concurrent with other live loads.
- 7) All plates are 2x4 MT20 unless otherwise indicated.
- 8) Gable requires continuous bottom chord bearing.
- 9) Gable studs spaced at 2-0-0 oc.
- 10) This truss has been designed for a 10.0 psf bottom
chord live load nonconcurrent with any other live loads.
- 11) * This truss has been designed for a live load of 20.0psf
on the bottom chord in all areas where a rectangle
3-06-00 tall by 2-00-00 wide will fit between the bottom
chord and any other members.
- 12) Provide mechanical connection (by others) of truss to
bearing plate capable of withstanding 149 lb uplift at
joint 2, 58 lb uplift at joint 22, 24 lb uplift at joint 35, 60 lb
uplift at joint 37, 50 lb uplift at joint 38, 43 lb uplift at joint
39, 49 lb uplift at joint 40, 49 lb uplift at joint 41, 49 lb
uplift at joint 42, 50 lb uplift at joint 43, 161 lb uplift at
joint 44, 15 lb uplift at joint 33, 63 lb uplift at joint 31, 50
lb uplift at joint 30, 43 lb uplift at joint 29, 49 lb uplift at
joint 28, 49 lb uplift at joint 27, 49 lb uplift at joint 26, 50
lb uplift at joint 25, 132 lb uplift at joint 24, 149 lb uplift at
joint 2 and 58 lb uplift at joint 22.
- 13) This truss is designed in accordance with the 2018
International Residential Code sections R502.11.1 and
R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932

Job 22090049	Truss B01	Truss Type Common	Qty 3	Ply 1	DRB HOMES - 90 FaNC Job Reference (optional)	I54555838
-----------------	--------------	----------------------	----------	----------	---	-----------

Carter Components (Sanford), Sanford, NC - 27332,

Run: 8.53 S Sep 22 2022 Print: 8.530 S Sep 22 2022 MiTek Industries, Inc. Wed Oct 05 07:40:12
ID:tZ4bPv91BhnMSJUNdOev4YyGMIS-RfC?PsB70Hq3NSgPqnL8w3uITXbGKwRCDoi7J4zJC?f

Page: 1

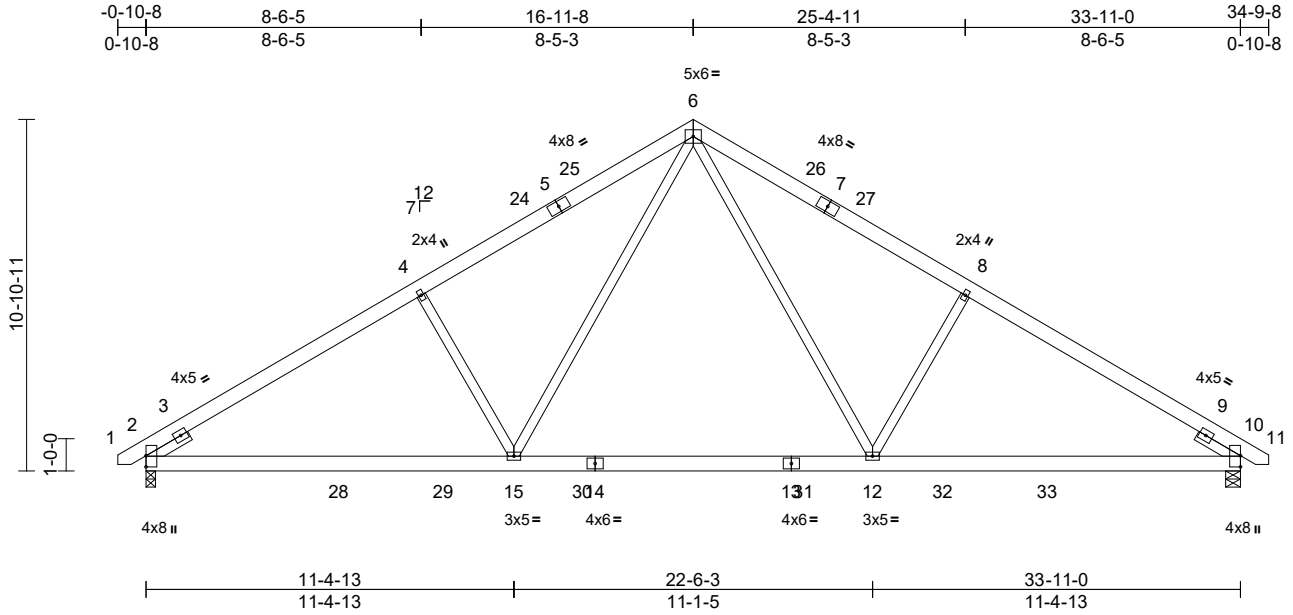

Scale = 1:71.4

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.68	Vert(LL)	-0.19	12-15	>999	240	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.72	Vert(CT)	-0.30	12-15	>999	180	
TCDL	10.0	Rep Stress Incr	YES	WB	0.36	Horz(CT)	0.06	10	n/a	n/a	
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-MSH							
BCDL	10.0										
										Weight: 232 lb	FT = 20%

LUMBER
TOP CHORD 2x6 SP No.2
BOT CHORD 2x6 SP No.2
WEBS 2x4 SP No.2 *Except* 4-15,8-12:2x4 SP No.3
SLIDER Left 2x4 SP No.3 -- 1-6-0, Right 2x4 SP No.3 -- 1-6-0

BRACING
TOP CHORD Structural wood sheathing directly applied or 3-11-15 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 2=0-3-8, 10=0-5-8
Max Horiz 2=-241 (LC 12)
Max Uplift 2=-136 (LC 14), 10=-136 (LC 15)
Max Grav 2=1644 (LC 24), 10=1644 (LC 25)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/20, 2-4=-2312/220, 4-6=-2135/276, 6-8=-2135/276, 8-10=-2312/220, 10-11=0/20
BOT CHORD 2-15=-253/2074, 12-15=-17/1377, 10-12=-111/1893
WEBS 6-15=-145/1002, 6-12=-145/1002, 4-15=-497/293, 8-12=-497/293

NOTES
1) Unbalanced roof live loads have been considered for this design.
2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-8-1 to 2-8-11, Interior (1) 2-8-11 to 13-6-13, Exterior(2R) 13-6-13 to 20-4-3, Interior (1) 20-4-3 to 31-2-5, Exterior(2E) 31-2-5 to 34-7-1 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60

- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 2 and 10. This connection is for uplift only and does not consider lateral forces.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



October 5, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932


Job 22090049	Truss B03	Truss Type Common Structural Gable	Qty 1	Ply 1	DRB HOMES - 90 FaNC Job Reference (optional)	I54555839
-----------------	--------------	---------------------------------------	----------	----------	---	-----------

Carter Components (Sanford), Sanford, NC - 27332,

Run: 8.53 S Sep 22 2022 Print: 8.530 S Sep 22 2022 MiTek Industries, Inc. Wed Oct 05 07:40:12

Page: 1

ID:NGVW_pqHvvlis4QS2d0z4MyGMF_-RfC?PsB70Hq3NSgPqnL8w3uTXbGKwRCDoi7J4zJC?f

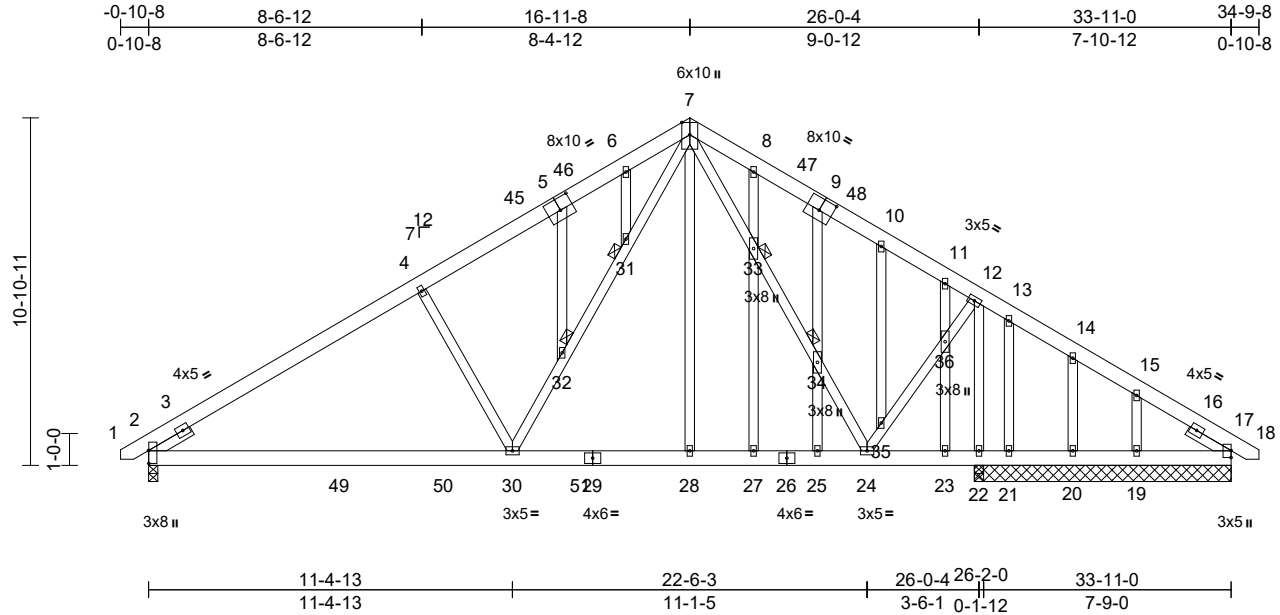

Scale = 1:72.2

Plate Offsets (X, Y): [2:0-4-14,0-0-2], [5:0-5-0,0-4-8], [9:0-5-0,0-4-8]

Loading	(psf)	Spacing	1-11-4	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.34	Vert(LL)	-0.12	30-39	>999	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.56	Vert(CT)	-0.21	30-39	>999	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.78	Horz(CT)	0.02	41	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 318 lb	FT = 20%

LUMBER
TOP CHORD 2x6 SP No.2
BOT CHORD 2x6 SP No.2
WEBS 2x4 SP No.3 *Except* 30-7,24-7:2x4 SP No.2
OTHERS 2x4 SP No.3
SLIDER Left 2x4 SP No.3 -- 1-6-0, Right 2x4 SP No.3 -- 1-6-0

BRACING
TOP CHORD Structural wood sheathing directly applied or 5-8-5 oc purlins.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
JOINTS 1 Brace at Jt(s): 31, 32, 33, 34

REACTIONS (size)
2=0-3-8, 17=8-0-8, 19=8-0-8, 20=8-0-8, 21=8-0-8, 22=0-3-8, 41=8-0-8
Max Horiz 2=-232 (LC 12)
Max Uplift 2=-115 (LC 14), 19=-103 (LC 15), 20=-36 (LC 15), 21=-63 (LC 21), 22=-74 (LC 14)
Max Grav 2=1225 (LC 24), 17=173 (LC 37), 19=278 (LC 25), 20=159 (LC 25), 21=20 (LC 14), 22=1332 (LC 24), 41=173 (LC 37)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/20, 2-4=-1547/178, 4-6=-1378/241, 6-7=-1256/251, 7-8=-560/227, 8-10=-620/201, 10-11=-619/126, 11-12=-528/91, 12-13=-115/58, 13-14=-60/49, 14-15=-80/28, 15-17=-85/42, 17-18=0/20

BOT CHORD 2-30=-242/1421, 28-30=0/772, 27-28=0/773, 25-27=0/773, 24-25=0/773, 23-24=-33/111, 22-23=-33/111, 21-22=-33/111, 20-21=-33/111, 19-20=-33/111, 17-19=-33/111
WEBS 30-32=-149/895, 31-32=-182/915, 7-31=-178/961, 7-33=-496/47, 33-34=-494/43, 24-34=-527/46, 24-35=-14/865, 35-36=-24/858, 12-36=-19/776, 12-22=-697/45, 4-30=-455/257, 7-28=0/208, 6-31=-53/0, 5-32=-85/38, 8-33=-40/100, 27-33=-34/98, 9-34=-203/71, 25-34=-188/79, 10-35=-68/64, 11-36=-254/56, 23-36=-369/75, 13-21=-228/32, 14-20=-84/65, 15-19=-171/105

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-8-1 to 2-8-11, Interior (1) 2-8-11 to 13-5-5, Exterior(2R) 13-5-5 to 20-2-12, Interior (1) 20-2-12 to 30-11-8, Exterior(2E) 30-11-8 to 34-7-1 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10

- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.



October 5, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ENGINEERING BY
TRENCO
A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Job 22090049	Truss C02	Truss Type Roof Special	Qty 4	Ply 1	DRB HOMES - 90 FaNC Job Reference (optional)	154555840
-----------------	--------------	----------------------------	----------	----------	---	-----------

Carter Components (Sanford), Sanford, NC - 27332,

Run: 8.53 S Sep 22 2022 Print: 8.530 S Sep 22 2022 MiTek Industries, Inc. Wed Oct 05 07:40:12
ID:NpYN7RFcvL119e2ac9ExSXYGMES-RfC?PsB70Hq3NSgPqnL8w3uITxBGKwRCD0i7J4zJC?f

Page: 1

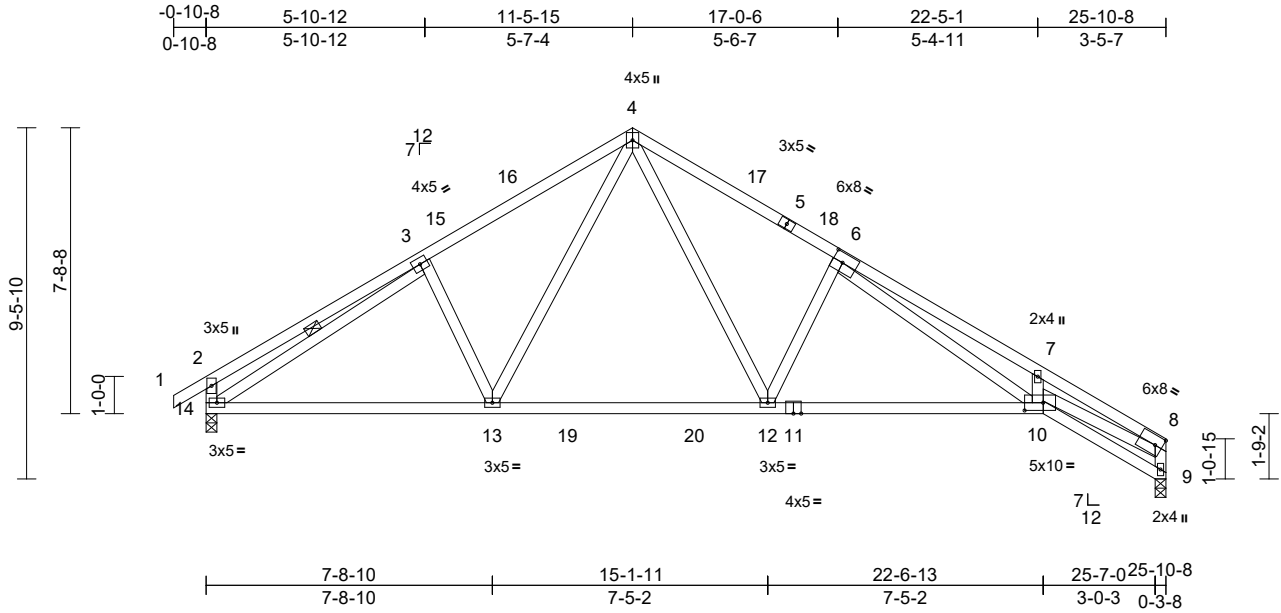

Scale = 1:62.1

Plate Offsets (X, Y): [6:0-3-5,0-3-1], [10:0-6-0,0-2-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.74	Vert(LL)	-0.26	10-12	>999	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.90	Vert(CT)	-0.51	10-12	>605	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.81	Horz(CT)	0.26	9	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 150 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 WEBS 2x4 SP No.3 *Except* 10-8:2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
 WEBS 1 Row at midpt 3-14

REACTIONS

(size) 9=0-3-8, 14=0-3-8
 Max Horiz 14=217 (LC 13)
 Max Uplift 9=-105 (LC 15), 14=-102 (LC 14)
 Max Grav 9=1174 (LC 25), 14=1213 (LC 24)

FORCES

(lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=0/31, 2-3=-451/133, 3-4=-1480/208,
 4-6=-1733/223, 6-7=-3884/457,
 7-8=-3875/321, 8-9=-1174/128,
 2-14=-415/141
 BOT CHORD 13-14=-101/1389, 12-13=0/1043,
 10-12=-43/1666, 9-10=-32/187
 WEBS 3-13=-291/203, 4-13=-99/551,
 4-12=-133/996, 6-12=-667/236,
 6-10=-287/2105, 7-10=-182/167,
 8-10=-231/3237, 3-14=-1247/52

NOTES

1) Unbalanced roof live loads have been considered for this design.

- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior (1) 2-1-8 to 8-5-15, Exterior(2R) 8-5-15 to 14-5-15, Interior (1) 14-5-15 to 22-8-12, Exterior(2E) 22-8-12 to 25-8-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Bearing at joint(s) 9 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 9 and 14. This connection is for uplift only and does not consider lateral forces.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



October 5, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

Job 22090049	Truss C03	Truss Type Roof Special Supported Gable	Qty 1	Ply 1	DRB HOMES - 90 FaNC Job Reference (optional)	154555841
-----------------	--------------	--	----------	----------	---	-----------

Carter Components (Sanford), Sanford, NC - 27332,

Run: 8.53 S Sep 22 2022 Print: 8.530 S Sep 22 2022 MiTek Industries, Inc. Wed Oct 05 07:40:13
ID:sph12DIEfKafPe1af4A8ZVyGMDDe-RfC?PsB70Hq3NSgPqnlL8w3uITXhGKWrCDoi7J4zJC7f

Page: 1

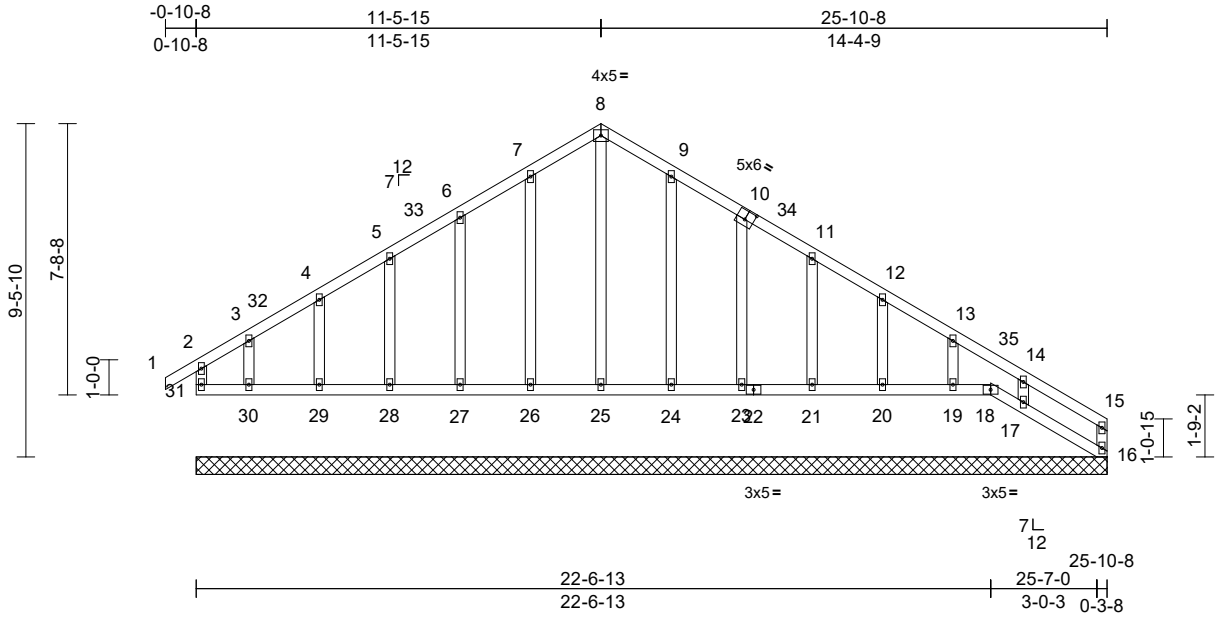

Scale = 1:65.4

Plate Offsets (X, Y): [10:0-3-0-0-3-0]

Loading	(psf)	Spacing	1-11-4	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.17	Vert(LL)	n/a	-	n/a	999	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.08	Vert(CT)	n/a	-	n/a	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.23	Horz(CT)	0.00	16	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-MR								
BCDL	10.0											
											Weight: 154 lb	FT = 20%

LUMBER	TOP CHORD	2x4 SP No.2	BOT CHORD	2x4 SP No.2	WEBS	2x4 SP No.3	OTHERS	2x4 SP No.3								
BRACING	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.														
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 17-18.															
REACTIONS (size)	16=25-10-8, 17=25-10-8, 18=25-10-8, 19=25-10-8, 20=25-10-8, 21=25-10-8, 23=25-10-8, 24=25-10-8, 25=25-10-8, 26=25-10-8, 27=25-10-8, 28=25-10-8, 29=25-10-8, 30=25-10-8, 31=25-10-8	31=210 (LC 13)	16=9 (LC 14), 17=114 (LC 15), 18=43 (LC 13), 19=43 (LC 15), 20=52 (LC 15), 21=41 (LC 15), 23=54 (LC 15), 24=46 (LC 15), 26=46 (LC 14), 27=51 (LC 14), 28=50 (LC 14), 29=42 (LC 14), 30=111 (LC 11), 31=146 (LC 10)	16=76 (LC 22), 17=221 (LC 25), 18=59 (LC 10), 19=148 (LC 25), 20=167 (LC 25), 21=151 (LC 25), 23=217 (LC 22), 24=255 (LC 22), 25=220 (LC 15), 26=245 (LC 21), 27=220 (LC 21), 28=163 (LC 24), 29=163 (LC 1), 30=195 (LC 28), 31=215 (LC 25)	TOP CHORD	2-31=-169/111, 1-2=0/30, 2-3=-180/174, 3-4=-142/145, 4-5=-133/166, 5-6=-118/192, 6-7=-144/230, 7-8=-169/271, 8-9=-170/272, 9-11=-144/229, 11-12=-95/141, 12-13=-68/94, 13-14=-58/53, 14-15=-79/58, 15-16=-72/15			BOT CHORD	30-31=-64/75, 29-30=-64/75, 28-29=-64/75, 27-28=-64/75, 26-27=-64/75, 25-26=-64/75, 24-25=-64/75, 23-24=-64/75, 21-23=-61/74, 20-21=-61/74, 19-20=-61/74, 18-19=-61/74, 17-18=-85/92, 16-17=-71/84			WEBS	8-25=-217/83, 7-26=-206/69, 6-27=-181/75, 5-28=-123/72, 4-29=-123/71, 3-30=-129/88, 9-24=-216/69, 10-23=-178/77, 11-21=-113/64, 12-20=-127/76, 13-19=-112/62, 14-17=-158/107		
NOTES	<p>5) Unbalanced snow loads have been considered for this design.</p> <p>6) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.</p> <p>7) All plates are 2x4 MT20 unless otherwise indicated.</p> <p>8) Gable requires continuous bottom chord bearing.</p> <p>9) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).</p> <p>10) Gable studs spaced at 2-0-0 oc.</p> <p>11) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.</p> <p>12) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.</p>															

FORCES	(lb) - Maximum Compression/Maximum Tension
Max Horiz	16=9 (LC 14), 17=114 (LC 15), 18=43 (LC 13), 19=43 (LC 15), 20=52 (LC 15), 21=41 (LC 15), 23=54 (LC 15), 24=46 (LC 15), 26=46 (LC 14), 27=51 (LC 14), 28=50 (LC 14), 29=42 (LC 14), 30=111 (LC 11), 31=146 (LC 10)
Max Uplift	16=76 (LC 22), 17=221 (LC 25), 18=59 (LC 10), 19=148 (LC 25), 20=167 (LC 25), 21=151 (LC 25), 23=217 (LC 22), 24=255 (LC 22), 25=220 (LC 15), 26=245 (LC 21), 27=220 (LC 21), 28=163 (LC 24), 29=163 (LC 1), 30=195 (LC 28), 31=215 (LC 25)
Max Grav	16=76 (LC 22), 17=221 (LC 25), 18=59 (LC 10), 19=148 (LC 25), 20=167 (LC 25), 21=151 (LC 25), 23=217 (LC 22), 24=255 (LC 22), 25=220 (LC 15), 26=245 (LC 21), 27=220 (LC 21), 28=163 (LC 24), 29=163 (LC 1), 30=195 (LC 28), 31=215 (LC 25)
FORCES	(lb) - Maximum Compression/Maximum Tension



October 5, 2022

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSITPI Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



Job 22090049	Truss C03	Truss Type Roof Special Supported Gable	Qty 1	Ply 1	DRB HOMES - 90 FaNC Job Reference (optional)	I54555841
-----------------	--------------	--	----------	----------	---	-----------

Carter Components (Sanford), Sanford, NC - 27332,

Run: 8.53 S Sep 22 2022 Print: 8.530 S Sep 22 2022 MiTek Industries, Inc. Wed Oct 05 07:40:13
ID:sph12DEfKafPe1af4A8ZVyGMDe-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

Page: 2

- 13) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 146 lb uplift at joint 31, 43 lb uplift at joint 18, 9 lb uplift at joint 16, 46 lb uplift at joint 26, 51 lb uplift at joint 27, 50 lb uplift at joint 28, 42 lb uplift at joint 29, 111 lb uplift at joint 30, 46 lb uplift at joint 24, 54 lb uplift at joint 23, 41 lb uplift at joint 21, 52 lb uplift at joint 20, 43 lb uplift at joint 19 and 114 lb uplift at joint 17.
- 14) Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 31, 18, 25, 26, 27, 28, 29, 30, 24, 23, 21, 20, 19, 17.
- 15) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932

Job 22090049	Truss D01	Truss Type Monopitch	Qty 4	Ply 1	DRB HOMES - 90 FaNC Job Reference (optional)	154555842
-----------------	--------------	-------------------------	----------	----------	---	-----------

Carter Components (Sanford), Sanford, NC - 27332,

Run: 8.53 S Sep 22 2022 Print: 8.530 S Sep 22 2022 MiTek Industries, Inc. Wed Oct 05 07:40:13
ID:duDvsaOamEtiR5Ee7uw_GLyGMD_-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC7f

Page: 1

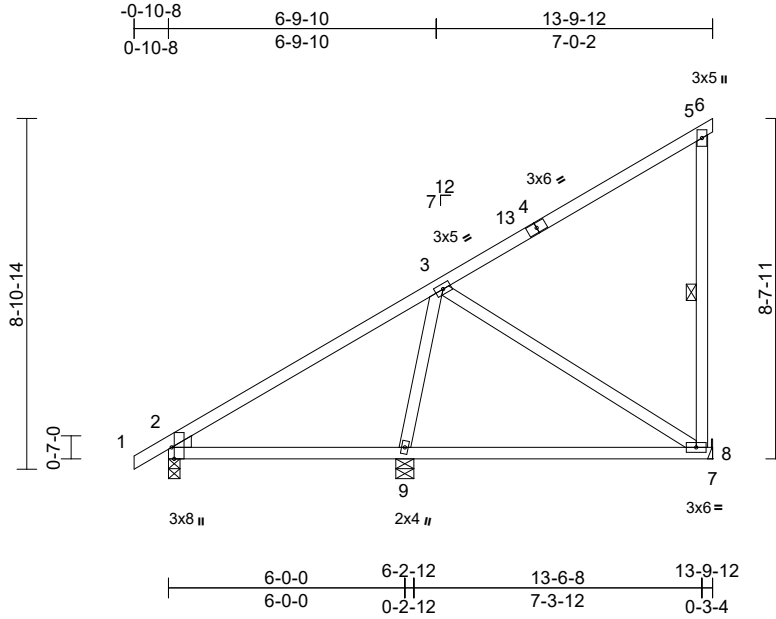

Scale = 1:58.5

Plate Offsets (X, Y): [2:0-3-8,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.82	Vert(LL)	0.09	9-12	>843	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.48	Vert(CT)	-0.16	8-9	>560	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.37	Horz(CT)	-0.01	2	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 76 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3
WEDGE Left: 2x4 SP No.3

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 5-8

REACTIONS (size) 2=0-3-8, 8= Mechanical, 9=0-5-8
Max Horiz 2=300 (LC 13)
Max Uplift 2=-76 (LC 14), 8=-154 (LC 14)
Max Grav 2=402 (LC 1), 8=524 (LC 21), 9=445 (LC 21)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/26, 2-3=-356/337, 3-5=-212/118, 5-6=-13/0, 5-8=-298/77
BOT CHORD 2-9=-229/262, 8-9=-218/300, 7-8=0/0
WEBS 3-9=-276/23, 3-8=-306/377

NOTES

- Wind: ASCE 7-16; Vult=130mph (3-second gust)
Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft;
Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior (1) 2-1-8 to 10-9-12, Exterior(2E) 10-9-12 to 13-9-12 zone; cantilever left and right exposed; end vertical left and right exposed; porch left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10

- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 154 lb uplift at joint 8.
- One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 2. This connection is for uplift only and does not consider lateral forces.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



October 5, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932

Job 22090049	Truss D02	Truss Type Monopitch Structural Gable	Qty 1	Ply 1	DRB HOMES - 90 FaNC Job Reference (optional)	154555843
-----------------	--------------	--	----------	----------	---	-----------

Carter Components (Sanford), Sanford, NC - 27332,

Run: 8.53 S Sep 22 2022 Print: 8.530 S Sep 22 2022 MiTek Industries, Inc. Wed Oct 05 07:40:14
ID:HCyRNhX5xwO?bx9yqQ80ltyGMCo-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWRCDoI7J4zJC?F

Page: 1

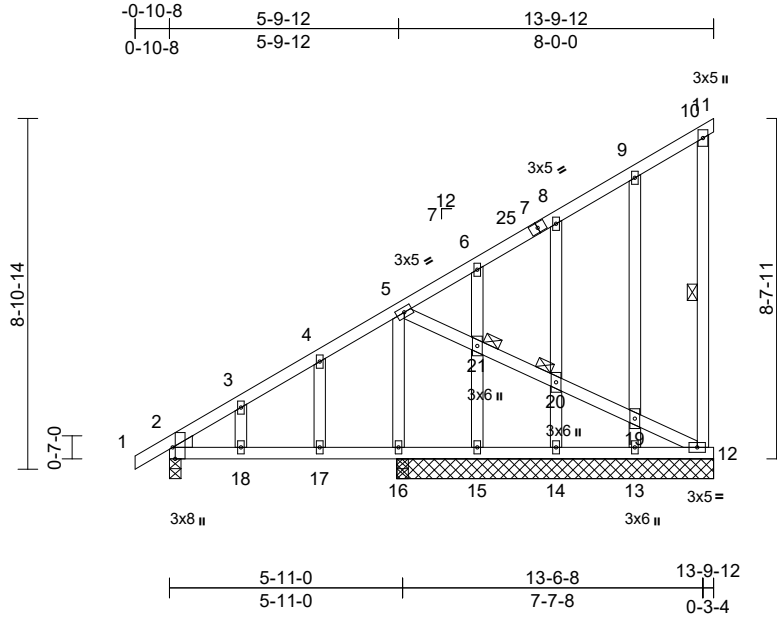

Scale = 1:58.5

Plate Offsets (X, Y): [2:0-3-8,Edge]

Loading	(psf)	Spacing	1-11-4	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.66	Vert(LL)	0.06	17-18	>999	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.31	Vert(CT)	-0.06	17-18	>999	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.15	Horz(CT)	-0.01	11	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 106 lb	FT = 20%

LUMBER	
TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
WEBS	2x4 SP No.3
OTHERS	2x4 SP No.3
WEDGE	Left: 2x4 SP No.3
BRACING	
TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	1 Row at midpt 10-12
JOINTS	1 Brace at Jt(s): 20, 21
REACTIONS	(size)
	2=0-3-8, 11=8-0-8, 12=8-0-8, 13=8-0-8, 14=8-0-8, 15=8-0-8, 16=8-0-8
Max Horiz	2=290 (LC 13)
Max Uplift	2=-29 (LC 14), 11=-84 (LC 14), 12=-167 (LC 13), 13=-50 (LC 14), 14=-61 (LC 14), 15=-5 (LC 7), 16=-24 (LC 11)
Max Grav	2=356 (LC 21), 11=108 (LC 13), 12=201 (LC 24), 13=217 (LC 21), 14=261 (LC 21), 15=55 (LC 11), 16=265 (LC 1)
FORCES	(lb) - Maximum Compression/Maximum Tension
TOP CHORD	1-2=0/26, 2-3=-309/181, 3-4=-288/192, 4-5=-256/203, 5-6=-176/103, 6-8=-161/105, 8-9=-153/104, 9-10=-113/109, 10-11=-76/70, 10-12=-137/119
BOT CHORD	2-18=-183/212, 17-18=-162/212, 16-17=-162/212, 15-16=-162/212, 14-15=-162/212, 13-14=-162/212, 12-13=-162/212

WEBS	
	5-21=-205/273, 20-21=-204/272, 19-20=-205/272, 12-19=-208/277, 9-19=-191/61, 13-19=-184/56, 8-20=-200/98, 14-20=-198/96, 6-21=-56/41, 15-21=-59/42, 5-16=-62/0, 4-17=-62/49, 3-18=-52/43

NOTES

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior (1) 2-1-8 to 13-9-12 zone; cantilever left and right exposed ; end vertical left and right exposed; porch left exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- 4) Unbalanced snow loads have been considered for this design.
- 5) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- 6) All plates are 2x4 MT20 unless otherwise indicated.
- 7) Gable studs spaced at 2-0-0 oc.
- 8) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 9) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.

- 10) Bearing at joint(s) 11 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 11) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 84 lb uplift at joint 11.



October 5, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932

Job 22090049	Truss D03	Truss Type Monopitch	Qty 3	Ply 1	DRB HOMES - 90 FaNC Job Reference (optional)	154555844
-----------------	--------------	-------------------------	----------	----------	---	-----------

Carter Components (Sanford), Sanford, NC - 27332,

Run: 8.53 S Sep 22 2022 Print: 8.530 S Sep 22 2022 MiTek Industries, Inc. Wed Oct 05 07:40:14
ID:a5wx_1pHWYAIeQkXNQwXyGMC9-RfC?PsB70Hq3NSgPqnL8w3uTXbGKwRCDoi7J4zJC?f

Page: 1

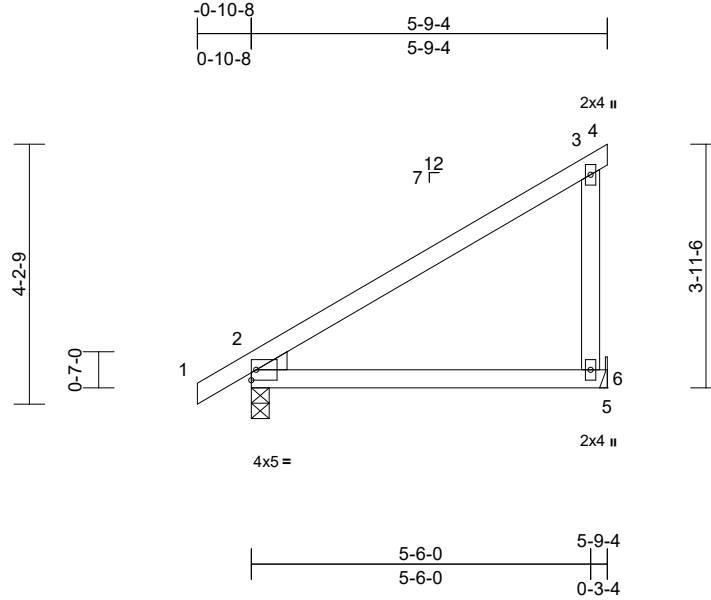

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	Vert(LL)	0.15	6-9	>436	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	Vert(CT)	-0.14	6-9	>482	180		
TCDL	10.0	Rep Stress Incr	YES	WB	Horz(CT)	0.02	2	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-MP							
BCDL	10.0									Weight: 26 lb	FT = 20%

LUMBER
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3
WEDGE Left: 2x4 SP No.3

BRACING
TOP CHORD Structural wood sheathing directly applied or 5-9-4 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 2=0-3-8, 6= Mechanical
Max Horiz 2=132 (LC 13)
Max Uplift 2=-30 (LC 14), 6=-78 (LC 11)
Max Grav 2=360 (LC 21), 6=353 (LC 21)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/26, 2-3=-128/92, 3-4=-13/0, 3-6=-257/129
BOT CHORD 2-6=-90/94, 5-6=0/0

- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Refer to girder(s) for truss to truss connections.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 78 lb uplift at joint 6.
 - One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 2. This connection is for uplift only and does not consider lateral forces.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- LOAD CASE(S)** Standard

- NOTES**
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior (1) 2-1-8 to 2-9-4, Exterior(2E) 2-9-4 to 5-9-4 zone; cantilever left and right exposed; end vertical left and right exposed; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
 - Unbalanced snow loads have been considered for this design.
 - This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.



October 5, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932

Job 22090049	Truss E01	Truss Type Common	Qty 1	Ply 1	DRB HOMES - 90 FaNC Job Reference (optional)	154555845
-----------------	--------------	----------------------	----------	----------	---	-----------

Carter Components (Sanford), Sanford, NC - 27332,

Run: 8.53 S Sep 22 2022 Print: 8.530 S Sep 22 2022 MiTek Industries, Inc. Wed Oct 05 07:40:14
ID:ihREf8wh5VYyjslTpPoBeczDKNI-RfC?PsB70Hq3NSgPqnL8w3uTXbGKWrCDoi7J4zJC7f

Page: 1

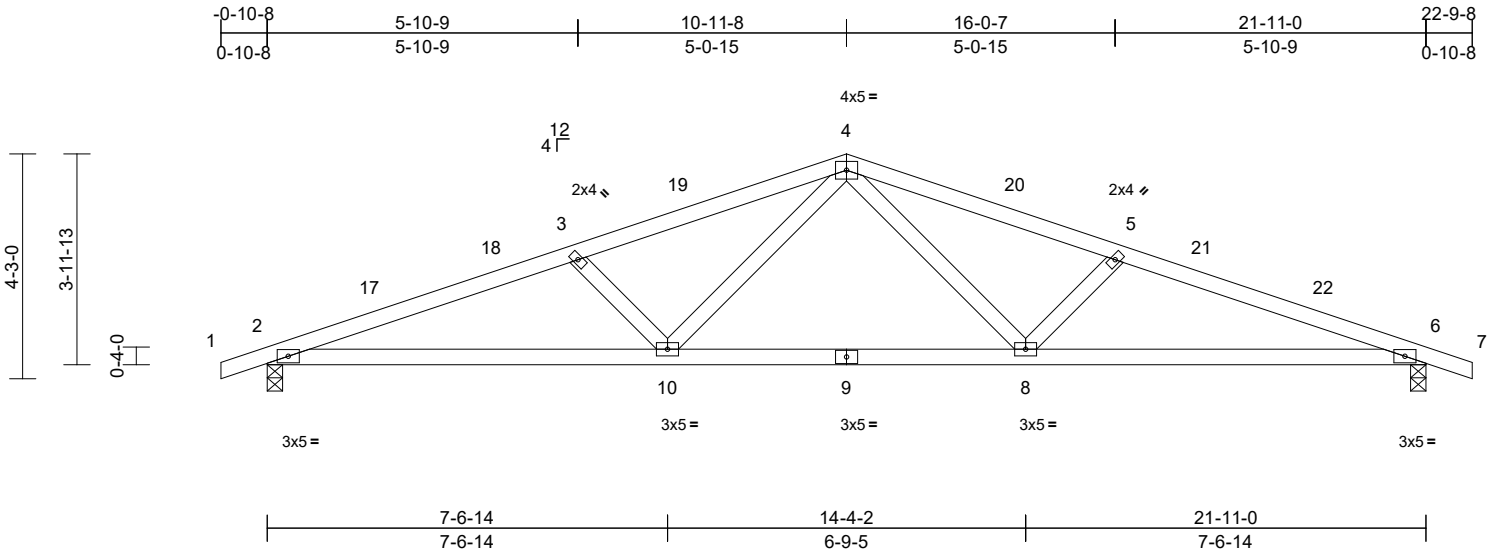

Scale = 1:43.6

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.50	Vert(LL)	-0.10	10	>999	240	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.74	Vert(CT)	-0.22	10-13	>999	180	
TCDL	10.0	Rep Stress Incr	YES	WB	0.30	Horz(CT)	0.06	6	n/a	n/a	
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-MSH							
BCDL	10.0									Weight: 92 lb	FT = 20%

LUMBER	
TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
WEBS	2x4 SP No.3
BRACING	
TOP CHORD	Structural wood sheathing directly applied or 3-6-12 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
REACTIONS	
(size)	2=0-3-8, 6=0-3-8
Max Horiz	2=63 (LC 14)
Max Uplift	2=-136 (LC 10), 6=-136 (LC 11)
Max Grav	2=976 (LC 21), 6=976 (LC 22)
FORCES	
(lb) - Maximum Compression/Maximum Tension	
TOP CHORD	1-2=0/17, 2-3=-2246/431, 3-4=-1938/383, 4-5=-1938/383, 5-6=-2246/431, 6-7=0/17
BOT CHORD	2-10=-333/2108, 8-10=-185/1307, 6-8=-333/2108
WEBS	4-8=-60/714, 5-8=-510/168, 4-10=-60/714, 3-10=-510/168

- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 2 and 6. This connection is for uplift only and does not consider lateral forces.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior (1) 2-1-8 to 7-11-8, Exterior(2R) 7-11-8 to 13-11-8, Interior (1) 13-11-8 to 19-9-8, Exterior(2E) 19-9-8 to 22-9-8 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10



October 5, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932

Job 22090049	Truss M01	Truss Type Scissor	Qty 5	Ply 1	DRB HOMES - 90 FaNC Job Reference (optional)	154555847
-----------------	--------------	-----------------------	----------	----------	---	-----------

Carter Components (Sanford), Sanford, NC - 27332,

Run: 8.53 S Sep 22 2022 Print: 8.530 S Sep 22 2022 MiTek Industries, Inc. Wed Oct 05 07:40:15
ID: ?sLARzd3QKsjhmbdCaqo_rzDKMO-RFC?PsB70Hq3NSgPqnL8w3uITXbGKwRCDoi7J4zJC?f

Page: 1

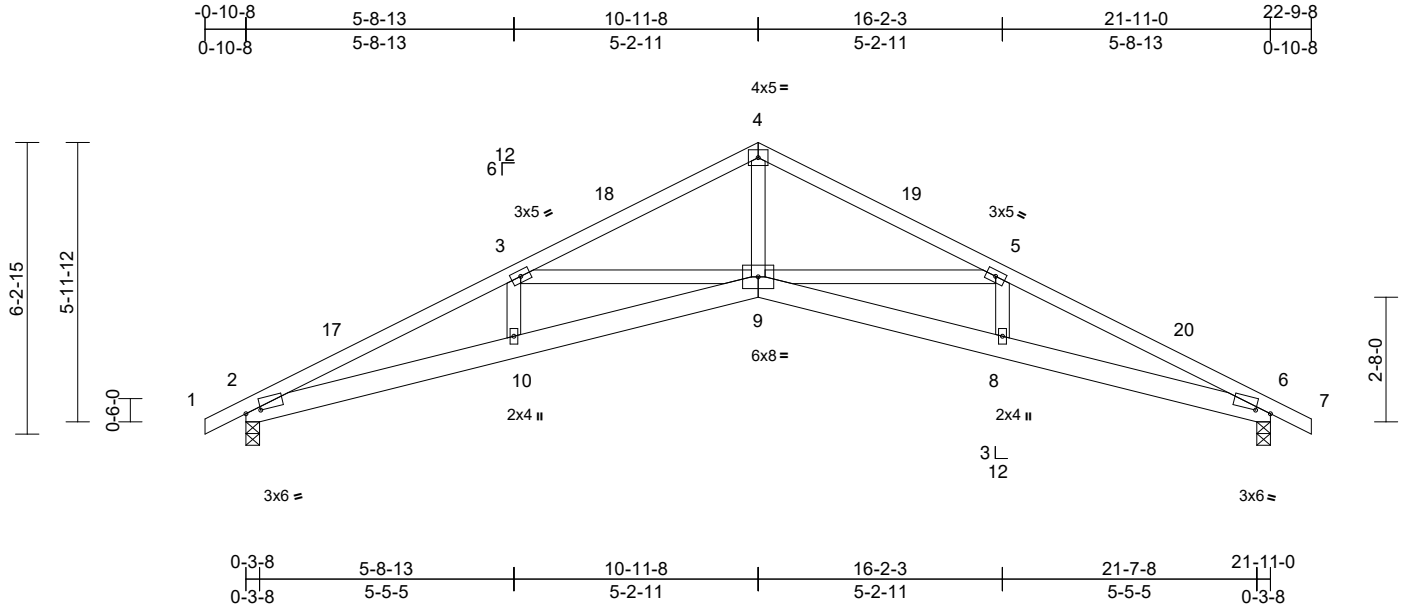

Scale = 1:49.3

Plate Offsets (X, Y): [2:0-3-15,0-0-0], [6:0-3-15,0-0-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.74	Vert(LL)	-0.14	8-9	>999	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.59	Vert(CT)	-0.28	8-9	>931	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.57	Horz(CT)	0.18	6	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 115 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x6 SP No.2
WEBS 2x4 SP No.3

BRACING

TOP CHORD Structural wood sheathing directly applied or 2-8-14 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(size) 2=0-3-8, 6=0-3-8
Max Horiz 2=-94 (LC 15)
Max Uplift 2=-101 (LC 14), 6=-101 (LC 15)
Max Grav 2=968 (LC 21), 6=968 (LC 22)

FORCES

(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/23, 2-3=-2777/351, 3-4=-1969/254, 4-5=-1969/254, 5-6=-2777/351, 6-7=0/23
BOT CHORD 2-10=-267/2505, 9-10=-268/2527, 8-9=-235/2527, 6-8=-233/2505
WEBS 4-9=-81/1367, 5-8=0/163, 3-9=-778/228, 3-10=0/163, 5-9=-778/239

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-10-8 to 2-1-8, Interior (1) 2-1-8 to 7-11-8, Exterior(2R) 7-11-8 to 13-11-8, Interior (1) 13-11-8 to 19-9-8, Exterior(2E) 19-9-8 to 22-9-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60

- 3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- 4) Unbalanced snow loads have been considered for this design.
- 5) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 8) Bearing at joint(s) 2, 6 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 9) One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 2 and 6. This connection is for uplift only and does not consider lateral forces.
- 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



October 5, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




818 Soundside Road
Edenton, NC 27932

Job 22090049	Truss V01	Truss Type Valley	Qty 1	Ply 1	DRB HOMES - 90 FaNC Job Reference (optional)	I54555849
-----------------	--------------	----------------------	----------	----------	---	-----------

Carter Components (Sanford), Sanford, NC - 27332,

Run: 8.53 S Sep 22 2022 Print: 8.530 S Sep 22 2022 MiTek Industries, Inc. Wed Oct 05 07:40:15
ID: fryBRKwSrW_wSCYjZOGzWHyGMN8-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWRcDoi7J4zJC?f

Page: 1

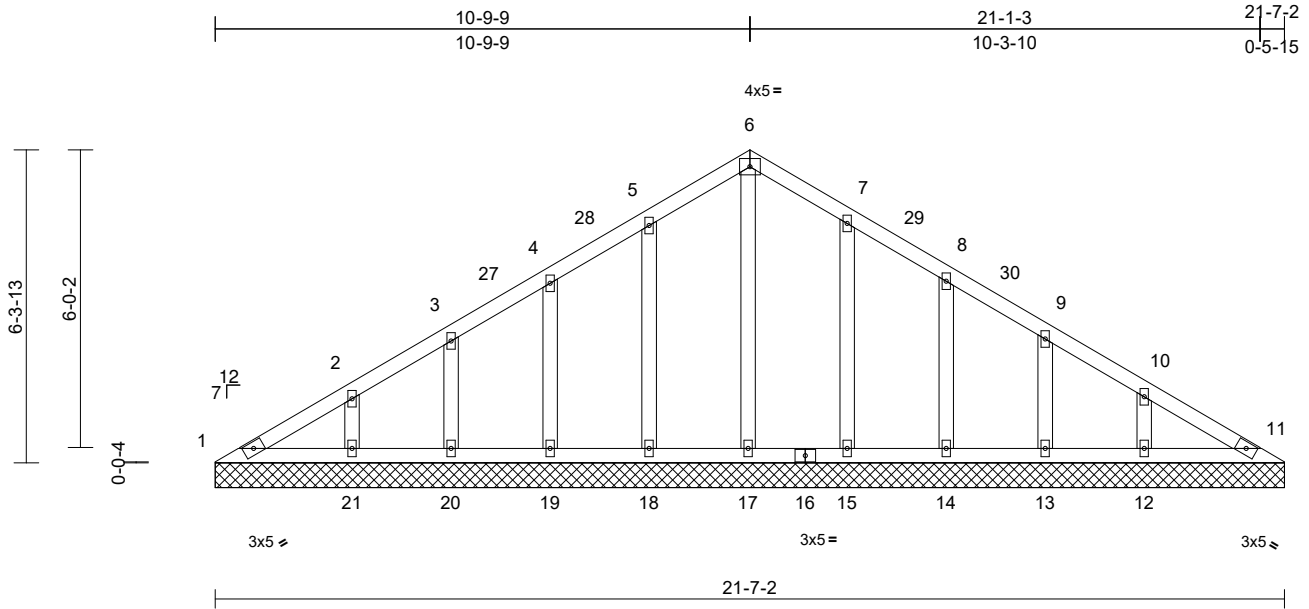

Scale = 1:46.5

Loading	(psf)	Spacing	1-11-4	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.13	Vert(LL)	n/a	-	n/a	999	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.09	Vert(TL)	n/a	-	n/a	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.15	Horiz(TL)	0.00	11	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 110 lb	FT = 20%

LUMBER	
TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
OTHERS	2x4 SP No.3
BRACING	
TOP CHORD	Structural wood sheathing directly applied or 10-0-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.
REACTIONS (size)	
Max Horiz	1=140 (LC 11)
Max Uplift	1=-31 (LC 10), 12=-42 (LC 15), 13=-58 (LC 15), 14=-48 (LC 15), 15=-47 (LC 15), 18=-50 (LC 14), 19=-50 (LC 14), 20=-46 (LC 14), 21=-58 (LC 14)
Max Grav	1=72 (LC 28), 12=242 (LC 21), 13=124 (LC 24), 14=231 (LC 21), 15=244 (LC 21), 17=263 (LC 26), 18=249 (LC 20), 19=221 (LC 20), 20=147 (LC 23), 21=211 (LC 33)
FORCES (lb) - Maximum Compression/Maximum Tension	
TOP CHORD	1-2=-99/212, 2-3=-75/190, 3-4=-48/179, 4-5=-27/185, 5-6=-34/185, 6-7=-34/177, 7-8=-12/160, 8-9=0/151, 9-10=0/126, 10-11=-57/147
BOT CHORD	1-21=-105/69, 20-21=-105/53, 19-20=-105/53, 18-19=-105/53, 17-18=-105/53, 15-17=-104/54, 14-15=-104/54, 13-14=-104/54, 12-13=-104/54, 11-12=-104/54
WEBS	6-17=-223/0, 5-18=-211/74, 4-19=-179/73, 3-20=-118/71, 2-21=-140/73, 7-15=-207/70, 8-14=-185/73, 9-13=-107/76, 10-12=-156/68

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-0-7 to 2-9-9, Interior (1) 2-9-9 to 7-10-0, Exterior(2R) 7-10-0 to 13-10-0, Interior (1) 13-10-0 to 18-1-8, Exterior(2E) 18-1-8 to 21-1-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 31 lb uplift at joint 1, 50 lb uplift at joint 18, 50 lb uplift at joint 19, 46 lb uplift at joint 20, 58 lb uplift at joint 21, 47 lb uplift at joint 15, 48 lb uplift at joint 14, 58 lb uplift at joint 13 and 42 lb uplift at joint 12.

12) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



October 5, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932

Job 22090049	Truss V02	Truss Type Valley	Qty 1	Ply 1	DRB HOMES - 90 FaNC Job Reference (optional)	154555850
-----------------	--------------	----------------------	----------	----------	---	-----------

Carter Components (Sanford), Sanford, NC - 27332,

Run: 8.53 S Sep 22 2022 Print: 8.530 S Sep 22 2022 MiTek Industries, Inc. Wed Oct 05 07:40:16
ID: fryBRKWsRw_wSCYj2OGZwHyGMN8-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWRCDoi7J4zJC?f

Page: 1

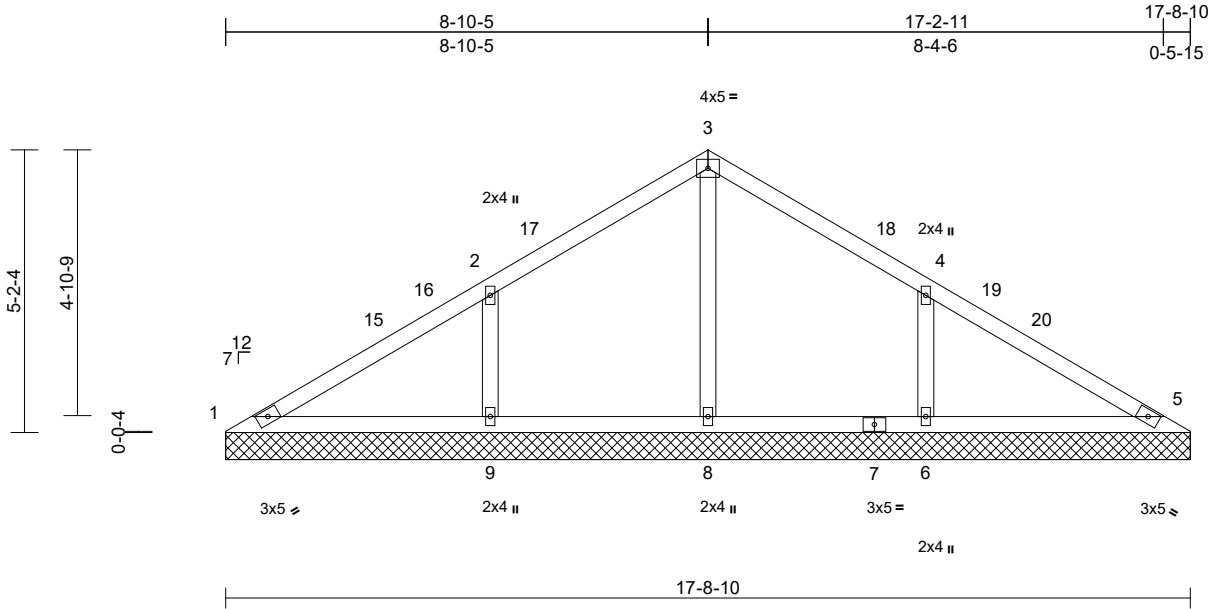

Scale = 1:42.3

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.42	Vert(LL)	n/a	-	n/a	999	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.19	Vert(TL)	n/a	-	n/a	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.23	Horiz(TL)	-0.01	5	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 69 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.3

BRACING

TOP CHORD Structural wood sheathing directly applied or 10-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS

(size) 1=17-8-10, 5=17-8-10, 6=17-8-10, 8=17-8-10, 9=17-8-10, 14=17-8-10
Max Horiz 1=117 (LC 11)
Max Uplift 1=-37 (LC 34), 6=-130 (LC 15), 9=-135 (LC 14)
Max Grav 1=95 (LC 33), 5=0 (LC 24), 6=535 (LC 21), 8=542 (LC 21), 9=540 (LC 20), 14=0 (LC 24)

FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=-112/348, 2-3=0/316, 3-4=0/337, 4-5=-105/350
BOT CHORD 1-9=-239/92, 8-9=-239/74, 6-8=-239/74, 5-6=-239/74
WEBS 3-8=-481/1, 2-9=-421/170, 4-6=-419/168

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-0-7 to 3-0-7, Interior (1) 3-0-7 to 5-10-12, Exterior(2R) 5-10-12 to 11-10-12, Interior (1) 11-10-12 to 14-9-1, Exterior(2E) 14-9-1 to 17-9-1 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60

- 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 4) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- 5) Unbalanced snow loads have been considered for this design.
- 6) Gable requires continuous bottom chord bearing.
- 7) Gable studs spaced at 4-0-0 oc.
- 8) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 9) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 10) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 37 lb uplift at joint 1, 135 lb uplift at joint 9 and 130 lb uplift at joint 6.
- 11) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



October 5, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932

Job 22090049	Truss V03	Truss Type Valley	Qty 1	Ply 1	DRB HOMES - 90 FaNC Job Reference (optional)	154555851
-----------------	--------------	----------------------	----------	----------	---	-----------

Carter Components (Sanford), Sanford, NC - 27332,

Run: 8.53 S Sep 22 2022 Print: 8.530 S Sep 22 2022 MiTek Industries, Inc. Wed Oct 05 07:40:16
ID:71WZefXUcq6n4M7vc5noTUyGMN7-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

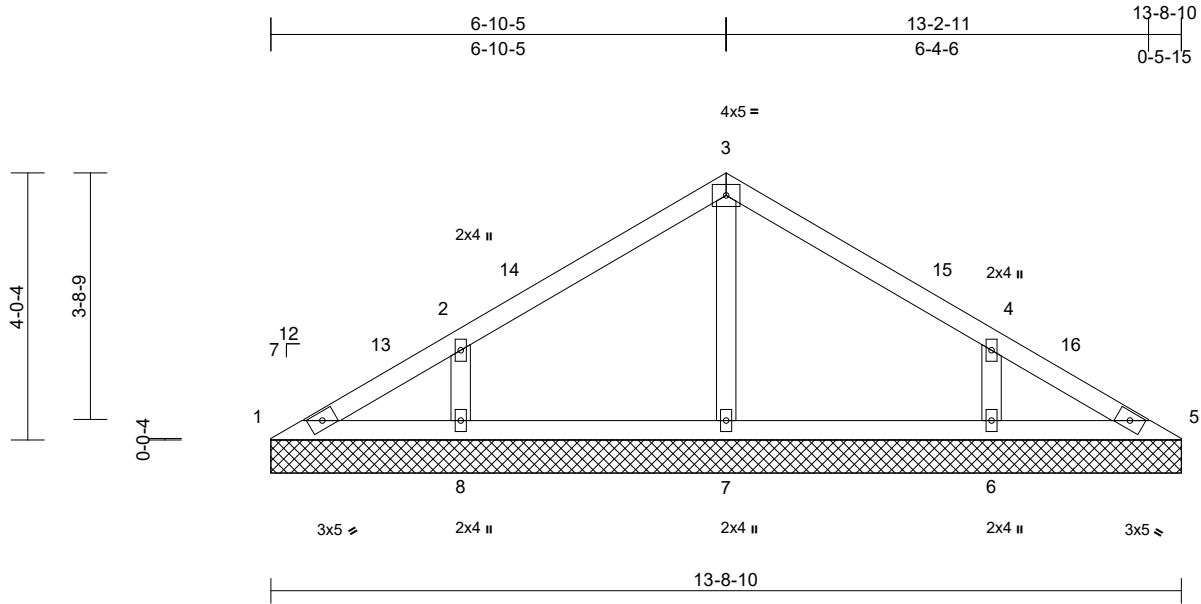

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.29	Vert(LL)	n/a	-	n/a	999	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.12	Vert(TL)	n/a	-	n/a	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.08	Horiz(TL)	0.00	5	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-MSH								
BCDL	10.0											
										Weight: 51 lb	FT = 20%	

LUMBER
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.3

BRACING
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS (size) 1=13-8-10, 5=13-8-10, 6=13-8-10, 7=13-8-10, 8=13-8-10
Max Horiz 1=-90 (LC 10)
Max Uplift 1=-11 (LC 15), 6=-101 (LC 15), 8=-103 (LC 14)
Max Grav 1=86 (LC 24), 5=80 (LC 1), 6=455 (LC 21), 7=309 (LC 21), 8=455 (LC 20)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-119/94, 2-3=-127/88, 3-4=-127/81, 4-5=-100/68
BOT CHORD 1-8=-34/102, 7-8=-34/51, 6-7=-34/51, 5-6=-34/78
WEBS 3-7=-226/24, 2-8=-386/144, 4-6=-386/144

NOTES
1) Unbalanced roof live loads have been considered for this design.
2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-0-7 to 2-10-12, Interior (1) 2-10-12 to 3-10-12, Exterior(2R) 3-10-12 to 9-10-12, Interior (1) 9-10-12 to 10-9-1, Exterior(2E) 10-9-1 to 13-9-1 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60

- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 11 lb uplift at joint 1, 103 lb uplift at joint 8 and 101 lb uplift at joint 6.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



October 5, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSITPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932

Job 22090049	Truss V04	Truss Type Valley	Qty 1	Ply 1	DRB HOMES - 90 FaNC Job Reference (optional)	154555852
-----------------	--------------	----------------------	----------	----------	---	-----------

Carter Components (Sanford), Sanford, NC - 27332,

Run: 8.53 S Sep 22 2022 Print: 8.530 S Sep 22 2022 MiTek Industries, Inc. Wed Oct 05 07:40:17
ID:71WZefXUcq6n4M7vc5noTUyGMN7-RfC?PsB70Hq3NSgPqnL8w3uITXbGKwCrDoi7J4zJC?f

Page: 1

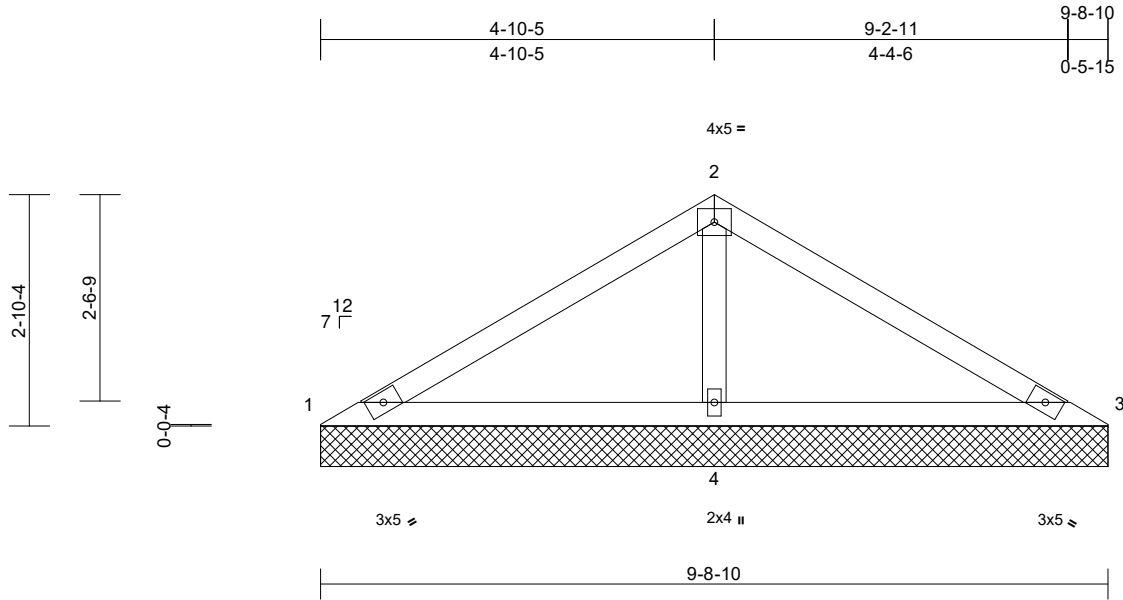

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.41	Vert(LL)	n/a	-	n/a	999	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.40	Vert(TL)	n/a	-	n/a	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.13	Horiz(TL)	0.00	4	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-MSH								
BCDL	10.0										Weight: 33 lb	FT = 20%

LUMBER
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.3

BRACING
TOP CHORD Structural wood sheathing directly applied or 9-8-10 oc purlins.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS (size) 1=9-8-10, 3=9-8-10, 4=9-8-10
Max Horiz 1=63 (LC 11)
Max Uplift 1=-38 (LC 21), 3=-38 (LC 20), 4=-68 (LC 14)
Max Grav 1=123 (LC 20), 3=123 (LC 21), 4=742 (LC 20)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-122/388, 2-3=-122/388
BOT CHORD 1-4=-247/135, 3-4=-247/135
WEBS 2-4=-567/203

- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 38 lb uplift at joint 1, 38 lb uplift at joint 3 and 68 lb uplift at joint 4.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-0-7 to 3-0-7, Exterior(2R) 3-0-7 to 6-9-1, Exterior(2E) 6-9-1 to 9-9-1 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.



October 5, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component


Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.

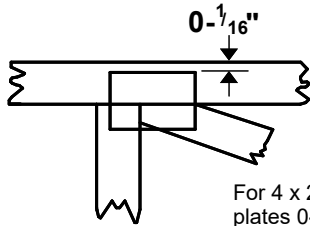

For 4 x 2 orientation, locate plates 0- 1/16" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.


* Plate location details available in MiTek 20/20 software or upon request.

PLATE SIZE

4 x 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur. Min size shown is for crushing only.

Industry Standards:

- ANSI/TPI1: National Design Specification for Metal Plate Connected Wood Truss Construction.
 DSB-89: Design Standard for Bracing.
 BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

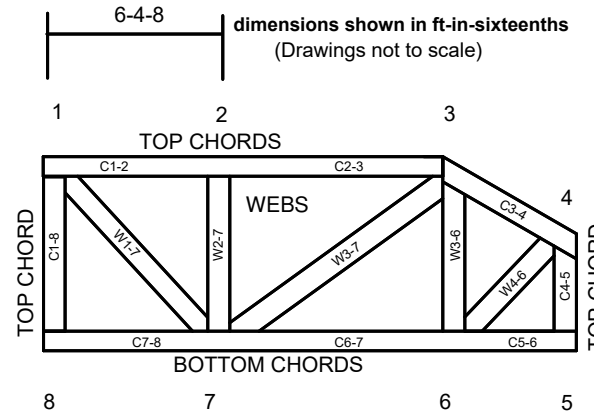

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ESR1988
 ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TPI 1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MiTek® All Rights Reserved



MiTek Engineering Reference Sheet: MII-7473 rev. 5/19/2020

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TPI 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TPI 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TPI 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.