1-25-18

## **|**/4" = |'-0" BUILDER MEN507IR DRAWN BY



I. GUTTERS AND DOWNSPOUTS ARE NOT SHOWN FOR CLARITY. DOWNSPOUTS SHALL BE LOCATED TOWARDS THE FRONT AND REAR OF THE HOUSE, LOCATE DOWNSPOUTS IN NON-VISUALLY OFFENSIVE LOCATIONS, FOR EXAMPLE, FRONT WALL OF HOUSE, BESIDE PORCH COLUMNS, ETC. GENERAL CONTRACTOR SHALL VERIFY EXISTING GRADES AND COORDINATE ANY NECESSARY ADJUSTMENTS TO HOUSE WITH OWNER.

2. PLUMBING AND HVAC VENTS SHALL BE GROUPED IN ATTIC TO LIMIT ROOF PENETRATIONS AND TO BE LOCATED AWAY FROM PUBLIC VIEW, I.E. AT THE REAR OF THE HOUSE AND SHALL BE PRIMED AND PAINTED TO MATCH ROOF COLOR.

3. PROVIDE ATTIC VENTILATION PER LOCAL CODE REQUIREMENTS.

4. EXTERIOR FLASHING SHALL BE CORRECTLY INSTALLED AT ALL CONNECTIONS BETWEEN ROOFS. WALLS, CHIMNEYS, PROJECTIONS AND PENETRATIONS AS REQUIRED BY APPROVED CONSTRUCTION PRACTICES.

5. CONTRACTOR SHALL PROVIDE ADEQUATE ATTIC VENTILATIONS / ROOF VENTS PER LOCAL GOVERNING CODE. INSTALL CONTINUOUS RIDGE VENTILATION AND PAINT TO MATCH ROOF. PROVIDE APPROPRIATE SOFFIT VENTILATION AT OVERHANGS.

1/2" GYP. BOARD <sup>L</sup>

ROOFING - SEE ELEVATION
15# ROOFING FELT

∠2 - 2X4 TOP PL.

— IXI2 FRIEZE

1/2" CDX PLYWOOD W/ CLIPS MIN. 2X6 OR 2X8 RAFTERS ● 16"o.c.

— 2X6 OR 2X8 CEILING JOISTS ♠16"o.c.

—2X6 SUB-FASCIA

---3/8" EXT. PLYWOOD SOFFIT W/ 2" CONT. VENT OR VINYL SOFFITS

──IX2 TRIM OR 3 I/4" CROWN


——2X4 BLOCKING ♠ 24"o.c. —— IX4 OR 2X4 CONTINUOUS NAILER

- IX8 FASCIA CUT TO 6-I/4" NOTCH I/4" DEEP FOR 3/8" SOFFIT - IX2 TRIM


— 2X4 STUDS ♠ 16"o.c. — 1/2" FOIL BACK SHEATHING — TYVEK WRAP

— BRICK W/ TIES — MIN. R-13 BATT INSULATION

## REAR ELEVATION

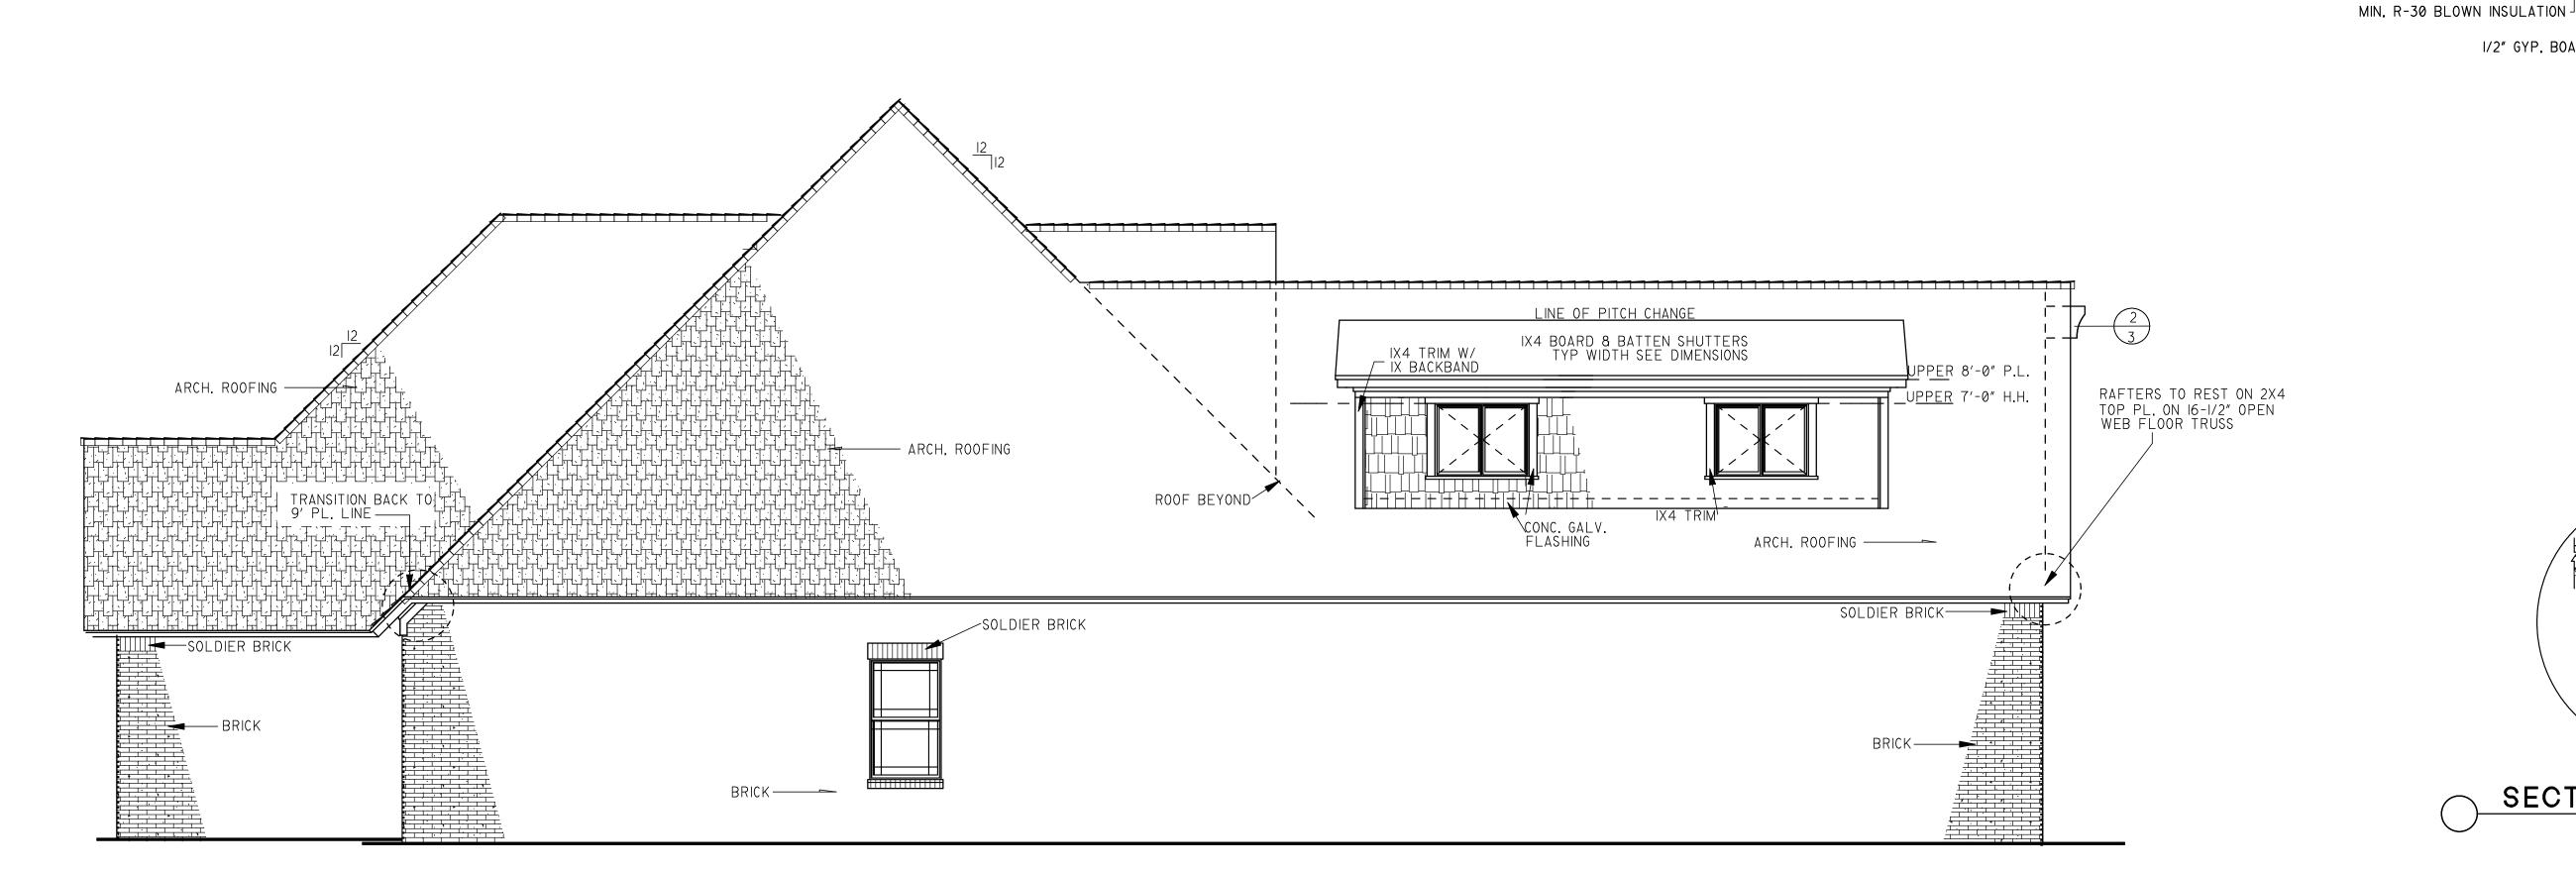

LEFT ELEVATION

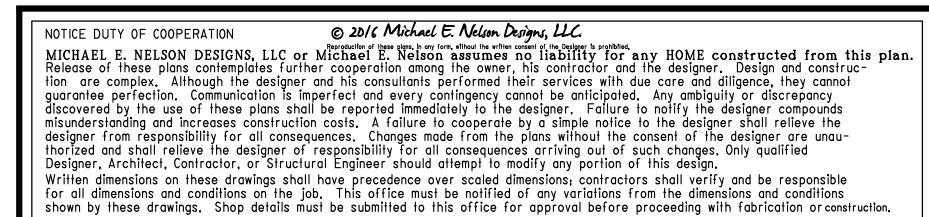

SECTIONAL DETAIL

