


Job	Truss	Truss Type	Qty	Ply	NEW HOME INC./WILSON	156330396
PERMITRF	A01	COMMON	4	1	Job Reference (optional)	

Builders FirstSource, Apex, NC 27523

8.530 s May 26 2022 MiTek Industries, Inc. Thu Jan 26 10:19:25 2023 Page 1
 ID:fBvoiMT4ig2f9oC0oYgUqSztrhi-Cx65k6ShJWBdUxOBTbuXLICLIXkqfPwF7hyzrWHm

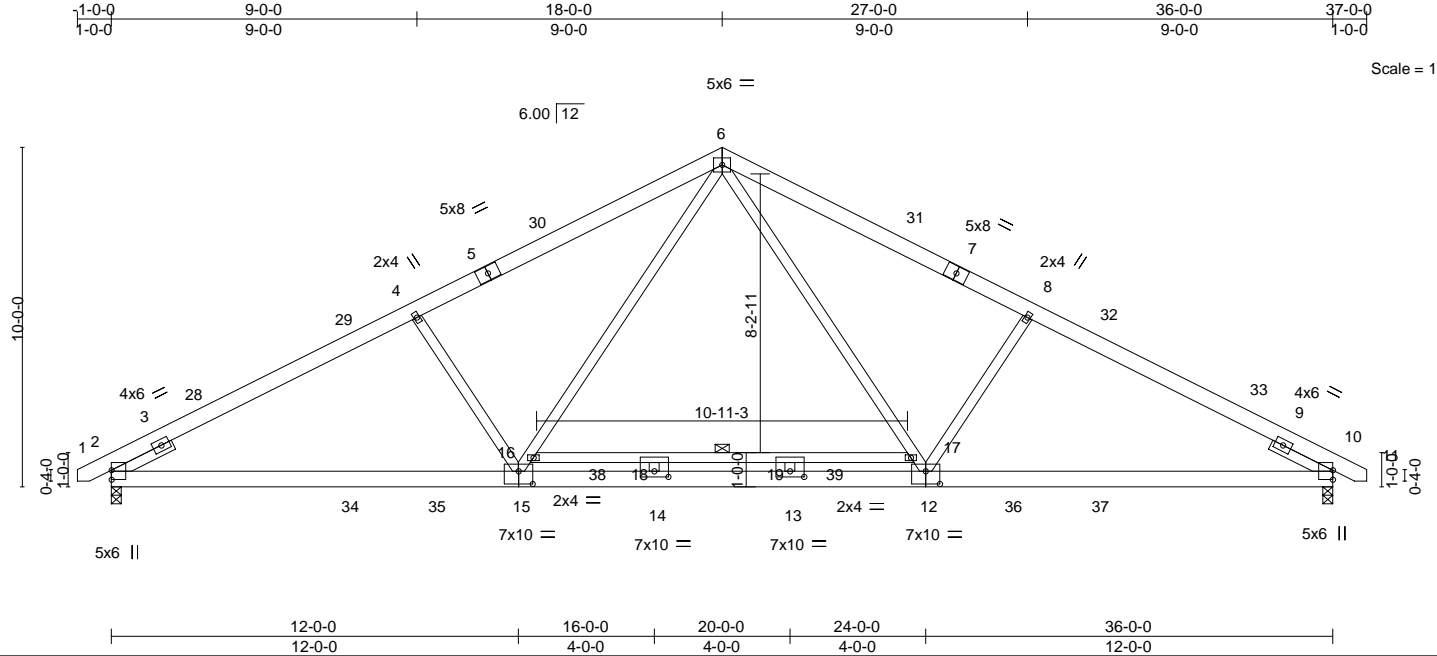

Scale = 1:67.9

Plate Offsets (X,Y)--	[12:0-5-0,0-4-8], [13:0-5-0,0-2-0], [14:0-5-0,0-2-0], [15:0-5-0,0-4-8]
-----------------------	--

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.53	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.82	Vert(LL) -0.38 13-14 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.68	Vert(CT) -0.54 13-14 >796 240		
BCDL 10.0	Rep Stress Incr YES	Matrix-MS	Horz(CT) 0.07 10 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.05 13 >999 240		
				Weight: 256 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.2	TOP CHORD Structural wood sheathing directly applied or 4-3-0 oc purlins.
BOT CHORD 2x6 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	WEBS 1 Row at midpt 16-17
SLIDER Left 2x4 SP No.3 1-11-12, Right 2x4 SP No.3 1-11-12	

REACTIONS. (size) 2=0-3-8, 10=0-3-8
 Max Horz 2=112(LC 12)
 Max Grav 2=1489(LC 1), 10=1489(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-970/0, 3-28=-2387/91, 28-29=-2357/114, 4-29=-2239/131, 4-5=-2184/121,
 5-30=-2094/138, 6-30=-2082/165, 6-31=-2075/165, 7-31=-2087/138, 7-8=-2178/121,
 8-32=-2232/131, 32-33=-2350/114, 9-33=-2380/91, 9-10=-969/0
 BOT CHORD 2-34=-24/2057, 34-35=-24/2057, 15-35=-24/2057, 14-15=0/1541, 13-14=0/1541,
 12-13=0/1541, 12-36=-27/2051, 36-37=-27/2051, 10-37=-27/2051
 WEBS 6-17=-5/863, 12-17=-12/785, 8-12=-487/169, 15-16=-12/792, 6-16=-5/878,
 4-15=-487/169

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) 0-9-14 to 2-9-6, Interior(1) 2-9-6 to 18-0-0, Exterior(2) 18-0-0 to 23-1-1, Interior(1) 23-1-1 to 36-9-14 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - N/A

- LOAD CASE(S)**
- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-6=-60, 6-11=-60, 20-24=-20
 - Dead + 0.75 Roof Live (balanced) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-6=-50, 6-11=-50, 20-34=-20, 34-35=-50, 35-36=-20, 36-37=-50, 24-37=-20, 38-39=-30



January 26, 2023

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



Job	Truss	Truss Type	Qty	Ply	NEW HOME INC./WILSON	156330396
PERMITRF	A01	COMMON	4	1	Job Reference (optional)	

Builders FirstSource, Apex, NC 27523

8.530 s May 26 2022 MiTek Industries, Inc. Thu Jan 26 10:19:25 2023 Page 2
ID:fBvoiMT4ig2f9oC0oYgUqSztrhi-Cx65k6ShJWBUDxoOBTbuXLICLIXkqfPwFw7hyzrWHm

LOAD CASE(S)

- 3) Dead + Uninhabitable Attic Without Storage: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-6=-20, 6-11=-20, 20-24=-40, 38-39=-40
- 4) Dead + 0.6 C-C Wind (Pos. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=42, 2-28=22, 6-28=12, 6-31=22, 10-31=12, 10-11=8, 20-24=-12
Horz: 1-2=-54, 2-28=-34, 6-28=-24, 6-31=34, 10-31=24, 10-11=20
- 5) Dead + 0.6 C-C Wind (Pos. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=8, 2-30=12, 6-30=22, 6-33=12, 10-33=22, 10-11=42, 20-24=-12
Horz: 1-2=-20, 2-30=-24, 6-30=-34, 6-33=24, 10-33=34, 10-11=54
- 6) Dead + 0.6 C-C Wind (Neg. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-13, 2-6=-32, 6-10=-32, 10-11=-27, 20-24=-20
Horz: 1-2=-7, 2-6=12, 6-10=-12, 10-11=-7
- 7) Dead + 0.6 C-C Wind (Neg. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-27, 2-6=-32, 6-10=-32, 10-11=-13, 20-24=-20
Horz: 1-2=7, 2-6=12, 6-10=-12, 10-11=7
- 8) Dead + 0.6 MWFRS Wind (Pos. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=7, 2-6=-3, 6-10=7, 10-11=2, 20-24=-12
Horz: 1-2=-19, 2-6=-9, 6-10=19, 10-11=14
- 9) Dead + 0.6 MWFRS Wind (Pos. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=2, 2-6=7, 6-10=-3, 10-11=7, 20-24=-12
Horz: 1-2=-14, 2-6=-19, 6-10=9, 10-11=19
- 10) Dead + 0.6 MWFRS Wind (Neg. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-15, 2-6=-20, 6-10=-10, 10-11=-6, 20-24=-20
Horz: 1-2=-5, 2-6=0, 6-10=10, 10-11=14
- 11) Dead + 0.6 MWFRS Wind (Neg. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-6, 2-6=-10, 6-10=-20, 10-11=-15, 20-24=-20
Horz: 1-2=-14, 2-6=10, 6-10=0, 10-11=5
- 12) Dead + 0.6 MWFRS Wind (Pos. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=14, 2-29=19, 6-29=9, 6-10=2, 10-11=-3, 20-24=-12
Horz: 1-2=-26, 2-29=-31, 6-29=-21, 6-10=14, 10-11=9
- 13) Dead + 0.6 MWFRS Wind (Pos. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-3, 2-6=2, 6-32=9, 10-32=19, 10-11=14, 20-24=-12
Horz: 1-2=-9, 2-6=-14, 6-32=21, 10-32=31, 10-11=26
- 14) Dead + 0.6 MWFRS Wind (Pos. Internal) 3rd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=5, 2-6=9, 6-10=2, 10-11=-3, 20-24=-12
Horz: 1-2=-17, 2-6=-21, 6-10=14, 10-11=9
- 15) Dead + 0.6 MWFRS Wind (Pos. Internal) 4th Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-3, 2-6=2, 6-10=9, 10-11=5, 20-24=-12
Horz: 1-2=-9, 2-6=-14, 6-10=21, 10-11=17
- 16) Dead + 0.6 MWFRS Wind (Neg. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=6, 2-29=2, 6-29=-7, 6-10=-15, 10-11=-11, 20-24=-20
Horz: 1-2=-26, 2-29=-22, 6-29=-13, 6-10=5, 10-11=9
- 17) Dead + 0.6 MWFRS Wind (Neg. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-11, 2-6=-15, 6-32=-7, 10-32=2, 10-11=6, 20-24=-20
Horz: 1-2=-9, 2-6=-5, 6-32=13, 10-32=22, 10-11=26
- 18) Dead + Uninhabitable Attic Storage: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-6=-20, 6-11=-20, 20-34=-20, 34-35=-60, 35-36=-20, 36-37=-60, 24-37=-20, 38-39=-40
- 19) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) Left): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-46, 2-6=-50, 6-10=-43, 10-11=-39, 20-34=-20, 34-35=-50, 35-36=-20, 36-37=-50, 24-37=-20, 38-39=-30
Horz: 1-2=-4, 2-6=0, 6-10=7, 10-11=11
- 20) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) Right): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-39, 2-6=-43, 6-10=-50, 10-11=-46, 20-34=-20, 34-35=-50, 35-36=-20, 36-37=-50, 24-37=-20, 38-39=-30
Horz: 1-2=-11, 2-6=-7, 6-10=0, 10-11=4
- 21) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60

Continued on page 3

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	NEW HOME INC./WILSON	156330396
PERMITRF	A01	COMMON	4	1	Job Reference (optional)	

Builders FirstSource, Apex, NC 27523

8.530 s May 26 2022 MiTek Industries, Inc. Thu Jan 26 10:19:25 2023 Page 3
 ID:fByoiMT4ig2f9oC0oYgUqSztrhi-Cx65k6ShJWBduDxoOBTbuXLICltXkqfPwfW7hyzrWHm

LOAD CASE(S)

Uniform Loads (plf)

Vert: 1-2=-30, 2-29=-34, 6-29=-41, 6-10=-46, 10-11=-43, 20-34=-20, 34-35=-50, 35-36=-20, 36-37=-50, 24-37=-20, 38-39=-30
 Horz: 1-2=-20, 2-29=-16, 6-29=-9, 6-10=4, 10-11=7

22) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 1-2=-43, 2-6=-46, 6-32=-41, 10-32=-34, 10-11=-30, 20-34=-20, 34-35=-50, 35-36=-20, 36-37=-50, 24-37=-20, 38-39=-30
 Horz: 1-2=-7, 2-6=-4, 6-32=9, 10-32=16, 10-11=20

23) 1st Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-6=-60, 6-11=-20, 20-24=-20

24) 2nd Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-6=-20, 6-11=-60, 20-24=-20

25) 3rd Dead + 0.75 Roof Live (unbalanced) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-6=-50, 6-11=-20, 20-34=-20, 34-35=-50, 35-36=-20, 36-37=-50, 24-37=-20, 38-39=-30

26) 4th Dead + 0.75 Roof Live (unbalanced) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-6=-20, 6-11=-50, 20-34=-20, 34-35=-50, 35-36=-20, 36-37=-50, 24-37=-20, 38-39=-30

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932


Job PERMITRF	Truss A01G	Truss Type GABLE	Qty 1	Ply 1	NEW HOME INC./WILSON	156330397
					Job Reference (optional)	

Builders FirstSource (Apex, NC),

Apex, NC - 27523,

8.530 s Aug 11 2022 MiTek Industries, Inc. Wed Jan 25 17:15:19 2023 Page 1

ID:fByoiMT4ig2f9oC0oYgUqSztrhi-1a1YmCUgweyqUsf06p_gxJRix5ccqsB5Rtyg2TzrllHs

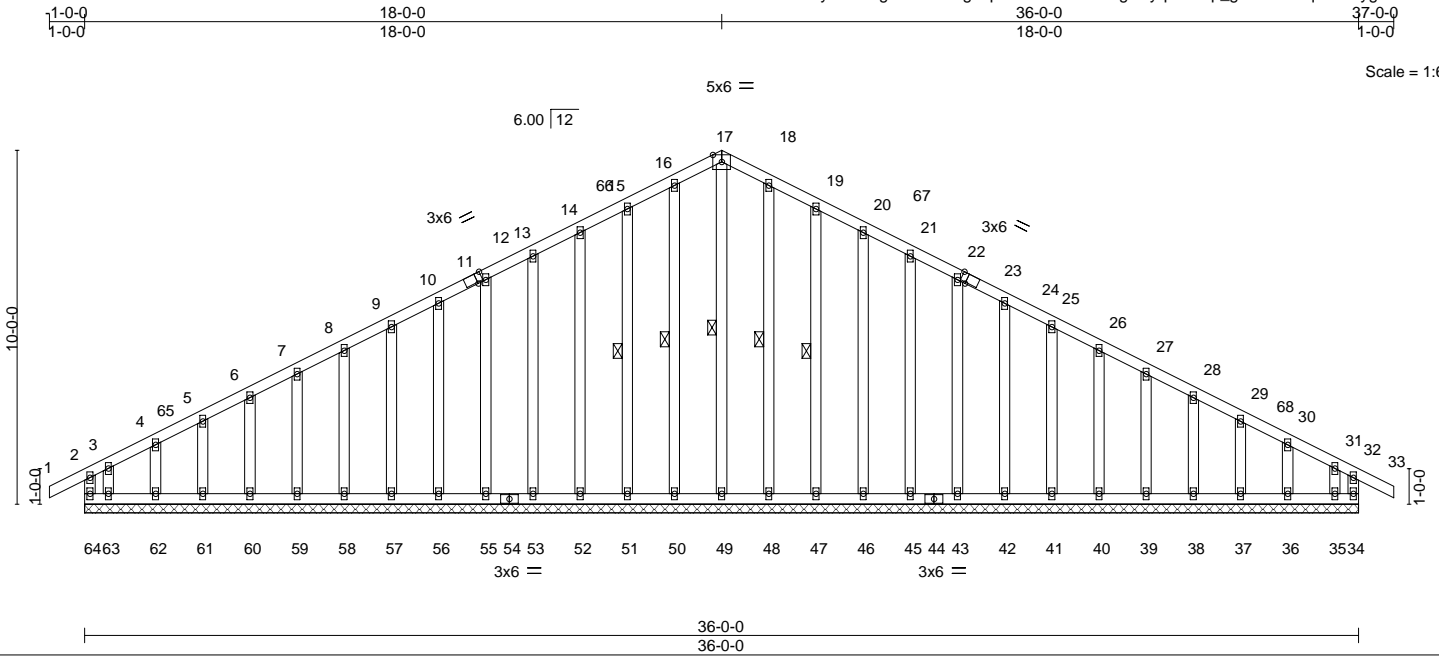

Scale = 1:65.1

Plate Offsets (X,Y)--	[11:0-1-15,Edge], [23:0-1-15,Edge]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.15	Vert(LL) -0.00 33 n/r 120	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.08	Vert(CT) -0.00 33 n/r 120		
BCLL 0.0 *	Rep Stress Incr NO	WB 0.09	Horz(CT) 0.01 34 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-R			
				Weight: 318 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3	WEBS 1 Row at midpt 17-49, 16-50, 15-51, 18-48, 19-47
OTHERS 2x4 SP No.3	

REACTIONS. All bearings 36-0-0.
 (lb) - Max Horz 64=114(LC 11)
 Max Uplift All uplift 100 lb or less at joint(s) 64, 34, 50, 51, 52, 53, 55, 56, 57, 58, 59, 60, 61, 62, 47, 46, 45, 43, 42, 41, 40, 39, 38, 37, 36 except 63=-195(LC 12), 35=-152(LC 13)
 Max Grav All reactions 250 lb or less at joint(s) 64, 34, 49, 50, 51, 52, 53, 55, 56, 57, 58, 59, 60, 61, 62, 63, 48, 47, 46, 45, 43, 42, 41, 40, 39, 38, 37, 36, 35

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 15-16=-92/277, 16-17=-97/289, 17-18=-97/283, 18-19=-92/271

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) -1-0-0 to 2-7-3, Exterior(2) 2-7-3 to 18-0-0, Corner(3) 18-0-0 to 21-7-3, Exterior(2) 21-7-3 to 37-0-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 4) All plates are 2x4 MT20 unless otherwise indicated.
 - 5) Gable requires continuous bottom chord bearing.
 - 6) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - 7) Gable studs spaced at 1-4-0 oc.
 - 8) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 9) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 10) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 64, 34, 50, 51, 52, 53, 55, 56, 57, 58, 59, 60, 61, 62, 47, 46, 45, 43, 42, 41, 40, 39, 38, 37, 36 except (jt=lb) 63=195, 35=152.




January 26, 2023

Job	Truss	Truss Type	Qty	Ply	NEW HOME INC./WILSON	156330398
PERMITRF	A02	COMMON	7	1	Job Reference (optional)	

Builders FirstSource, Apex, NC 27523

8.530 s May 26 2022 MiTek Industries, Inc. Thu Jan 26 10:19:37 2023 Page 1
 ID:FbyoiMT4ig2f9oC0oYgUqSzfthi-sErDFDbCUCiWK3s65ihPN3qK2BzFYFSAhXQm6GzrWHa

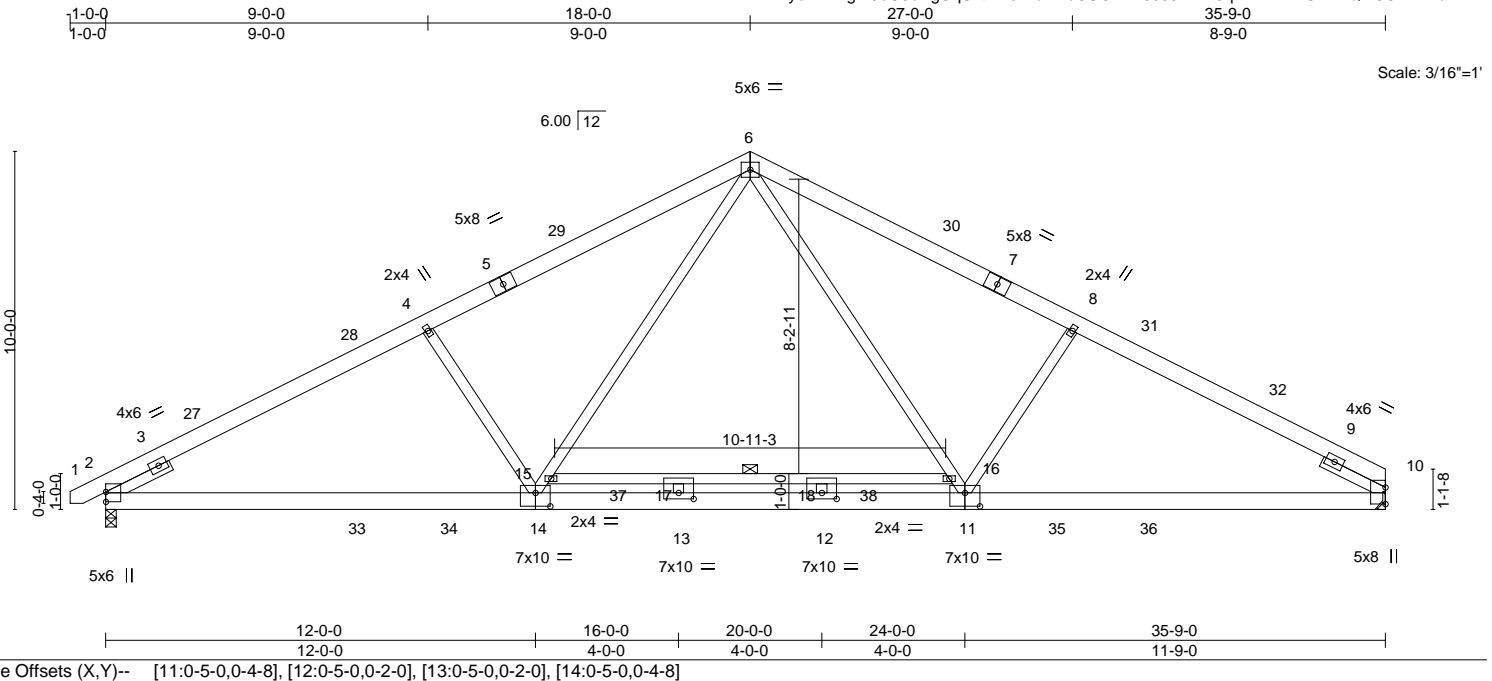

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.60	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.83	Vert(LL) -0.39 12-13 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.69	Vert(CT) -0.56 12-13 >767 240		
BCDL 10.0	Rep Stress Incr YES	Matrix-MS	Horz(CT) 0.08 10 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.05 12 >999 240		
				Weight: 252 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.2	TOP CHORD Structural wood sheathing directly applied or 3-8-0 oc purlins.
BOT CHORD 2x6 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	WEBS 1 Row at midpt 15-16
SLIDER Left 2x4 SP No.3 1-11-12, Right 2x4 SP No.3 1-11-12	

REACTIONS. (size) 2=0-3-8, 10=Mechanical
 Max Horz 2=117(LC 12)
 Max Grav 2=1480(LC 1), 10=1432(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-961/0, 3-27=-2368/91, 27-28=-2339/115, 4-28=-2221/130, 4-5=-2166/120,
 5-29=-2075/137, 6-29=-2064/165, 6-30=-2024/170, 7-30=-2033/143, 7-8=-2124/126,
 8-31=-2176/136, 31-32=-2270/113, 9-32=-2319/109, 9-10=-696/0
 BOT CHORD 2-33=-47/2040, 33-34=-47/2040, 14-34=-47/2040, 13-14=0/1518, 12-13=0/1518,
 11-12=0/1518, 11-35=-36/1989, 35-36=-36/1989, 10-36=-36/1989
 WEBS 4-14=-487/169, 14-15=-11/797, 6-15=-4/882, 6-16=-8/819, 11-16=-15/741,
 8-11=-461/168

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) 0-9-14 to 2-9-1, Interior(1) 2-9-1 to 18-0-0, Exterior(2) 18-0-0 to 23-0-11, Interior(1) 23-0-11 to 35-9-0 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Refer to girder(s) for truss to truss connections.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - N/A

LOAD CASE(S)

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-6=-60, 6-10=-60, 19-23=-20
- Dead + 0.75 Roof Live (balanced) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-6=-50, 6-10=-50, 19-33=-20, 33-34=-50, 34-35=-20, 35-36=-50, 23-36=-20, 37-38=-30



Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	NEW HOME INC./WILSON	156330398
PERMITRF	A02	COMMON	7	1	Job Reference (optional)	

Builders FirstSource, Apex, NC 27523

8.530 s May 26 2022 MiTek Industries, Inc. Thu Jan 26 10:19:38 2023 Page 2
ID:fByoiMT4ig2f9oC0oYgUqSztrhi-KRO?TZcFwVqYDRieQCewHNvobJUHiJwBAJfzrWHZ

LOAD CASE(S)

- 3) Dead + Uninhabitable Attic Without Storage: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-6=-20, 6-10=-20, 19-23=-40, 37-38=-40
- 4) Dead + 0.6 C-C Wind (Pos. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=42, 2-27=22, 6-27=12, 6-30=22, 10-30=12, 19-23=-12
Horz: 1-2=-54, 2-27=-34, 6-27=-24, 6-30=34, 10-30=24
- 5) Dead + 0.6 C-C Wind (Pos. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=8, 2-29=12, 6-29=22, 6-32=12, 10-32=22, 19-23=-12
Horz: 1-2=-20, 2-29=-24, 6-29=-34, 6-32=24, 10-32=34
- 6) Dead + 0.6 C-C Wind (Neg. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-13, 2-6=-32, 6-10=-32, 19-23=-20
Horz: 1-2=-7, 2-6=12, 6-10=-12
- 7) Dead + 0.6 C-C Wind (Neg. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-27, 2-6=-32, 6-10=-32, 19-23=-20
Horz: 1-2=7, 2-6=12, 6-10=-12
- 8) Dead + 0.6 MWFRS Wind (Pos. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=7, 2-6=-3, 6-10=7, 19-23=-12
Horz: 1-2=-19, 2-6=-9, 6-10=19
- 9) Dead + 0.6 MWFRS Wind (Pos. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=2, 2-6=7, 6-10=-3, 19-23=-12
Horz: 1-2=-14, 2-6=-19, 6-10=9
- 10) Dead + 0.6 MWFRS Wind (Neg. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-15, 2-6=-20, 6-10=-10, 19-23=-20
Horz: 1-2=-5, 2-6=0, 6-10=10
- 11) Dead + 0.6 MWFRS Wind (Neg. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-6, 2-6=-10, 6-10=-20, 19-23=-20
Horz: 1-2=-14, 2-6=10, 6-10=0
- 12) Dead + 0.6 MWFRS Wind (Pos. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=14, 2-28=19, 6-28=9, 6-10=2, 19-23=-12
Horz: 1-2=-26, 2-28=-31, 6-28=-21, 6-10=14
- 13) Dead + 0.6 MWFRS Wind (Pos. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-3, 2-6=2, 6-31=9, 10-31=19, 19-23=-12
Horz: 1-2=-9, 2-6=-14, 6-31=21, 10-31=31
- 14) Dead + 0.6 MWFRS Wind (Pos. Internal) 3rd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=5, 2-6=9, 6-10=2, 19-23=-12
Horz: 1-2=-17, 2-6=-21, 6-10=14
- 15) Dead + 0.6 MWFRS Wind (Pos. Internal) 4th Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-3, 2-6=2, 6-10=9, 19-23=-12
Horz: 1-2=-9, 2-6=-14, 6-10=21
- 16) Dead + 0.6 MWFRS Wind (Neg. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=6, 2-28=2, 6-28=-7, 6-10=-15, 19-23=-20
Horz: 1-2=-26, 2-28=-22, 6-28=-13, 6-10=5
- 17) Dead + 0.6 MWFRS Wind (Neg. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-11, 2-6=-15, 6-31=-7, 10-31=2, 19-23=-20
Horz: 1-2=-9, 2-6=-5, 6-31=13, 10-31=22
- 18) Dead + Uninhabitable Attic Storage: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-6=-20, 6-10=-20, 19-33=-20, 33-34=-60, 34-35=-20, 35-36=-60, 23-36=-20, 37-38=-40
- 19) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) Left): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-46, 2-6=-50, 6-10=-43, 19-33=-20, 33-34=-50, 34-35=-20, 35-36=-50, 23-36=-20, 37-38=-30
Horz: 1-2=-4, 2-6=0, 6-10=7
- 20) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) Right): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-39, 2-6=-43, 6-10=-50, 19-33=-20, 33-34=-50, 34-35=-20, 35-36=-50, 23-36=-20, 37-38=-30
Horz: 1-2=-11, 2-6=-7, 6-10=0
- 21) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60

Continued on page 3

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	NEW HOME INC./WILSON	156330398
PERMITRF	A02	COMMON	7	1	Job Reference (optional)	

Builders FirstSource, Apex, NC 27523

8.530 s May 26 2022 MiTek Industries, Inc. Thu Jan 26 10:19:38 2023 Page 3
 ID:fByoiMT4ig2f9oC0oYgUqSztrhi-KRO?TZcrFWqNyDRleQCewHNvobJUHiJwBAJfizrWHZ

LOAD CASE(S)

Uniform Loads (plf)

Vert: 1-2=-30, 2-28=-34, 6-28=-41, 6-10=-46, 19-33=-20, 33-34=-50, 34-35=-20, 35-36=-50, 23-36=-20, 37-38=-30

Horz: 1-2=-20, 2-28=-16, 6-28=-9, 6-10=4

22) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 1-2=-43, 2-6=-46, 6-31=-41, 10-31=-34, 19-33=-20, 33-34=-50, 34-35=-20, 35-36=-50, 23-36=-20, 37-38=-30

Horz: 1-2=-7, 2-6=-4, 6-31=9, 10-31=16

23) 1st Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-6=-60, 6-10=-20, 19-23=-20

24) 2nd Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-6=-20, 6-10=-60, 19-23=-20

25) 3rd Dead + 0.75 Roof Live (unbalanced) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-6=-50, 6-10=-20, 19-33=-20, 33-34=-50, 34-35=-20, 35-36=-50, 23-36=-20, 37-38=-30

26) 4th Dead + 0.75 Roof Live (unbalanced) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-6=-20, 6-10=-50, 19-33=-20, 33-34=-50, 34-35=-20, 35-36=-50, 23-36=-20, 37-38=-30

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	NEW HOME INC./WILSON	I56330399
PERMITRF	A02G	GABLE	1	1	Job Reference (optional)	

Builders FirstSource (Apex, NC), Apex, NC - 27523,

8.530 s Aug 11 2022 MiTek Industries, Inc. Wed Jan 25 17:15:25 2023 Page 1
ID:fByoimT4ig2f9oC0oYgUqSztzrhi-rkOp1FZRvUj_Cn6AT444AagkNwF_EagzqpP?F6zrlHm

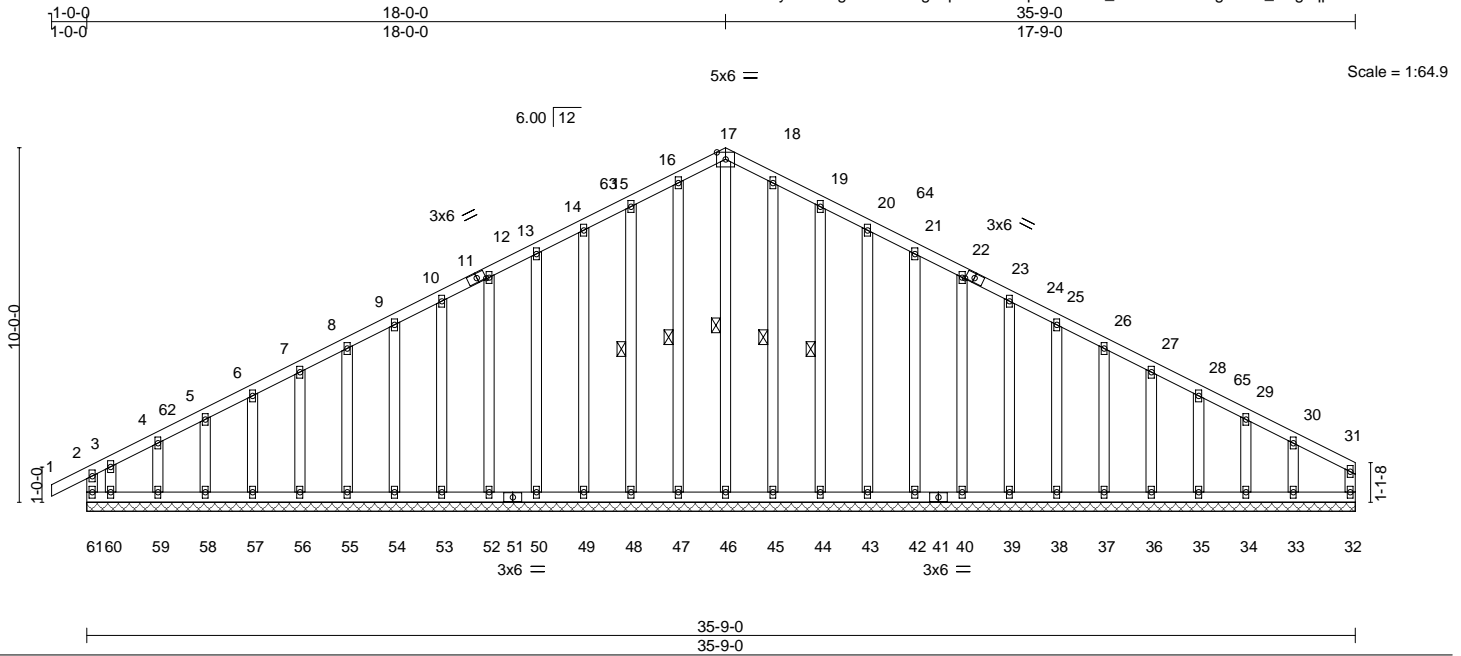



Plate Offsets (X,Y)--	[11:0-2-13,0-1-8], [23:0-2-13,0-1-8]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	BC 0.15	Vert(LL) 0.00 1 n/r 120	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	TC 0.08	Vert(CT) -0.00 1 n/r 120		
BCLL 0.0 *	Rep Stress Incr NO	WB 0.09	Horz(CT) 0.00 32 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-R		Weight: 314 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	WEBS 1 Row at midpt 17-46, 16-47, 15-48, 18-45, 19-44
OTHERS 2x4 SP No.3	

REACTIONS. All bearings 35-9-0.
 (lb) - Max Horz 61=120(LC 9)
 Max Uplift All uplift 100 lb or less at joint(s) 47, 48, 49, 50, 52, 53, 54, 55, 56, 57, 58, 59, 44, 43, 42, 40, 39, 38, 37, 36, 35, 33 except 61=108(LC 8), 60=199(LC 12)
 Max Grav All reactions 250 lb or less at joint(s) 32, 46, 47, 48, 49, 50, 52, 53, 54, 55, 56, 57, 58, 59, 60, 45, 44, 43, 42, 40, 39, 38, 37, 36, 35, 34, 33 except 61=253(LC 21)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 14-15=-92/263, 15-16=-102/292, 16-17=-105/303, 17-18=-105/297, 18-19=-102/283, 19-20=-92/254

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) -1-0-0 to 2-6-14, Exterior(2) 2-6-14 to 18-0-0, Corner(3) 18-0-0 to 21-6-14, Exterior(2) 21-6-14 to 35-7-4 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 1-4-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 47, 48, 49, 50, 52, 53, 54, 55, 56, 57, 58, 59, 44, 43, 42, 40, 39, 38, 37, 36, 35, 33 except (jt=lb) 61=108, 60=199.

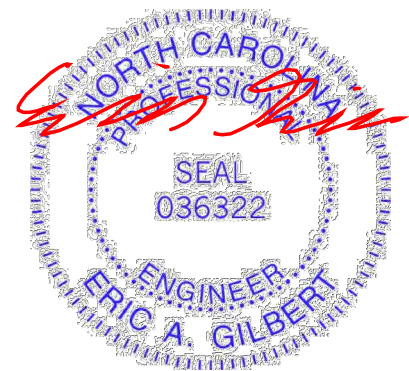


January 26, 2023

Job PERMITRF	Truss B01G	Truss Type GABLE	Qty 1	Ply 1	NEW HOME INC./WILSON 156330400
-----------------	---------------	---------------------	----------	----------	-----------------------------------


Builders FirstSource (Apex, NC), Apex, NC - 27523,

8.530 s Aug 11 2022 MiTek Industries, Inc. Wed Jan 25 17:15:27 2023 Page 1
ID:fByoiMT4ig2f9oC0oYgUqSztrhi-o6VZSxah15yiS5GYaV7YF?m5HJLfUjGH7u5K?zrlHk



4x6 =

Scale = 1:36.2

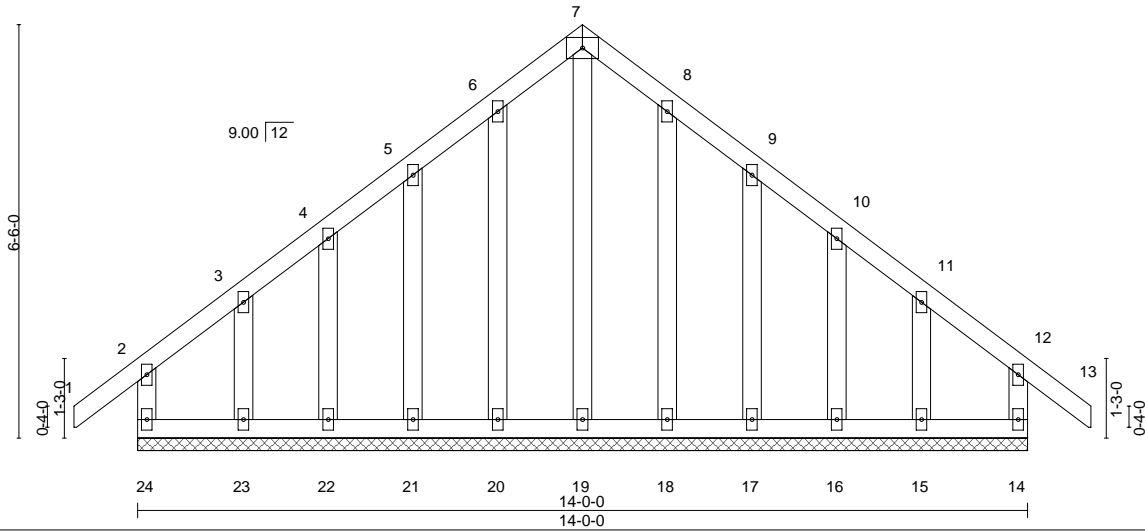

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.12	Vert(LL)	-0.00	13	n/r	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.07	Vert(CT)	-0.01	13	n/r		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.12	Horz(CT)	-0.00	14	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-R						
								Weight: 103 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3
OTHERS 2x4 SP No.3

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS. All bearings 14-0-0.
(lb) - Max Horz 24=148(LC 10)
Max Uplift All uplift 100 lb or less at joint(s) 24, 14, 20, 21, 22, 23, 18, 17, 16, 15
Max Grav All reactions 250 lb or less at joint(s) 24, 14, 19, 20, 21, 22, 23, 18, 17, 16, 15

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) -0-11-12 to 2-0-4, Exterior(2) 2-0-4 to 7-0-0, Corner(3) 7-0-0 to 10-0-0, Exterior(2) 10-0-0 to 14-11-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- Gable studs spaced at 1-4-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 24, 14, 20, 21, 22, 23, 18, 17, 16, 15.



January 26, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932


Job PERMITRF	Truss B02-2PL	Truss Type COMMON	Qty 1	Ply 2	NEW HOME INC./WILSON	156330401
-----------------	------------------	----------------------	----------	----------	----------------------	-----------

Builders FirstSource (Apex, NC),

Apex, NC - 27523,

8.530 s Aug 11 2022 MiTek Industries, Inc. Wed Jan 25 17:15:29 2023 Page 1

ID:fByoiMT4ig2f9oC0oYgUqSztrhi-kVdKsdcxZjDPhPQxiw90LQrOQ7ubAH2ZIRNCotzrHi



4x6 ||

Scale = 1:40.8


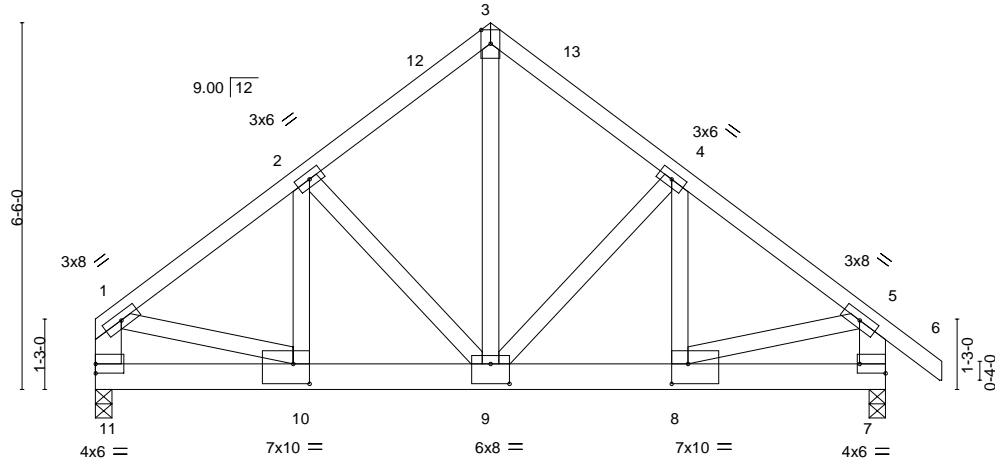


Plate Offsets (X, Y)-- [7:Edge,0-2-0], [8:0-3-8,0-4-4], [9:0-4-0,0-4-4], [10:0-3-8,0-4-4]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.27	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.68	Vert(LL) -0.04 9-10 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.51	Vert(CT) -0.08 9-10 >999 240		
BCDL 10.0	Rep Stress Incr NO	Matrix-MS	Horz(CT) 0.02 7 n/a n/a		
	Code IRC2015/TP12014		Wind(LL) 0.03 9-10 >999 240	Weight: 211 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 5-7-4 oc purlins, except end verticals.
BOT CHORD 2x6 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.2 *Except* 1-11,5-7: 2x6 SP No.2	

REACTIONS. (size) 11=0-3-8, 7=0-3-8
 Max Horz 11=-141(LC 6)
 Max Uplift 11=-383(LC 8), 7=-399(LC 9)
 Max Grav 11=5407(LC 15), 7=5452(LC 15)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-11=-4139/304, 1-2=-5075/371, 2-3=-3928/335, 3-4=-3944/335, 4-5=-5078/373, 5-7=-4183/321
 BOT CHORD 10-11=-105/669, 9-10=-310/4086, 8-9=-250/4021, 7-8=-51/595
 WEBS 3-9=-356/4470, 4-9=-1246/177, 4-8=-95/1477, 5-8=-222/3572, 2-9=-1327/178, 2-10=-89/1479, 1-10=-231/3564

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
 Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc, 2x4 - 1 row at 0-9-0 oc.
 Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-8-0 oc.
 Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 11=383, 7=399.

LOAD CASE(S) Standard
 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-3=-60, 3-5=-60, 5-6=-60, 7-11=-696(B=-676)



January 26, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

818 Soundside Road
 Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	NEW HOME INC./WILSON	I56330402
PERMITRF	P01	MONO TRUSS	6	1	Job Reference (optional)	

Builders FirstSource (Apex, NC),


Apex, NC - 27523,

8.530 s Aug 11 2022 MiTek Industries, Inc. Wed Jan 25 17:15:31 2023 Page 1

ID:fByoiMT4ig2f9oC0oYgUqSzrhi-gtL4HJdC5KT7wiZKpLBUQrwl2wixelasCIsJtmzrlHg



Scale = 1:13.3

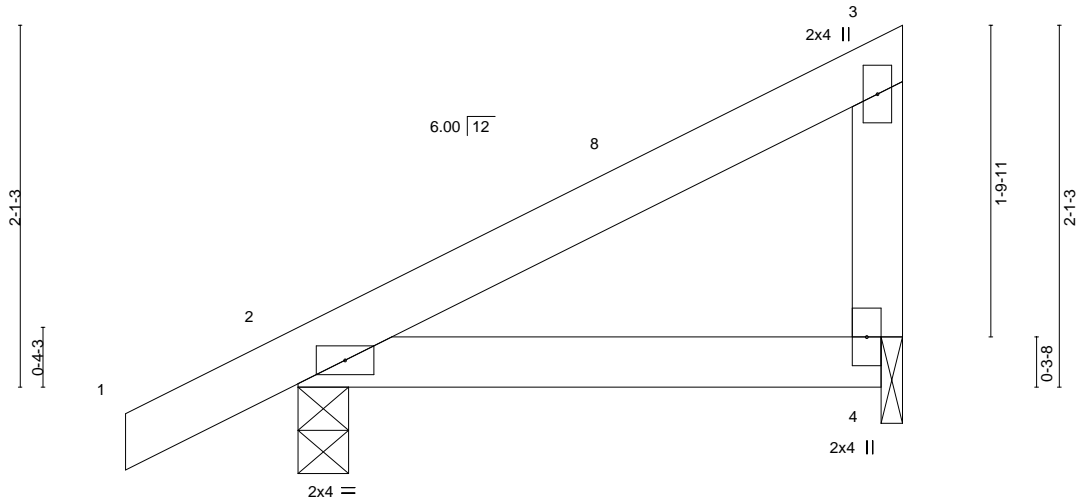

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.14	Vert(LL)	-0.01 4-7	>999	360	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.11	Vert(CT)	-0.01 4-7	>999	240		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.00	Horz(CT)	0.00 2	n/a	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-MP	Wind(LL)	0.01 4-7	>999	240		
	Code IRC2015/TPI2014						Weight: 15 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 WEBS 2x4 SP No.3

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 3-6-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 2=0-3-8, 4=0-1-8
 Max Horz 2=61(LC 11)
 Max Uplift 2=22(LC 12), 4=15(LC 12)
 Max Grav 2=203(LC 1), 4=125(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) - 1-0-0 to 2-0-0, Interior(1) 2-0-0 to 3-4-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Bearing at joint(s) 4 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 5) Provide mechanical connection (by others) of truss to bearing plate at joint(s) 4.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 4.



January 26, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932


Job PERMITRF	Truss P01SG	Truss Type GABLE	Qty 2	Ply 1	NEW HOME INC./WILSON Job Reference (optional)	156330403
-----------------	----------------	---------------------	----------	----------	--	-----------

Builders FirstSource (Apex, NC),

Apex, NC - 27523,

8.530 s Aug 11 2022 MiTek Industries, Inc. Wed Jan 25 17:15:32 2023 Page 1

ID:fByoiMT4ig2f9oC0oYgUqSztrhi-84JSVfeqseb_Ys8WN2ijy3TwoK2ANlq?RPcs?CzrlHf

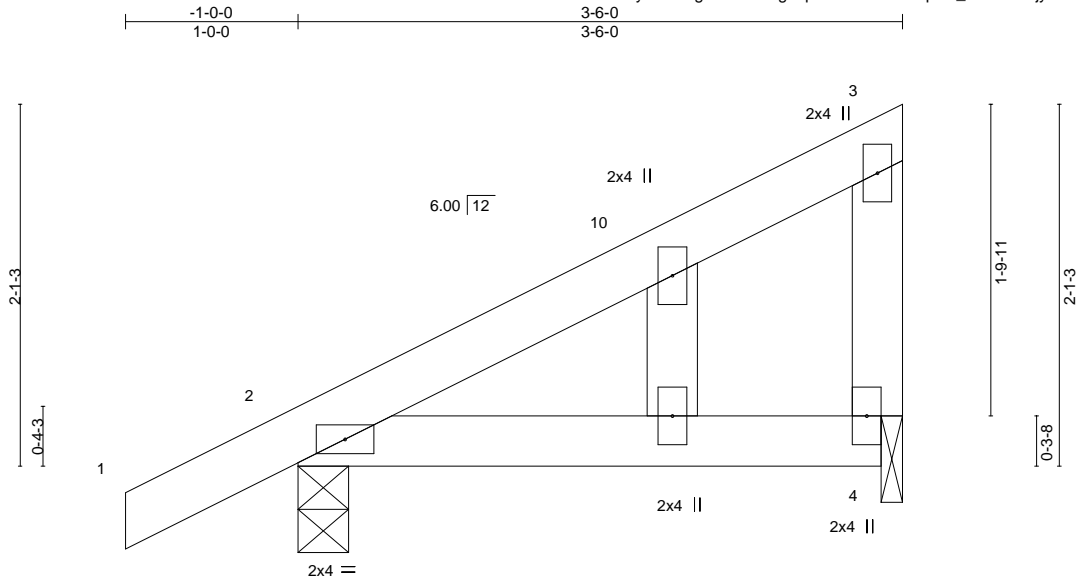

Scale = 1:13.3

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.14	Vert(LL)	-0.00 4-9	>999	360	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.11	Vert(CT)	-0.01 4-9	>999	240		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.00	Horz(CT)	0.00 2	n/a	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-MP	Wind(LL)	0.01 4-9	>999	240		
	Code IRC2015/TPI2014						Weight: 16 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 WEBS 2x4 SP No.3
 OTHERS 2x4 SP No.3

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 3-6-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 2=0-3-8, 4=0-1-8
 Max Horz 2=61(LC 11)
 Max Uplift 2=-22(LC 12), 4=-15(LC 12)
 Max Grav 2=203(LC 1), 4=125(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -1-0-0 to 2-0-0, Interior(1) 2-0-0 to 3-4-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) Gable studs spaced at 1-4-0 oc.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Bearing at joint(s) 4 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 7) Provide mechanical connection (by others) of truss to bearing plate at joint(s) 4.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 4.



January 26, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

Job PERMITRF	Truss V01G	Truss Type GABLE	Qty 1	Ply 1	NEW HOME INC./WILSON Job Reference (optional)	I56330404
-----------------	---------------	---------------------	----------	----------	--	-----------

Builders FirstSource (Apex, NC),

Apex, NC - 27523,

8.530 s Aug 11 2022 MiTek Industries, Inc. Wed Jan 25 17:15:34 2023 Page 1
ID:fByoiMT4ig2f9oC0oYgUqSztrhi-4SRDwKf4OFrinAluVTIB2UYIZ8lsreHluj5z45zrlHd

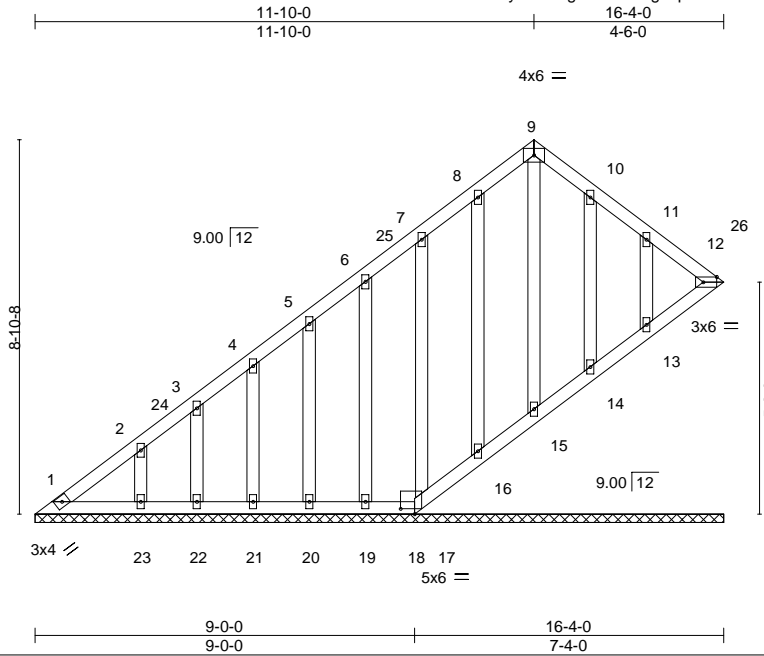

Scale = 1:54.7

Plate Offsets (X,Y)--	[12:0-3-13,Edge], [18:0-4-0,0-1-8]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.06	Vert(LL) n/a - n/a 999	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.03	Vert(CT) n/a - n/a 999		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.07	Horz(CT) 0.00 12 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S		Weight: 119 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
OTHERS 2x4 SP No.3	

REACTIONS. All bearings 16-4-0.
 (lb) - Max Horz 1=207(LC 12)
 Max Uplift All uplift 100 lb or less at joint(s) 1, 12, 18, 16, 17, 19, 20, 21, 22, 23, 14, 13
 Max Grav All reactions 250 lb or less at joint(s) 1, 12, 18, 15, 16, 17, 19, 20, 21, 22, 23, 14, 13

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) 0-5-4 to 3-5-4, Interior(1) 3-5-4 to 11-10-0, Exterior(2) 11-10-0 to 14-10-0, Interior(1) 14-10-0 to 16-1-1 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 12, 18, 16, 17, 19, 20, 21, 22, 23, 14, 13.
 - Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 12, 15, 16, 17, 14, 13.




January 26, 2023

Job PERMITRF	Truss V02	Truss Type VALLEY	Qty 1	Ply 1	NEW HOME INC./WILSON Job Reference (optional)	I56330405
-----------------	--------------	----------------------	----------	----------	--	-----------

Builders FirstSource (Apex, NC),

Apex, NC - 27523,

8.530 s Aug 11 2022 MiTek Industries, Inc. Wed Jan 25 17:15:36 2023 Page 1
ID:fBoiMT4ig2f9oC0oYgUqSztrhi-1rYzL0hKvs5Q1USHcunf7veZixNbJXhbM1a48zrIHb

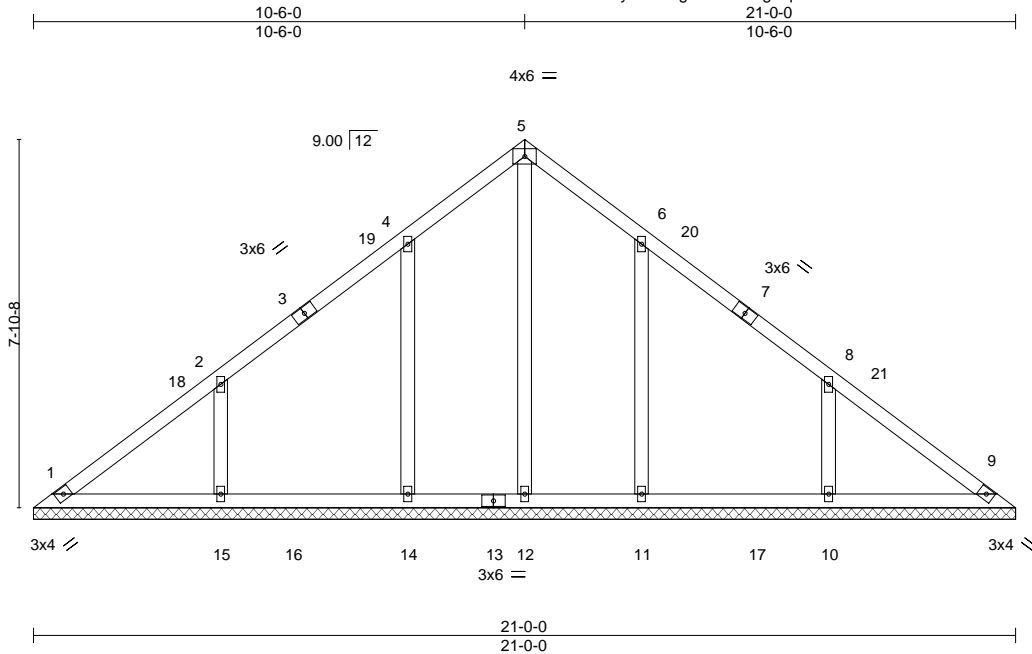

Scale = 1:49.3

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.33	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.21	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.14	Horz(CT)	0.00	9	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S					Weight: 103 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 SP No.3
BOT CHORD 2x4 SP No.3
OTHERS 2x4 SP No.3

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 21-0-0.
(lb) - Max Horz 1=-149(LC 10)
Max Uplift All uplift 100 lb or less at joint(s) 1, 11, 14 except 10=-105(LC 13), 15=-105(LC 12)
Max Grav All reactions 250 lb or less at joint(s) 1, 12, 9 except 10=382(LC 20), 11=389(LC 20), 15=381(LC 19), 14=389(LC 19)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 8-10=-267/152, 2-15=-267/152

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) 0-5-4 to 3-5-4, Interior(1) 3-5-4 to 10-6-0, Exterior(2) 10-6-0 to 13-6-0, Interior(1) 13-6-0 to 20-6-12 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) All plates are 2x4 MT20 unless otherwise indicated.
- 4) Gable requires continuous bottom chord bearing.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 11, 14 except (jt=lb) 10=105, 15=105.



January 26, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932

Job PERMITRF	Truss V03	Truss Type VALLEY	Qty 1	Ply 1	NEW HOME INC./WILSON	156330406
-----------------	--------------	----------------------	----------	----------	----------------------	-----------

Builders FirstSource (Apex, NC),

Apex, NC - 27523,

8.530 s Aug 11 2022 MiTek Industries, Inc. Wed Jan 25 17:15:37 2023 Page 1
ID:fBoiMT4ig2f9oC0oYgUqSztrhi-V16LYMizgADHed1TAbluf6Ak9Ljm2?6kagKdgQzrlHa

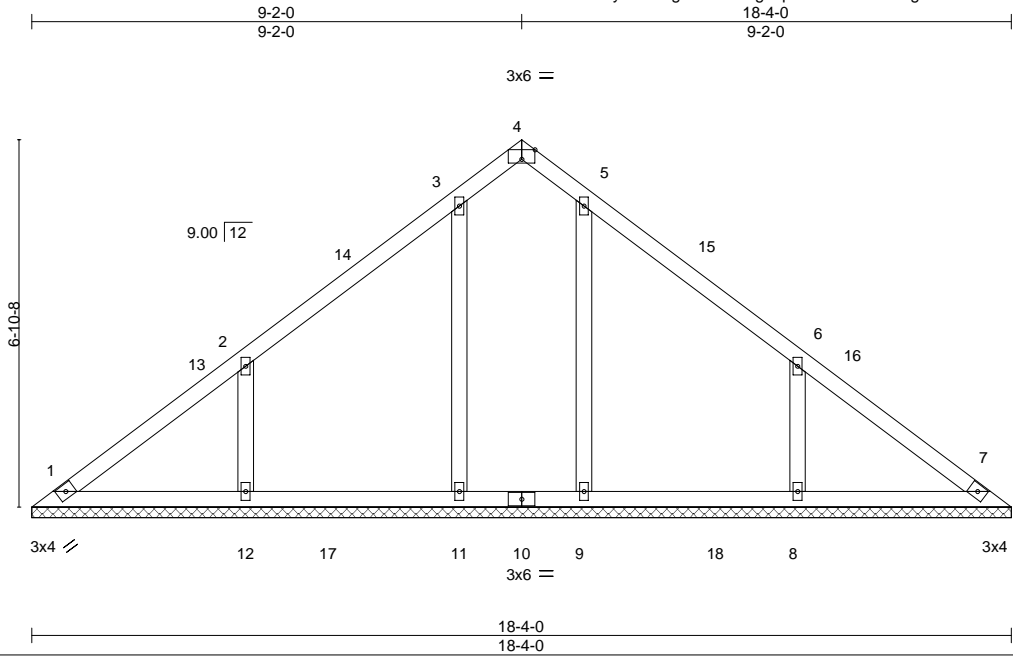

Scale = 1:43.1

Plate Offsets (X,Y)--	[3:0-0-0,0-0-0], [4:0-3-0,Edge]
-----------------------	---------------------------------

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.35	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.21	Vert(LL) n/a - n/a 999		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.13	Vert(CT) n/a - n/a 999		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.01 7 n/a n/a		
	Code IRC2015/TPI2014			Weight: 83 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.3	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x4 SP No.3	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
OTHERS 2x4 SP No.3	

REACTIONS. All bearings 18-4-0.
 (lb) - Max Horz 1=-129(LC 10)
 Max Uplift All uplift 100 lb or less at joint(s) 9, 11 except 8=-110(LC 13), 12=-109(LC 12)
 Max Grav All reactions 250 lb or less at joint(s) 1, 7 except 8=388(LC 20), 9=345(LC 20), 12=386(LC 19), 11=354(LC 19)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 WEBS 6-8=-270/157, 2-12=-269/156

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) 0-5-4 to 3-5-4, Interior(1) 3-5-4 to 9-2-0, Exterior(2) 9-2-0 to 12-2-0, Interior(1) 12-2-0 to 17-10-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 9, 11 except (jt=lb) 8=110, 12=109.




January 26, 2023

Job PERMITRF	Truss V05	Truss Type VALLEY	Qty 1	Ply 1	NEW HOME INC./WILSON	156330408
-----------------	--------------	----------------------	----------	----------	----------------------	-----------

Builders FirstSource (Apex, NC),

Apex, NC - 27523,

8.530 s Aug 11 2022 MiTek Industries, Inc. Wed Jan 25 17:15:40 2023 Page 1
ID:fByoiMT4ig2f9oC0oYgUqSztrhi-vcoUAOKrz5brV5l2rksbHloGiZmDFN0BGeYHHlzlRHx

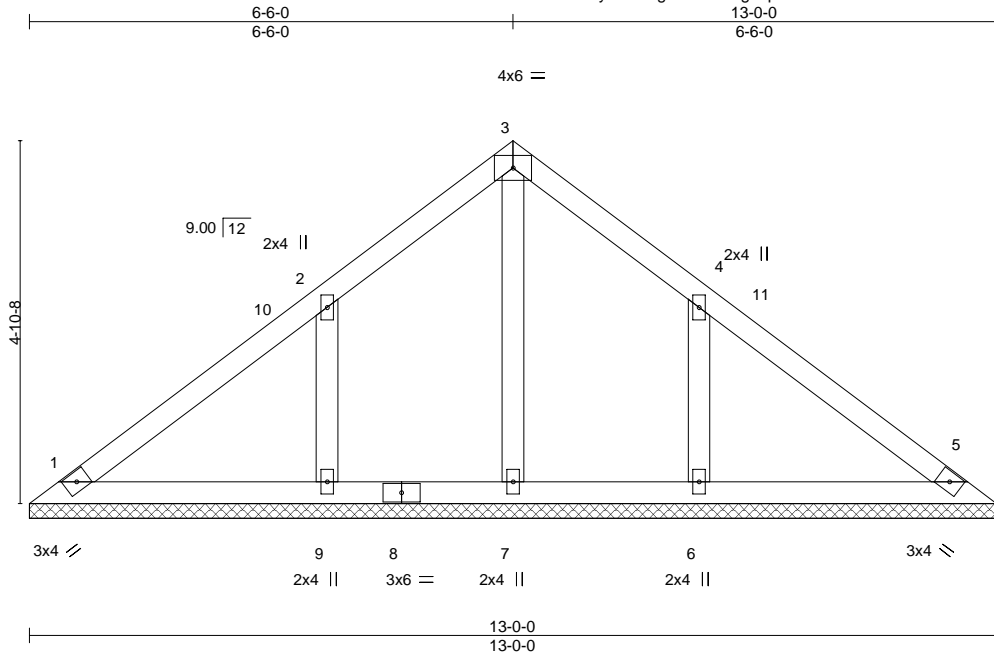

Scale = 1:31.0

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.27	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.16	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.05	Horz(CT)	0.00	5	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-S					Weight: 56 lb	FT = 20%
	Code IRC2015/TPI2014							

LUMBER-

TOP CHORD 2x4 SP No.3
BOT CHORD 2x4 SP No.3
OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

All bearings 13-0-0.
(lb) - Max Horz 1=90(LC 8)
Max Uplift All uplift 100 lb or less at joint(s) 6, 9
Max Grav All reactions 250 lb or less at joint(s) 1, 5, 7 except 6=317(LC 20), 9=318(LC 19)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) 0-5-4 to 3-5-4, Interior(1) 3-5-4 to 6-6-0, Exterior(2) 6-6-0 to 9-6-0, Interior(1) 9-6-0 to 12-6-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 6, 9.



January 26, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932


Job PERMITRF	Truss V06	Truss Type VALLEY	Qty 1	Ply 1	NEW HOME INC./WILSON	156330409
-----------------	--------------	----------------------	----------	----------	----------------------	-----------

Builders FirstSource (Apex, NC),

Apex, NC - 27523,

8.530 s Aug 11 2022 MiTek Industries, Inc. Wed Jan 25 17:15:42 2023 Page 1

ID:fByoiMT4ig2f9oC0oYgUqSztrhi-r?vEb3m5VirZIPvRz8u3MAucwMSbjHXtky1OMdzrlHV

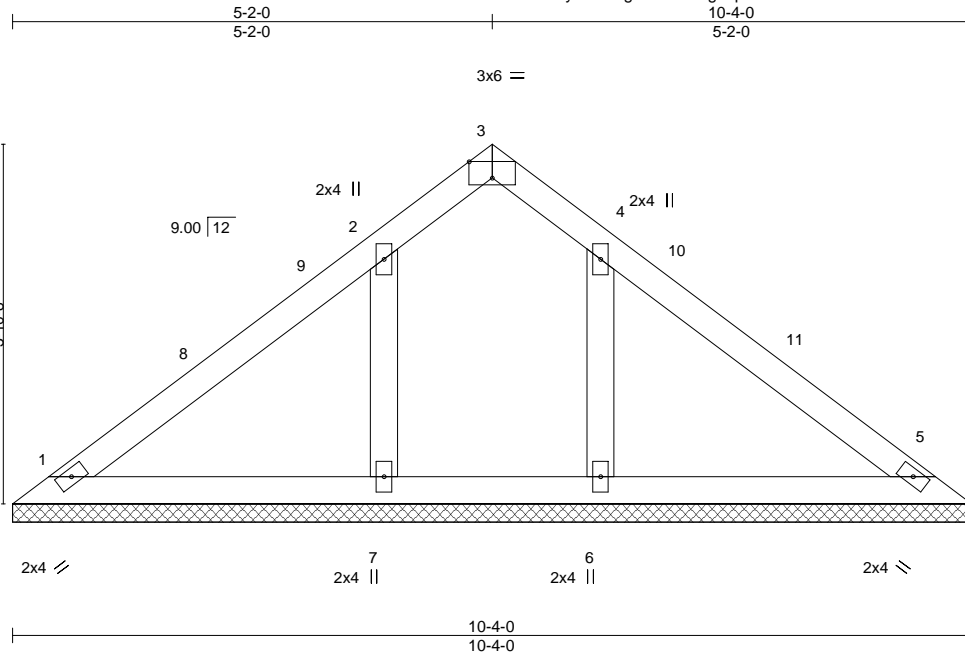

Scale = 1:24.8

Plate Offsets (X,Y)--	[3:0-3-0,Edge]									
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 20.0	Plate Grip DOL	1.15	TC 0.29	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.17	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.05	Horz(CT)	0.00	5	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S						Weight: 40 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SP No.3
 BOT CHORD 2x4 SP No.3
 OTHERS 2x4 SP No.3

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS. All bearings 10-4-0.
 (lb) - Max Horz 1=70(LC 8)
 Max Uplift All uplift 100 lb or less at joint(s) 6, 7
 Max Grav All reactions 250 lb or less at joint(s) 1, 5 except 6=295(LC 20), 7=298(LC 19)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) 0-5-4 to 3-5-4, Interior(1) 3-5-4 to 5-2-0, Exterior(2) 5-2-0 to 8-2-0, Interior(1) 8-2-0 to 9-10-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 6, 7.



January 26, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932


Job PERMITRF	Truss V07	Truss Type VALLEY	Qty 1	Ply 1	NEW HOME INC./WILSON Job Reference (optional)	156330410
-----------------	--------------	----------------------	----------	----------	--	-----------

Builders FirstSource (Apex, NC),

Apex, NC - 27523,


8.530 s Aug 11 2022 MiTek Industries, Inc. Wed Jan 25 17:15:43 2023 Page 1

ID:fByoiMT4ig2f9oC0oYgUqSzfthi-KBTdpPmjG0_QMYUdWsPlvNqn2mmNSkzdczcnxu4zrIHU



4x6 =

Scale = 1:19.6

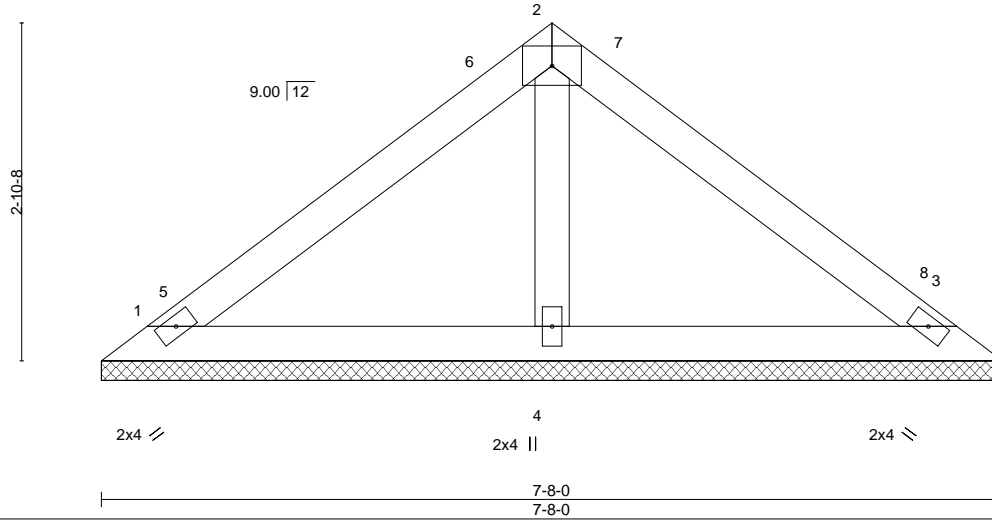

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 20.0	Plate Grip DOL	1.15	TC 0.26	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.20	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.04	Horz(CT)	0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S						Weight: 28 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SP No.3
 BOT CHORD 2x4 SP No.3
 OTHERS 2x4 SP No.3

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 1=7-8-0, 3=7-8-0, 4=7-8-0
 Max Horz 1=-50(LC 10)
 Max Uplift 1=-11(LC 12), 3=-18(LC 13)
 Max Grav 1=137(LC 1), 3=137(LC 1), 4=268(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) 0-5-4 to 3-5-4, Interior(1) 3-5-4 to 3-10-0, Exterior(2) 3-10-0 to 6-10-0, Interior(1) 6-10-0 to 7-2-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.



January 26, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	NEW HOME INC./WILSON	156330411
PERMITRF	V08	VALLEY	1	1	Job Reference (optional)	

Builders FirstSource (Apex, NC),


Apex, NC - 27523,

8.530 s Aug 11 2022 MiTek Industries, Inc. Wed Jan 25 17:15:44 2023 Page 1

ID:fByoiMT4ig2f9oC0oYgUqSztrhi-oN1?0InM1J6H_i3p4ZwXSbz?yA8YBBVmBGWVQWzrlHT



Scale: 1"=1'

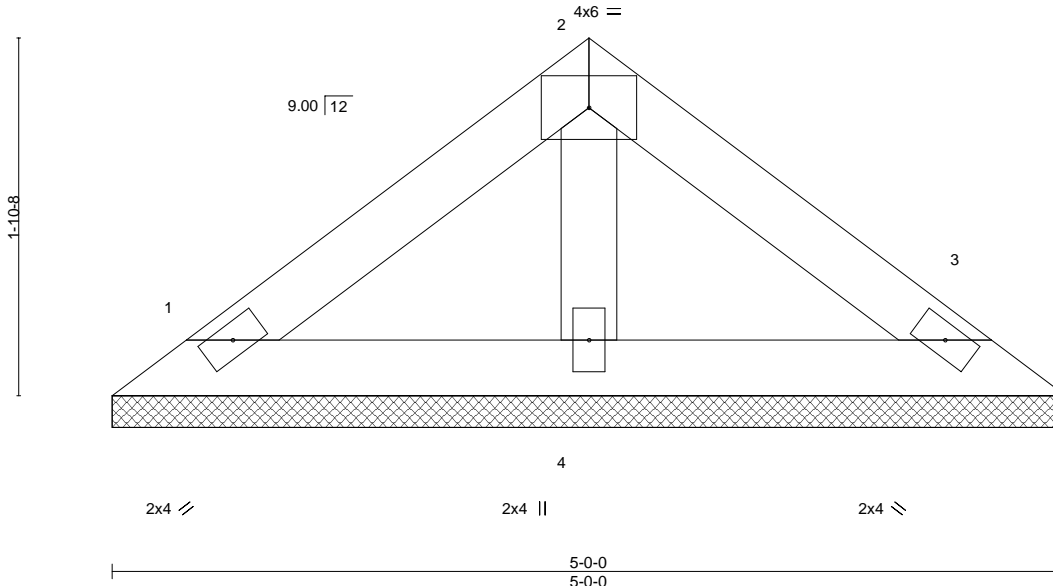

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.13	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.07	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.02	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-P					Weight: 17 lb	FT = 20%
	Code IRC2015/TPI2014							


LUMBER-
 TOP CHORD 2x4 SP No.3
 BOT CHORD 2x4 SP No.3
 OTHERS 2x4 SP No.3

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 5-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 1=5-0-0, 3=5-0-0, 4=5-0-0
 Max Horz 1=30(LC 11)
 Max Uplift 1=11(LC 12), 3=15(LC 13)
 Max Grav 1=91(LC 1), 3=91(LC 1), 4=148(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Gable requires continuous bottom chord bearing.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.

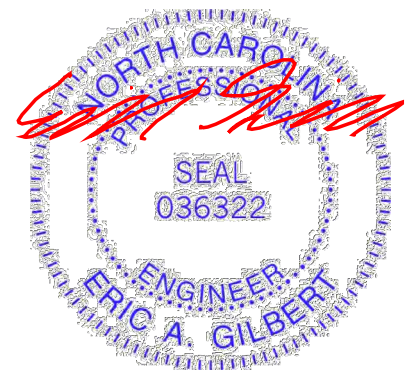

January 26, 2023


Job PERMITRF	Truss V09	Truss Type VALLEY	Qty 1	Ply 1	NEW HOME INC./WILSON	156330412
-----------------	--------------	----------------------	----------	----------	----------------------	-----------

Builders FirstSource (Apex, NC),

Apex, NC - 27523,

8.530 s Aug 11 2022 MiTek Industries, Inc. Wed Jan 25 17:15:45 2023 Page 1

ID:fByoiMT4ig2f9oC0oYgUqSztrhi-GabND5o_odE8cse0eHRm_oVBRaVJwe2wQwG2zyrIHS

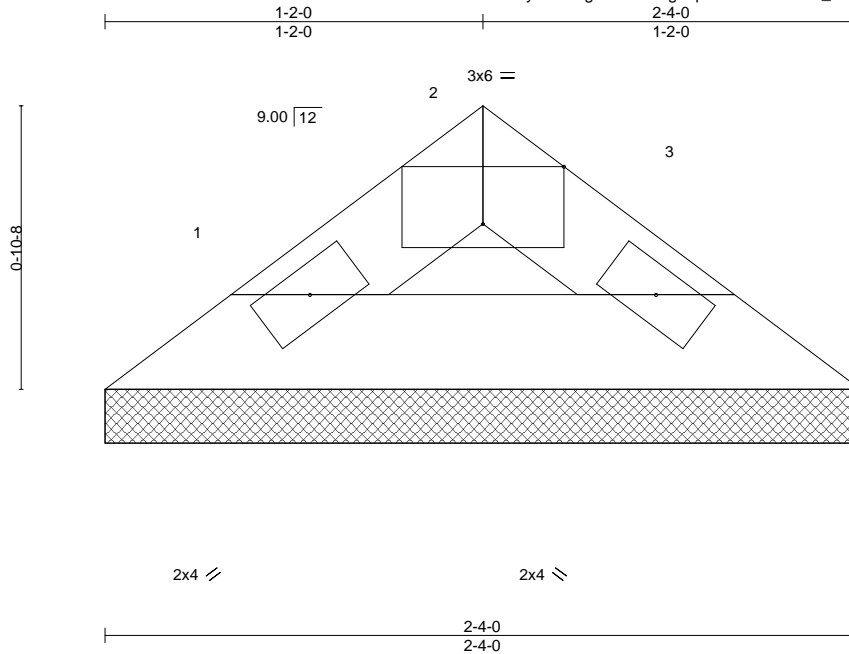

Scale = 1:7.1

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.01	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.04	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-P					Weight: 6 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 SP No.3
BOT CHORD 2x4 SP No.3

BRACING-
TOP CHORD Structural wood sheathing directly applied or 2-4-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 1=2-4-0, 3=2-4-0
Max Horz 1=11(LC 11)
Max Uplift 1=-1(LC 12), 3=-1(LC 13)
Max Grav 1=58(LC 1), 3=58(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Gable requires continuous bottom chord bearing.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.



January 26, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component


Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932


Symbols

PLATE LOCATION AND ORIENTATION

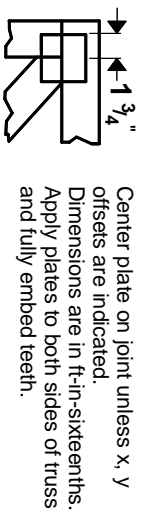

Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.

For 4 x 2 orientation, locate plates 0- $\frac{1}{16}$ " from outside edge of truss.




This symbol indicates the required direction of slots in connector plates.

PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur. Min size shown is for crushing only.

Industry Standards:

ANSI/TPI 1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-89: Design Standard for Bracing, Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

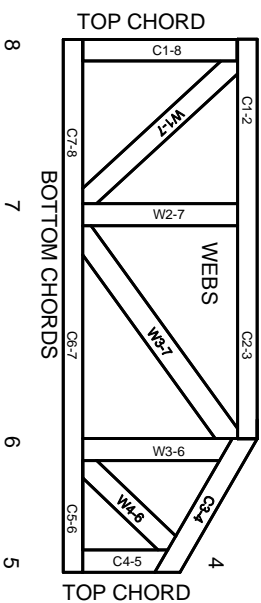

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ESR1988
ESR-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TPI 1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MITTEK® All Rights Reserved



Mitek Engineering Reference Sheet: MIT-7473 rev. 5/19/2020



General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TPI 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TPI 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TPI 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.