






Front Elevation
Scale: 1/4" = 1'0"

NOTICE TO CONTRACTOR:
All construction must comply with current NC Building Codes and is subject to field inspection and verification.

APPROVED
Limited building only review
Permit holder responsible for full compliance with the code


01/26/2023

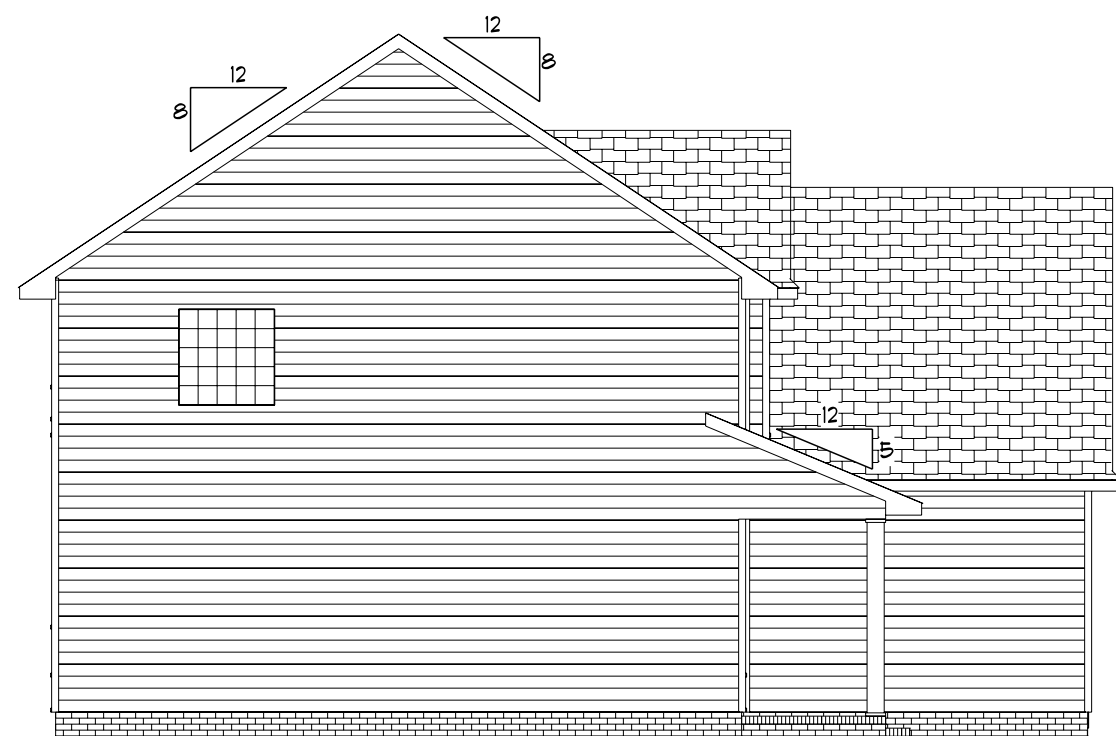Left Elevation
Scale: 1/8" = 1'0"



Rear Elevation
Scale: 1/8" = 1'0"

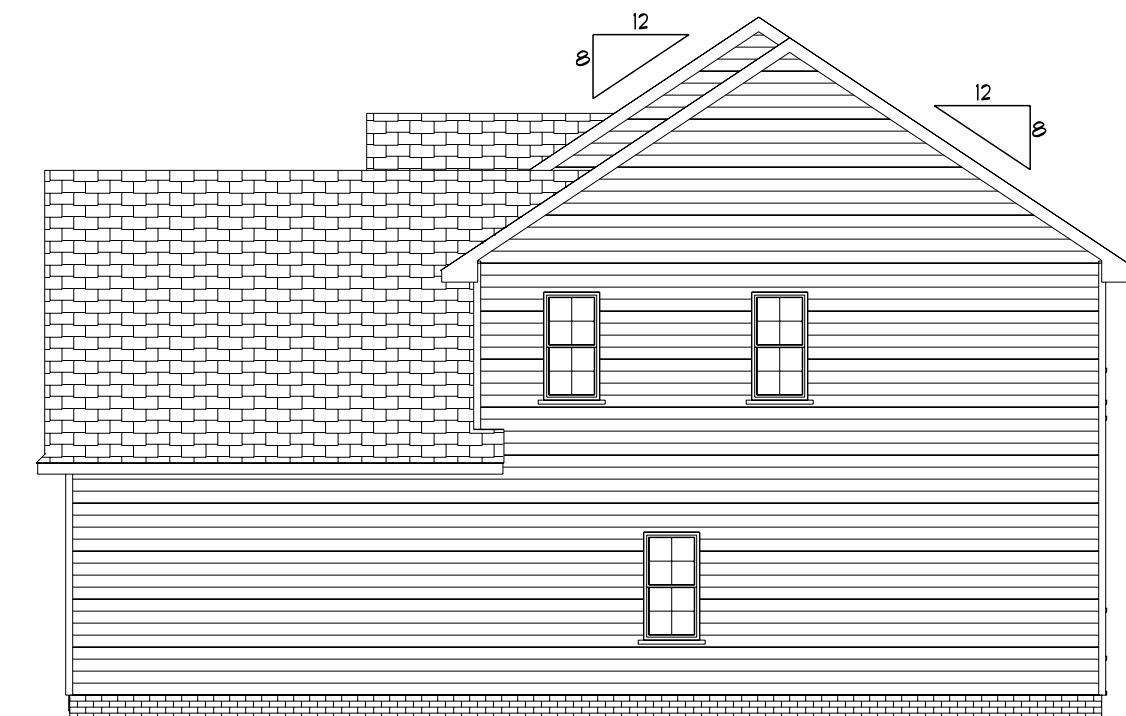



Right Elevation
Scale: 1/8" = 1'0"

DATE: 1/6/2023
REVISED
DRAWING#

SCALE: 1/4"
DRAWN BY
APPROVED

Plan #5

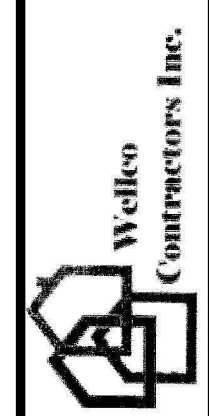

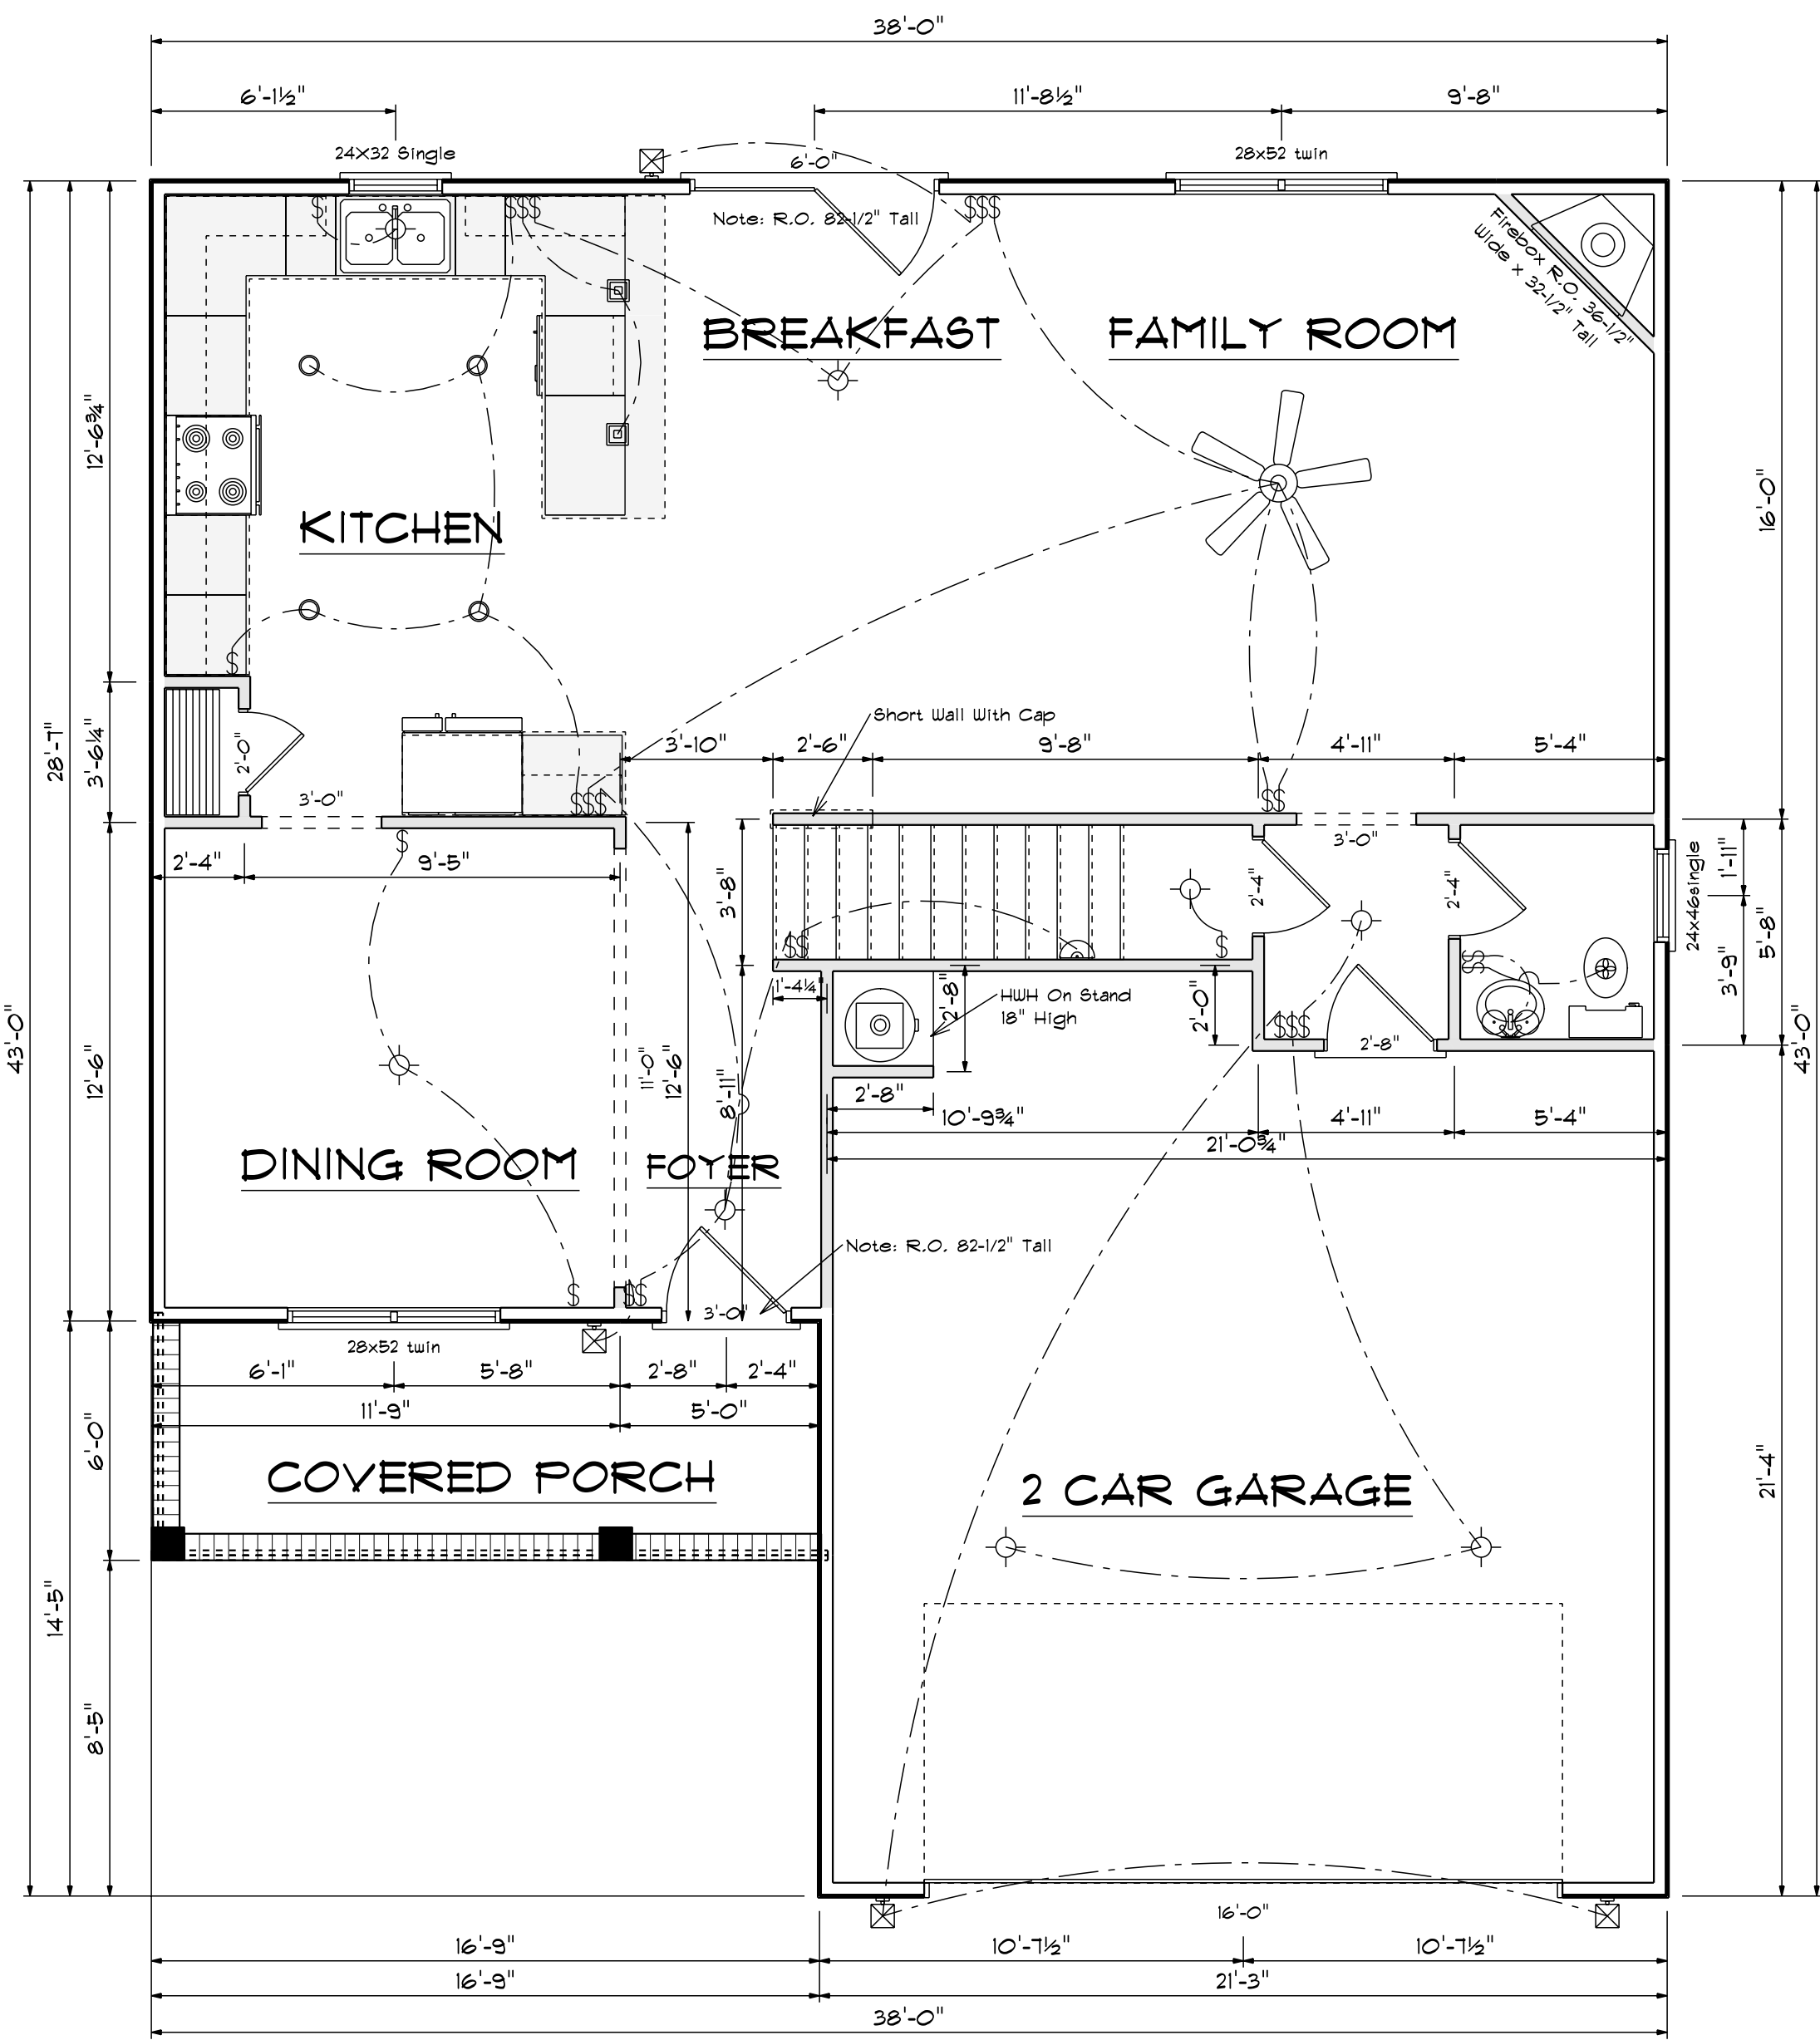


FIRST FLOOR OPENING SCHEDULE				
COUNT	REVERSED	HINGE	SIZE	PRODUCT CODE
1	NO	L	3'-0"	36X80 COLONIAL A 1
1	NO	RN	6'-0"	72X80 FRENCH A 2
1	NO	U	16'-0"	192X84 - GARAGE DR
1	NO	L	2'-0"	2-0 Door Unit
2	NO	R	2'-4"	2-4 Door Unit
1	NO	L	2'-8"	2-8 Door Unit
1	NA	N	2'-4" x 3'-2"	24X32 Single
1	NA	N	2'-4" x 4'-6"	24x46single
2	NA	NN	5'-4" x 5'-2"	28x52 twin

Areas

First Floor	929
Second Floor	1209
=====	
Total Heated	2138
Garage	470
Front Porch	100


First Floor Plan
 Scale: 1/4" = 1'-0"

<p>Plan #5</p>	<p>Wellco Contractors Inc.</p>
<p>DATE: 1/6/2023</p>	<p>REVISID</p>
<p>SCALE: 1/4"</p>	<p>DRAWN BY</p>
<p>DRAWING#</p>	<p>APPROVED</p>

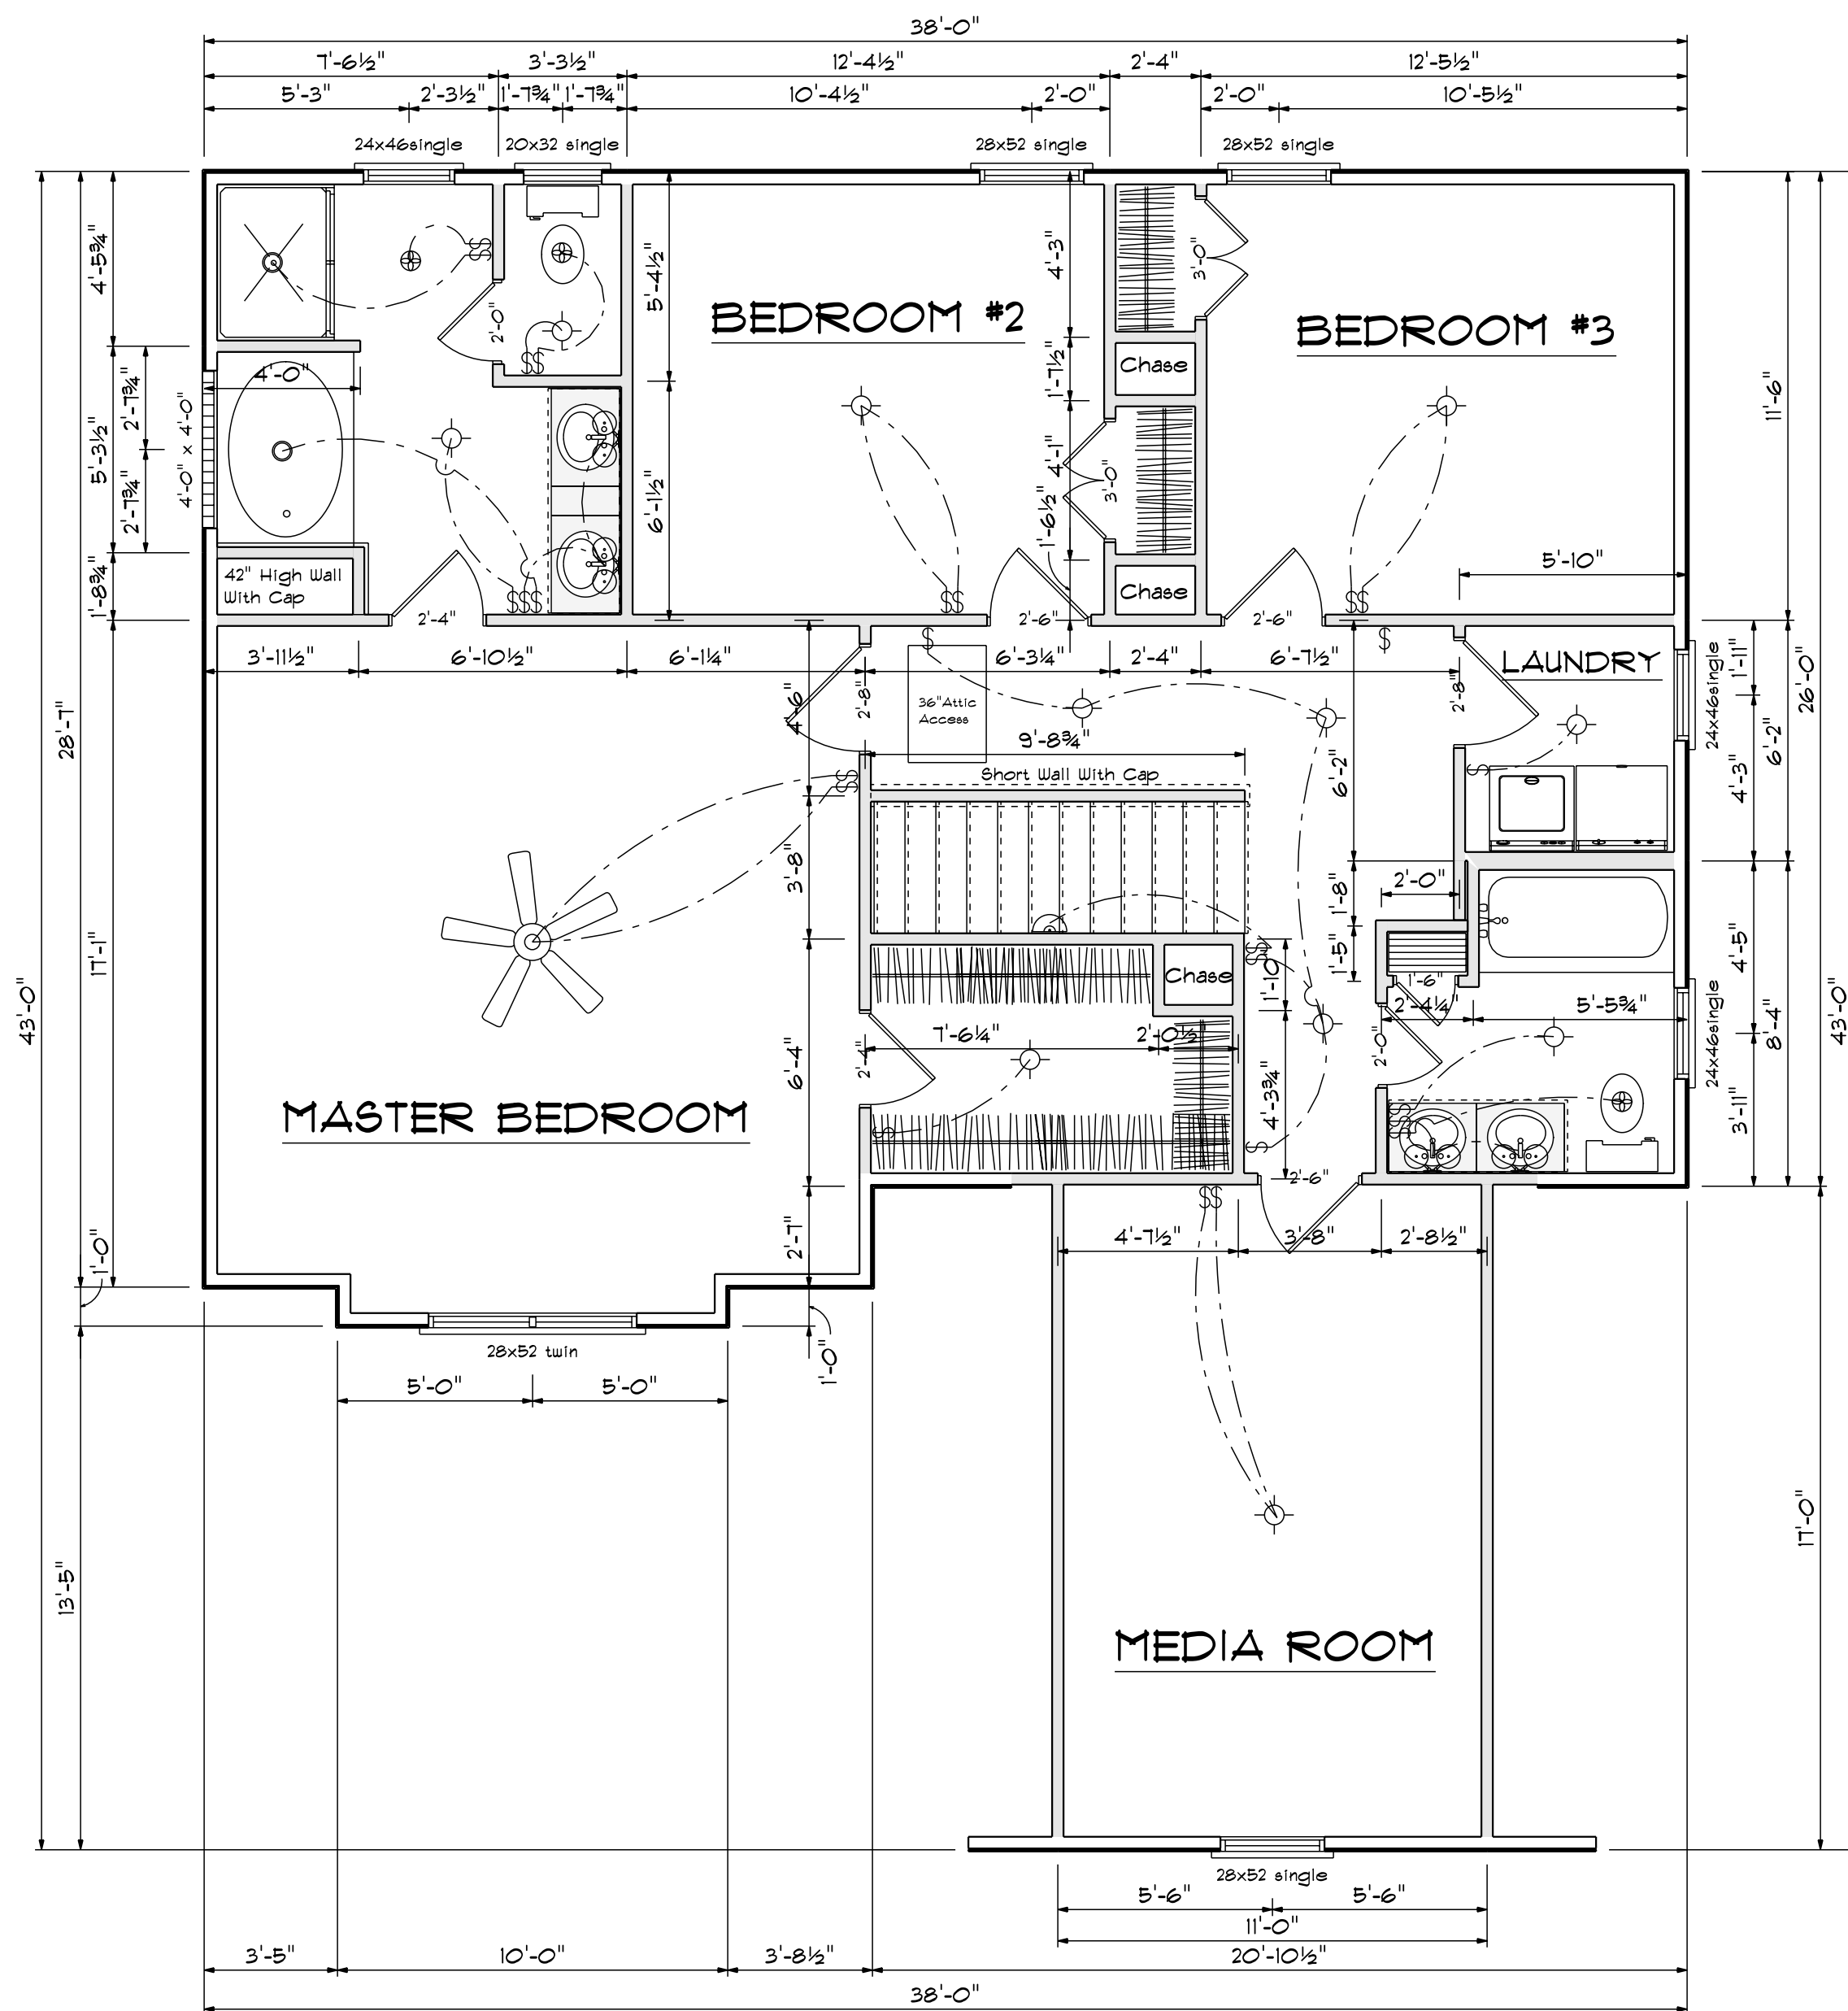



SECOND FLOOR OPENING SCHEDULE				
PRODUCT CODE	SIZE	HINGE	REVERSED	COUNT
1-6 Door Unit	1'-6"	L	NO	1
2-0 Door Unit	2'-0"	L	NO	1
2-0 Door Unit	2'-0"	R	NO	1
2-4 Door Unit	2'-4"	R	NO	2
2-6 Door Unit	2'-6"	L	NO	1
2-6 Door Unit	2'-6"	R	NO	2
2-8 Door Unit	2'-8"	R	NO	1
2-8 Door Unit	2'-8"	L	NO	1
3-0 Doublehung Door Unit	3'-0"	LR	NO	2
20x32 single	2'-0" x 3'-2"	N	NA	1
24x46single	2'-4" x 4'-6"	N	NA	3
28x52 single	2'-8" x 5'-2"	N	NA	3
28x52 twin	5'-4" x 5'-2"	NN	NA	1
4X8 GLASS BLOCK	4'-0" x 4'-0"	N	NA	1

Second Floor Plan
Scale: 1/4" = 1'-0"

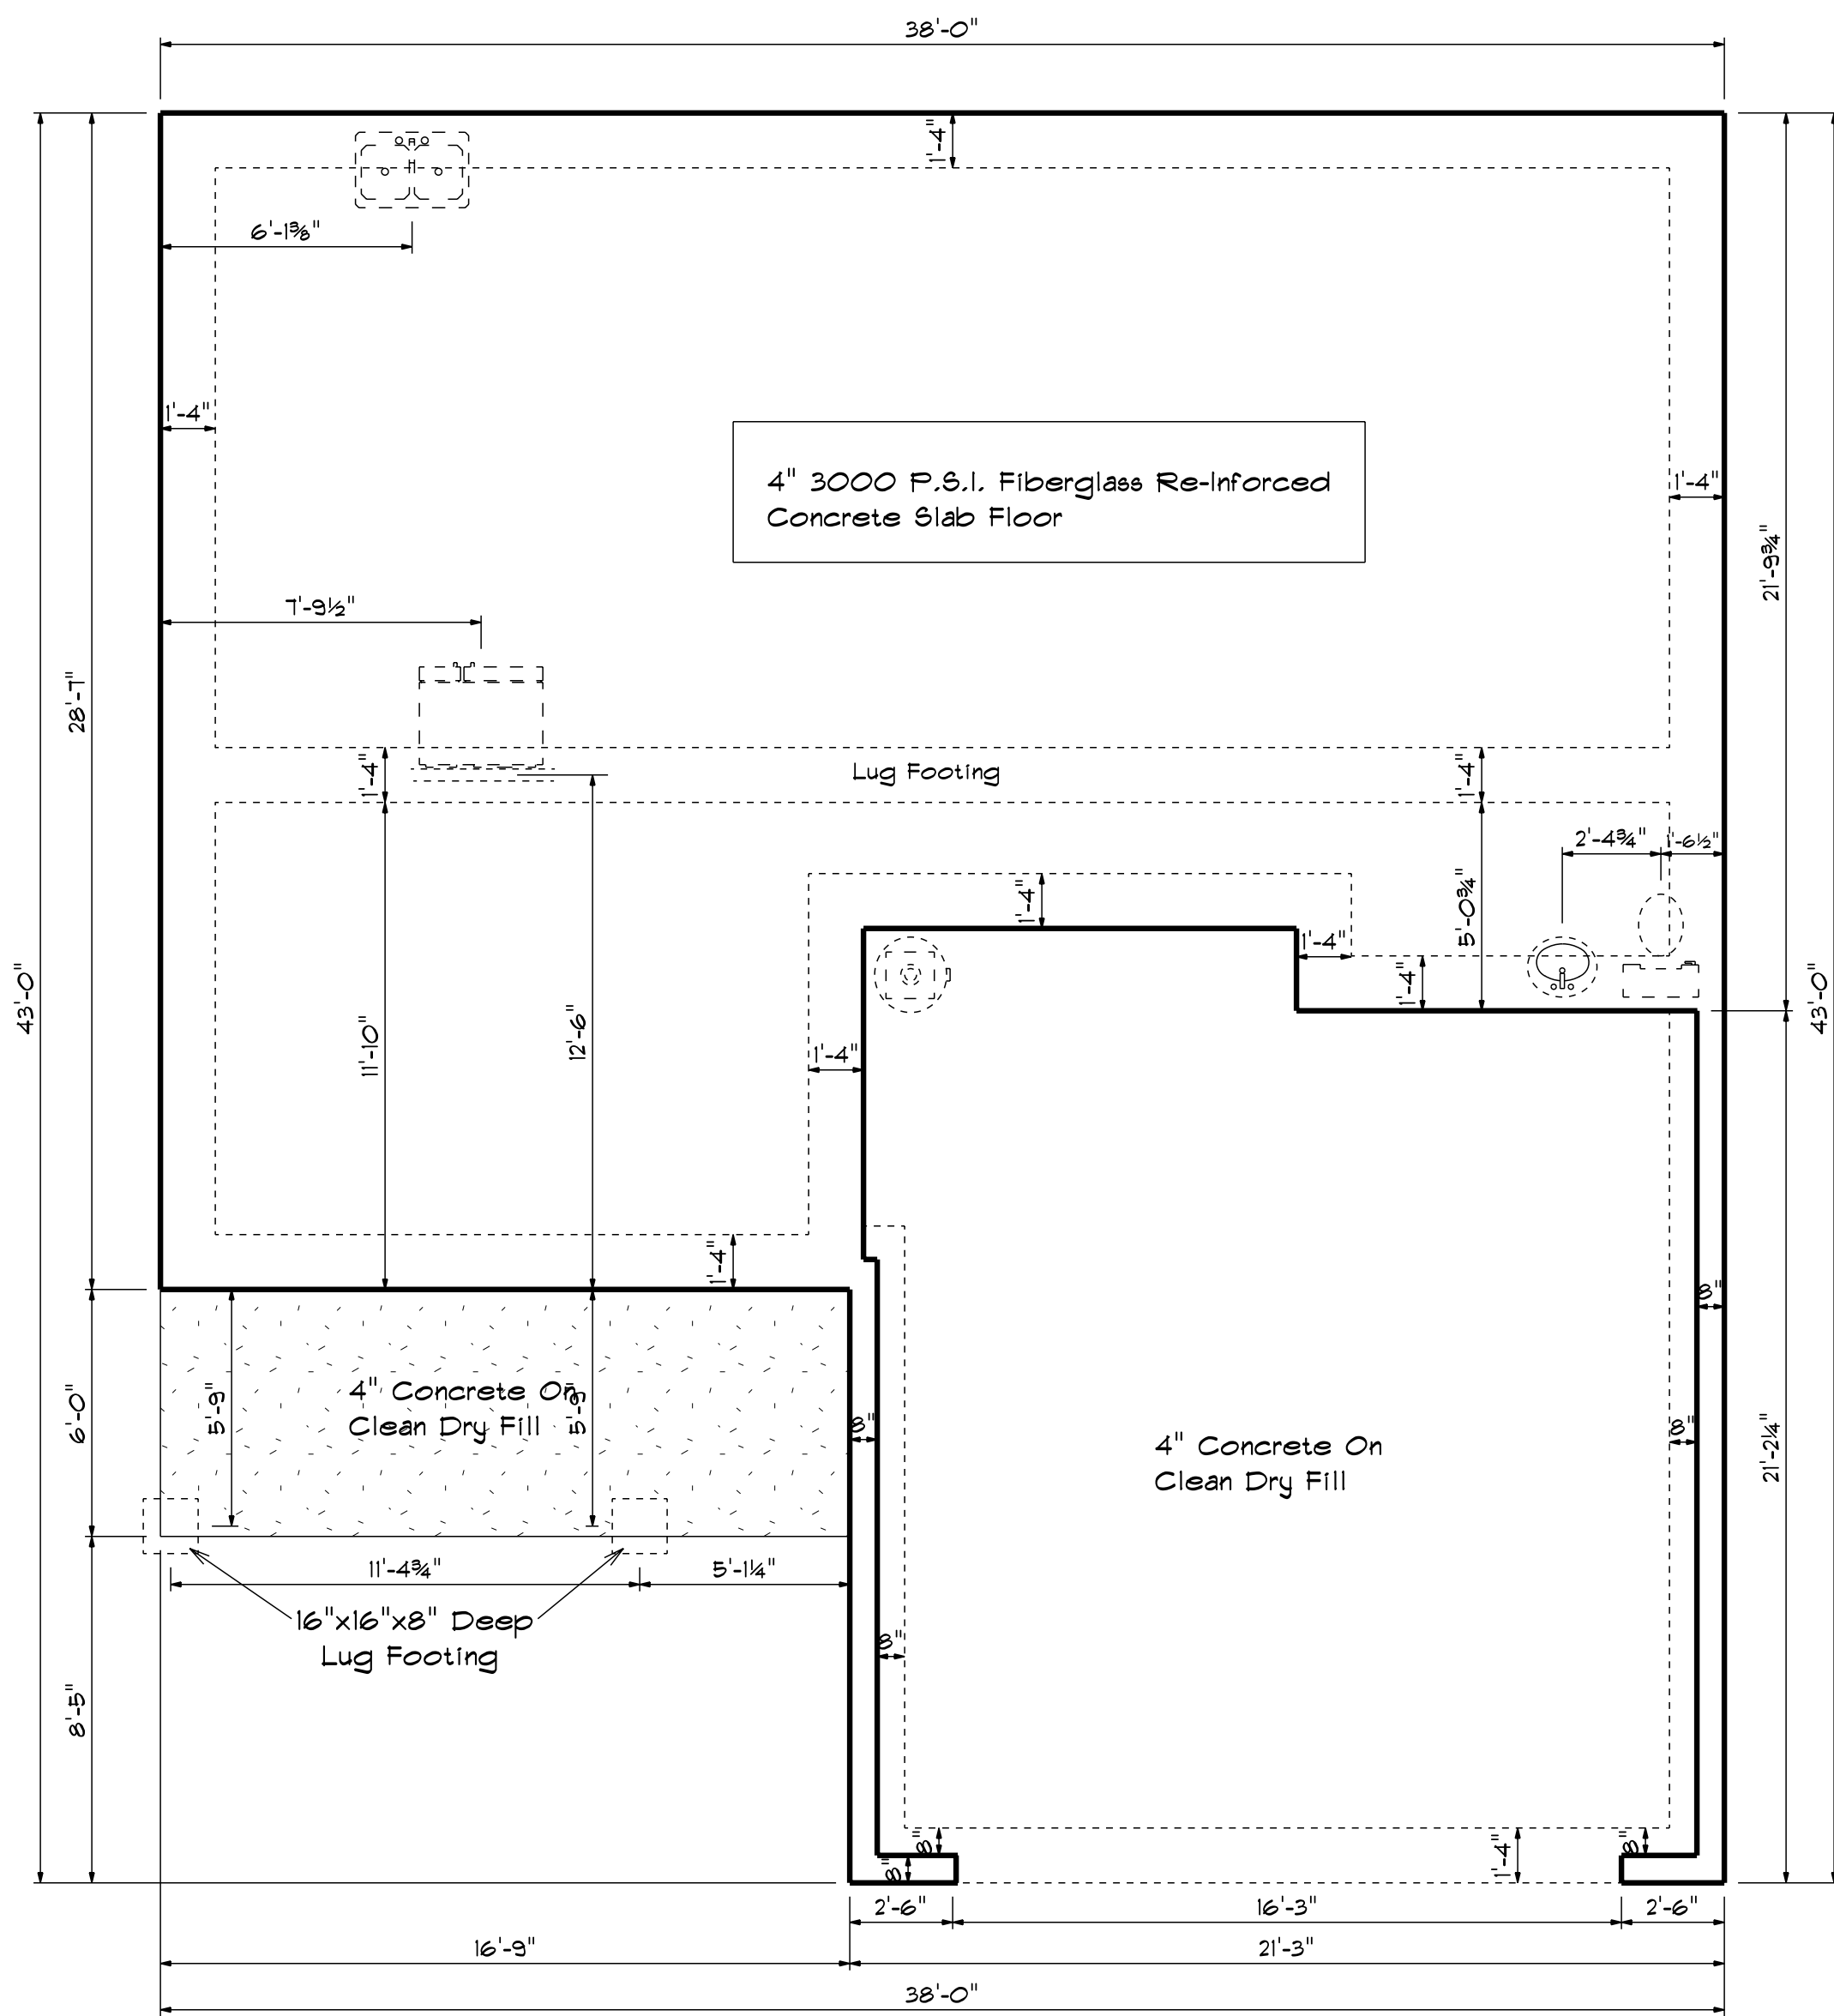

Foundation Plan

Scale: 1/4" = 1'-0"

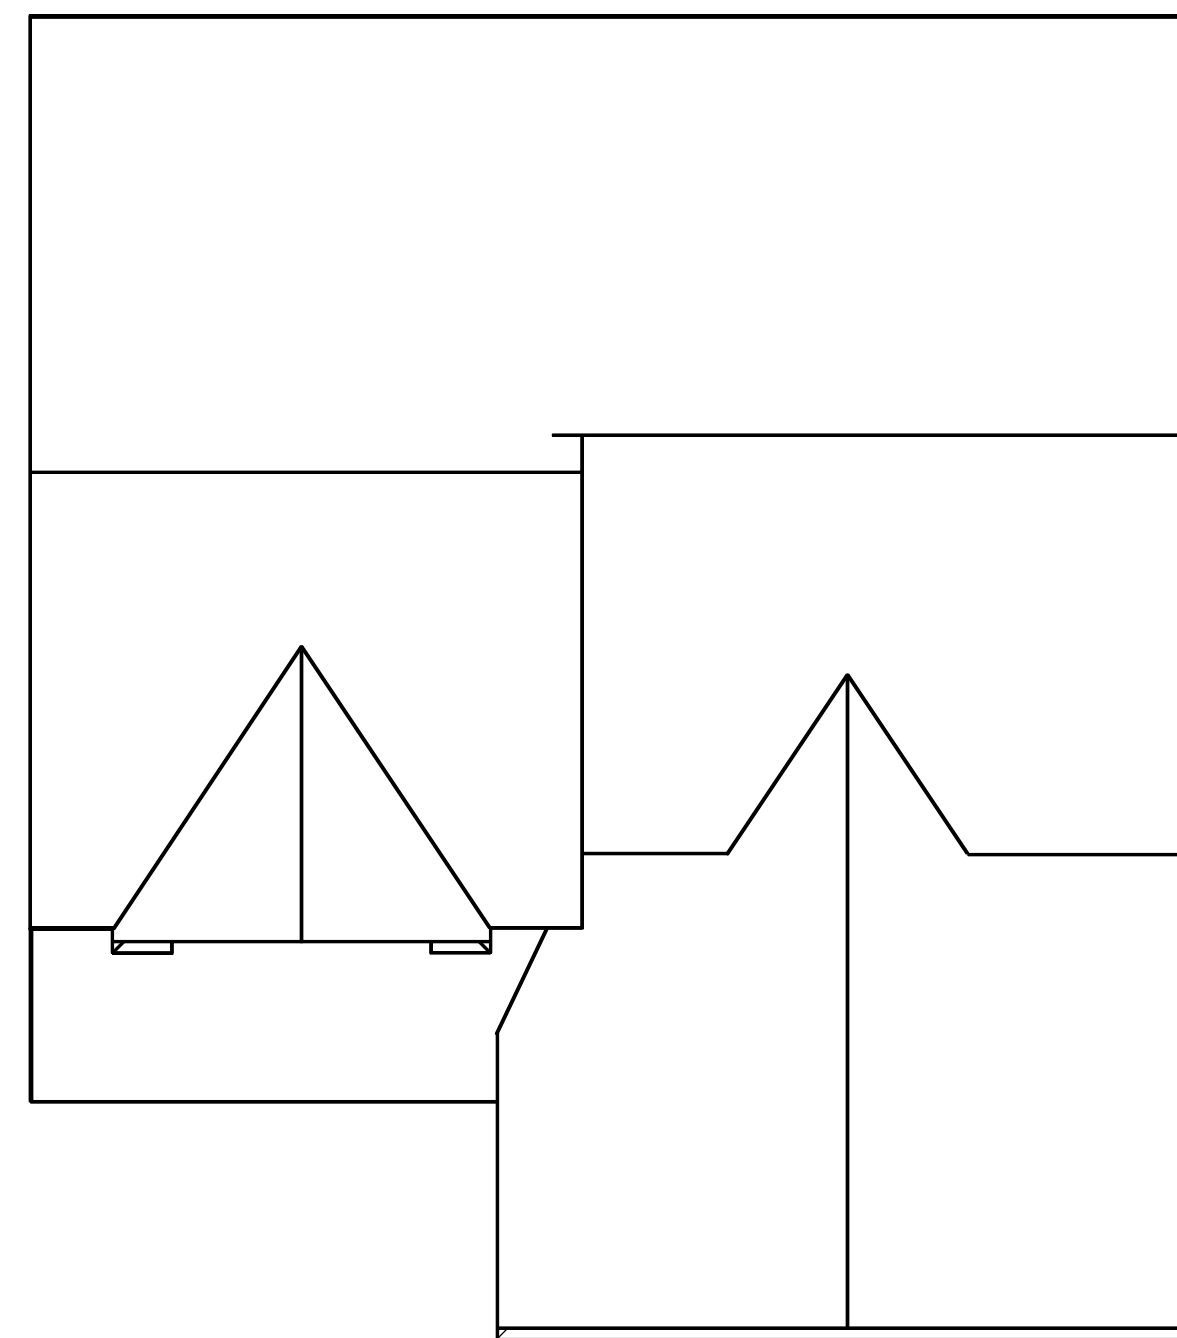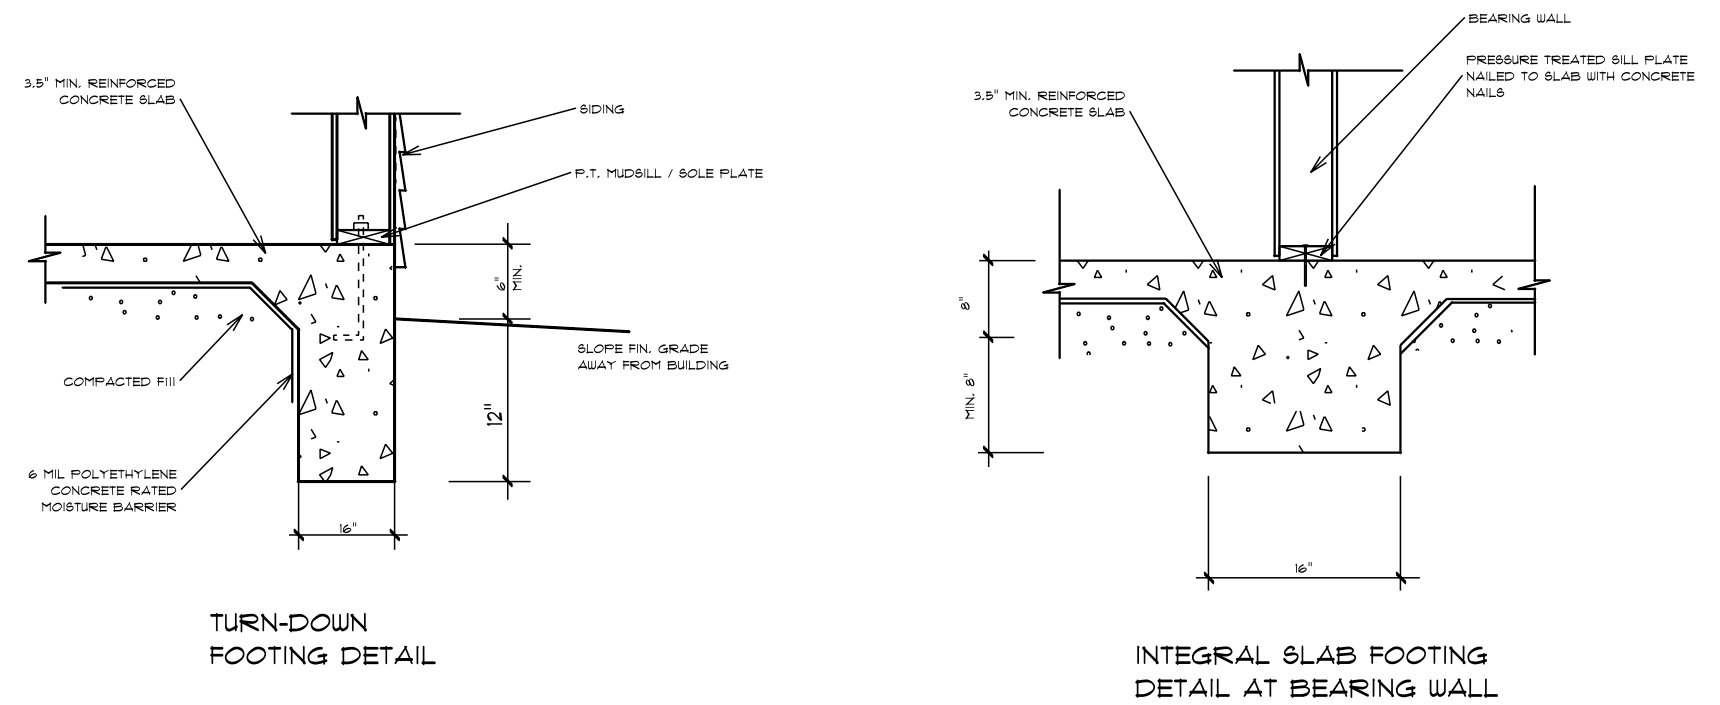


Roof Plan

DATE: 1/6/2023
REVISED
DRAWING#

SCALE: 1/4"
DRAWN BY
APPROVED



Plan #5



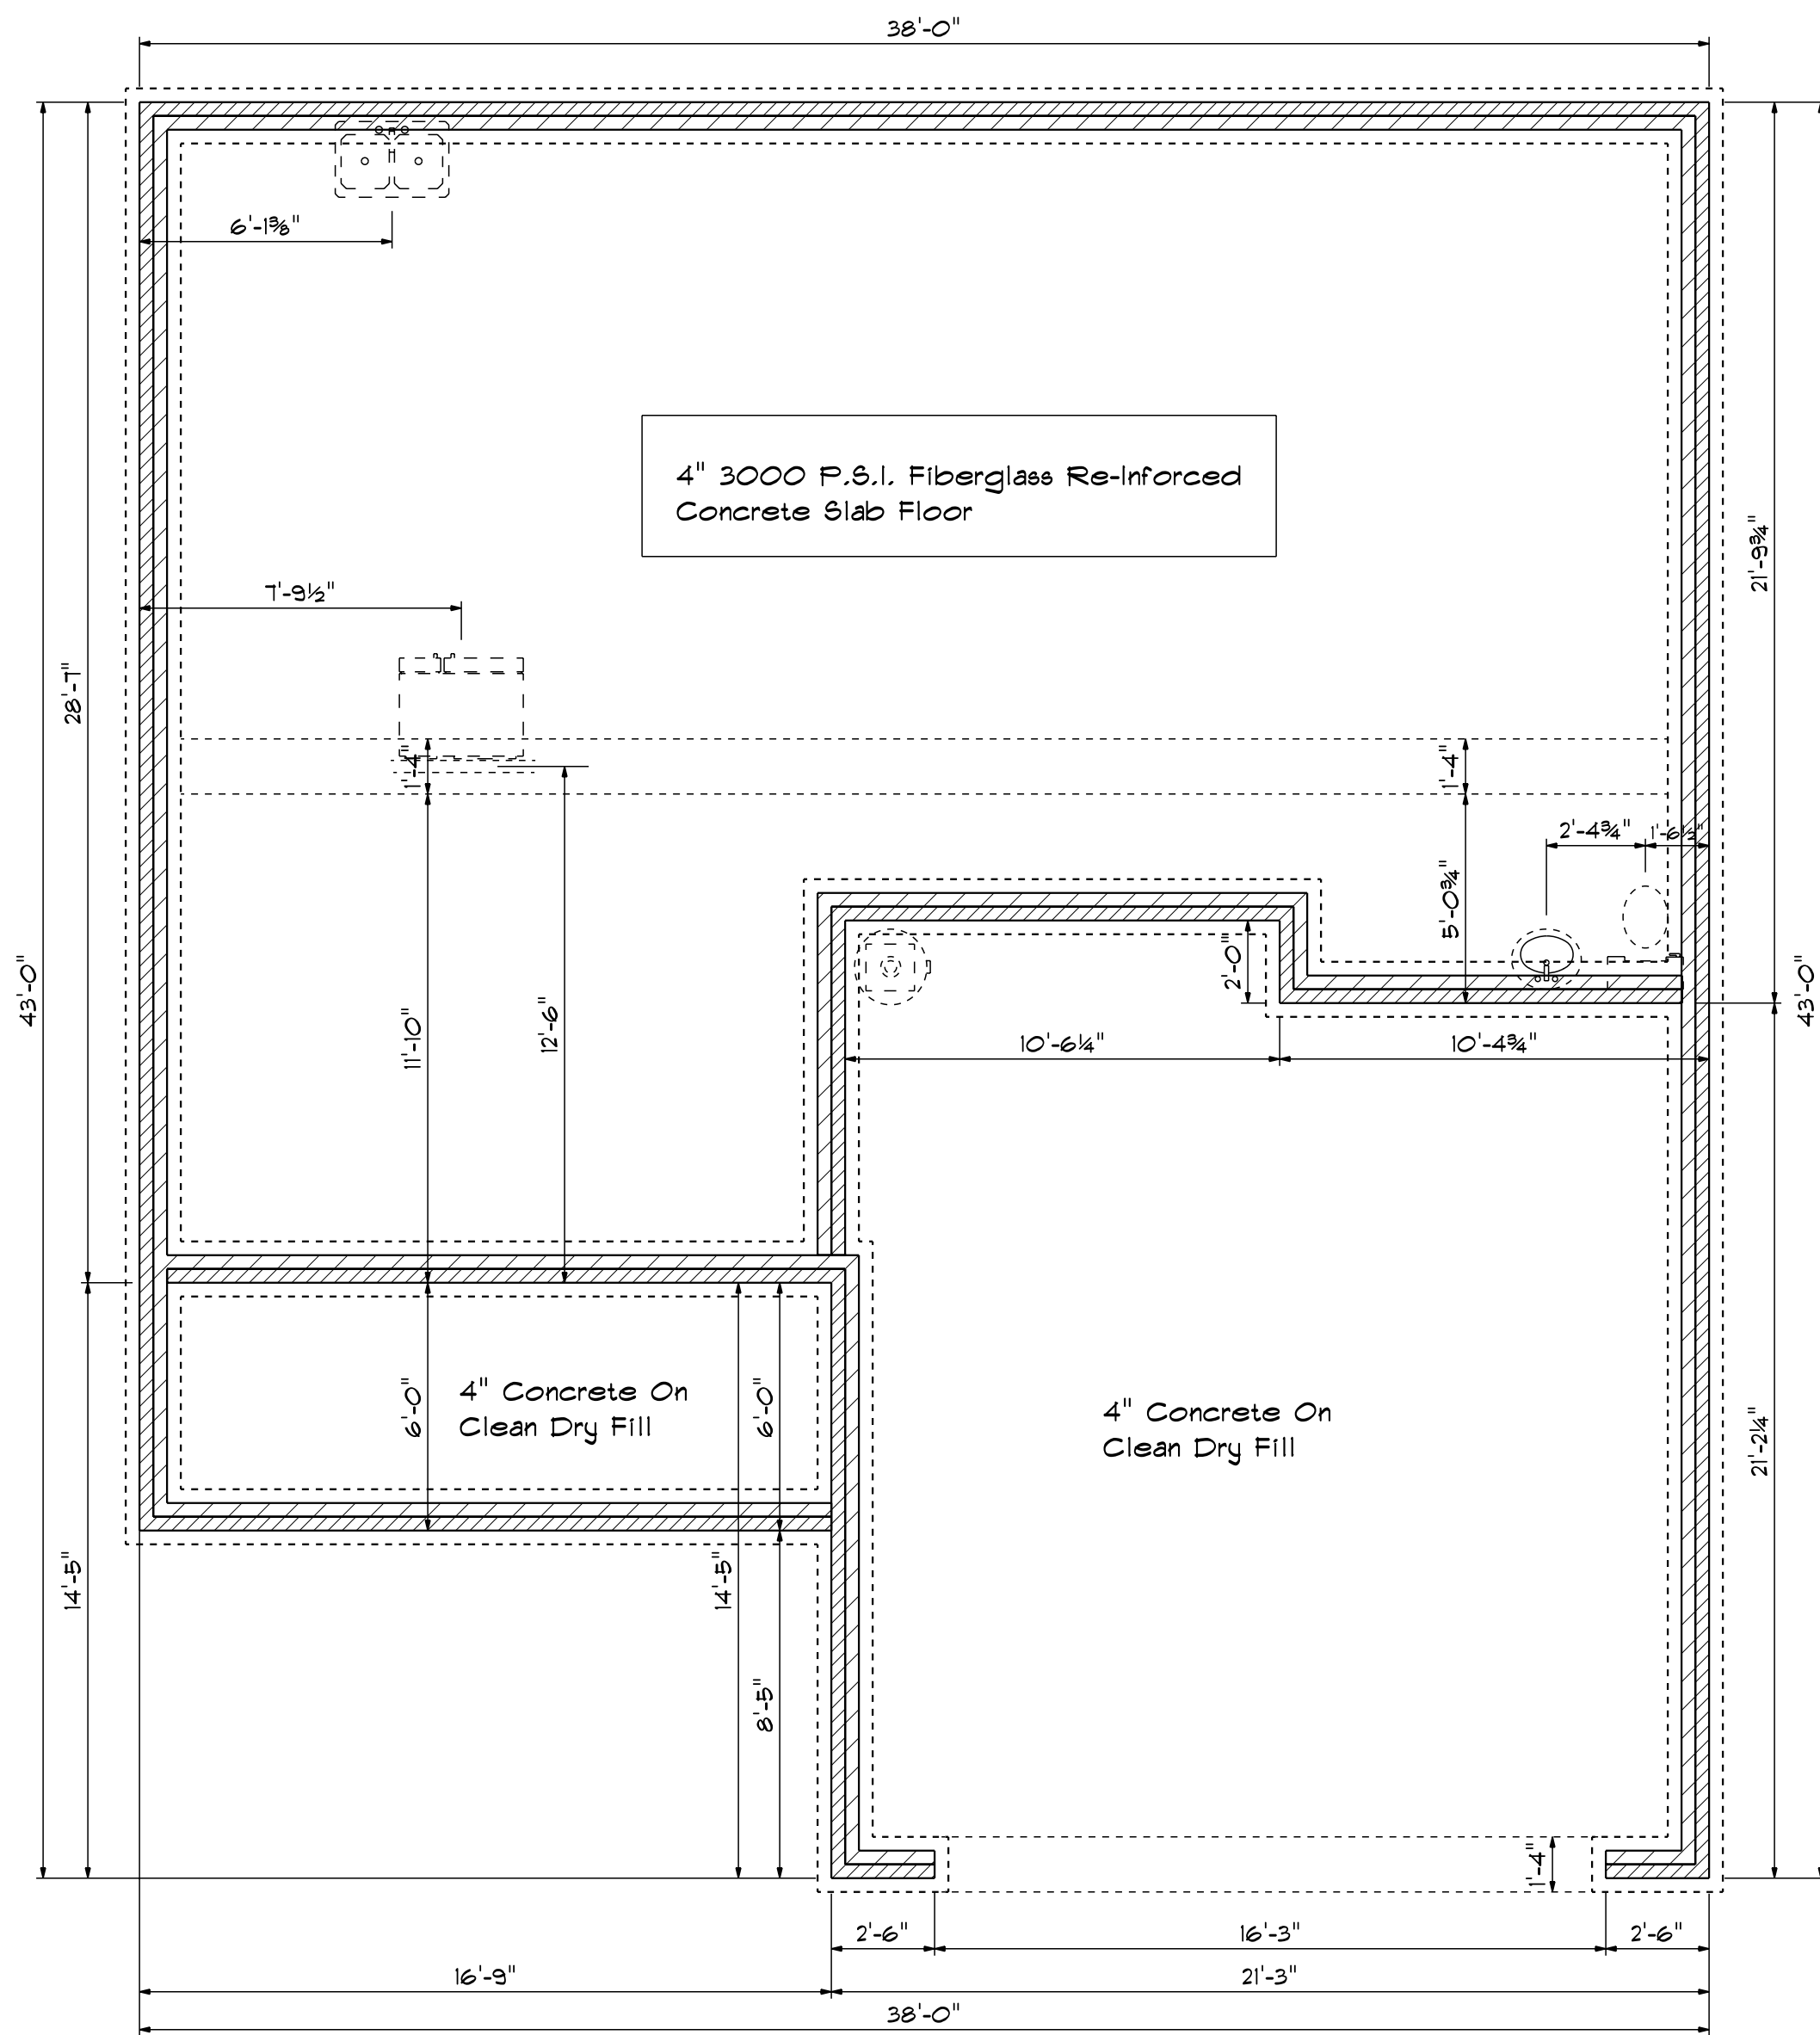

Foundation Plan

Scale: 1/4" = 1'-0"

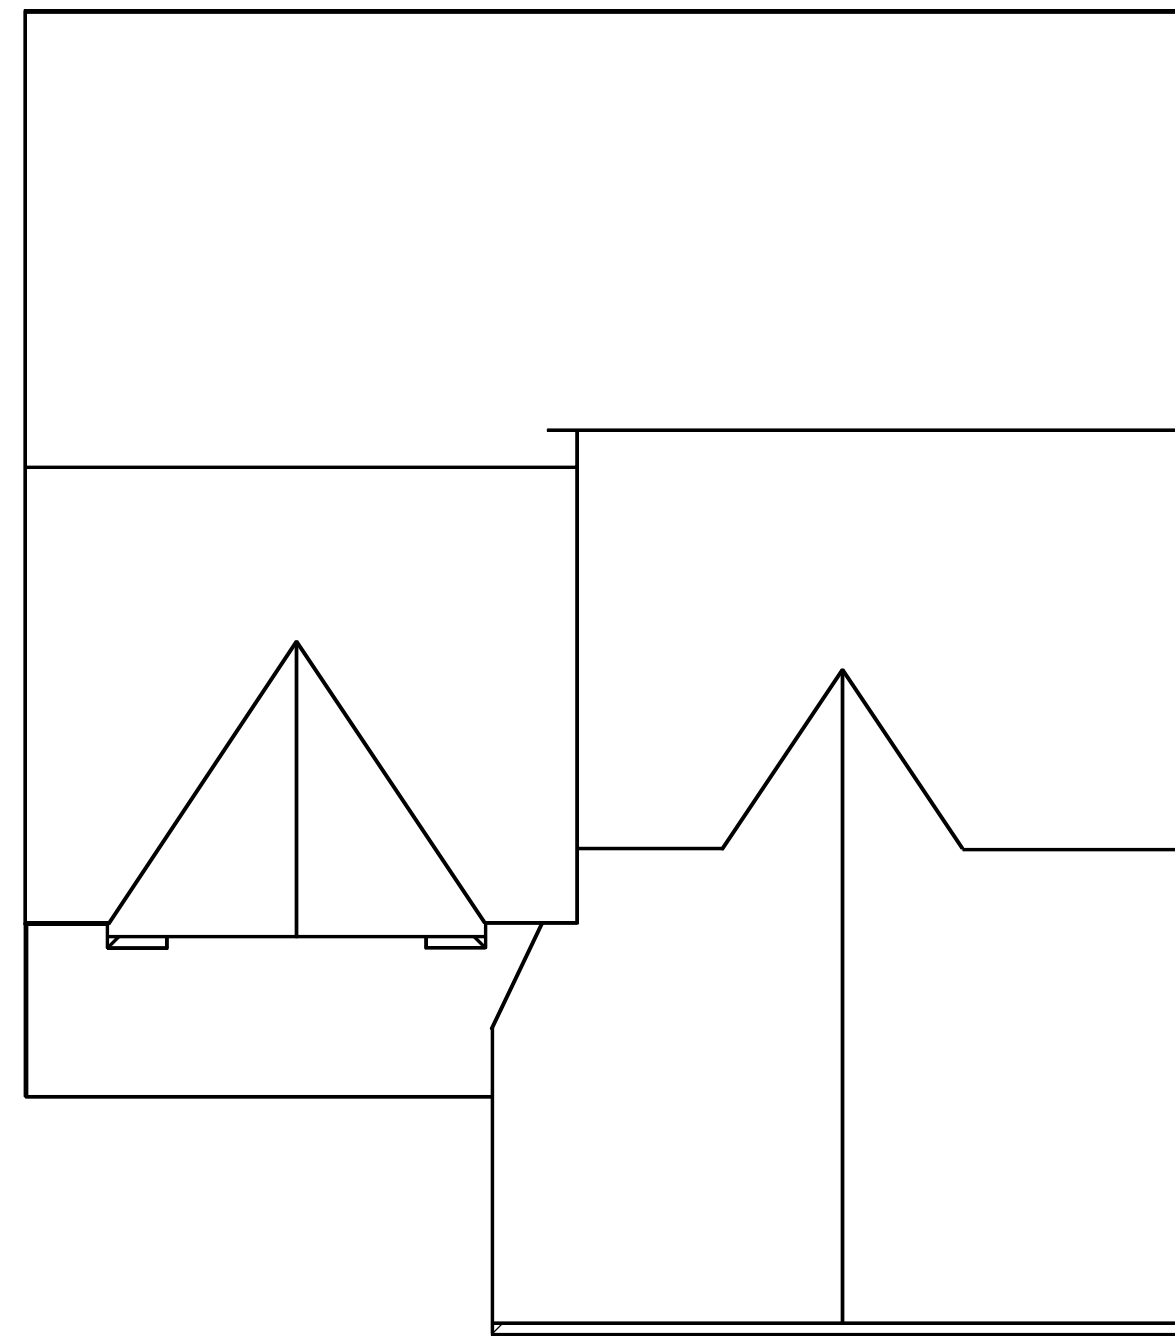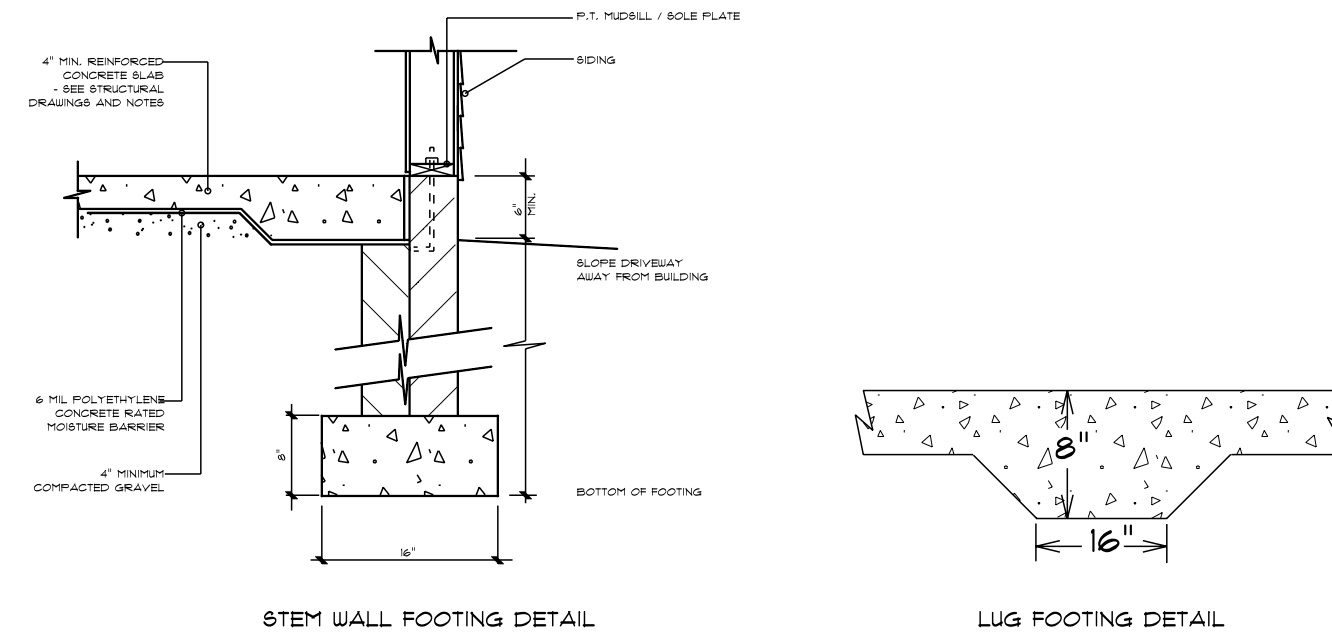


Roof Plan

DATE: 1/6/2023
REVISED
DRAWING#

SCALE: 1/4"
DRAWN BY
APPROVED

Plan #5

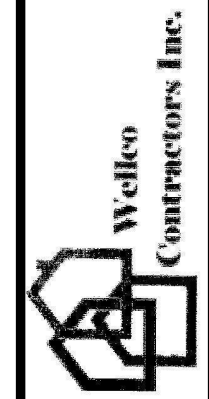



ROOF & FLOOR TRUSSES & BEAMS

Reilly Road Industrial Park
Fayetteville, N.C. 28309
Phone: (910) 864-8787
Fax: (910) 864-4444

Bearing reactions less than or equal to 3000# are deemed to comply with the prescriptive Code requirements. The contractor shall refer to the attached Tables (derived from the prescriptive Code requirements) to determine the minimum foundation size and number of wood studs required to support reactions greater than 3000# but not greater than 15000#. A registered design professional shall be retained to design the support system for any reaction that exceeds those specified in the attached Tables. A registered design professional shall be retained to design the support system for all reactions that exceed 15000#.

Signature **David Landry**
David Landry

LOAD CHART FOR JACK STUDS

(BASED ON TABLES R502.5(1) & (b))
NUMBER OF JACK STUDS REQUIRED @ EA END OF HEADER/BORDER

END REACTION (LPT)	REQ'D STUDS FOR (LPT) HEADERS	END REACTION (LPT)	REQ'D STUDS FOR (LPT) HEADERS	END REACTION (LPT)	REQ'D STUDS FOR (LPT) HEADERS
1700	1	2550	1	3400	1
3400	2	5100	2	6800	2
5100	3	7650	3	10200	3
6800	4	10200	4	13600	4
8500	5	12750	5	17000	5
10200	6	15300	6		
11900	7				
13600	8				
15300	9				

All Walls Shown Are Considered Load Bearing

Roof Area = 2147.16 sq.ft.
Ridge Line = 71.84 ft.
Hip Line = 0 ft.
Horiz. OH = 110.23 ft.
Raked OH = 151.18 ft.
Decking = 74 sheets

Dimension Notes

- All exterior wall to wall dimensions are to face of sheathing unless noted otherwise
- All interior wall dimensions are to face of frame wall unless noted otherwise
- All exterior wall to truss dimensions are to face of frame wall unless noted otherwise


Hatch Legend

- Second Floor Walls
- Box Storage
- Drop Beam

Connector Information					Nail Information	
Sym	Product	Manuf	Qty	Supported Member	Header	Truss
■	HUS26	USP	5	NA	16d/3-1/2"	16d/3-1/2"

Products				
PlotID	Length	Product	Plies	Net Qty
GDH	22' 0"	1-3/4"x 11-7/8" LVL Kerto-S	2	2

1 Truss Placement Plan
Scale: 1/4"=1'

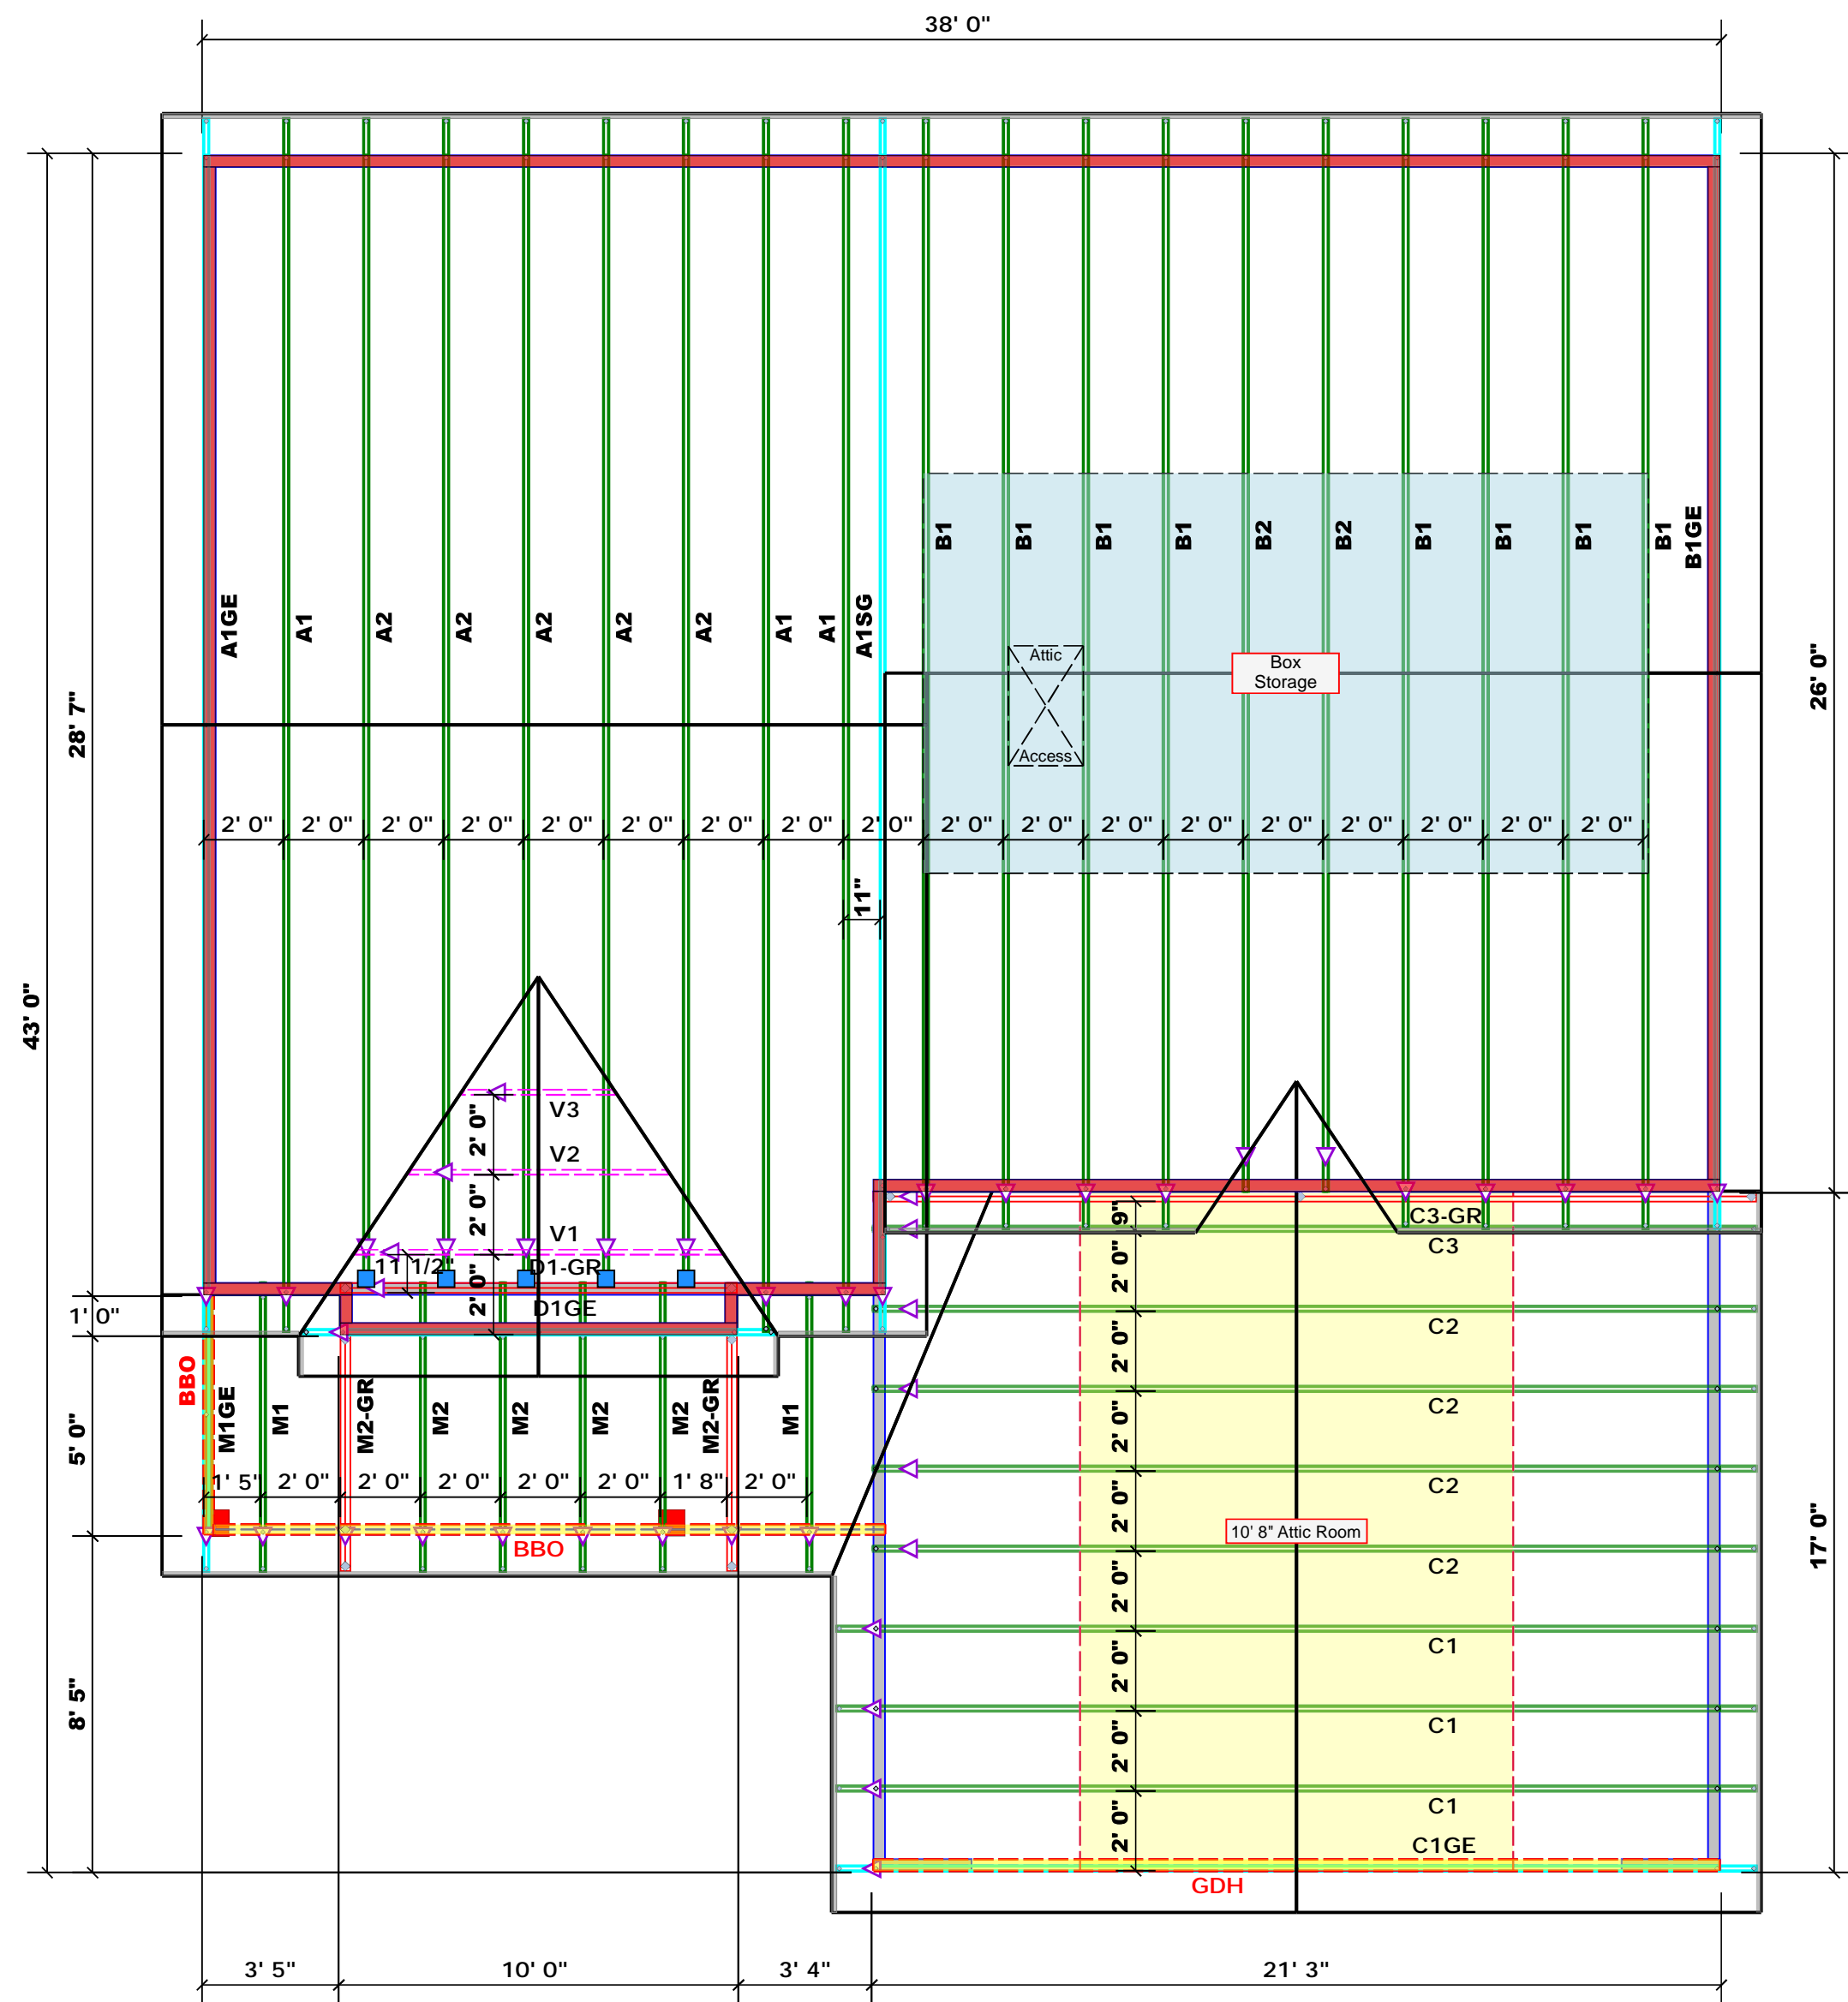

BUILDER	JOB NAME	PLAN	SEAL DATE	QUOTE #	JOB #
Wellco Contractors	Lot 122 Hidden Lakes	Plan 5	N/A		J1122-5618

CITY / CO.	ADDRESS	MODEL	DATE REV.	DRAWN BY	SALES REP.
Clayton / Johnston	89 Sugarberry Place	Roof	11/11/22	Jonathan Landry	Lenny Norris

△ = Indicates Left End of Truss
(Reference Engineered Truss Drawing)
Do NOT Erect Truss Backwards

THIS IS A TRUSS PLACEMENT DIAGRAM ONLY. These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult BCSI-B1 and BCSI-B3 provided with the truss delivery package or online @ sbcindustry.com



RE: J1122-5618
Lot 122 Hidden Lakes

Trenco
818 Soundside Rd
Edenton, NC 27932

Site Information:

Customer: Wellco Contractors Project Name: J1122-5618
Lot/Block: 122 Model: Plan 5
Address: 89 Sugarberry Place Subdivision: Hidden Lakes
City: Clayton State: NC

General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):

Design Code: IRC2015/TPI2014 Design Program: MiTek 20/20 8.4
Wind Code: ASCE 7-10 Wind Speed: 150 mph
Roof Load: 40.0 psf Floor Load: N/A psf

This package includes 21 individual, dated Truss Design Drawings and 0 Additional Drawings.

No.	Seal#	Truss Name	Date	No.	Seal#	Truss Name	Date
1	I53182508	A1	7/20/2022	21	I53182528	V3	7/20/2022
2	I53182509	A1GE	7/20/2022				
3	I53182510	A1SG	7/20/2022				
4	I53182511	A2	7/20/2022				
5	I53182512	B1	7/20/2022				
6	I53182513	B1GE	7/20/2022				
7	I53182514	B2	7/20/2022				
8	I53182515	C1	7/20/2022				
9	I53182516	C1GE	7/20/2022				
10	I53182517	C2	7/20/2022				
11	I53182518	C3	7/20/2022				
12	I53182519	C3-GR	7/20/2022				
13	I53182520	D1-GR	7/20/2022				
14	I53182521	D1GE	7/20/2022				
15	I53182522	M1	7/20/2022				
16	I53182523	M1GE	7/20/2022				
17	I53182524	M2	7/20/2022				
18	I53182525	M2-GR	7/20/2022				
19	I53182526	V1	7/20/2022				
20	I53182527	V2	7/20/2022				

The truss drawing(s) referenced above have been prepared by Truss Engineering Co. under my direct supervision based on the parameters provided by Comtech, Inc - Fayetteville.

Truss Design Engineer's Name: Strzyzewski, Marvin

My license renewal date for the state of North Carolina is December 31, 2022.

North Carolina COA: C-0844


IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to TRENCO. Any project specific information included is for TRENCO customers file reference purpose only, and was not taken into account in the preparation of these designs. TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.



July 20, 2022


Job J1122-5618	Truss A1	Truss Type COMMON	Qty 3	Ply 1	Lot 122 Hidden Lakes Job Reference (optional)	153182508
-------------------	-------------	----------------------	----------	----------	--	-----------

Comtech, Inc. Fayetteville, NC - 28314, 8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Jul 19 11:34:29 2022 Page 1



5x5 =

Scale = 1:59.8

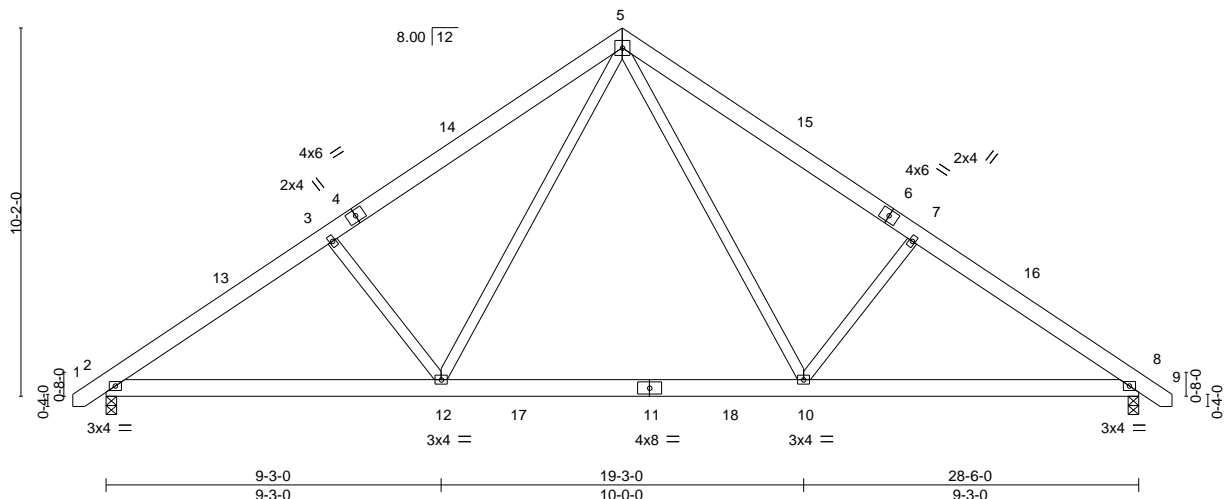

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.26	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.45	Vert(LL) -0.18 10-12 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.45	Vert(CT) -0.24 10-12 >999 240		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.03 8 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.04 12 >999 240	Weight: 198 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.1
BOT CHORD 2x6 SP No.1
WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-7-5 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 2=0-3-8, 8=0-3-8
Max Horz 2=319(LC 11)
Max Uplift 2=-211(LC 12), 8=-211(LC 13)
Max Grav 2=1253(LC 19), 8=1253(LC 20)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1805/625, 3-5=-1722/666, 5-7=-1722/666, 7-8=-1804/625
BOT CHORD 2-12=-371/1631, 10-12=-45/1007, 8-10=-382/1397
WEBS 5-10=-222/799, 7-10=-568/395, 5-12=-222/799, 3-12=-568/395

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-9-1 to 3-7-12, Interior(1) 3-7-12 to 14-3-0, Exterior(2) 14-3-0 to 18-7-13, Interior(1) 18-7-13 to 29-3-1 zone:C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 211 lb uplift at joint 2 and 211 lb uplift at joint 8.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



July 20,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932

Job J1122-5618	Truss A1GE	Truss Type GABLE	Qty 1	Ply 1	Lot 122 Hidden Lakes Job Reference (optional)	153182509
-------------------	---------------	---------------------	----------	----------	--	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Jul 19 11:34:30 2022 Page 1

ID:9TsBS1yzEQOf2XeoOILTI2yyUuf-Sn5zyAqOca5kGM66CEK2x1g8xU0SR0tcl9e3QMyywWHd

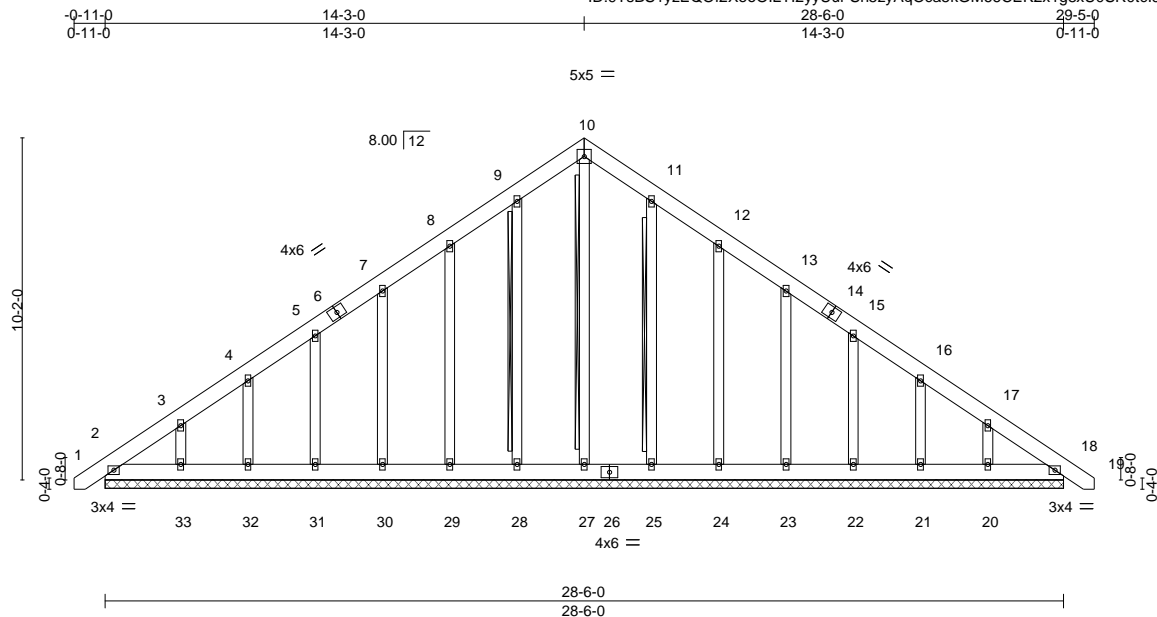

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.06	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.03	Vert(LL) 0.00 18 n/r 120		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.16	Vert(CT) 0.00 18 n/r 120		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.01 18 n/a n/a		
	Code IRC2015/TPI2014			Weight: 248 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.1
 BOT CHORD 2x6 SP No.1
 OTHERS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
 WEBS T-Brace: 2x4 SPF No.2 - 10-27, 9-28, 11-25
 Fasten (2X) T and I braces to narrow edge of web with 10d (0.131"x3") nails, 6in o.c., with 3in minimum end distance.
 Brace must cover 90% of web length.

REACTIONS.

All bearings 28-6-0.
 (lb) - Max Horz 2=399(LC 10)
 Max Uplift All uplift 100 lb or less at joint(s) 18, 28, 25 except 2=109(LC 8), 29=147(LC 12), 30=132(LC 12), 31=132(LC 12), 32=127(LC 12), 33=177(LC 12), 24=151(LC 13), 23=132(LC 13), 22=132(LC 13), 21=127(LC 13), 20=172(LC 13)
 Max Grav All reactions 250 lb or less at joint(s) 2, 18, 28, 29, 30, 31, 32, 33, 25, 24, 23, 22, 21, 20 except 27=252(LC 13)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=399/302, 3-4=282/248, 8-9=246/301, 9-10=298/340, 10-11=298/340, 11-12=246/274, 17-18=308/211
 BOT CHORD 2-33=200/311, 32-33=200/311, 31-32=200/311, 30-31=200/311, 29-30=200/311, 28-29=200/311, 27-28=200/311, 25-27=200/311, 24-25=200/311, 23-24=200/311, 22-23=200/311, 21-22=200/311, 20-21=200/311, 18-20=200/311

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TCCL=6.0psf; BCCL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 18, 28, 25 except (jt=lb) 2=109, 29=147, 30=132, 31=132, 32=127, 33=177, 24=151, 23=132, 22=132, 21=127, 20=172.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Warning: Additional permanent and stability bracing for truss system (not part of this component design) is always required.



July 20, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	Lot 122 Hidden Lakes	153182510
J1122-5618	A1SG	GABLE	1	1	Job Reference (optional)	

Comtech, Inc. Fayetteville, NC - 28314, 8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Jul 19 11:34:31 2022 Page 1

0-11-0 6-3-0 14-3-0 22-3-0 28-6-0 29-5-0
 0-11-0 6-3-0 8-0-0 8-0-0 6-3-0 0-11-0

5x5 =

Scale = 1:59.8

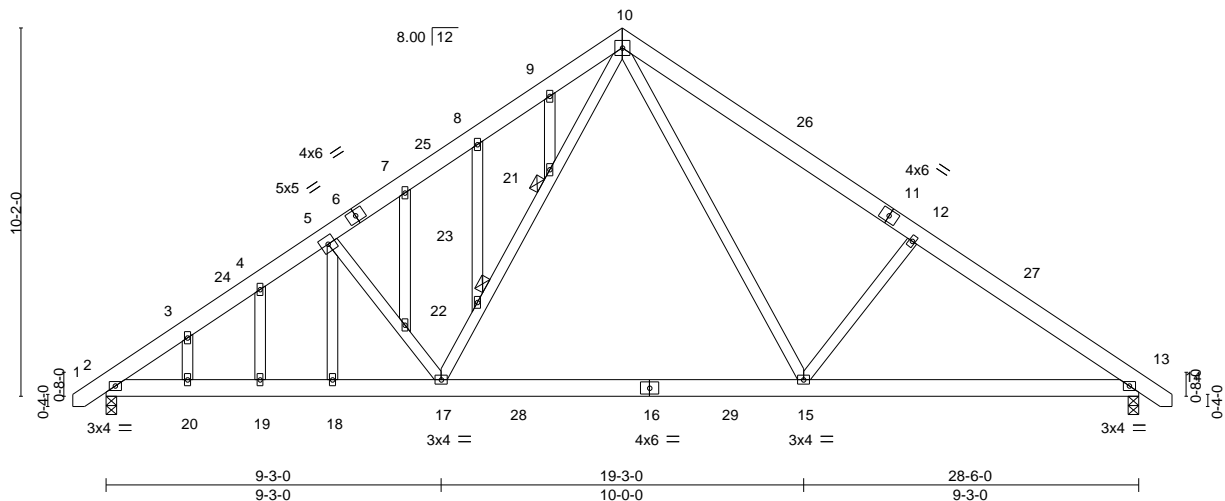

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.25	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.44	Vert(LL) -0.15 15-17 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.45	Vert(CT) -0.23 15-17 >999 240		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.03 13 n/a n/a		
	Code IRC2015/TP12014		Wind(LL) 0.04 15-17 >999 240	Weight: 226 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.1
 BOT CHORD 2x6 SP No.1
 WEBS 2x4 SP No.2
 OTHERS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-7-7 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
 JOINTS 1 Brace at Jt(s): 21, 22

REACTIONS.

(size) 2=0-3-8, 13=0-3-8
 Max Horz 2=-319(LC 10)
 Max Uplift 2=-211(LC 12), 13=-211(LC 13)
 Max Grav 2=1253(LC 19), 13=1253(LC 20)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-1783/526, 3-4=-1775/588, 4-5=-1745/620, 5-7=-1636/578, 7-8=-1705/649,
 8-9=-1721/698, 9-10=-1697/702, 10-12=-1724/665, 12-13=-1807/625
 BOT CHORD 2-20=-330/1564, 19-20=-330/1564, 18-19=-330/1564, 17-18=-331/1561, 15-17=-47/1008,
 13-15=-381/1398
 WEBS 10-15=-218/787, 12-15=-565/393, 17-22=-224/822, 21-22=-299/865, 10-21=-281/871,
 5-23=-433/256, 17-23=-572/342

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-9-1 to 3-7-12, Interior(1) 3-7-12 to 14-3-0, Exterior(2) 14-3-0 to 18-7-13, Interior(1) 18-7-13 to 29-3-1 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=211, 13=211.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



July 20, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

Job J1122-5618	Truss A2	Truss Type COMMON	Qty 5	Ply 1	Lot 122 Hidden Lakes Job Reference (optional)	153182511
-------------------	-------------	----------------------	----------	----------	--	-----------

Comtech, Inc. Fayetteville, NC - 28314.

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Jul 19 11:34:32 2022 Page 1

ID:9TsBS1yzEQof2XeoOILT12yyUuf-PADjNrr8BLSWgGUKfNWOSIQIHbMvrlvIT7AVFywWHb

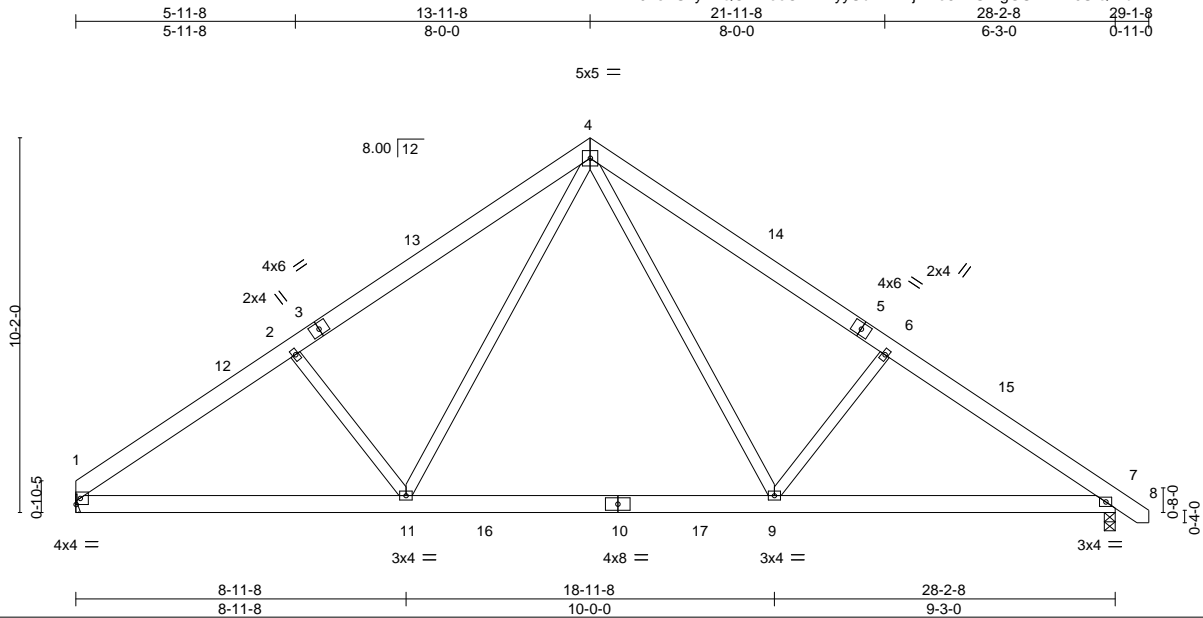

Scale = 1:58.9

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.26	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.45	Vert(LL) -0.18 9-11 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.45	Vert(CT) -0.24 9-11 >999 240		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.03 7 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.03 9-11 >999 240	Weight: 194 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.1
 BOT CHORD 2x6 SP No.1
 WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-7-11 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=Mechanical, 7=0-3-8
 Max Horz 1=316(LC 8)
 Max Uplift 1=188(LC 12), 7=210(LC 13)
 Max Grav 1=1191(LC 19), 7=1245(LC 20)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-2=-1763/627, 2-4=-1686/670, 4-6=-1707/662, 6-7=-1790/622
 BOT CHORD 1-11=-376/1589, 9-11=-46/995, 7-9=-383/1385
 WEBS 4-9=-222/800, 6-9=-568/395, 4-11=-218/771, 2-11=-533/388

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TC DL=6.0psf; BC DL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-0-12 to 4-5-9, Interior(1) 4-5-9 to 13-11-8, Exterior(2) 13-11-8 to 18-4-5, Interior(1) 18-4-5 to 28-11-9 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BC DL = 10.0psf.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=188, 7=210.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



July 20, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

Job J1122-5618	Truss B1	Truss Type COMMON	Qty 8	Ply 1	Lot 122 Hidden Lakes Job Reference (optional)	153182512
-------------------	-------------	----------------------	----------	----------	--	-----------

Comtech, Inc. Fayetteville, NC - 28314.

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Jul 19 11:34:33 2022 Page 1

ID:9TsBS1yzEQOf2XeoOILTl2yyUuf-tMn5aBsGvVTJ7qrhtMulZgISbhyQeGz2_7sj1hywWHa



4x6 =

Scale = 1:56.0

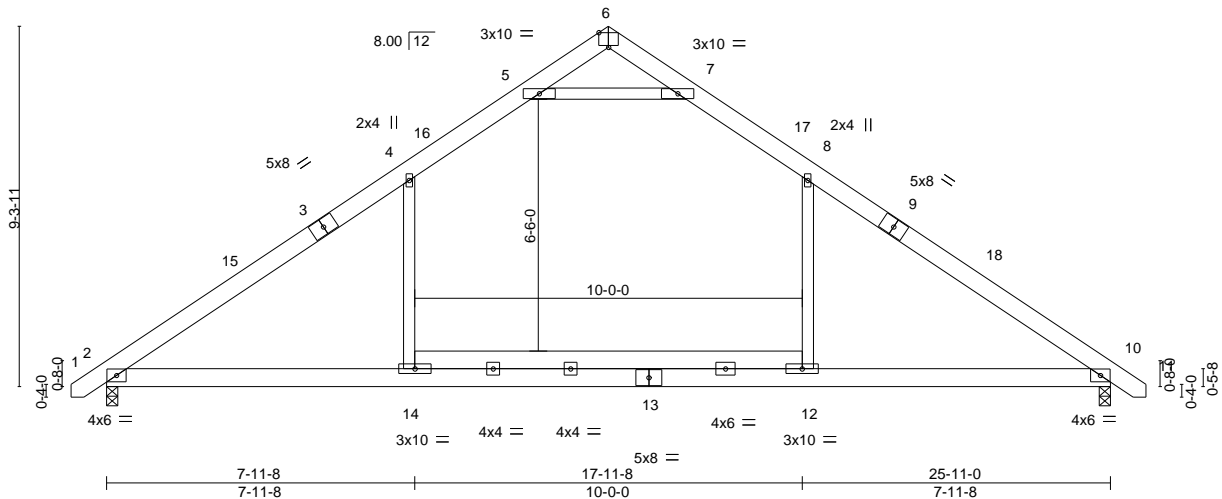


Plate Offsets (X,Y)-- [6:0-3-0,Edge]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.86	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.40	Vert(LL) -0.26 12-14 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.58	Vert(CT) -0.43 12-14 >722 240		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.03 10 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.26 2-14 >999 240	Weight: 183 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.1
 BOT CHORD 2x6 SP No.1
 WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-10-10 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 2=0-3-8, 10=0-3-8
 Max Horz 2=-292(LC 10)
 Max Uplift 2=-194(LC 12), 10=-194(LC 13)
 Max Grav 2=1255(LC 19), 10=1255(LC 20)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-4=-1689/451, 4-5=-1185/524, 5-6=-264/772, 6-7=-264/773, 7-8=-1184/524,
 8-10=-1690/451
 BOT CHORD 2-14=-161/1274, 12-14=-164/1275, 10-12=-161/1274
 WEBS 8-12=-6/553, 4-14=-4/551, 5-7=-2239/921

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-9-1 to 3-7-12, Interior(1) 3-7-12 to 12-11-8, Exterior(2) 12-11-8 to 17-4-5, Interior(1) 17-4-5 to 26-8-1 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=194, 10=194.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



July 20, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

Job J1122-5618	Truss B1GE	Truss Type GABLE	Qty 1	Ply 1	Lot 122 Hidden Lakes Job Reference (optional)	153182513
-------------------	---------------	---------------------	----------	----------	--	-----------

Comtech, Inc. Fayetteville, NC - 28314.


8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Jul 19 11:34:34 2022 Page 1

ID:9TSBS1yzEQOf2XeoOILT2yyUuf-LZLToXtugobAl_Qtr4P_5tqq05OKNq4CCncHZ7ywWHZ



5x5 =

Scale = 1:59.0

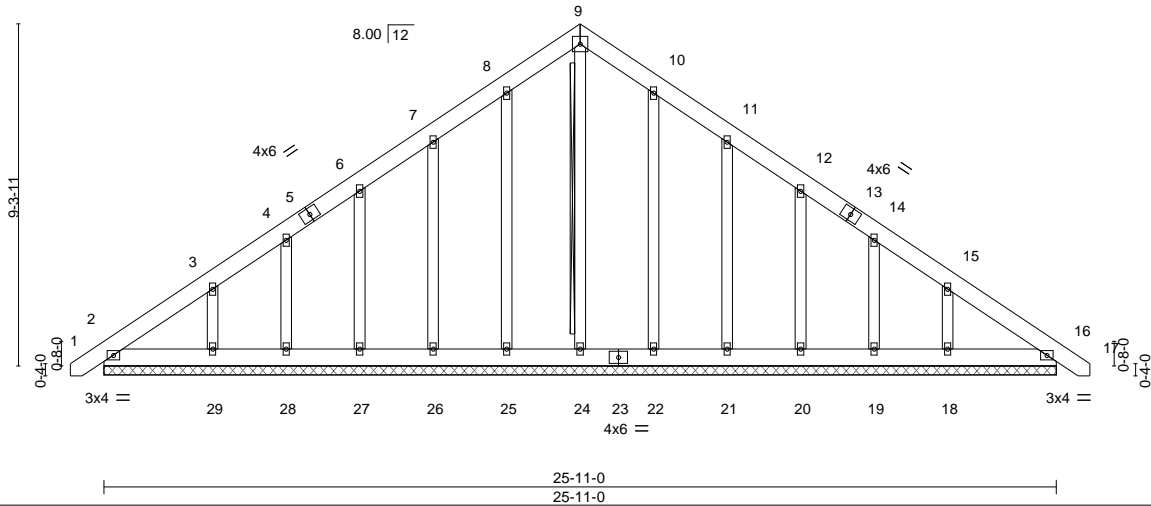

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.05	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.04	Vert(LL) 0.00 16 n/r 120		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.14	Vert(CT) 0.00 16 n/r 120		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.01 16 n/a n/a		
	Code IRC2015/TPI2014			Weight: 217 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.1
BOT CHORD 2x6 SP No.1
OTHERS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS T-Brace: 2x4 SPF No.2 - 9-24
Fasten (2X) T and I braces to narrow edge of web with 10d (0.131"x3") nails, 6in o.c., with 3in minimum end distance.
Brace must cover 90% of web length.

REACTIONS.

All bearings 25-11-0.
(lb) - Max Horz 2=365(LC 11)
Max Uplift All uplift 100 lb or less at joint(s) 2, 16, 22 except 25=101(LC 12), 26=145(LC 12), 27=134(LC 12), 28=114(LC 12), 29=209(LC 12), 21=149(LC 13), 20=134(LC 13), 19=114(LC 13), 18=205(LC 13)
Max Grav All reactions 250 lb or less at joint(s) 2, 16, 24, 25, 26, 27, 28, 22, 21, 20, 19 except 29=282(LC 19), 18=278(LC 20)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-340/270, 7-8=-218/269, 8-9=-273/310, 9-10=-273/310, 15-16=-257/175
BOT CHORD 2-29=-180/283, 28-29=-180/283, 27-28=-180/283, 26-27=-180/283, 25-26=-180/283, 24-25=-180/283, 22-24=-180/283, 21-22=-180/283, 20-21=-180/283, 19-20=-180/283, 18-19=-180/283, 16-18=-180/283
WEBS 3-29=-267/227, 15-18=-267/224

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 16, 22 except (jt=lb) 25=101, 26=145, 27=134, 28=114, 29=209, 21=149, 20=134, 19=114, 18=205.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Warning: Additional permanent and stability bracing for truss system (not part of this component design) is always required.



July 20, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932

Job J1122-5618	Truss B2	Truss Type COMMON	Qty 2	Ply 1	Lot 122 Hidden Lakes Job Reference (optional)	153182514
-------------------	-------------	----------------------	----------	----------	--	-----------

Comtech, Inc. Fayetteville, NC - 28314.

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Jul 19 11:34:35 2022 Page 1

ID:9TsBS1yzEQOf2XeoOILT2yyUuf-plvs?tuWR6j1N7?3?nwDe5NoyVes6AQLRRlQ6ayWHY
 17-11-8 5-0-0 7-11-8 25-11-0 26-10-0 0-11-0

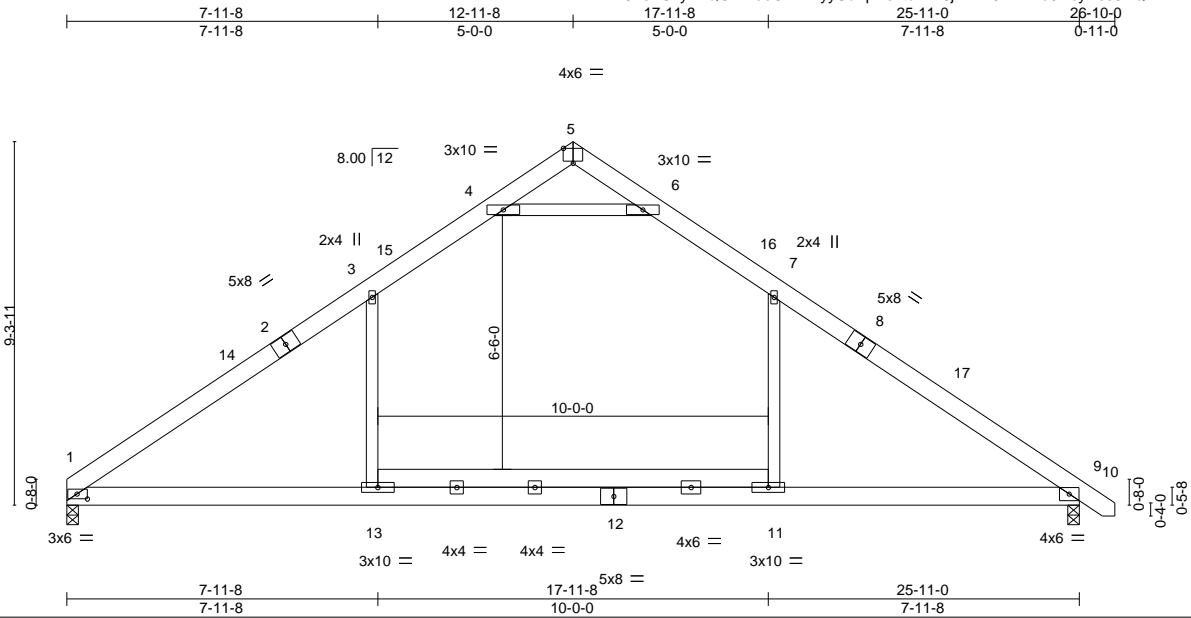

Scale = 1:55.5

Plate Offsets (X,Y)-- [1:0-3-3,0-1-8], [5:0-3-0,Edge]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.87	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.40	Vert(LL) -0.26 11-13 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.59	Vert(CT) -0.43 11-13 >715 240		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.03 9 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.26 1-13 >999 240	Weight: 181 lb	FT = 20%

LUMBER-
 TOP CHORD 2x6 SP No.1
 BOT CHORD 2x6 SP No.1
 WEBS 2x4 SP No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 4-9-8 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 1=0-3-8, 9=0-3-8
 Max Horz 1=288(LC 8)
 Max Uplift 1=173(LC 12), 9=194(LC 13)
 Max Grav 1=1202(LC 19), 9=1255(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-3=-1683/449, 3-4=-1187/531, 4-5=-267/777, 5-6=-279/778, 6-7=-1183/523, 7-9=-1692/452
 BOT CHORD 1-13=-168/1275, 11-13=-171/1276, 9-11=-168/1275
 WEBS 7-11=-6/557, 3-13=-5/539, 4-6=-2250/945

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TC DL=6.0psf; BC DL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-1-12 to 4-6-9, Interior(1) 4-6-9 to 12-11-8, Exterior(2) 12-11-8 to 17-4-5, Interior(1) 17-4-5 to 26-8-1 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=173, 9=194.
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



July 20,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601


818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 122 Hidden Lakes	153182515
J1122-5618	C1	ATTIC	3	1	Job Reference (optional)	

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Jul 19 11:34:36 2022 Page 1

ID:9TsBS1yzEQOf2XeoOILTiyUf-HxTECDv9CQRu_HaGZVRSAlwORuvrIrsVg45Ne0yWHX



Scale = 1:76.0

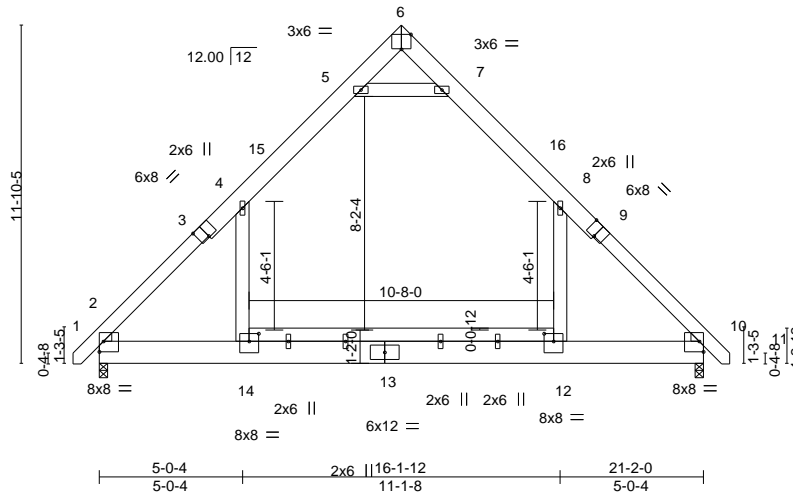


Plate Offsets (X,Y)-- [2:Edge,0-4-6], [3:0-4-0,Edge], [6:0-4-0,Edge], [9:0-4-0,Edge], [10:Edge,0-4-6], [12:0-4-0,0-3-4], [14:0-4-0,0-3-4]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.70	Vert(LL)	-0.20 12-14	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.67	Vert(CT)	-0.34 12-14	>726	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.13	Horz(CT)	0.01 10	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S	Wind(LL)	0.10 12-14	>999	240	Weight: 232 lb	FT = 20%

LUMBER-

TOP CHORD 2x8 SP No.1 *Except*
1-3,9-11: 2x6 SP No.1
BOT CHORD 2x10 SP No.1 *Except*
12-14: 2x6 SP No.1
WEBS 2x6 SP No.1
WEDGE
Left: 2x4 SP No.2, Right: 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-9-13 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 2=0-3-8, 10=0-3-8
Max Horz 2=359(LC 11)
Max Grav 2=1416(LC 20), 10=1416(LC 21)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-4=-1859/64, 4-5=-991/278, 5-6=-127/647, 6-7=-127/648, 7-8=-991/278,
8-10=-1859/64
BOT CHORD 2-14=0/1050, 12-14=0/1050, 10-12=0/1050
WEBS 8-12=0/904, 4-14=0/904, 5-7=-1886/542

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TCCL=6.0psf; BCCL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-9-6 to 3-7-7, Interior(1) 3-7-7 to 10-7-0, Exterior(2) 10-7-0 to 14-11-13, Interior(1) 14-11-13 to 21-11-6 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Ceiling dead load (10.0 psf) on member(s). 4-5, 7-8, 5-7; Wall dead load (5.0psf) on member(s). 8-12, 4-14
- Bottom chord live load (40.0 psf) and additional bottom chord dead load (10.0 psf) applied only to room. 12-14
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Attic room checked for L/360 deflection.



July 20,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932

Job J1122-5618	Truss C1GE	Truss Type GABLE	Qty 1	Ply 1	Lot 122 Hidden Lakes Job Reference (optional)	153182516
-------------------	---------------	---------------------	----------	----------	--	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Jul 19 11:34:37 2022 Page 1

ID:9TsBS1yzEQOf2XeoOIL12yyUuf-170cQZvzizlcR9S6CyhjWSAzIF9aC6evkqxASywwHHW



6x8 =

Scale = 1:70.7

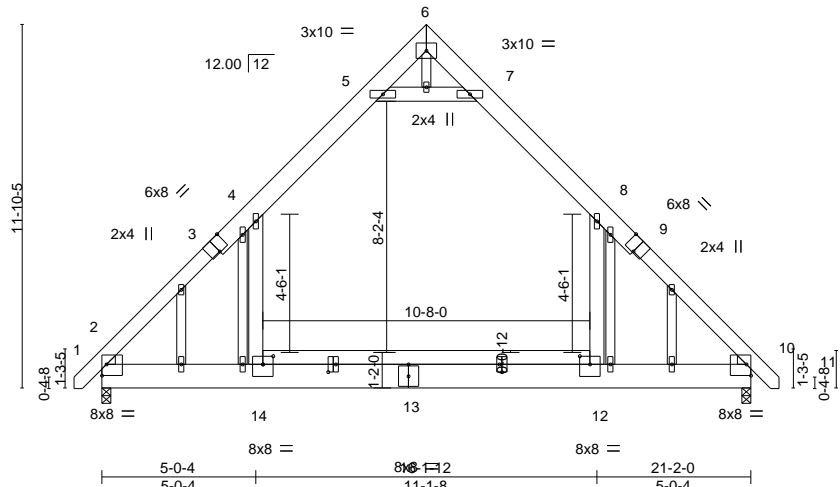


Plate Offsets (X,Y)-- [2:Edge,0-4-6], [3:0-4-0,Edge], [9:0-4-0,Edge], [10:Edge,0-4-6], [12:0-4-0,0-3-4], [13:0-3-0,2-1-8], [13:0-3-0,3-0-8], [14:0-4-0,0-3-4]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.71	Vert(LL)	-0.20	12-14	>999	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.67	Vert(CT)	-0.34	12-14	>726		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.13	Horz(CT)	0.01	10	n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S	Wind(LL)	0.14	12-14	>999	Weight: 254 lb	FT = 20%

LUMBER-

TOP CHORD 2x8 SP No.1 *Except*
1-3,9-11: 2x6 SP No.1
BOT CHORD 2x10 SP No.1 *Except*
12-14: 2x6 SP No.1
WEBS 2x6 SP No.1
OTHERS 2x4 SP No.2
WEDGE
Left: 2x4 SP No.2, Right: 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-9-13 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 2=0-3-8, 10=0-3-8
Max Horz 2=449(LC 11)
Max Uplift 2=-102(LC 12), 10=-102(LC 13)
Max Grav 2=1408(LC 20), 10=1408(LC 21)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-4=-1886/154, 4-5=-996/317, 5-6=-152/655, 6-7=-153/656, 7-8=-996/317,
8-10=-1885/153
BOT CHORD 2-14=0/1082, 12-14=0/1082, 10-12=0/1082
WEBS 8-12=-15/919, 4-14=-15/919, 5-7=-1886/683

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x6 MT20 unless otherwise indicated.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Ceiling dead load (10.0 psf) on member(s). 4-5, 7-8, 5-7; Wall dead load (5.0psf) on member(s).8-12, 4-14
- Bottom chord live load (40.0 psf) and additional bottom chord dead load (10.0 psf) applied only to room. 12-14
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=102, 10=102.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Attic room checked for L/360 deflection.



July 20,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932

Job J1122-5618	Truss C2	Truss Type ATTIC	Qty 4	Ply 1	Lot 122 Hidden Lakes Job Reference (optional)	153182517
-------------------	-------------	---------------------	----------	----------	--	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Jul 19 11:34:38 2022 Page 1
ID:9TsBS1yzEQOf2XeoOILTI2yyUuf-DKa_dwwPk15cEbkgewTwGj?M?ibJfNo7OaUiuywWHV



Scale = 1:76.0

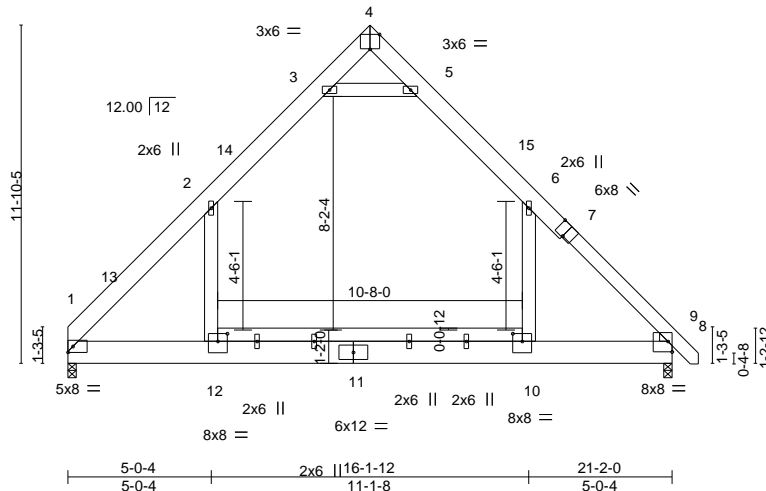


Plate Offsets (X,Y)-- [4:0-4-0,Edge], [7:0-4-0,Edge], [8:Edge,0-4-6], [10:0-4-0,0-3-4], [12:0-4-0,0-3-4]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.69	Vert(LL)	-0.20 10-12	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.67	Vert(CT)	-0.35 10-12	>715	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.12	Horz(CT)	0.01 8	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S	Wind(LL)	0.10 10-12	>999	240	Weight: 233 lb	FT = 20%

LUMBER-

TOP CHORD 2x8 SP No.1 *Except*
7-9: 2x6 SP No.1
BOT CHORD 2x10 SP No.1 *Except*
10-12: 2x6 SP No.1
WEBS 2x6 SP No.1
WEDGE
Right: 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-9-13 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=0-3-8, 8=0-3-8
Max Horz 1=357(LC 8)
Max Grav 1=1375(LC 21), 8=1416(LC 21)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=-1841/34, 2-3=-992/278, 3-4=-121/640, 4-5=-122/650, 5-6=-991/279, 6-8=-1855/61
BOT CHORD 1-12=0/1048, 10-12=0/1048, 8-10=0/1048
WEBS 6-10=0/902, 2-12=0/886, 3-5=-1870/542

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-1-12 to 4-6-9, Interior(1) 4-6-9 to 10-7-0, Exterior(2) 10-7-0 to 14-11-13, Interior(1) 14-11-13 to 21-11-6 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Ceiling dead load (10.0 psf) on member(s). 2-3, 5-6, 3-5; Wall dead load (5.0psf) on member(s). 6-10, 2-12
- Bottom chord live load (40.0 psf) and additional bottom chord dead load (10.0 psf) applied only to room. 10-12
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Attic room checked for L/360 deflection.



July 20, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932

Job J1122-5618	Truss C3	Truss Type ATTIC	Qty 1	Ply 1	Lot 122 Hidden Lakes Job Reference (optional)	153182518
-------------------	-------------	---------------------	----------	----------	--	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Jul 19 11:34:39 2022 Page 1

ID:9TsBS1yzEQOf2XeoOILT2yyUuf-hW8MrFx1VLDSrlqEd?9oxYV6xT25OxM2J2FLyWwHU



Scale = 1:76.0

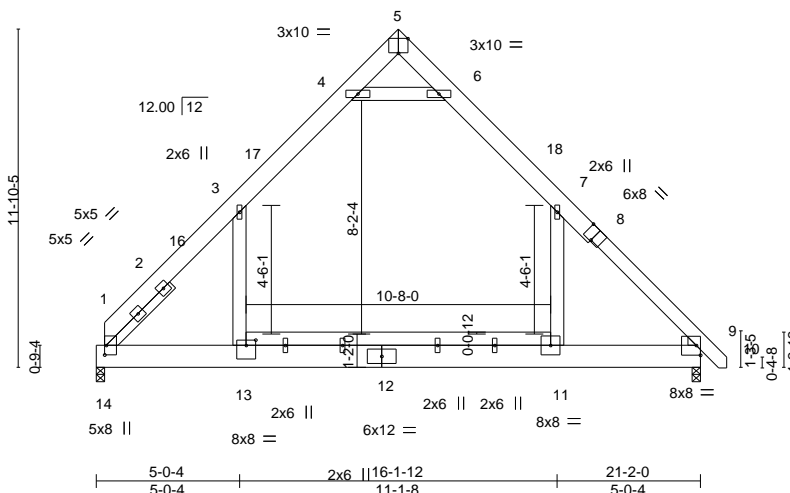


Plate Offsets (X,Y)-- [1:0-4-0,0-0-11], [5:0-4-0,Edge], [8:0-4-0,Edge], [9:Edge,0-4-2], [13:0-4-0,0-2-4]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.76	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.68	Vert(LL) -0.20 11-13 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.14	Vert(CT) -0.36 11-13 >700 240		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.01 9 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.11 11-13 >999 240	Weight: 236 lb	FT = 20%

LUMBER-

TOP CHORD 2x8 SP No.1 *Except*
8-10: 2x6 SP No.1
BOT CHORD 2x10 SP No.1 *Except*
11-13: 2x6 SP No.1
WEBS 2x6 SP No.1
WEDGE
Right: 2x4 SP No.3
SLIDER Left 2x4 SP No.2 3-1-11

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-11-6 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 14=0-3-8, 9=0-3-8
Max Horz 14=-360(LC 10)
Max Grav 14=1396(LC 21), 9=1401(LC 21)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-3=-1959/62, 3-4=-1007/279, 4-5=-126/683, 5-6=-120/668, 6-7=-1028/284,
7-9=-1776/66
BOT CHORD 1-14=-352/360, 1-13=0/1087, 11-13=0/1087, 9-11=0/1081
WEBS 7-11=0/783, 3-13=0/997, 4-6=-1935/548

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-3-8 to 4-8-5, Interior(1) 4-8-5 to 10-7-0, Exterior(2) 10-7-0 to 14-11-13, Interior(1) 14-11-13 to 21-11-6 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Ceiling dead load (10.0 psf) on member(s). 3-4, 6-7, 4-6; Wall dead load (5.0psf) on member(s). 7-11, 3-13
- Bottom chord live load (40.0 psf) and additional bottom chord dead load (10.0 psf) applied only to room. 11-13
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Attic room checked for L/360 deflection.



July 20, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 122 Hidden Lakes
J1122-5618	C3-GR	ATTIC	1	2	Job Reference (optional)

Comtech, Inc, Fayetteville, NC - 28314,

8.530 s Jan 6 2022 MiTek Industries, Inc. Wed Jul 20 11:48:24 2022 Page 1

ID:9TsBS1yzEQOf2XeoOILT2yyUuf-u?_XJ7LjXcLxWqpyE6hX99Q4tsdFhD91uzL8x4ywLXb

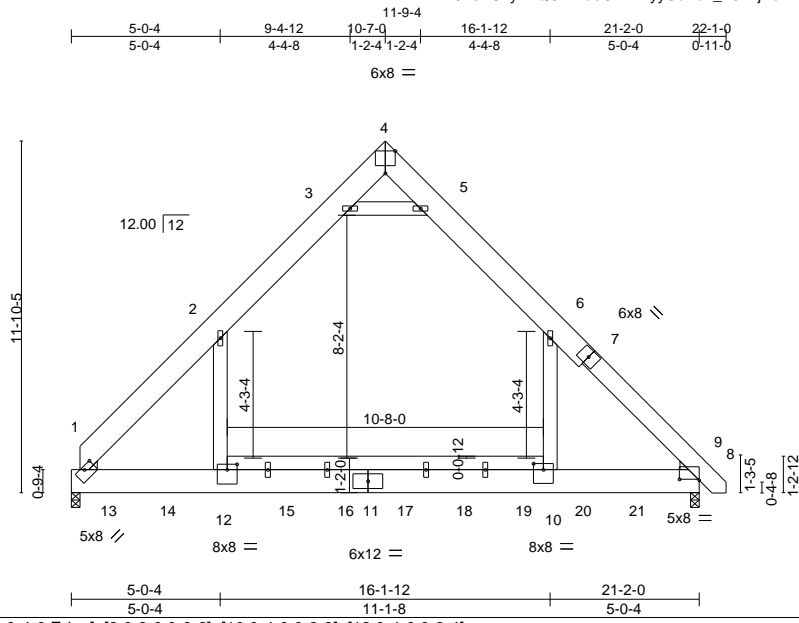


Plate Offsets (X,Y)-- [1:0-4-0,0-1-4], [4:0-4-0,Edge], [8:0-8-0,0-0-6], [10:0-4-0,0-2-8], [12:0-4-0,0-2-4]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.66	Vert(LL)	-0.17	10-12	>999	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.62	Vert(CT)	-0.24	10-12	>999		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.14	Horz(CT)	0.01	8	n/a		
BCDL 10.0	Rep Stress Incr NO	Matrix-S	Wind(LL)	0.03	10-12	>999		
	Code IRC2015/TPI2014						Weight: 512 lb	FT = 20%

LUMBER-
TOP CHORD 2x10 SP No.1 *Except*
7-9: 2x8 SP No.1
BOT CHORD 2x10 SP No.1 *Except*
10-12: 2x6 SP No.1
WEBS 2x6 SP No.1
WEDGE
Left: 2x4 SP No.2, Right: 2x4 SP No.2

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (lb/size) 1=1392/0-3-8, 8=1259/0-3-8
Max Horz 1=353(LC 4)
Max Grav 1=2374(LC 14), 8=2047(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=-2740/0, 2-3=-1280/139, 3-4=-66/1351, 4-5=-71/1291, 5-6=-1334/142, 6-7=-2579/0, 7-8=-2706/0
BOT CHORD 1-13=0/1474, 13-14=0/1474, 12-14=0/1474, 12-15=0/1490, 15-16=0/1490, 11-16=0/1490, 11-17=0/1490, 17-18=0/1490, 18-19=0/1490, 10-19=0/1490, 10-20=0/1475, 20-21=0/1475, 8-21=0/1475
WEBS 6-10=0/1930, 2-12=0/2079, 3-5=-3358/212

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x10 - 2 rows staggered at 0-9-0 oc, 2x8 - 2 rows staggered at 0-9-0 oc.
Bottom chords connected as follows: 2x10 - 2 rows staggered at 0-9-0 oc.
Webs connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); Lumber DOL=1.60 plate grip DOL=1.60
 - All plates are 2x6 MT20 unless otherwise indicated.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Ceiling dead load (10.0 psf) on member(s). 2-3, 5-6, 3-5; Wall dead load (5.0psf) on member(s).6-10, 2-12
 - Bottom chord live load (40.0 psf) and additional bottom chord dead load (10.0 psf) applied only to room. 10-12
 - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



July 20,2022

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



Job J1122-5618	Truss C3-GR	Truss Type ATTIC	Qty 1	Ply 2	Lot 122 Hidden Lakes Job Reference (optional)
-------------------	----------------	---------------------	----------	-----------------	--

Lezzer Truss, Curwensville, Pa. 16833

8.530 s Jan 6 2022 MiTek Industries, Inc. Wed Jul 20 11:48:25 2022 Page 2

ID:9TsBS1yzEQOf2XeoOILT12yyUuf-MBXwXTMLlwTo7zO8oqCmhNzFzUQgOA7d5iUXywlXa

NOTES-

11) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 320 lb down at 1-1-12, 320 lb down at 5-1-12, 320 lb down at 7-1-12, 320 lb down at 9-1-12, 139 lb down and 99 lb up at 11-1-12, 139 lb down and 99 lb up at 13-1-12, 139 lb down and 99 lb up at 15-1-12, 139 lb down and 99 lb up at 17-1-12, and 139 lb down and 99 lb up at 18-11-12, and 132 lb down and 18 lb up at 3-1-12 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

12) Attic room checked for L/360 deflection.

LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-2=-60, 2-3=-80, 3-4=-60, 4-5=-60, 5-6=-80, 6-9=-60, 1-12=-20, 10-12=-40, 8-10=-20, 3-5=-20

Drag: 6-10=-10, 2-12=-10

Concentrated Loads (lb)

Vert: 12=-73(B) 13=-73(B) 14=-73(B) 15=-73(B) 16=-73(B) 17=-3(B) 18=-3(B) 19=-3(B) 20=-3(B) 21=-3(B)

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932

Job J1122-5618	Truss D1-GR	Truss Type Common Girder	Qty 1	Ply 2	Lot 122 Hidden Lakes Job Reference (optional)	153182520
-------------------	----------------	-----------------------------	----------	----------	--	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Jul 19 11:34:42 2022 Page 1
ID:9TsBS1yzEQOf2XeoOILTI2yyUuf-65qVTGzvoGb1jC1PvYsQZA6oJyhFO1N20YirgyWHR

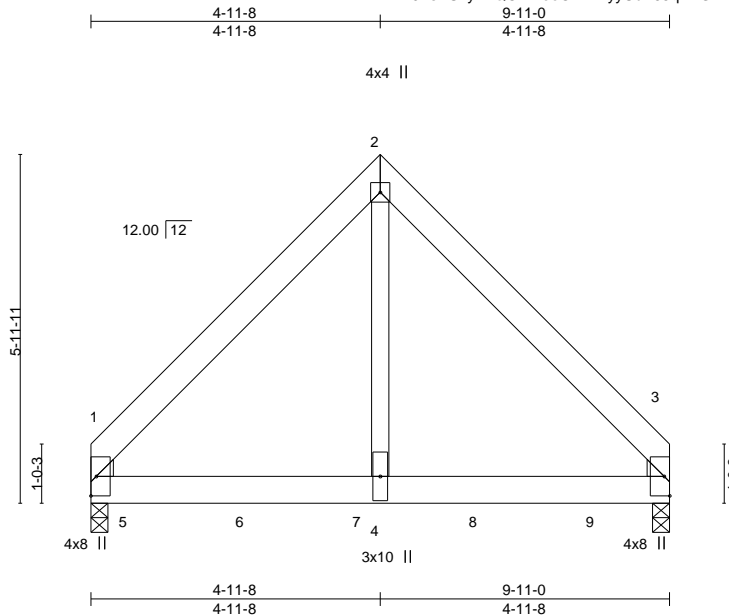

Scale = 1:37.1

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.38	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.65	Vert(LL) -0.03 3-4 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.40	Vert(CT) -0.06 3-4 >999 240		
BCDL 10.0	Rep Stress Incr NO	Matrix-S	Horz(CT) 0.01 3 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.03 3-4 >999 240	Weight: 132 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.1
BOT CHORD 2x6 SP No.1
WEBS 2x4 SP No.2
WEDGE

Left: 2x4 SP No.2 , Right: 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=0-3-8, 3=0-3-8
Max Horz 1=173(LC 25)
Max Uplift 1=590(LC 9), 3=528(LC 8)
Max Grav 1=3316(LC 1), 3=2955(LC 1)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=-2510/495, 2-3=-2509/495
BOT CHORD 1-4=-291/1646, 3-4=-291/1646
WEBS 2-4=-534/3269

NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-7-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TC DL=6.0psf; BC DL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=590, 3=528.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 1104 lb down and 203 lb up at 0-7-12, 1099 lb down and 208 lb up at 2-7-12, 1099 lb down and 208 lb up at 4-7-12, and 1099 lb down and 208 lb up at 6-7-12, and 1099 lb down and 208 lb up at 8-7-12 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.



July 20,2022

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 122 Hidden Lakes	I53182520
J1122-5618	D1-GR	Common Girder	1	2	Job Reference (optional)	

Comtech, Inc, Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Jul 19 11:34:42 2022 Page 2
 ID:9TsBS1yzEQOf2XeoOILTl2yyUuf-65qVTGzvoGb1jC1PvYsQZA6oJyhFO1N20YirgywWHR

LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-2=-60, 2-3=-60, 1-3=-20

Concentrated Loads (lb)

Vert: 5=-1104(B) 6=-1099(B) 7=-1099(B) 8=-1099(B) 9=-1099(B)

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932


Job J1122-5618	Truss D1GE	Truss Type COMMON SUPPORTED GAB	Qty 1	Ply 1	Lot 122 Hidden Lakes Job Reference (optional)	153182521
-------------------	---------------	------------------------------------	----------	----------	--	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Jul 19 11:34:41 2022 Page 1
ID:9T5BS1yzEQof2XeoOILT2yyUuf-evG7GwyH1yTA52SDL21dtMd0WvnBW1BEpMo8JDyyWHS



Scale = 1:37.0

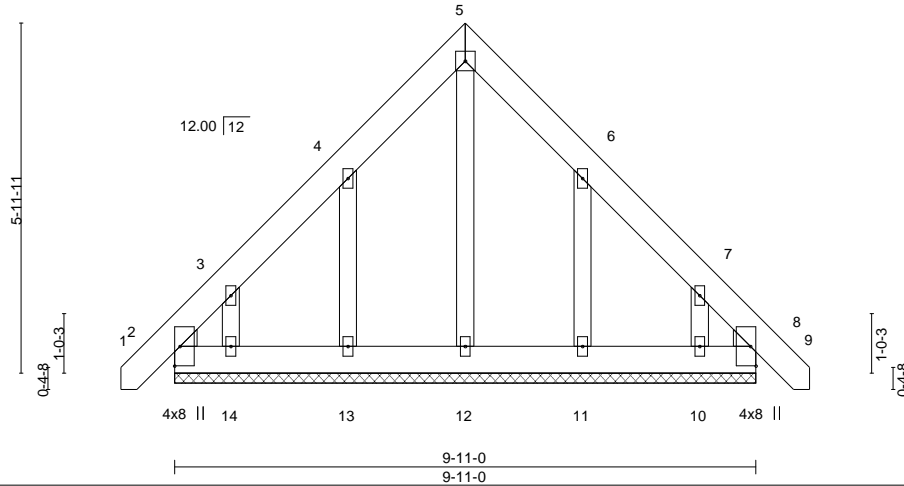

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.03	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.02	Vert(LL) -0.00 8 n/r 120		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.06	Vert(CT) -0.00 8 n/r 120		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.00 8 n/a n/a		
	Code IRC2015/TPI2014			Weight: 83 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.1
BOT CHORD 2x6 SP No.1
OTHERS 2x4 SP No.2
WEDGE

Left: 2x4 SP No.2 , Right: 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

All bearings 9-11-0.
(lb) - Max Horz 2=229(LC 10)
Max Uplift All uplift 100 lb or less at joint(s) 8 except 2=-109(LC 8), 13=-201(LC 12), 14=-243(LC 12),
11=-197(LC 13), 10=-236(LC 13)
Max Grav All reactions 250 lb or less at joint(s) 2, 8, 12, 13, 14, 11, 10

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-286/183, 7-8=-253/163

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 8 except (jt=lb) 2=109, 13=201, 14=243, 11=197, 10=236.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



July 20,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601





818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 122 Hidden Lakes	I53182522
J1122-5618	M1	MONOPITCH	2	1	Job Reference (optional)	

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Jul 19 11:34:43 2022 Page 1

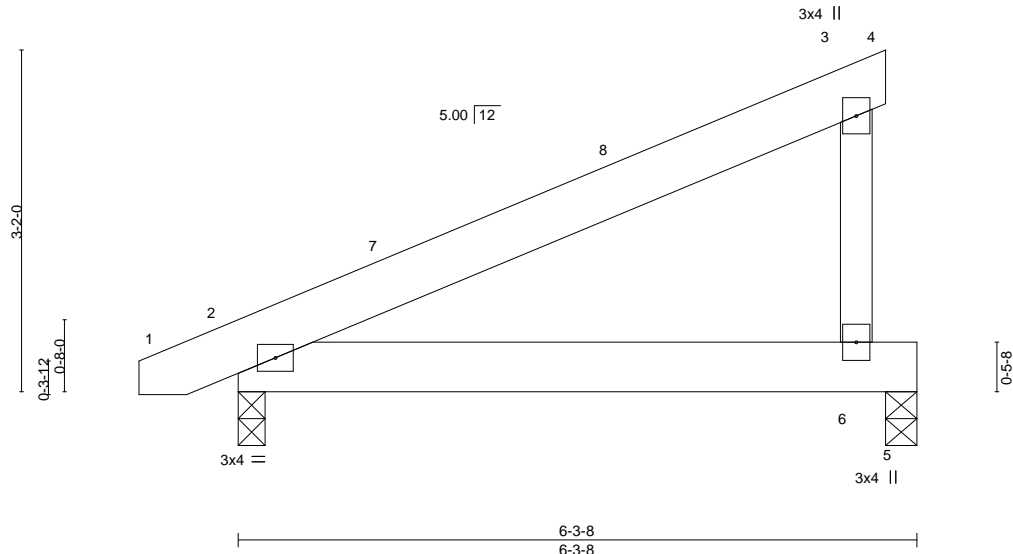

Scale = 1:20.1

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.21	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.24	Vert(LL) 0.06 2-6 >999 240		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.00	Vert(CT) -0.04 2-6 >999 240		
BCDL 10.0	Rep Stress Incr YES	Matrix-P	Horz(CT) 0.00 n/a n/a		
	Code IRC2015/TPI2014			Weight: 36 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.1
 BOT CHORD 2x6 SP No.1
 WEBS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 2=0-3-0, 5=0-3-8
 Max Horz 2=119(LC 12)
 Max Uplift 2=129(LC 8), 5=124(LC 8)
 Max Grav 2=293(LC 1), 5=219(LC 1)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 3-6=-179/291

NOTES-

- 1) Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-8-6 to 3-8-7, Interior(1) 3-8-7 to 6-0-0 zone; porch left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=129, 5=124.
- 5) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



July 20, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932


Job J1122-5618	Truss M1GE	Truss Type MONOPITCH SUPPORTED	Qty 1	Ply 1	Lot 122 Hidden Lakes Job Reference (optional)	153182523
-------------------	---------------	-----------------------------------	----------	----------	--	-----------

Comtech, Inc., Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Jul 19 11:34:44 2022 Page 1
ID:9TsBS1yzEQOf2XeoOILT2yyUuf-2UxFuy?AJtrlyWBo1AaKV_FXz7o3jNAgWK1pwYyWHP



Scale = 1:19.7

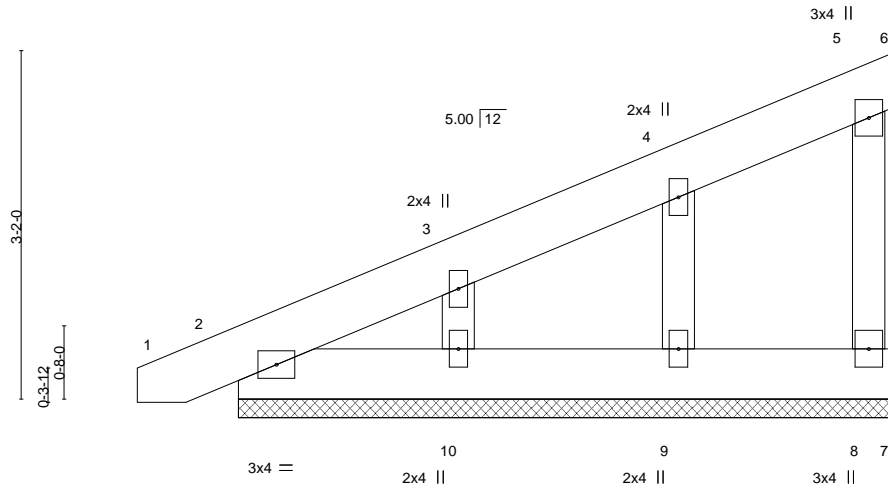

LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.02	Vert(LL) 0.00 5 n/r 120	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.01	Vert(CT) 0.00 5 n/r 120		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.04	Horz(CT) 0.00 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-P		Weight: 38 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.1
BOT CHORD 2x6 SP No.1
WEBS 2x4 SP No.2
OTHERS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

All bearings 6-0-0.
(lb) - Max Horz 2=172(LC 12)
Max Uplift All uplift 100 lb or less at joint(s) 8, 2, 9 except 10=120(LC 12)
Max Grav All reactions 250 lb or less at joint(s) 8, 2, 9, 10

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TCCL=6.0psf; BCCL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; porch left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) Gable requires continuous bottom chord bearing.
- 4) Gable studs spaced at 2-0-0 oc.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 8, 2, 9 except (jt=lb) 10=120.
- 8) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



July 20, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932

Job J1122-5618	Truss M2	Truss Type ROOF SPECIAL	Qty 4	Ply 1	Lot 122 Hidden Lakes Job Reference (optional)	153182524
-------------------	-------------	----------------------------	----------	----------	--	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Jul 19 11:34:44 2022 Page 1

ID:9TsBS1yzEQOf2XeoOILTI2yyUuf-2UxUFuy?AJrlyWBo1AaKv_FTY7irjNcgWK1pwYyWHP

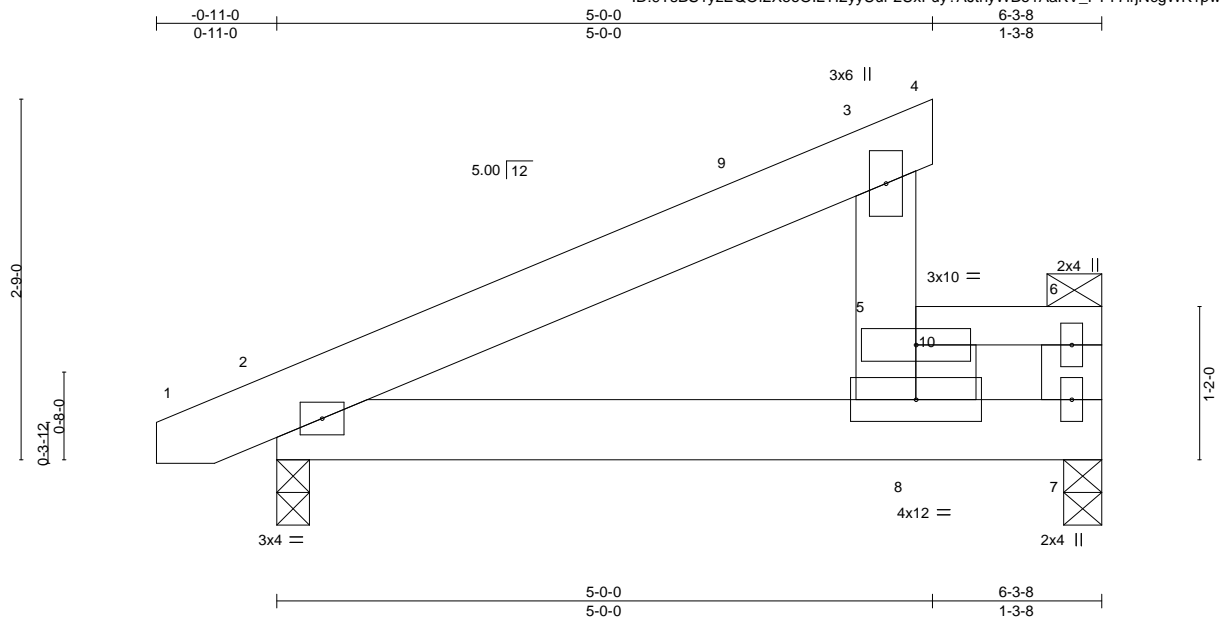

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.30	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.41	Vert(LL) -0.01 8 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.01	Vert(CT) -0.02 2-8 >999 240		
BCDL 10.0	Rep Stress Incr NO	Matrix-S	Horz(CT) 0.00 7 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.02 2-8 >999 240	Weight: 38 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.1 *Except*
5-6: 2x4 SP No.1
BOT CHORD 2x6 SP No.1
WEBS 2x6 SP No.1

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins: 5-8, 5-6. Except: 6-0-0 oc bracing: 3-5
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 2=0-3-0, 7=0-3-8
Max Horz 2=101(LC 12)
Max Uplift 2=-75(LC 8)
Max Grav 2=349(LC 1), 7=627(LC 2)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-377/187, 5-8=-460/11
BOT CHORD 2-8=-284/316

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); porch left exposed; Lumber DOL=1.60 plate grip DOL=1.60
- C-C wind load user defined.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Load case(s) 1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 14, 15, 16, 17, 18, 19, 20, 21, 22, 23, 24, 25, 26 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s). The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S)

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-3=-60, 3-4=-60, 2-7=-20, 5-10=-20, 6-10=-60
Concentrated Loads (lb)
Vert: 10=-345(F)



July 20, 2022

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 122 Hidden Lakes	I53182524
J1122-5618	M2	ROOF SPECIAL	4	1	Job Reference (optional)	

Comtech, Inc. Fayetteville, NC - 28314.

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Jul 19 11:34:44 2022 Page 2
ID:9TsBS1yzEQOf2XeoOILTI2yyUuf-2UxFuy?AJtrlyWBo1AaKV_FTytirjNcgWK1pwYyWHP

LOAD CASE(S)

- 2) Dead + 0.75 Roof Live (balanced) + 0.75 Attic Floor: Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-3=-50, 3-4=-50, 2-7=-20, 5-10=-20, 6-10=-50
Concentrated Loads (lb)
Vert: 10=-503(F)
- 3) Dead + Uninhabitable Attic Without Storage: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-3=-20, 3-4=-20, 2-7=-40, 5-6=-20
Concentrated Loads (lb)
Vert: 10=-345(F)
- 4) Dead + 0.6 C-C Wind (Pos. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=98, 2-9=82, 3-9=42, 3-4=207, 2-7=73, 5-6=47
Horz: 1-2=-110, 2-9=-94, 3-9=-54, 3-4=-219
Concentrated Loads (lb)
Vert: 10=-345(F)
- 5) Dead + 0.6 C-C Wind (Pos. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=73, 2-3=82, 3-4=73, 2-7=73, 5-6=87
Horz: 1-2=-85, 2-3=-94, 3-4=-85
Concentrated Loads (lb)
Vert: 10=-345(F)
- 6) Dead + 0.6 C-C Wind (Neg. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=5, 2-3=-54, 3-4=30, 2-7=-5, 5-6=-44
Horz: 1-2=-25, 2-3=34, 3-4=-50
Concentrated Loads (lb)
Vert: 10=-345(F)
- 7) Dead + 0.6 C-C Wind (Neg. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-45, 2-3=-54, 3-4=-45, 2-7=-5, 5-6=-44
Horz: 1-2=25, 2-3=34, 3-4=25
Concentrated Loads (lb)
Vert: 10=-345(F)
- 8) Dead + 0.6 MWFRS Wind (Pos. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=40, 2-3=20, 3-4=11, 2-7=18, 5-6=15
Horz: 1-2=-52, 2-3=-32, 3-4=-23
Concentrated Loads (lb)
Vert: 10=-345(F)
- 9) Dead + 0.6 MWFRS Wind (Pos. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=11, 2-3=20, 3-4=41, 2-7=-12, 5-6=31
Horz: 1-2=-23, 2-3=-32, 3-4=-53
Concentrated Loads (lb)
Vert: 10=-345(F)
- 10) Dead + 0.6 MWFRS Wind (Neg. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=3, 2-3=-6, 3-4=3, 2-7=10, 5-6=-11
Horz: 1-2=-23, 2-3=-14, 3-4=-23
Concentrated Loads (lb)
Vert: 10=-345(F)
- 11) Dead + 0.6 MWFRS Wind (Neg. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=3, 2-3=-6, 3-4=3, 2-7=-20, 5-6=5
Horz: 1-2=-23, 2-3=-14, 3-4=-23
Concentrated Loads (lb)
Vert: 10=-345(F)
- 12) Dead + 0.6 MWFRS Wind (Pos. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=22, 2-3=31, 3-4=22, 2-7=-12, 5-6=15
Horz: 1-2=-34, 2-3=-43, 3-4=-34
Concentrated Loads (lb)
Vert: 10=-345(F)
- 13) Dead + 0.6 MWFRS Wind (Pos. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=6, 2-3=15, 3-4=6, 2-7=-12, 5-6=31
Horz: 1-2=-18, 2-3=-27, 3-4=-18
Concentrated Loads (lb)
Vert: 10=-345(F)
- 14) Dead + 0.6 MWFRS Wind (Pos. Internal) 3rd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=22, 2-3=31, 3-4=22, 2-7=-12, 5-6=15
Horz: 1-2=-34, 2-3=-43, 3-4=-34
Concentrated Loads (lb)
Vert: 10=-345(F)

Continued on page 3

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 122 Hidden Lakes	153182524
J1122-5618	M2	ROOF SPECIAL	4	1	Job Reference (optional)	

Comtech, Inc, Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Jul 19 11:34:44 2022 Page 3
ID:9TsBS1yzEQOf2XeoOILTI2yyUuf-2UxFuy?AJrlyWBo1AaKV_FTY7irjNcgWK1pwYywWHP

LOAD CASE(S)

- 15) Dead + 0.6 MWFRS Wind (Pos. Internal) 4th Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=6, 2-3=15, 3-4=6, 2-7=-12, 5-6=31
Horz: 1-2=-18, 2-3=-27, 3-4=-18
Concentrated Loads (lb)
Vert: 10=-345(F)
- 16) Dead + 0.6 MWFRS Wind (Neg. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=14, 2-3=5, 3-4=14, 2-7=-20, 5-6=-11
Horz: 1-2=-34, 2-3=-25, 3-4=-34
Concentrated Loads (lb)
Vert: 10=-345(F)
- 17) Dead + 0.6 MWFRS Wind (Neg. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-2, 2-3=-11, 3-4=-2, 2-7=-20, 5-6=5
Horz: 1-2=-18, 2-3=-9, 3-4=-18
Concentrated Loads (lb)
Vert: 10=-345(F)
- 18) Dead: Lumber Increase=0.90, Plate Increase=0.90 Plt. metal=0.90
Uniform Loads (plf)
Vert: 1-3=-20, 3-4=-20, 2-7=-20, 5-6=-20
Concentrated Loads (lb)
Vert: 10=-450(F)
- 19) Dead + 0.75 Roof Live (bal.) + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) Left): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-33, 2-3=-40, 3-4=-33, 2-7=2, 5-10=-13, 6-10=-43
Horz: 1-2=-17, 2-3=-10, 3-4=-17
Concentrated Loads (lb)
Vert: 10=-503(F)
- 20) Dead + 0.75 Roof Live (bal.) + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) Right): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-33, 2-3=-39, 3-4=-33, 2-7=-20, 5-10=-1, 6-10=-31
Horz: 1-2=-17, 2-3=-11, 3-4=-17
Concentrated Loads (lb)
Vert: 10=-503(F)
- 21) Dead + 0.75 Roof Live (bal.) + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-24, 2-3=-31, 3-4=-24, 2-7=-20, 5-10=-13, 6-10=-43
Horz: 1-2=-26, 2-3=-19, 3-4=-26
Concentrated Loads (lb)
Vert: 10=-503(F)
- 22) Dead + 0.75 Roof Live (bal.) + 0.75 Attic Floor + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-36, 2-3=-43, 3-4=-36, 2-7=-20, 5-10=-1, 6-10=-31
Horz: 1-2=-14, 2-3=-7, 3-4=-14
Concentrated Loads (lb)
Vert: 10=-503(F)
- 23) 1st Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-3=-60, 3-4=-60, 2-7=-20, 5-6=-20
Concentrated Loads (lb)
Vert: 10=-345(F)
- 24) 2nd Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-3=-20, 3-4=-20, 2-7=-20, 5-10=-20, 6-10=-60
Concentrated Loads (lb)
Vert: 10=-345(F)
- 25) 3rd Dead + 0.75 Roof Live (unbalanced) + 0.75 Attic Floor: Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-3=-50, 3-4=-50, 2-7=-20, 5-6=-20
Concentrated Loads (lb)
Vert: 10=-503(F)
- 26) 4th Dead + 0.75 Roof Live (unbalanced) + 0.75 Attic Floor: Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-3=-20, 3-4=-20, 2-7=-20, 5-10=-20, 6-10=-50
Concentrated Loads (lb)
Vert: 10=-503(F)

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932

Job J1122-5618	Truss M2-GR	Truss Type ROOF SPECIAL	Qty 2	Ply 2	Lot 122 Hidden Lakes Job Reference (optional)	153182525
-------------------	----------------	----------------------------	----------	----------	--	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Jul 19 11:34:45 2022 Page 1

ID:9TsBS1yzEQOf2XeoOILTl2yyUuf-WgVe5l0o4B_cagn_au5Z2BnhyX7kSprpk_mMS_ywWHO

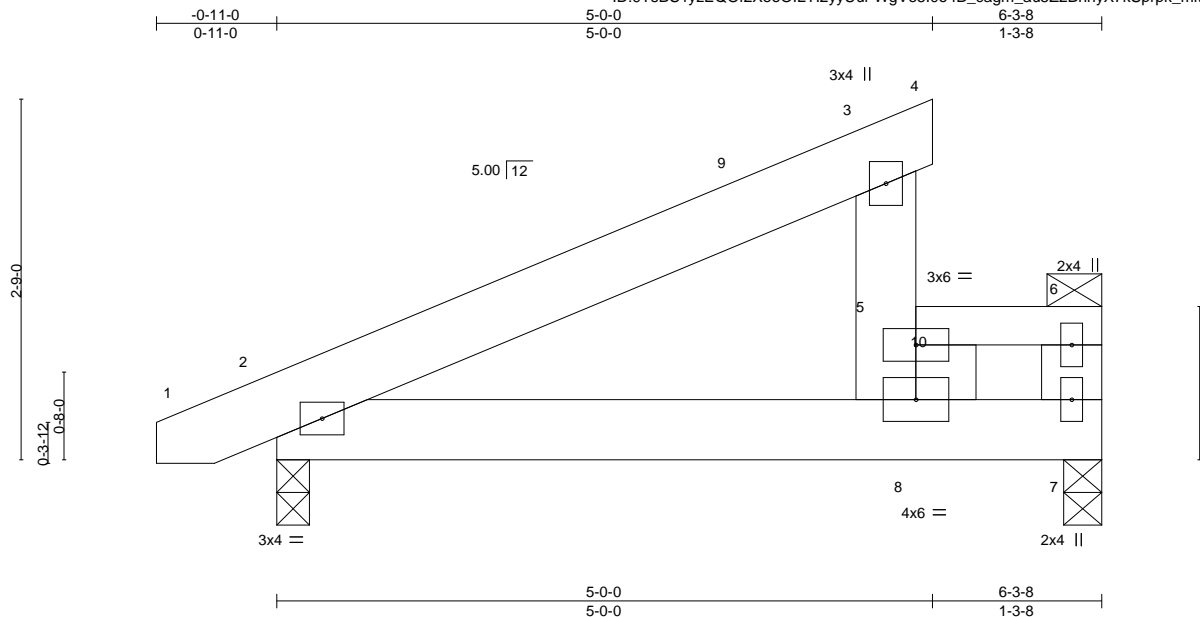

Scale = 1:16.5

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.07	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.11	Vert(LL) -0.00 2-8 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.08	Vert(CT) -0.01 2-8 >999 240		
BCDL 10.0	Rep Stress Incr NO	Matrix-S	Horz(CT) 0.00 7 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.00 8 >999 240	Weight: 76 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.1 *Except*
5-6: 2x4 SP No.1
BOT CHORD 2x6 SP No.1
WEBS 2x6 SP No.1

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins: 5-8, 5-6. Except: 6-0-0 oc bracing: 3-5
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 2=0-3-0, 7=0-3-8
Max Horz 2=101(LC 12)
Max Uplift 2=38(LC 12)
Max Grav 2=312(LC 1), 7=1947(LC 18)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-287/64
WEBS 6-7=-1776/0

NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc, 2x4 - 2 rows staggered at 0-2-0 oc.
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
Webs connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TCCL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-8-6 to 3-8-7, Interior(1) 3-8-7 to 6-0-12 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Load case(s) 1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 14, 15, 16, 17, 18, 19, 20, 21, 22, 23, 24, 25, 26 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s). The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard Except:



July 20,2022

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 122 Hidden Lakes
J1122-5618	M2-GR	ROOF SPECIAL	2	2	153182525
					Job Reference (optional)

Comtech, Inc. Fayetteville, NC - 28314.

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Jul 19 11:34:45 2022 Page 2
ID:9TsBS1yzEQOf2XeoOILTl2yyUuf-WgVe5l0o4B_cagm_au5Z2BnhyX7kSprk_mMS_ywWHO

LOAD CASE(S) Standard Except:

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-3=-60, 3-4=-60, 2-7=-20, 5-10=-140(F=-120), 6-10=-180(F=-120)
- 2) Dead + 0.75 Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-3=-50, 3-4=-50, 2-7=-20, 5-10=-140(F=-120), 6-10=-170(F=-120)
Concentrated Loads (lb)
Vert: 6=-1256(F)
- 3) Dead + Uninhabitable Attic Without Storage: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-3=-20, 3-4=-20, 2-7=-40, 5-6=-140(F=-120)
- 4) Dead + 0.6 C-C Wind (Pos. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=98, 2-9=82, 3-9=42, 3-4=207, 2-7=-12, 5-6=-73(F=-120)
Horz: 1-2=-110, 2-9=-94, 3-9=-54, 3-4=-219
- 5) Dead + 0.6 C-C Wind (Pos. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=73, 2-3=82, 3-4=73, 2-7=-12, 5-6=-33(F=-120)
Horz: 1-2=-85, 2-3=-94, 3-4=-85
- 6) Dead + 0.6 C-C Wind (Neg. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=5, 2-3=-54, 3-4=30, 2-7=-20, 5-6=-164(F=-120)
Horz: 1-2=-25, 2-3=34, 3-4=-50
- 7) Dead + 0.6 C-C Wind (Neg. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-45, 2-3=-54, 3-4=-45, 2-7=-20, 5-6=-164(F=-120)
Horz: 1-2=25, 2-3=34, 3-4=25
- 8) Dead + 0.6 MWFRS Wind (Pos. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=40, 2-3=20, 3-4=11, 2-7=-12, 5-6=-105(F=-120)
Horz: 1-2=-52, 2-3=-32, 3-4=-23
- 9) Dead + 0.6 MWFRS Wind (Pos. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=11, 2-3=20, 3-4=41, 2-7=-12, 5-6=-89(F=-120)
Horz: 1-2=-23, 2-3=-32, 3-4=-53
- 10) Dead + 0.6 MWFRS Wind (Neg. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=3, 2-3=-6, 3-4=3, 2-7=-20, 5-6=-131(F=-120)
Horz: 1-2=-23, 2-3=-14, 3-4=-23
- 11) Dead + 0.6 MWFRS Wind (Neg. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=3, 2-3=-6, 3-4=3, 2-7=-20, 5-6=-115(F=-120)
Horz: 1-2=-23, 2-3=-14, 3-4=-23
- 12) Dead + 0.6 MWFRS Wind (Pos. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=22, 2-3=31, 3-4=22, 2-7=-12, 5-6=-105(F=-120)
Horz: 1-2=-34, 2-3=-43, 3-4=-34
- 13) Dead + 0.6 MWFRS Wind (Pos. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=6, 2-3=15, 3-4=6, 2-7=-12, 5-6=-89(F=-120)
Horz: 1-2=-18, 2-3=-27, 3-4=-18
- 14) Dead + 0.6 MWFRS Wind (Pos. Internal) 3rd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=22, 2-3=31, 3-4=22, 2-7=-12, 5-6=-105(F=-120)
Horz: 1-2=-34, 2-3=-43, 3-4=-34
- 15) Dead + 0.6 MWFRS Wind (Pos. Internal) 4th Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=6, 2-3=15, 3-4=6, 2-7=-12, 5-6=-89(F=-120)
Horz: 1-2=-18, 2-3=-27, 3-4=-18
- 16) Dead + 0.6 MWFRS Wind (Neg. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=14, 2-3=5, 3-4=14, 2-7=-20, 5-6=-131(F=-120)
Horz: 1-2=-34, 2-3=-25, 3-4=-34
- 17) Dead + 0.6 MWFRS Wind (Neg. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-2, 2-3=-11, 3-4=-2, 2-7=-20, 5-6=-115(F=-120)
Horz: 1-2=-18, 2-3=-9, 3-4=-18
- 18) Dead: Lumber Increase=0.90, Plate Increase=0.90 Plt. metal=0.90
Uniform Loads (plf)
Vert: 1-3=-20, 3-4=-20, 2-7=-20, 5-6=-140(F=-120)
Concentrated Loads (lb)
Vert: 6=-1674(F)
- 19) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) Left): Lumber Increase=1.60, Plate Increase=1.60

Continued on page 3

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 122 Hidden Lakes
J1122-5618	M2-GR	ROOF SPECIAL	2	2	I53182525
					Job Reference (optional)

Comtech, Inc, Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Jul 19 11:34:45 2022 Page 3
ID:9TsBS1yzEQOf2XeoOILTl2yyUuf-WgVe5l0o4B_cagm_au5Z2BnhYX7kSprk_mMS_ywWHO

LOAD CASE(S) Standard Except:

- Uniform Loads (plf)
 - Vert: 1-2=-33, 2-3=-40, 3-4=-33, 2-7=-20, 5-10=-133(F=-120), 6-10=-163(F=-120)
 - Horz: 1-2=-17, 2-3=-10, 3-4=-17
- Concentrated Loads (lb)
 - Vert: 6=-1256(F)
- 20) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) Right): Lumber Increase=1.60, Plate Increase=1.60
 - Uniform Loads (plf)
 - Vert: 1-2=-33, 2-3=-39, 3-4=-33, 2-7=-20, 5-10=-121(F=-120), 6-10=-151(F=-120)
 - Horz: 1-2=-17, 2-3=-11, 3-4=-17
 - Concentrated Loads (lb)
 - Vert: 6=-1256(F)
- 21) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60
 - Uniform Loads (plf)
 - Vert: 1-2=-24, 2-3=-31, 3-4=-24, 2-7=-20, 5-10=-133(F=-120), 6-10=-163(F=-120)
 - Horz: 1-2=-26, 2-3=-19, 3-4=-26
 - Concentrated Loads (lb)
 - Vert: 6=-1256(F)
- 22) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60
 - Uniform Loads (plf)
 - Vert: 1-2=-36, 2-3=-43, 3-4=-36, 2-7=-20, 5-10=-121(F=-120), 6-10=-151(F=-120)
 - Horz: 1-2=-14, 2-3=-7, 3-4=-14
 - Concentrated Loads (lb)
 - Vert: 6=-1256(F)
- 23) 1st Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15
 - Uniform Loads (plf)
 - Vert: 1-3=-60, 3-4=-60, 2-7=-20, 5-6=-140(F=-120)
- 24) 2nd Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15
 - Uniform Loads (plf)
 - Vert: 1-3=-20, 3-4=-20, 2-7=-20, 5-10=-140(F=-120), 6-10=-180(F=-120)
- 25) 3rd Dead + 0.75 Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15
 - Uniform Loads (plf)
 - Vert: 1-3=-50, 3-4=-50, 2-7=-20, 5-6=-140(F=-120)
 - Concentrated Loads (lb)
 - Vert: 6=-1256(F)
- 26) 4th Dead + 0.75 Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15
 - Uniform Loads (plf)
 - Vert: 1-3=-20, 3-4=-20, 2-7=-20, 5-10=-140(F=-120), 6-10=-170(F=-120)
 - Concentrated Loads (lb)
 - Vert: 6=-1256(F)

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 122 Hidden Lakes	153182526
J1122-5618	V1	VALLEY	1	1	Job Reference (optional)	

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Jul 19 11:34:46 2022 Page 1
 ID:9TsBS1yzEQOf2XeoOILT12yyUuf_s30Je0QrU6TBqLB8bdoaPKqvwScBHTzzeWv_RywWHN

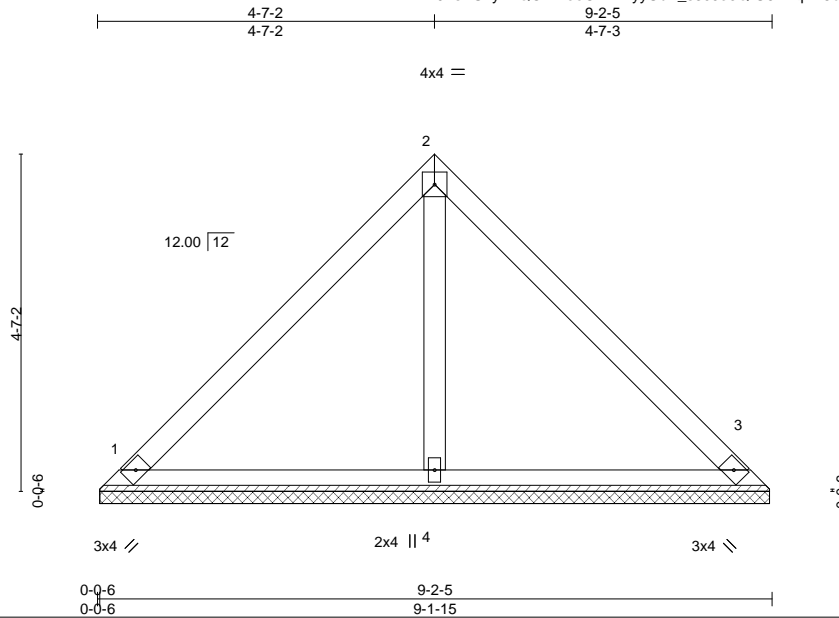

Scale = 1:29.6

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.25	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.13	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.05	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-S					Weight: 37 lb	FT = 20%
	Code IRC2015/TPI2014							

LUMBER-

TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 OTHERS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=9-1-9, 3=9-1-9, 4=9-1-9
 Max Horz 1=135(LC 8)
 Max Uplift 1=51(LC 13), 3=51(LC 13), 4=-17(LC 12)
 Max Grav 1=192(LC 1), 3=193(LC 1), 4=294(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TCDL=6.0psf; BCDL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3, 4.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



July 20,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932


Job J1122-5618	Truss V2	Truss Type VALLEY	Qty 1	Ply 1	Lot 122 Hidden Lakes Job Reference (optional)	153182527
-------------------	-------------	----------------------	----------	----------	--	-----------

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Jul 19 11:34:46 2022 Page 1
ID:9TsBS1yzEQOf2XeoOILTl2yyUuf_s30Je0QRu6TBqLB88doakPrzwUJBH?zzeWv_RywWHN



Scale = 1:22.6

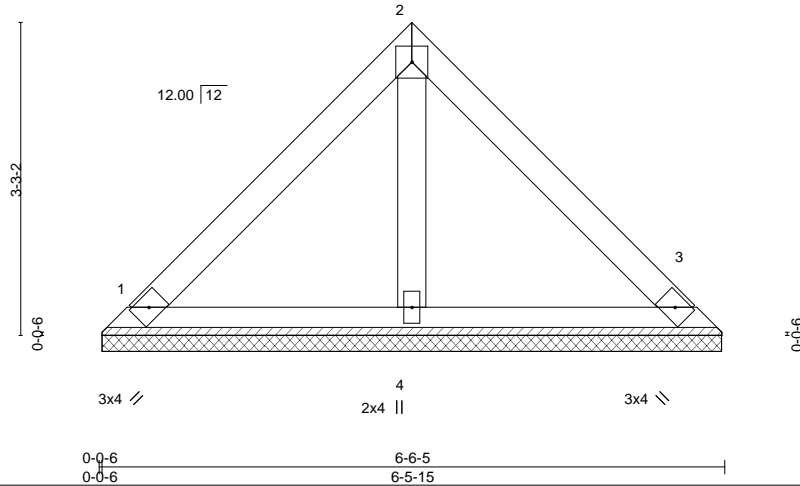

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 20.0	Plate Grip DOL	1.15	TC 0.18	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.06	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.02	Horz(CT)	0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-P						Weight: 26 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.1
BOT CHORD 2x4 SP No.1
OTHERS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=6-5-9, 3=6-5-9, 4=6-5-9
Max Horz 1=93(LC 8)
Max Uplift 1=46(LC 13), 3=46(LC 13)
Max Grav 1=142(LC 1), 3=142(LC 1), 4=182(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TCCL=6.0psf; BCCL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.
- 6) Non Standard bearing condition. Review required.
- 7) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



July 20,2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 122 Hidden Lakes	153182528
J1122-5618	V3	VALLEY	1	1	Job Reference (optional)	

Comtech, Inc. Fayetteville, NC - 28314,

8.430 s Aug 16 2021 MiTek Industries, Inc. Tue Jul 19 11:34:47 2022 Page 1
 ID:9TsBS1yzEQOf2XeoOILT2yyUuf-S3dOW_12coEKpzwNiJ817ct2kKqewkQ6CIFTXtywWHM

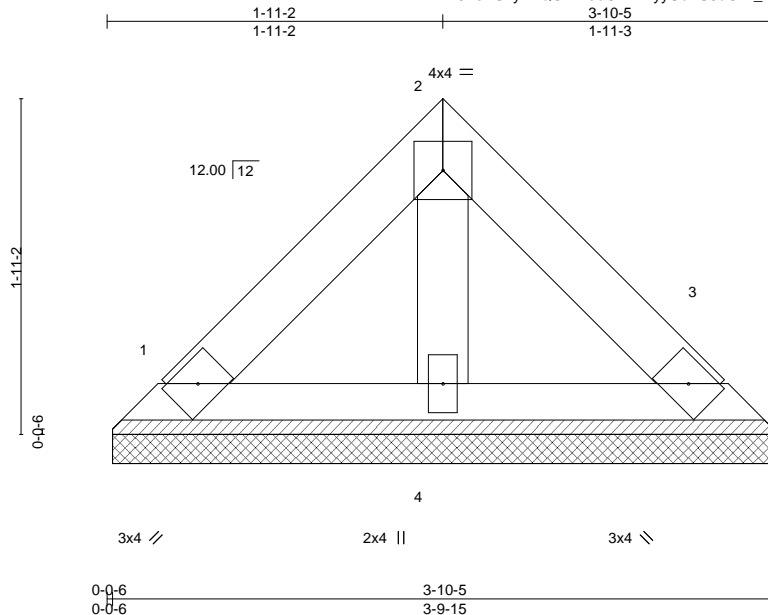

Scale = 1:12.5

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.05	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.02	Vert(LL) n/a - n/a 999		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.01	Vert(CT) n/a - n/a 999		
BCDL 10.0	Rep Stress Incr YES	Matrix-P	Horz(CT) 0.00 3 n/a n/a		
	Code IRC2015/TPI2014			Weight: 14 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.1
 BOT CHORD 2x4 SP No.1
 OTHERS 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-10-5 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=3-9-9, 3=3-9-9, 4=3-9-9
 Max Horz 1=50(LC 8)
 Max Uplift 1=-25(LC 13), 3=-25(LC 13)
 Max Grav 1=77(LC 1), 3=77(LC 1), 4=99(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=150mph Vasd=119mph; TCCL=6.0psf; BCCL=6.0psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.
- 6) N/A
- 7) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



July 20, 2022


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.

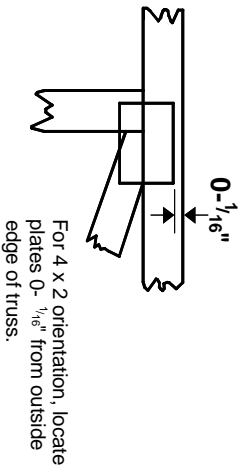

For 4 x 2 orientation, locate plates 0- $\frac{1}{16}$ " from outside edge of truss.

— This symbol indicates the required direction of slots in connector plates.

* Plate location details available in **MITek 20/20 software** or upon request.

PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur. Min size shown is for crushing only.

Industry Standards:

ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-89: Design Standard for Bracing, Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

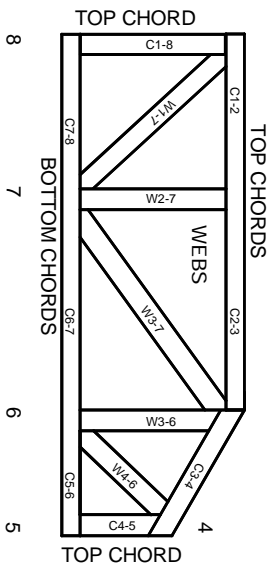

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ESR 1988
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MITek® All Rights Reserved



MITek Engineering Reference Sheet: Mill-7473 rev. 5/19/2020

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.

Reaction Summary of Order



REQ. QUOTE DATE	//	ORDER #	J1122-5618
ORDER DATE	11/08/22	QUOTE #	
DELIVERY DATE	//	CUSTOMER ACCT #	0000006558
DATE OF INVOICE	//	CUSTOMER PO #	
ORDERED BY	Jason Wellons	INVOICE #	
COUNTY	Johnston	TERMS	Net 10 Days
SUPERINTENDANT	Jason Wellons	SALES REP	Lenny Norris
JOBSITE PHONE #	(910) 263-0276	SALES AREA	David Landry

WELCO CONTRACTORS	Wellco Contractors, Inc. PO Box 766 Spring Lake, NC 28390 (910) 436-3131	JOB NAME: Lot 122 Hidden Lakes MODEL: Roof TAG: Plan 5 DELIVERY INSTRUCTIONS:	LOT # 122 SUBDIV: Hidden Lakes JOB CATEGORY: B & S - Build and Ship
	Wellco Contractors 89 Sugarberry Place Clayton, NC 27527	SPECIAL INSTRUCTIONS: Copied from Lot 113 Hidden Lakes (J0722-3619)	PLAN SEAL DATE: N/A

BUILDING DEPARTMENT	OVERHANG INFO	HEEL HEIGHT	00-04-05	REQ. LAYOUTS	REQ. ENGINEERING	QUOTE	JL	DATE
Roof Order	END CUT RETURN					LAYOUT	JL	11/11/22
	PLUMB NO	GABLE STUDS	16 IN. OC	JOBSITE	1	CUTTING	JL	11/11/22

ROOF TRUSSES

LOADING INFORMATION

TCLL-TCDL-BCLL-BCDL	STRESS INCR.
20.0,10.0,0.0,10.0	1.15

ROOF TRUSS SPACING: 24.0 IN. O.C. (TYP.)

PROFILE	QTY	PITCH		TYPE ID	BASE O/A	LUMBER		OVERHANG		REACTIONS
		TOP	BOT			TOP	BOT	LEFT	RIGHT	
	3	8.00	0.00	COMMON A1	28-06-00 28-06-00	2 X 6	2 X 6	00-11-00	00-11-00	Joint 2 Joint 8 1253.0 lbs. 1253.0 lbs. -211.2 lbs. -211.2 lbs.
	1	8.00	0.00	GABLE A1GE	28-06-00 28-06-00	2 X 6	2 X 6	00-11-00	00-11-00	Joint 2 Joint 18 Joint 20 Joint 21 Joint 22 218.3 lbs. 158.5 lbs. 223.8 lbs. 181.1 lbs. 190.0 lbs. -109.2 lbs. -30.4 lbs. -171.6 lbs. -127.3 lbs. -132.3 lbs.
	1	8.00	0.00	GABLE A1SG	28-06-00 28-06-00	2 X 6	2 X 6	00-11-00	00-11-00	Joint 2 Joint 13 1253.0 lbs. 1253.0 lbs. -211.2 lbs. -211.2 lbs.
	5	8.00	0.00	COMMON A2	28-02-08 28-02-08	2 X 6	2 X 6		00-11-00	Joint 1 Joint 7 1191.3 lbs. 1245.2 lbs. -188.0 lbs. -210.4 lbs.
	8	8.00	0.00	COMMON B1	25-11-00 25-11-00	2 X 6	2 X 6	00-11-00	00-11-00	Joint 2 Joint 10 1255.0 lbs. 1255.0 lbs. -193.6 lbs. -193.6 lbs.
	1	8.00	0.00	GABLE B1GE	25-11-00 25-11-00	2 X 6	2 X 6	00-11-00	00-11-00	Joint 2 Joint 16 Joint 18 Joint 19 Joint 20 218.3 lbs. 167.9 lbs. 278.1 lbs. 161.7 lbs. 193.2 lbs. -85.2 lbs. -15.2 lbs. -205.0 lbs. -113.8 lbs. -134.1 lbs.
	2	8.00	0.00	COMMON B2	25-11-00 25-11-00	2 X 6	2 X 6		00-11-00	Joint 1 Joint 9 1202.0 lbs. 1255.4 lbs. -173.1 lbs. -193.8 lbs.
	3	12.00	0.00	ATTIC C1	21-02-00 21-02-00	2 X 8	2 X 10	00-11-00	00-11-00	Joint 2 Joint 10 1415.6 lbs. 1415.6 lbs. 53.1 lbs. 53.1 lbs.
	1	12.00	0.00	GABLE C1GE	21-02-00 21-02-00	2 X 8	2 X 10	00-11-00	00-11-00	Joint 2 Joint 10 1408.2 lbs. 1408.2 lbs. -101.8 lbs. -101.8 lbs.
	4	12.00	0.00	ATTIC C2	21-02-00 21-02-00	2 X 8	2 X 10		00-11-00	Joint 1 Joint 8 1375.3 lbs. 1416.3 lbs. 64.7 lbs. 53.0 lbs.

Reaction Summary of Order



REQ. QUOTE DATE	//	ORDER #	J1122-5618
ORDER DATE	11/08/22	QUOTE #	
DELIVERY DATE	//	CUSTOMER ACCT #	0000006558
DATE OF INVOICE	//	CUSTOMER PO #	
ORDERED BY	Jason Wellons	INVOICE #	
COUNTY	Johnston	TERMS	Net 10 Days
SUPERINTENDANT	Jason Wellons	SALES REP	Lenny Norris
JOBSITE PHONE #	(910) 263-0276	SALES AREA	David Landry

WELLCO CONTRACTORS	Wellco Contractors, Inc. PO Box 766 Spring Lake, NC 28390 (910) 436-3131	JOB NAME: Lot 122 Hidden Lakes MODEL: Roof TAG: Plan 5 DELIVERY INSTRUCTIONS:	LOT # 122 SUBDIV: Hidden Lakes JOB CATEGORY: B & S - Build and Ship
	Wellco Contractors 89 Sugarberry Place Clayton, NC 27527	SPECIAL INSTRUCTIONS: Copied from Lot 113 Hidden Lakes (J0722-3619)	PLAN SEAL DATE: N/A

BUILDING DEPARTMENT	OVERHANG INFO	HEEL HEIGHT	00-04-05	REQ. LAYOUTS	REQ. ENGINEERING	QUOTE	JL	DATE
Roof Order	END CUT RETURN					LAYOUT	JL	11/11/22
	PLUMB NO	GABLE STUDS	16 IN. OC	JOBSITE	1	CUTTING	JL	11/11/22

ROOF TRUSSES

LOADING INFORMATION

TCLL-TCDL-BCLL-BCDL	STRESS INCR.
20.0,10.0,0.0,10.0	1.15

ROOF TRUSS SPACING: 24.0 IN. O.C. (TYP.)

PROFILE	QTY PLY	PITCH		TYPE ID	BASE O/A	LUMBER		OVERHANG		REACTIONS
		TOP	BOT			TOP	BOT	LEFT	RIGHT	
	1	12.00	0.00	ATTIC C3	21-02-00 21-02-00	2 X 8	2 X 10		00-11-00	Joint 9 Joint 14 1400.6 lbs. 1395.6 lbs. 53.2 lbs. 68.0 lbs.
	1 2 Ply	12.00	0.00	ATTIC C3-GR	21-02-00 21-02-00	2 X	2 X 10		00-11-00	Joint 1 Joint 8 2555.2 lbs. 2067.1 lbs. 64.5 lbs. 53.3 lbs.
	1 2 Ply	12.00	0.00	COMMON D1-GR	09-11-00 09-11-00	2 X 6	2 X 6			Joint 1 Joint 3 3316.0 lbs. 2954.7 lbs. -589.8 lbs. -527.5 lbs.
	1	12.00	0.00	COMMON D1GE	09-11-00 09-11-00	2 X 6	2 X 6	00-11-00	00-11-00	Joint 2 Joint 8 Joint 10 Joint 11 Joint 12 199.6 lbs. 178.5 lbs. 171.6 lbs. 219.2 lbs. 138.4 lbs. -108.8 lbs. -68.7 lbs. -236.1 lbs. -197.4 lbs. 28.4 lbs.
	2	5.00	0.00	MONOPITCH M1	06-00-00 06-00-00	2 X 6	2 X 6	00-11-00	00-03-08	Joint 2 Joint 5 292.8 lbs. 218.5 lbs. -129.2 lbs. -123.6 lbs.
	1	5.00	0.00	MONOPITCH M1GE	06-00-00 06-00-00	2 X 6	2 X 6	00-11-00		Joint 2 Joint 8 Joint 9 Joint 10 114.1 lbs. 66.7 lbs. 159.7 lbs. 170.4 lbs. -10.8 lbs. -45.6 lbs. -96.9 lbs. -119.8 lbs.
	4	5.00	0.00	ROOF M2	05-00-00 05-00-00	2 X 6	2 X 6	00-11-00	01-03-08	Joint 2 Joint 7 349.3 lbs. 627.0 lbs. -75.1 lbs. 167.4 lbs.
	2 2 Ply	5.00	0.00	ROOF M2-GR	05-00-00 05-00-00	2 X 6	2 X 6	00-11-00	01-03-08	Joint 2 Joint 7 311.9 lbs. 1946.9 lbs. -37.6 lbs. 85.3 lbs.
	1	12.00	0.00	VALLEY V1	09-01-09 09-01-09	2 X 4	2 X 4			Joint 1 Joint 3 Joint 4 192.4 lbs. 192.5 lbs. 294.1 lbs. -50.8 lbs. -50.8 lbs. -17.4 lbs.
	1	12.00	0.00	VALLEY V2	06-05-09 06-05-09	2 X 4	2 X 4			Joint 1 Joint 3 Joint 4 141.8 lbs. 141.8 lbs. 182.1 lbs. -46.0 lbs. -45.9 lbs. 10.3 lbs.

Reaction Summary of Order



REQ. QUOTE DATE	//	ORDER #	J1122-5618
ORDER DATE	11/08/22	QUOTE #	
DELIVERY DATE	//	CUSTOMER ACCT #	0000006558
DATE OF INVOICE	//	CUSTOMER PO #	
ORDERED BY	Jason Wellons	INVOICE #	
COUNTY	Johnston	TERMS	Net 10 Days
SUPERINTENDANT	Jason Wellons	SALES REP	Lenny Norris
JOBSITE PHONE #	(910) 263-0276	SALES AREA	David Landry

WELLCO CONTRACTORS, INC.	Wellco Contractors, Inc. PO Box 766 Spring Lake, NC 28390 (910) 436-3131	JOB NAME: Lot 122 Hidden Lakes MODEL: Roof TAG: Plan 5	LOT # 122 SUBDIV: Hidden Lakes JOB CATEGORY: B & S - Build and Ship
	Wellco Contractors 89 Sugarberry Place Clayton, NC 27527	DELIVERY INSTRUCTIONS: SPECIAL INSTRUCTIONS: Copied from Lot 113 Hidden Lakes (J0722-3619)	PLAN SEAL DATE: N/A

BUILDING DEPARTMENT	OVERHANG INFO	HEEL HEIGHT	00-04-05	REQ. LAYOUTS	REQ. ENGINEERING	QUOTE	JL	11/11/22
Roof Order	END CUT RETURN					LAYOUT	JL	11/11/22
	PLUMB NO	GABLE STUDS	16 IN. OC	JOBSITE 1	JOBSITE 1	CUTTING	JL	11/11/22

ROOF TRUSSES

LOADING INFORMATION

TCLL-TCDL-BCLL-BCDL	STRESS INCR.
20.0,10.0,0.0,10.0	1.15

ROOF TRUSS SPACING: 24.0 IN. O.C. (TYP.)

PROFILE	QTY	PITCH		TYPE ID	BASE O/A	LUMBER		OVERHANG		REACTIONS
		TOP	BOT			TOP	BOT	LEFT	RIGHT	
	1	12.00	0.00	VALLEY V3	03-09-09 03-09-09	2 X 4	2 X 4			Joint 1 Joint 3 Joint 4 76.8 lbs. 76.9 lbs. 98.7 lbs. -24.9 lbs. -24.9 lbs. 5.6 lbs.

ITEMS

QTY	ITEM TYPE	SIZE	LENGTH FT-IN-16	PART NUMBER	NOTES
5	Hangers, USP	HUS 26			SIMPSON (HUS26)



ROOF & FLOOR TRUSSES & BEAMS

Reilly Road Industrial Park
Fayetteville, N.C. 28309
Phone: (910) 864-8787
Fax: (910) 864-4444

Bearing reactions less than or equal to 3000# are deemed to comply with the prescriptive Code requirements. The contractor shall refer to the attached Tables (derived from the prescriptive Code requirements) to determine the minimum foundation size and number of wood studs required to support reactions greater than 3000# but not greater than 15000#. A registered design professional shall be retained to design the support system for any reaction that exceeds those specified in the attached Tables. A registered design professional shall be retained to design the support system for all reactions that exceed 15000#.

Signature David Landry
David Landry

LOAD CHART FOR JACK STUDS

(BASED ON TABLES R502.5(1) & (b))

NUMBER OF JACK STUDS REQUIRED @ EA END OF HEADER/BORDER

END REACTION (LPTO)	REQ'D STUDS FOR (LPTO) HEADER	END REACTION (RPTO)	REQ'D STUDS FOR (RPTO) HEADER	END REACTION (LPTO)	REQ'D STUDS FOR (LPTO) BORDER
1700	1	2550	1	3400	1
3400	2	5100	2	6800	2
5100	3	7650	3	10200	3
6800	4	10200	4	13600	4
8500	5	12750	5	17000	5
10200	6	15300	6		
11900	7				
13600	8				
15300	9				

All Walls Shown Are Considered Load Bearing

- Plumbing Drop Notes**
1. Plumbing drop locations shown are NOT exact.
 2. Contractor to verify ALL plumbing drop locations prior to setting Floor Trusses.
 3. Adjust spacing as needed not to exceed 24"oc.

- Dimension Notes**
1. All exterior wall to wall dimensions are to face of sheathing unless noted otherwise
 2. All interior wall dimensions are to face of frame wall unless noted otherwise
 3. All exterior wall to truss dimensions are to face of frame wall unless noted otherwise

Hatch Legend


- Second Floor Walls
- Box Storage
- Drop Beam
- Flush Beam

Connector Information					Nail Information	
Sym	Product	Manuf	Qty	Supported Member	Header	Truss
●	HUS410	USP	19	NA	16d/3-1/2"	16d/3-1/2"

Products

PlotID	Length	Product	Plies	Net Qty
BM1	12' 0"	1-3/4"x 14" LVL Kerto-S	2	2
GDH	22' 0"	1-3/4"x 11-7/8" LVL Kerto-S	2	2

1 Truss Placement Plan
Scale: 1/4"=1'

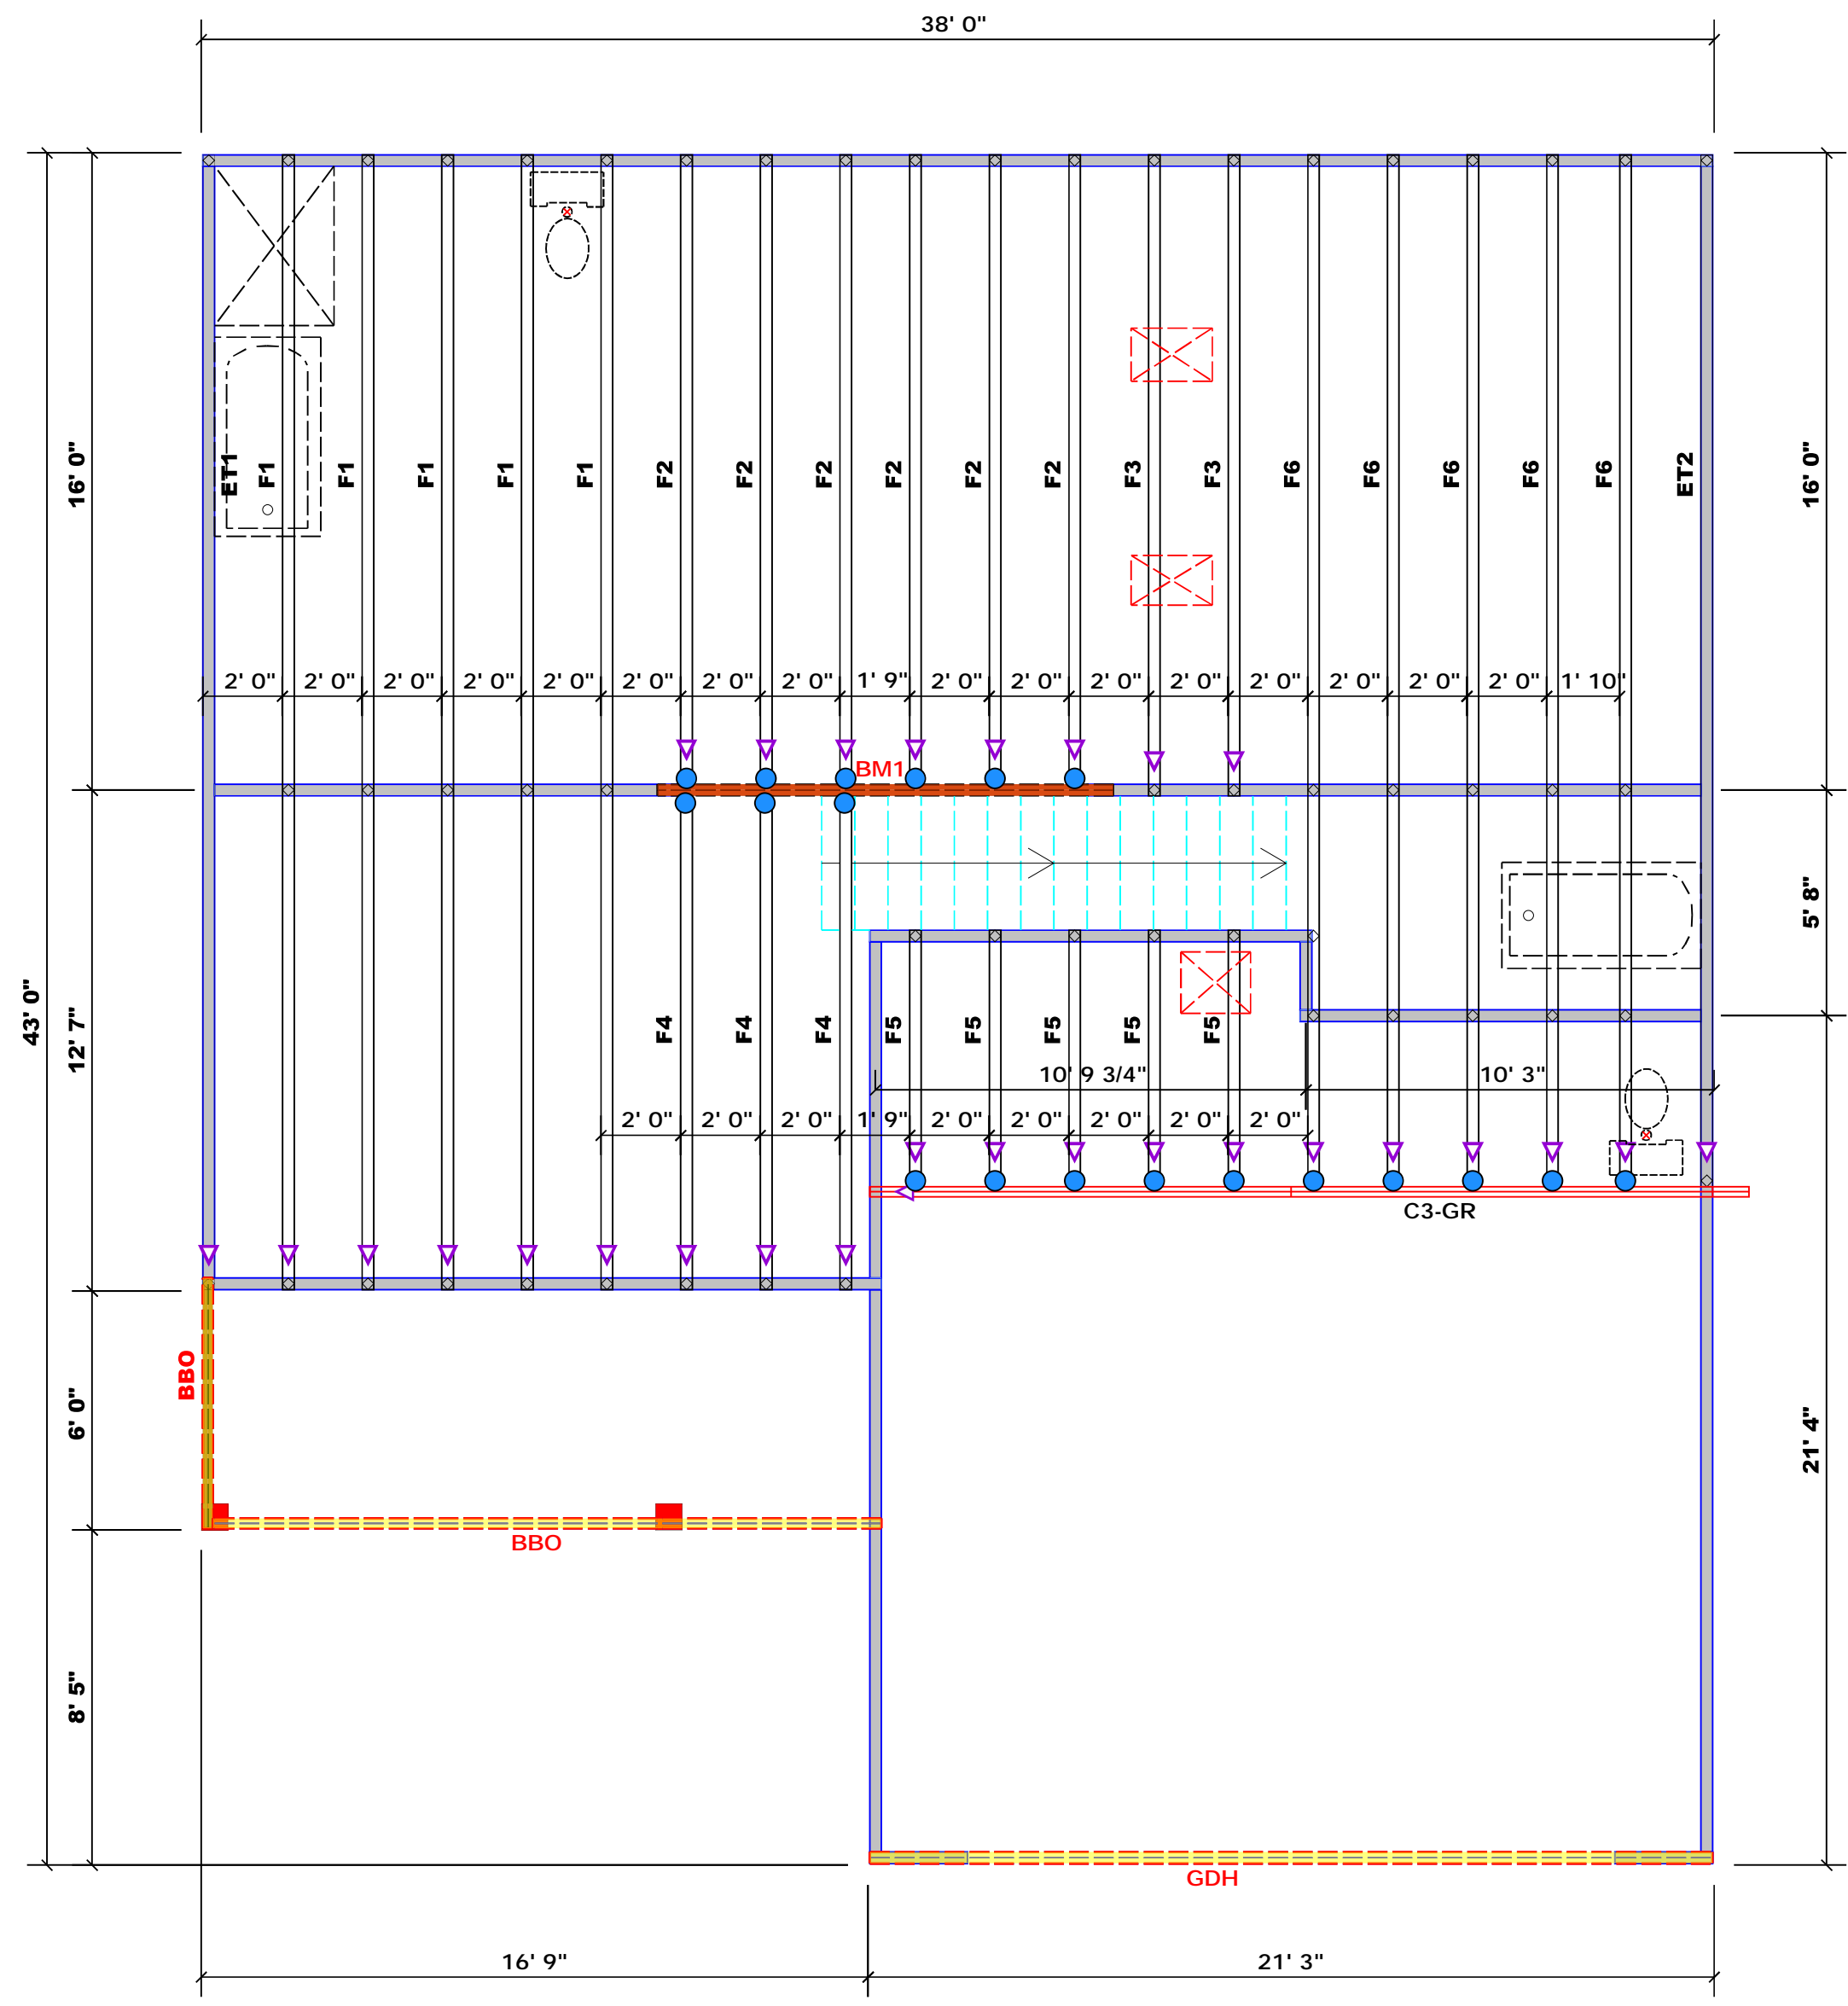

▲ = Indicates Left End of Truss
(Reference Engineered Truss Drawing)
Do NOT Erect Truss Backwards

BUILDER	CITY / CO.	CLAYTON / JOHNSTON
JOB NAME	ADDRESS	89 Sugarberry Place
PLAN	MODEL	Floor
SEAL DATE	DATE REV.	11/11/22
QUOTE #	DRAWN BY	Jonathan Landry
JOB #	SALES REP.	Lenny Norris

THIS IS A TRUSS PLACEMENT DIAGRAM ONLY. These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult BCSI-B1 and BCSI-B3 provided with the truss delivery package or online @ sbcindustry.com



Trenco
818 Soundside Rd
Edenton, NC 27932

Re: J1122-5619
Lot 122 Hidden Lakes

The truss drawing(s) referenced below have been prepared by Truss Engineering Co. under my direct supervision based on the parameters provided by Comtech, Inc - Fayetteville.

Pages or sheets covered by this seal: I55503006 thru I55503013

My license renewal date for the state of North Carolina is December 31, 2022.

North Carolina COA: C-0844



November 30, 2022

Gilbert, Eric

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

Job	Truss	Truss Type	Qty	Ply	Lot 122 Hidden Lakes	155503006
J1122-5619	ET1	GABLE	1	1	Job Reference (optional)	


Comtech, Inc, Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Wed Nov 30 13:19:52 2022 Page 1
 ID:9TsBS1yzEQOf2XeoOILT12yyUuf-LeFeDTs6Z4pWUP6?1?Z8rhBOoMr13YcnX1m2z7Ye_Cb

0-1-8

0-1-8

Scale: 1/4"=1'

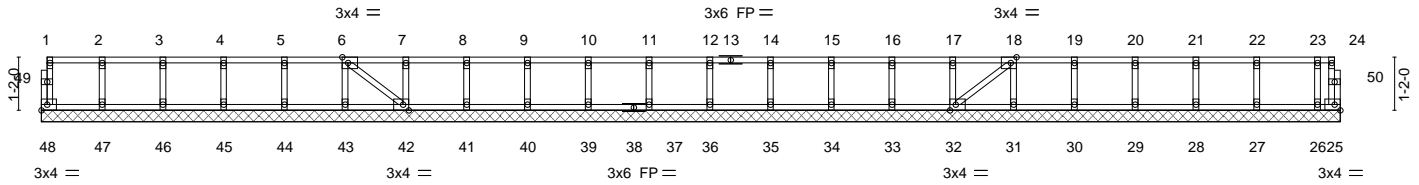

1-4-0	2-8-0	4-0-0	5-4-0	6-8-0	8-0-0	9-4-0	10-8-0	12-0-0	13-4-0	14-8-0	16-0-0	17-4-0	18-8-0	20-0-0	21-4-0	22-8-0	24-0-0	25-4-0	26-8-0	28-0-0	28-6-0
1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	0-6-0

Plate Offsets (X,Y)--	[6:0-1-8,Edge], [18:0-1-8,Edge], [32:0-1-8,Edge], [42:0-1-8,Edge]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.06	Vert(LL) n/a - n/a 999	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.01	Vert(CT) n/a - n/a 999		
BCLL 0.0	Rep Stress Incr YES	WB 0.03	Horz(CT) -0.00 25 n/a n/a		
BCDL 5.0	Code IRC2015/TPI2014	Matrix-S		Weight: 122 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing, Except: 10-0-0 oc bracing: 47-48,46-47,45-46,44-45,43-44,42-43.
WEBS 2x4 SP No.3(flat)	
OTHERS 2x4 SP No.3(flat)	


REACTIONS. All bearings 28-6-0.
 (lb) - Max Uplift All uplift 100 lb or less at joint(s) 25
 Max Grav All reactions 250 lb or less at joint(s) 48, 47, 46, 45, 44, 43, 42, 41, 40, 39, 37, 36, 35, 34, 33, 32, 31, 30, 29, 28, 27, 26

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) All plates are 1.5x3 MT20 unless otherwise indicated.
 - 2) Plates checked for a plus or minus 1 degree rotation about its center.
 - 3) Gable requires continuous bottom chord bearing.
 - 4) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - 5) Gable studs spaced at 1-4-0 oc.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 25.
 - 7) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.



November 30,2022

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE. Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	 818 Soundside Road Edenton, NC 27932
--	--


Job	Truss	Truss Type	Qty	Ply	Lot 122 Hidden Lakes	155503007
J1122-5619	ET2	GABLE	1	1		

Comtech, Inc, Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Wed Nov 30 13:19:54 2022 Page 1
 ID:9TsBS1yzEQOf2XeoOILT2yyUuf-H1NOe9uM5h3EkiGN9Qbcx6GkHAXDXS54_LF910yE_CZ

0-1-8

Scale = 1:43.3

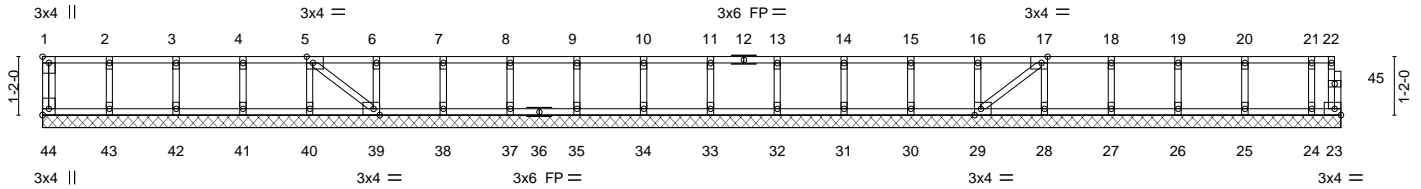

1-4-0	2-8-0	4-0-0	5-4-0	6-8-0	8-0-0	9-4-0	10-8-0	12-0-0	13-4-0	14-8-0	16-0-0	17-4-0	18-8-0	20-0-0	21-4-0	22-8-0	24-0-0	25-4-0	25-11-0
1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	1-4-0	0-7-0

Plate Offsets (X,Y)--		[1:Edge.0-1-8], [5:0-1-8,Edge], [17:0-1-8,Edge], [29:0-1-8,Edge], [39:0-1-8,Edge], [44:Edge.0-1-8]								
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP	
TCLL 40.0	Plate Grip DOL	1.00	TC 0.06	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL 10.0	Lumber DOL	1.00	BC 0.01	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.03	Horz(CT)	-0.00	23	n/a	n/a		
BCDL 5.0	Code	IRC2015/TPI2014	Matrix-S						Weight: 112 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1 (flat)	TOP CHORD Structural wood sheathing directly applied or 10-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1 (flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing, Except: 10-0-0 oc bracing: 43-44,42-43,41-42,40-41,39-40.
WEBS 2x4 SP No.3 (flat)	
OTHERS 2x4 SP No.3 (flat)	


REACTIONS. All bearings 25-11-0.
 (lb) - Max Uplift All uplift 100 lb or less at joint(s) 23
 Max Grav All reactions 250 lb or less at joint(s) 44, 43, 42, 41, 40, 39, 38, 37, 35, 34, 33, 32, 31, 30, 29, 28, 27, 26, 25, 24

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) All plates are 1.5x3 MT20 unless otherwise indicated.
 - 2) Plates checked for a plus or minus 1 degree rotation about its center.
 - 3) Gable requires continuous bottom chord bearing.
 - 4) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - 5) Gable studs spaced at 1-4-0 oc.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 23.
 - 7) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 8) CAUTION, Do not erect truss backwards.



November 30, 2022

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE. Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	 818 Soundside Road Edenton, NC 27932
--	--

Job	Truss	Truss Type	Qty	Ply	Lot 122 Hidden Lakes	155503008
J1122-5619	F1	Floor	5	1		

Comtech, Inc, Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Wed Nov 30 13:19:56 2022 Page 1
 ID:9TsBS1yzEQOf2XeoOILT12yyUuf-EPV83qvddJJyz0QmGrd40XMwpz1u?EkNSfkG6uyE_CX

0-1-8



0-1-8
Scale: 1/4"=1'

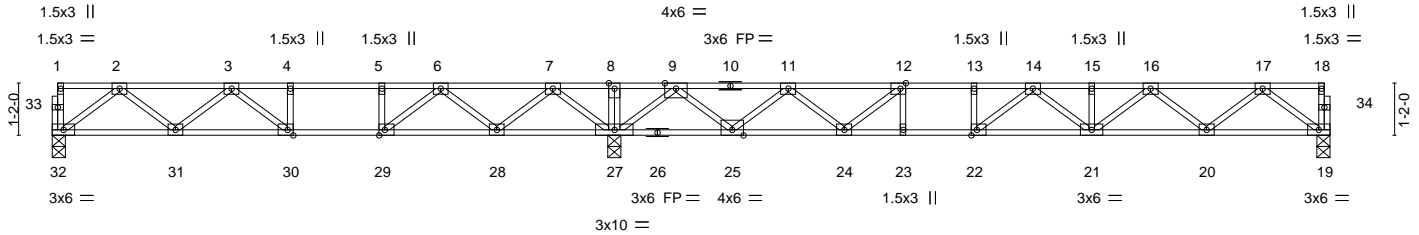


Plate Offsets (X,Y)--	[12:0-1-8,Edge], [22:0-1-8,Edge], [29:0-1-8,Edge], [30:0-1-8,Edge]
-----------------------	--

LOADING (psf)	SPACING-	CS.I.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 40.0	Plate Grip DOL 1.00	TC 0.70	Vert(LL)	-0.18	21-22	>999	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.83	Vert(CT)	-0.25	21-22	>747		
BCLL 0.0	Rep Stress Incr YES	WB 0.53	Horz(CT)	0.04	19	n/a		
BCDL 5.0	Code IRC2015/TPI2014	Matrix-S						
							Weight: 143 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1(flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1(flat)	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SP No.3(flat)	

REACTIONS. (size) 32=0-3-8, 27=0-3-8, 19=0-3-8
 Max Grav 32=594(LC 3), 27=1839(LC 1), 19=770(LC 4)


FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-1126/0, 3-4=-1508/171, 4-5=-1508/171, 5-6=-1508/171, 6-7=-537/783, 7-8=0/1922, 8-9=0/1922, 9-11=-597/322, 11-12=-1894/0, 12-13=-2482/0, 13-14=-2482/0, 14-15=-2450/0, 15-16=-2450/0, 16-17=-1553/0
 BOT CHORD 31-32=0/728, 30-31=0/1466, 29-30=-171/1508, 28-29=-504/1104, 27-28=-1054/0, 25-27=-692/0, 24-25=-76/1386, 23-24=0/2482, 22-23=0/2482, 21-22=0/2610, 20-21=0/2128, 19-20=0/954
 WEBS 2-32=-911/0, 2-31=0/518, 3-31=-442/70, 3-30=-311/54, 7-27=-1279/0, 7-28=0/848, 6-28=-877/0, 6-29=0/841, 5-29=-370/0, 9-27=-1543/0, 9-25=0/1121, 11-25=-1076/0, 11-24=0/720, 12-24=-873/0, 12-23=0/252, 17-19=-1195/0, 17-20=0/779, 16-20=-748/0, 16-21=0/412, 14-22=-428/127

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) Plates checked for a plus or minus 1 degree rotation about its center.
 - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 5) CAUTION, Do not erect truss backwards.



November 30, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSIP/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 122 Hidden Lakes	155503009
J1122-5619	F2	Floor	6	1		

Comtech, Inc, Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Wed Nov 30 13:19:57 2022 Page 1
 ID:9TsBS1yzEQOf2XeoOILT12yyUuf-ic2XGAwFOcRpbA?yqY8JYlu74NM9kjXWgJTpeLyE_CW

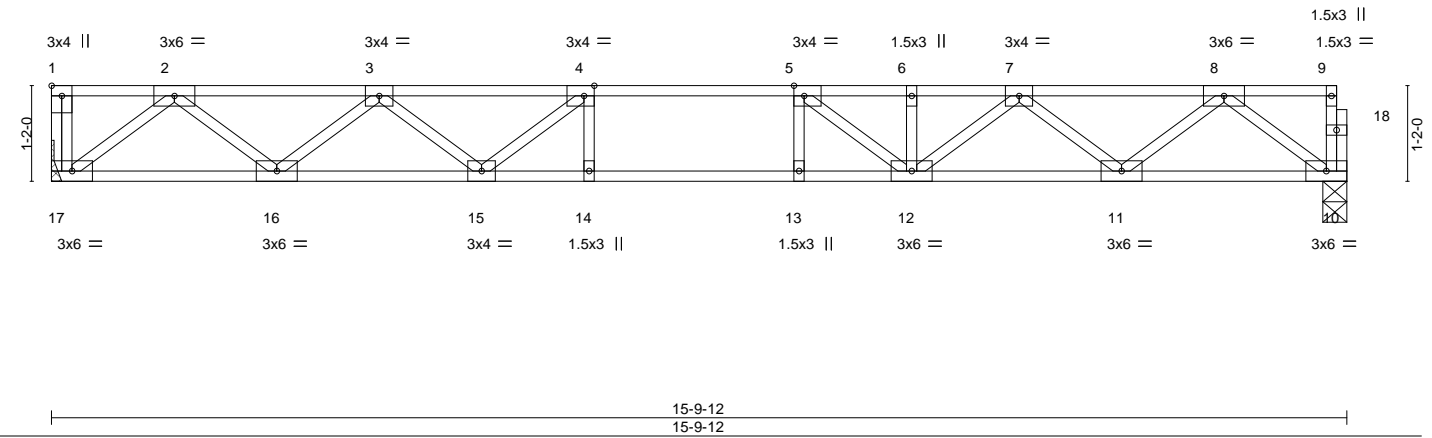



Plate Offsets (X,Y)-- [1:Edge,0-1-8], [4:0-1-8,Edge], [5:0-1-8,Edge]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 40.0	2-0-0	TC 0.54	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.82	Vert(LL) -0.20 12-13 >954 480		
BCLL 0.0	Lumber DOL 1.00	WB 0.44	Vert(CT) -0.26 12-13 >720 360		
BCDL 5.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.05 10 n/a n/a		
	Code IRC2015/TPI2014			Weight: 79 lb	FT = 20%F, 11%E

LUMBER-
 TOP CHORD 2x4 SP No.1(flat)
 BOT CHORD 2x4 SP No.1(flat)
 WEBS 2x4 SP No.3(flat)

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 17=Mechanical, 10=0-3-8
 Max Grav 17=856(LC 1), 10=850(LC 1)


FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-1761/0, 3-4=-2788/0, 4-5=-3145/0, 5-6=-2831/0, 6-7=-2831/0, 7-8=-1757/0
 BOT CHORD 16-17=0/1058, 15-16=0/2429, 14-15=0/3145, 13-14=0/3145, 12-13=0/3145, 11-12=0/2418, 10-11=0/1061
 WEBS 2-17=-1328/0, 2-16=0/915, 3-16=-870/0, 3-15=0/529, 4-15=-648/0, 8-10=-1329/0, 8-11=0/906, 7-11=-860/0, 7-12=0/527, 5-12=-707/0

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) Plates checked for a plus or minus 1 degree rotation about its center.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 5) CAUTION, Do not erect truss backwards.



November 30, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 122 Hidden Lakes	155503010
J1122-5619	F3	Floor	2	1	Job Reference (optional)	

Comtech, Inc, Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Wed Nov 30 13:19:57 2022 Page 1
ID:9TsBS1yzEQOf2XeoOILT12yyUuf-ic2XGAwFOcRpbA?yqY8JYlu9cNMykjlWgJTpeLYE_CW

0-1-8



0-1-8
Scale = 1:27.2

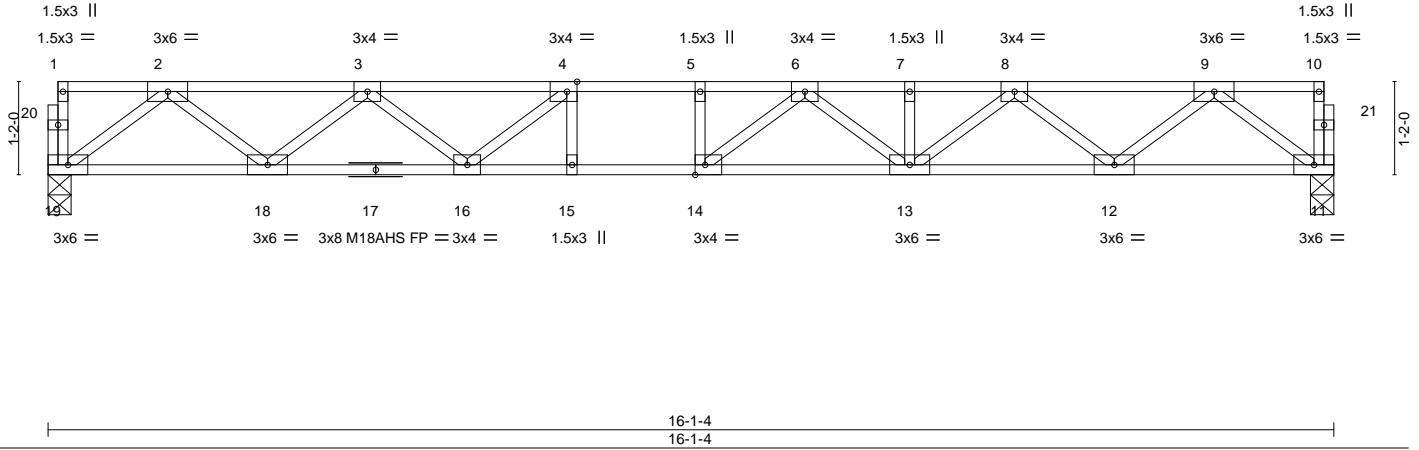


Plate Offsets (X,Y)-- [4:0-1-8,Edge], [14:0-1-8,Edge]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 40.0	2-0-0 Plate Grip DOL 1.00	TC 0.44	Vert(LL)	-0.20 13-14	>941	480	MT20	244/190
TCDL 10.0	Lumber DOL 1.00	BC 0.77	Vert(CT)	-0.28 13-14	>678	360	M18AHS	186/179
BCLL 0.0	Rep Stress Incr YES	WB 0.45	Horz(CT)	0.05 11	n/a	n/a		
BCDL 5.0	Code IRC2015/TPI2014	Matrix-S						
							Weight: 82 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1 (flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1 (flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3 (flat)	

REACTIONS. (size) 19=0-3-8, 11=0-3-8
Max Grav 19=866(LC 1), 11=866(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1801/0, 3-4=-2865/0, 4-5=-3270/0, 5-6=-3270/0, 6-7=-2921/0, 7-8=-2921/0, 8-9=-1796/0
BOT CHORD 18-19=0/1079, 16-18=0/2486, 15-16=0/3270, 14-15=0/3270, 13-14=0/3206, 12-13=0/2480, 11-12=0/1081
WEBS 2-19=-1351/0, 2-18=0/940, 3-18=-891/0, 3-16=0/537, 4-16=-651/0, 9-11=-1354/0, 9-12=0/930, 8-12=-890/0, 8-13=0/563, 6-13=-365/0, 6-14=-196/408

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are MT20 plates unless otherwise indicated.
 - 3) Plates checked for a plus or minus 1 degree rotation about its center.
 - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.



November 30, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 122 Hidden Lakes	155503011
J1122-5619	F4	Floor	3	1	Job Reference (optional)	

Comtech, Inc, Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Wed Nov 30 13:19:58 2022 Page 1
ID:9TsBS1yzEQ0f2XeoOILT2yyUuf-AocvUWxt9wZgCKZ9OGf5yRMmo_TC1gvzDNBnyE_CV

0-1-8



Scale = 1:20.5

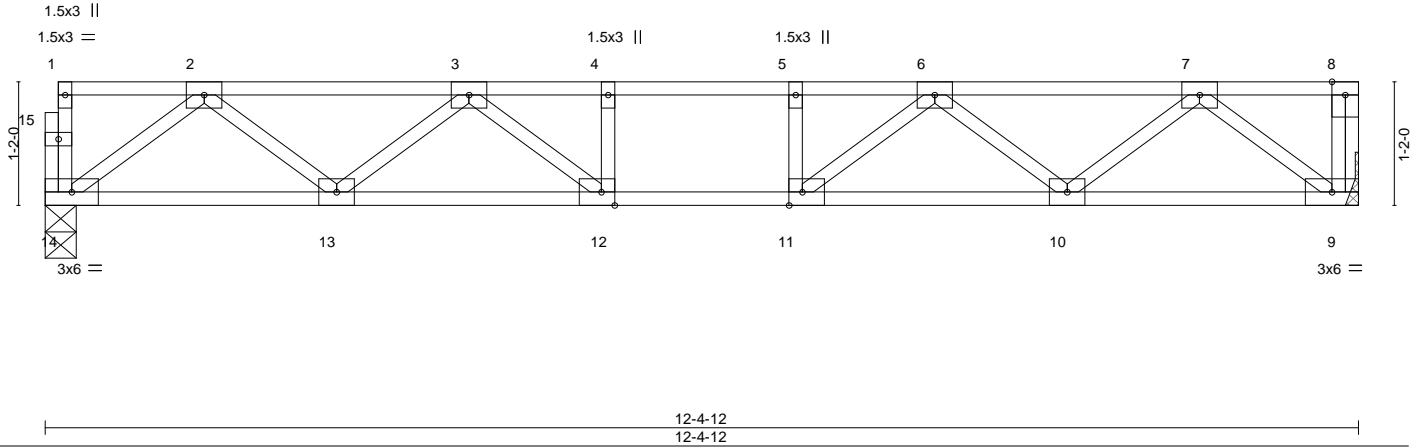


Plate Offsets (X,Y)-- [11:0-1-8,Edge], [12:0-1-8,Edge]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 40.0	2-0-0	TC 0.28	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.40	Vert(LL) -0.08 10-11 >999 480		
BCLL 0.0	Lumber DOL 1.00	WB 0.29	Vert(CT) -0.10 10-11 >999 360		
BCDL 5.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.02 9 n/a n/a		
	Code IRC2015/TPI2014			Weight: 63 lb	FT = 20%F, 11%E

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.1 (flat)	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.1 (flat)	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3 (flat)	

REACTIONS. (size) 14=0-3-8, 9=Mechanical
Max Grav 14=662(LC 1), 9=668(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1285/0, 3-4=-1916/0, 4-5=-1916/0, 5-6=-1916/0, 6-7=-1285/0
BOT CHORD 13-14=0/815, 12-13=0/1720, 11-12=0/1916, 10-11=0/1720, 9-10=0/816
WEBS 2-14=-1020/0, 2-13=0/611, 3-13=-566/0, 3-12=0/443, 7-9=-1024/0, 7-10=0/611, 6-10=-565/0, 6-11=0/443

- NOTES-**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 3x4 MT20 unless otherwise indicated.
 - 3) Plates checked for a plus or minus 1 degree rotation about its center.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 6) CAUTION, Do not erect truss backwards.



November 30, 2022


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 122 Hidden Lakes	155503012
J1122-5619	F5	Floor	5	1		

Comtech, Inc, Fayetteville, NC - 28314,

8.430 s Jan 6 2022 MiTek Industries, Inc. Wed Nov 30 13:19:59 2022 Page 1
ID:9TsBS1yzEQOf2XeoOILT2yyUuf-e_AHhsyVwEhXqU8LxzBneA_afBDhCiAp8dywDyE_CU



Scale: 1"=1'

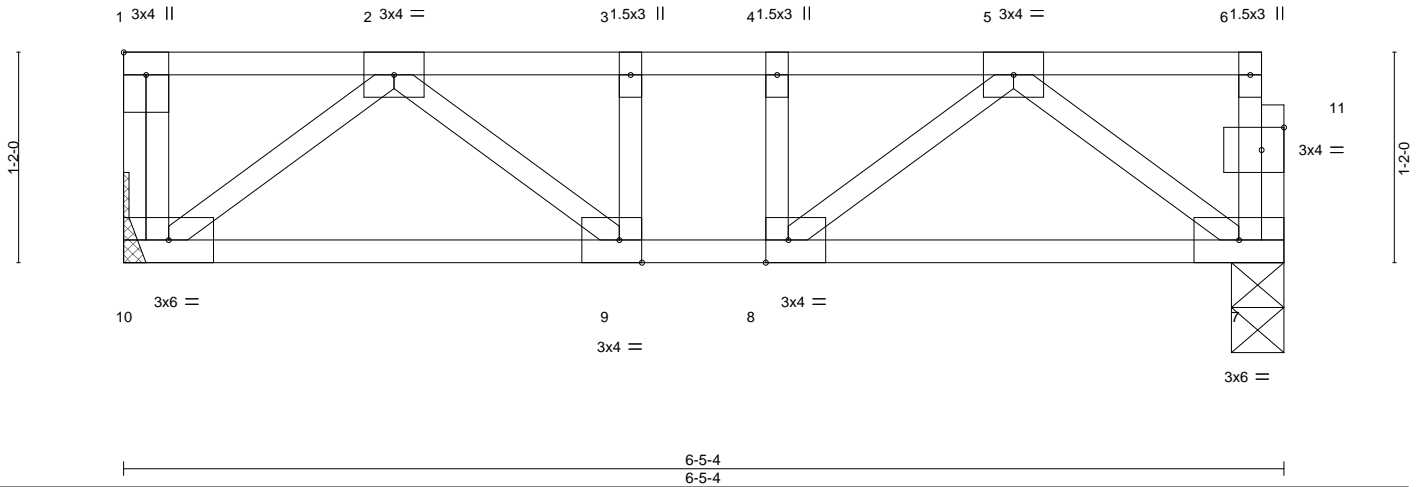


Plate Offsets (X,Y)-- [1:Edge,0-1-8], [8:0-1-8,Edge], [9:0-1-8,Edge], [11:0-1-8,0-1-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 40.0	2-0-0	TC 0.08	Vert(LL)	-0.01	7-8	>999	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.12	Vert(CT)	-0.01	7-8	>999		
BCLL 0.0	Lumber DOL 1.00	WB 0.11	Horz(CT)	0.00	7	n/a		
BCDL 5.0	Rep Stress Incr YES	Matrix-S						
	Code IRC2015/TPI2014						Weight: 36 lb	FT = 20%F, 11%E

LUMBER-

TOP CHORD 2x4 SP No.1 (flat)
BOT CHORD 2x4 SP No.1 (flat)
WEBS 2x4 SP No.3 (flat)

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 10=Mechanical, 7=0-3-8
Max Grav 10=340(LC 1), 7=334(LC 1)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-507/0, 3-4=-507/0, 4-5=-507/0
BOT CHORD 9-10=0/361, 8-9=0/507, 7-8=0/359
WEBS 5-7=-447/0, 2-10=-453/0

NOTES-

- 1) Unbalanced floor live loads have been considered for this design.
- 2) Plates checked for a plus or minus 1 degree rotation about its center.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
- 5) CAUTION, Do not erect truss backwards.



November 30, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	Lot 122 Hidden Lakes	155503013
J1122-5619	F6	Floor	5	1		

Comtech, Inc, Fayetteville, NC - 28314,

8,430 s Jan 6 2022 MiTek Industries, Inc. Wed Nov 30 13:20:01 2022 Page 1
 ID:9TsBS1yzEQOf2XeoOIL2I23yyUuf-bNI16YzISrxF3nlj3ODFjb3nw_kXgWN6bxR1n6yE_CS



Scale = 1:43.4


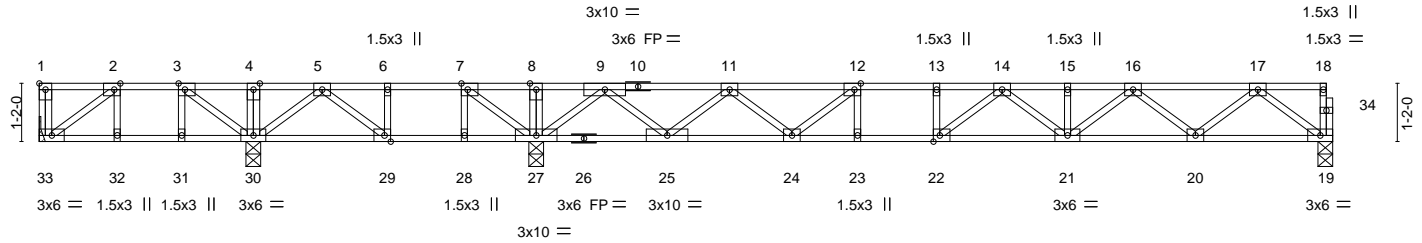


Plate Offsets (X,Y)-- [1:Edge,0-1-8], [2:0-1-8,Edge], [3:0-1-8,Edge], [7:0-1-8,Edge], [12:0-1-8,Edge], [22:0-1-8,Edge], [29:0-1-8,Edge]

LOADING (psf)	SPACING-	CS.	DEFL.	PLATES	GRIP
TCLL 40.0	2-0-0	TC 0.67	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.00	BC 0.80	Vert(LL) -0.19 21-22 >999 480		
BCLL 0.0	Lumber DOL 1.00	WB 0.51	Vert(CT) -0.26 21-22 >736 360		
BCDL 5.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.03 19 n/a n/a		
	Code IRC2015/TPI2014			Weight: 134 lb	FT = 20%F, 11%E

LUMBER-

TOP CHORD 2x4 SP No.1(flat)
 BOT CHORD 2x4 SP No.1(flat)
 WEBS 2x4 SP No.3(flat)

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS.

All bearings 0-3-8 except (jt=length) 33=Mechanical.
 (lb) - Max Uplift All uplift 100 lb or less at joint(s) 33
 Max Grav All reactions 250 lb or less at joint(s) 33 except 30=605(LC 3), 27=1395(LC 11), 19=785(LC 13)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 3-4=0/605, 4-5=0/605, 5-6=-98/846, 6-7=-98/846, 7-8=0/1320, 8-9=0/1320, 9-11=-797/0, 11-12=-2048/0, 12-13=-2609/0, 13-14=-2609/0, 14-15=-2526/0, 15-16=-2526/0, 16-17=-1592/0
 BOT CHORD 29-30=-578/44, 28-29=-846/98, 27-28=-846/98, 24-25=0/1564, 23-24=0/2609, 22-23=0/2609, 21-22=0/2705, 20-21=0/2184, 19-20=0/975
 WEBS 2-33=-102/273, 3-30=-617/0, 5-30=-374/159, 7-27=-838/0, 5-29=-343/76, 9-27=-1510/0, 9-25=0/1069, 11-25=-1012/0, 11-24=0/644, 12-24=-766/0, 17-19=-1220/0, 17-20=0/803, 16-20=-771/0, 16-21=0/436, 14-22=-317/238

NOTES-

- Unbalanced floor live loads have been considered for this design.
- All plates are 3x4 MT20 unless otherwise indicated.
- Plates checked for a plus or minus 1 degree rotation about its center.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 33.
- Recommend 2x6 strongbacks, on edge, spaced at 10-0-0 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
- CAUTION, Do not erect truss backwards.



November 30, 2022


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSIP/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

Symbols


PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.

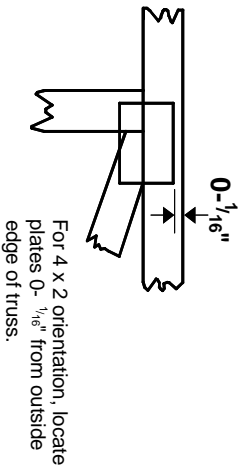

For 4 x 2 orientation, locate plates 0- $\frac{1}{16}$ " from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur. Min size shown is for crushing only.

Industry Standards:

ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-89: Design Standard for Bracing, Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

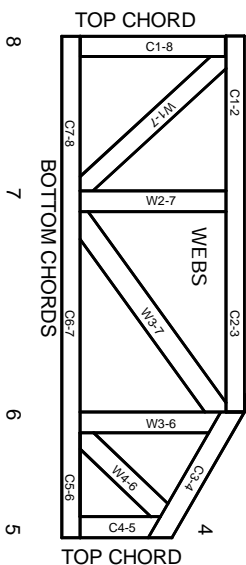

TOP CHORDS
BOTTOM CHORDS
WEBS

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ESR 1988
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MITek® All Rights Reserved



MITek Engineering Reference Sheet: Mill-7473 rev. 5/19/2020

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

- Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
- Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
- Never exceed the design loading shown and never stack materials on inadequately braced trusses.
- Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
- Cut members to bear tightly against each other.
- Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1.
- Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1.
- Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
- Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
- Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
- Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
- Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
- Lumber used shall be sheathed or purlins provided at spacing indicated on design.
- Top chords must be braced at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
- Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
- Connections not shown are the responsibility of others.
- Do not cut or alter truss member or plate without prior approval of an engineer.
- Install and load vertically unless indicated otherwise.
- Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
- Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
- Design assumes manufacture in accordance with ANSI/TP1 Quality Criteria.
- The design does not take into account any dynamic or other loads other than those expressly stated.




Client: Wellco Contractors
 Project: Plan 5
 Address: 89 Sugarberry Place
 Clayton, NC 27527

Date: 11/30/2022
 Input by: Jonathan Landry
 Job Name: Lot 122 Hidden Lakes
 Project #: J1122-5619

BM1 Kerto-S LVL 1.750" X 14.000" 2-Ply - PASSED

Level: Level

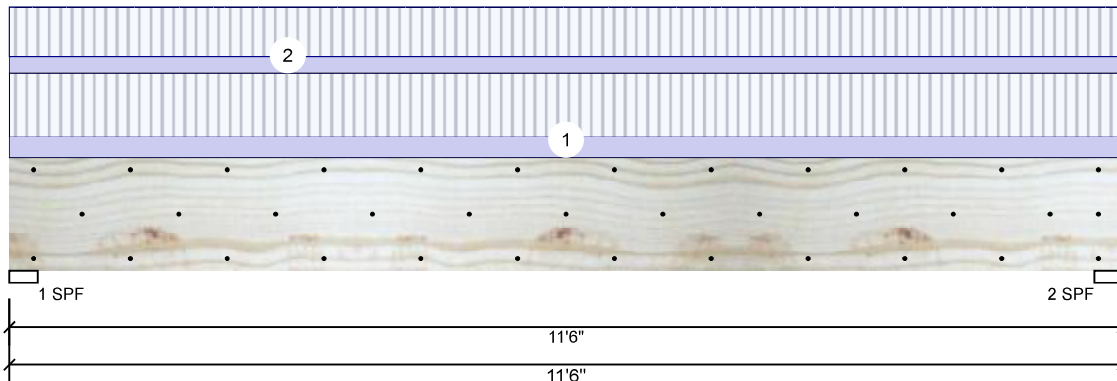

Member Information

Type: Girder
 Plies: 2
 Moisture Condition: Dry
 Deflection LL: 480
 Deflection TL: 240
 Importance: Normal - II
 Temperature: Temp <= 100°F

Application: Floor
 Design Method: ASD
 Building Code: IBC/IRC 2015
 Load Sharing: No
 Deck: Not Checked

Reactions UNPATTERNED lb (Uplift)

Brg	Direction	Live	Dead	Snow	Wind	Const
1	Vertical	3289	1161	0	0	0
2	Vertical	3289	1161	0	0	0

Bearings

Bearing	Length	Dir.	Cap.	React D/L lb	Total	Ld. Case	Ld. Comb.
1 - SPF	3.500"	Vert	85%	1161 / 3289	4450	L	D+L
2 - SPF	3.500"	Vert	85%	1161 / 3289	4450	L	D+L

Analysis Results

Analysis	Actual	Location	Allowed	Capacity	Comb.	Case
Moment	11794 ft-lb	5'9"	26999 ft-lb	0.437 (44%)	D+L	L
Unbraced	11794 ft-lb	5'9"	11799 ft-lb	1.000 (100%)	D+L	L
Shear	4224 lb	1'5 1/2"	10453 lb	0.404 (40%)	D+L	L
LL Defl inch	0.140 (L/946)	5'9"	0.276 (L/480)	0.507 (51%)	L	L
TL Defl inch	0.189 (L/699)	5'9"	0.552 (L/240)	0.343 (34%)	D+L	L

Design Notes

- 1 Provide support to prevent lateral movement and rotation at the end bearings. Lateral support may also be required at the interior bearings by the building code.
- 2 Fasten all plies using 3 rows of 10d Box nails (.128x3") at 12" o.c. Maximum end distance not to exceed 6".
- 3 Refer to last page of calculations for fasteners required for specified loads.
- 4 Girders are designed to be supported on the bottom edge only.
- 5 Top must be laterally braced at a maximum of 8'10 5/8" o.c.
- 6 Bottom must be laterally braced at end bearings.
- 7 Lateral slenderness ratio based on single ply width.

ID	Load Type	Location	Trib Width	Side	Dead 0.9	Live 1	Snow 1.15	Wind 1.6	Const. 1.25	Comments
1	Uniform			Far Face	107 PLF	321 PLF	0 PLF	0 PLF	0 PLF	F2
2	Uniform			Near Face	84 PLF	251 PLF	0 PLF	0 PLF	0 PLF	F4
	Self Weight				11 PLF					

Notes
 Calculated Structured Designs is responsible only of the structural adequacy of this component based on the design criteria and loadings shown. It is the responsibility of the customer and/or the contractor to ensure the component suitability of the intended application, and to verify the dimensions and loads.
Lumber
 1. Dry service conditions, unless noted otherwise
 2. LVL not to be treated with fire retardant or corrosive

Handling & Installation
 1. LVL beams must not be cut or drilled
 2. Refer to manufacturer's product information regarding installation requirements, multi-ply fastening details, beam strength values, and code approvals
 3. Damaged Beams must not be used
 4. Design assumes top edge is laterally restrained
 5. Provide lateral support at bearing points to avoid lateral displacement and rotation

6. For flat roofs provide proper drainage to prevent ponding
 This design is valid until 11/3/2024

Manufacturer Info
 Metsä Wood
 301 Merritt 7 Building, 2nd Floor
 Norwalk, CT 06851
 (800) 622-5850
 www.metsawood.com/us

Comtech, Inc.
 1001 S. Reilly Road, Suite #639
 Fayetteville, NC
 USA
 28314
 910-864-TRUS






Client: Wellco Contractors
 Project: Plan 5
 Address: 89 Sugarberry Place
 Clayton, NC 27527

Date: 11/30/2022
 Input by: Jonathan Landry
 Job Name: Lot 122 Hidden Lakes
 Project #: J1122-5619

BM1 Kerto-S LVL 1.750" X 14.000" 2-Ply - PASSED

Level: Level

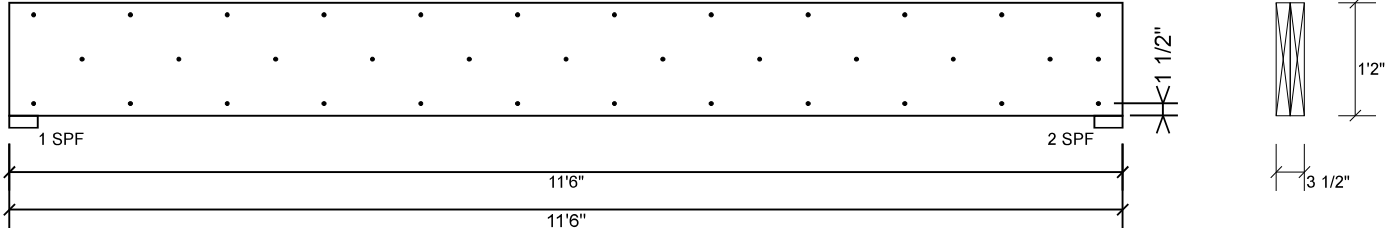

Multi-Ply Analysis

Fasten all plies using 3 rows of 10d Box nails (.128x3") at 12" o.c.. Maximum end distance not to exceed 6".

Capacity	87.1 %
Load	214.0 PLF
Yield Limit per Foot	245.6 PLF
Yield Limit per Fastener	81.9 lb.
Yield Mode	IV
Edge Distance	1 1/2"
Min. End Distance	3"
Load Combination	D+L
Duration Factor	1.00

Notes

Calculated Structured Designs is responsible only of the structural adequacy of this component based on the design criteria and loadings shown. It is the responsibility of the customer and/or the contractor to ensure the component suitability of the intended application, and to verify the dimensions and loads.

Lumber

1. Dry service conditions, unless noted otherwise
2. LVL not to be treated with fire retardant or corrosive

chemicals

Handling & Installation

1. LVL beams must not be cut or drilled
2. Refer to manufacturer's product information regarding installation requirements, multi-ply fastening details, beam strength values, and code approvals
3. Damaged Beams must not be used
4. Design assumes top edge is laterally restrained
5. Provide lateral support at bearing points to avoid lateral displacement and rotation

6. For flat roofs provide proper drainage to prevent ponding

This design is valid until 11/3/2024

Manufacturer Info

Metsä Wood
 301 Merritt 7 Building, 2nd Floor
 Norwalk, CT 06851
 (800) 622-5850
www.metsawood.com/us

Comtech, Inc.
 1001 S. Reilly Road, Suite #639
 Fayetteville, NC
 USA
 28314
 910-864-TRUS






Client: Wellco Contractors
 Project: Plan 5
 Address: 89 Sugarberry Place
 Clayton, NC 27527

Date: 11/30/2022
 Input by: Jonathan Landry
 Job Name: Lot 122 Hidden Lakes
 Project #: J1122-5619

GDH Kerto-S LVL 1.750" X 11.875" 2-Ply - PASSED

Level: Level

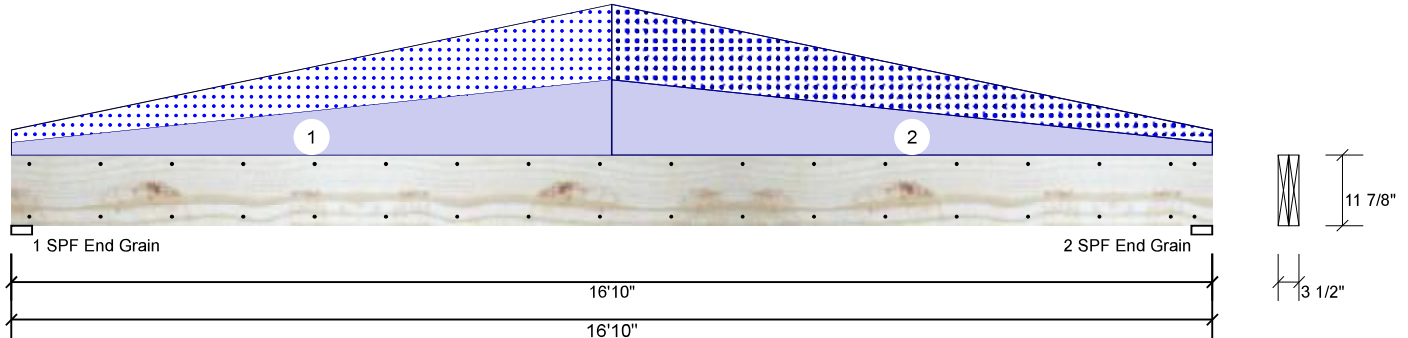

Member Information

Type: Girder
 Plies: 2
 Moisture Condition: Dry
 Deflection LL: 480
 Deflection TL: 240
 Importance: Normal - II
 Temperature: Temp <= 100°F

Application: Floor
 Design Method: ASD
 Building Code: IBC/IRC 2015
 Load Sharing: No
 Deck: Not Checked

Reactions UNPATTERNED lb (Uplift)

Brg	Direction	Live	Dead	Snow	Wind	Const
1	Vertical	0	961	884	0	0
2	Vertical	0	961	884	0	0

Bearings

Bearing	Length	Dir.	Cap.	React D/L lb	Total	Ld. Case	Ld. Comb.
1 - SPF End Grain	3.500"	Vert	18%	961 / 884	1845	L	D+S
2 - SPF End Grain	3.500"	Vert	18%	961 / 884	1845	L	D+S

Analysis Results

Analysis	Actual	Location	Allowed	Capacity	Comb.	Case
Moment	9115 ft-lb	8'5"	22897 ft-lb	0.398 (40%)	D+S	L
Unbraced	9115 ft-lb	8'5"	9123 ft-lb	0.999 (100%)	D+S	L
Shear	1736 lb	15'6 5/8"	10197 lb	0.170 (17%)	D+S	L
LL Defl inch	0.223 (L/880)	8'5 1/16"	0.409 (L/480)	0.545 (55%)	S	L
TL Defl inch	0.463 (L/425)	8'5 1/16"	0.819 (L/240)	0.565 (57%)	D+S	L

Design Notes

- 1 Provide support to prevent lateral movement and rotation at the end bearings. Lateral support may also be required at the interior bearings by the building code.
- 2 Fasten all plies using 2 rows of 10d Box nails (.128x3") at 12" o.c. Maximum end distance not to exceed 6".
- 3 Refer to last page of calculations for fasteners required for specified loads.
- 4 Girders are designed to be supported on the bottom edge only.
- 5 Top loads must be supported equally by all plies.
- 6 Top must be laterally braced at a maximum of 10'3 15/16" o.c.
- 7 Bottom must be laterally braced at end bearings.
- 8 Lateral slenderness ratio based on single ply width.

ID	Load Type	Location	Trib Width	Side	Dead 0.9	Live 1	Snow 1.15	Wind 1.6	Const. 1.25	Comments
1	Tapered Start	0-0-0		Top	30 PLF	0 PLF	30 PLF	0 PLF	0 PLF	C1GE
	End	8-5-0			180 PLF	0 PLF	180 PLF	0 PLF	0 PLF	
2	Tapered Start	8-5-0		Top	180 PLF	0 PLF	180 PLF	0 PLF	0 PLF	C1GE
	End	16-10-0			30 PLF	0 PLF	30 PLF	0 PLF	0 PLF	
	Self Weight				9 PLF					

Notes
 Calculated Structural Designs is responsible only of the structural adequacy of this component based on the design criteria and loadings shown. It is the responsibility of the customer and/or the contractor to ensure the component suitability of the intended application, and to verify the dimensions and loads.
Lumber
 1. Dry service conditions, unless noted otherwise
 2. LVL not to be treated with fire retardant or corrosive

Handling & Installation
 1. LVL beams must not be cut or drilled
 2. Refer to manufacturer's product information regarding installation requirements, multi-ply fastening details, beam strength values, and code approvals
 3. Damaged Beams must not be used
 4. Design assumes top edge is laterally restrained
 5. Provide lateral support at bearing points to avoid lateral displacement and rotation

6. For flat roofs provide proper drainage to prevent ponding

This design is valid until 11/3/2024

Manufacturer Info
 Metsä Wood
 301 Merritt 7 Building, 2nd Floor
 Norwalk, CT 06851
 (800) 622-5850
www.metsawood.com/us

Comtech, Inc.
 1001 S. Reilly Road, Suite #639
 Fayetteville, NC
 USA
 28314
 910-864-TRUS






Client: Wellco Contractors
 Project: Plan 5
 Address: 89 Sugarberry Place
 Clayton, NC 27527

Date: 11/30/2022
 Input by: Jonathan Landry
 Job Name: Lot 122 Hidden Lakes
 Project #: J1122-5619

GDH Kerto-S LVL 1.750" X 11.875" 2-Ply - PASSED

Level: Level

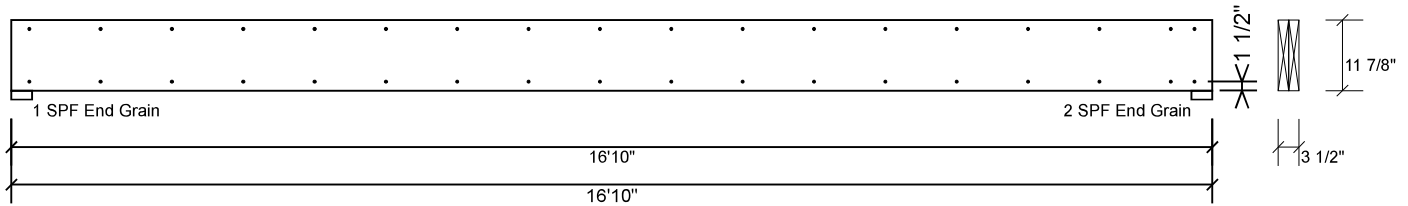

Multi-Ply Analysis

Fasten all plies using 2 rows of 10d Box nails (.128x3") at 12" o.c.. Maximum end distance not to exceed 6".

Capacity	0.0 %
Load	0.0 PLF
Yield Limit per Foot	163.7 PLF
Yield Limit per Fastener	81.9 lb.
Yield Mode	IV
Edge Distance	1 1/2"
Min. End Distance	3"
Load Combination	
Duration Factor	1.00

Notes

Calculated Structured Designs is responsible only of the structural adequacy of this component based on the design criteria and loadings shown. It is the responsibility of the customer and/or the contractor to ensure the component suitability of the intended application, and to verify the dimensions and loads.

Lumber

1. Dry service conditions, unless noted otherwise
2. LVL not to be treated with fire retardant or corrosive

Handling & Installation

1. LVL beams must not be cut or drilled
2. Refer to manufacturer's product information regarding installation requirements, multi-ply fastening details, beam strength values, and code approvals
3. Damaged Beams must not be used
4. Design assumes top edge is laterally restrained
5. Provide lateral support at bearing points to avoid lateral displacement and rotation

6. For flat roofs provide proper drainage to prevent ponding

This design is valid until 11/3/2024

Manufacturer Info

Metsä Wood
 301 Merritt 7 Building, 2nd Floor
 Norwalk, CT 06851
 (800) 622-5850
www.metsawood.com/us

Comtech, Inc.
 1001 S. Reilly Road, Suite #639
 Fayetteville, NC
 USA
 28314
 910-864-TRUS



Reaction Summary of Order



REQ. QUOTE DATE	//	ORDER #	J1122-5619
ORDER DATE	11/08/22	QUOTE #	
DELIVERY DATE	//	CUSTOMER ACCT #	0000006558
DATE OF INVOICE	//	CUSTOMER PO #	
ORDERED BY	Jason Wellons	INVOICE #	
COUNTY	Johnston	TERMS	Net 10 Days
SUPERINTENDANT	Jason Wellons	SALES REP	Lenny Norris
JOBSITE PHONE #	(910) 263-0276	SALES AREA	David Landry

WELLCO CONTRACTORS	Wellco Contractors, Inc. PO Box 766 Spring Lake, NC 28390 (910) 436-3131	JOB NAME: Lot 122 Hidden Lakes MODEL: Floor TAG: Plan 5 DELIVERY INSTRUCTIONS:	LOT # 122 SUBDIV: Hidden Lakes JOB CATEGORY: B & S - Build and Ship
	Wellco Contractors 89 Sugarberry Place Clayton, NC 27527	SPECIAL INSTRUCTIONS: Copied from Lot 113 Hidden Lakes (J0722-3619)	PLAN SEAL DATE: N/A

BUILDING DEPARTMENT	OVERHANG INFO	HEEL HEIGHT	00-04-05	REQ. LAYOUTS	REQ. ENGINEERING	QUOTE	JL	DATE
Floor Order	END CUT RETURN					LAYOUT	JL	11/11/22
	PLUMB NO	GABLE STUDS	16 IN. OC	JOBSITE 1	JOBSITE 1	CUTTING	JL	11/11/22

FLOOR TRUSSES

LOADING INFORMATION

TCLL-TCDL-BCLL-BCDL	STRESS INCR.
40.0,10.0,0.0,5.0	1.00

FLOOR TRUSS SPACING: 24.0 IN. O.C. (TYP.)

FLOOR PROFILE	QTY	DEPTH ID	BASE SPAN	O/A SPAN	END TYPE		INT BEARING		REACTIONS				
					LEFT	RIGHT	SIZE	LOCATION					
	1	01-02-00 ET1	28-06-00	28-06-00					Joint 25 -19.5 lbs.	Joint 26 123.6 lbs.	Joint 27 152.0 lbs.	Joint 28 145.3 lbs.	Joint 29 147.0 lbs.
	1	01-02-00 ET2	25-11-00	25-11-00					Joint 23 -7.3 lbs.	Joint 24 120.6 lbs.	Joint 25 152.0 lbs.	Joint 26 145.3 lbs.	Joint 27 147.0 lbs.
	5	01-02-00 F1	28-06-00	28-06-00					Joint 19 769.8 lbs. 171.6 lbs.	Joint 27 1839.1 lbs. 1067.4 lbs.	Joint 32 594.3 lbs. 64.1 lbs.		
	6	01-02-00 F2	15-09-12	15-09-12					Joint 10 849.7 lbs. 440.4 lbs.	Joint 17 855.9 lbs. 447.4 lbs.			
	2	01-02-00 F3	16-01-04	16-01-04					Joint 11 865.7 lbs. 399.7 lbs.	Joint 19 865.7 lbs. 460.3 lbs.			
	3	01-02-00 F4	12-04-12	12-04-12					Joint 9 668.0 lbs. 341.6 lbs.	Joint 14 661.8 lbs. 340.4 lbs.			
	5	01-02-00 F5	06-05-04	06-05-04					Joint 7 334.1 lbs. 170.8 lbs.	Joint 10 340.3 lbs. 172.0 lbs.			
	5	01-02-00 F6	25-11-00	25-11-00					Joint 19 785.1 lbs. 215.6 lbs.	Joint 27 1395.1 lbs. 575.9 lbs.	Joint 30 604.9 lbs. 281.1 lbs.	Joint 33 159.0 lbs. -78.7 lbs.	

ITEMS

QTY	ITEM TYPE	SIZE	LENGTH FT-IN-16	PART NUMBER	NOTES
-----	-----------	------	--------------------	-------------	-------

Reaction Summary of Order



REQ. QUOTE DATE	//	ORDER #	J1122-5619
ORDER DATE	11/08/22	QUOTE #	
DELIVERY DATE	//	CUSTOMER ACCT #	0000006558
DATE OF INVOICE	//	CUSTOMER PO #	
ORDERED BY	Jason Wellons	INVOICE #	
COUNTY	Johnston	TERMS	Net 10 Days
SUPERINTENDANT	Jason Wellons	SALES REP	Lenny Norris
JOBSITE PHONE #	(910) 263-0276	SALES AREA	David Landry

WELLCO CONTRACTORS	Wellco Contractors, Inc. PO Box 766 Spring Lake, NC 28390 (910) 436-3131	JOB NAME: Lot 122 Hidden Lakes MODEL: Floor TAG: Plan 5 DELIVERY INSTRUCTIONS:	LOT # 122 SUBDIV: Hidden Lakes JOB CATEGORY: B & S - Build and Ship
	Wellco Contractors 89 Sugarberry Place Clayton, NC 27527	SPECIAL INSTRUCTIONS: Copied from Lot 113 Hidden Lakes (J0722-3619)	PLAN SEAL DATE: N/A

BUILDING DEPARTMENT	OVERHANG INFO	HEEL HEIGHT	00-04-05	REQ. LAYOUTS	REQ. ENGINEERING	QUOTE	BY	DATE
Floor Order	END CUT RETURN					JL		11/11/22
	PLUMB NO	GABLE STUDS	16 IN. OC	JOBSITE	1	JL		11/11/22

ITEMS

QTY	ITEM TYPE	SIZE	LENGTH FT-IN-16	PART NUMBER	NOTES
19	Hangers, USP	HUS 410			SIMPSON (HUS410)
2	LVL Beams (Sized)	LVL, 1-3/4" x 11-7/8" (S)	22-00-00		GDH
2	LVL Beams (Sized)	LVL, 1-3/4" x 14" (S)	12-00-00		BM1