

### **ECS Southeast, LLP**

6151 Raeford Road, Suite A Fayetteville, NC 28304 9104013288 9103230539

### **LETTER OF TRANSMITTAL**

July 12, 2023

W.S. Wellons Realty

PO Box 766

Spring Lake, NC 28390

ATTN: Chandler Jones

RE: Lot 124 HLN ECS Job # 33:6230-D

Permits:

Location: 41 Sugarberry PI

Spring Lake, NC 28390

 $\underline{X}$  Field Reports  $\underline{X}$  For your use  $\underline{X}$  As requested

CC:

ENCL:

Field Report # 2 7/12/2023

**JUL 12 2023** 

Jack Cowsert, Office Manager Aaron Kyle Adair Team Leader

#### Disclaimer

<sup>1.</sup> This report (and any attachments) shall not be reproduced except in full without prior written approval of ECS.

<sup>2.</sup> The information in this report relates only to the activities performed on the report date.

<sup>3.</sup> Where appropriate, this report includes statements as to compliance with applicable project drawings, and specifications for the activities, performed on this report date.

<sup>4.</sup> Incomplete or non-conforming work will be reported for future resolution.

<sup>5.</sup> The results of samples and/or specimens obtained or prepared for subsequent laboratory testing will be presented in separate reports/documents.



ECS Southeast, LLP 6151 Raeford Road, Suite A Fayetteville, NC 28304 (910) 401-3288 [Phone] (910) 323-0539 [Fax]

Project Lot 124 HLN

Location Spring Lake, NC

W.S. Wellons Realty Client

Contractor W.S. Wellons Realty

## FIELD REPORT

Project No. 33:6230-D

Report No.

Day & Date Wednesday 7/12/2023

Weather 90 °/ Sunny

On-Site Time 1.75 Lab Time 0.00 Travel Time\* 0.00 Total 1.75 0.00

Re Obs Time

Remarks

Tolls/Parking\* Trip Charges\* Mileage\* Time of Departure Arrival Chargeable Items 1:30P 3:15P


Summary of Services Performed (field test data, locations, elevations & depths are estimates) & Individuals Contacted.

ECS Representative arrived on site, as requested, to check the bearing capacity of soils via hand auger/DCP method (ASTMSTP-399) for foundation footings. Please see the attached sketch and data sheet for details.


A total of 4 hand auger/DCP evaluations were performed to a depth of approximately 3 feet below the current footing sub grade elevation. Test results indicated that the materials in place (at the locations and elevations tested) did appear to be suitable to support the design bearing capacity 2,000 psf.

ECS will return upon request.

<sup>\*</sup> Travel time and mileage will be billed in accordance with the contract.

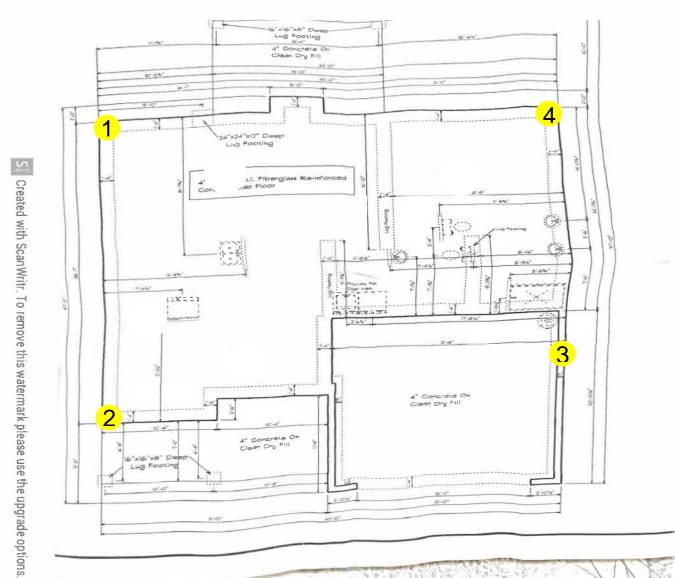

George Oxendine 7/12/2023 Lot 124 HLN Proj#:6230-D

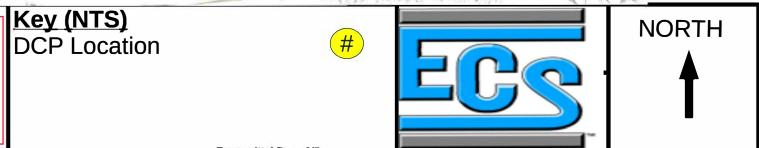

#### NC Registered Firm # F-1078



# **Report of Spread Footing - Foundation Observations**

Project: Lot 124 HLN Project No.: 33:6230-D 41 Sugarberry PI Day/Date: 7/12/2023 Location:

Spring Lake - Cumberland - NC - 28390
Contractor: W.S. Wellons Realty

Footing Number	Location	Size (W x H x L)		Footing Bottom Elevation			D	Required Blow Counts	Daainn
		Design	Actual	Design **	Depth of Undercut (in)	Description of Steel Placed	Description of Subgrade Material	# of Blows / Increment	Design Bearing Pressure
1	N.W Corner	хх	хх	N/A				6 (0)3,4,5(-1)5,6,6(-2) 8,9,10(-3)10,11,10	2000
2	S.W Corner	хх	хх	N/A			(0)/-3 Orange clay Sand	6 (0)5,4,5(-1)6,8,9(-2) 13,11,13(-3)11,11,8	2000
3	S.E Corner	хх	хх	N/A				6 (0)2,4,5(-1)8,7,6(-2) 8,10,11(-3)8,5,7	2000
3	N.E Corner	хх	x x	N/A				6 (0)3,5,5(-1)5,6,6(-2) 6,8,11(-3)5,7,7	2000

** SGE: Subgrade Elevation to be determined by surveyor.	By: George Pate Oxendine Jr.	
		ECS Southeast, LLP

WO: 73092