

ECS Southeast, LLP

6151 Raeford Road, Suite A Fayetteville, NC 28304 9104013288 9103230539

LETTER OF TRANSMITTAL

October 18, 2023 W.S. Wellons Realty

PO Box 766

Spring Lake, NC 28390

ATTN: Chandler Jones

Lot 134 HLN RE: ECS Job # 33:6230-I

Permits:

Location:

46 Sugarberry Place

Spring Lake, NC 28390

For your use X As requested X Field Reports X

CC:

ENCL: Field Report # 1

Office Manager

10/17/2023

OCT 18 2023

Aaron Kyle Adair Team Leader

Disclaimer

2. The information in this report relates only to the activities performed on the report date.

4. Incomplete or non-conforming work will be reported for future resolution.

^{1.} This report (and any attachments) shall not be reproduced except in full without prior written approval of ECS.

^{3.} Where appropriate, this report includes statements as to compliance with applicable project drawings, and specifications for the activities, performed on this report date.

^{5.} The results of samples and/or specimens obtained or prepared for subsequent laboratory testing will be presented in separate reports/documents.



ECS Southeast, LLP 6151 Raeford Road, Suite A Fayetteville, NC 28304 (910) 401-3288 [Phone] (910) 323-0539 [Fax]

Project

Lot 134 HLN

Location

Spring Lake, NC

Client

W.S. Wellons Realty

Contractor

W.S. Wellons Realty

FIELD REPORT

Project No.

33:6230-I

Report No.

Day & Date

Tuesday 10/17/2023

Weather

65 °/ Sunny

On-Site Time Lab Time

1.50 0.00

Travel Time*

Total

0.00

1.50

Re Obs Time

0.00

Remarks

Trip Charges*

Chargeable Items

Tolls/Parking*

Mileage*

Time of

Arrival

4:00P

Departure 5:30P


Summary of Services Performed (field test data, locations, elevations & depths are estimates) & Individuals Contacted.

ECS arrived on site, as requested, to check the bearing capacity of soils via hand auger/DCP (ASTM STP-399) method for footing prior to placement of concrete. Please see the attached sketch and data sheet for details.

A total of 4 hand auger/DCP evaluations were performed to a depth of approximately 3 feet below the current footing sub grade elevation. Test results indicated that the materials in place, at the locations and elevations tested, did appear to be suitable to support the design bearing capacity of 2,000 psf.


ECS will return upon request.


^{*} Travel time and mileage will be billed in accordance with the contract.

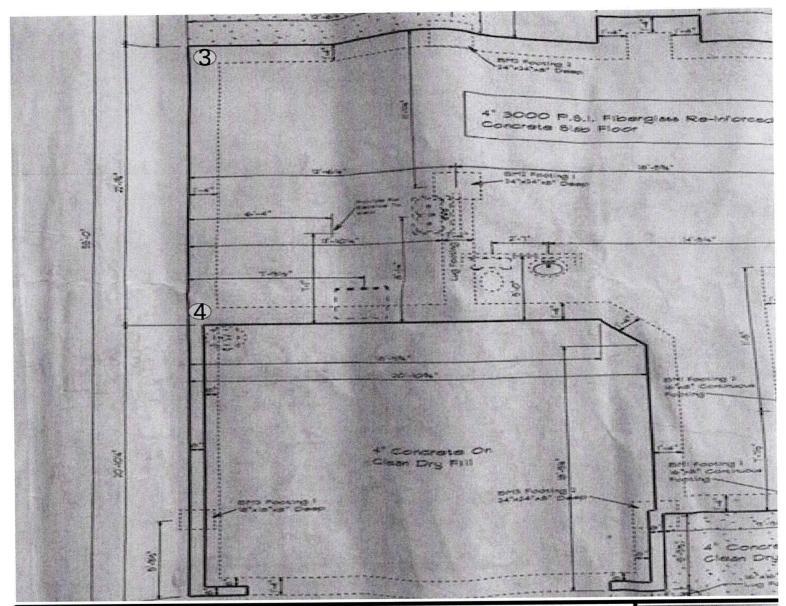

Todd T. Davis 10/17/2023 Lot 134 – 46 Sugarberry Proj #: 6230-I W/O # 74787

Key (NTS) Hand Auger / DCP Test Location --- ⊕



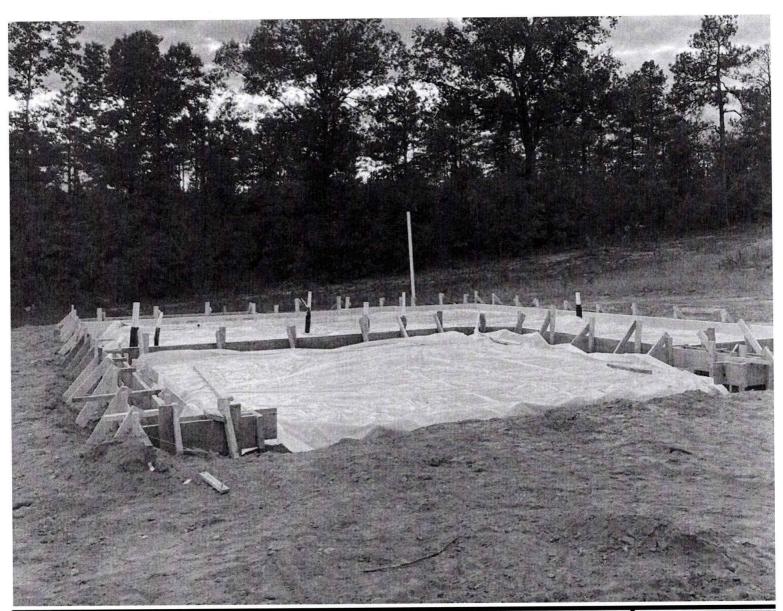

Todd T. Davis 10/17/2023 Lot 134 – 46 Sugarberry Proj #: 6230-I W/O # 74787

Key (NTS) View of Lot 134 – 46 Sugarberry Place



NC Registered Firm # F-1078



Report of Spread Footing - Foundation Observations

Project:

Lot 134 HLN

Location:

46 Sugarberry Place Spring Lake - Cumberland - NC - 28390

Contractor: W.S. Wellons Realty

Project No.: 33:6230-I

Day/Date: 10/17/2023

	Location	Size (W x H x L)		Footing Bottom Elevation				Re
Footing Number		Design	Actual	Design **	Depth of Undercut (in)	Description of Steel Placed	Subgrade Material	#
1		x x	x x	N/A	N/A		(0-3) Tan-Red Silty Sand	6 (0 8,
2		хх	x x	N/A	N/A		(0-3) Tan Silty Sand	6 (0 6,
3		x x	x x	N/A	N/A		(0-3) Tan-Brown Silty Sand	6 (0 7,
4	v	хх	хх	N/A	N/A		(0-3) Tan-Brown Silty Sand	6 (0 5,

** SGE: Subgrade Elevation to be determined by surveyor.	By:	Todd Davis

ECS Southeast, LL

Transmittal Page 5/5