

# Harnett County Department of Public Health

PERMIT # SFP2301-0075

## Operation Permit

New Installation  
  Septic Tank  
  Nitrification Line  
  Repair  
  Expansion

PROPERTY LOCATION: 70 SUGARBERRY

Name: (owner) WELCO CONTRACTORS    SUBDIVISION ROLLING SPRINGS    LOT # 135

System Installer: YELLOW DOG

Basement with plumbing:     Garage     Number of Bedrooms 3


Type of Water Supply:  Community,  Public     Well    Distance from well \_\_\_\_\_ feet

System Type: Htg    Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

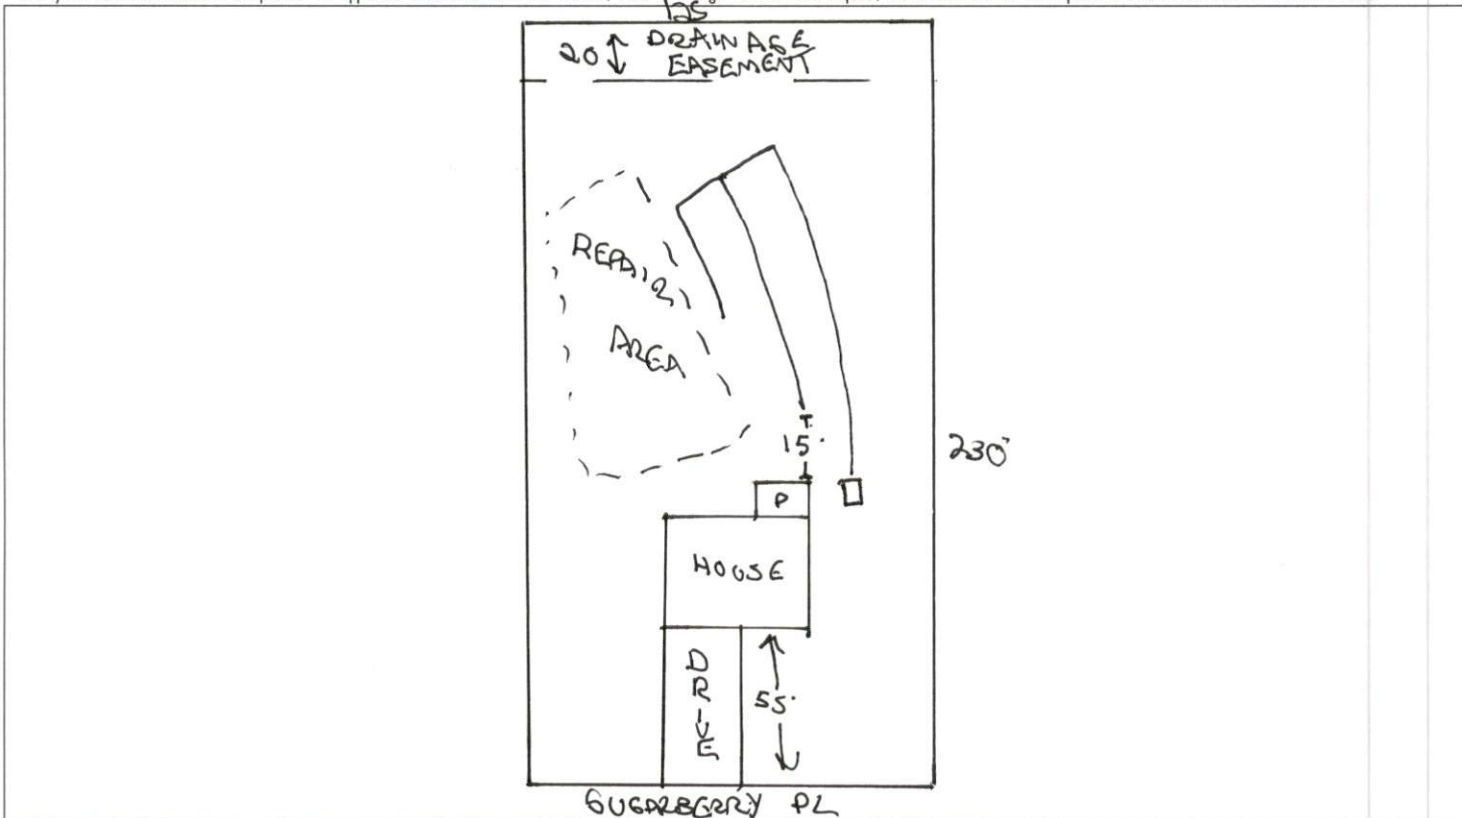

**PERMIT CONDITIONS:**

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_  
 Subsurface system operator required? Yes  No   
 If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: \_\_\_\_\_
- V. Other: \_\_\_\_\_

D-Box  
  Pump  
  Alarm  
  H2O Line  
  PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional     Other CHAMBER (QW)    Septic Tank: 1000 gallons    Pump Tank: \_\_\_\_\_ gallons  
 Subsurface Drainage Field: No. of ditches 1    exact length of each ditch 180 feet    width of ditches 3 feet    depth of ditches 24-18 inches  
 French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent: [Signature]    Date: 3/5/24