SOUTHPORT INVENTORY MARKED

Dream Finders Homes

SHEET COVER

HOME FINDER

DATE: SEPTEMBER 16, 20 REV - ALIGUST 01, 2021 DRAWN BY-NGINEERED BY:


SOUTHPORT **REVISION LIST - STRUCTURAL:**

- COMBINED WILMINGTON AND WILMINGTON II PLANS. (2-18)
- ADDED BRICK OPTION ON SECOND FLOOR. (2-18)
- CALLED OUT SERIES/SPACING OF LIOISTS ON BASEMENT. (2-18)
- 2018 NCRC UPDATE (6-19)
- 2018 SC IRC (2-15-20)
- ADDED ELEVATION A.2 (BRICK WATERTABLE W/SIDING ABOVE) & ELEVATION A.3 (STONE WATERTABLE W/SIDING ABOVE), (2-15-20)

SOUTHPORT **REVISION LIST - ARCHITECTURAL:**

- CREATED ELEVATIONS TO BE IN STANDARDS WITH OTHER PLANS (SEE SHEETS A-1 THROUGH A-3.5)
- CHANGED COLUMNS ON ELEVATIONS TO STANDARD COLUMNS
- CHANGED GARAGE DOORS TO REPRESENT STANDARD GARAGE DOOR FOR EACH ELEVATION
- FIXED COVERED PORCH TO KEEP COLUMNS FROM OVERLAPPING EDGE OF CONCRETE
- REMOVED GRIDS FROM TRANSOMS ABOVE FRONT DOOR
- ADDED NOTE FOR GARAGE DOOR "GARAGE DOOR PER SPECIFICATIONS AND GLASS INSERT (TOP PANEL ONLY)"
- MOVED ROOF PLANS TO SHEETS A-8 & A-8.1
- CREATED SLAB INTERFACE PLAN (SEE SHEET A4 THROUGH A4.2)
- MOVED ALL OPTIONS OFF BASE PLAN AND PLACED ON SEPARATE SHEET
- ADDED NOTE FOR FLUSH COUNTERTOP ON ISLAND
- CHANGED PATIO SIZE TO STANDARD 12'X10'
- ADDED OPTIONAL GAS LINE
- CHANGED KITCHEN LAYOUT
- ADDED 2ND HOSE BIB
- 15. CALLED OUT "45" WALL WITH CAP" AS STANDARD
- CHANGED ALL EXTERIOR WALLS FROM 2X6 TO 2X4 EXCEPT WHERE SHADED
- ADDED NOTE "OPT REF."
- REMOVED NUMBERS ON STAIRS
- ADDED NOTE "OPT. W/D"
- ADDED NOTE "WASHER ALWAYS TO BE LOCATED TO THE LEFT OF DRYER
- VERIFIED VENTILATION AND LIGHT REQUIREMENTS AT OWNER'S BEDROOM MEETS CODE (11-01-20)
- SQUARE FOOTAGES ARE UPDATED AND CHANGED DUE TO MOVEMENT OF WALLS FROM 2X6 TO 2X, TO KEEP JOGS IN ROOMS, EXTERIOR WALL MOVED MEANING ROOF LINES HAVE CHANGED
- SQUARE FOOTAGE OF COVERED PORCH CHANGED DUE TO KEEPING COLUMNS FROM OVERLAPPING CONCRETE EDGE
- CREATED PARTIAL PLANS FOR B & C ELEVATIONS (FLOOR, SLAB, & ELECTRICAL)
- REMOVED ALL WALL OUTLETS
- REMOVED ALL PHONE OUTLETS
- REMOVED ALL TV OUTLETS
- PLACED STANDARD 3 BUILB LIGHT IN KITCHEN
- VERIFIED COACH LIGHT LOCATIONS (SEE ELEVS. FOR DIMS.)
- PLACED DASHED FANS WHERE APPLICABLE WITH NOTE "STD. LIGHT, OPT. FAN/LT PREWIRE"
- 31. LIPDATED ELECTRICAL KEY
- VERIFIED CO2 DETECTOR LOCATIONS
- SHOWED PENDANT LIGHTS AS OPTIONAL
- SHOWED CAN LIGHTS IN KITCHEN AND FAMILY ROOM AS "OPTIONAL CAN LIGHTS"
- PLACED OPTIONAL FLOOD LIGHTS
- PLACED OPTIONAL FLOOR OUTLET IN FAMILY ROOM
- PLACED CALCULATIONS FOR SOFFIT AND RIDGE VENT REQUIREMENTS
- UPDATED STAIR LAYOUT TO KEEP MAIN WALL AT KITCHEN FROM MOVING WHEN OPTIONAL BASEMENT SELECTED.



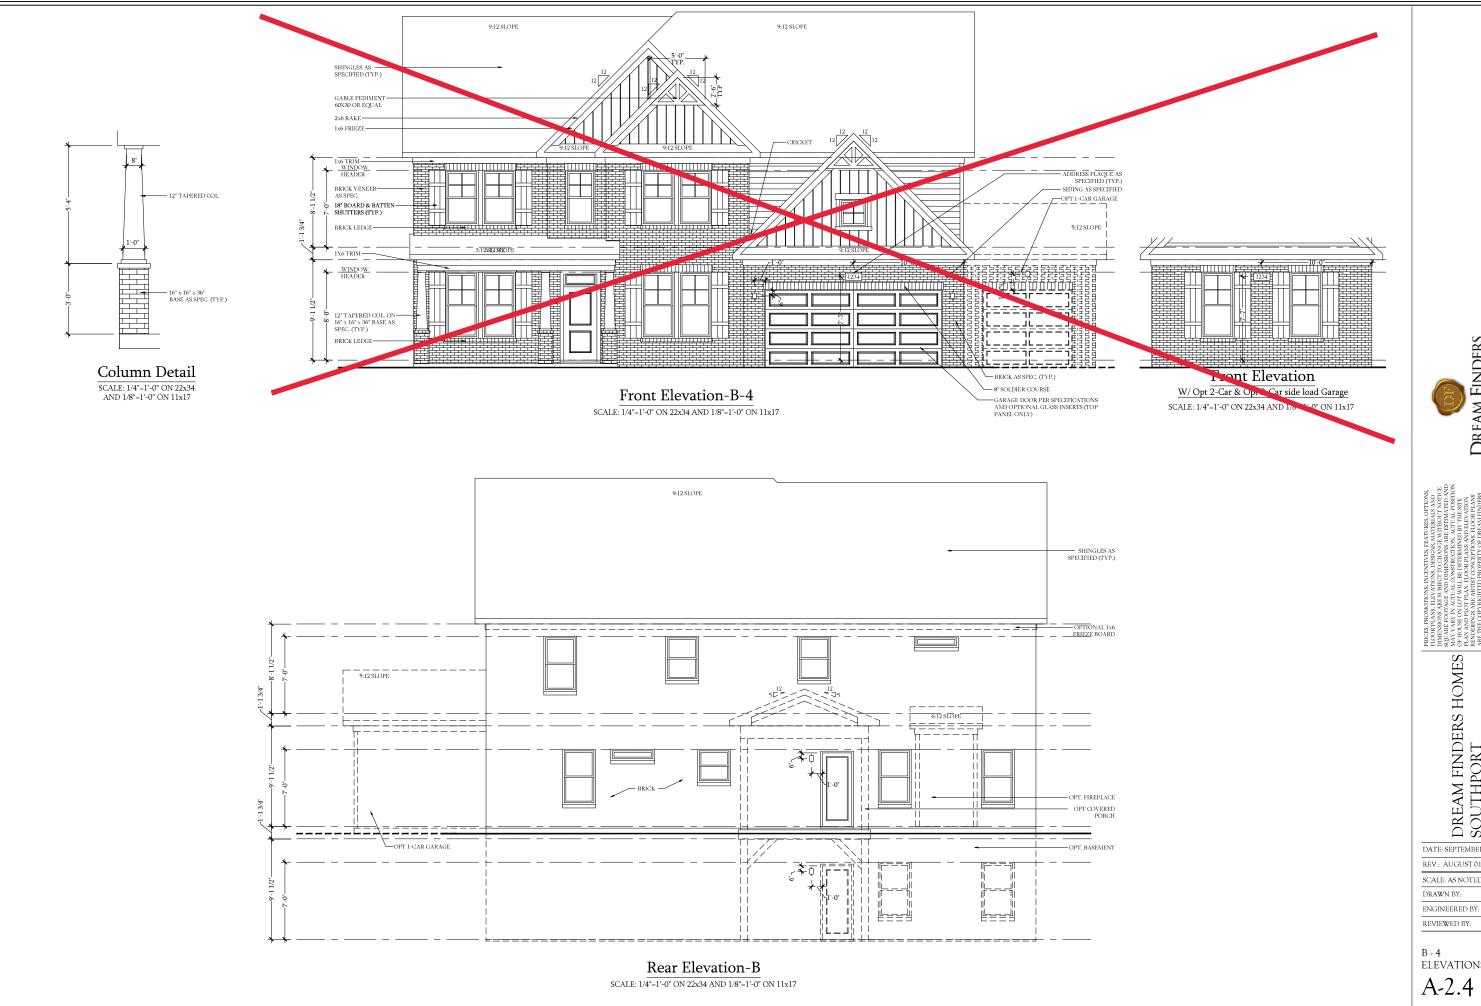

Dream Finders Homes

PRICES, F FLOOR PI DIMENSIS SQUARE: MAY VAN OF HOUS PLAN AN RENDERI ARE THE HOMES. A HOMES. A


DREAM FINDERS HOMES SOUTHPORT


DATE: SEPTEMBER 16, 2019 REV.: AUGUST 01, 2021

SCALE: AS NOTED

REVIEWED BY:

ELEVATIONS

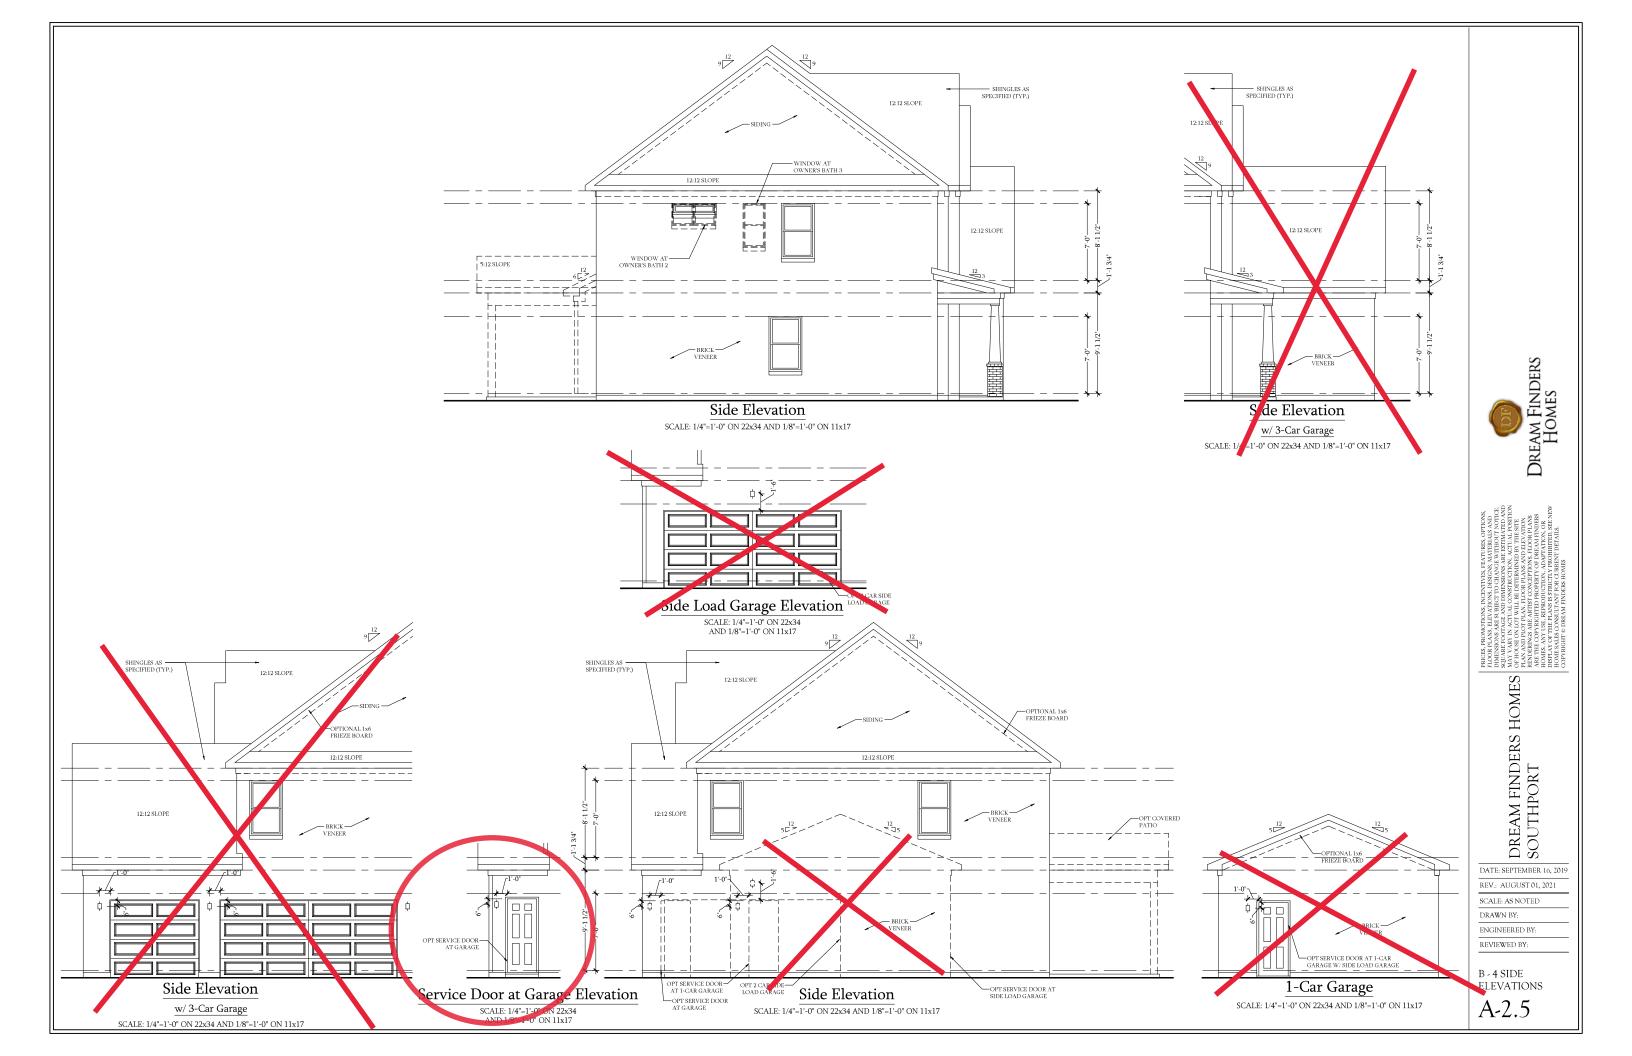

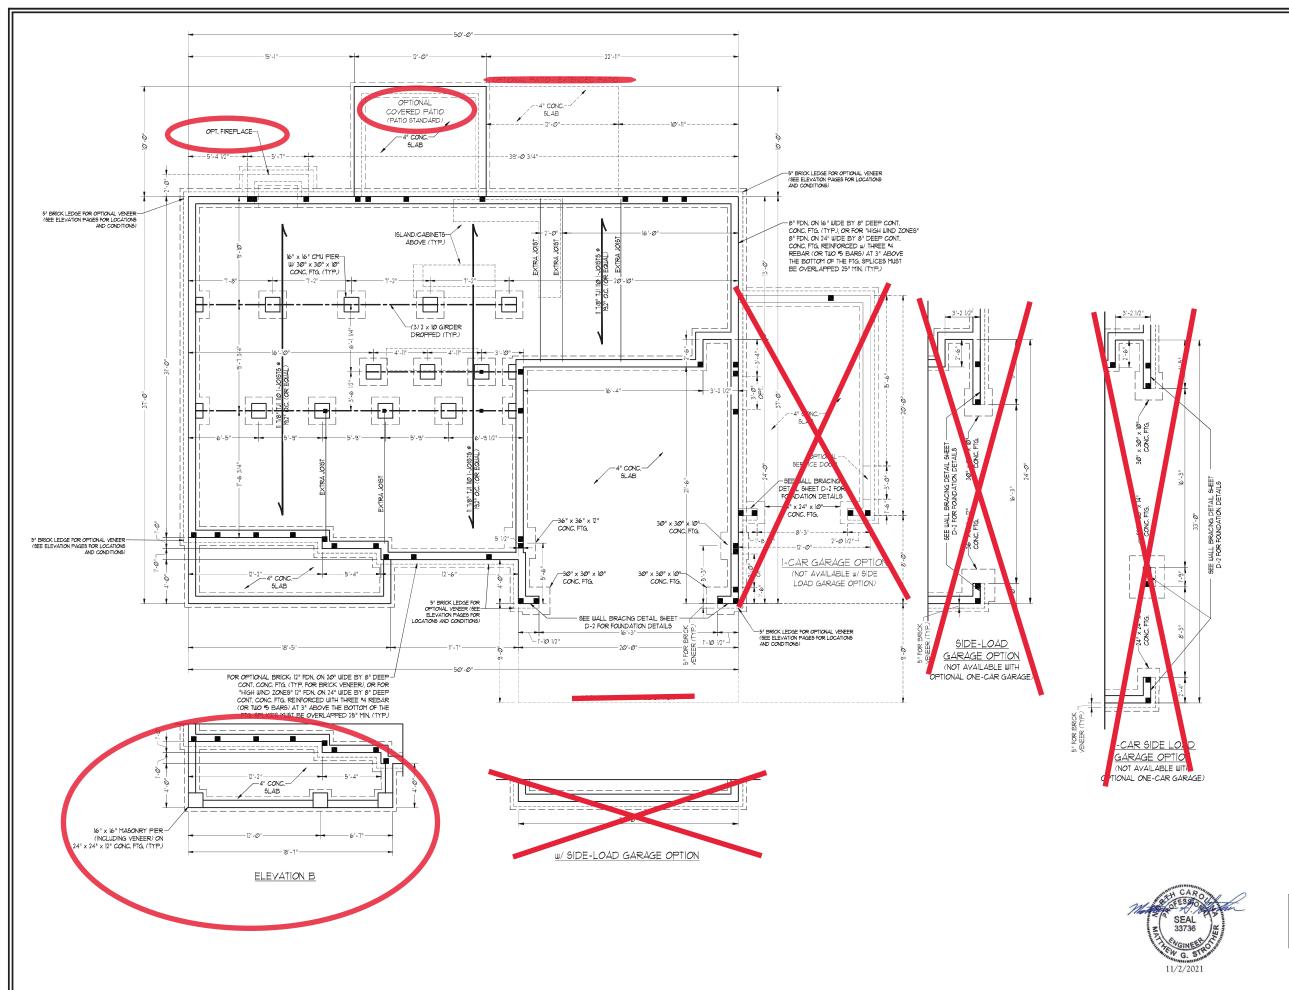

150 MPH ULTIMATE DESIGN WIND SPEED NOTES FOR LESS THAN 30' MEAN ROOF HEIGHT:

30' MEAN ROOF HEIGHT:

BNAINERS SEAL APPLIES ONLY TO

STRUCTURAL COPONENTS, BYSIMEERS

SEAL DOES NOT CERTIFY DIPENSIONAL

ACCURACY OR ACCURTED THE STRUCTURAL LATOUT

NCLIUDNS ROOF SYSTEM.

TRICLURAL DESIGN PER NORTH

CAROLINA RESIDENTIAL CODE, 2008

EDITION WITH PEGILAL CONSIDERATION TO

CHAPTER 48 ("HIGH WIND ZONES" FOR BO

PHY WINDS).

BUILDER 15 TO PROVIDE RAVINING

CONNECTIONS AS REQUIRED BY CHAPTER

45 ("HIGH WIND ZONES" FOR BO

PHY WINDS).

BUILDER 16 TO PROVIDE RAVINING

CONNECTIONS AS REQUIRED BY CHAPTER

45 ("HIGH WIND ZONES" FOR BO

PHY WINDS).

BUILDER 16 TO PROVIDE RAVINING

AS REGULED BY CHAPTER

45 ("HIGH WIND ZONES" FOR BO

PHY WINDS).

BUILDER 16 TO PROVIDE RAVINING

AS REGULED BY CHAPTER

45 ("HIGH WIND ZONES" FOR BO

PHY WINDS).

BUILDER 16 TO ROST LOCATION

18 HE NORTH CAROLINA

RESIDENTIAL CODE, 2008 BDTION

PEAN ACCOPAGE BY COLOR CAST PRE
AND 32 PSF ("A. NDICALE POSITIVE")

ROOF CLADDING DESIGNED FOR 423 PSF

AND 33 PSF ("A. NDICALE POSITIVE")

ROOF CLADDING DESIGNED FOR 222 PSF

AND 33 PSF ("A. NDICALE POSITIVE")

ROOF CLADDING DESIGNED FOR 222 PSF

AND 33 PSF ("A. NDICALE POSITIVE")

ROOF CLADDING DESIGNED FOR 222 PSF

AND 33 PSF ("A. NDICALE POSITIVE")

ROOF CLADDING DESIGNED FOR 223 PSF

AND 33 PSF ("A. NDICALE POSITIVE")

ROOF CLADDING DESIGNED FOR 223 PSF

AND 33 PSF ("A. NDICALE POSITIVE")

ROOF CLADDING DESIGNED FOR 223 PSF

AND 33 PSF ("A. NDICALE POSITIVE")

ROOF CLADDING DESIGNED FOR 223 PSF

AND 33 PSF ("A. NDICALE POSITIVE")

ROOF CLADDING DESIGNED FOR 223 PSF

AND 33 PSF ("A. NDICALE POSITIVE")

ROOF CLADDING DESIGNED FOR ROOF PITCHED 223 PSF FOR ROOF

PITCHED 223 PSF ("A. NDICALE POSITIVE")

166 CSS SEALTHING IS REQUIRED ON ALL

166 CSS SEALTHING IS REQUIRED ON ALL

PITCHED 23/07 TO 1/17,
1/6 /056 94-54Thins is REQUIRED ON ALL
EXTERIOR UALLS

WILLS TO BE BRACED IN ACCORDANCE
WITH SECTION REQUIRED OF THE NORTH
CAROLINA REPORTINIAL CODE 1/16
EDITION AND AS NOTED ON FLAWS.
DERROY SETTICENT COMPLIANCE AND
NSLATION VALUES OF THE BUILDING TO
THE IN ACCORDANCE WITH CHAPTER II OF
THE NORC, 20/08 EDITION.

120 MPH ULTIMATE DESIGN WIND SPEED NOTES FOR LESS THAN 30' MEAN ROOF HEIGHT:

I. ENGINEER'S SEAL APPLIES ONLY 10' O STRUCTURAL COMPONENTS, ENGINEER'S SEAL DOES NOT CENTER' D'IMBRONS SEAL ACCURACY OR ARCHITECTURAL LAYOUT NCLUDIA'S ROOF SYSTEM.

2. STRUCTURAL DESIGN FER NORTH CAROLINA RESIDENTIAL CODE, 20'S EDITION.

3. NISTALL 10' ANCHOR BOLTS 6'-0" OC. AND UNITHIN 1-0" FROM BOLTS 6'-0" OC. AND UNITHIN 1-0" THO THOU BOUT OF CONCRETE LOCATE.

ANCHOR BOLTS HUST EXTEND A TIMINATION OF TIMINOT WASONITY OR CONCEPT. LOCATE BOLT UITHIN MIDDLE THIRD OF PLATE UIDTH.

I PERA NODE HIGHT IS LESS THAN 30 PEET.

5. EVIEROR UILLE DESCARD FOR 120 PHY UINDS.

6. WALL CLADDING DESIGNED FOR 160 PHY UINDS.

6. WALL CLADDING DESIGNED FOR 165 PGF AND -20 PGF (1-1 NDICATE POSITIVE / NEGATIVE PRESSURE (TYP).

7. ROD'CLADDING DESIGNED FOR 142 PGF AND -36 PGF FOR ROD'C PTICHED 125/10 TO 1/2.

AND 160 PGF AND -36 PGF FOR ROD'C PTICHED 125/10 TO 1/2.

AND 160 PGF AND -36 PGF FOR ROD'C PTICHED 125/10 TO 1/2.

NISTALL TIME '058 SHEATHING ON ALL EXTERIOR UILLE OF ALL STORIES IN ACCORDANCE WITH CERTICAL SHEET FOR MORE INFORMATION. SHEET FOR MORE INFORMATION OF THE WALL BEACHES MOTES AND DETAIL SHEET FOR MORE INFORMATION OF THE BULLDING TO BE IN ACCORDANCE WITH CHAPTER IN GF THE NORM, 2006 EDITION.

RETHER TO NOTICE AND DETAIL SHEETS FOR ADDITIONAL STRUCTURAL INFORMATION.

STRUCTURAL NOTES:

ALL FRAMING LUMBER TO BE *2 SPF (UNO). ALL TREATED LUMBER TO BE *2 SYP (UNO.) INSTALL AN EXTRA OR DOUBLE

. NOTALL AN EXTRA OR DOUBLE JOIST WHERE WALLS PARALLEL TO FLOOR JOISTS WHERE NOTED ON THE PLANS.

SQUARES DENOTE POINT LOADS WHICH REQUIRE SOLID BLOCKING TO GIRDER OR FOUNDATION.

. SHADED PIERS TO BE FILLED

SALUED PIERS TO BE FILLED SOLID.

INSTALL LADDER WIRE & 16" O.C. TO SECURE MULTIPLE WYTHE FOUNDATION WALLS TOGETHER.

6. REFER TO NOTES AND DETAIL SHEETS FOR ADDITIONAL STRUCTURAL INFORMATION.

NOTE:

BCI 4500%-18 JOISTS MAY BE USED IN LIEU OF TJI 110 JOISTS AT THE DEPTH AND SPACING NOTED ON THE PLAN.

SCALE: 1/4" = 1'-0" DRAWN BY: H&H HOMES

DATE: NOVEMBER 2, 2021

NGINEERED BY: WFB

SHEET: 1 OF: 9 S-1a CRAWL FOUNDATION PLAN


27605 921

S S ഗ

ERING, SUITE 104 RALEIGH, 1893-819 FAX: (919) 78

S.TH(
S.TH(
NGINE
606 WADE AVE., SUIT)
PHONE, (910)

SOUTHPORT H&H HOMES

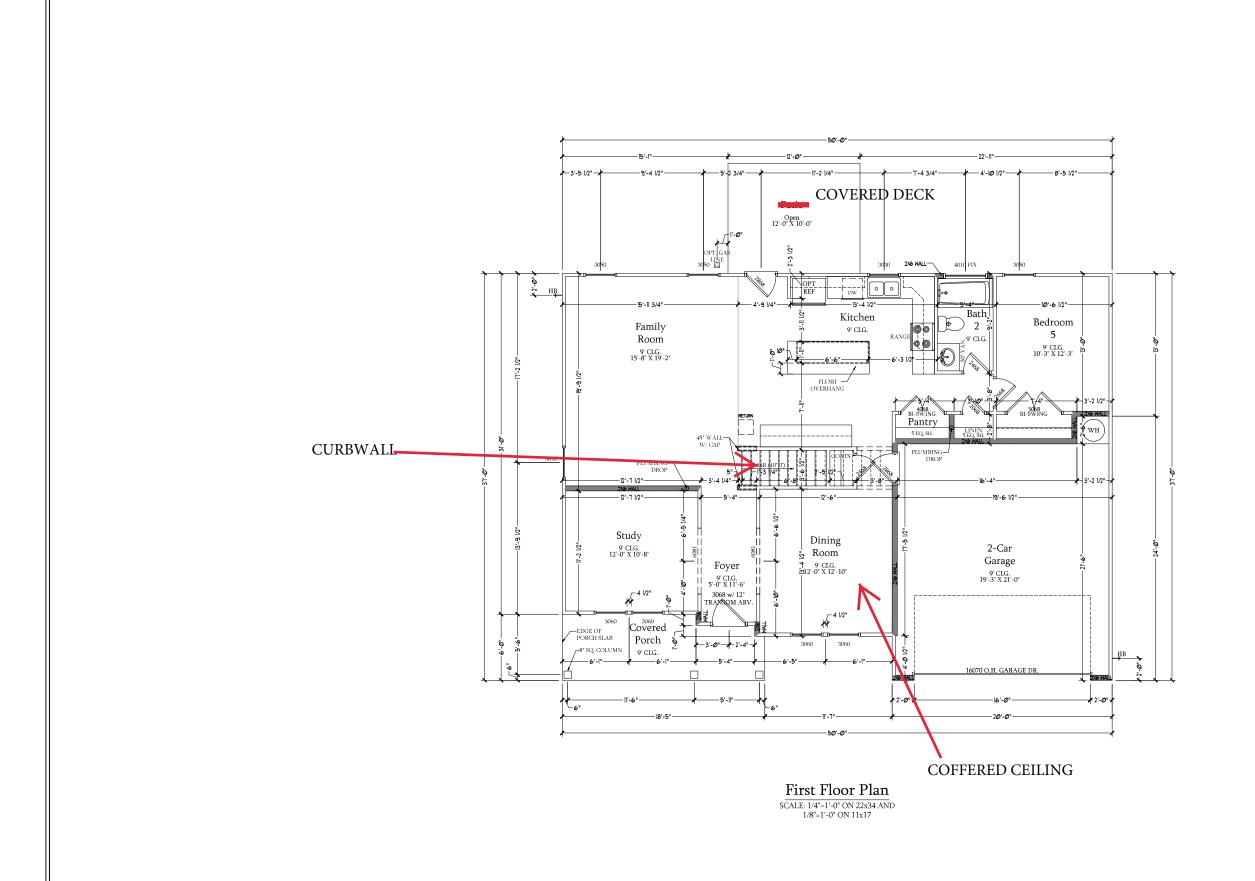



REPOTRER AND IMPRISOROR ARE BETAINATED AND AREA TO ACTUAL POSTRUCTON. BELY ACTUON RINGS. AND ACTUAL PLANS AND ELEVATTON RINGS. ARE ARTIST CONCEPTIONS. FLOOR PLANS AND ACTUAL ADMITTATION. AS ANY USE, REPRODUCTION. ADMITTATION. OR AND ACTUAL PUBLICATION. TO THE PLANS RESTRICTLY PROBIETTIES SEE NUM. AND ACTUAL POR CURRENT PETAILS.

DREAM FINDERS HOMES SOUTHPORT

DATE: SEPTEMBER 16, 2019

REV.: AUGUST 01, 2021

SCALE: 1/4"=1'-0"


DRAWN BY:


ENGINEERED BY:

REVIEWED BY:

FIRST FLOOR PLAN

A-6

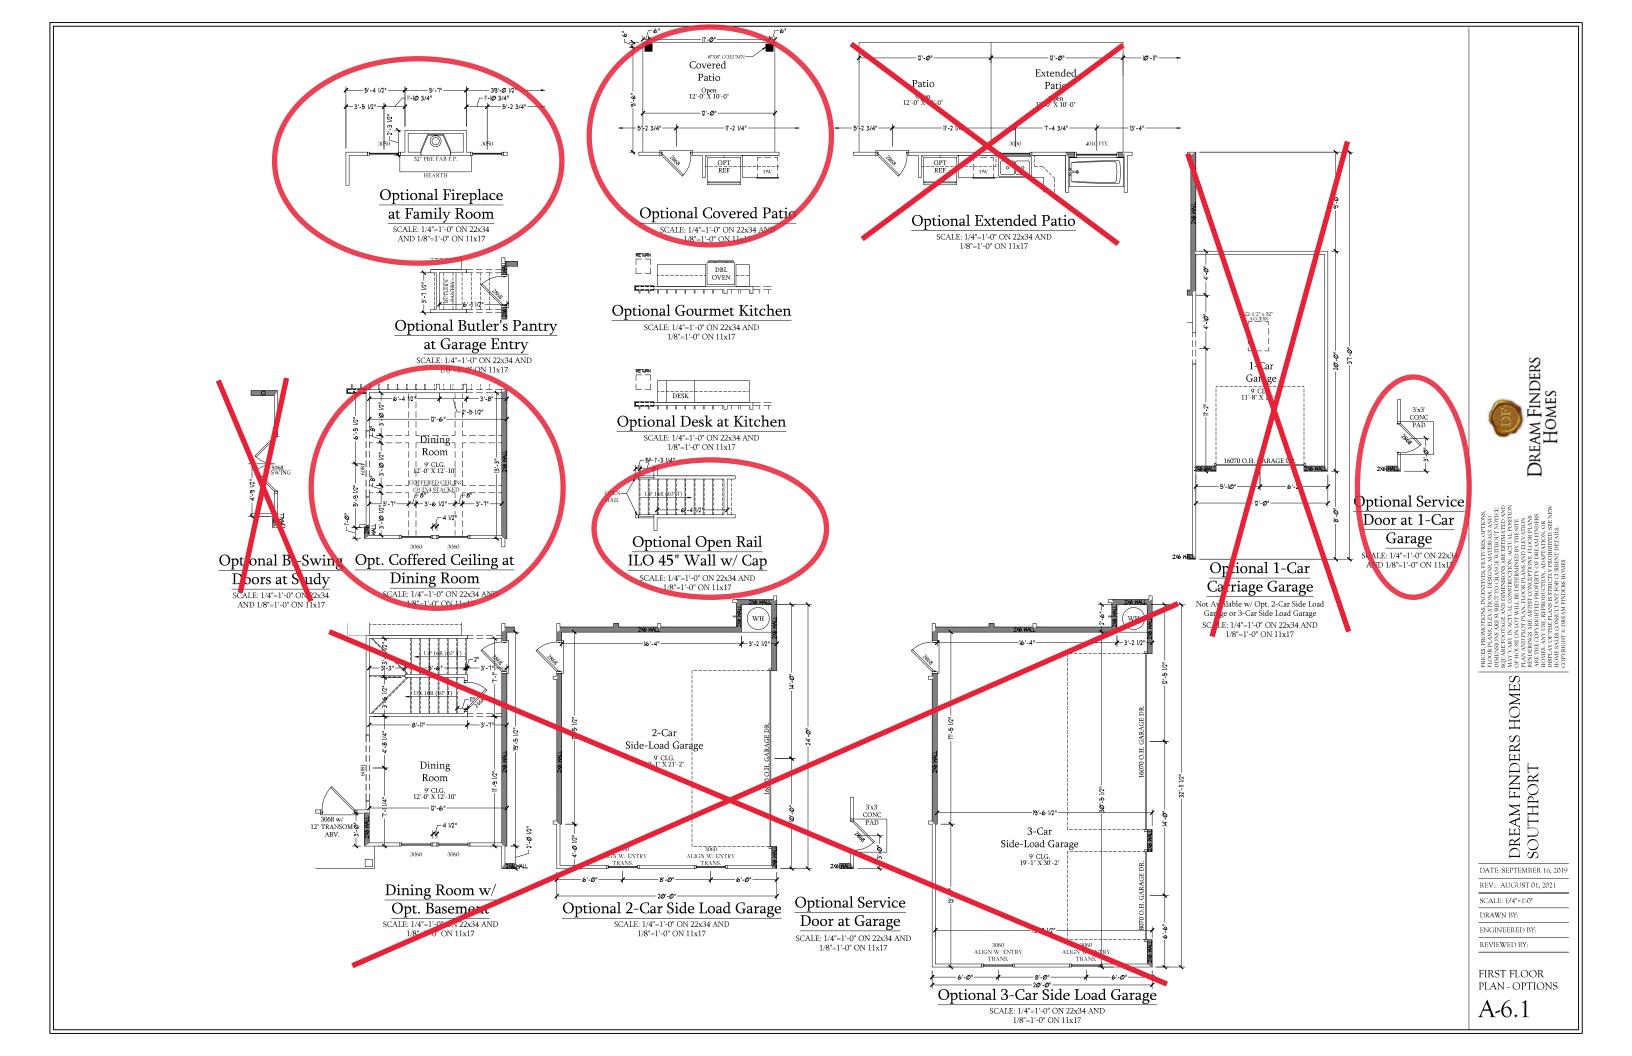

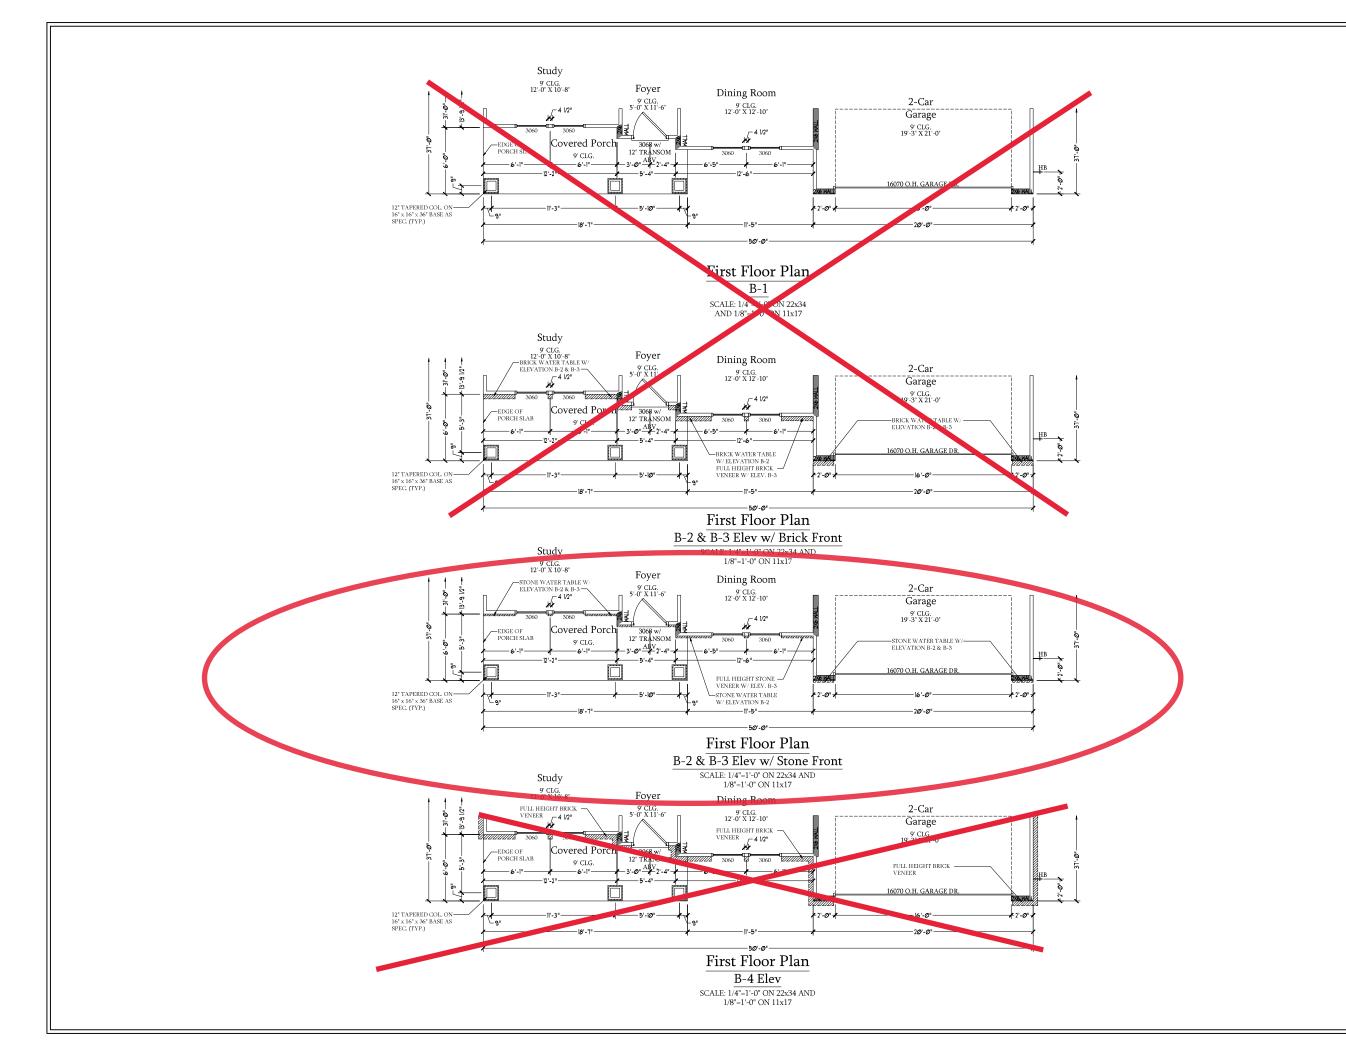



PRICES, P FLOOR PI DIMENSI SQUARE: NATY VAI OF HOUS PLAN AN RENDER ARE THE HOMES DISPLAY DISPL

DREAM FINDERS HOMES SOUTHPORT

DATE: SEPTEMBER 16, 2019 REV.: AUGUST 01, 2021

SCALE: 1/4"=1"-0"


DRAWN BY: ENGINEERED BY:

REVIEWED BY:

B ELEVATION

FIRST FLOOR PARTIAL PLANS

A-6.3

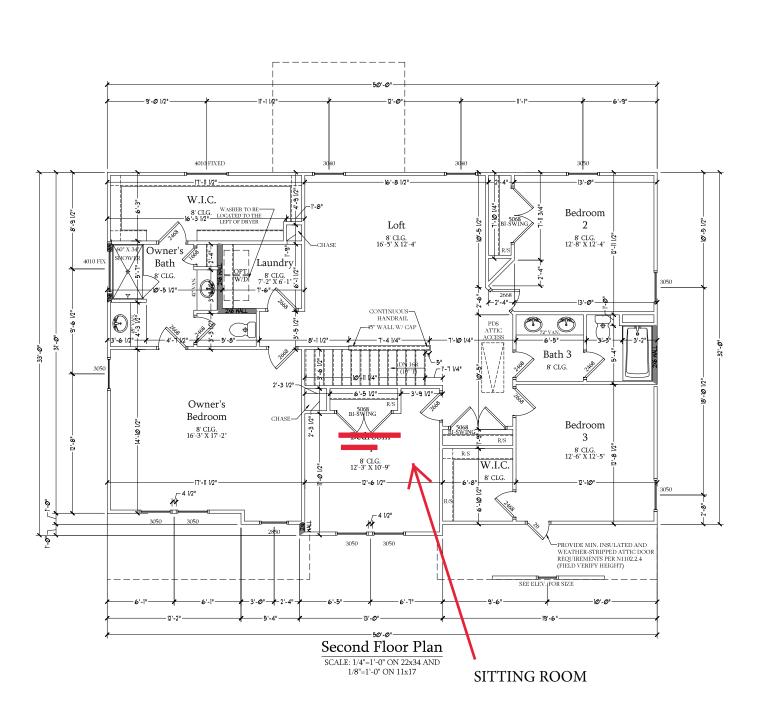



R PLANS ELEVATIONS DISCISSEN ARTHER LAS AND
SASSIONS ARE SUBJECT TO CLANGE WITHOUT NOTICE.
RE POOTICE, AND DIMENSIONS ARE ESTIMATED AND
ARRAY IN ACTIVAL CONSTRUCTION ACTIVAL POSTION
SUSFOOT OUT WILL BE PETERANDED BY THE STIF
AND FOOT PLANS FLOOR PLANS AND BLEVATION
RETRINGS ARE ARTIST CONCEPTIONS. FLOOR PLANS

DREAM FINDERS HOMES SOUTHPORT

DATE: SEPTEMBER 16, 2019
REV.: AUGUST 01, 2021

REV.: AUGUS

SCALE: 1/4"=1'-0"


DRAWN BY:
ENGINEERED BY:


REVIEWED BY:

SECOND FLOOR PLAN

A-7







Optional Re Room ILO Loft

'-0" ON 22x34 AND SCALE: 1/4




45"/Wall w/ Cap at Loft SCALE: 1/4"=1'-0" ON 22x34 AND 1/8"=1'-0" ON 11x17



Sitting Room 8' CLG. 12'-3" X 13'-0"


Optional Sitting Room at Owner's Bedroom ILO Bedroom 4

CALE: 1/4"=1'-0" ON 22x34 AND 1/8"=1'-0" ON 11x17




Option I Open Rail ILC 45" Wall w/ Cap at Loft w/ Opt. Basement

CALE: 1/4"=1'-0" ON 22x34 1/8"=1'-0" ON 11x17




Bedroom 4 w/ Opt. Basement

SCALE: 1/4"




Optional Sitting Room at Owner's Bedroom ILD Bedroom 4 w/ Opt Basement

SCALE: 1/4"=1'-0" ON 22x34 AND 1/8"=1'-0" ON 11x17

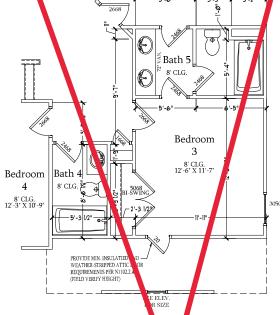

Opt. Bath 5 \ / B droom 3 & Bah A

SCALE: 1/4"=1'-0" C 1/8"=1'-0" ON



pt. 3-Car Side-Load Garage

SCALE: 1/4"=1'-0" ON 22x34 AND 1/8"=1'-0" ON 11x17

PRICES, FLOOR J DIMENS SQUARE MAY VA OF HOU PLAN AI RENDER ARE THI ARE THI HOMES HOME S DREAM FINDERS HOMES SOUTHPORT

Dream Finders Homes

DATE: SEPTEMBER 16, 2019 REV.: AUGUST 01, 2021


SCALE: 1/4"=1'-0"


DRAWN BY:

ENGINEERED BY: REVIEWED BY:

SECOND FLOOR PLAN - OPTIONS

A-7.1

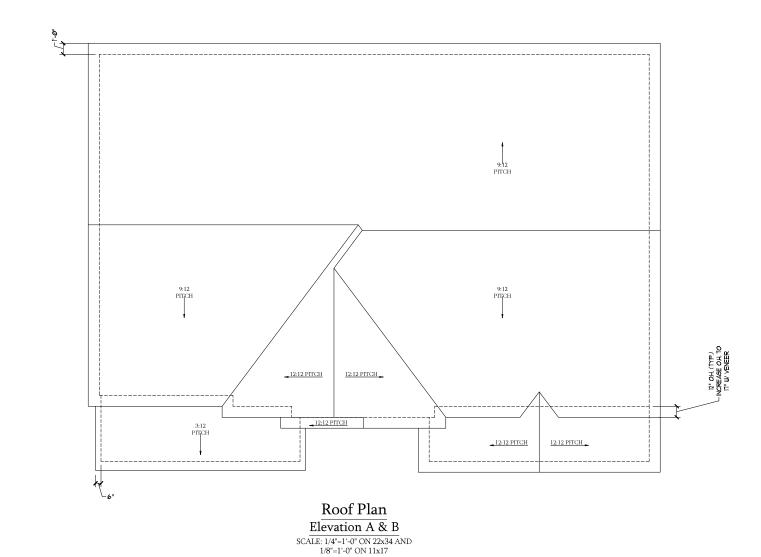

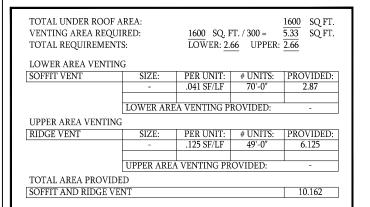

DREAM FINDER HOMES

PRICES, PROMOTHONS, INCENTIVES, FEATURES, OFTIONS, ILLOND PANS, ELEVATIONS, DESIGNS, MATERIALAS AND DIMENSIONS ARE SUBJECT TO CHANGE WITHOUT NOTICE. SOLAR AND THE SUBJECT OF SU

DREAM FINDERS HOMES SOUTHPORT

DATE: SEPTEMBER 16, 2019

REV.: AUGUST 01, 2021

SCALE: 1/4"=1'-0"


DRAWN BY:


ENGINEERED BY:


REVIEWED BY:

ELEVATIONS A & B ROOF PLAN

A-8

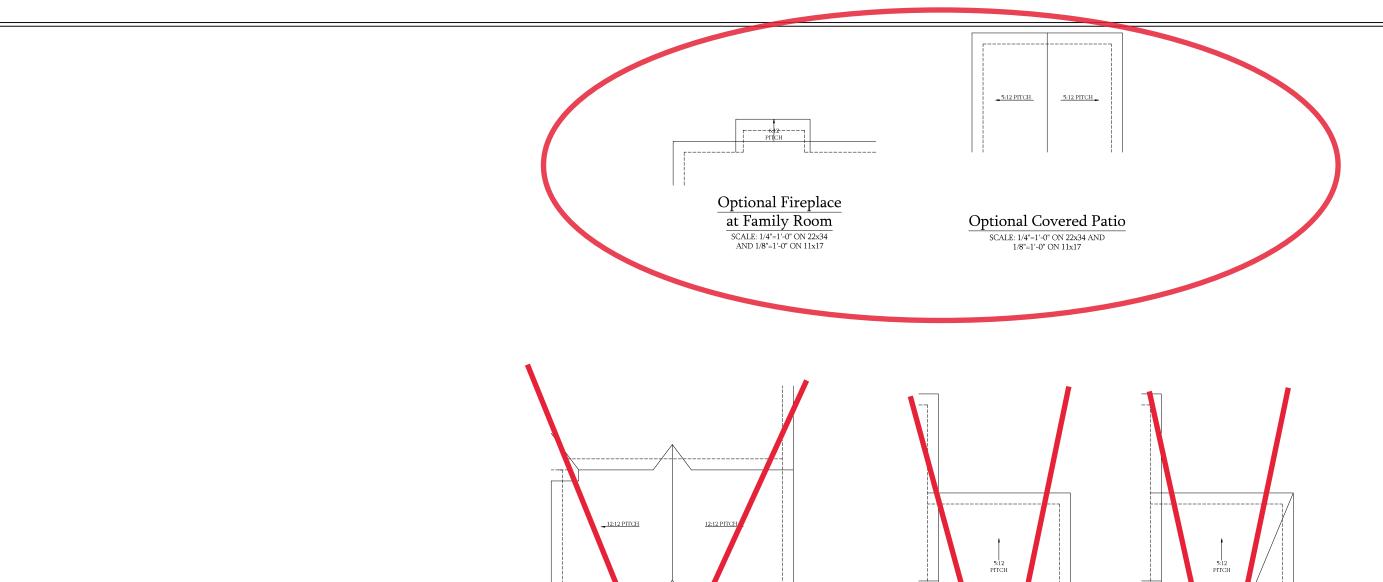







Optional 3-Car Side Load Garage

Elevation A & B SCALE: 1/4"=1'-0" ON 22x34 AND 1/8"=1'-0" ON 11x17

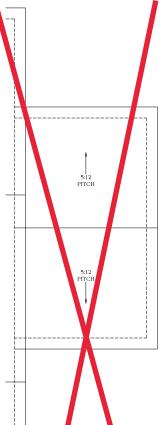

Opt onal 1-Ca Car iage Garag Elevation A & B

Not Avai tble w/ Opt. 2-Car Side Lo Garage or 3-Car Side Load Garage SCAI : 1/4"=1'-0" ON 22x34 AND 1/8"=1'-0" ON 11x17

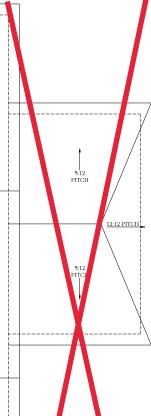

Optional 1-Car Carriage Garage llevation C

ilable w/ Opt. 2-Car Side ge or 3-Car Side Load Gara E: 1/4"=1'-0" ON 22x34 AN 1/8"=1'-0" ON 11x17



PRICES, PROMO FILOOR PLANS, E SQUARE FOOTWA MAY VARY IN A OF HOUSE ON IL PLAN AND PLOT PLAN AND PLOT

DREAM FINDERS HOMES SOUTHPORT

DATE: SEPTEMBER 16, 2019


REV.: AUGUST 01, 2021

SCALE: 1/4"=1'-0" DRAWN BY:

ENGINEERED BY: REVIEWED BY:

ROOF PLAN OPTIONS

A-8.2

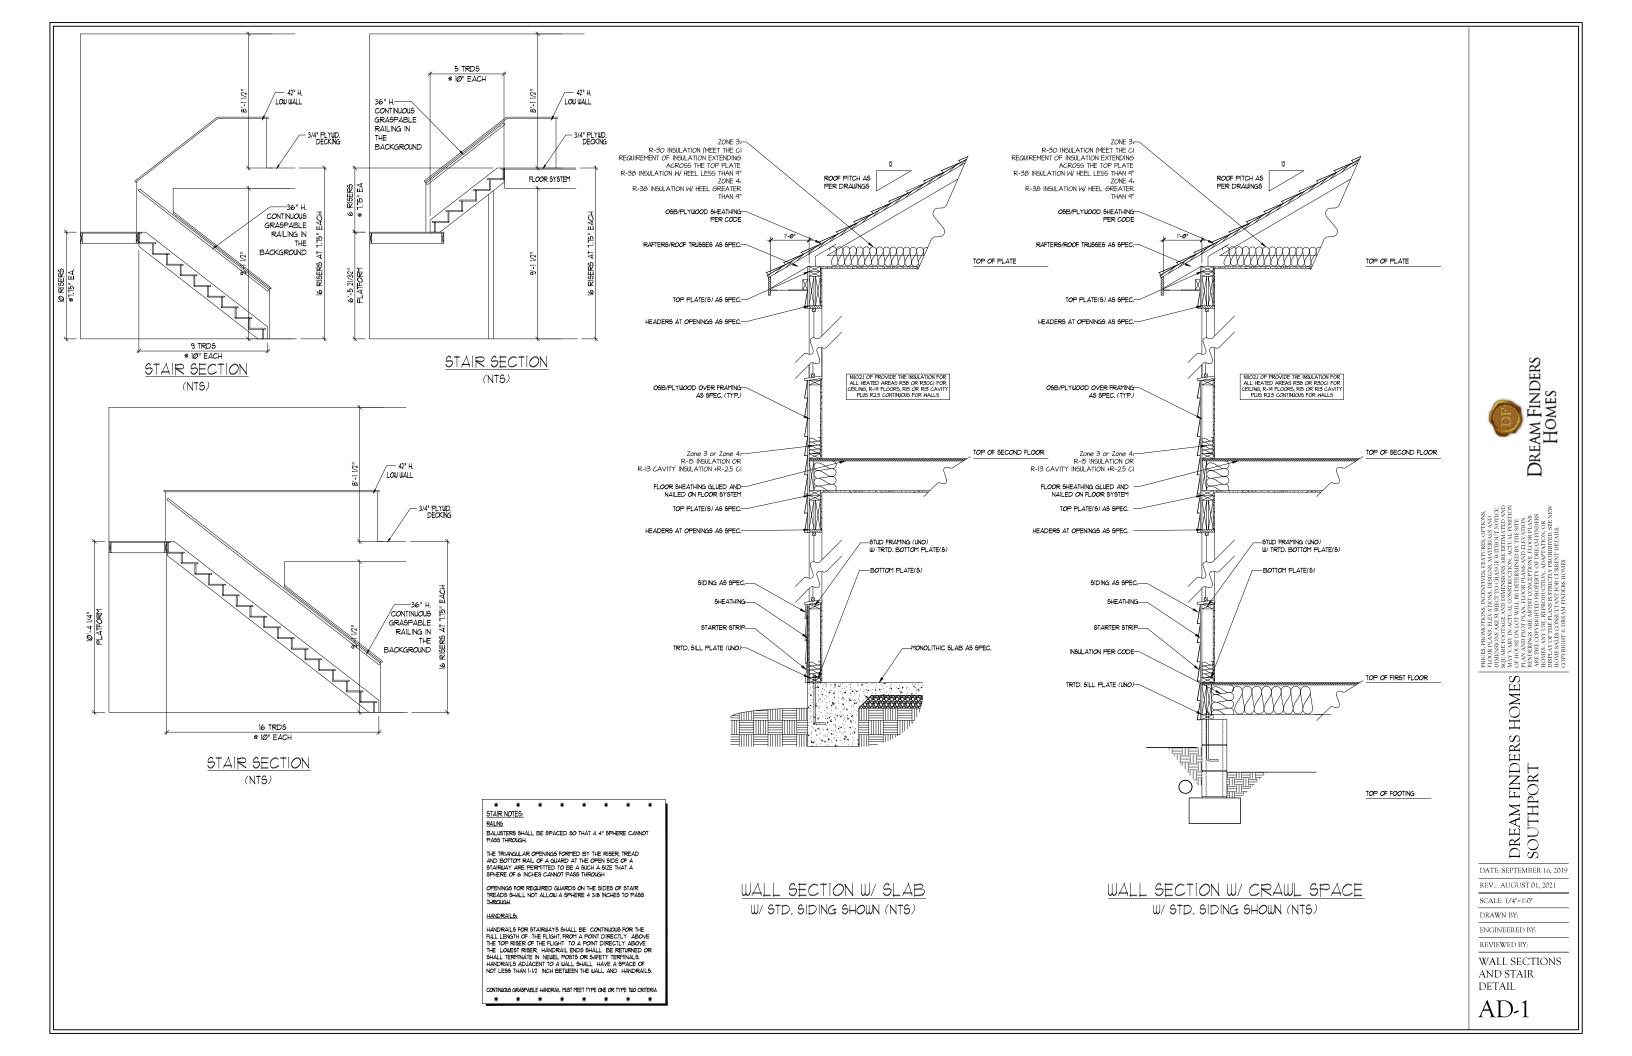

120V BASEBOARD OUTLET **₩** FLOOR MOUNTED 120V FLOOR MOUNTED 120V GFI WEATHERPROOF 120V DEDICATED CIRCUIT 220V DEDICATED GIRCUIT SPECIAL PURPOSE (240 V, ETC.) \triangle WALL MOUNT LIGHT ф CEILING MOUNT LIGHT Ф PENDANT LIGHT \Diamond RECESSED CAN LIGHT \bigcirc MINI CAN LIGHT EYEBALL LIGHT FLUORESCENT LIGHT UNDERCABINET LIGHT FLOOD LIGHT SWITCH 3-WAY SWITCH 4-WAY SWITCH TELEPHONE TV-CD-CONDUIT FOR COMPONENT WIRING 6P SPEAKER COMBO SMOKE/ CARBON MONOXIDE DETECTOR (SID) 110 V SMOKE DETECTOR EXHAUST FAN


ELECTRICAL LEGEND

ELECTRICAL NOTES:

 PROVIDE AND INSTALL GROUND FAULT CIRCUIT-INTERRUPTERS (G.F.I.) AS INDICATED ON PLANS OR AS ITEM NO. 4 AND 5 BELOW INDICATES.

LOW VOLTAGE PANEL

- 3. ALL SMOKE DETECTORS SHALL BE HARDWIRED INTO AN ELECTRICAL POWER SOURCE AND SHALL BE EQUIPPED WITH A MONITORED BATTERY BACKUP, PROVIDE AND INSTALL LOCALLY CERTIFIED SMOKE DETECTORS.
- 4. ALL 15A AND 20A RECEPTACLES IN SLEEPING ROOMS, FAMILY ROOMS, DINING ROOMS, LIVING ROOMS, PARLORS, LIBRARIES, DENS, SUNROOMS, RECREATION ROOMS, CLOSETS, HALLWAYS, AND SIMILAR AREAS WILL REQUIRE A COMBINATION TYPE A.F.C. DEVICE AND TAMPER-PROOF RECEPTACLES.
- ALL 15A AND 20A 120V RECEPTAGLES LOCATED IN THE GARAGE AND UTILITY ROOMS SHALL BE G.F.C.I. PROTECTED (G.F.I).
- 6. IT IS THE RESPONSIBILITY OF THE LICENSED ELECTRICIAN TO ENSURE THAT ALL ELECTRICAL WORK IS IN FULL COMPLIANCE WITH ALL APPLICABLE LOCAL STANDARDS, CODES, AND ORDINANCES.
- 7. EVERY BUILDING HAVING A FOSSIL-FUEL-BURNING HEATER OR APPLIANCE, FIREPLACE, OR AN ATTACHED GARAGE SHALL HAVE AN OPERATIONAL CARBON MONOXIDE DETECTOR INSTALLED WITHIN 10 FEET OF EACH ROOM USED FOR SLEEPING PURPOSE.
- 8. ALARMS SHALL RECEIVE THEIR PRIMARY POWER FROM THE BUILDING WIRING WHEN SUCH WIRING IS SERVED FROM THE LOCAL POWER UTILITY. SUCH ALARMS SHALL HAVE BATTERY BACKIP, COMBINATION SMOCKECARRON MONOXIDE ALARMS SHALL BE LISTED OR LABELED BY A NATIONALLY RECOGNIZED TESTING LABORATORY.

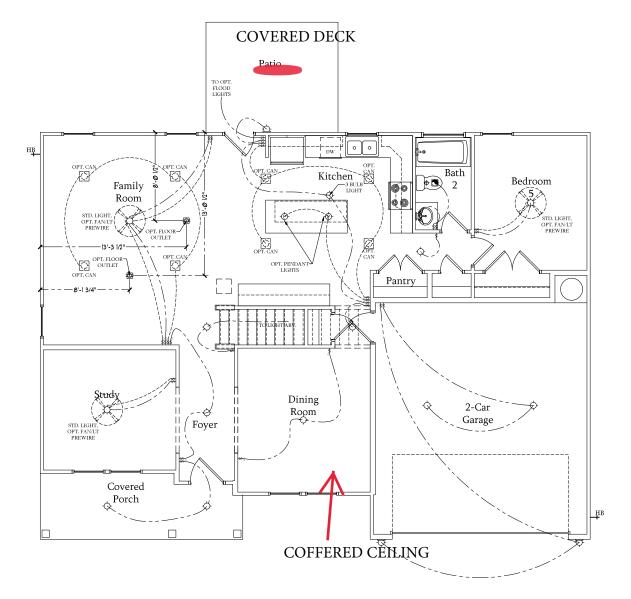

First Floor Plan
SCALE: 1/4"=1'-0" ON 22x34 AND
1/8"=1'-0" ON 11x17



PRICES, PROMOTIONS, INCENTIVES, FLATURES, OPTIONS, PHOORP NAME SELEMINO'S DISCIOSA, MATRRIALS AND DIMENSIONS ARE SUBJECT, WATRRIALS AND DIMENSIONS ARE SUBJECT OUTANGE WITHOUT O'CHICA'S ADJURE FOOTIGE AND DIMENSIONS ARE SUBJECT ON ACTIVAL POSTION OF HOUSE ON LOTWILL BE DETERMINED BY THE STITE PLAN AND PLOF PLAN, FLOOR PLANS AND ELLYATION RENDERING AS BEATREM FOOR PLANS ARE THE COPPRICATION ARE THE COPPRICATION AND THE COPPRICATION AND THE COPPRICATION AND THE COPPRICATION AND THE PLANS ARE THE TOOR PLANS AND THE PLANS IS STRICTLY PROHIBITED. SEE PART OF THE PLANS IS TRUCTLY PROHIBITED. SEE PART OF THE PLANS IN THOUS HOUSE MONIES.

DREAM FINDERS HOMES SOUTHPORT

DATE: SEPTEMBER 16, 2019 REV.: AUGUST 01, 2021

SCALE: 1/4"=1'-0"


SCALE: 1/4"=1 DRAWN BY:


ENGINEERED BY:

REVIEWED BY:

FIRST FLOOR ELECTRICAL PLAN

E-1

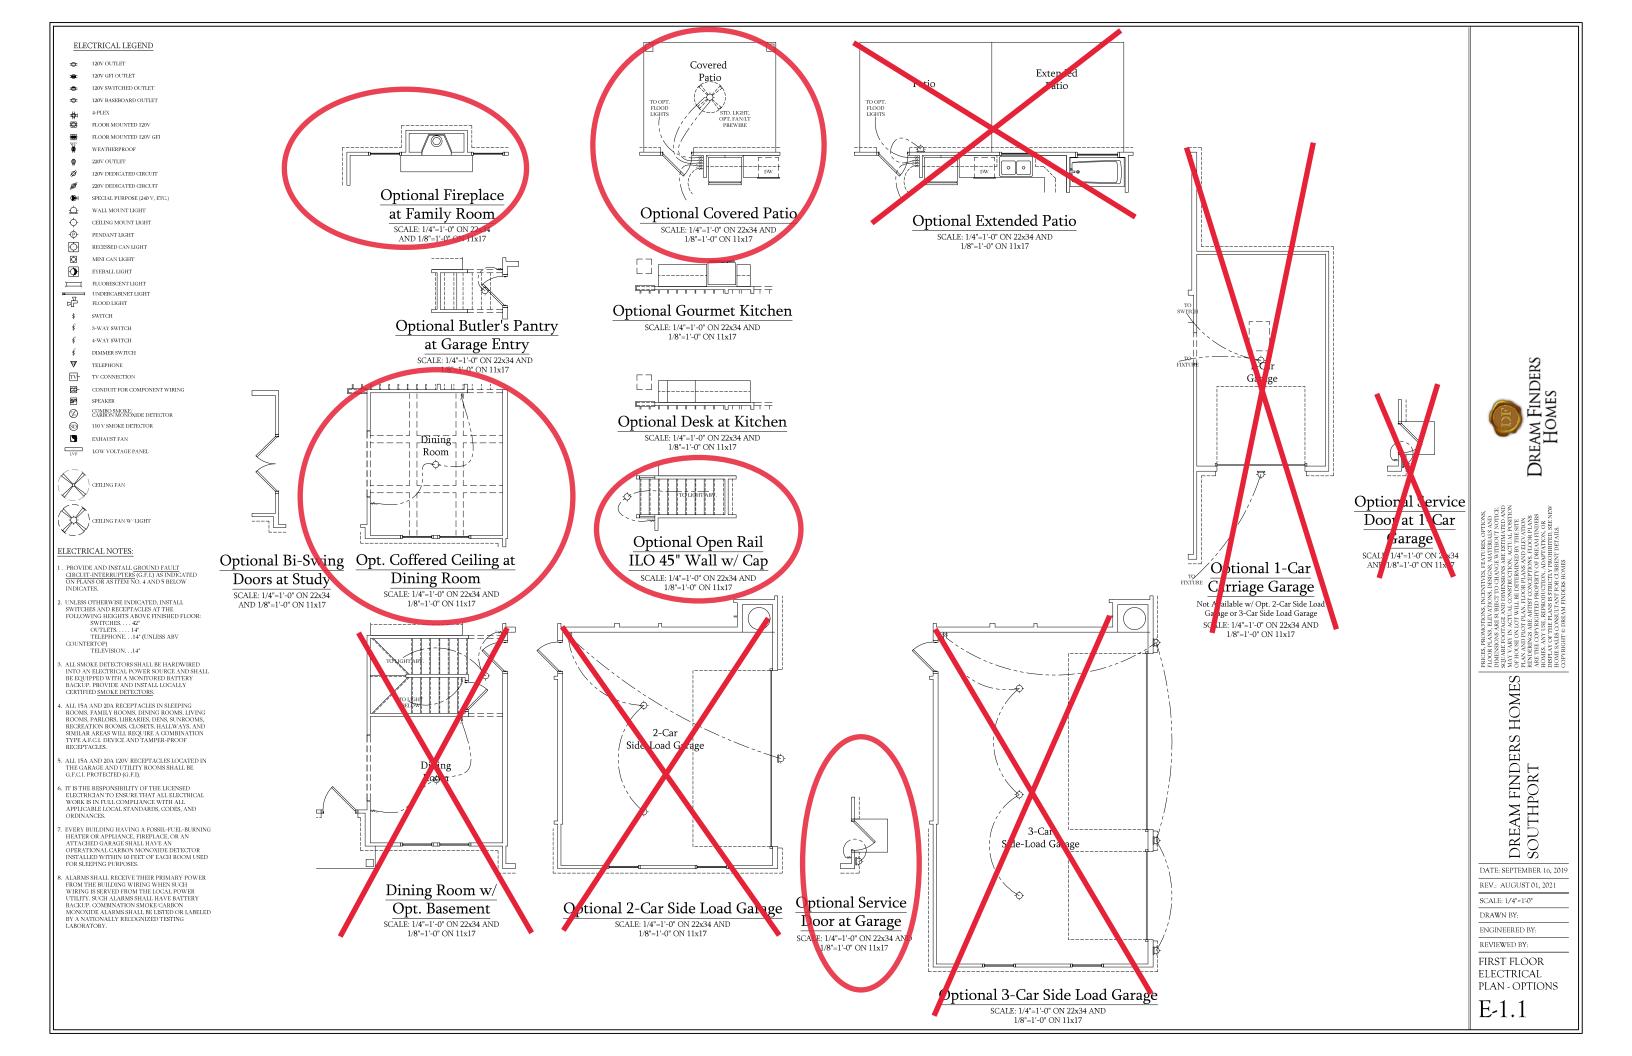

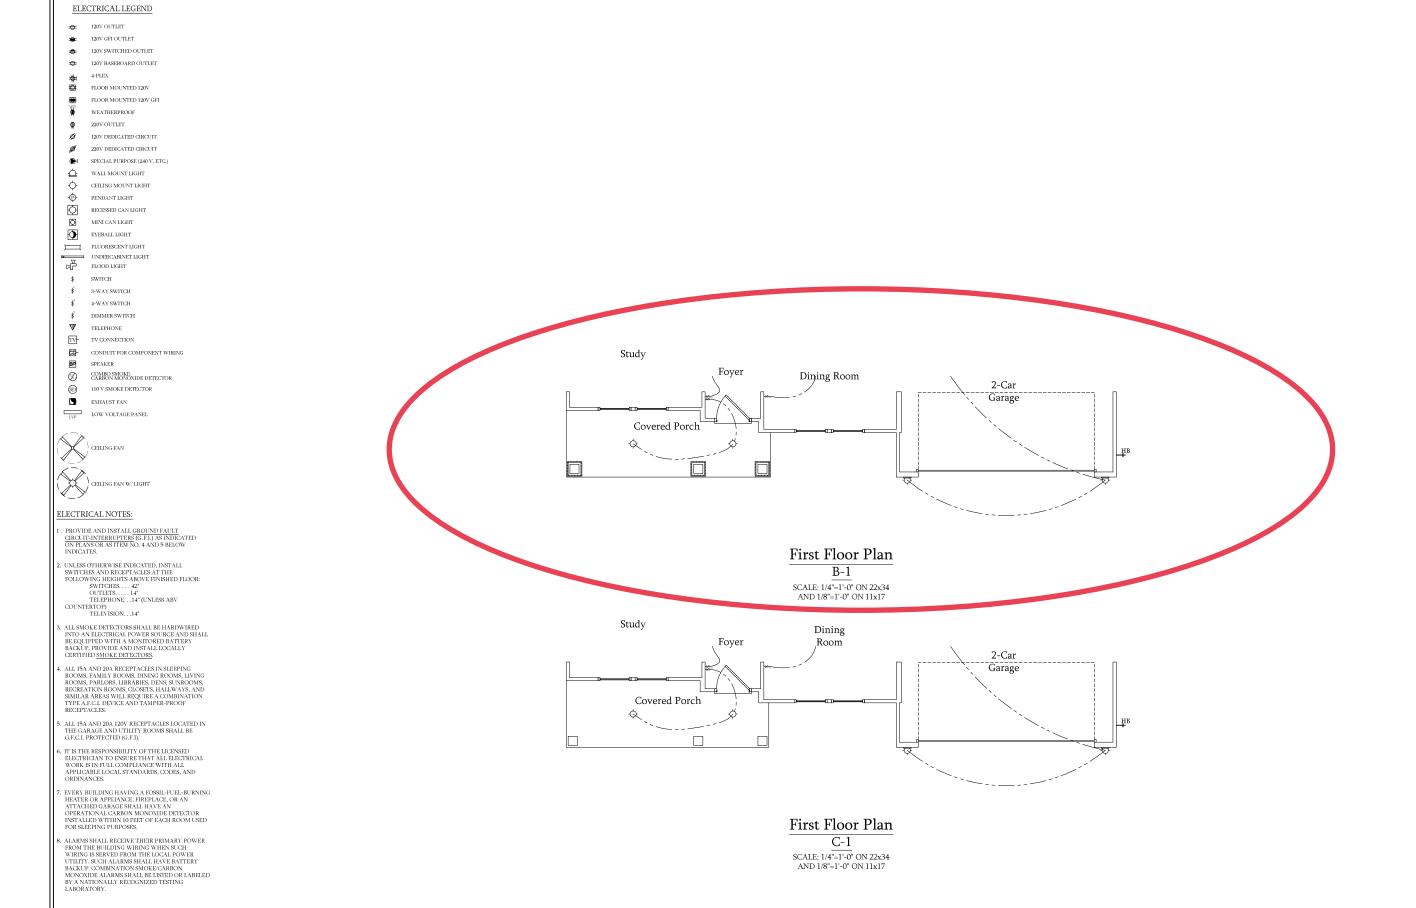

GETTON
TO BEST OR EAW FINDERS
AND HOMES
HOMES

PRICES, ROMOTONS, NORTIVER, EATTRESS, OFTONS, ILLON PLANS, ELEVATIONS, DISTORS, MATRIALAS, NO. DIMENSIONS ARE RELIABLED SONGER, WINDRIADAS AND SOLICIAR FOR DIMENSIONS ARE SETTIALIZED AND MAY VAIN IN ACTUAL CONSTRUCTION, ACTUAL ROSTING OFF HORSE ON TOTH MALL BETERMINISM BY THE STEE ELEVAN SOLICIAR AND PLOTY LAAN. FLOOR PLANS AND ILLAYATION RECHIEF CONSTRUCTION, ADMINISM SET ELOR PLANS ARE ARTED PROPERTY OF DERANI INDEES HOMES AND YOUR AND SETTIAL TO BE DERANI INDEES HOMES AND SETTIAL PROCEDURATION OF MEAN INDEES HOMES AND SETTIAL PROCEDURATION.

DREAM FINDERS HOMES SOUTHPORT

DATE: SEPTEMBER 16, 2019

REV.: AUGUST 01, 2021

SCALE: 1/4"=1'-0"

DRAWN BY:

ENGINEERED BY:

REVIEWED BY:

FIRST FLOOR ELECTRICAL PARTIAL PLANS

E-1.2

ELECTRICAL LEGEND □ 120V OUTLET € 120V GFI OUTLET 120V BASEBOARD OUTLET **₩** FLOOR MOUNTED 120V FLOOR MOUNTED 120V GFI WEATHERPROOF 120V DEDICATED CIRCUIT 220V DEDICATED CIRCUIT SPECIAL PURPOSE (240 V, ETC.) \triangle WALL MOUNT LIGHT \Diamond CEILING MOUNT LIGHT Ф PENDANT LIGHT \Diamond RECESSED CAN LIGHT \bigcirc MINI CAN LIGHT EYEBALL LIGHT FLUORESCENT LIGHT UNDERCABINET LIGHT FLOOD LIGHT SWITCH 3-WAY SWITCH 4-WAY SWITCH TELEPHONE TV-CD-CONDUIT FOR COMPONENT WIRING SPEAKER COMBO SMOKE/ CARBON MONOXIDE DETECTOR (SID) 110 V SMOKE DETECTOR EXHAUST FAN


ELECTRICAL NOTES:

 PROVIDE AND INSTALL GROUND FAULT CIRCUIT-INTERRUPTERS (G.F.I.) AS INDICATED ON PLANS OR AS ITEM NO. 4 AND 5 BELOW INDICATES.

LOW VOLTAGE PANEL

- 3. ALL SMOKE DETECTORS SHALL BE HARDWIRED INTO AN ELECTRICAL POWER SOURCE AND SHALL BE EQUIPPED WITH A MONITORED BATTERY BACKUP, PROVIDE AND INSTALL LOCALLY CERTIFIED SMOKE DETECTORS.
- 4. ALL 15A AND 20A RECEPT ACLES IN SLEEPING ROOMS, FAMILY ROOMS, DINING ROOMS, LIVING ROOMS, PARLORS, LIBRARIES, DENS, SUNROOMS, RECREATION ROOMS, CLOSETS, HALLWAYS, AND SIMILAR AREAS WILL REQUIRE A COMBINATION TYPE A.F.C.I. DEVICE AND TAMPER-PROOF RECEPTACLES.
- ALL 15A AND 20A 120V RECEPTAGLES LOGATED I THE GARAGE AND UTILITY ROOMS SHALL BE G.F.C.I. PROTECTED (G.F.I).
- 6. IT IS THE RESPONSIBILITY OF THE LICENSED ELECTRICIAN TO ENSURE THAT ALL ELECTRICAL WORK IS IN FULL COMPLIANCE WITH ALL APPLICABLE LOCAL STANDARDS, CODES, AND ORDINANCES.
- 7. EVERY BUILDING HAVING A FOSSIL-FUEL-BURNING HEATER OR APPLIANCE, FIREPLACE, OR AN ATTACHED GARAGE SHALL HAVE AN OPERATIONAL CARBON MONOXIDE DETECTOR INSTALLED WITHIN 10 FEET OF EACH ROOM USED FOR SLEEPING PURPOSES.
- FOR SELECTION FUNCIONS.

 B. ALARMS SHALL RECEIVE THEIR PRIMARY POWER
 FROM THE BUILDING WIRING WHEN SUCH
 WIRING IS SERVED FROM THE LOCAL FOWER
 UTILITY, SUCH ALARMS SHALL HAVE BATTERY
 BACKUP, COMBINATION SMOKE CARBOTTERY
 MONOXIDE ALARMS SHALL BE LISTED OR LABELED
 BY A NATIONALLY RECOGNIZED TESTING
 LABORATORY.

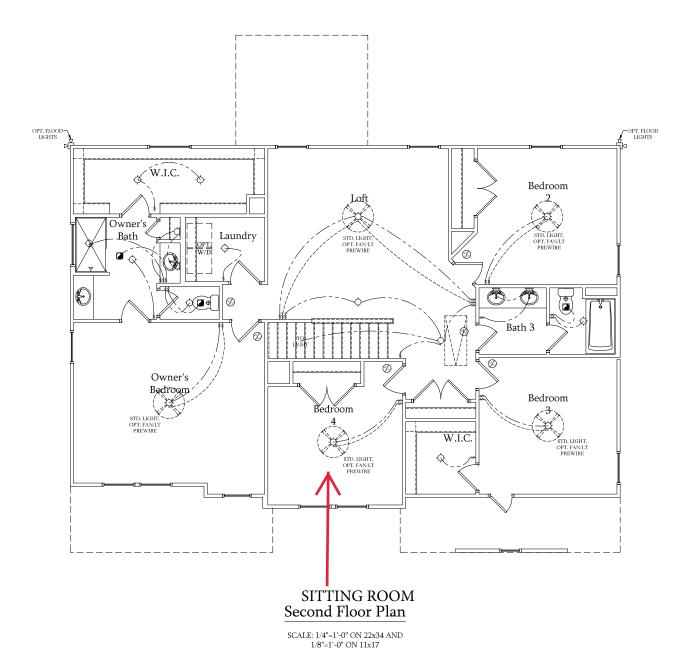

DREAM FINDERS HOMES

PRICES, PROMOTIONS, INCENTIVES, FEATURES, OPTIONS, CLOOR PLANS, ELEVATIONS, DESIGNS, MATHERAIS AND DIMENSIONS ARE SUBJECT TO CHANGE WITHOUT OCTICE. SAGARE FOOTIONS. AND INTERPRESSIONS ARE STRINKTED AND MAY VAR IN ACTIVAL CONSTRUCTION. ACTIVAL POSITION AND AND ALLY AND TO THAN ENTERNINDED WITH ESTITE PLAN AND PLOT PLAN. FLOOR PLANS AND ELEVATION RESURPRINGNES ARE MINISTOCIONETHONS, FLOOR PLANS ARE THE COPYRIGHTED PROPERTY OF DREAM INDRESS HIGH PLANS IS STRICTLY PROHIBITED. SEE NEW DISPLAY OF THE PLANS IS STRICTLY PROHIBITED. SEE NEW DISPLAY OF THE PLANS IS STRICTLY PROHIBITED. SEE NEW DISPLAY OF CHRRITED. SEE NEW DISPLAY OF CHRRITED. SEE NEW DISPLAY OF CHRRITED. SEE NEW COPYRIGHT © DREAM FUNDERS HONES.

DREAM FINDERS HOMES SOUTHPORT

DATE: SEPTEMBER 16, 2019
REV.: AUGUST 01, 2021

REV.: AUGUST

SCALE: 1/4"=1'-0"
DRAWN BY:

ENGINEERED BY:

REVIEWED BY:

SECOND FLOOR ELECTRICAL PLAN

E-2



120V GFI OUTLET

120V BASEBOARD OUTLET

- 1 FLOOR MOUNTED 120V

FLOOR MOUNTED 120V GFI

WEATHERPROOF

120V DEDICATED CIRCUIT

220V DEDIGATED CIRCUIT

SPECIAL PURPOSE (240 V, ETC.)

ሷ WALL MOUNT LIGHT

 \Diamond CEILING MOUNT LIGHT

Ф PENDANT LIGHT

RECESSED CAN LIGHT

 \Diamond \odot MINI CAN LIGHT

EYEBALL LIGHT

FLUORESCENT LIGHT UNDERCABINET LIGHT
FLOOD LIGHT

SWITCH

3-WAY SWITCH

4-WAY SWITCH

TELEPHONE TV-

CD-CONDUIT FOR COMPONENT WIRING

LOW VOLTAGE PANEL

SP SPEAKER COMBO SMOKE/ CARBON MONOXIDE DETECTOR \oslash

(SID)

EXHAUST FAN

ELECTRICAL NOTES:

PROVIDE AND INSTALL GROUND FAULT CIRCUIT-INTERRUPTERS (G.F.L.) AS INDICATED ON PLANS OR AS ITEM NO. 4 AND 5 BELOW


. ALL SMOKE DETECTORS SHALL BE HARDWIRED INTO AN ELECTRICAL POWER SOURCE AND SHALL BE EQUIPPED WITH A MONITORED BATTERY BACKUP, PROVIDE AND INSTALL LOCALLY CERTIFIED $\underline{\text{SMOKE DETECTORS}}.$

ALL 15A AND 20A RECEPTACLES IN SLEEPING ALL 15A AND 20A RICEPTACLES IN SLEEPING ROOMS, FAMILY ROOMS, DINING ROOMS, FUND ROOMS, PARLORS, LIBRARIES, DENS, SUNROOMS, RECREATION ROOMS, CLOSETS, HALLWAYS, AND SIMILAR AREAS WILL REQUIRE A COMBINATION TYPE A F.C. L DEVICE AND TAMPER-PROOF RECEPTACLES.

I. IT IS THE RESPONSIBILITY OF THE LICENSED ELECTRICIAN TO ENSURE THAT ALL ELECTRICAL WORK IS IN FULL COMPLIANCE WITH ALL APPLICABLE LOCAL STANDARDS, CODES, AND ORDINANCES.


EVERY BUILDING HAVING A FOSSIL-FUEL-BURNING EVERY BUILDING HAVING A FOSSIL-FUEL-BURN HEATER OR APPLIANCE, FIREPLACE, OR AN ATTACHED GARAGE SHALL HAVE AN OPERATIONAL CARBON MONOXIDE DETECTOR INSTALLED WITHIN 10 FEET OF EACH ROOM USED FOR SLEEPING PURPOSES.

ALARMS SHALL RECEIVE THEIR PRIMARY POWER






SCALE: 1/4"=1'-0" ON 22x34 Al 1/8"=1'-0" ON 11x17




Optional Re Room ILO Loft

SCALE: 1/4 " ON 22x34 AND



SCALE: 1/4"=1'-0" ON 22x34 AND 1/8"=1'-0" ON 11x17




Optional Sitting Room at Owner's Bedroom ILO Bedroom 4

SCALE: 1/4"=1'-0" ON 22x34 AND 1/8"=1'-0" ON 11x17


Optional Open Rail ILO 45" Wall w/ Cal at Loft w/ Opt Basement

SCALE: 1/4"=1'-0" ON 22x2




Bedroom 4 w/ Opt. Basen ent

LE: 1/4"=1'-0" (I 22x34 AND 1/8"=1'-0" O



Optional Sitting Room at Ovmer's Be room ILO Bedroom 4 w/ Opt Rasement


SCALE: 1/4"=1'-0" ON 22x34 AND 1/8"=1'-0" ON 11x17

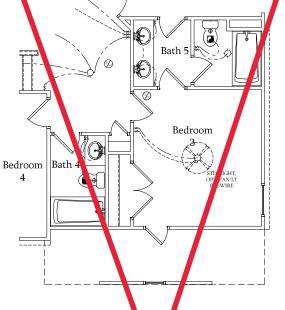

Opt. Bath w/Bedroom 3

& Bat 14

SCALE: 1/4"=1 0" ON 22x34 AND



Opt. 3-Car Side-Load Garage

SCALE: 1/4"=1'-0" ON 22x34 AND 1/8"=1'-0" ON 11x17

SCALE: 1/4"=1'-0"

SECOND FLOOR ELECTRICAL



DREAM FINDERS HOMES SOUTHPORT


DATE: SEPTEMBER 16, 2019 REV.: AUGUST 01, 2021

DRAWN BY:

ENGINEERED BY: REVIEWED BY:

PLAN - OPTIONS

E-2.1

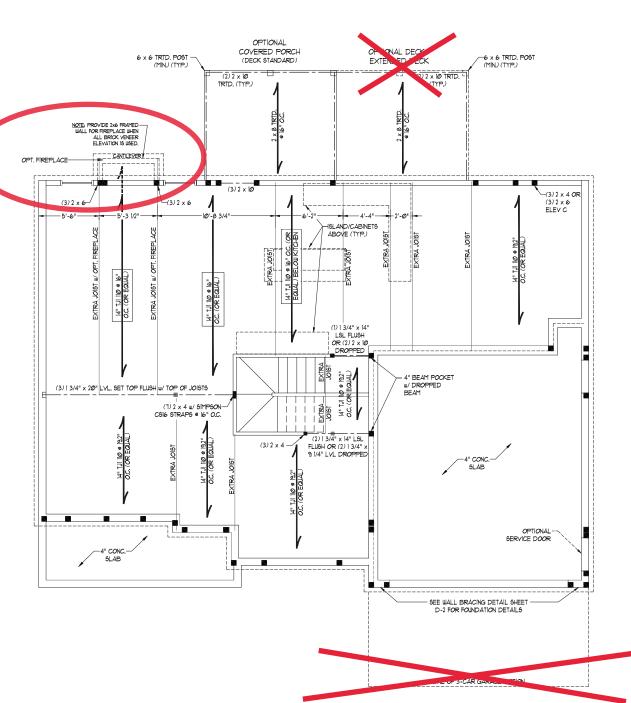

	LINTEL SCHEDULE FOR BRICKNATURAL STONE SUPPORT		
LENGTH (FT.)		SIZE OF LINTEL	
	UP TO 4 FT.	L 3 1/2 x 3 1/2 x 1/4	
	4-8	L 5 x 3 1/2 x 5/16 LLV	
	8 AND GREATER	L 6 x 4 x 5/16 LLV	

BRICK SUPPORT NOTES:

- LINTEL SCHEDULE APPLIES TO ALL OPENINGS IN BRICK VENEER (UNO), SEE ARCH DUGS, FOR SIZE AND LOCATION OF

- ARCH DUGS, FOR SIZE AND LOCATION OF OPENINGS.
 (LLY) = LONG LEG VERTICAL
 LENGTH = CLEAR OPENING
 EMBED ALL ANGLE IRONS MIN. 4" EACH
 SIDE INTO VENEER TO PROVIDE BEARING,
 FOR ALL HEADERS 8"-0" AND AREATER
 N LENGTH, ATTACH STEEL ANGLE TO
 HEADER W 1/2" LAG SCREWS 9 12" O.C.
 STRACSFEDE
- STAGGERED.
 FOR ALL BRICK SUPPORT @ ROOF LINES, FOR ALL BRICK SUPPORT © ROCK LINES, FASTEN (2) 2 × 10 BLOCKING BETWEEN STUDS W (4) 12a NAILS PER PLY, FASTEN A 6' x 4" x 50" 8" STELL ANGLE TO (2) 2 × 10 BLOCKING W (2) 1/2" LAG SOREIUS © 12" OC. STAGERED SEE SECTION R103.8.2.1 OF THE 2018 NCRC FOR ADDITIONAL
- BRICK SUPPORT INFORMATION.
 PRECAST REINFORCED CONCRETE
 LINTELS ENGINEERED BY OTHERS MAY BE
 USED IN LIEU OF STEEL LINTELS.

NOTE:

BCI 45006-18 JOISTS MAY BE USED IN LIEU OF TJI 110 JOISTS AT THE DEPTH AND SPACING NOTED ON THE PLAN.

BRACED WALL DESIGN NOTES:

WALL INFORMATION

- BRACED WALL DESIGN PER SECTION R602.00 OF THE NCRC 2018 EDITION. CS-WSP REFERS TO "CONTINUOUS SHEATHING WOOD STRUCTURAL PAINELS" CONTRACTOR IS TO INSTALL TAIS" OSB
- STRACTURAL PANELS* CONTRACTOR IS 10 NOTALL ING* OSD ON ALL EXTERIOR WALLS ATTACHED W &MAILS SPACED 6* O.C. ALONG PANEL EDGES AND 2* O.C. IN THE FIELD. 42B REFERS TO "GTPSUM DOARD" CONTRACTOR IS TO INSTALL I/2* (MIN) GTPSUM WALL BOARD WHERE NOTED ON THE FILANS. FASTEN GB WITH I I/4* (SERVISIO OR 15/8* NAILS SPACED T* O.C. ALONG PANEL EDGES AND IN THE FIELD INCLUDING TOP AND SOUTH ON THE STRACTOR OF THE PROPERTY BOTTOM PLATES.
- BOTTOM PLATES.

 PRACED MALL DEBIGN APPLIED IN WIND ZONES UP TO 130 MPLFOR HIGH WIND ZONES, BRACE WALLS ARE TO BE CONSTRUCTED.

 IN ACCORDANCE WITH CHAPTER 45 OF THE NICRC 2018 EDITION.
 SEE NOTES AND DETAIL SHEETS FOR ADDITIONAL BRACED.

NOTE:

- L PER SECTION R6021046 OF THE 2010 NCRC, THE AMOUNT OF BRACING REQUIRED ON THE WALK OUT BASEMENT WALLS EXCEEDS THE AMOUNT OF BRACING ON THE WALL ABOVE MULTIPLIED BY A FACTOR OF US.
- 2. SHEATH ALL EXTERIOR WALLS WITH 1/16" OSB SHEATHING ATTACHED WITH 8d NAILS AT 6" O.C. ALONG PANEL EDGES AND 12" O.C. IN THE FIELD.

STRUCTURAL NOTES:

- ALL FRAMING LUMBER TO BE *2 SPF (UNO), ALL
- TREATED LIMPER TO BE 12 SYP (UNO.)

 NSTALL AN EXTRA JOIST UNDER WALLS PARALLEL TO FLOOR JOISTS WHERE NOTED ON THE PLANS, WINDOW AND DOOR HEADERS TO BE SUPPORTED W/(I)
- JACK STUD AND (1) KING STUD EA, END (UNO.), SEE TABLE REQUISE FOR ADDITIONAL KING STUD
 REQUIREMENTS.
 SQUARES DENOTE POINT LOADS WHICH REQUIRE SOLID
- BLOCKING TO GIRDER OR FOUNDATION. SUPPORT UNSPECIFIED PT. LOADS ALONG FRAMED WALLS w/ (2) STUDS (UNO).
- ALL LOAD BEARING HEADERS TO BE (3) 2 x 10 (UNO.)
- STEP BASEMENT FDN. DOUN TO 2 x 6 6 16* O.C. WALL
 WHERE GRADE PERVITS.
 ALL LOAD BEARING INTERIOR WALLS TO BE 2 x 4 9 12"
 O.C. OR 2 x 6 9 16* O.C. (UNO.)
- OC. OR 2 x 6 e (e) OC. (UNO.)

 5. FOR HIGH WIND ZONES, ALL EXTERIOR WALLS TO BE

 9HEATHED WITH 1/16" OSB 9HEATHING WITH JOINTS

 BLOCKED AND SECURED WITH 86 NAILS AT 3" OC.

 ALONG EDGES AND 6" OC. IN THE FIELD.

 5. FOR HIGH WIND ZONES, SECURE ALL EXTERIOR WALLS

 9HEATHING PARIES TO DOUBLE TO PP LATES, BANDS,

 JOINTS, AND GIRDERS WITH (2) ROUS OF 80 NAILS.
- STAGGERED AT 3" O.C. PANELS SHALL EXTEND 12"
- BEYOND CONSTRUCTION JOINTS AND SHALL OVERLAP GIRDERS AND DOUBLE SILL PLATES THEIR RULL DEPTH. ALL 4 × 4 POSTS SHALL BE ANCHORED TO SLABS W/ SIMPSON ABUA4 POST BASES (OR EQUAL) AND 6 × 6 POSTS W ABUGE POST BASES (OR EQUAL) (UNO). ALL 4 x 4 AND 6 x 6 POSTS TO BE INSTALLED WITH TOO LB CAPACITY UPLIFT CONNECTORS AT TOP (UNO.) REFER TO NOTES AND DETAIL SHEETS FOR ADDITIONAL STRUCTURAL INFORMATION.

TABLE R602.75 MINIMUM NUMBER OF RULL HEIGHT STUDS AT EACH END OF HEADERS IN EXTERIOR WAL

	AL PHOLITICA OF LIPUDE AND IN TAUTION WAT			
	HEADER SPAN (FEET)	MAXIMUM STUD SPACING (INCHES. (PER TABLE R6023(5)		
		16	24	
	UP TO 31	1	1	
	4'	2	1	
	8'	3	2	
	121	5	3	
	16'	6	4	



J.S. THOMPSON
ENGINEERING, INC
606 WADE AVE. SUITE 104 RALEICH, NC 27605
PHONE, (919) 789-9919 FAX. (919) 789-9071

SOUTHPORT H&H HOMES


DATE: NOVEMBER 2, 2021

SCALE: 1/4" = 1'0" DRAWN BY: H&H HOMES

NGINEERED BY: WFB

SHEET: 5 OF: 9

S-2 FIRST FLOOR FRAMING PLAN

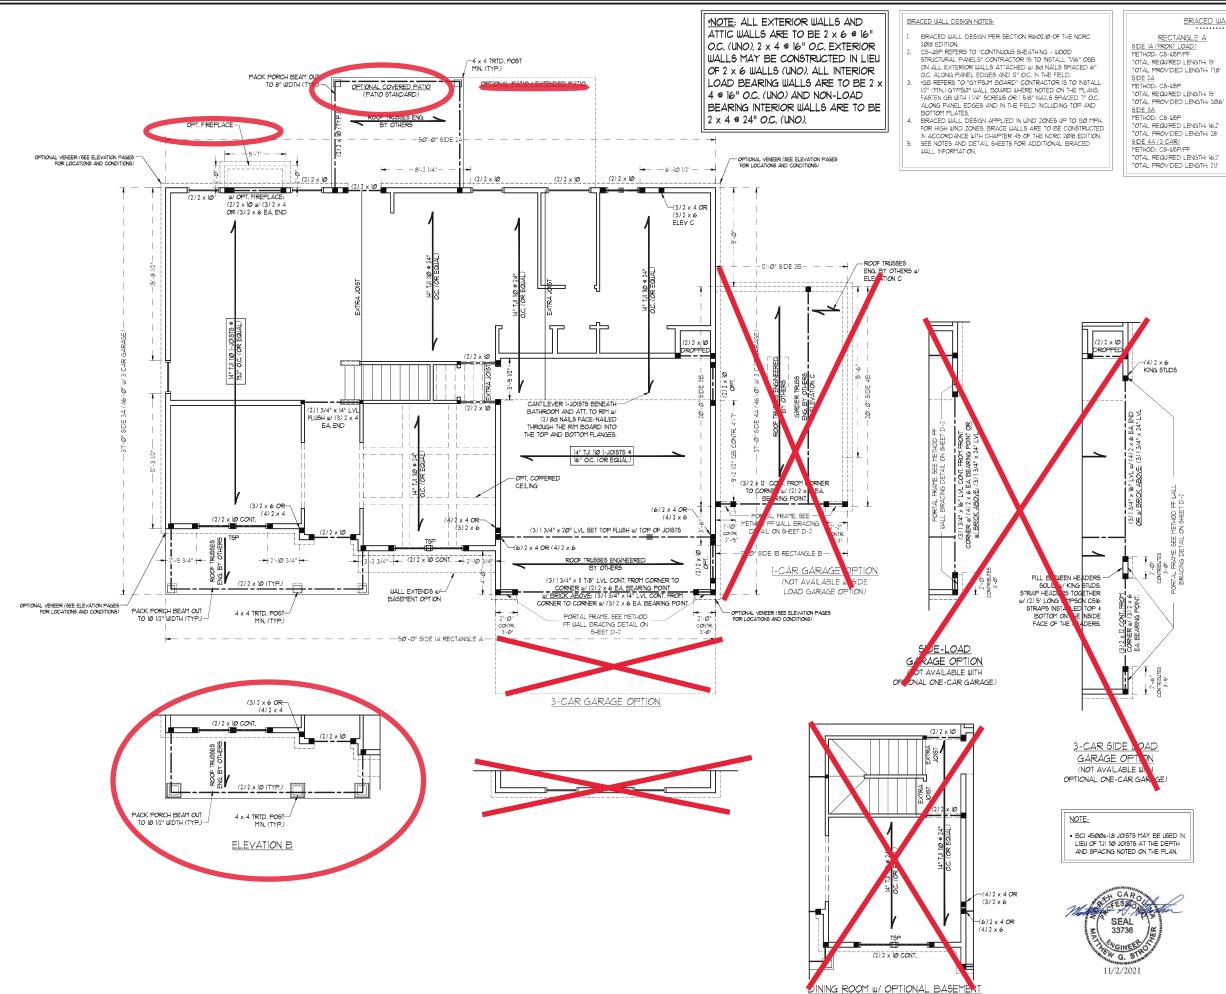

BRACED WALL DESIGN

TOTAL PROVIDED LENGTH: 1181

RECTANGLE B

1ETHOD: CS-WSP TOTAL REQUIRED LENGTH: 2,85"

TOTAL PROVIDED LENGTH: 28'

METHOD: PF/C5-WSP TOTAL REQUIRED LENGTH: 2.85 TOTAL PROVIDED LENGTH: 61

TOTAL PROVIDED LENGTH: 121 SIDE 3B / SIDE 4A CUMULATIVE METHOD: C6-U6P/GB TOTAL REQUIRED LENGTH: 1831 TOTAL PROVIDED LENGTH: 21,11 SIDE 4B METHOD: CS-WSP TOTAL REQUIRED LENGTH: 2,1'

TOTAL PROVIDED LENGTH: 15,58'

LENGTH (FT.)

UP TO 4 FT

4-8

S27605

» NC ഗ **D** 0 5 ERING
UTE 104 RALEIGH,
789-9919 FAX; (919) 7.
ICENSE NO.: C.1733 五四 NGINI NGINI 606 WADE AVE, PHONE: (919

VШ

SOUTHPORT H&H HOMES

8 AND GREATER BRICK SUPPORT NOTES:

LINTEL SCHEDULE APPLIES TO ALL OPENINGS IN BRICK VENEER (UNO), SEE ARCH DUGS, FOR SIZE AND LOCATION OF OPENINGS.

LINTEL SCHEDULE FOR

SIZE OF LINTEL

1 3 1/2 x 3 1/2 x 1/4

L 5 x 3 l/2 x 5/l6 LLV

L 6 x 4 x 5/16 LLV

BRICKNATURAL STONE SUPPORT

- OPENINGS.
 (LLV) = LONG LEG VERTICAL
 LENGTH = CLEAR OPENING
 EMBED ALL ANGLE IRONG MIN. 4" EACH
 SIDE INTO VENEER TO PROVIDE BEARING. FOR ALL HEADERS 8'-0" AND GREATER IN LENGTH, ATTACH STEEL ANGLE TO
- IN LENGTH, ATTACH STEEL ANGLE TO HEADER W/ 1/2" LAG SCREWS ® 12" O.C. STAGGERED. FOR ALL BRICK SUPPORT ® ROOF LINES, FASTEN (2) 2 x 10 BLOCKING BETWEEN
- STUDS w/ (4) 12d NAILS PER PLY, FASTEN Δ 6" x 4" x 5/16" STEEL ΔNGLE TO (2) 2 x A 6" X 4" X 5716" 51EEL ANGLE 10 (27 Z X 10 BLOCKING W (2) I/2" LAG SCREWS = 12" O.C. STAGGERED, SEE SECTION R103.82.1 OF THE 2018 NCRC FOR ADDITIONAL BRICK SUPPORT INFORMATION. PRECAST REINFORCED CONCRETE
- LINTELS ENGINEERED BY OTHERS MAY BE USED IN LIEU OF STEEL LINTELS.

STRUCTURAL NOTES:

- ALL FRAMING LUMBER TO BE SPF 12 (UNO.). ALL TREATED LUMBER TO BE SYP 12 (UNO.). ALL LOAD BEARING HEADERS TO BE (2) 2 x 6
- WINDOW AND DOOR HEADERS TO BE SUPPORTED W/ (1) JACK STUD AND (1) KING STUD EA, END (UNO.), SEE TABLE R6@2,75 FOR
- ADDITIONAL KING STUD REQUIREMENTS.
 SQUARES DENOTE POINT LOADS WHICH REQUIRE
 SOLID BLOCKING TO GIRDER OR FOUNDATION. ALL SQUARES TO BE (2) STUDS (UNO.)
- FOR HIGH WIND ZONES, ALL EXTERIOR WALLS TO BE SHEATHED WITH 1/6" 09B SHEATHING WITH JOINTS BLOCKED AND SECURED WITH 80 NAILS AT 3" O.C. ALONG EDGES AND 6" O.C. IN THE FIELD. FOR HIGH WIND ZONES, SECURE ALL EXTERIOR
- WALL SHEATHING PANELS TO DOUBLE TOP PLATES, BANDS, JOISTS, AND GIRDERS WITH (2) ROWS OF 8d NAILS STAGGERED AT 3" O.C. PANELS SHALL EXTEND 12" BEYOND CONSTRUCTION JOINTS AND SHALL OVERLAF GIRDERS AND DOUBLE SILL PLATES THEIR FULL DEPTH.
 ALL 4 x 4 POSTS SHALL BE ANCHORED TO
- SLABS w/ SIMPSON ABU44 POST BASES (OR EQUAL) AND 6 x 6 POSTS W/ ABU66 POST BASES (OR EQUAL) (UNO). ALL 4 x 4 AND 6 x 6 POSTS TO BE INSTALLED WITH 100 LB CAPACITY UPLIFT CONNECTORS AT TOP (UNO.)
- FOR FIBERGLASS, ALUMINUM, OR COLUMN ENG. BY OTHERS, SECURE TO SLAB w/ (2) METAL ANGLES USING 2" CONC. SCREWS. FASTEN ANGLES TO COLUMNS W/ 1/4" THROUGH BOLTS W/ NUTS AND MASHES. LOCATE ANGLES ON OPPOSITE SIDES OF COLUMN. THROUGH BOLTS MUST BE INSTALLED PRIOR TO SETTING COLUMN.
- REFER TO NOTES AND DETAIL SHEETS FOR ADDITIONAL STRUCTURAL INFORMATION.

"TSP" INDICATES TRIPLE STUD POCKET BETWEEN WINDOW UNITS.

TABLE R60215 MINIMUM NUMBER OF FULL HEIGHT STUDS AT EACH END OF HEADERS IN EXTERIOR WA

ALL THOU TIED OF HENDELSON IN EXCENSION WHEED			
MAXIMUM STUD SPACING (INCHES) (PER TABLE R6023(5)			
16	24		
1	1		
2	1		
3	2		
5	3		
6	4		
	MAXIMUM STUD S (PER TABL) 16 1 2 3 5		


ATE: NOVEMBER 2, 2021 CALE: 1/4" = 1'-0"

DRAWN BY: H&H HOMES

NGINEERED BY: WFB SHEET, 6

of: 9 S-3

SECOND FLOOR FRAMING PLAN

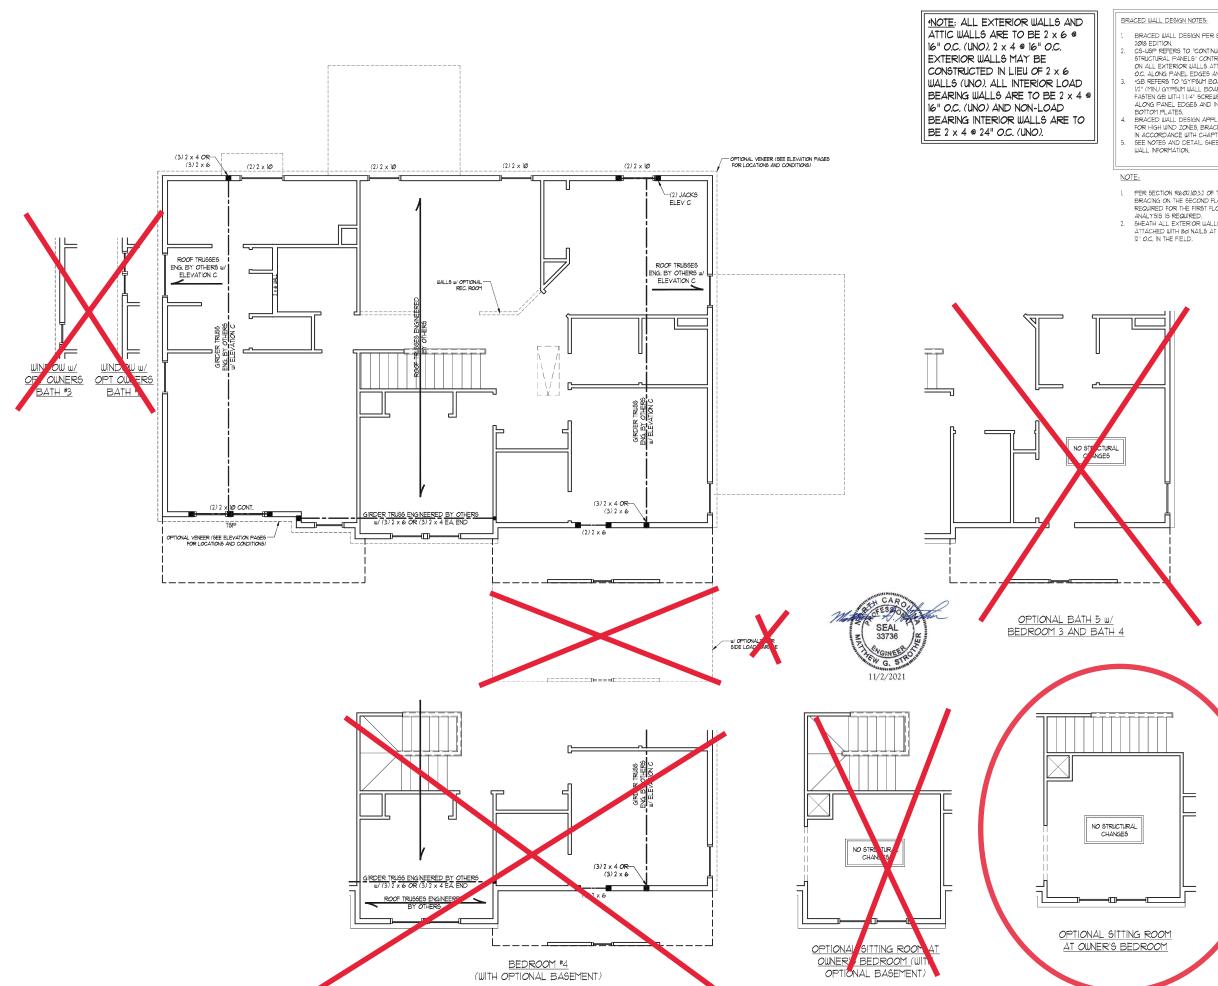

- BRACED WALL DESIGN PER SECTION R60210 OF THE NORC
- 2018 EDITION. CS-WSP REFERS TO "CONTINUOUS SHEATHING WOOD
- CS-LOP REPERS TO "CONTRACTOR IS TO INSTALL 17/6" OSB ON ALL EXTERIOR WALLS ATTACHED W 8d NAILS SPACED 6" OC. ALONG PANEL EDGES AND 2" OC. N. THE FIELD.

 GB REFERS TO "SYPSUM BOARD" CONTRACTOR IS TO INSTALL 1/2" ("INL) GYPSUM WALL BOARD WERE NOTED ON THE PLANS. FASTEN GB UTHI 1/4" SCREW OR 15/6" NAILS SPACED TO OC. ALONG PANEL EDGES AND IN THE FIELD INCLUDING TOP AND POOTTOM IS ATE.
- ALONG PANEL EDGES AND IN THE FIELD INCLUDING TOP AND BOTTOM PLATES.

 BRACED WALL DESIGN APPLIED IN WIND ZONES UP TO 130 MPH. FOR HIGH WIND ZONES, BRACE WALLES ARE TO BE CONSTRUCTED IN ACCORDANCE WITH CHAPTER 45 OF THE NCRC 2018 EDITION.

 SEE NOTES AND DETAIL SHEETS FOR ADDITIONAL BRACED
- L PER SECTION R602,1032 OF THE 2010 NCRC, THE AMOUNT OF BRACING ON THE SECOND FLOOR EXCEEDS THE AMOUNT REQUIRED FOR THE FIRST FLOOR AND NO BRACED WALL
- ANALYSIS IS REQUIRED.
 2. SHEATH ALL EXTERIOR WALLS WITH 1/16" OSB SHEATHING ATTACHED WITH 8d NAILS AT 6" O.C. ALONG PANEL EDGES AND

	CHEDULE FOR AL STONE SUPPORT	
	LENGTH (FT.)	SIZE OF LINTEL
	UP TO 4 FT.	L 3 1/2 x 3 1/2 x 1/4
	4-8	L 5 x 3 1/2 x 5/16 LLV

BRICK SUPPORT NOTES:

LINTEL SCHEDULE APPLIES TO ALL LINIEL SCHEDULE APPLIES TO ALL
OPENNAS IN DRICK VENEER (UND.) SEE
ARCH DUIGS, FOR SIZE AND LOCATION OF
OPENNAS.
(ILLY) = LONG LEG VERTICAL
LENGTH = CLEAR OPENNA
EMBED ALL ANGLE IRONS MIN. 4° EACH
SIDE INTO VENEER TO PROVIDE BEARING.

8 AND GREATER L 6 x 4 x 5/16 LLV

- FOR ALL HEADERS 8'-0" AND GREATER
 IN LENGTH, ATTACH STEEL ANGLE TO
 HEADER W/ 1/2" LAG SCREWS © 12" O.C. STAGGERED. FOR ALL BRICK SUPPORT @ ROOF LINES,
- FOR ALL BRICK SUPPORT © ROOF LINES, FASTEN (2) × 10 BLOCKING BETWEEN STUDS w/ (4) 12d NAILS PER PLY, FASTEN A 6" x 4" x 5/16" STEEL ANGLE TO (2) 2 x D BLOCKING w/ (2) 1/2" LAG SCREUS © 12" OC. STAGGERED. SEE SECTION R103.82.1 OF THE 2018 NORC FOR ADDITIONAL BRICK SUPPORT INFORMATION
- PRECAST REINFORCED CONCRETE
 LINTELS ENGINEERED BY OTHERS MAY BE
 USED IN LIEU OF STEEL LINTELS.

STRUCTURAL NOTES:

- ALL FRAMING LUMBER TO BE SPF 12 (UNO).
- ALL TREATED LUMBER TO BE \$17 % (UNO.)
 ALL LOAD BEARING HEADERS TO BE (2) 2 x 6 (UNO.)
- WINDOW AND DOOR HEADERS TO BE SUPPORTED W/(1) JACK STUD AND (1) KING STUD EA, END (UNO.), SEE TABLE R602,15 FOR ADDITIONAL KING STUD REQUIREMENTS, SQUARES DENOTE POINT LOADS WHICH
- REQUIRE SOLID BLOCKING TO GIRDER OR FOUNDATION. ALL SQUARES TO BE (2) STUDS (UNO.)
- FOR HIGH WIND ZONES, ALL EXTERIOR WALLS TO BE SHEATHED WITH THE "08B SHEATHING WITH JOINTS BLOCKED AND SECURED WITH 8d NAILS AT 3" O.C. ALONG EDGES AND 6" O.C. IN THE FIELD.
- FOR HIGH WIND ZONES, SECURE ALL EXTERIOR WALL SHEATHING PANELS TO DOUBLE TOP PLATES, BANDS, JOISTS, AND GIRDERS WITH (2) ROUS OF 8d NAILS STAGGERED AT 3" O.C. PANELS SHALL EXTEND 12" BEYOND CONSTRUCTION JOINTS AND SHALL OVERLAP GIRDERS AND DOUBLE SILL PLATES THEIR FULL DEPTH. EFFER TO NOTES AND DETAIL SHEETS FOR DDITIONAL STRUCTURAL INFORMATION.
- SP" INDICATES TRIPLE STUD POCKET

TABLE R602.1.5 MINIMUM NUMBER OF FULL HEIGHT STUDS EACH END OF HEADERS IN EXTERIOR WALLS

	ADER SPAN (FEET)	MAXIMUM 6TUD SPACING (INCHE (PER TABLE R6023(5)	
/	(ILLI)	16	24
	UP TO 31	1	1
	4'	2	1
	8'	3	2
	12'	5	3
	16'	6	4

	SCALE: 1/4" = 1'-0"		
	DRAWN BY: H&H HOM	(ES	
	ENGINEERED BY: WFB		
	SHEET: 7	OF:	(

DATE: NOVEMBER 2, 2021

SON H, NC 27605 1789-9921


ENGINEERING,

sowne average and a supplementation of the supplementa

 \rightarrow

SOUTHPORT H&H HOMES

CEILING FRAMING

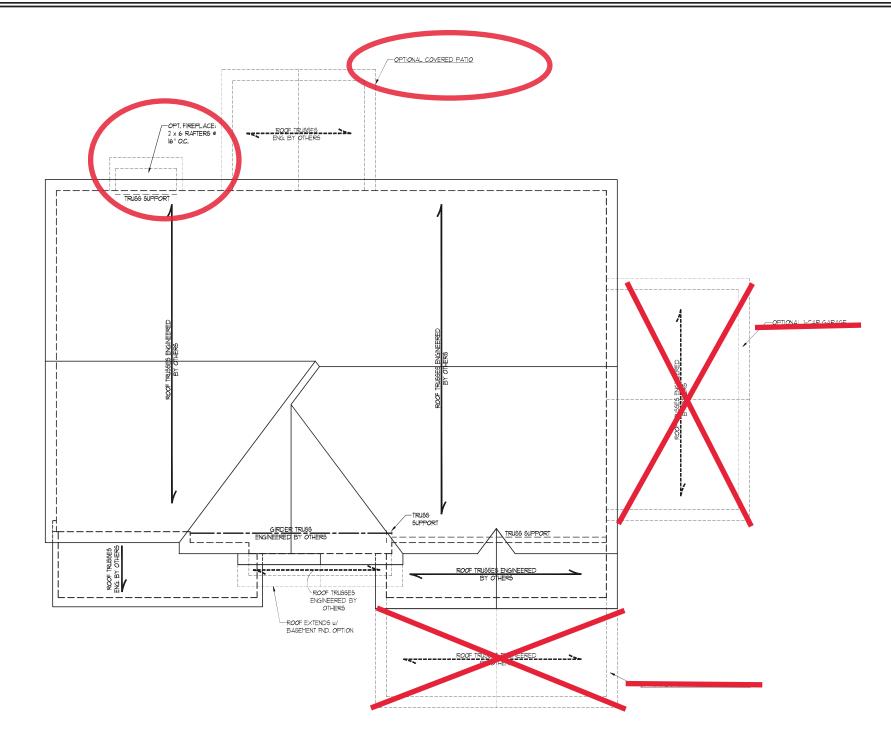

ELEVATIONS A & B



BRICK SUPPORT NOTE:

FASTEN (2) 2 × 10 BLOCKING BETWEEN WALL
STUDS W (4) 12d NAILS FER PLY, FASTEN A
6' x 4' x 5/16' STEEL ANGLE TO (2) 2 x 10
BLOCKING W (2) 12' 12d SOCEBUS 6 12' 0.C.
STAGERED. SEE SECTION R103321. OF
THE 2018 NORF FOR ADDITIONAL BRICK
SUPPORT INFORMATION.
WHERE ROOF SLOPES EXCEED 1-12, NSTALL
3" x 3" x 14" STEEL PLATE STOPS AT 24"
O.C. PER SECTION R103221 OF THE NORTH
CAROLINA RESIDENTIAL CODE, 2018
EDITION.

STRUCTURAL NOTES:

- STRUCTURAL NOTES:

 STRUCTURAL NOTES:

 ALL FRAMING LUMBER TO BE *2

 FOR (NO).

 CIRCLES DENOTE (3) 2 x 4 POSTS
 FOR ROOF SUPPORT.

 FRAME DOR'TER WALLS ON TOP
 OF DOUBLE OR TRIPLE RAFTERS.

 HIP SPLICES ARE TO BE SPACED
 A MIN OF 8'-0", FASTEN
 MEMBERS WITH THREE ROUS OF
 IZO NAILS & 16" OC. (17"P)

 STICK FRAME OVER-FRAMED
 ROOF SECTIONS W 2 x 8 RIDGES,
 2 x 6 RAFTERS ® 16" OC. AND
 FLAT 2 x 0" VALLET'S OR USE
 VALLET YRISSES.

 FASTEN FLAT VALLET'S TO
 RAFTERS OR TRISSES WITH
 SIMPSON H25A BURRICANE
 TIES THROUGH NOTCH IN ROOF
 SHEATHING. EACH RAFTER IS TO
 BE FASTEND TO THE FLAT
 VALLET WITH A MIN. OF (6) 12d
 TOE NAILS.

 REFER TO SECTION RAPOLIT OF THE
 2018 NORCE FOR REQUISION OF THE
 2018 NORCE FOR REQUISION OF THE
 RESISTANCE AT RAFTERS AND
 TRISSES.

 REFER TO NOTES AND DETAIL
- RESISTANCE AT RAFTERS AND TRUSSES.
 REFER TO NOTES AND DETAIL SHEETS FOR ADDITIONAL STRUCTURAL INFORMATION.

SOUTHPORT H&H HOMES

DATE: NOVEMBER 2, 2021

SCALE: 1/4" = 1'-0" DRAWN BY: H&H HOMES


ENGINEERED BY: WFB


SHEET: 8 OF: 9

S-5a ROOF FRAMING PLAN




DETAIL 3 <u>DETAIL 4</u> TRID. BOTTOM PLATE SECURED BY 1/2" DIA— BOLTS, 1/2" SEDHEAD ANCHORS, OR 1/2" SIMPRON TITIS HO BOLTS HITMIN 1/2" OF EACH CORNER (MINIMUM OF TUO ANCHORS FER PLATE SECTION, SEE CHART FOR SPACING AND EMBEDITIEST REC. TRID. BOTTOM PLATE SECURED BY 1/2" DIA— BOLTS, 1/2" REDHEAD ANCHORS, OR 1/2" SMPSON TIEN HD BOLTS WITHIN 12" OF EACH CORNER (MININUM OF TWO ANCHORS PER PLATE SECTION). SEE CHART FOR SPACING AND EMBEDMENT REQ. -SIDING AS SPEC. 1-4" VERTICALLY AND 2-6" HORIZONTALLY 4" PRICK VENEER FLASHING SHEATHING STARTER STRIP 4" CONCRETE SLAB-FIBER REINFORCING -WEEP HOLES -FINISH OR WELDED WIRE FABRIC W FIBER REINFORCING OR WELDED WIRE FABRIC -5" LEDGE / Ø 4" COMPACTED— WELL-DRAINING SOIL OR WASHED STONE 4" COMPACTED— WELL-DRAINING SOIL OR WASHED STONE UNDISTURBED EARTH, COMPACTED FILL OR WASHED STONE UNDISTURBED EARTH, WASHED STONE

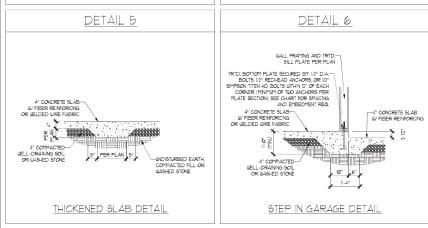



GARAGE CURB DETAIL


STEMWALL DETAILS



GRADE

ē ₹

GARAGE CURB BRICK LEDGE DETAIL



TYPICAL STEM WALL DETAIL (W/ OPTIONAL WATERTABLE

OPTIONAL STEM WALL DETAIL

DETAIL 2 WALL FRAMING AND TRTD.— SILL PLATE PER PLAN SILL PLATE PER PLAN FRID. BOTTOM PLATE SECURED BY 1/2" DIABOLTS OR THREADED RODS, WITHIN 12" OF EACH CORRER (THINTIUM OF TWO ANCHORS) PER PLATE SECTION, SEE CHART FOR SPACING AND EMBEDMENT REQ. I'-4" VERTICALLY AND 2'-6" HORIZONTALLY 4" BRICK VENEER 4" LEDGE -WEEP HOLES W FIBER REINFORCING OR WELDED WIRE FABRIC 4" COMPACTED— WELL-DRAINING SOIL OR WASHED STONE -LADDER WIRE EVERY OTHER COURSE -20" WIDE BY 8" DEEP WALL AND ALL CELLS III. REINF, TO BE GROUTED SOLID

DETAIL 3 SILL PLATE FER PLATE

TRID. BOTTOM PLATE SECURED BY 1/2" DIA.—
BOLTS OR THREADED RODS, WITHIN 2" OF
EACH CORNER (MINIMUM OF TUD ANCHORS
PER PLATE SECTION), SEE CHART FOR SIDING AS SPEC SHEATHING. W FIBER REINFORCING OR WELDED WIRE FABRIC 6 MIL. VAPOR— BARRIER FNISHED GRADE 4" COMPACTED-UNDISTURBED EARTH,-COMPACTED FILL OR WASHED STONE -8" CMU BLOCK WALL AND ALL CELLS W/ REINF. TO BE GROUTED SOLID.


TYPICAL STEM WALL FND. W/ BRICK DETAIL

TYPICAL STEM WALL FND. DETAIL W/ CURB @ GARAGE


<u>DETAIL 4</u>

LADDER WIRE EVERY OTHER COURSE

-12" CMJ BI OCK



TRTD. BOTTOM PLATE SECURED BY 1/2" DIA.— BOLTS OR THREADED ROD WITHIN 12" OF EACH CORNER (MINIMUM OF TWO ANCHORS PER PLATE SECTION), SEE CHART FOR 1'-4" VERTICALLY AND 2'-6" HORIZONTALLY 4" BRICK VENEER FLASHING EXPANSION— JOINT 4" CONCRETE SLAB-6 MIL. VAPOR-BARRIER 4" COMPACTED-WELL-DRAINING SOIL OR WASHED STONE UNDISTURBED EARTH, COMPACTED FILL OR WASHED STONE TOP TWO COURSES OF STEM WALL AND ALL CELLS W/ REINF, TO BE GROUTED SOLID. TYPICAL STEM WALL FND. DETAIL W/ BRICK OPTIONAL STEM WALL FND. DETAIL W/ CURB @ GARAGE

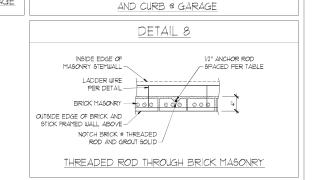

MASONRY STEMWALL SPECIFICATIONS MASONRY WALL TYPE WALL HEIGHT (FEET) 4" BRICK AND 4" 4" BRICK AND 8" 8" CMU 12" CMU 2 AND BELOW UNGROUTED GROUT SOLID UNGROUTED UNGROUTED UNGROUTED GROUT SOLID UNGROUTED UNGROUTED GROUT SOLID w/ *4 REBAR @ 48" O.C. GROUT SOLID w/ *4 REBAR @ 64" O.C. GROUT SOLID GROUT SOLID GROUT SOLID W/ *4 GROUT SOLID W/ *4 GROUT SOLID w/ #4 5 NOT APPLICABLE REBAR @ 36" O.C. NOT APPLICABLE GROUT SOLID W/ *4 GROUT SOLID W/ *4 REBAR @ 24* O.C. REBAR @ 64* O.C. GROUT SOLID w/ *4 REBAR @ 24" O.C. 6 1 AND GREATER ENGINEERED DESIGN BASED ON SITE CONDITIONS

STRUCTURAL NOTES:

WALL HEIGHT MEASURED FROM TOP OF FOOTING TO TOP OF THE WALL.
TIE MULTIPLE WITHES TOGETHER WITH LADDER WIRE AT 16" O.C. VERTICALLY.
CHART APPLICABLE FOR HOUSE FOUNDATION ONLY, CONSULT ENGINEER FOR DESIGN OF GARAGE FOUNDATION NOT COMMON TO HOUSE.

FOUNDATION NOT COMMON TO HOUSE.

BACKFILL OF CLEAN 51 / 51 MASHED STONE 16 ALLOWABLE.

BACKFILL OF WELL DRAINED OR SAND - GRAVEL MIXTURE SOILS (45 PSP.FT BELOW GRADE)

CLASSIFIED AS GROUP I ACCORDING TO INFIRED SOILS CLASSIFICATION SYSTEM IN ACCORDANCE

WITH TABLE RADE OF THE 708 INTERNATIONAL RESIDENTIAL CODE ARE ALLOWABLE.

PREP \$LAB PER RS0621 AND R80622 BASE OF THE 2018 INTERNATIONAL RESIDENTIAL CODE.

MINIMUM 24" LAP SPLICE LENGTH

LOCATE REBAR IN CENTER GIF.

LOCATE REBAR IN CENTER OF FOUNDATION WALL.

WHERE REQUIRED, FILL BLOCK SOLID WITH TYPE "S" MORTAR OR 3000 PSI GROUT, USE OF "LOW LIFT GROUTING" METHOD REQUIRED WHEN FILLING WALLS WITH GROUT AT HEIGHTS OF 5" AND GREATER

ANCHOR SPACING AND EMBEDMENT		
WIND ZONE	12 <i>0</i> MPH	130 MPH
5PACING:	6'-0" O.C.	4'-0" O.C.
EMBEDMENT	7"	IS" INTO MASONRY T" INTO CONCRETE

S. II. NGINE GGG WADE AVT PHONT SPEED

WIND MPH ULTIMATE DESIGN FOUNDATION DETAILS 130] 120 MPH -

CALE: NTS GINEERED BY: JES

D-1 FOUNDATION DETAILS








- WALL BRACING DESIGNED IN ACCORDANCE WITH CHAPTER 6 OF THE 2018 NC RESIDENTIAL BUILDING CODE (NCRC). TABLES AND FIGURES REFERENCED ARE FROM THE 2018 NCRC. SEE THIS SHEET FOR GENERAL DETAILS. REFER TO THE 2018 NORG FOR ADDITIONAL INFORMATION AS NEEDED
- SEE STRUCTURAL SHEETS FOR BRACED WALL LOCATIONS, DIMENSIONS, HOLD DOWN TYPE AND LOCATIONS, BRACED WALL LINE KEY WITH WALL DESIGN SUMMARY OF REQUIRED/PROVIDED TOTALS FOR EACH WALL LINE AND ANY SPECIAL NOTES
- 4. ALL EXTERIOR WALLS ARE TO BE SHEATHED WITH CS-WSP IN ACCORDANCE WITH SECTION R602.10.3 UNLESS NOTED OTHERWISE.
- O HERWISE.


 ALL EXTERIOR AND INTERIOR WALLS TO HAVE 1/2" GYPSUM INSTALLED, WHEN NOT USING METHOD "GB", GYPSUM TO BE FASTENED PER TABLE RIGOLS, METHOD GB TO BE FASTENED PER TABLE REGOL/Ø]

 6. CS-WSP REFERS TO THE "CONTINUOUS SHEATHING. WOOD STRUCTURAL PANELS" WALL BRACING METHOD. TI/6" OSB SHEATHING IS TO BE NISTALLED ON ALL EXTERIOR WALLS ATTACHED W 6d COMMON NAILS OR 8d (2) 1/2" LONG X Ø]13" DIAMETER) NAILS SPACED 6" O.C. ALONG PANEL EDGES AND 12" O.C. IN THE FIELD (UN.O.).
- GB REFERS TO THE "GTPSM" BOARD" WALL BRACING METHOD. 12" (MIN) GYPSM" WALL BOARD IS TO BE INSTALLED ON BOTH SIDES OF THE BRACED WALL FASTENED WITH 114" SCREWS OR 15.0" NALLS SPACED T" OC. ALONG PARAL EDGES NICLUDING TOP AND BOTHOM PLATES AND INTERMEDIATE SUPPORTS (MIN). VERBY ALL FASTENED WITH STORY AND SOTOM PLATES AND INTERMEDIATE SUPPORTS (MIN). VERBY ALL FASTENED WITH STORY AND 5/8" GYPSM" FRIOR TO CONSTRUCTION. FOR INTERIOR FASTENER OPTIONS SEE TABLE RT0235. FOR EXTERIOR FASTENER OPTIONS SEE TABLE R6023(1). EXTERIOR GB TO BE INSTALLED VERTICALLY.
- REQUIRED BRACED WALL LENGTH FOR EACH SIDE OF THE CIRCUMSCRIBED RECTANGLE ARE INTERPOLATED PER TABLE R602, 103, METHOD CS-USP CONTRIBUTES ITS ACTUAL LENGTH, METHOD GB CONTRIBUTES 5 ITS ACTUAL LENGTH, AND METHOD PF CONTRIBUTES IS TIMES ITS ACTUAL LENGTH.

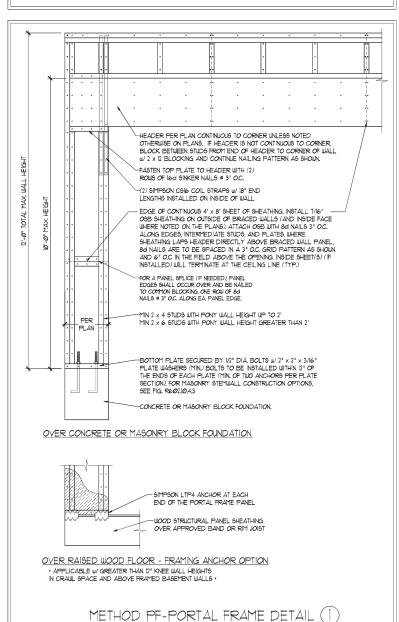

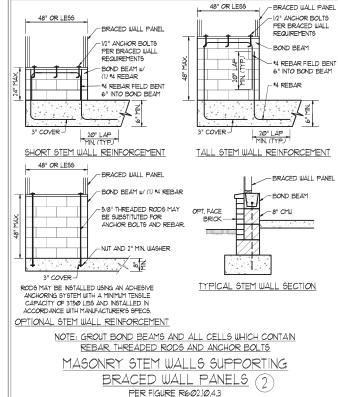

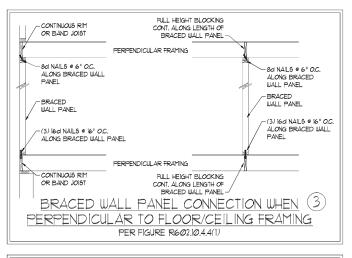

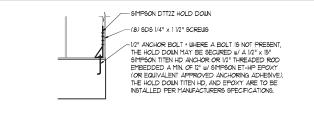

HOLD DOWN DETAIL FOR MASONRY

FOUNDATION OR MONOLITHIC SLAB

* APPLICABLE ONLY WHERE SPECIFIED ON PLAN


This sealed page is to be used in conjunction with a full plan set engineered by J.S. Thompson Engineering, Inc. only. Use of this individual sealed page within architectural pages or shop drawings by others is a punishable offense under N.C. Statute § 89C-23


WITH CHAPTER 1 (TYP.


(2 ROUS @ 24" O.C. -


SHEATHING PER PLAN

CONTINUOUS ILLOOD

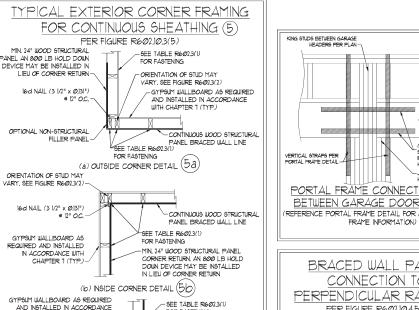





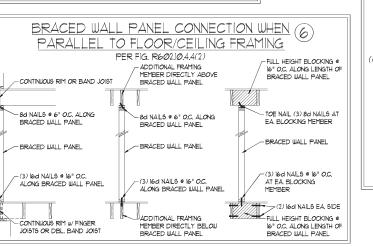


MIN. 24" WOOD STRUCTURAL

PANEL CORNER RETURN. AN

FASTENERS ON EACH STUD (5c) AT EACH PANEL EDGE (c) GARAGE DOOR CORNER DETAIL (SEE PLAN FOR ADDITIONAL STRUCTURAL INFORMATION OR ALTERNATE CONFIGURATIONS)

800 LB HOLD DOWN DEVICE MAY BE INSTALLED IN LIEU



SPEED S DESIGN WIND S AND DETAILS MPH ULTIMATE I BRACING NOTES MPH - 130 N WALL E 120

DATE: NOVEMBER 14, 2018 CALE: 1/4" = 1'-0"

DRAWN BY: IST

NGINEERED BY: IST

BRACED WALL NOTES AND DETAILS AND PF DETAIL

33736

a Z ഗ وَ الْمُ Z Z Z II W ٠ | أ ح ٠ ٥ -S S JШ

ഗ

lw '

SPEED WIND · 130 MPH ULTIMATE DESIGN W STANDARD STRUCTURAL NOT

DATE: NOVEMBER 14, 2018

CALE: 1/4" - 1'-0" DRAWN BY: IES

NGINEERED BY: JST

GENERAL NOTES

- 1 ENGINEER'S SEAL APPLIES ONLY TO STRUCTURAL COMPONENTS INCLUDING ROOF RAFTERS HIPS VALLEYS RIDGES FLOORS WALLS BEAMS HEADERS, COLUMNS, CANTILEYERS, OFFSET LOAD BEARING WALLS, PIERS, GIRDER SYSTEM AND FOOTING. ENGINEER'S SEAL DOES NOT CERTIFY DIMENSIONAL ACCURACY OF ARCHITECTURAL LAYOUT INCLUDING ROOF, ENGINEER'S SEAL DOES NOT APPLY TO 1-JOIST OR FLOOR/ROOF TRUSS
- ALL CONSTRUCTION SHALL CONFORM TO THE LATEST REQUIREMENTS OF THE NORTH CAROLINA RESIDENTIAL CODE (NORC.), 2018 EDITION, PLUS
 ALL LOCAL CODES AND REGULATIONS. THE STRUCTURAL ENGINEER IS NOT RESPONSIBLE FOR, AND WILL NOT HAVE CONTROL OF, CONSTRUCTION MEANS METHODS TECHNIQUES SEQUENCES OR PROCEDURES OR SAFETY PRECAUTIONS AND PROGRAMS IN CONNECTION WITH THE CONSTRUCTION WORK. NOR WILL THE ENGINEER BE RESPONSIBLE FOR THE CONTRACTORS FAILURE TO CARRY OUT THE CONSTRUCTION WORK IN ACCORDANCE WITH THE CONTRACT DOCUMENTS.
- 3. STRUCTURAL DESIGN BASED ON THE PROVISIONS OF THE NCRC, 2018 EDITION (R3014 R3011)

DESIGN CRITERIA:	LIVE LOAD (PSF)	DEAD LOAD (PSF)	DEFLECTION (IN)
ATTIC WITH LIMITED STORAGE	20	10	L/240 (L/360 w/ BRITTLE FINISHES)
ATTIC WITHOUT STORAGE	10	10	L/36Ø
DECKS	40	10	L/36Ø
EXTERIOR BALCONIES	40	10	L/36Ø
FIRE ESCAPES	40	1Ø	L/36Ø
HANDRAILS/GUARDRAILS	200 LB OR 50 (PLF)	10	L/360
PASSENGER VEHICLE GARAGE	5Ø	10	L/36Ø
ROOMS OTHER THAN SLEEPING ROOM	40	10	L/36Ø
SLEEPING ROOMS	3Ø	10	L/36Ø
STAIRS	40	10	L/360
WIND LOAD	(BASED ON TABLE R3012(4) WIND ZONE AND EXPOSURE)		
GROUND SNOW LOAD: Pg	SNOW LOAD; Pg 20 (PSF)		

- I-JOIST SYSTEMS DESIGNED WITH 12 PSF DEAD LOAD AND DEFLECTION (IN) OF L/480
- FLOOR TRUSS SYSTEMS DESIGNED WITH 15 PSF DEAD LOAD
- 4. FOR 115 AND 120 MPH WIND ZONES FOUNDATION ANCHORAGE IS TO COMPLY WITH SECTION R403.16 OF THE NCRC, 2018 EDITION, FOR 130 MPH, 140 MPH, AND 150 MPH WIND ZONES, FOUNDATION ANCHORAGE IS TO COMPLY WITH SECTION 4504 OF THE NCRC, 2018 EDITION.
- 5. ENERGY EFFICIENCY COMPLIANCE AND INSULATION VALUES OF THE BUILDING TO BE IN ACCORDANCE WITH CHAPTER II OF THE NCRC, 2018 EDITION.

FOOTING AND FOUNDATION NOTES

- 1. FOUNDATION DESIGN BASED ON A MINIMUM ALLOWABLE BEARNG CAPACITY OF 2000 PSF. CONTACT GEOTECHNICAL ENGINEER IF BEARNG CAPACITY IS NOT ACHIEVED.
- 2. FOR ALL CONCRETE SLABS AND FOOTINGS, THE AREA WITHIN THE PERIMETER OF THE BUILDING ENVELOPE SHALL HAVE ALL VEGETATION, TOP FOR ALL CORCNETE IS LABS AND FOOTINGS, THE AREA WITHIN THE PERITE ERY OF THE BUILDING ENVELOYE SHALL HAVE ALL YESTETATION OF THE SULPHIAN ENVELOYE SHALL HAVE ALL YESTETATION CONTROL THE FILL DEPTHS SHALL HAVE ALL YESTETATION CONTROL THE FILL DEPTHS SHALL NOT EXCEED 24 FOR CLEAN SAND OR GRAYEL. A 4" THICK BASED CONSISTING OF CLEAN GRADED SAND OR GRAYEL SHALL BE PLACED. A BASE COURSE CONSISTING OF CLEAN GRADED SAND OR GRAYEL SHALL BE PLACED. A BASE COURSE IS NOT REQUIRED UNLETE A CONCRETE SLAB IS INSTALLED ON USELL-DRAINED OR SAND-GRAY INTURIES OF IS CLASSIFIED AS GROUP I, ACCORDING TO THE UNITED SOIL CLASSIFICATION SYSTEM IN ACCORDANCE WITH TABLE R4051 OF THE NORC, 2018 EDITION.
- 3. PROPERLY DEWATER EXCAVATION PRIOR TO POURING CONCRETE WHEN BOTTOM OF CONCRETE SLAB IS AT OR BELOW WATER TABLE. IF APPLICABLE, 3/4" - 1" DEEP CONTROL JOINTS ARE TO BE SAWED WITHIN 4 TO 12 HOURS OF CONCRETE FINISHING AND WALL LOCATIONS HAVE BEEN MARKED. ADJUST WHERE NECESSARY.
- 4. CONCRETE SHALL CONFORM TO SECTION R4022 OF THE NCRC, 2018 EDITION, CONCRETE REINFORCING STEEL TO BE ASTM A615 GRADE 60 WELDED WIRE FABRIC TO BE ASTM AIRS. MAINTAIN A MINIMUM CONCRETE COVER AROUND REINFORCING STEEL OF 3" IN FOOTINGS AND 1 1/2" IN SLABS, FOR POURED CONCRETE WALLS, CONCRETE COVER FOR REINFORCING STEEL MEASURED FROM THE INSIDE FACE OF THE WALL SHALL ONOT BE LESS THAN 3/4". CONCRETE COVER FOR REINFORCING STEEL MEASURED FROM THE OUTSIDE FACE OF THE WALL. SHALL NOT BE LESS THAN 11/2" FOR 15 BARS OR SMALLER, AND NOT LESS THAN 2" FOR 16 BARS OR LARGER.

This sealed page is to be used in conjunction with a full

architectural pages or shop drawings by others is a punishable offense under N.C. Statute § 89C-23

ered by J.S. Thompson Engineering, Inonly. Use of this individual sealed page within

- 5. MASONRY UNITS TO CONFORM TO ACE 530/ASCE 5/TMS 402. MORTAR SHALL COMFORM
- 6. THE UNSUPPORTED HEIGHT OF MASONRY PIERS SHALL NOT EXCEED FOUR TIMES THEIR LEAST DIMENSION FOR UNFILLED HOLLOW CONCRETE MASONRY UNITS AND TEN TIMES THEIR LEAST DIMENSION FOR SOLID OR SOLID FILLED PIERS. PERS MAY BE FILLED SOLID WITH CONCRETE OR TYPE M OR 5 MORTAR PIERS AND WALLS SHALL BE CAPPED WITH 8" OF SOLID MASONRY
- THE CENTER OF EACH OF THE PIERS SHALL BEAR IN THE MIDDLE THIRD OF ITS RESPECTIVE FOOTING, EACH GIRDER SHALL BEAR IN THE MIDDLE THIRD OF THE PIERS.
- 8. ALL CONCRETE AND MASONRY FOUNDATION WALLS ARE TO BE CONSTRUCTED IN ACCORDANCE WITH THE PROVISIONS OF SECTION RIPS OF INTENSIVE EDITION OR IN ACCORDANCE WITH ACI 318, ACI 332, NCM* AREA-A OR ACE 350/ASCE 5/1705 462. WASONRY FOUNDATION WALLS ARE TO BE REINFORCED FER TABLE RAPALINI), RAPALINI2), RAPALINI3), OR RAPALINI4) OF THE NCRC, 2018 EDITION. CONCRETE FOUNDATION WALLS ARE TO BE REINFORCED FER TABLE RAPALINIS) OF THE NCRC, 2018 EDITION. STEP CONCRETE FOUNDATION WALLS TO 2 x 6 FRAMED WALLS AT 16" O.C. WHERE GRADE PERMITS (UNO).

ALL FRAMING LUMBER SHALL BE \$2 SPF MINIMUM (Fb = 815 PS) Fv = 315 PS) F = 16000000 PS)) LINLESS NOTED OTHERWISE (UNO.) ALL TREATED LUMBER SHALL BE 1 2 SYP MINIMUM (Fb = 915 PSI, Fv =115 PSI, E = 1600000 PSI) UNLESS NOTED OTHERWISE (UNC

FRAMING NOTES

- LAMINATED VENEER LUMBER (LVL) SHALL HAVE THE FOLLOWING MINIMUM PROPERTIES: Fo =2600 PSI, Fv = 285 PSI, E = 19000000 PSI. LAMINATED STRAND LUMBER (LSL) SHALL HAVE THE FOLLOWING MINIMUM PROPERTIES; Fb = 2325 PSI, Fv = 310 PSI, E = 1550000 PSI, PARALLEL STRAND LUMBER (PSL.) UP TO 1" DEPTH SHALL HAVE THE FOLLOWING MINIMUM PROPERTIES: Fo = 2500 FSI, E = 18000000 FSI, PARALLEL STRAND LUMBER (PSL.) MORE THAN 1" DEPTH SHALL HAVE THE FOLLOWING MINIMUM PROPERTIES: Fo = 2900 FSI, E = 20000000 PSI. INSTALL ALL CONNECTIONS PER MANUFACTURER'S SPECIFICATIONS.
- 3. STRUCTURAL STEEL SHALL CONFORM TO THE FOLLOWING ASTM SPECIFICATIONS

W AND WT SHAPES: CHANNELS AND ANGLES: ASTM A36 HOLLOW STRUCTURAL SECTIONS: ASTM A500 GRADE B ASTM A53, GRADE B, TYPE E OR S

4. STEEL BEAMS SHALL BE SUPPORTED AT EACH END WITH A MINIMUM BEARING LENGTH OF 3 1/2" AND FULL FLANGE WIDTH (UNO). PROVIDE SOLID BEARING FROM BEAM SUPPORT TO FOUNDATION. BEAMS SHALL BE ATTACHED AT THE BOTTOM FLANGE TO EACH SUPPORT AS FOLLOWS (UNO):

A. WOOD FRAMING (2) 1/2" DIA. x 4" LONG LAG SCREWS B. CONCRETE C. MASONRY (FULLY GROUTED) (2) 1/2" DIA. x 4" LONG SIMPSON TITEN HD ANCHORS

LATERAL SUPPORT IS CONSIDERED ADEQUATE PROVIDING THE JOISTS ARE TOE NAILED TO THE 2x NAILER ON TOP OF THE STEEL BEAM, AND THE 2x NAILER 16 SECURED TO THE TOP OF THE STEEL BEAM w/ (2) ROUG OF SELF TAPPING SCREUG ® 16" O.C. OR (2) ROUG OF 1/2" DIAMETER BOLTS ® 16" O.C. IF 1/2" BOLTS ARE USED TO FASTEN THE NAILER, THE STEEL BEAM SHALL BE FABRICATED w/ (2) ROUG OF 9/6" DIAMETER

- 5. SQUARES DENOTE POINT LOADS WHICH REQUIRE SOLID BLOCKING TO GIRDER OR FOUNDATION, SHADED SQUARES DENOTE POINT LOADS
- $6. \quad \text{ALL LOAD BEARING HEADERS TO CONFORM TO TABLE R602.7(1) AND R602.7(2) OF THE NCRC, 2018 EDITION OR BE (2) 2 × 6 WITH (1) JACK } \\$ AND (1) KING STUD EACH END (UNO), WHICHEVER IS GREATER ALL HEADERS TO BE SECURED TO EACH JACK STUD WITH (4) 8d NAILS. ALL BEAMS TO BE SUPPORTED WITH (2) STUDS AT EACH BEARING POINT (UNO). INSTALL KING STUDS PER SECTION R602.1.5 OF THE NORTH CAROLINA RESIDENTIAL CODE, 2018 EDITION.
- 1. ALL BEAMS, HEADERS, OR GIRDER TRUSSES PARALLEL TO WALL ARE TO BEAR FULLY ON (1) JACK OR (2) STUDS MINIMUM OR THE NUMBER OF JACKS OR STUDS NOTED. ALL BEAMS OR GIRDER TRUSSES PERPENDICULAR TO WALL AND SUPPORTED BY (3) STUDS OR LESS ARE TO HAVE I 1/2" MINIMUM BEARING (UNO). ALL BEAMS OR GIRDER TRUSSES PERPENDICULAR TO WALL AND SUPPORTED BY MORE THAN (3) STUDS OR OTHER NOTED COLUMN ARE TO BEAR FULLY ON SUPPORT COLUMN FOR ENTIRE WALL DEPTH (UNO). BEAM ENDS THAT BUTT INTO ONE ANOTHER ARE TO EACH BEAR EQUAL LENGTHS (UNO).
- FLITCH BEAMS SHALL BE BOLTED TOGETHER USING 1/2" DIAMETER BOLTS (ASTM A3/01) WITH WASHERS PLACED AT THREADED END OF BOLT. BOLTS SHALL BE SPACED AT 24" CENTERS (MAXIMUM), AND STAGGERED AT TOP AND BOTTOM OF BEAM (2" EDGE DISTANCE), WITH (2) BOLTS OCATED AT 6" FROM EACH END (UNO)
- 9. ALL I-JOIST OR TRUSS LAYOUTS ARE TO BE IN COMPLIANCE WITH THE OVERALL DESIGN SPECIFIED ON THE PLANS, ALL DEVIATIONS ARE TO BE BROUGHT TO THE ATTENTION OF THE ENGINEER OF RECORD PRIOR TO INSTALLATION.
- IØ. BRACED WALL PANELS SHALL BE CONSTRUCTED ACCORDING TO THE NORTH CAROLINA RESIDENTIAL CODE 2018 EDITION WALL BRACING CRITERIA, THE AMOUNT, LENGTH, AND LOCATION OF BRACING SHALL COMPLY WITH ALL APPLICABLE TABLES IN SECTION R602.10.
- PROVIDE DOUBLE JOIST UNDER ALL WALLS PARALLEL TO FLOOR JOISTS. PROVIDE SUPPORT UNDER ALL WALLS PARALLEL TO FLOOR TRUSSES OR 1-JOISTS PER MANUFACTURER'S SPECIFICATIONS. INSTALL BLOCKING BETWEEN JOISTS OR TRUSSES FOR POINT LOAD SUPPORT FOR ALL POINT LOADS ALONG OFFSET LOAD LINES.
- 12. FOR ALL HEADERS SUPPORTING BRICK VENEER THAT ARE LESS THAN 8'-0" IN LENGTH, REST A 6" x 4" x 5/6" STEEL ANGLE WITH 6" MINIMUM EMBEDMENT AT SIDES FOR BRICK SUPPORT (UN.O.). FOR ALL HEADERS 8'-Ø" AND GREATER IN LENGTH, BOLT A 6" x 4" x 5/6" STEEL ANGLE TO HEADER WITH 1/2" LAG SCREWS AT 12" O.C. STAGGERED FOR BRICK SUPPORT. FOR ALL BRICK SUPPORT AT ROOF LINES, BOLT A 6" x 4" x 5/16" STEEL ANGLE TO (2) 2 x 10 BLOCKING INSTALLED W/ (4) 12d NAILS EA, PLY BETWEEN WALL STUDS WITH (2) ROWS OF 1/2" LAG SCREWS AT 12" O.C. STAGGERED AND IN ACCORDANCE WITH SECTION RT03.82.1 OF THE NCRC, 2018 EDITION.
- 13. FOR STICK FRAMED ROOFS: CIRCLES DENOTE (3) 2×4 POSTS FOR ROOF MEMBER SUPPORT. HIP SPLICES ARE TO BE SPACED A MINIMUM OF 8'-0". FASTEN MEMBERS WITH THREE ROWS OF 12d NAILS AT 16" O.C. FRAME DORMER WALLS ON TOP OF DOUBLE OR TRIPLE RAFTERS AS
- 14. FOR TRUSSED ROOFS, FRAME DORMER WALLS ON TOP OF 2 x 4 LADDER FRAMING AT 24" O.C. BETWEEN ADJACENT ROOF TRUSSES, STICK FRAME OVER-FRAMED ROOF SECTIONS WITH 2 x 8 RIDGES, 2 x 6 RAFTERS AT 16" O.C. AND FLAT 2 x 10" VALLEYS (UNO).
- ALL 4 x 4 AND 6 x 6 POSTS TO BE INSTALLED WITH 100 LB CAPACITY UPLIFT CONNECTORS TOP AND BOTTOM (UNO.) POSTS MAY BE SECURED USING ONE SIMPSON H6 OR LTS12 UPLIFT CONNECTOR FASTENED TO THE BAND AT THE BOTTOM AND THE BEAM AT THE TOP OF EACH POST. ONE 16" SECTION OF SIMPSON CS16 COIL STRAPPING WITH (8) 8d HDG NAILS AT EACH END MAY BE USED IN LIEU OF EACH TWIST STRAP IF DESIRED. FOR MASONRY OR CONCRETE FOUNDATION USE SIMPSON POST BASE.

MPH 120

S-0 STRUCTURAL NOTES