

RE: 34943A
 54 SERENITY

Trenco
 818 Soundside Rd
 Edenton, NC 27932

Site Information:

Customer: Project Name: 34943A
 Lot/Block:
 Address:
 City:

Model:
 Subdivision:
 State:

General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):

Design Code: IRC2015/TPI2014
 Wind Code: ASCE 7-10
 Roof Load: 40.0 psf

Design Program: MiTek 20/20 8.6
 Wind Speed: 120 mph
 Floor Load: N/A psf

This package includes 46 individual, dated Truss Design Drawings and 0 Additional Drawings.

No.	Seal#	Truss Name	Date	No.	Seal#	Truss Name	Date
1	I53629133	A1G	8/16/2022	21	I53629153	J3	8/16/2022
2	I53629134	A2	8/16/2022	22	I53629154	J4	8/16/2022
3	I53629135	A3	8/16/2022	23	I53629155	J5	8/16/2022
4	I53629136	A4	8/16/2022	24	I53629156	J6	8/16/2022
5	I53629137	A5	8/16/2022	25	I53629157	J7	8/16/2022
6	I53629138	A6	8/16/2022	26	I53629158	J8	8/16/2022
7	I53629139	A7	8/16/2022	27	I53629159	J9	8/16/2022
8	I53629140	A8E	8/16/2022	28	I53629160	M1	8/16/2022
9	I53629141	B1E	8/16/2022	29	I53629161	M1GE	8/16/2022
10	I53629142	B2G	8/16/2022	30	I53629162	M2	8/16/2022
11	I53629143	C1E	8/16/2022	31	I53629163	M2GE	8/16/2022
12	I53629144	C2	8/16/2022	32	I53629164	M3	8/16/2022
13	I53629145	C3	8/16/2022	33	I53629165	M3GE	8/16/2022
14	I53629146	C4G	8/16/2022	34	I53629166	PB1	8/16/2022
15	I53629147	D1E	8/16/2022	35	I53629167	PB2	8/16/2022
16	I53629148	D2	8/16/2022	36	I53629168	V1	8/16/2022
17	I53629149	E1E	8/16/2022	37	I53629169	V2	8/16/2022
18	I53629150	E2	8/16/2022	38	I53629170	V3	8/16/2022
19	I53629151	J1	8/16/2022	39	I53629171	V4	8/16/2022
20	I53629152	J2	8/16/2022	40	I53629172	V5	8/16/2022

The truss drawing(s) referenced above have been prepared by Truss Engineering Co. under my direct supervision based on the parameters provided by 84 Components - #2383.

Truss Design Engineer's Name: Gilbert, Eric

My license renewal date for the state of North Carolina is December 31, 2023.

North Carolina COA: C-0844

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to TRENCO. Any project specific information included is for TRENCO customers file reference purpose only, and was not taken into account in the preparation of these designs. TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.



August 16, 2022

RE: 34943A - 54 SERENITY

Trenco
818 Soundside Rd
Edenton, NC 27932

Site Information:

Project Customer: Project Name: 34943A

Lot/Block:

Subdivision:

Address:

City, County:

State:

No.	Seal#	Truss Name	Date
41	I53629173	V6	8/16/2022
42	I53629174	V7	8/16/2022
43	I53629175	V8	8/16/2022
44	I53629176	V9	8/16/2022
45	I53629177	V10	8/16/2022
46	I53629178	V11	8/16/2022

Job 34943A	Truss A1G	Truss Type Half Hip Girder	Qty 1	Ply 2	54 SERENITY	153629133
---------------	--------------	-------------------------------	----------	----------	-------------	-----------


84 Components (Dunn), Dunn, NC - 28334,

8.610 s Jul 18 2022 MiTek Industries, Inc. Thu Aug 11 21:24:20 2022 Page 1

ID:nxbot3WsxISjrAw_FcBFB3yorwP-9djemlhSsnYo4g0P2CY7vtDCkot_h3O98FjeqzyouUf



Scale = 1:59.8

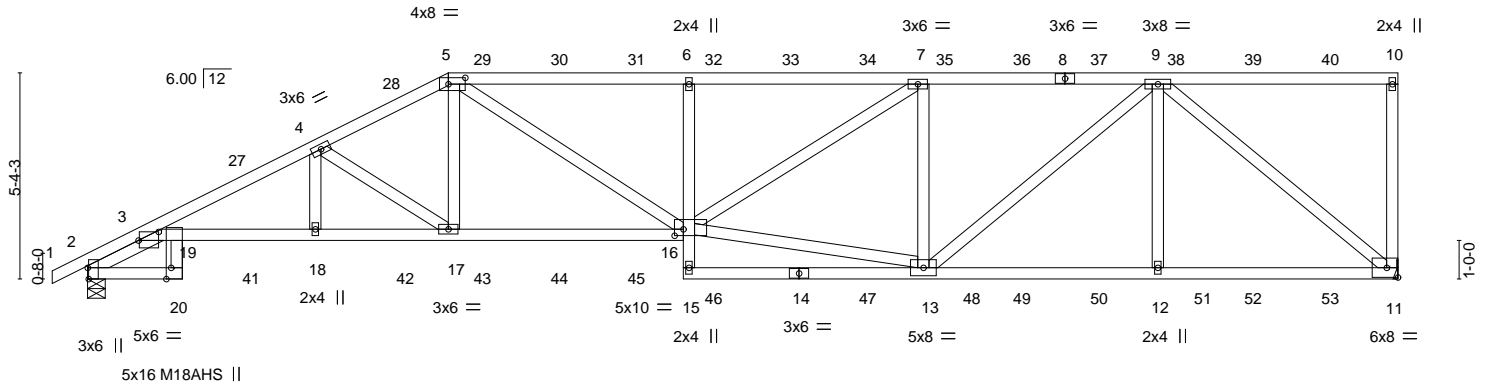

2-5-8	5-10-15	9-4-5	15-5-8	21-8-4	27-9-4	34-0-0
2-5-8	3-5-7	3-5-7	6-1-3	6-2-12	6-1-0	6-2-12

Plate Offsets (X, Y)-- [2:0-3-8,Edge], [3:0-6-5,0-2-11], [5:0-5-4,0-2-0], [16:0-2-12,0-2-0], [20:0-3-8,Edge]


LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.81	Vert(LL)	0.29 16-17	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.88	Vert(CT)	-0.39 18-19	>999	180	M18AHS	142/136
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.58	Horz(CT)	0.23 11	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MS						
								Weight: 409 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2 *Except* 1-5: 2x4 SP No.1	TOP CHORD Structural wood sheathing directly applied or 4-3-12 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2 *Except* 19-20: 2x4 SP No.1, 3-16: 2x4 SP DSS	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.2 or 2x4 SPF No.2	
SLIDER Left 2x4 SP No.3 2-0-15	

REACTIONS. (size) 11=Mechanical, 2=0-5-8
 Max Horz 2=173(LC 26)
 Max Uplift 11=-945(LC 5), 2=-631(LC 8)
 Max Grav 11=1873(LC 1), 2=1919(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 3-22=-1922/640, 3-4=-4826/1873, 4-5=-3661/1617, 5-6=-4018/1950, 6-7=-3972/1932, 7-9=-2977/1487
 BOT CHORD 2-20=-440/1098, 19-20=-120/322, 3-19=-1383/3256, 18-19=-1824/4354, 17-18=-1824/4354, 16-17=-1527/3234, 6-16=-513/337, 12-13=-1032/1945, 11-12=-1032/1945
 WEBS 4-18=-1777/725, 4-17=-1369/401, 5-17=-310/870, 5-16=-625/1011, 13-16=-1480/2816, 7-16=-544/1172, 7-13=-1129/656, 9-13=-656/1344, 9-12=-7/362, 9-11=-2497/1281

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
 Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
 Bottom chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
 Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - All plates are MT20 plates unless otherwise indicated.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Refer to girder(s) for truss to truss connections.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 945 lb uplift at joint 11 and 631 lb uplift at joint 2.



August 16, 2022

Continued on page 2

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	<p>818 Soundside Road Edenton, NC 27932</p>
--	---

Job 34943A	Truss A1G	Truss Type Half Hip Girder	Qty 1	Ply 2	54 SERENITY Job Reference (optional)	I53629133
---------------	--------------	-------------------------------	----------	-----------------	---	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.610 s Jul 18 2022 MiTek Industries, Inc. Thu Aug 11 21:24:20 2022 Page 2
ID:nxbot3WsxISjrAw_FcBFB3yorwP-9djemlhSsnYo4g0P2CY7vtDCkot_h3O98FjeqzyooUf

NOTES-

11) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 90 lb down and 43 lb up at 4-2-4, 67 lb down and 48 lb up at 6-2-4, 19 lb down and 19 lb up at 8-2-4, 89 lb down and 72 lb up at 10-2-4, 90 lb down and 72 lb up at 12-2-4, 90 lb down and 72 lb up at 14-2-4, 103 lb down and 108 lb up at 16-2-4, 103 lb down and 108 lb up at 18-2-4, 103 lb down and 108 lb up at 20-2-4, 103 lb down and 108 lb up at 22-2-4, 103 lb down and 108 lb up at 24-2-4, 103 lb down and 108 lb up at 26-2-4, 103 lb down and 108 lb up at 28-2-4, and 103 lb down and 108 lb up at 30-2-4, and 103 lb down and 108 lb up at 32-2-4 on top chord, and 72 lb down at 4-2-4, 35 lb down and 38 lb up at 6-2-4, 100 lb down and 92 lb up at 8-2-4, 58 lb down and 70 lb up at 10-2-4, 58 lb down and 70 lb up at 12-2-4, 58 lb down and 70 lb up at 14-2-4, 45 lb down and 34 lb up at 16-2-4, 45 lb down and 34 lb up at 18-2-4, 45 lb down and 34 lb up at 20-2-4, 45 lb down and 34 lb up at 22-2-4, 45 lb down and 34 lb up at 24-2-4, 45 lb down and 34 lb up at 26-2-4, 45 lb down and 34 lb up at 28-2-4, and 45 lb down and 34 lb up at 30-2-4, and 45 lb down and 34 lb up at 32-2-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-5=-60, 5-10=-60, 20-21=-20, 16-19=-20, 11-15=-20

Concentrated Loads (lb)

Vert: 14=-22(F) 4=-27(F) 18=-35(F) 27=-50(F) 29=-26(F) 30=-26(F) 31=-26(F) 32=-41(F) 33=-41(F) 34=-41(F) 35=-41(F) 36=-41(F) 37=-41(F) 38=-41(F) 39=-41(F) 40=-41(F) 41=-72(F) 42=-91(F) 43=-37(F) 44=-37(F) 45=-37(F) 46=-22(F) 47=-22(F) 48=-22(F) 49=-22(F) 50=-22(F) 51=-22(F) 52=-22(F) 53=-22(F)

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932

Job 34943A	Truss A2	Truss Type Common	Qty 1	Ply 1	54 SERENITY Job Reference (optional)	I53629134
---------------	-------------	----------------------	----------	----------	---	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.610 s Jul 18 2022 MiTek Industries, Inc. Thu Aug 11 21:24:22 2022 Page 1
ID:nxbot3WxsI5jrAw_FcBFB3yorwP-6?qPB_iiOoWJ_Ao9dab_IJdfcZW9yuScZCvsvyooUd



Scale = 1:60.0


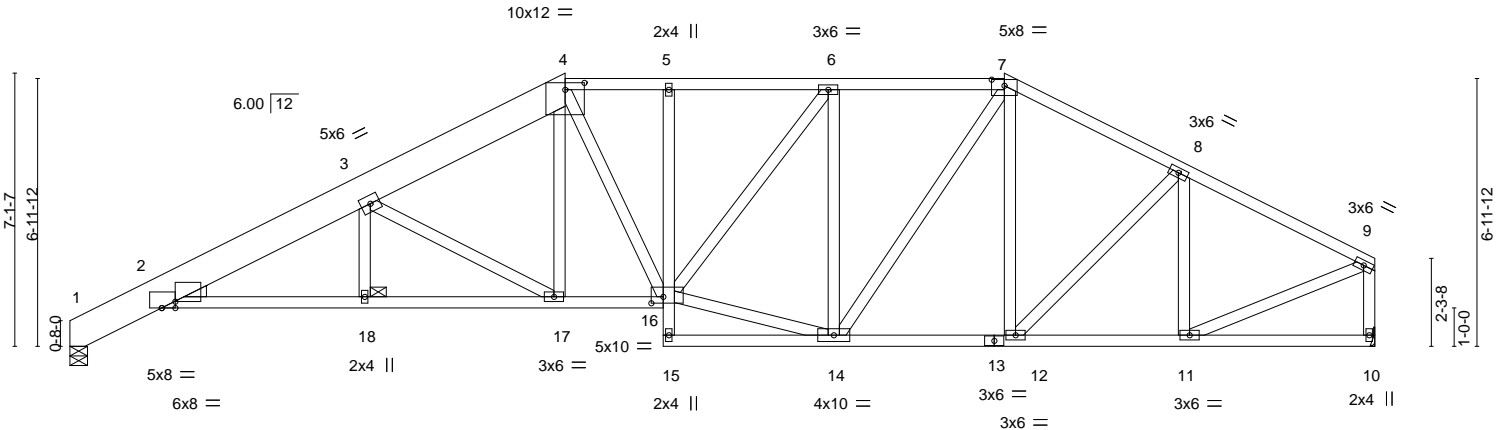


Plate Offsets (X,Y)-- [2:0-4-4,0-2-0], [2:0-4-4,0-0-0], [4:0-6-0,0-2-3], [7:0-4-0,0-1-15], [16:0-3-12,0-2-0]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.46	Vert(LL) -0.13 17 >999 240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.88	Vert(CT) -0.28 17-18 >999 180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.58	Horz(CT) 0.16 10 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-MS		Weight: 248 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2 *Except*
1-4: 2x10 SP DSS
BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2
WEBS 2x4 SP No.2 or 2x4 SPF No.2 *Except*
9-10,9-11: 2x4 SP No.3

WEDGE
Left: 2x4 SP No.3

REACTIONS.

(size) 1=0-5-8, 10=Mechanical
Max Horz 1=116(LC 9)
Max Uplift 1=-38(LC 10), 10=-20(LC 11)
Max Grav 1=1362(LC 1), 10=1346(LC 1)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=601/95, 2-3=2936/432, 3-4=2228/367, 4-5=1981/372, 5-6=1975/372,
6-7=1667/345, 7-8=1596/313, 8-9=1490/252, 9-10=1298/216
BOT CHORD 2-18=322/2734, 17-18=322/2734, 16-17=-133/1882, 12-14=-83/1375, 11-12=-120/1281
WEBS 3-17=967/217, 4-17=-57/588, 4-16=-89/339, 14-16=-122/1606, 6-16=-47/535,
6-14=-739/144, 7-14=-71/595, 8-11=-437/121, 9-11=-150/1349

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCCL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Bearing at joint(s) 1 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 38 lb uplift at joint 1 and 20 lb uplift at joint 10.



August 16, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932

Job 34943A	Truss A3	Truss Type Common	Qty 1	Ply 1	54 SERENITY	153629135
---------------	-------------	----------------------	----------	----------	-------------	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.610 s Jul 18 2022 MiTek Industries, Inc. Thu Aug 11 21:24:23 2022 Page 1

ID:nxbot3Wsx1SjrAw_FcBFB3yorwP-aCOnOKjK9ixNx7l_JL5qXWriU?wOuTwcqCxlRlyooUc



Scale: 3/16"=1'

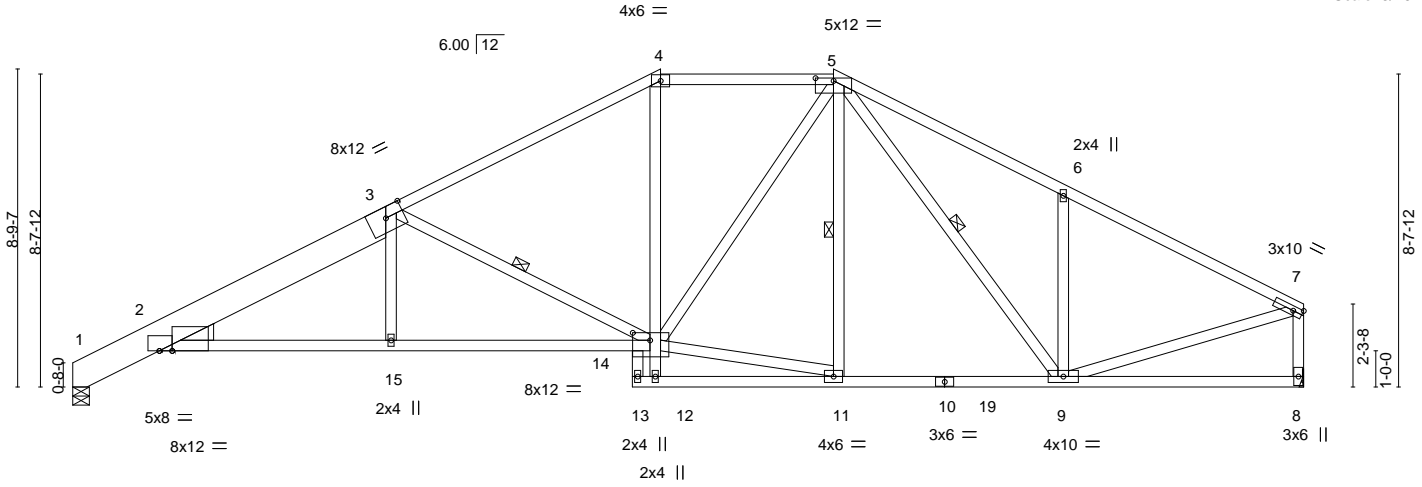


Plate Offsets (X,Y)--	[2:0-4-4,0-0-0], [2:0-4-4,0-0-0], [5:0-6-0,0-0-15], [14:0-5-12,0-2-8]
-----------------------	---


LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.84	Vert(LL) -0.14 15-18 >999 240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.78	Vert(CT) -0.31 14-15 >999 180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.34	Horz(CT) 0.16 8 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-MS			
				Weight: 228 lb	FT = 20%

LUMBER-	BRACING-	FLAT TOP CHORD SECTION BRACED AT 24" O.C
TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2 *Except* 1-3: 2x10 SP DSS	TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals.	
BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except:	
WEBS 2x4 SP No.2 or 2x4 SPF No.2 *Except* 7-8: 2x4 SP No.3	WEBS 6-0-0 oc bracing: 13-14,12-13. 1 Row at midpt 3-14, 5-11, 5-9	

REACTIONS.	WEDGE
(size) 8=Mechanical, 1=0-5-8 Max Horz 1=133(LC 9) Max Uplift 8=46(LC 11), 1=59(LC 10) Max Grav 8=1347(LC 1), 1=1363(LC 1)	Left: 2x6 SP No.2

FORCES.
(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=602/99, 2-3=2666/423, 3-4=1880/357, 4-5=1549/361, 5-6=1644/428, 6-7=1632/287, 7-8=1285/233
BOT CHORD 2-15=297/2441, 14-15=294/2448, 9-11=50/1290
WEBS 3-15=0/298, 3-14=974/245, 11-14=56/1229, 6-9=422/242, 7-9=151/1390, 12-14=0/302, 4-14=17/475, 5-14=73/518

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCCL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Refer to girder(s) for truss to truss connections.
 - Bearing at joint(s) 1 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 46 lb uplift at joint 8 and 59 lb uplift at joint 1.

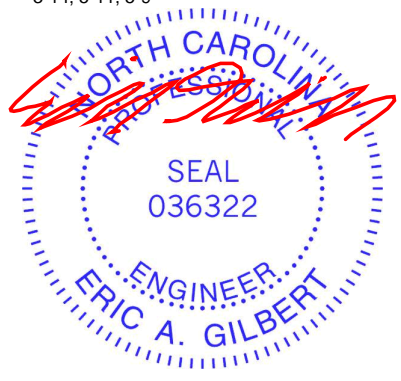

August 16, 2022


<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	<p>818 Soundside Road Edenton, NC 27932</p>
--	---

Job 34943A	Truss A4	Truss Type Common	Qty 2	Ply 1	54 SERENITY	153629136
					Job Reference (optional)	

84 Components (Dunn), Dunn, NC - 28334,

8.610 s Jul 18 2022 MiTek Industries, Inc. Thu Aug 11 21:24:24 2022 Page 1

ID: nxbot3Wxs1SjrAw_FcBFB3yorwP-2Oy9cgkyw03EYHKBH2d33jOugPGfdmDI3shrlyooUb



5x10 =

Scale = 1:64.9

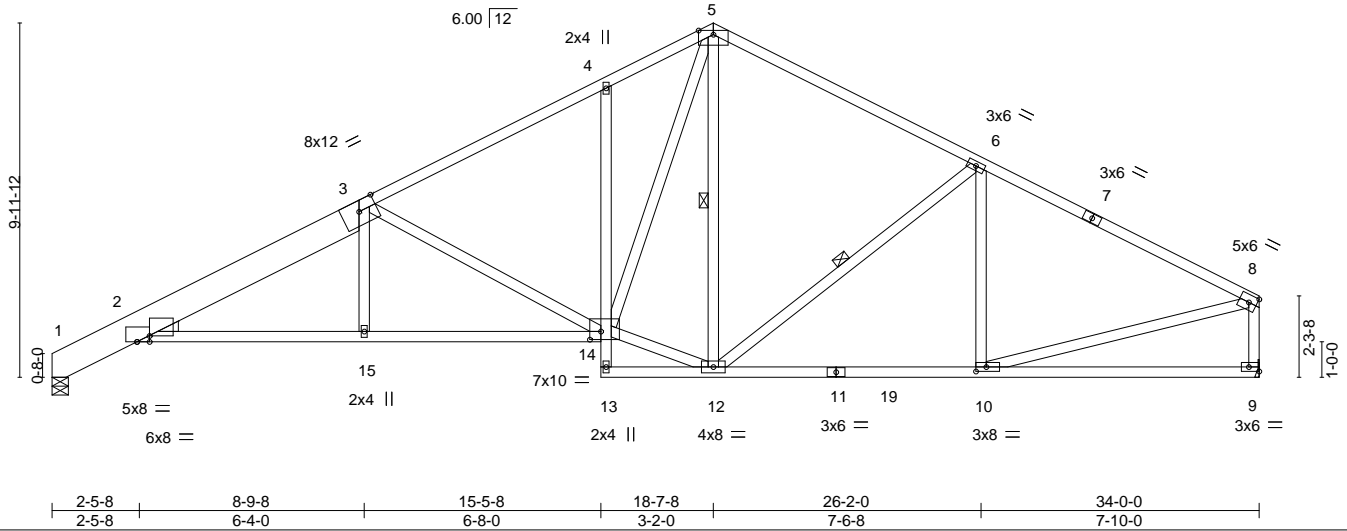


Plate Offsets (X, Y)-- [2:0-4-4,0-0-0], [2:0-4-4,0-2-0], [9:Edge,0-1-8], [10:0-3-8,0-1-8], [14:0-3-12,0-2-12]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.81	in (loc) l/defl L/d	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.77	Vert(LL) -0.15 15-18 >999 240		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.98	Vert(CT) -0.33 14-15 >999 180		
BCDL 10.0	Rep Stress Incr YES	Matrix-MS	Horz(CT) 0.16 9 n/a n/a		
	Code IRC2015/TPI2014			Weight: 225 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2 *Except*
 1-3: 2x10 SP DSS
 BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2
 WEBS 2x4 SP No.2 or 2x4 SPF No.2 *Except*
 8-9: 2x4 SP No.3

BRACING-
 TOP CHORD Structural wood sheathing directly applied, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
 WEBS 1 Row at midpt 5-12, 6-12

WEDGE
 Left: 2x4 SP No.3

REACTIONS. (size) 9=Mechanical, 1=0-5-8
 Max Horz 1=146(LC 9)
 Max Uplift 9=61(LC 11), 1=72(LC 10)
 Max Grav 9=1346(LC 1), 1=1362(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-2=-601/101, 2-3=-2643/426, 3-4=-1886/375, 4-5=-1807/458, 5-6=-1435/349,
 6-8=-1691/309, 8-9=-1275/247
 BOT CHORD 2-15=-297/2414, 14-15=-294/2421, 4-14=-301/159, 10-12=-141/1433
 WEBS 3-15=0/296, 3-14=-932/217, 12-14=0/1204, 5-14=-226/1218, 6-12=-393/152,
 8-10=-151/1391

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Refer to girder(s) for truss to truss connections.
- Bearing at joint(s) 1 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 61 lb uplift at joint 9 and 72 lb uplift at joint 1.



August 16, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601





818 Soundside Road
 Edenton, NC 27932

Job 34943A	Truss A5	Truss Type Common	Qty 6	Ply 1	54 SERENITY	153629137
---------------	-------------	----------------------	----------	----------	-------------	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.610 s Jul 18 2022 MiTek Industries, Inc. Thu Aug 11 21:24:26 2022 Page 1

ID: nxbot3Wsx1SjrAw_FcBFB3yorwP_n4w1MIDSdJxobUZOTfX88TCvDxa5qg2XAAy2dyooUZ

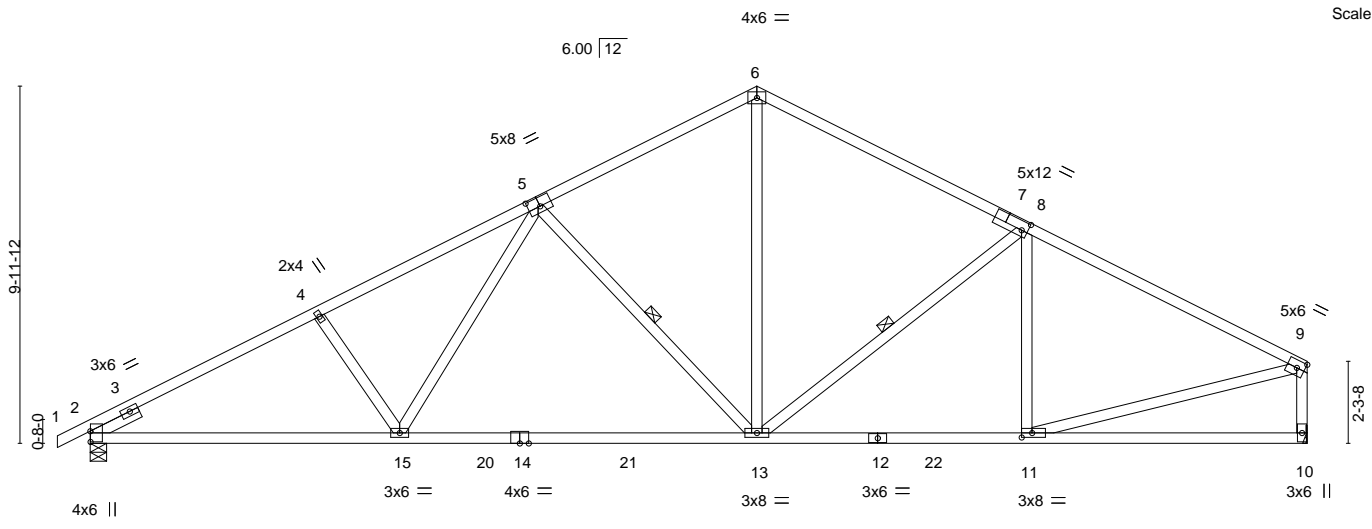

Scale: 3/16"=1'

Plate Offsets (X, Y)--	[2:0-3-9,0-0-1], [5:0-4-0,0-3-0], [7:0-2-0,0-3-0], [11:0-3-8,0-1-8]
------------------------	---

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.96	Vert(LL)	-0.33 13-15	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.81	Vert(CT)	-0.60 13-15	>679	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.34	Horz(CT)	0.06 10	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MS					Weight: 191 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD 2x4 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.2 or 2x4 SPF No.2 *Except*	WEBS 1 Row at midpt 5-13, 8-13
9-10: 2x4 SP No.3	
SLIDER Left 2x4 SP No.3 1-6-0	

REACTIONS. (size) 2=0-5-8, 10=Mechanical
 Max Horz 2=151(LC 9)
 Max Uplift 2=-98(LC 10), 10=-61(LC 11)
 Max Grav 2=1410(LC 1), 10=1353(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-4=-2317/394, 4-5=-2146/406, 5-6=-1432/353, 6-8=-1458/347, 8-9=-1697/313, 9-10=-1279/250
 BOT CHORD 2-15=-281/1999, 13-15=-172/1629, 11-13=-145/1438
 WEBS 4-15=-273/171, 5-15=-29/495, 5-13=-650/221, 6-13=-152/876, 8-13=-379/160, 9-11=-155/1392

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Refer to girder(s) for truss to truss connections.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 98 lb uplift at joint 2 and 61 lb uplift at joint 10.



August 16, 2022

Job 34943A	Truss A6	Truss Type Common	Qty 7	Ply 1	54 SERENITY	I53629138
---------------	-------------	----------------------	----------	----------	-------------	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.610 s Jul 18 2022 MiTek Industries, Inc. Thu Aug 11 21:24:27 2022 Page 1

ID:nxbot3WsxISjrAw_FcBFB3yorwP-SzelEimrCxRoPI3lyBAmhM0Q?dFCqFFBlqwVa4yooUY



5x6 =

Scale = 1:65.1

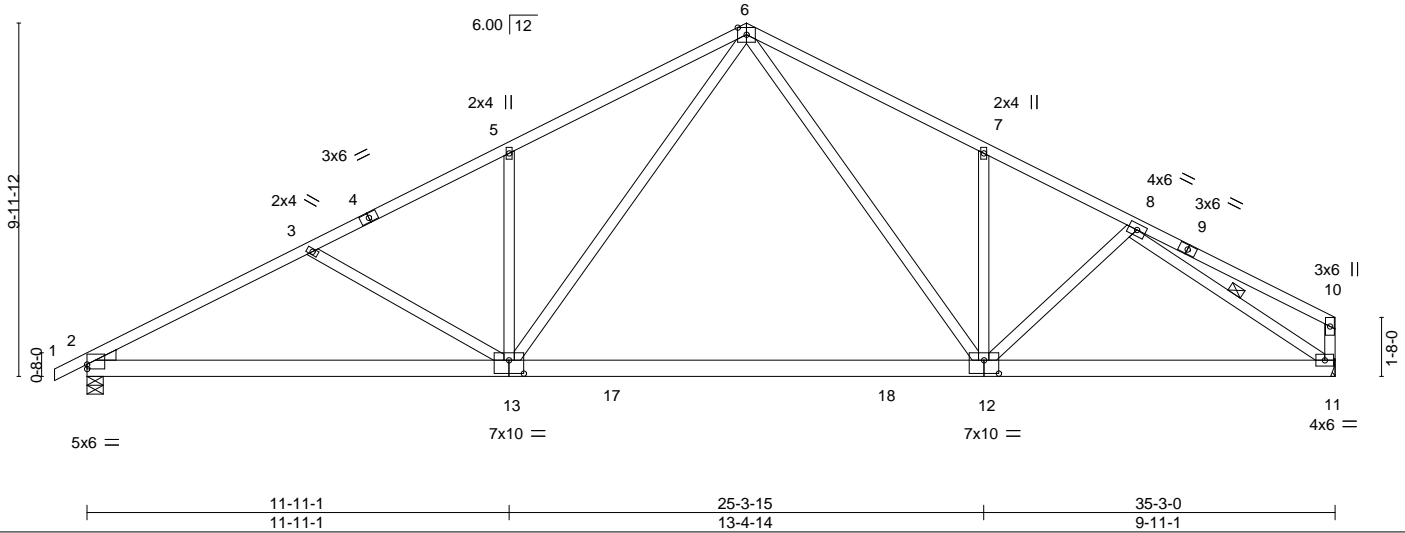


Plate Offsets (X,Y)--	[2:0-0-0,0-1-9], [12:0-5-0,0-4-8], [13:0-5-0,0-4-8]
-----------------------	---


LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.81	Vert(LL) -0.43 12-13 >969 240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.91	Vert(CT) -0.68 12-13 >619 180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.45	Horz(CT) 0.06 11 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-MS		Weight: 224 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 1-11-14 oc purlins, except end verticals.
BOT CHORD 2x6 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.2 or 2x4 SPF No.2 *Except* 10-11: 2x4 SP No.3	WEBS 1 Row at midpt 8-11
WEDGE Left: 2x4 SP No.3	

REACTIONS.	(size) 2=0-5-8, 11=Mechanical Max Horz 2=146(LC 14) Max Uplift 2=98(LC 10), 11=69(LC 11) Max Grav 2=1460(LC 1), 11=1403(LC 1)
-------------------	--

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-2468/441, 3-5=-2133/371, 5-6=-2157/507, 6-7=-1963/477, 7-8=-1927/353
BOT CHORD 2-13=-320/2127, 12-13=-53/1272, 11-12=-209/1599
WEBS 3-13=-338/186, 5-13=-410/224, 6-13=-187/1052, 6-12=-142/782, 7-12=-367/197, 8-11=-1874/258

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Refer to girder(s) for truss to truss connections.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 98 lb uplift at joint 2 and 69 lb uplift at joint 11.



August 16, 2022

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	<p>818 Soundside Road Edenton, NC 27932</p>
--	---

Job 34943A	Truss A7	Truss Type COMMON	Qty 2	Ply 1	54 SERENITY	153629139
---------------	-------------	----------------------	----------	----------	-------------	-----------

84 Components (Dunn), Dunn, NC - 28334,


8.610 s Jul 18 2022 MiTek Industries, Inc. Thu Aug 11 21:24:28 2022 Page 1

ID:nxbot3WsxISjrAw_FcBFB3yorwP-w9CgR1nTzEZf1vdyWuh?EZZZA0bRZjVL_Uf36WyoUX

0-11-0	6-4-6	11-11-1	18-7-8	25-3-15	29-6-3	35-3-0	36-2-0
0-11-0	6-4-6	5-6-11	6-8-7	6-8-7	4-2-4	5-8-13	0-11-0

5x6 =

Scale = 1:65.6

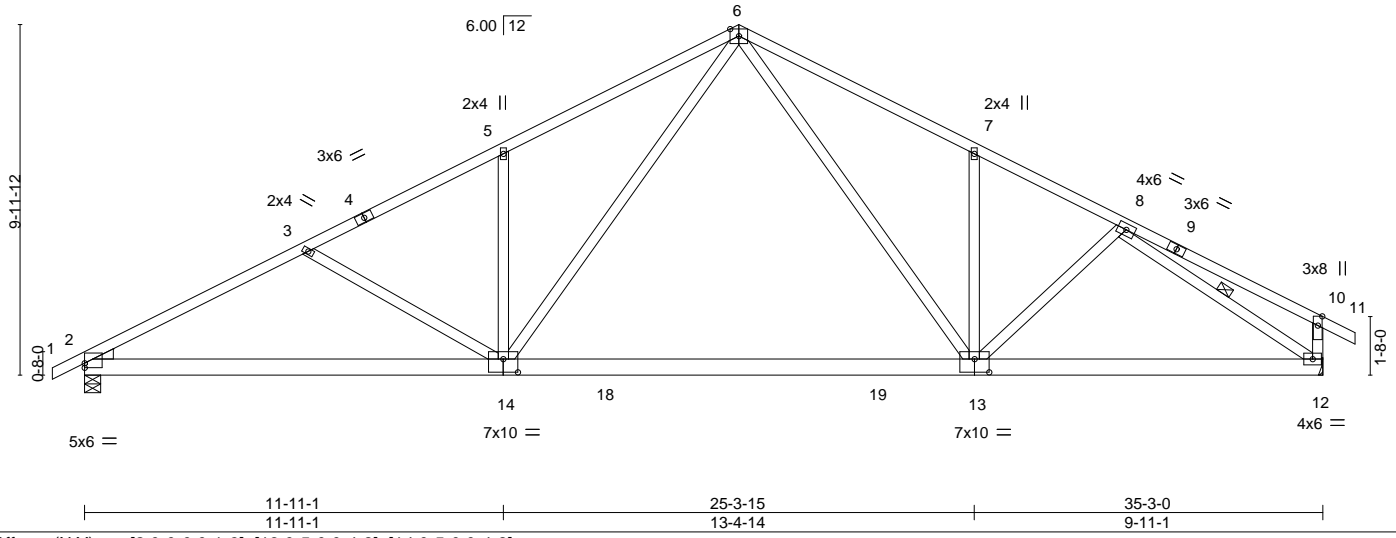

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.78	Vert(LL)	-0.43	13-14	>969	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.91	Vert(CT)	-0.68	13-14	>619		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.45	Horz(CT)	0.06	12	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MS						
								Weight: 225 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals.
BOT CHORD 2x6 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.2 or 2x4 SPF No.2 *Except* 10-12: 2x4 SP No.3	WEBS 1 Row at midpt 8-12
WEDGE Left: 2x4 SP No.3	

REACTIONS.	(size) 2=0-5-8, 12=Mechanical
	Max Horz 2=139(LC 14)
	Max Uplift 2=-98(LC 10), 12=-86(LC 11)
	Max Grav 2=1459(LC 1), 12=1468(LC 1)

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-3=-2466/441, 3-5=-2131/371, 5-6=-2155/507, 6-7=-1960/478, 7-8=-1922/353, 8-10=-259/149, 10-12=-323/179
BOT CHORD	2-14=-290/2125, 13-14=-23/1270, 12-13=-177/1587
WEBS	3-14=-338/186, 5-14=-410/224, 6-14=-187/1052, 6-13=-144/780, 7-13=-373/200, 8-12=-1832/218

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 98 lb uplift at joint 2 and 86 lb uplift at joint 12.



August 16, 2022

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	<p>ENGINEERING BY</p> <p>TRENCO</p> <p>A MiTek Affiliate</p> <p>818 Soundside Road Edenton, NC 27932</p>
--	---

Job 34943A	Truss A8E	Truss Type Common Supported Gable	Qty 1	Ply 1	54 SERENITY Job Reference (optional)	153629140
---------------	--------------	--------------------------------------	----------	----------	---	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.610 s Jul 18 2022 MiTek Industries, Inc. Thu Aug 11 21:24:30 2022 Page 1

ID:nxbot3WsxISjrAw_FcBFB3yorwP-tYJQsjojVspNGCnKdJtJ_e4XqVE1i3eRo8ABOyooUV

0-11-0
0-11-0

18-7-8
18-7-8

35-3-0
16-7-8

5x6 =

Scale = 1:65.6

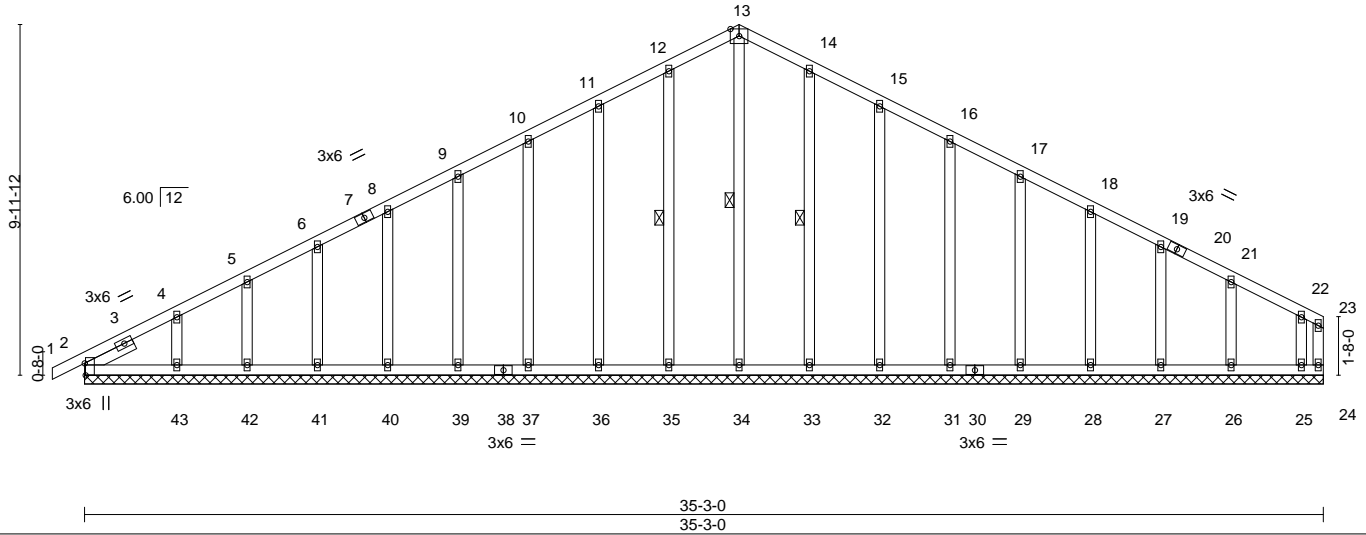



Plate Offsets (X,Y)--	[2:0-4-1,Edge]									
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15		TC 0.08	Vert(LL) -0.00	1	n/r	120		MT20	197/144
TCDL 10.0	Lumber DOL 1.15		BC 0.06	Vert(CT) 0.00	1	n/r	90			
BCLL 0.0 *	Rep Stress Incr YES		WB 0.12	Horz(CT) 0.00	24	n/a	n/a			
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S						Weight: 248 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	WEBS 1 Row at midpt 13-34, 12-35, 14-33
OTHERS 2x4 SP No.2 or 2x4 SPF No.2	
SLIDER Left 2x4 SP No.3 1-6-6	

REACTIONS. All bearings 35-3-0.
 (lb) - Max Horz 2=144(LC 14)
 Max Uplift All uplift 100 lb or less at joint(s) 24, 35, 36, 37, 39, 40, 41, 42, 43, 33, 32, 31, 29, 28, 27, 26, 2 except 25=153(LC 11)
 Max Grav All reactions 250 lb or less at joint(s) 24, 34, 35, 36, 37, 39, 40, 41, 42, 43, 33, 32, 31, 29, 28, 27, 26, 25, 2

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 11-12=-111/260, 12-13=-124/296, 13-14=-124/296, 14-15=-111/260

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 4) All plates are 2x4 MT20 unless otherwise indicated.
 - 5) Gable requires continuous bottom chord bearing.
 - 6) Gable studs spaced at 2-0-0 oc.
 - 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 8) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 24, 35, 36, 37, 39, 40, 41, 42, 43, 33, 32, 31, 29, 28, 27, 26, 2 except (jt=lb) 25=153.




August 16, 2022

Job 34943A	Truss B1E	Truss Type GABLE	Qty 1	Ply 1	54 SERENITY	153629141
---------------	--------------	---------------------	----------	----------	-------------	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.610 s Jul 18 2022 MiTek Industries, Inc. Thu Aug 11 21:24:31 2022 Page 1

ID:nxbot3WsxISjrAw_FcBFB3yorwP-Lkto43pLG9xEuMMXB0FirBADCEqSm9qngSujjryooUU



3x6 =

Scale = 1:40.4

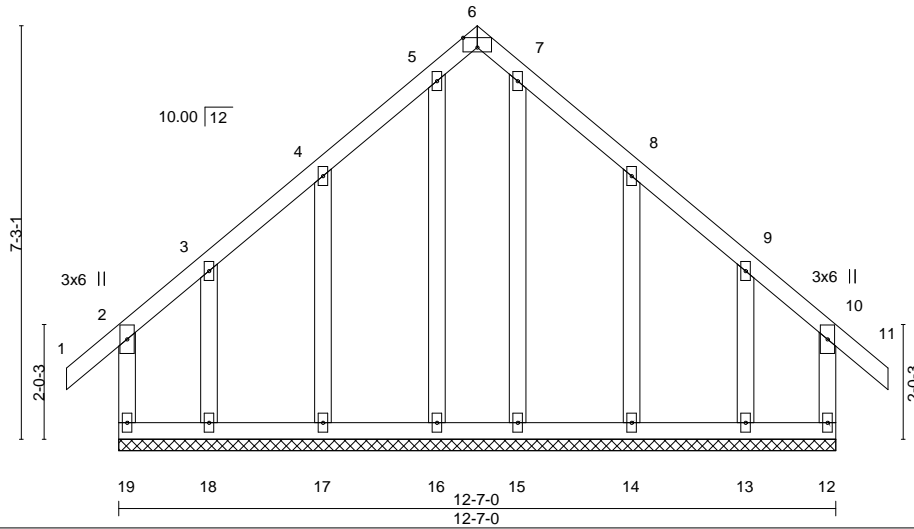


Plate Offsets (X,Y)--	[6:0-3-0,Edge]								
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.22	Vert(LL)	-0.00	11	n/r	120	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.12	Vert(CT)	-0.00	11	n/r	90	
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.09	Horz(CT)	-0.00	12	n/a	n/a	
BCDL 10.0	Code IRC2015/TPI2014		Matrix-R						
								Weight: 92 lb	FT = 20%

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2 or 2x4 SPF No.2	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2 or 2x4 SPF No.2	BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS	2x4 SP No.3		
OTHERS	2x4 SP No.2 or 2x4 SPF No.2		

REACTIONS. All bearings 12-7-0.
 (lb) - Max Horz 19=182(LC 9)
 Max Uplift All uplift 100 lb or less at joint(s) 17, 14 except 19=136(LC 6), 12=130(LC 7), 18=140(LC 7), 13=135(LC 6)
 Max Grav All reactions 250 lb or less at joint(s) 19, 12, 16, 17, 18, 15, 14, 13

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 4) All plates are 2x4 MT20 unless otherwise indicated.
 - 5) Gable requires continuous bottom chord bearing.
 - 6) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - 7) Gable studs spaced at 2-0-0 oc.
 - 8) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 9) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 10) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 17, 14 except (jt=lb) 19=136, 12=130, 18=140, 13=135.



August 16, 2022


<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	<p>ENGINEERING BY</p> <p>TRENCO</p> <p>A MiTek Affiliate</p> <p>818 Soundside Road Edenton, NC 27932</p>
--	---

Job	Truss	Truss Type	Qty	Ply	54 SERENITY	153629142
34943A	B2G	Common Girder	1	2	Job Reference (optional)	

84 Components (Dunn), Dunn, NC - 28334,

8.610 s Jul 18 2022 MiTek Industries, Inc. Thu Aug 11 21:24:32 2022 Page 1

ID:nxbot3WsxISjrAw_FcBFB3yorwP-pwRBHPqz1T35WWxjlkmxOPjP9e3SVX8wv6dGFHyooUT

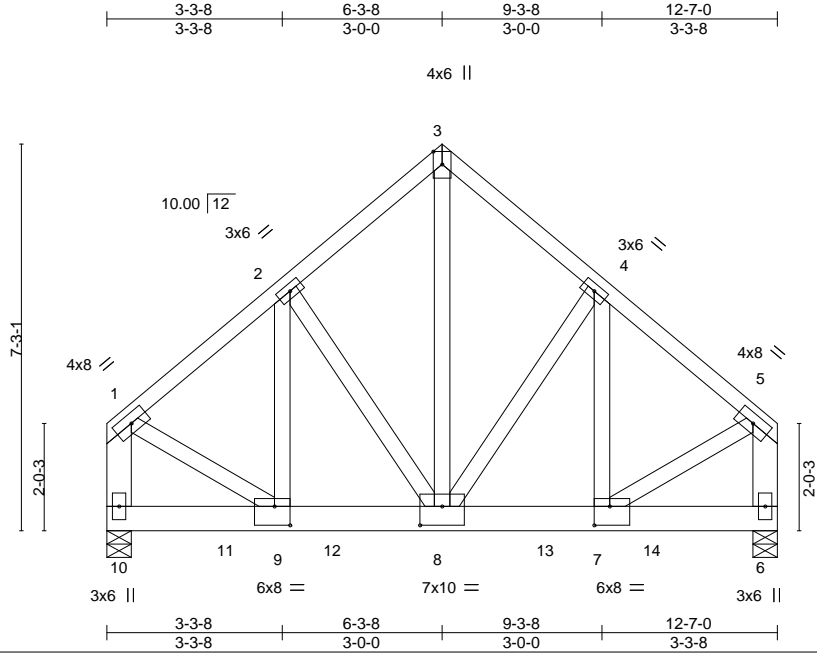

Scale = 1:43.2

Plate Offsets (X,Y)-- [7:0-3-8,0-4-4], [8:0-5-0,0-4-4], [9:0-3-8,0-4-4]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.14	Vert(LL) -0.02	7-8	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.52	Vert(CT) -0.05	7-8	>999	180		
BCLL 0.0 *	Rep Stress Incr NO	WB 0.41	Horz(CT) 0.01	6	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-MS						
							Weight: 214 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2
 BOT CHORD 2x6 SP No.2
 WEBS 2x4 SP No.2 or 2x4 SPF No.2 *Except*
 1-10,5-6: 2x6 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 10=0-5-8, 6=0-5-8
 Max Horz 10=-162(LC 23)
 Max Uplift 10=-215(LC 9), 6=-212(LC 8)
 Max Grav 10=3972(LC 1), 6=3915(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-3316/221, 2-3=-2794/240, 3-4=-2794/240, 4-5=-3317/221, 1-10=-3551/209, 5-6=-3558/209
 BOT CHORD 8-9=-187/2494, 7-8=-126/2495
 WEBS 3-8=-245/3316, 4-8=-681/128, 4-7=-82/759, 2-8=-680/128, 2-9=-82/758, 1-9=-131/2708, 5-7=-132/2723

NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
 Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.
 Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-7-0 oc.
 Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCdL=6.0psf; BCdL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a live load of 20.0psf on the bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 10=215, 6=212.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 1383 lb down and 89 lb up at 2-2-12, 1383 lb down and 89 lb up at 4-2-12, 1383 lb down and 89 lb up at 6-2-12, and 1383 lb down and 89 lb up at 8-2-12, and 1383 lb down and 89 lb up at 10-2-12 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.



August 16, 2022

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

Job 34943A	Truss B2G	Truss Type Common Girder	Qty 1	Ply 2	54 SERENITY Job Reference (optional)	I53629142
---------------	--------------	-----------------------------	----------	-----------------	---	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.610 s Jul 18 2022 MiTek Industries, Inc. Thu Aug 11 21:24:33 2022 Page 2
ID:nxbot3WsxISjrAw_FcBFB3yorwP-H7?ZV/IconBy7gWvJRHAXcGau1OhE_O48mNqojyooUS

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
- Uniform Loads (plf)
 - Vert: 1-3=-60, 3-5=-60, 6-10=-20
- Concentrated Loads (lb)
 - Vert: 8=-1383(F) 11=-1383(F) 12=-1383(F) 13=-1383(F) 14=-1383(F)

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932

Job 34943A	Truss C1E	Truss Type GABLE	Qty 1	Ply 1	54 SERENITY Job Reference (optional)	153629143
---------------	--------------	---------------------	----------	----------	---	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.610 s Jul 18 2022 MiTek Industries, Inc. Thu Aug 11 21:24:34 2022 Page 1

ID:nxbot3WsxISjrAw_FcBFB3yorwP-IJZxi5sEZ4Jplq56s9oPTqokPRr5zWSDMQ6NKAYooUR



3x6 =

Scale = 1:41.2

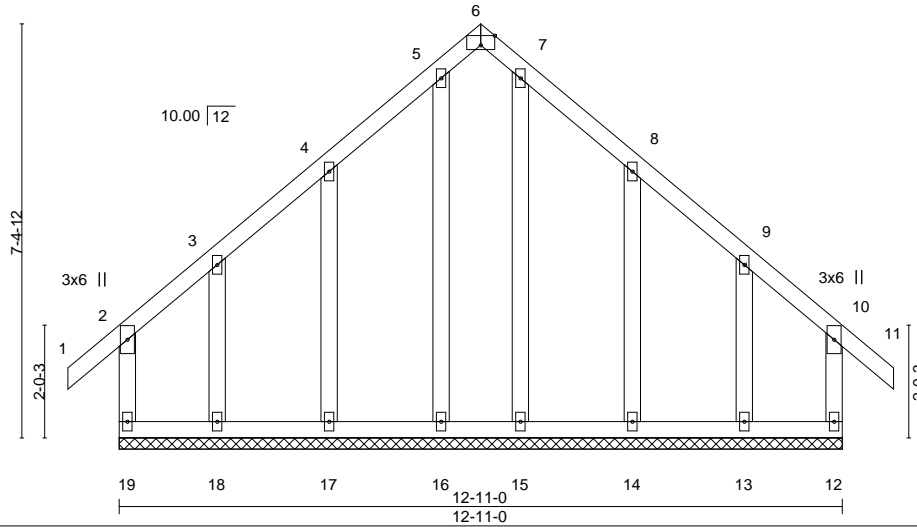



Plate Offsets (X,Y)--	[6:0-3-0,Edge]									
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15		TC 0.22	Vert(LL) -0.00	11	n/r	120		MT20	197/144
TCDL 10.0	Lumber DOL 1.15		BC 0.13	Vert(CT) -0.00	11	n/r	90			
BCLL 0.0 *	Rep Stress Incr YES		WB 0.10	Horz(CT) -0.00	12	n/a	n/a			
BCDL 10.0	Code IRC2015/TPI2014		Matrix-R						Weight: 94 lb	FT = 20%

LUMBER-		BRACING-	
TOP CHORD	2x4 SP No.2 or 2x4 SPF No.2	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2 or 2x4 SPF No.2	BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS	2x4 SP No.3		
OTHERS	2x4 SP No.2 or 2x4 SPF No.2		

REACTIONS. All bearings 12-11-0.
 (lb) - Max Horz 19=185(LC 8)
 Max Uplift All uplift 100 lb or less at joint(s) 17, 14 except 19=127(LC 6), 12=121(LC 7), 18=135(LC 7), 13=130(LC 6)
 Max Grav All reactions 250 lb or less at joint(s) 19, 12, 16, 17, 18, 15, 14, 13

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 4) All plates are 2x4 MT20 unless otherwise indicated.
 - 5) Gable requires continuous bottom chord bearing.
 - 6) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - 7) Gable studs spaced at 2-0-0 oc.
 - 8) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 9) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 10) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 17, 14 except (jt=lb) 19=127, 12=121, 18=135, 13=130.




August 16, 2022

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	<p>ENGINEERING BY</p> <p>TRENCO</p> <p>A MiTek Affiliate</p> <p>818 Soundside Road Edenton, NC 27932</p>
--	---

Job 34943A	Truss C2	Truss Type Common	Qty 3	Ply 1	54 SERENITY	153629144
---------------	-------------	----------------------	----------	----------	-------------	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.610 s Jul 18 2022 MiTek Industries, Inc. Thu Aug 11 21:24:35 2022 Page 1
ID:nxbot3WsxISjrAw_FcBFB3yorwP-DV7JvRssKORgNzglQsJe01Lnlr5oiz7Nb4sxsycyooUQ



Scale = 1:44.0

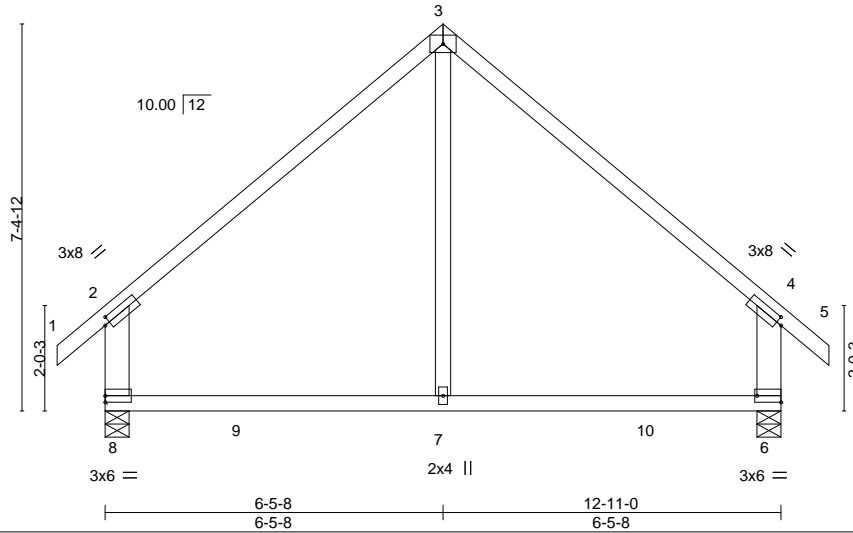


Plate Offsets (X, Y)-- [2:0-1-4,0-1-8], [4:0-1-4,0-1-8], [6:Edge,0-1-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.72	in (loc) l/defl L/d	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.48	Vert(LL) -0.09 7 >999 240		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.07	Vert(CT) -0.16 6-7 >941 180		
BCDL 10.0	Rep Stress Incr YES	Matrix-MR	Horz(CT) 0.01 6 n/a n/a		
	Code IRC2015/TPI2014			Weight: 67 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2
BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2
WEBS 2x6 SP No.2 *Except*
3-7: 2x4 SP No.2 or 2x4 SPF No.2


BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 8=0-5-8, 6=0-5-8
Max Horz 8=-187(LC 8)
Max Uplift 8=-29(LC 10), 6=-29(LC 11)
Max Grav 8=613(LC 17), 6=613(LC 18)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-521/122, 3-4=-520/122, 2-8=-506/159, 4-6=-506/159
BOT CHORD 7-8=-18/334, 6-7=-18/334
WEBS 3-7=0/310

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 8, 6.

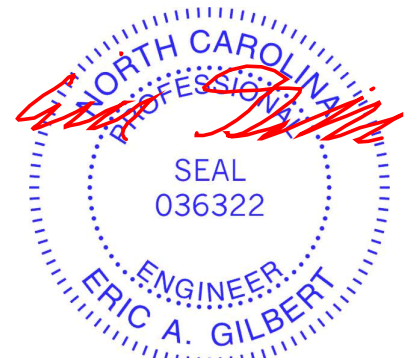

August 16, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932

Job 34943A	Truss C3	Truss Type Common	Qty 1	Ply 1	54 SERENITY Job Reference (optional)	153629145
---------------	-------------	----------------------	----------	----------	---	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.610 s Jul 18 2022 MiTek Industries, Inc. Thu Aug 11 21:24:35 2022 Page 1

ID:nxbot3WxISjrAw_FcBFB3yorwP-DV7JvRssKORgNzgjQsJe01LnXr3pizBNb4sxscooUQ

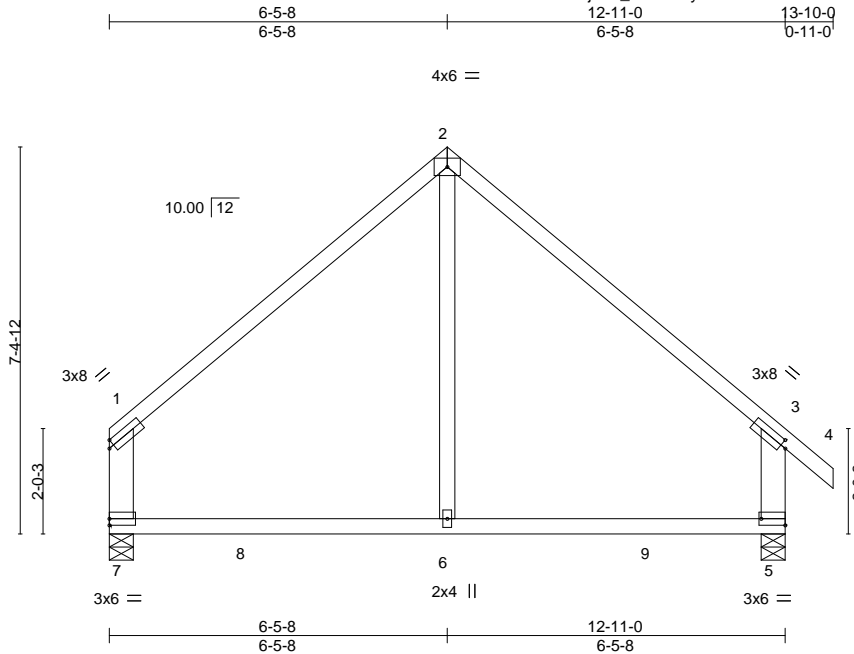

Scale = 1:44.0

Plate Offsets (X, Y)--	[3:0-1-4,0-1-8], [5:Edge,0-1-8]				
LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.71	in (loc) l/defl L/d	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.61	Vert(LL) -0.12 5-6 >999 240		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.07	Vert(CT) -0.20 5-6 >736 180		
BCDL 10.0	Rep Stress Incr YES	Matrix-MR	Horz(CT) 0.01 5 n/a n/a		
	Code IRC2015/TPI2014			Weight: 65 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x6 SP No.2 *Except*	
2-6: 2x4 SP No.2 or 2x4 SPF No.2	

REACTIONS.	(size) 7=0-5-8, 5=0-5-8
	Max Horz 7=-180(LC 6)
	Max Uplift 7=-14(LC 11), 5=-27(LC 11)
	Max Grav 7=564(LC 18), 5=616(LC 18)

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	1-2=-508/116, 2-3=-518/115, 1-7=-426/114, 3-5=-502/154
BOT CHORD	6-7=-18/333, 5-6=-18/333
WEBS	2-6=0/296

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 7, 5.



August 16, 2022

Job 34943A	Truss C4G	Truss Type GABLE	Qty 1	Ply 2	54 SERENITY Job Reference (optional)	153629146
---------------	--------------	---------------------	----------	----------	---	-----------

84 Components (Dunn), Dunn, NC - 28334, 8.610 s Jul 18 2022 MiTek Industries, Inc. Thu Aug 11 21:24:39 2022 Page 1
 ID:nxbot3WxsI5jrAw_FcBFB3yowP-6HMqlvMOdy5rbz3fiOaAtWZcSLAedNywQ8?NyooUM

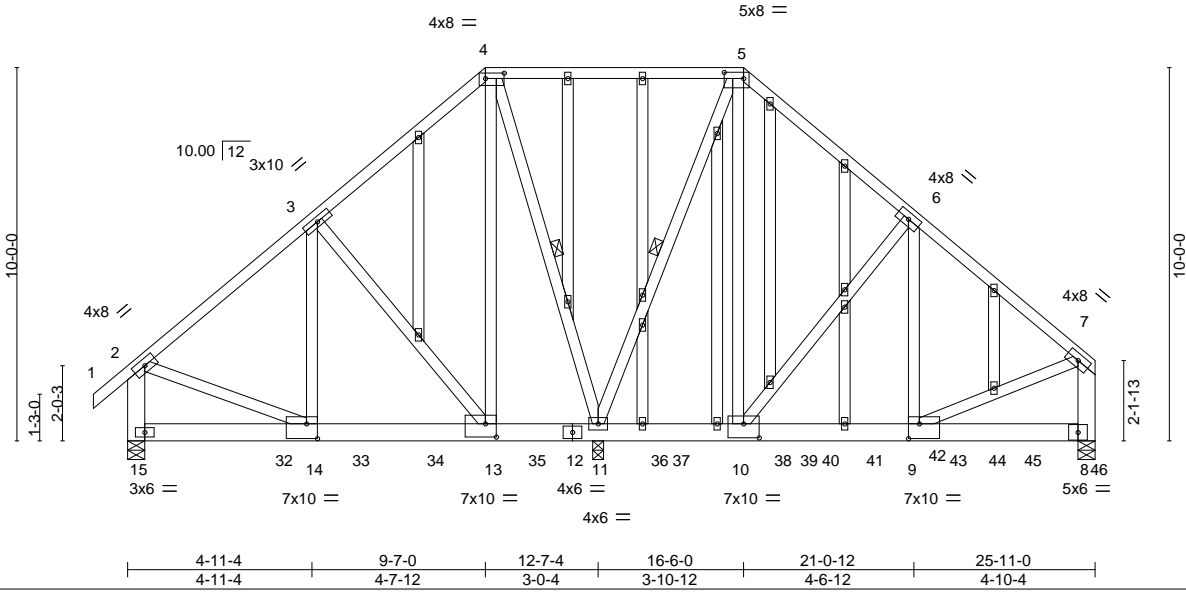



Plate Offsets (X,Y)-- [4:0-6-0,0-1-12], [5:0-6-4,0-2-0], [9:0-3-8,0-4-12], [10:0-5-0,0-4-8], [13:0-3-8,0-4-4], [14:0-3-8,0-4-12]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.38	Vert(LL) -0.06 13-14 >999 240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.90	Vert(CT) -0.13 13-14 >999 180		
BCLL 0.0 *	Rep Stress Incr NO	WB 0.69	Horz(CT) 0.02 8 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-MS		Weight: 590 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x6 SP No.2 *Except* 8-12: 2x6 SP DSS	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.2 or 2x4 SPF No.2 *Except* 2-15,7-8: 2x6 SP No.2	WEBS 1 Row at midpt 4-11, 5-11
OTHERS 2x4 SP No.2 or 2x4 SPF No.2	

REACTIONS. (size) 11=0-3-8 (req. 0-7-8), 15=0-5-8, 8=0-5-8
 Max Horz 15=235(LC 5)
 Max Uplift 11=-952(LC 8), 15=-690(LC 8), 8=-395(LC 9)
 Max Grav 11=9583(LC 1), 15=3247(LC 19), 8=4579(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-3261/641, 3-4=-1453/189, 5-6=-1864/211, 6-7=-3704/321, 2-15=-3122/584, 7-8=-3483/297
 BOT CHORD 14-15=-290/306, 13-14=-593/2429, 11-13=-197/1110, 10-11=-142/1429, 9-10=-198/2776, 8-9=-50/304
 WEBS 3-14=-765/2571, 3-13=-2150/755, 4-13=-502/3978, 4-11=-3627/480, 5-11=-3743/407, 5-10=-438/4256, 6-10=-2241/358, 6-9=-253/2686, 2-14=-411/2466, 7-9=-178/2678

NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
 Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.
 Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-5-0 oc.
 Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Provide adequate drainage to prevent water ponding.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- WARNING: Required bearing size at joint(s) 11 greater than input bearing size.
- Bearing at joint(s) 15, 8 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.



Job	Truss	Truss Type	Qty	Ply	54 SERENITY	153629146
34943A	C4G	GABLE	1	2	Job Reference (optional)	

84 Components (Dunn), Dunn, NC - 28334,

8.610 s Jul 18 2022 MiTek Industries, Inc. Thu Aug 11 21:24:39 2022 Page 2
ID:nxbot3WsxISjrAw_FcBFB3yorwP-6HMqlovMOdy5rbz3fiOaAtWZcSLAedNyWiq8?NyooUM

NOTES-

- 13) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 11=952, 15=690, 8=395.
- 14) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 1853 lb down and 965 lb up at 4-1-8, 1326 lb down and 40 lb up at 6-2-4, 1327 lb down and 66 lb up at 8-2-4, 1326 lb down and 81 lb up at 10-2-4, 1326 lb down and 81 lb up at 12-2-4, 1333 lb down and 81 lb up at 14-2-4, 41 lb down and 55 lb up at 14-9-4, 1333 lb down and 81 lb up at 16-2-4, 41 lb down and 55 lb up at 16-9-4, 1333 lb down and 81 lb up at 18-2-4, 41 lb down and 55 lb up at 18-9-4, 41 lb down and 63 lb up at 19-2-14, 1333 lb down and 81 lb up at 20-2-4, 41 lb down and 63 lb up at 21-2-14, 1333 lb down and 81 lb up at 22-2-4, 41 lb down and 63 lb up at 23-2-14, and 1333 lb down and 81 lb up at 24-2-4, and 44 lb down and 58 lb up at 25-2-14 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-2=-60, 2-4=-60, 4-5=-60, 5-7=-60, 8-15=-20

Concentrated Loads (lb)

Vert: 12=-1326(B) 10=-1333(B) 9=-29(F) 32=-1853(B) 33=-1326(B) 34=-1327(B) 35=-1326(B) 36=-1333(B) 39=-1333(B) 41=-29(F) 42=-1333(B) 43=-1333(B) 44=-29(F) 45=-1333(B) 46=-34(F)

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932

Job 34943A	Truss D1E	Truss Type Common Supported Gable	Qty 1	Ply 1	54 SERENITY Job Reference (optional)	153629147
---------------	--------------	--------------------------------------	----------	----------	---	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.610 s Jul 18 2022 MiTek Industries, Inc. Thu Aug 11 21:24:41 2022 Page 1

ID: nxbot3WsxISjrAw_FcBFB3yorwP-2fUaAUxdvECp5u7Sn7Q2F1bz2GFE6gxFz0JF4GyooUK

-0-11-0 19-11-8 39-11-0 40-10-0
0-11-0 19-11-8 19-11-8 0-11-0

Scale = 1:70.7

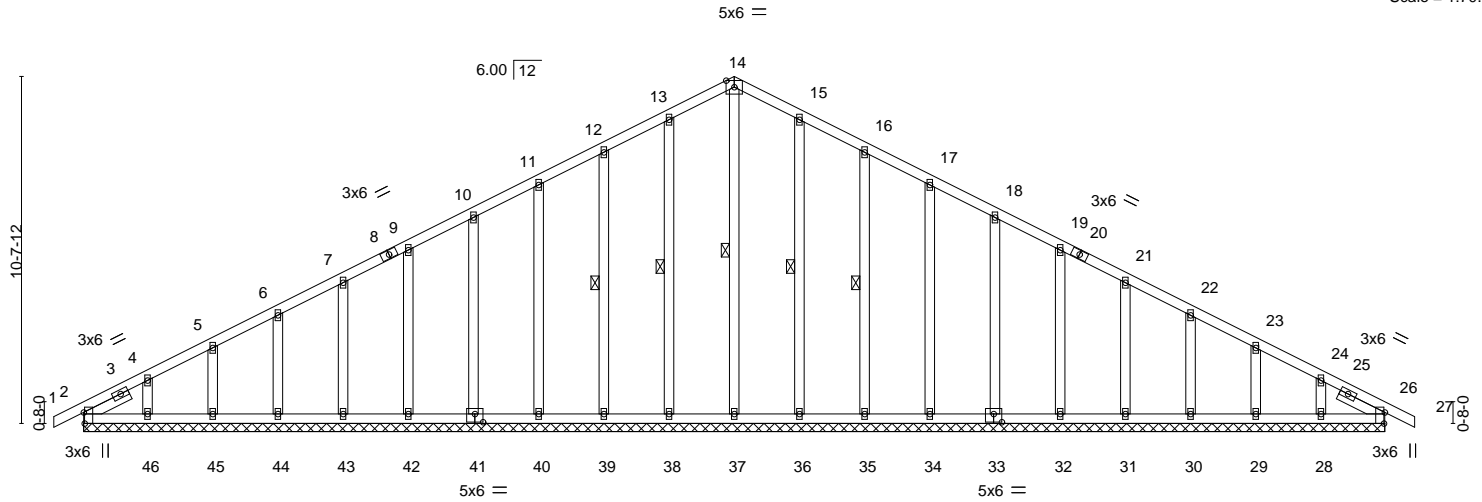


Plate Offsets (X,Y)--	[2:0-4-1,Edge], [26:0-4-1,Edge], [33:0-3-0,0-3-0], [41:0-3-0,0-3-0]
-----------------------	---


LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.06	Vert(LL)	-0.00	26	n/r	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.03	Vert(CT)	-0.00	26	n/r		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.11	Horz(CT)	0.01	26	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S						
								Weight: 285 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
OTHERS 2x4 SP No.2 or 2x4 SPF No.2	WEBS 1 Row at midpt 14-37, 13-38, 12-39, 15-36, 16-35
SLIDER Left 2x4 SP No.3 1-6-7, Right 2x4 SP No.3 1-6-7	

REACTIONS. All bearings 39-11-0.
 (lb) - Max Horz 2--148(LC 11)
 Max Uplift All uplift 100 lb or less at joint(s) 2, 38, 39, 40, 41, 42, 43, 44, 45, 46, 36, 35, 34, 33, 32, 31, 30, 29, 28
 Max Grav All reactions 250 lb or less at joint(s) 2, 37, 38, 39, 40, 41, 42, 43, 44, 45, 46, 36, 35, 34, 33, 32, 31, 30, 29, 28, 26

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 13-14=103/259, 14-15=103/259

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 4) All plates are 2x4 MT20 unless otherwise indicated.
 - 5) Gable requires continuous bottom chord bearing.
 - 6) Gable studs spaced at 2-0-0 oc.
 - 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 8) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 38, 39, 40, 41, 42, 43, 44, 45, 46, 36, 35, 34, 33, 32, 31, 30, 29, 28.



August 16, 2022

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	<p>818 Soundside Road Edenton, NC 27932</p>
--	---

Job 34943A	Truss D2	Truss Type Common	Qty 4	Ply 1	54 SERENITY	153629148
---------------	-------------	----------------------	----------	----------	-------------	-----------


84 Components (Dunn), Dunn, NC - 28334,

8.610 s Jul 18 2022 MiTek Industries, Inc. Thu Aug 11 21:24:43 2022 Page 1

ID:nxbot3WxslSjrAw_FcBFB3yorwP-_2cLbAytRrSXKHquYSWLjg6j3j5aVXYRkoM88yooUI

-0-11-0	6-10-3	13-4-13	19-11-8	26-6-3	33-0-13	39-11-0	40-10-0
0-11-0	6-10-3	6-6-11	6-6-11	6-6-11	6-6-11	6-10-3	0-11-0

Scale = 1:71.2

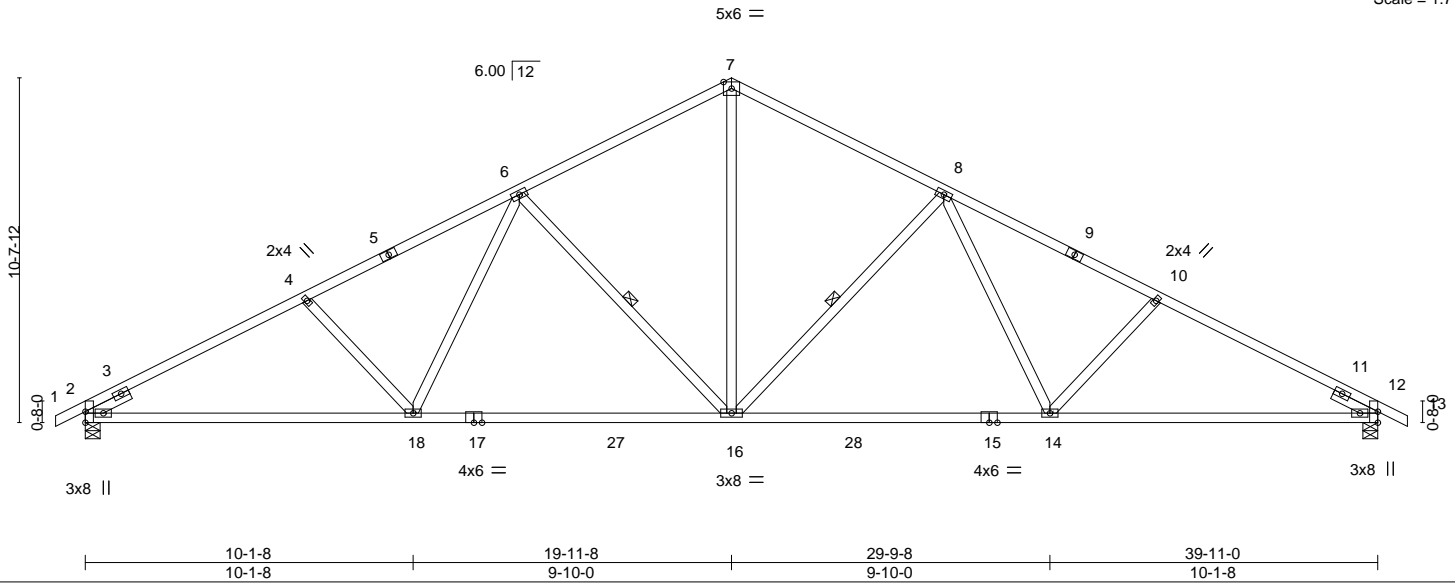

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.89	Vert(LL)	-0.36 16-18	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.90	Vert(CT)	-0.62 16-18	>771	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.43	Horz(CT)	0.13 12	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MS					Weight: 213 lb	FT = 20%


LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2 *Except* 1-5,9-13: 2x4 SP No.1	TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins.
BOT CHORD 2x4 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.2 or 2x4 SPF No.2	WEBS 1 Row at midpt 8-16, 6-16
SLIDER Left 2x4 SP No.3 1-6-0, Right 2x4 SP No.3 1-6-0	

REACTIONS. (size) 2=0-5-8, 12=0-5-8
 Max Horz 2=148(LC 10)
 Max Uplift 2=-103(LC 10), 12=-103(LC 11)
 Max Grav 2=1652(LC 1), 12=1652(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD	2-4=-2783/482, 4-6=-2554/468, 6-7=-1851/427, 7-8=-1851/427, 8-10=-2554/468, 10-12=-2783/482
BOT CHORD	2-18=-319/2409, 16-18=-190/2035, 14-16=-190/2035, 12-14=-319/2409
WEBS	7-16=-226/1277, 8-16=-705/233, 8-14=-14/494, 10-14=-307/183, 6-16=-705/233, 6-18=-14/494, 4-18=-307/183

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) All plates are 3x6 MT20 unless otherwise indicated.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=103, 12=103.



August 16, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ENGINEERING BY
TRENCO
 A MITEK Affiliate


818 Soundside Road
 Edenton, NC 27932

Job 34943A	Truss E2	Truss Type Common	Qty 4	Ply 1	54 SERENITY	153629150
---------------	-------------	----------------------	----------	----------	-------------	-----------


84 Components (Dunn), Dunn, NC - 28334,

8.610 s Jul 18 2022 MiTek Industries, Inc. Thu Aug 11 21:24:45 2022 Page 1

ID:nxbot3WsxISjrAw_FcBFB3yorwP-wQj50r_7zTiFaWRD0yV_Q8mXwtUL2UzrueHSD1yooUG



Scale = 1:24.7

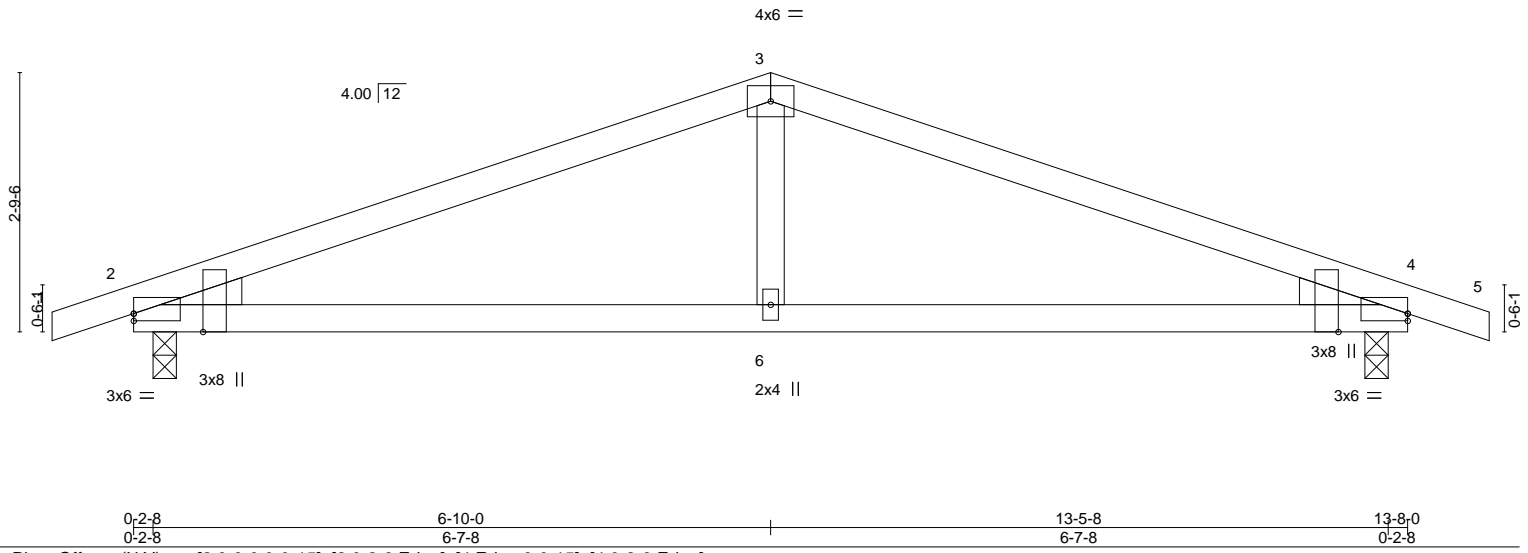

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.52	Vert(LL)	-0.07	6-12	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.53	Vert(CT)	-0.13	6-9	>999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.11	Horz(CT)	0.01	2	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MS					Weight: 51 lb	FT = 20%


LUMBER-
TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2
BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2
WEBS 2x4 SP No.3
WEDGE
Left: 2x4 SP No.3 , Right: 2x4 SP No.3

BRACING-
TOP CHORD Structural wood sheathing directly applied or 5-0-8 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 2=0-3-0, 4=0-3-0
Max Horz 2=37(LC 14)
Max Uplift 2=-69(LC 6), 4=-69(LC 7)
Max Grav 2=599(LC 1), 4=599(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-951/189, 3-4=-951/189
BOT CHORD 2-6=-100/855, 4-6=-100/855
WEBS 3-6=0/292

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 4.



August 16, 2022

Job 34943A	Truss J1	Truss Type Jack-Open	Qty 9	Ply 1	54 SERENITY Job Reference (optional)	153629151
---------------	-------------	-------------------------	----------	----------	---	-----------


84 Components (Dunn), Dunn, NC - 28334,

8.610 s Jul 18 2022 MiTek Industries, Inc. Thu Aug 11 21:24:46 2022 Page 1

ID:nxbot3WsxISjrAw_FcBFB3yorwP-PdHTDB?lkmq6Bg0PZg0DyMlhZHsInny_7H00ITyooUF



Scale = 1:29.9

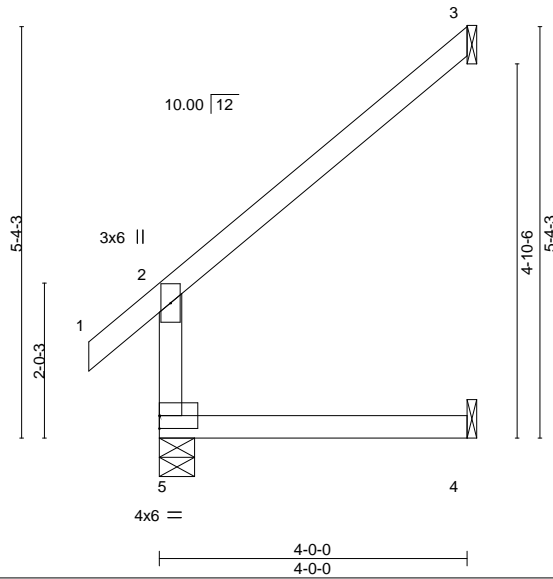

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.59	Vert(LL)	0.03 4-5	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.39	Vert(CT)	-0.03 4-5	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.10 3	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MR					Weight: 18 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2
 BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2
 WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

(size) 5=0-5-8, 3=Mechanical, 4=Mechanical
 Max Horz 5=109(LC 10)
 Max Uplift 3=97(LC 10), 4=-14(LC 10)
 Max Grav 5=224(LC 1), 3=120(LC 17), 4=73(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 4.

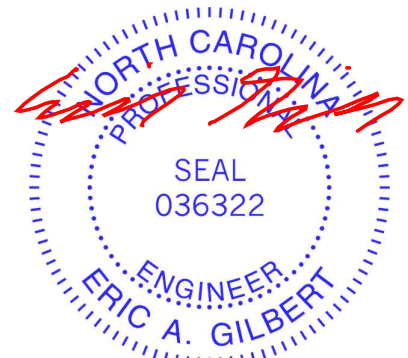

August 16, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

Job 34943A	Truss J2	Truss Type Jack-Open	Qty 3	Ply 1	54 SERENITY	153629152
---------------	-------------	-------------------------	----------	----------	-------------	-----------


84 Components (Dunn), Dunn, NC - 28334,

8.610 s Jul 18 2022 MiTek Industries, Inc. Thu Aug 11 21:24:47 2022 Page 1

ID:nxbot3WsxISjrAw_FcBFB3yorwP-tprsRX0OV4yzpqab7NXSVZrxqhDnWPB8MxmZHyooUE



Scale = 1:29.9

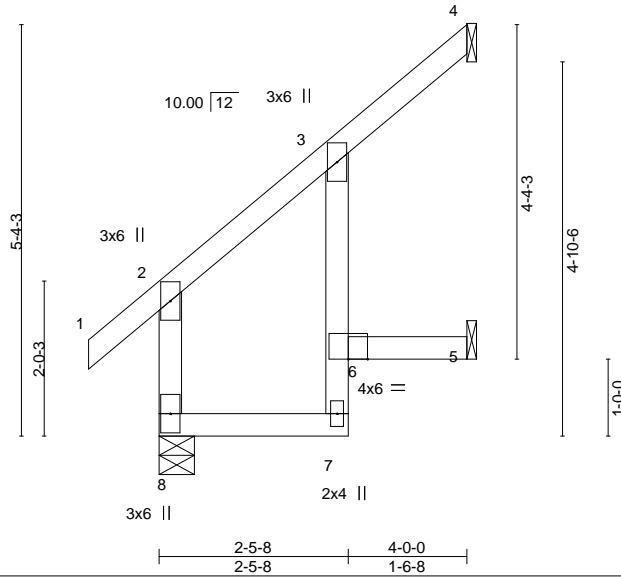

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL. in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.30	Vert(LL) 0.02	6	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.34	Vert(CT) -0.03	7	>999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT) -0.06	4	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MR				Weight: 23 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2
 BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2 *Except*
 3-7: 2x4 SP No.3
 WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

(size) 8=0-5-8, 4=Mechanical, 5=Mechanical
 Max Horz 8=109(LC 10)
 Max Uplift 4=-61(LC 10), 5=-50(LC 10)
 Max Grav 8=224(LC 1), 4=98(LC 17), 5=77(LC 17)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 5.

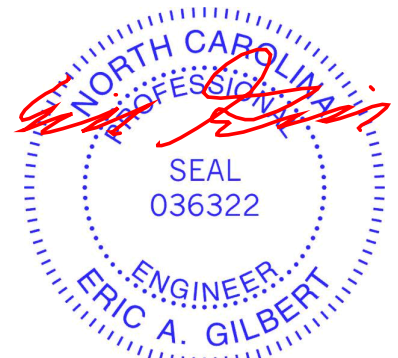

August 16, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

Job 34943A	Truss J3	Truss Type Jack-Open	Qty 1	Ply 1	54 SERENITY Job Reference (optional)	153629153
---------------	-------------	-------------------------	----------	----------	---	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.610 s Jul 18 2022 MiTek Industries, Inc. Thu Aug 11 21:24:47 2022 Page 1

ID:nxbot3WsxISjrAw_FcBFB3yorwP-tprsRX0OV4yzzpqab7NXSVZrxFhEZWPo8MxmZHvyooUE



Scale = 1:26.8

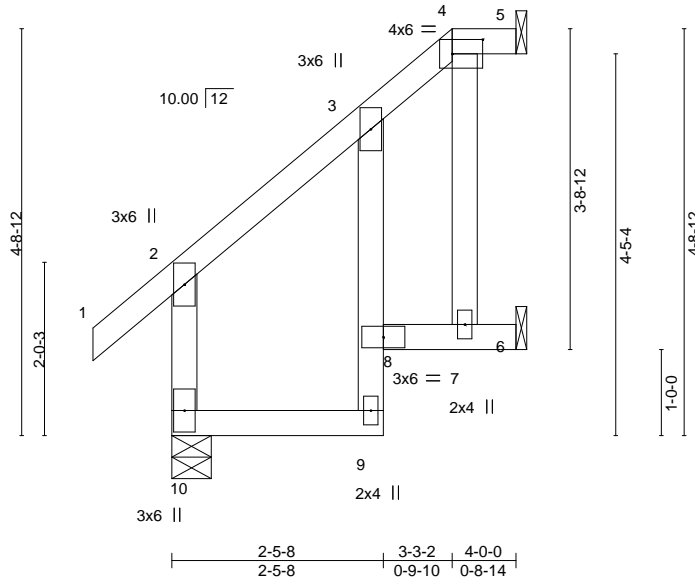



Plate Offsets (X,Y)--	[4:0-4-4,0-2-0]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.27	Vert(LL) 0.02 8 >999 240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.29	Vert(CT) -0.02 9 >999 180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.03	Horz(CT) -0.06 5 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-MS		Weight: 28 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 4-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2 *Except* 3-9: 2x4 SP No.3	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	

REACTIONS. (size) 10=0-5-8, 5=Mechanical, 6=Mechanical
 Max Horz 10=93(LC 7)
 Max Uplift 5=-11(LC 7), 6=-72(LC 10)
 Max Grav 10=224(LC 1), 5=32(LC 1), 6=129(LC 17)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 6) Refer to girder(s) for truss to truss connections.
 - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 6.



August 16, 2022


<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	<p>ENGINEERING BY TRENCO <small>A MiTek Affiliate</small></p> <p>818 Soundside Road Edenton, NC 27932</p>
--	---

Job 34943A	Truss J4	Truss Type Jack-Open	Qty 1	Ply 1	54 SERENITY	153629154
---------------	-------------	-------------------------	----------	----------	-------------	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.610 s Jul 18 2022 MiTek Industries, Inc. Thu Aug 11 21:24:48 2022 Page 1

ID:nxbot3WsxISjrAw_FcBFB3yorwP-L?PEet00GO4qRz9oh52h2nO7m4bfFsRHabV7qMyooUD

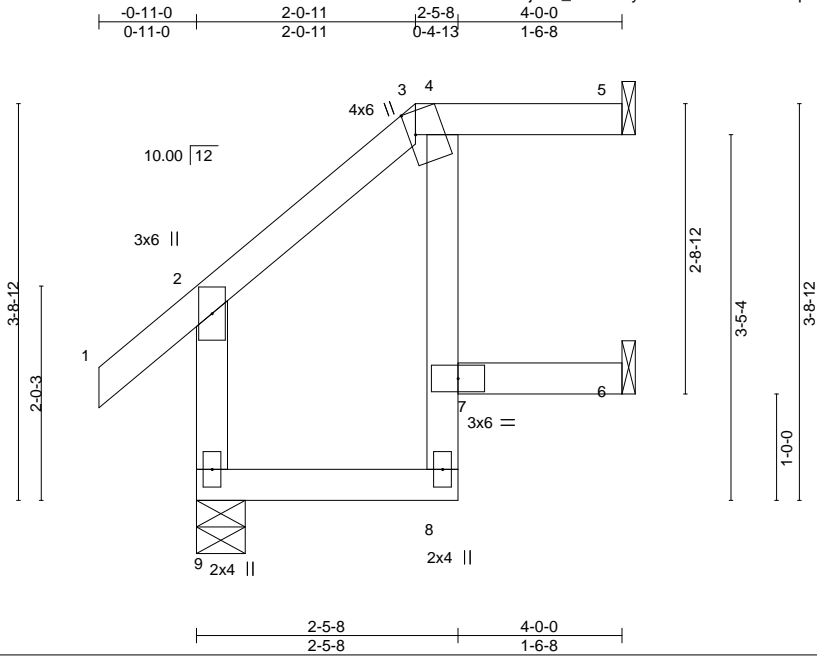

Scale = 1:21.7


Plate Offsets (X,Y)--	[3:0-2-9,Edge]								
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.23	Vert(LL)	-0.01	7	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.24	Vert(CT)	-0.02	7	>999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.05	5	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MR					Weight: 22 lb	FT = 20%

LUMBER-			BRACING-	
TOP CHORD	2x4 SP No.2 or 2x4 SPF No.2		TOP CHORD	Structural wood sheathing directly applied or 4-0-0 oc purlins, except end verticals.
BOT CHORD	2x4 SP No.2 or 2x4 SPF No.2 *Except*		BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
	4-8: 2x4 SP No.3			
WEBS	2x4 SP No.3			

REACTIONS. (size) 9=0-5-8, 5=Mechanical, 6=Mechanical
 Max Horz 9=74(LC 7)
 Max Uplift 5=-28(LC 7), 6=-18(LC 10)
 Max Grav 9=224(LC 1), 5=87(LC 1), 6=60(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.



- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 6) Refer to girder(s) for truss to truss connections.
 - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 6.



August 16, 2022

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	<p>ENGINEERING BY</p> <p>TRENCO</p> <p>A MiTek Affiliate</p> <p>818 Soundside Road Edenton, NC 27932</p>
--	---

Job 34943A	Truss J5	Truss Type Jack-Open Girder	Qty 1	Ply 1	54 SERENITY	I53629155
84 Components (Dunn), Dunn, NC - 28334,					8.610 s Jul 18 2022 MiTek Industries, Inc. Thu Aug 11 21:24:49 2022 Page 1	
					Job Reference (optional)	

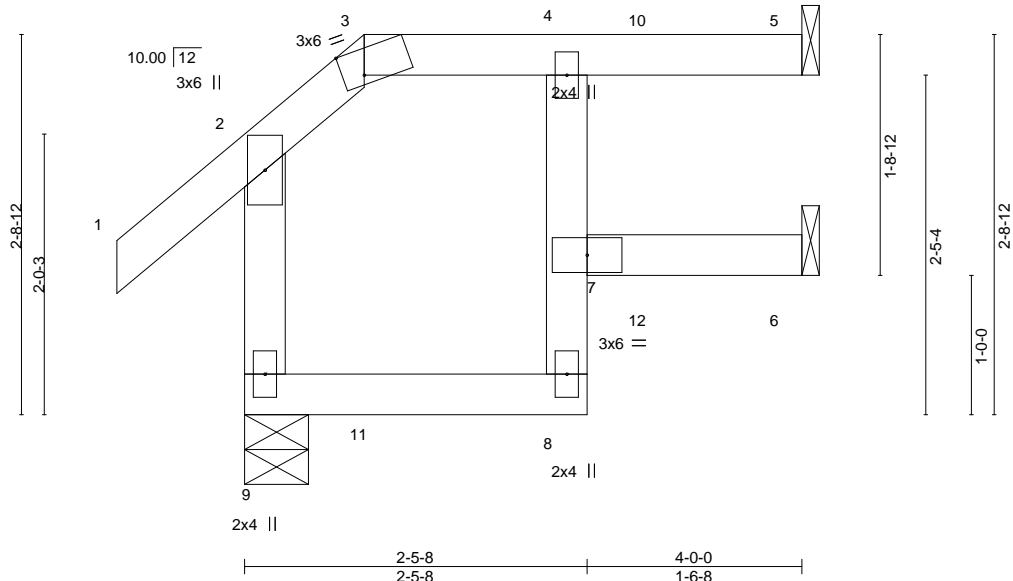

Scale = 1:16.5

Plate Offsets (X,Y)--	[3:0-1-13,Edge]
-----------------------	-----------------

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.31	in (loc) l/defl L/d	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.21	Vert(LL) -0.01 8 >999 240		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.00	Vert(CT) -0.03 8 >999 180		
BCDL 10.0	Rep Stress Incr NO	Matrix-MR	Horz(CT) 0.02 5 n/a n/a		
	Code IRC2015/TPI2014			Weight: 20 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 4-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2 *Except* 4-8: 2x4 SP No.3	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	


REACTIONS. (size) 9=0-5-8, 5=Mechanical, 6=Mechanical
 Max Horz 9=56(LC 5)
 Max Uplift 9=34(LC 8), 5=24(LC 5)
 Max Grav 9=349(LC 1), 5=110(LC 20), 6=101(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 6) Refer to girder(s) for truss to truss connections.
 - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 9, 5.
 - 8) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 4 lb down and 4 lb up at 0-10-5, and 36 lb down and 41 lb up at 2-11-1 on top chord, and 144 lb down and 58 lb up at 0-11-1, and 83 lb down at 2-11-1 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
 - 9) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-2=-60, 2-3=-60, 3-5=-60, 8-9=-20, 6-7=-20
Concentrated Loads (lb)
Vert: 10=41(B) 11=-144(B) 12=-78(B)




August 16, 2022

Job 34943A	Truss J6	Truss Type Jack-Open	Qty 1	Ply 1	54 SERENITY	153629156
---------------	-------------	-------------------------	----------	----------	-------------	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.610 s Jul 18 2022 MiTek Industries, Inc. Thu Aug 11 21:24:50 2022 Page 1

ID:nxbot3WsxISjrAw_FcBFB3yorwP-HOX_3Z2Go?KXgHJAoW497CTTHul5jmx2v_DuEyoUB

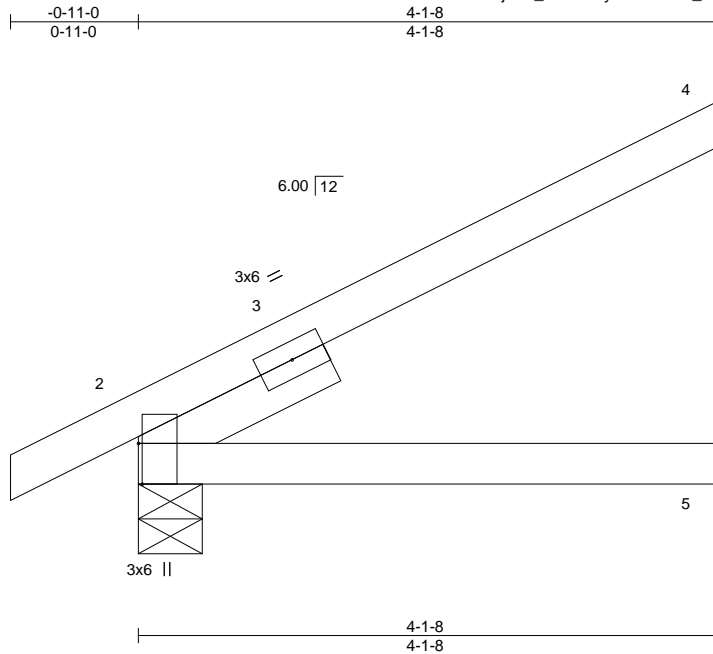

Scale = 1:16.5

Plate Offsets (X,Y)--	[2:0-3-8,Edge]									
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 20.0	Plate Grip DOL	1.15	TC 0.22	Vert(LL)	0.02	5-8	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.17	Vert(CT)	-0.03	5-8	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.01	2	n/a	n/a		
BCDL 10.0	Code	IRC2015/TPI2014	Matrix-MP						Weight: 17 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2
BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2
SLIDER Left 2x4 SP No.3 1-6-0

BRACING-
TOP CHORD Structural wood sheathing directly applied or 4-1-8 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 4=Mechanical, 2=0-5-8, 5=Mechanical
Max Horz 2=80(LC 10)
Max Uplift 4=-47(LC 10), 2=-12(LC 10)
Max Grav 4=104(LC 1), 2=224(LC 1), 5=73(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 2.



August 16, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932

Job 34943A	Truss J7	Truss Type Jack-Open	Qty 1	Ply 1	54 SERENITY	153629157
84 Components (Dunn), Dunn, NC - 28334,					8.610 s Jul 18 2022 MiTek Industries, Inc. Thu Aug 11 21:24:51 2022 Page 1	
					Job Reference (optional)	



Scale = 1:16.5

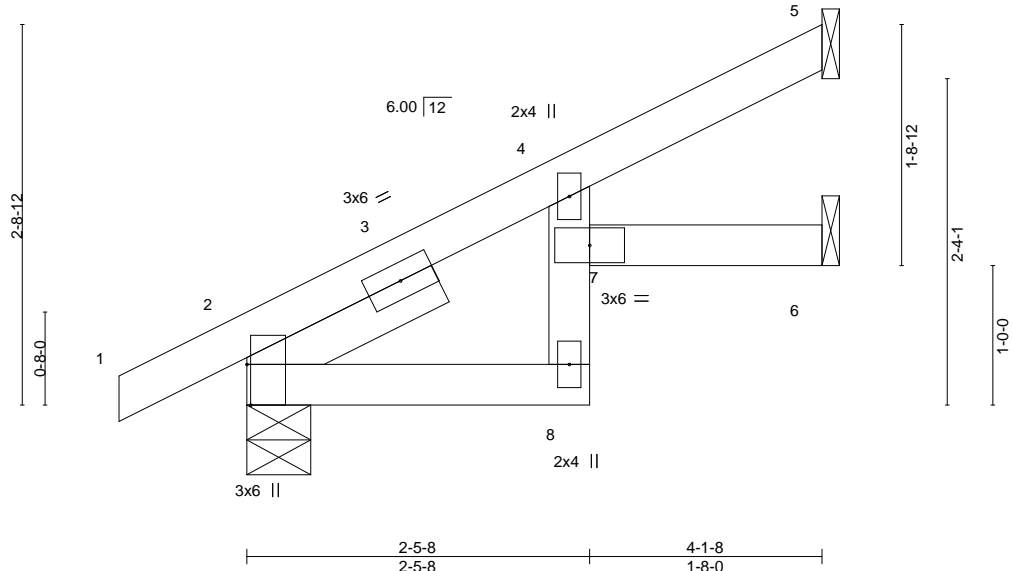


Plate Offsets (X,Y)--	[2:0-3-8,Edge]
-----------------------	----------------

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.13	Vert(LL)	-0.01	7	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.30	Vert(CT)	-0.02	7	>999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.01	6	n/a		
BCDL 10.0	Code	IRC2015/TPI2014	Matrix-MR					Weight: 19 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 4-1-8 oc purlins.
BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2 *Except* 4-8: 2x4 SP No.3	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
SLIDER Left 2x4 SP No.3 1-6-0	

REACTIONS. (size) 5=Mechanical, 2=0-5-8, 6=Mechanical
 Max Horz 2=80(LC 10)
 Max Uplift 5=-32(LC 10), 2=-12(LC 10), 6=-8(LC 10)
 Max Grav 5=85(LC 1), 2=224(LC 1), 6=73(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 2, 6.



August 16, 2022

Job 34943A	Truss J8	Truss Type Jack-Closed	Qty 4	Ply 1	54 SERENITY	153629158
---------------	-------------	---------------------------	----------	----------	-------------	-----------


84 Components (Dunn), Dunn, NC - 28334,

8.610 s Jul 18 2022 MiTek Industries, Inc. Thu Aug 11 21:24:52 2022 Page 1

ID:nxbot3WsxISjrAw_FcBFB3yorwP-DneIUf3WKcaFvbTZwx7eCdYrXi?cBgRtVDTKz7yooU9



Scale = 1:16.4

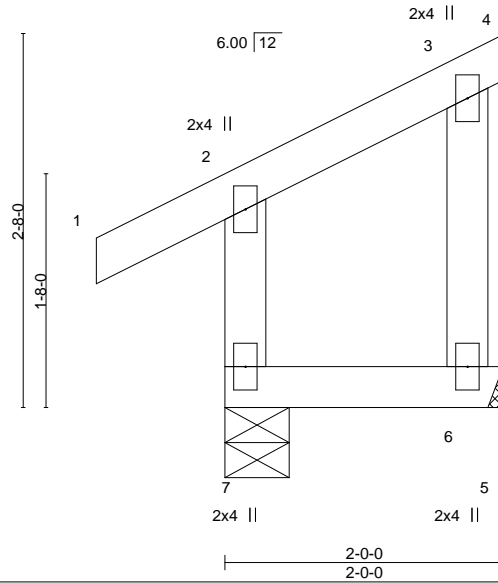

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.11	Vert(LL)	-0.00	7	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.04	Vert(CT)	-0.00	6	>999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.00	5	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MR					Weight: 13 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2
 BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2
 WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

(size) 7=0-5-8, 5=Mechanical
 Max Horz 7=81(LC 7)
 Max Uplift 7=-18(LC 10), 5=-46(LC 7)
 Max Grav 7=155(LC 1), 5=58(LC 17)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 7, 5.

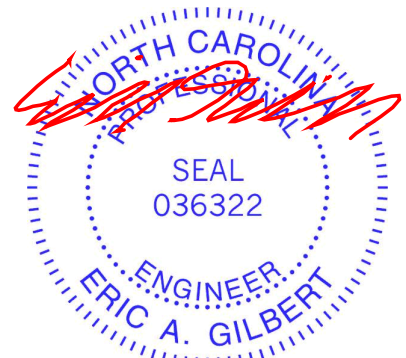

August 16, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

Job 34943A	Truss J9	Truss Type Jack-Closed	Qty 3	Ply 1	54 SERENITY	153629159
---------------	-------------	---------------------------	----------	----------	-------------	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.610 s Jul 18 2022 MiTek Industries, Inc. Thu Aug 11 21:24:52 2022 Page 1

ID: nxbot3WsxISjrAw_FcBFB3yorwP-DnelUF3WKcaFvbTZwx7eCdYp1i?YBgRtVDTKz7yooU9

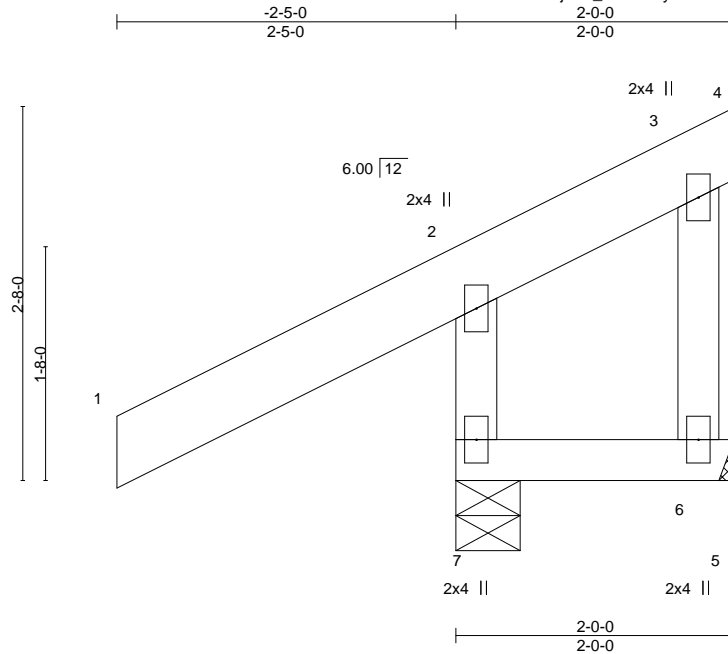

Scale = 1:16.4

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.21	Vert(LL)	-0.00	7	>999	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.05	Vert(CT)	-0.00	7	>999		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.00	Horz(CT)	-0.00	5	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-MR						
	Code IRC2015/TPI2014						Weight: 19 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.2
 BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2
 WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS.

(size) 7=0-5-8, 5=Mechanical
 Max Horz 7=110(LC 9)
 Max Uplift 7=-63(LC 10), 5=-62(LC 18)
 Max Grav 7=334(LC 1), 5=42(LC 6)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-7=-317/242

NOTES-

- 1) Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 7, 5.



August 16, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

Job 34943A	Truss M1	Truss Type MONO TRUSS	Qty 6	Ply 1	54 SERENITY	I53629160
---------------	-------------	--------------------------	----------	----------	-------------	-----------

84 Components (Dunn),


Dunn, NC - 28334,

8.610 s Jul 18 2022 MiTek Industries, Inc. Thu Aug 11 21:24:53 2022 Page 1

ID: nxbot3WsxISjrAw_FcBFB3yorwP-hzC7hb495wi6Xl2IUeetq5wE5Brw5C0ktDuVZyooU8



Scale = 1:21.6

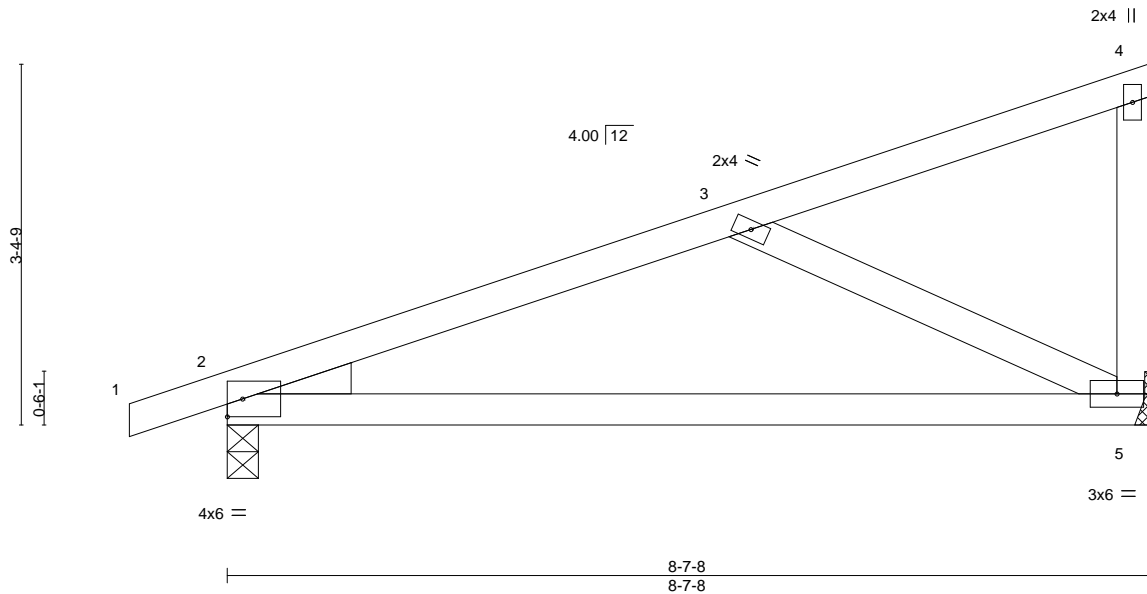

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.50	Vert(LL)	-0.17 5-8	>605	240	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.68	Vert(CT)	-0.34 5-8	>298	180		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.16	Horz(CT)	0.01 2	n/a	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-MP					Weight: 39 lb	FT = 20%
	Code IRC2015/TPI2014							

LUMBER-

TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2
 BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2
 WEBS 2x4 SP No.3
 WEDGE
 Left: 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


(size) 2=0-3-8, 5=Mechanical
 Max Horz 2=112(LC 9)
 Max Uplift 2=60(LC 6), 5=46(LC 10)
 Max Grav 2=397(LC 1), 5=336(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-447/167
 BOT CHORD 2-5=-137/405
 WEBS 3-5=-448/205

NOTES-

- 1) Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 5.

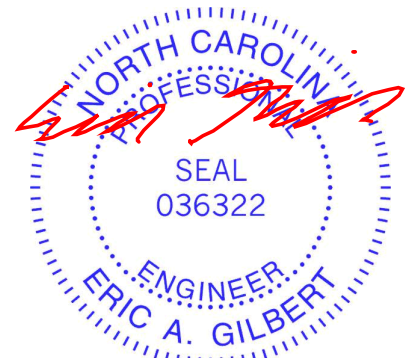

August 16, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

Job 34943A	Truss M1GE	Truss Type GABLE	Qty 1	Ply 1	54 SERENITY	153629161
---------------	---------------	---------------------	----------	----------	-------------	-----------

84 Components (Dunn),

Dunn, NC - 28334,

8.610 s Jul 18 2022 MiTek Industries, Inc. Thu Aug 11 21:24:54 2022 Page 1

ID: nxbot3WsxISjrAw_FcBFB3yorwP-A9mVvw5nsEqz9udy1L96H2d5_VX4fYSAzXyR1?yooU7



Scale = 1:20.3

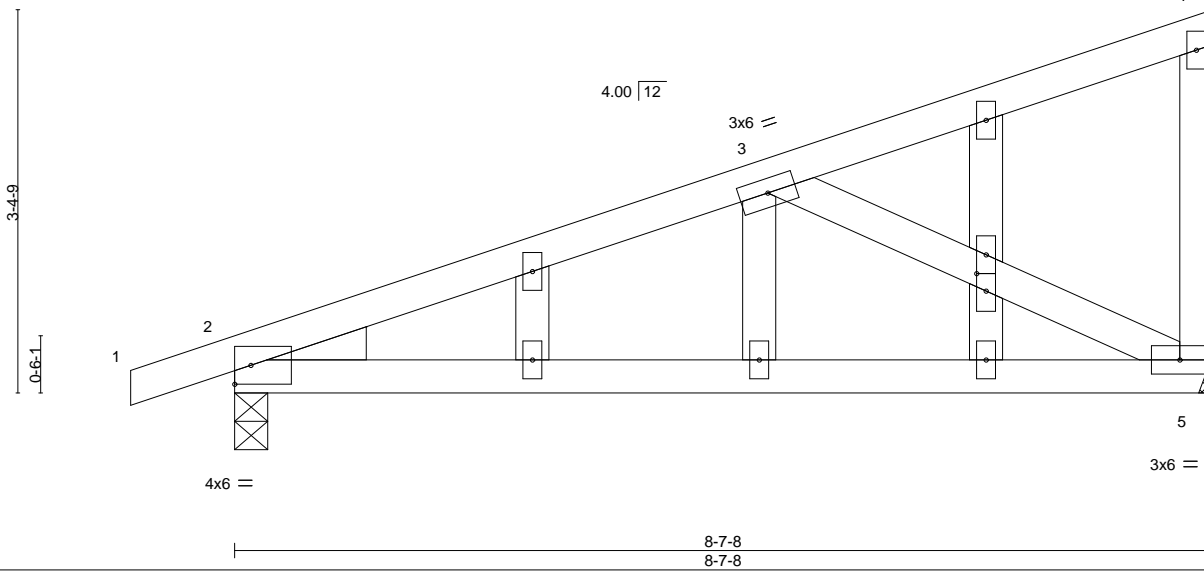



Plate Offsets (X,Y)--	[8:0-1-14,0-1-0]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.50	Vert(LL) -0.17 5-14 >605 240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.68	Vert(CT) -0.34 5-14 >298 180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.16	Horz(CT) 0.01 2 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-MP		Weight: 46 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	
OTHERS 2x4 SP No.3	
WEDGE	
Left: 2x4 SP No.3	

REACTIONS.	(size) 2=0-3-8, 5=Mechanical
	Max Horz 2=112(LC 9)
	Max Uplift 2=60(LC 6), 5=46(LC 10)
	Max Grav 2=397(LC 1), 5=336(LC 1)

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-3=-447/167
BOT CHORD	2-5=-137/405
WEBS	3-5=-448/205

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 3) All plates are 2x4 MT20 unless otherwise indicated.
 - 4) Gable studs spaced at 2-0-0 oc.
 - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 7) Refer to girder(s) for truss to truss connections.
 - 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 5.



August 16, 2022

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	<p>ENGINEERING BY</p> <p>TRENCO</p> <p>A MiTek Affiliate</p> <p>818 Soundside Road Edenton, NC 27932</p>
--	---

Job 34943A	Truss M2	Truss Type MONO TRUSS	Qty 3	Ply 1	54 SERENITY	153629162
---------------	-------------	--------------------------	----------	----------	-------------	-----------

84 Components (Dunn),


Dunn, NC - 28334,

8.610 s Jul 18 2022 MiTek Industries, Inc. Thu Aug 11 21:24:55 2022 Page 1

ID:nxbot3WsxISjrAw_FcBFB3yorwP-eMKt6G6PcXzqm2C8b3gLfQFAJfvzaO_tJBBi_ZSyooU6



Scale = 1:23.3

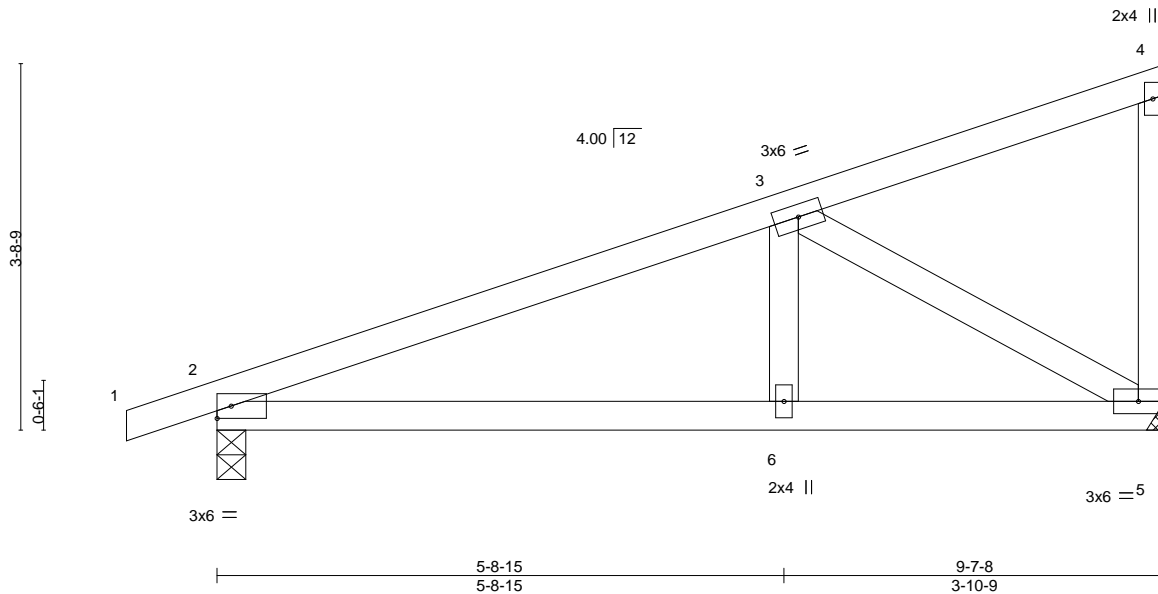

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.31	Vert(LL)	-0.02 6-9	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.28	Vert(CT)	-0.05 6-9	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.21	Horz(CT)	0.01 5	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MS					Weight: 44 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2
 BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2
 WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


(size) 2=0-3-8, 5=Mechanical
 Max Horz 2=124(LC 9)
 Max Uplift 2=64(LC 6), 5=52(LC 10)
 Max Grav 2=437(LC 1), 5=377(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-569/126
 BOT CHORD 2-6=-97/494, 5-6=-97/494
 WEBS 3-5=-562/171

NOTES-

- 1) Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 5.

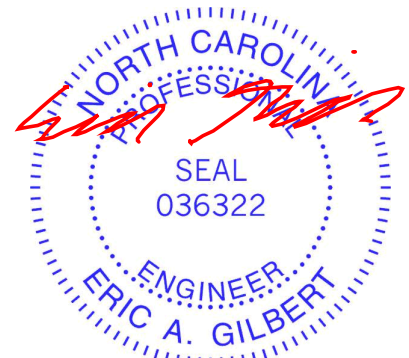

August 16, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

Job 34943A	Truss M2GE	Truss Type GABLE	Qty 1	Ply 1	54 SERENITY	153629163
---------------	---------------	---------------------	----------	----------	-------------	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.610 s Jul 18 2022 MiTek Industries, Inc. Thu Aug 11 21:24:55 2022 Page 1

ID: nxbot3WsxISjrAw_FcBFB3yorwP-eMKt6G6PcXzqm2C8b3gLqFAI8vz2OyWJBBi_ZSyooU6

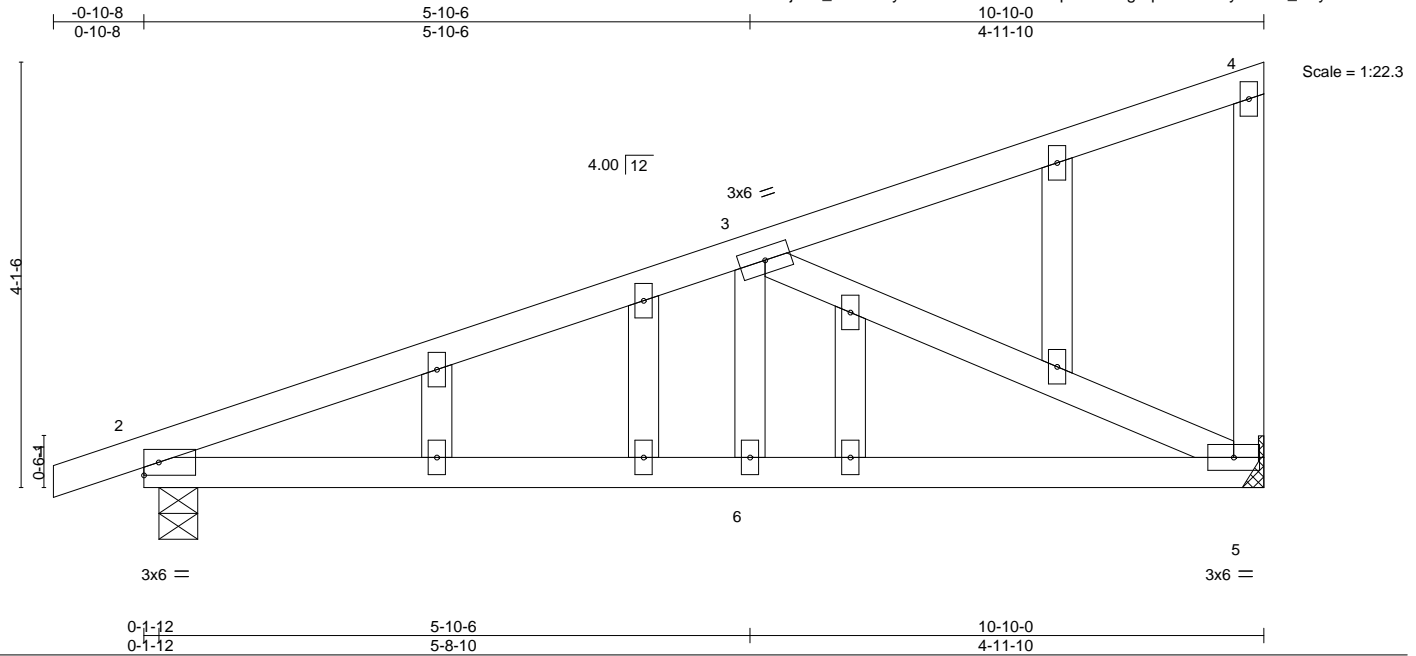


LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.34	Vert(LL)	-0.02	6-17	>999	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.32	Vert(CT)	-0.06	6-17	>999		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.36	Horz(CT)	0.01	5	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-MS					Weight: 59 lb	FT = 20%
	Code IRC2015/TPI2014							

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	
OTHERS 2x4 SP No.3	

REACTIONS. (size) 2=0-4-8, 5=Mechanical
 Max Horz 2=138(LC 9)
 Max Uplift 2=66(LC 6), 5=58(LC 10)
 Max Grav 2=482(LC 1), 5=425(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-704/146
 BOT CHORD 2-6=-119/622, 5-6=-119/622
 WEBS 3-5=-667/191

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 3) All plates are 2x4 MT20 unless otherwise indicated.
 - 4) Gable studs spaced at 2-0-0 oc.
 - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 7) Refer to girder(s) for truss to truss connections.
 - 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 5.



August 16, 2022

Job 34943A	Truss M3	Truss Type Monopitch	Qty 6	Ply 1	54 SERENITY	153629164
---------------	-------------	-------------------------	----------	----------	-------------	-----------


84 Components (Dunn), Dunn, NC - 28334,

8.610 s Jul 18 2022 MiTek Industries, Inc. Thu Aug 11 21:24:56 2022 Page 1

ID: nxbot3WsxISjrAw_FcBFB3yorwP-6YuFKc71Nr5hOCmK9mBaMTjTujJH7PmTQrRY6uyooU5



Scale = 1:24.9

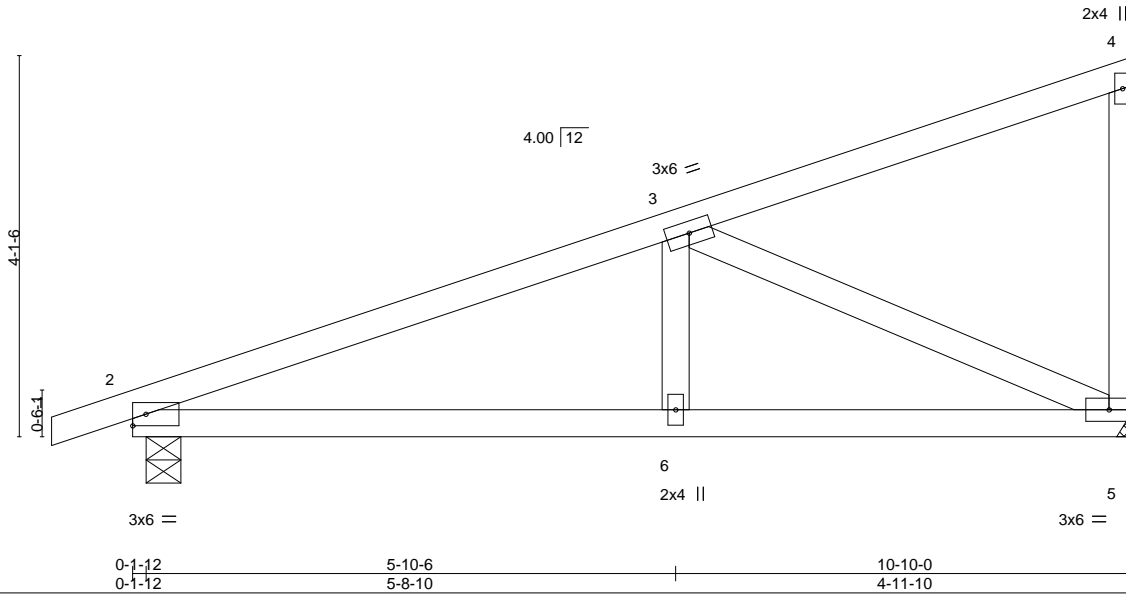

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.34	Vert(LL)	-0.02	6-9	>999	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.32	Vert(CT)	-0.06	6-9	>999		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.36	Horz(CT)	0.01	5	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-MS						
	Code IRC2015/TPI2014						Weight: 50 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2
 BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2
 WEBS 2x4 SP No.3

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 2=0-4-8, 5=Mechanical
 Max Horz 2=138(LC 9)
 Max Uplift 2=-66(LC 6), 5=-58(LC 10)
 Max Grav 2=482(LC 1), 5=425(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-704/146
 BOT CHORD 2-6=-119/622, 5-6=-119/622
 WEBS 3-5=-667/191

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 5.



August 16, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

Job 34943A	Truss M3GE	Truss Type Monopitch Structural Gable	Qty 1	Ply 1	54 SERENITY	153629165
---------------	---------------	--	----------	----------	-------------	-----------

84 Components (Dunn),


Dunn, NC - 28334,

8.610 s Jul 18 2022 MiTek Industries, Inc. Thu Aug 11 21:24:57 2022 Page 1

ID:nxbot3WsxISjrAw_FcBFB3yorwP-akSeXy7f89DY0MLWjUipvgFhOjiasxgcfVB5eKyooU4



Scale = 1:11.4

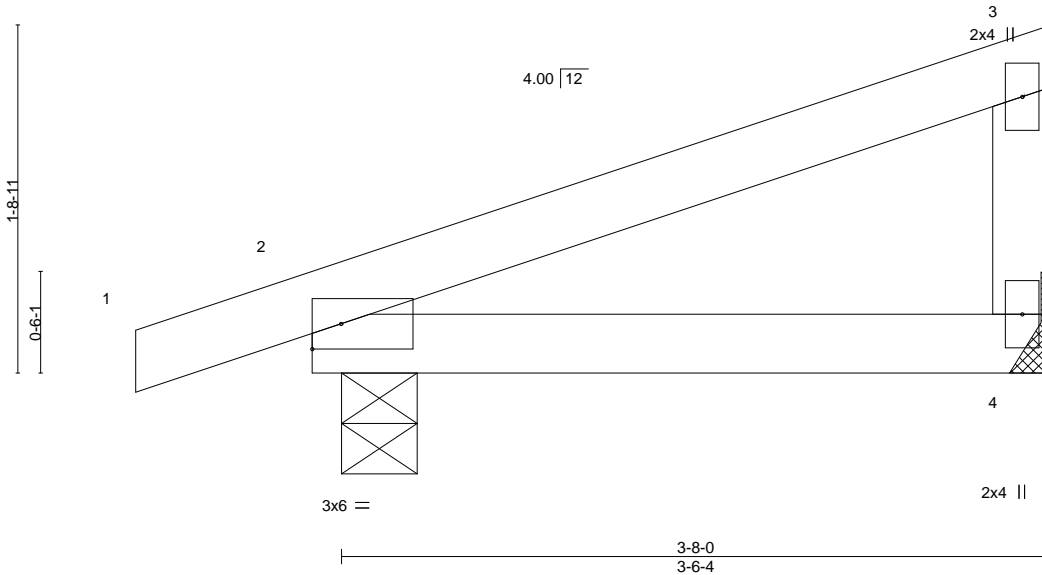

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.17	Vert(LL)	-0.01	4-7	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.12	Vert(CT)	-0.01	4-7	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	2	n/a	n/a		
BCDL 10.0	Code	IRC2015/TPI2014	Matrix-MP						Weight: 14 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2
 BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2
 WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-8-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

(size) 4=Mechanical, 2=0-4-8
 Max Horz 2=52(LC 9)
 Max Uplift 4=-18(LC 10), 2=-43(LC 6)
 Max Grav 4=134(LC 1), 2=200(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) Gable studs spaced at 2-0-0 oc.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Refer to girder(s) for truss to truss connections.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 2.

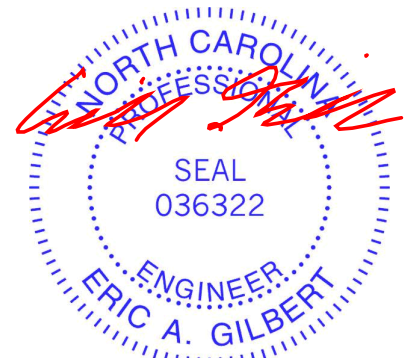

August 16, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	54 SERENITY	I53629166
34943A	PB1	GABLE	1	2	Job Reference (optional)	

84 Components (Dunn), Dunn, NC - 28334,

8.610 s Jul 18 2022 MiTek Industries, Inc. Thu Aug 11 21:24:58 2022 Page 1
 ID: nxbot3WsxISjrAw_FcBFB3yorwP-2x00kI8HvSLPdWwjGBE2Ruos623bNmlu9weAnyooUJ3

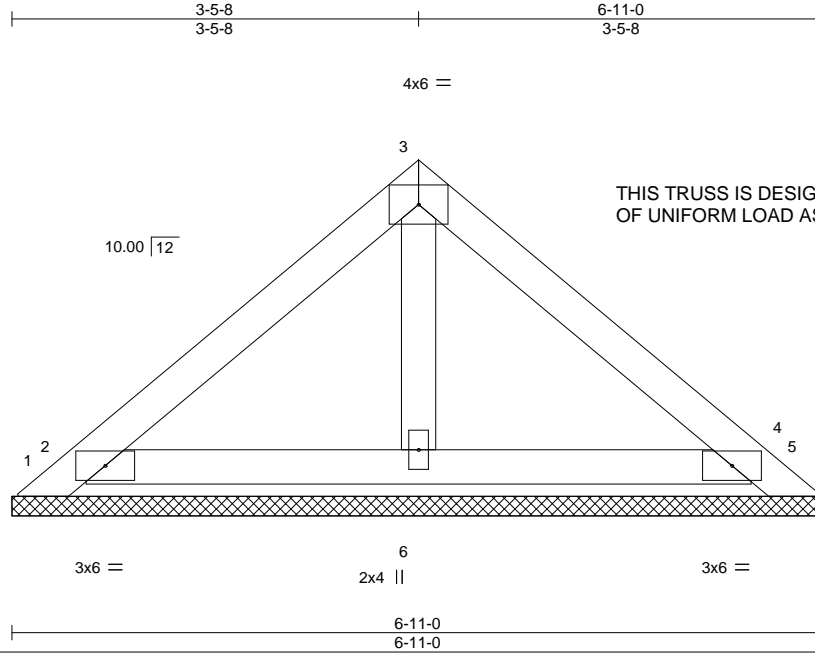

Scale = 1:19.6

LOADING (psf)	SPACING-	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.07	Vert(LL) n/a	-	n/a	999		MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.04	Vert(CT) n/a	-	n/a	999			
BCLL 0.0 *	Rep Stress Incr YES	WB 0.01	Horz(CT) 0.00	4	n/a	n/a			
BCDL 10.0	Code IRC2015/TPI2014	Matrix-P						Weight: 49 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2
 BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2
 OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

All bearings 6-11-0.
 (lb) - Max Horz 1=-56(LC 6)
 Max Uplift All uplift 100 lb or less at joint(s) except 1=-172(LC 17), 5=-145(LC 18), 2=-161(LC 10), 4=-143(LC 11)
 Max Grav All reactions 250 lb or less at joint(s) 1, 5, 6 except 2=329(LC 17), 4=309(LC 18)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
 Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
 Bottom chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCCL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 172 lb uplift at joint 1, 145 lb uplift at joint 5, 161 lb uplift at joint 2 and 143 lb uplift at joint 4.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

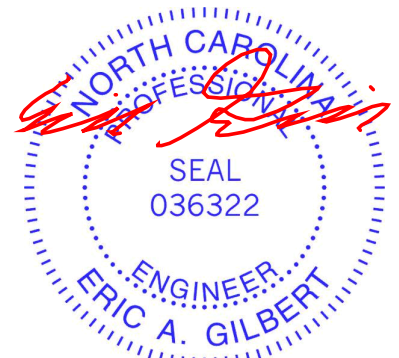

August 16, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

Job 34943A	Truss PB2	Truss Type GABLE	Qty 2	Ply 1	54 SERENITY	153629167
---------------	--------------	---------------------	----------	----------	-------------	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.610 s Jul 18 2022 MiTek Industries, Inc. Thu Aug 11 21:24:59 2022 Page 1

ID:nxbot3WsxISjrAw_FcBFB3yorwP-W7aOye9vgmTGFgVvqvIH_5L0QWIVKqAv6pgCiDyooU2

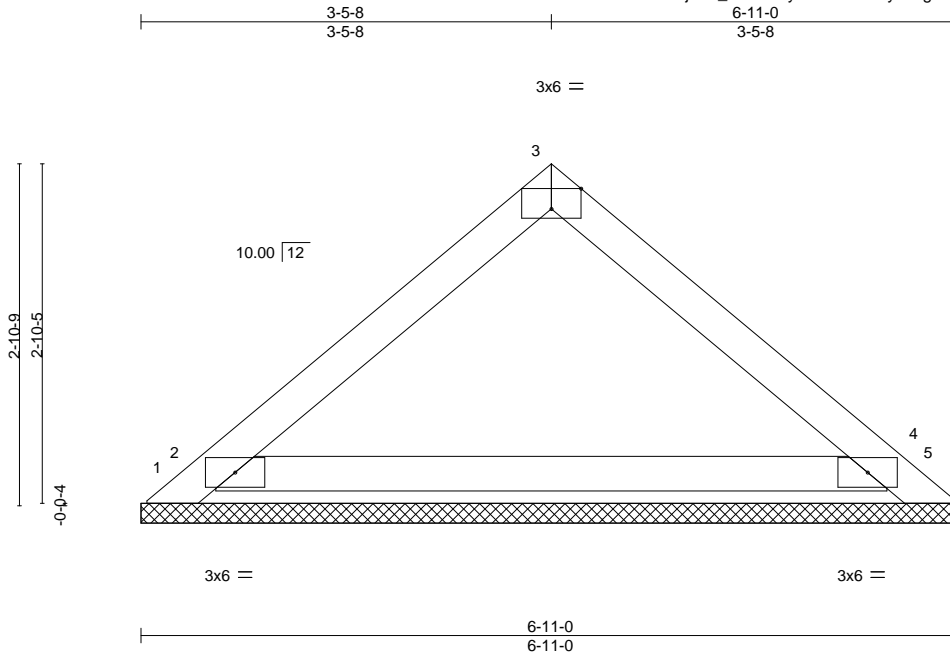

Scale = 1:19.4

Plate Offsets (X,Y)--	[3:0-3-0,Edge]						PLATES	GRIP
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	
TCLL 20.0	Plate Grip DOL	1.15	TC 0.13	Vert(LL)	n/a	-	n/a	999
TCDL 10.0	Lumber DOL	1.15	BC 0.41	Vert(CT)	n/a	-	n/a	999
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	5	n/a	n/a
BCDL 10.0	Code	IRC2015/TPI2014	Matrix-P					
								Weight: 22 lb FT = 20%

LUMBER-
 TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2
 BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2


BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 6-11-0.
 (lb) - Max Horz 1=-56(LC 6)
 Max Uplift All uplift 100 lb or less at joint(s) except 1=-174(LC 17), 5=-146(LC 18), 2=-145(LC 10), 4=-120(LC 11)
 Max Grav All reactions 250 lb or less at joint(s) 1, 5 except 2=412(LC 17), 4=391(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 174 lb uplift at joint 1, 146 lb uplift at joint 5, 145 lb uplift at joint 2 and 120 lb uplift at joint 4.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

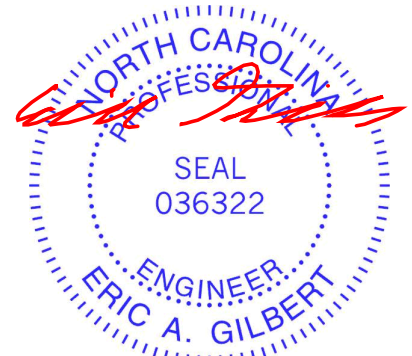

August 16, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

Job 34943A	Truss V1	Truss Type GABLE	Qty 1	Ply 1	54 SERENITY	153629168
---------------	-------------	---------------------	----------	----------	-------------	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.610 s Jul 18 2022 MiTek Industries, Inc. Thu Aug 11 21:25:00 2022 Page 1
ID:nxbot3WsxISjrAw_FcBFB3yorwP-_J7m9_AYR4b7p45OcGWXJtBPwiV3Fc2LTPIFyooU1

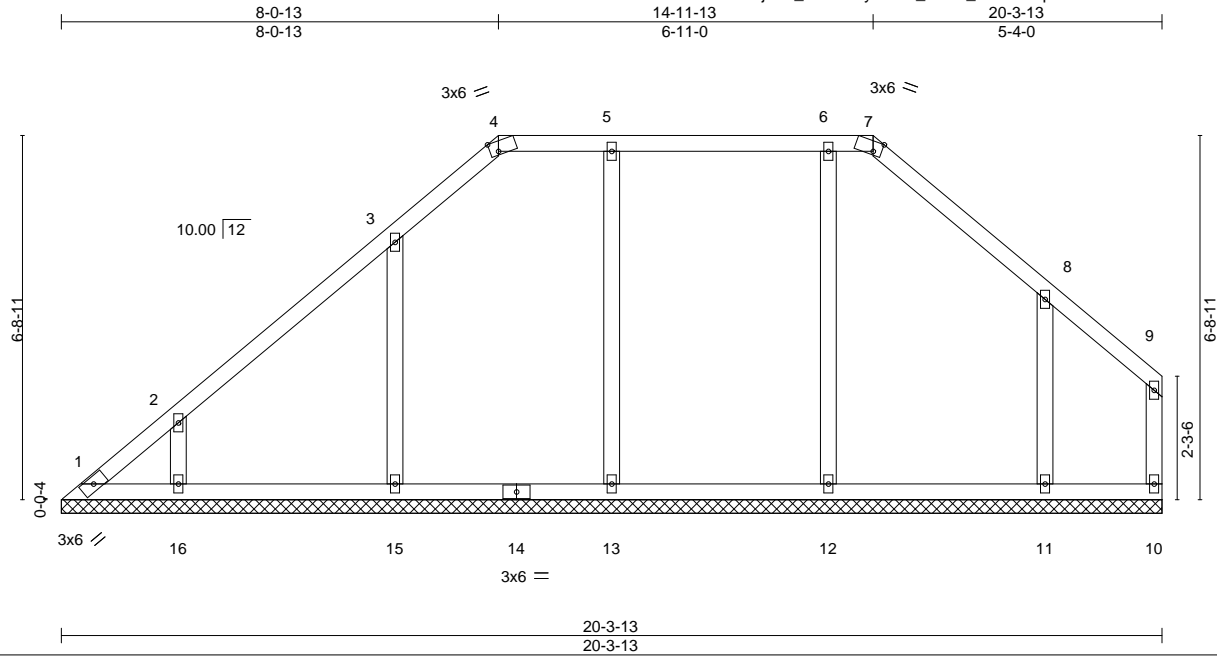

Scale = 1:42.5


Plate Offsets (X,Y)--	[4:0-1-13,Edge], [7:0-1-13,Edge]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.18	Vert(LL) n/a - n/a 999	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.17	Vert(CT) n/a - n/a 999		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.18	Horz(CT) -0.00 10 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S		Weight: 101 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.2 or 2x4 SPF No.2	
OTHERS 2x4 SP No.2 or 2x4 SPF No.2	

REACTIONS. All bearings 20-3-13.
 (lb) - Max Horz 1=158(LC 7)
 Max Uplift All uplift 100 lb or less at joint(s) 1, 13, 15 except 16=125(LC 10), 11=122(LC 11)
 Max Grav All reactions 250 lb or less at joint(s) 1, 10 except 13=409(LC 23), 15=411(LC 17), 16=273(LC 17), 12=409(LC 24), 11=355(LC 18)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 WEBS 3-15=267/122

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 13, 15 except (jt=lb) 16=125, 11=122.

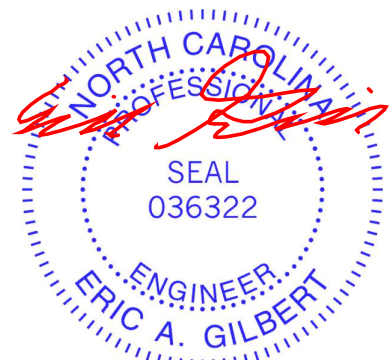

August 16, 2022

Job 34943A	Truss V2	Truss Type GABLE	Qty 1	Ply 1	54 SERENITY	153629169
---------------	-------------	---------------------	----------	----------	-------------	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.610 s Jul 18 2022 MiTek Industries, Inc. Thu Aug 11 21:25:02 2022 Page 1

ID: nxbot3WsxISjrAw_FcBFB3yorwP-xiFXagBozhrg67EUV11_ckzXxkOix9dLonusJYooU?

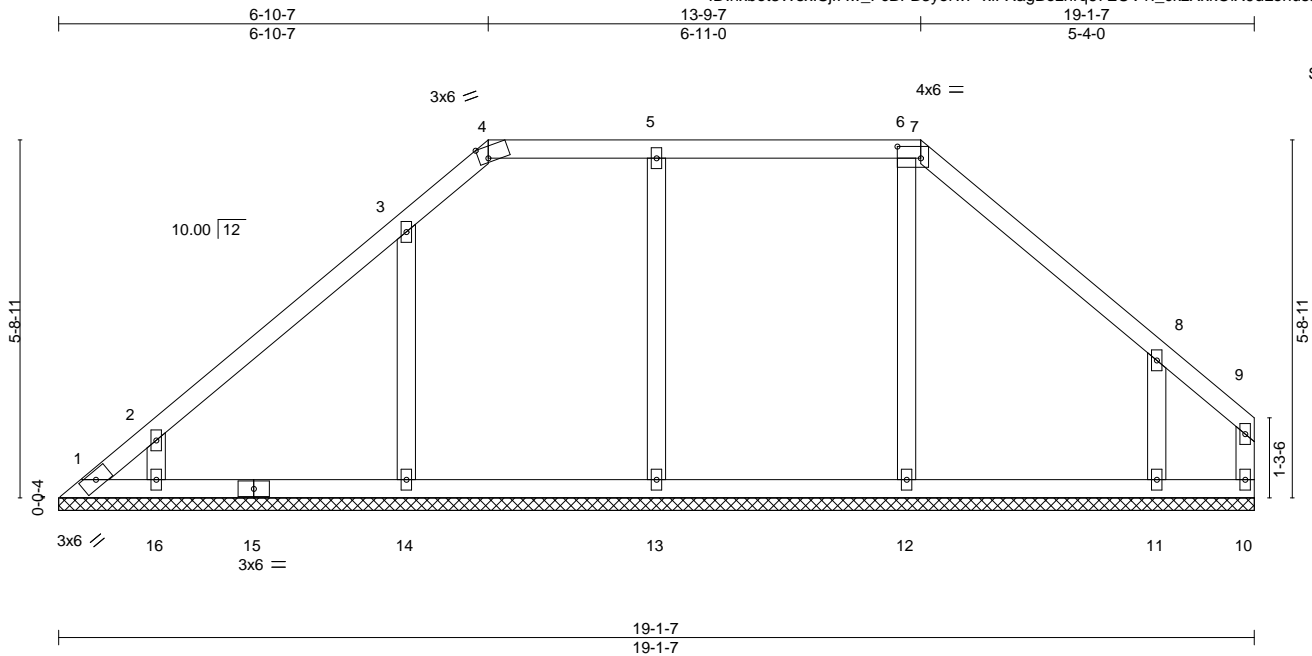


Plate Offsets (X,Y)--	[4:0-1-13,Edge], [7:0-4-8,0-2-4]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.18	Vert(LL) n/a - n/a 999	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.19	Vert(CT) n/a - n/a 999		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.15	Horz(CT) 0.00 10 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S		Weight: 89 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	
OTHERS 2x4 SP No.3	

REACTIONS. All bearings 19-1-7.
 (lb) - Max Horz 1=126(LC 7)
 Max Uplift All uplift 100 lb or less at joint(s) 1, 10, 13, 14 except 16=130(LC 10), 11=171(LC 11)
 Max Grav All reactions 250 lb or less at joint(s) 1, 10 except 13=421(LC 23), 14=386(LC 17), 16=282(LC 17), 12=324(LC 2), 11=295(LC 18)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 WEBS 2-16=251/178

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 10, 13, 14 except (jt=lb) 16=130, 11=171.




August 16, 2022

Job 34943A	Truss V3	Truss Type GABLE	Qty 1	Ply 1	54 SERENITY	153629170
---------------	-------------	---------------------	----------	----------	-------------	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.610 s Jul 18 2022 MiTek Industries, Inc. Thu Aug 11 21:25:03 2022 Page 1

ID:nxbot3WsxISjrAw_FcBFB3yorwP-Pupvo?CQk?zhkHpg3kpD8xVg67k2GczU1RePs_yooU_

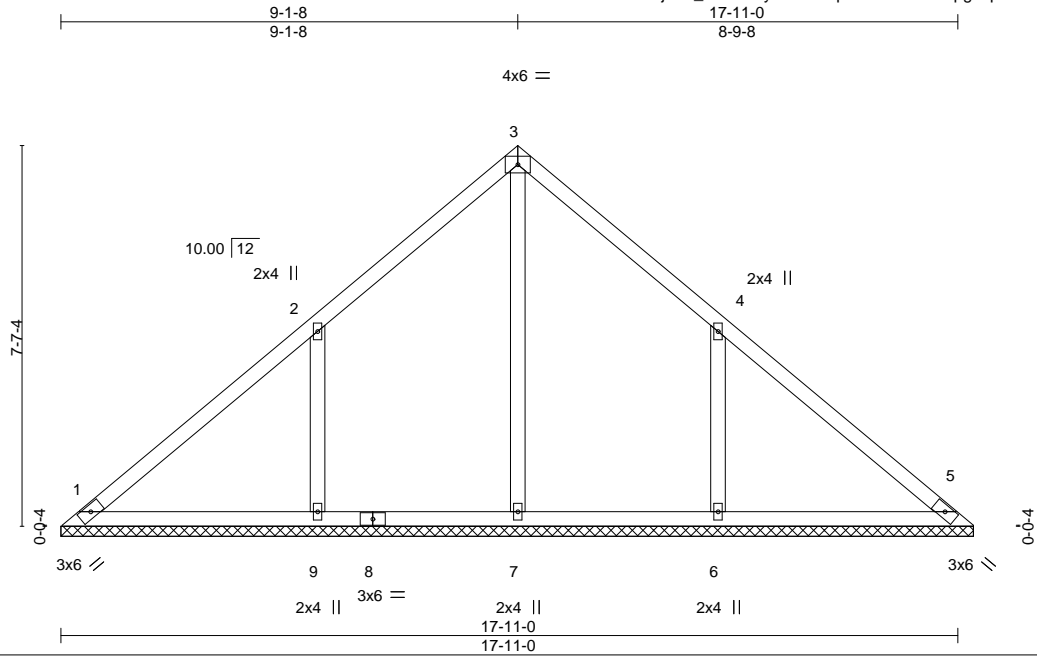

Scale = 1:46.0

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.28	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.18	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.14	Horz(CT)	0.00	5	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S					Weight: 82 lb	FT = 20%


LUMBER-
TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2
BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2
OTHERS 2x4 SP No.2 or 2x4 SPF No.2

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 18-2-12.
(lb) - Max Horz 1=-153(LC 6)
Max Uplift All uplift 100 lb or less at joint(s) 1 except 9=-172(LC 10), 6=-172(LC 11)
Max Grav All reactions 250 lb or less at joint(s) 1, 5 except 7=356(LC 20), 9=506(LC 17), 6=505(LC 18)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 2-9=-336/223, 4-6=-336/222

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1 except (jt=lb) 9=172, 6=172.

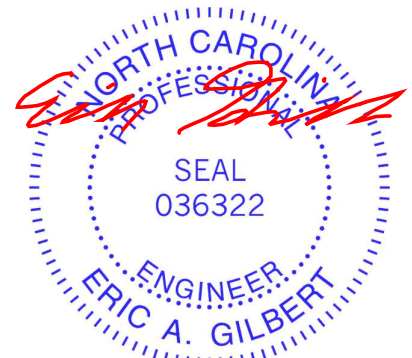

August 16, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932

Job 34943A	Truss V4	Truss Type Valley	Qty 1	Ply 1	54 SERENITY	153629171
---------------	-------------	----------------------	----------	----------	-------------	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.610 s Jul 18 2022 MiTek Industries, Inc. Thu Aug 11 21:25:04 2022 Page 1

ID:nxbot3WsxISjrAw_FcBFB3yorwP-t4NH?LD2VI5YLROtdSKSh92s7X4O74beG5NzNQyooTz

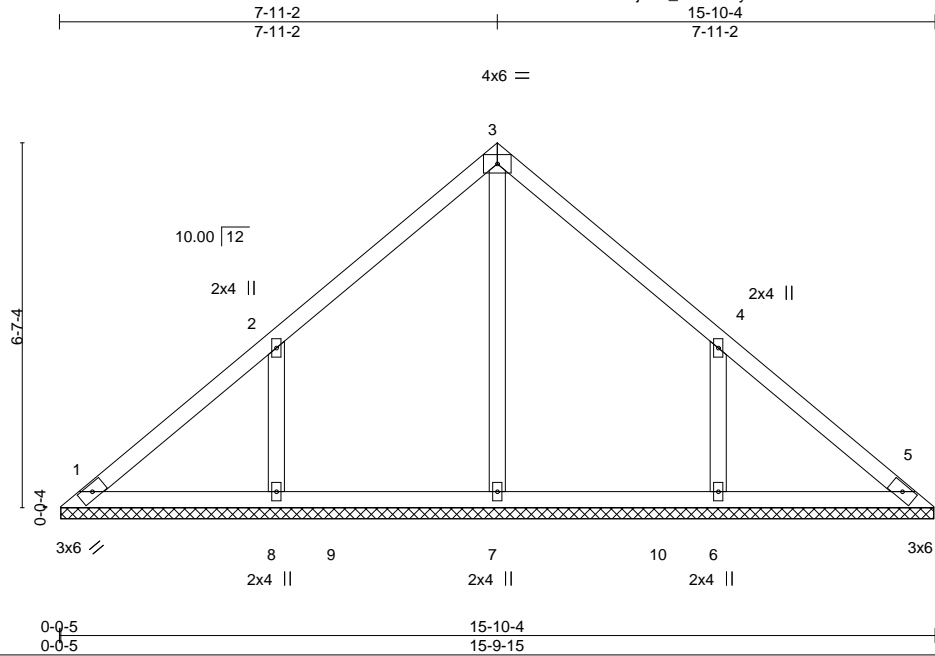

Scale = 1:41.7

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.20	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.17	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.12	Horz(CT)	0.00	5	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-S					Weight: 70 lb	FT = 20%
	Code IRC2015/TPI2014							

LUMBER-
 TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2
 BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2
 OTHERS 2x4 SP No.3

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 15-9-11.
 (lb) - Max Horz 1=-132(LC 6)
 Max Uplift All uplift 100 lb or less at joint(s) 1 except 8=-147(LC 10), 6=-147(LC 11)
 Max Grav All reactions 250 lb or less at joint(s) 1, 5 except 7=352(LC 20), 8=405(LC 17), 6=405(LC 18)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 2-8=-287/191, 4-6=-286/191

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1 except (jt=lb) 8=147, 6=147.



August 16, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601


ENGINEERING BY
TRENCO
 A MiTek Affiliate
 818 Soundside Road
 Edenton, NC 27932

Job 34943A	Truss V5	Truss Type GABLE	Qty 1	Ply 1	54 SERENITY Job Reference (optional)	153629172
---------------	-------------	---------------------	----------	----------	---	-----------

84 Components (Dunn), Dunn, NC - 28334,


8.610 s Jul 18 2022 MiTek Industries, Inc. Thu Aug 11 21:25:05 2022 Page 1

ID:nxbot3WsxISjrAw_FcBFB3yorwP-LHxfChEgGcDPzby3B9shEMb2FxQSkYonV17WvtyooTy



5x12 M18AHS ||

Scale = 1:35.6

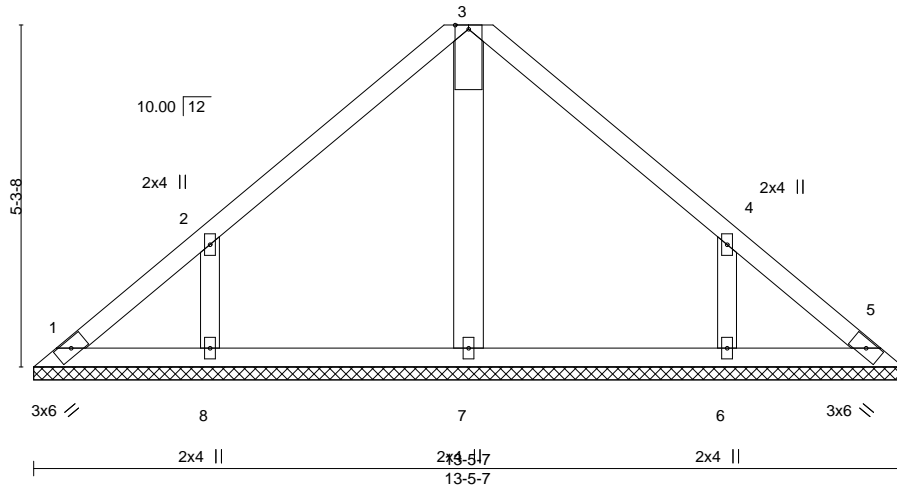

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.18	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.12	Vert(CT)	n/a	-	n/a	M18AHS	142/136
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.06	Horz(CT)	0.00	5	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S						
								Weight: 61 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2
 BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2
 OTHERS 2x4 SP No.3 *Except*
 3-7: 2x6 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


All bearings 13-5-7.
 (lb) - Max Horz 1=-111(LC 6)
 Max Uplift All uplift 100 lb or less at joint(s) 1, 5 except 8=-129(LC 10), 6=-129(LC 11)
 Max Grav All reactions 250 lb or less at joint(s) 1, 5 except 7=265(LC 1), 8=324(LC 17), 6=323(LC 18)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

WEBS 2-8=-253/170, 4-6=-253/170

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- All plates are MT20 plates unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5 except (jt=lb) 8=129, 6=129.

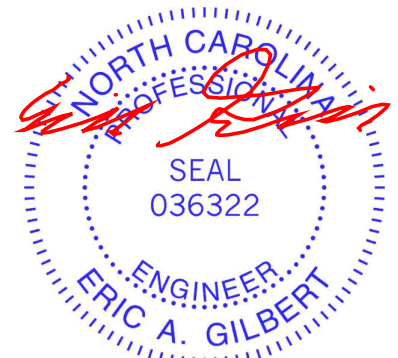

August 16, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

Job 34943A	Truss V6	Truss Type GABLE	Qty 1	Ply 1	54 SERENITY	I53629173
84 Components (Dunn), Dunn, NC - 28334,					Job Reference (optional)	

8.610 s Jul 18 2022 MiTek Industries, Inc. Thu Aug 11 21:25:06 2022 Page 1

ID:nxbot3WsxISjrAw_FcBFB3yorwP-pTV1Q1E1wLGbkXFktNwma7E?LmaT?JxjPs4RJyooTx

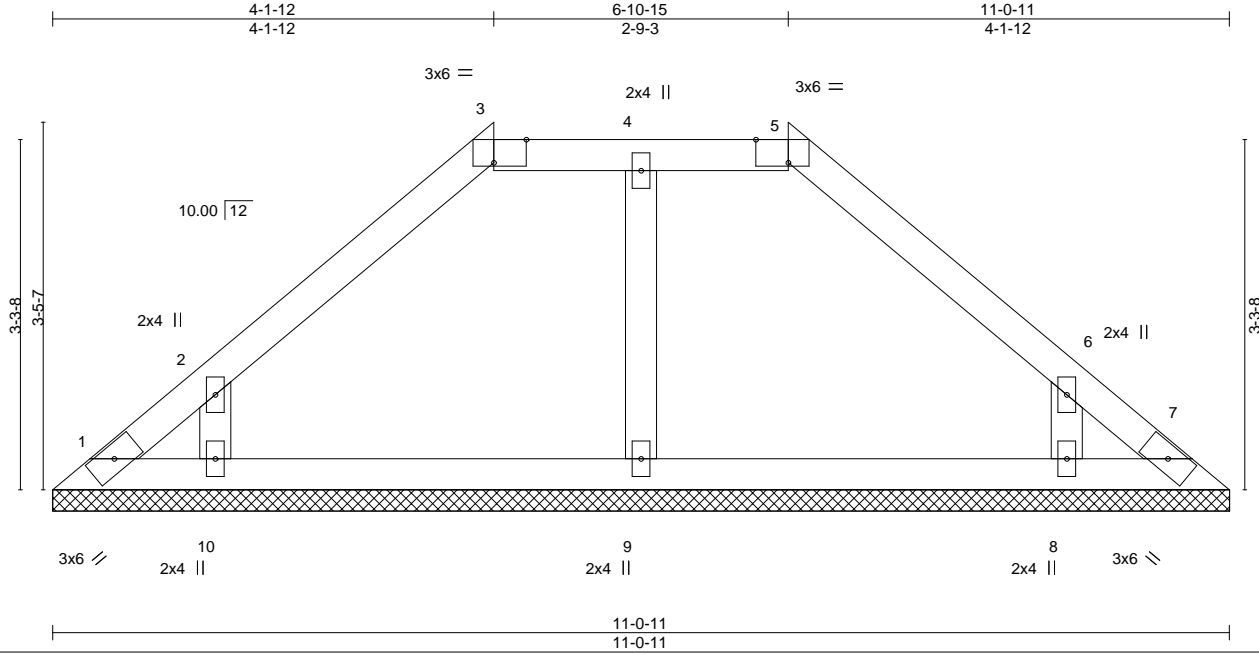


Plate Offsets (X,Y)-- [3:0-3-11,Edge], [5:0-3-11,Edge]


LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.11	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.13	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.04	Horz(CT)	0.00	7	n/a	n/a		
BCDL 10.0	Code	IRC2015/TPI2014	Matrix-S						Weight: 41 lb	FT = 20%

LUMBER-	BRACING-	FLAT TOP CHORD SECTION BRACED AT 24" O.C
TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
OTHERS 2x4 SP No.3		

REACTIONS. All bearings 11-0-11.
 (lb) - Max Horz 1=64(LC 7)
 Max Uplift All uplift 100 lb or less at joint(s) 1, 7, 10, 8
 Max Grav All reactions 250 lb or less at joint(s) 1, 7, 9, 8 except 10=250(LC 17)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCCL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 7, 10, 8.

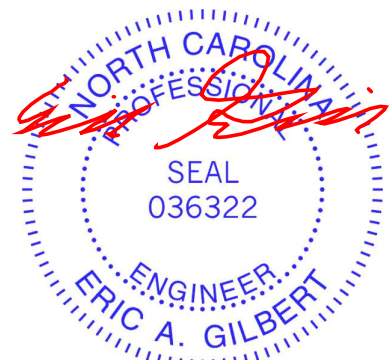


August 16, 2022

Job 34943A	Truss V7	Truss Type GABLE	Qty 1	Ply 1	54 SERENITY	153629174
---------------	-------------	---------------------	----------	----------	-------------	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.610 s Jul 18 2022 MiTek Industries, Inc. Thu Aug 11 21:25:07 2022 Page 1

ID:nxbot3WxslSjrAw_FcBFB3yorwP-Hf2QdNFxoDT7Cu6Rlau9JngPrI5RCSZ4y3cd_lyooTw



Scale: 3/4"=1'

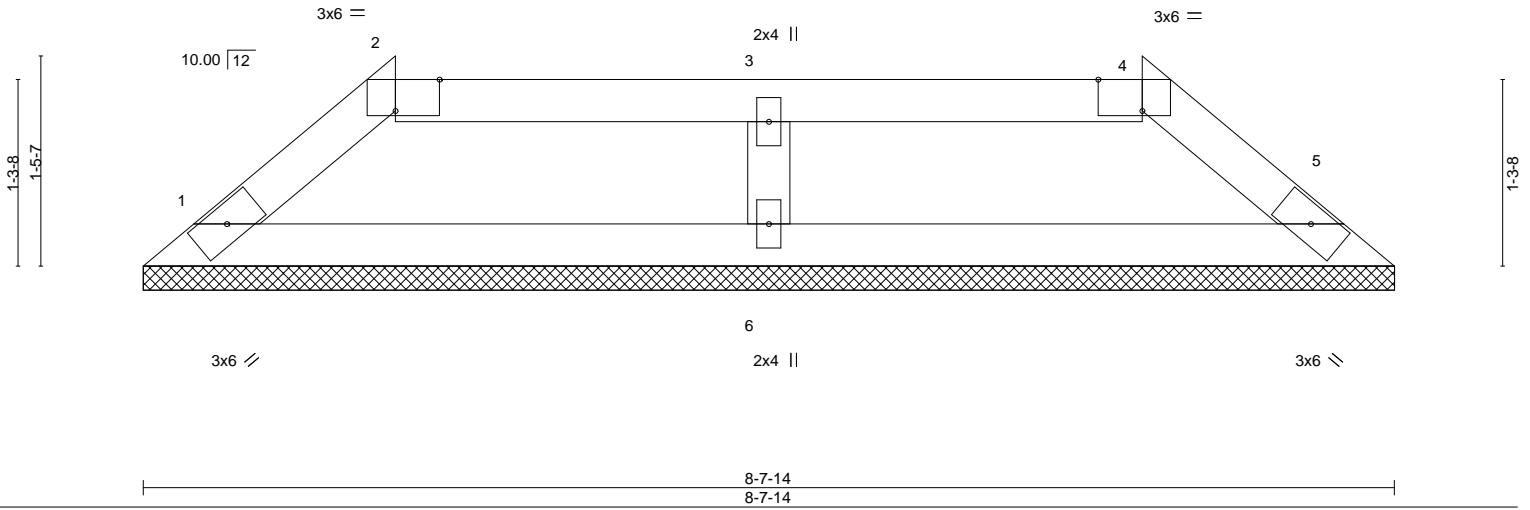


Plate Offsets (X,Y)--	[2:0-3-11,Edge], [4:0-3-11,Edge]							
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.11	Vert(LL) n/a	-	n/a	999	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.15	Vert(CT) n/a	-	n/a	999		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.04	Horz(CT) 0.00	5	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S					Weight: 27 lb	FT = 20%

LUMBER-	BRACING-	FLAT TOP CHORD SECTION BRACED AT 24" O.C
TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.	
BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.	
OTHERS 2x4 SP No.3		

REACTIONS. (size) 1=8-7-14, 5=8-7-14, 6=8-7-14
 Max Horz 1=-22(LC 6)
 Max Uplift 1=-12(LC 10), 5=-12(LC 11), 6=-12(LC 7)
 Max Grav 1=170(LC 1), 5=170(LC 1), 6=288(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCCL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5, 6.




August 16, 2022

Job 34943A	Truss V8	Truss Type Valley	Qty 1	Ply 1	54 SERENITY	153629175
---------------	-------------	----------------------	----------	----------	-------------	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.610 s Jul 18 2022 MiTek Industries, Inc. Thu Aug 11 21:25:08 2022 Page 1
ID:nxbot3WxsISjrAw_FcBFB3yorwP-IscorjGZZXb_q2hesIPOr?DZL8S7xvTEBJLAWByooTv

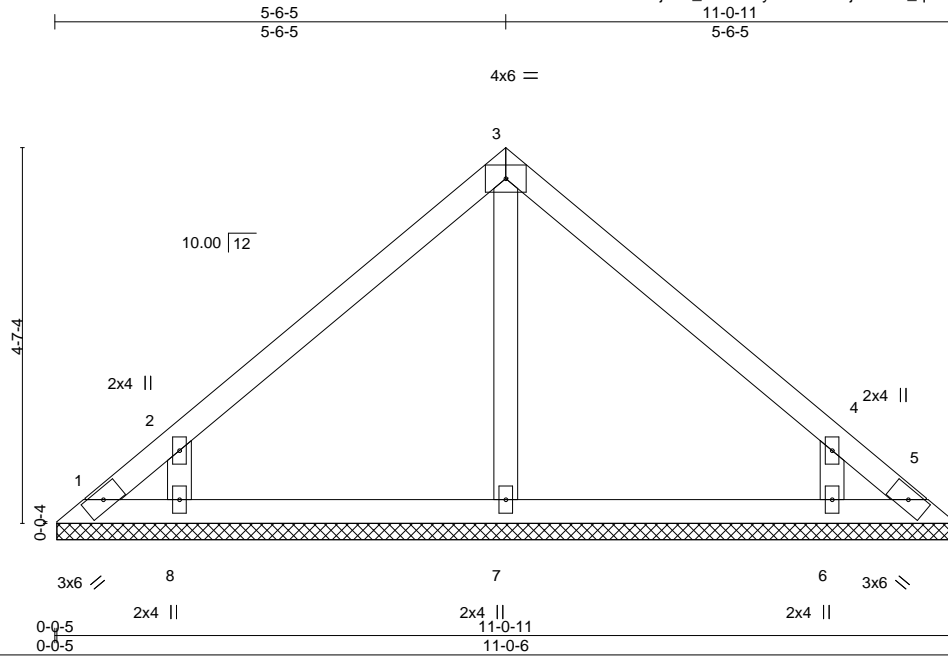

Scale = 1:28.2

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 20.0	Plate Grip DOL	1.15	TC 0.19	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.12	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.06	Horz(CT)	0.00	5	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S						Weight: 44 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2
BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2
OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


All bearings 11-0-1.
(lb) - Max Horz 1=90(LC 6)
Max Uplift All uplift 100 lb or less at joint(s) 1, 5 except 8=133(LC 10), 6=133(LC 11)
Max Grav All reactions 250 lb or less at joint(s) 1, 5, 7 except 8=323(LC 17), 6=323(LC 18)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

WEBS 2-8=-265/181, 4-6=-265/181

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5 except (jt=lb) 8=133, 6=133.

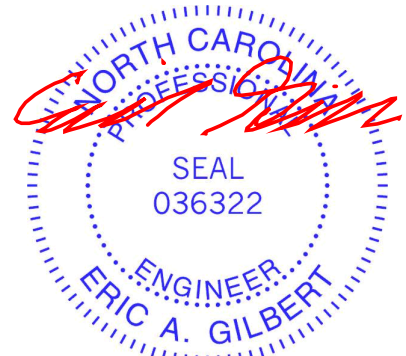

August 16, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932


Job 34943A	Truss V9	Truss Type Valley	Qty 1	Ply 1	54 SERENITY	153629176
---------------	-------------	----------------------	----------	----------	-------------	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.610 s Jul 18 2022 MiTek Industries, Inc. Thu Aug 11 21:25:09 2022 Page 1
ID:nxbot3WsxISjrAw_FcBFB3yorwP-D2AA23HBJrjSCGqQ?wdOCilYnpgMxNPM5k2eyooTu



Scale = 1:24.5

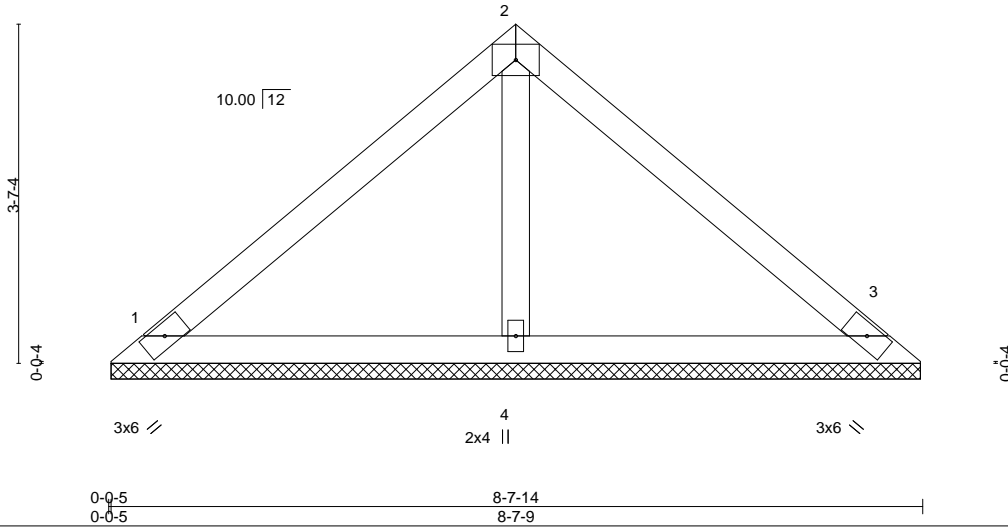

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 20.0	Plate Grip DOL	1.15	TC 0.30	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.16	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.05	Horz(CT)	0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-P						Weight: 32 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2
 BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2
 OTHERS 2x4 SP No.3


BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 1=8-7-4, 3=8-7-4, 4=8-7-4
 Max Horz 1=69(LC 6)
 Max Uplift 1=25(LC 11), 3=34(LC 11)
 Max Grav 1=180(LC 1), 3=180(LC 1), 4=268(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Gable requires continuous bottom chord bearing.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.

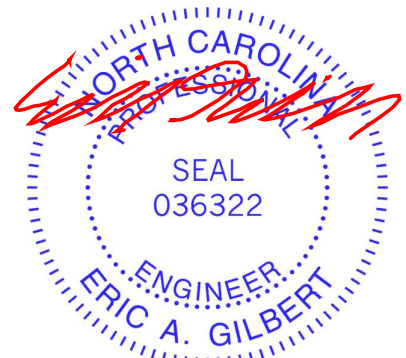

August 16, 2022

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

Job 34943A	Truss V10	Truss Type Valley	Qty 1	Ply 1	54 SERENITY Job Reference (optional)	153629177
---------------	--------------	----------------------	----------	----------	---	-----------


84 Components (Dunn), Dunn, NC - 28334,

8.610 s Jul 18 2022 MiTek Industries, Inc. Thu Aug 11 21:25:01 2022 Page 1

ID: nxbot3Wsx1SjrAw_FcBFB3yorwP-SVh8NKAACNj_UzflyKnl3WQMtK3CokGCa79Jn5yooU0



Scale = 1:18.3

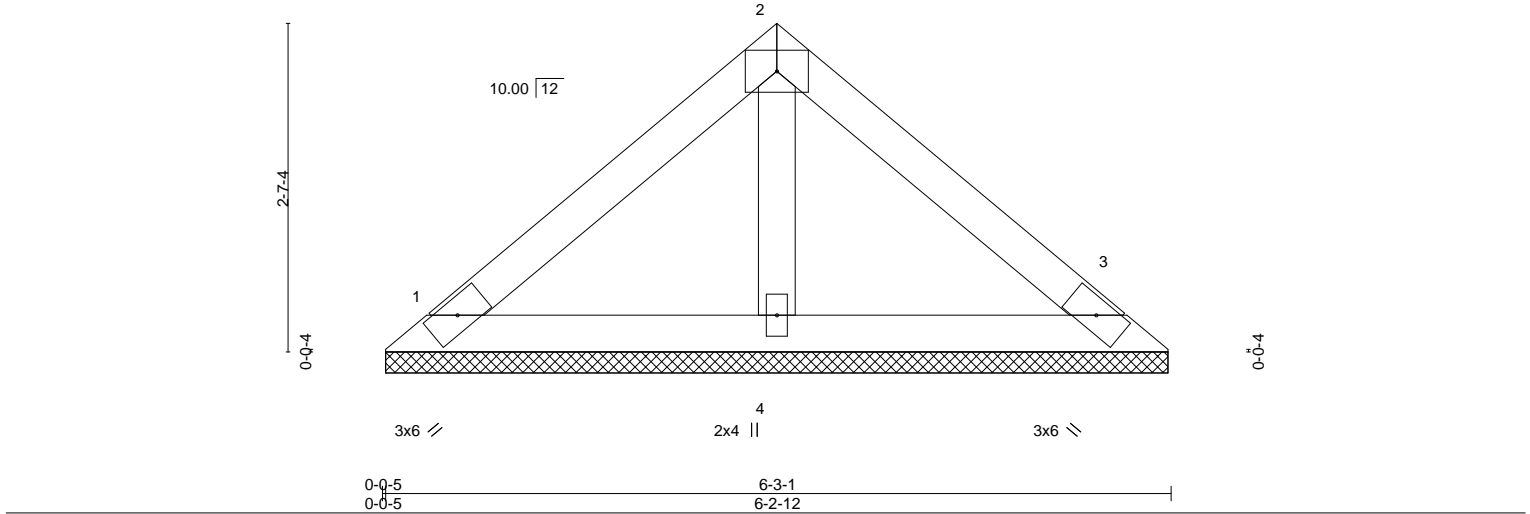


LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.14	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.08	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.03	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-P					Weight: 23 lb	FT = 20%
	Code IRC2015/TPI2014							

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2 or 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x4 SP No.2 or 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
OTHERS 2x4 SP No.3	

REACTIONS. (size) 1=6-2-7, 3=6-2-7, 4=6-2-7
 Max Horz 1=48(LC 9)
 Max Uplift 1=-17(LC 11), 3=-23(LC 11)
 Max Grav 1=125(LC 1), 3=125(LC 1), 4=186(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.


- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Gable requires continuous bottom chord bearing.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.




August 16, 2022

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.

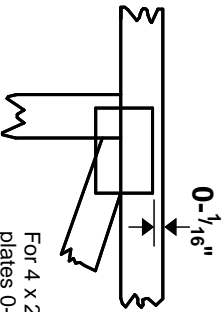

For 4 x 2 orientation, locate plates 0- 1/16" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

* Plate location details available in **MITek 20/20 software** or upon request.

PLATE SIZE

4 X 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur. Min size shown is for crushing only.

Industry Standards:

ANSI/TPI 1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-89: Design Standard for Bracing, Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

6-4-8
dimensions shown in ft-in-sixteenths
(Drawings not to scale)

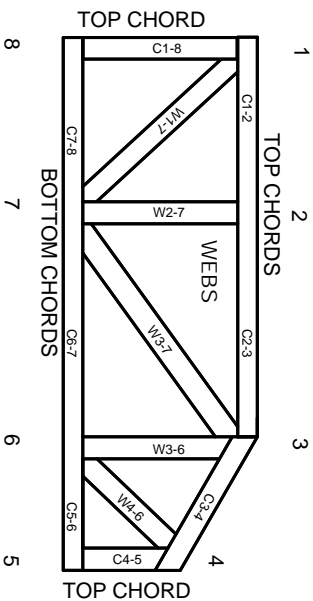

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ESR1988
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TPI 1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MITteK® All Rights Reserved



MITek Engineering Reference Sheet: Mill-7473 rev. 5/19/2020



General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TPI 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TPI 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TPI 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.