

North Carolina 2018 - R402.1.5 Total UA



Property
 , NC 27546
 Model: Azalea

Organization
 Southern Energy Manager
 Justin Smith

Inspection Status
 Results are projected

Garman Homes - Azalea 1850 plan
 - CZ 4 slab - ecoSelect
 Azalea plan

Builder
 Garman Homes

This report is based on a proposed design and does not confirm field enforcement of design elements.

Building UA

Elements	NC Reference	As Designed
Ceilings	35.1	33.3
Above-Grade Walls	170.8	161.1
Windows, Doors and Skylights	96.0	78.5
Slab Floor:	75.1	97.6
Framed Floors	0.3	0.3
Foundation Walls	0.0	0.0
Rim Joists	6.7	6.6
Overall UA (Design must be equal or lower):	384.0	377.4

Requirements

✓	R402.1.5	Total UA alternative compliance passes by 1.7%. The proposed home meets the UA requirement by 1.7%
✓	402.3.2	Average SHGC: 0.30 Max SHGC: 0.30 Average SHGC of 0.30 is greater than the maximum of 0.30.
✓	R402.4.2.2	Air Leakage Testing Air sealing is 0.28 CFM50 / ft ² Shell Area. It must not exceed 0.30 CFM50 / ft ² Shell Area.
✓	R402.5	Area-weighted average fenestration SHGC Area-weighted average fenestration SHGC is 0.3. The maximum allowed value is [No Limit].
✓	R402.5	Area-weighted average fenestration U-Factor
✓	R404.1	Lighting Equipment At least 75.0% of fixtures shall be high-efficacy lamps, currently 100.0% are high-efficacy.
✓	Mandatory Checklist	Mandatory code requirements that are not checked by Ekotrope must be met. 2015 IECC Mandatory Checklist must be checked as complete.
✓	R403.3.1	Duct Insulation Duct insulation meets the requirements specified in North Carolina 2018 Code Section 403.3.1.
✓	403.3.3	Duct Testing

Design exceeds requirements for North Carolina 2018 Prescriptive compliance by 1.7%.

Name: Justin Smith
 Organization: Southern Energy Management

Signature: Justin Smith
 Digitally signed: 9/26/22 at 9:50 AM

Ekotrope RATER - Version 4.0.1.2996

North Carolina 2018 Prescriptive compliance results calculated using Ekotrope RATER's energy and code compliance algorithm, including appropriate amendments.
 Ekotrope RATER is a RESNET Accredited HERS Rating Tool. All results are based on data entered by Ekotrope users.
 Ekotrope disclaims all liability for the information shown on this report.

Building Summary



SOUTHERN ENERGY
MANAGEMENT
ENERGY EFFICIENCY & SOLAR POWER

Property
NC 27546
Model: Azalea

Organization
Southern Energy Management
Justin Smith

Inspection Status
Results are projected

Garman Homes - Azalea 1850 plan - CZ 4 slab -
ecoSelect
Azalea plan

Builder
Garman Homes

General Building Information

Number Of Bedrooms	3
Number Of Floors	2
Conditioned Floor Area [sq. ft.]	1,850
Has Electric Vehicle Ready Space	No
Unconditioned, attached garage?	Yes
Conditioned Volume [cu. ft.]	17,539
Total Units in Building	1
Residence Type	Single family detached
Number of Floors in Building	-
Floor Number	-
Model	Azalea
Community	
RESNET/IECC 2006 Climate Zone	4A
IECC 2021 Climate Zone	3A

Foundation Wall

None Present

Foundation Wall Library List

None Present

Slab

Name	Library Type	Perimeter	Floor Grade	Carpet R	Exposed Masonry Area	Surface Area	Location	Enclosing
slab	Uninsulated	157	On Grade	1	0	1,163.0 ft²	Exposed Exterior	Conditioned Space

Slab Library List

Name	Wall Construction Type	Slab Completely Insulated?	Underslab Insulation Width [ft]	Perimeter Insulation Depth [ft]	Perimeter Insulation R Value	Thermal Break	Effective R-value
Uninsulated	Wood Frame / Other	No	0	0	0	No	0.00

Building Summary



SOUTHERN ENERGY
MANAGEMENT
ENERGY EFFICIENCY & SOLAR POWER

Property
NC 27546
Model: Azalea

Organization
Southern Energy Management
Justin Smith

Inspection Status
Results are projected

Garman Homes - Azalea 1850 plan - CZ 4 slab -
ecoSelect
Azalea plan

Builder
Garman Homes

Framed Floor

Name	Library Type	Carpet R	Floor Grade	Surface Area	Location
over ambient	R 19, 16"OC G1 Hardwood	0	Above Grade	6.0 ft ²	Exposed Exterior

Framed Floor Library List

Name	Effective R-value
R 19, 16"OC G1 Hardwood	18.371

Rim Joist

Name	Library Type	Surface Area	Location
1st floor ambient	R 15 G1, 16"OC	91.0 ft ²	Exposed Exterior
1st floor garage	R 15 G1, 16"OC	29.0 ft ²	Unconditioned, attached garage

Rim Joist Library List

Name	Effective Insulation R-value
R 15 G1, 16"OC	13.30

Wall

Name	Library Type	Surface Color	Surface Area	Location
1st floor ambient	R 15 Adv. Framing G1 16" O.C	Medium	1,152.0 ft ²	Exposed Exterior
1st floor garage	R 15 Adv. Framing G1 16" O.C	Medium	261.0 ft ²	Unconditioned, attached garage
2nd floor ambient	R 15 Adv. Framing G1 16" O.C	Medium	828.0 ft ²	Exposed Exterior
2nd floor attic	R 15 Adv. Framing G1 16" O.C	Medium	252.0 ft ²	Attic

Building Summary



SOUTHERN ENERGY
MANAGEMENT
ENERGY EFFICIENCY & SOLAR POWER

Property
NC 27546
Model: Azalea

Organization
Southern Energy Management
Justin Smith

Inspection Status
Results are projected

Garman Homes - Azalea 1850 plan - CZ 4 slab -
ecoSelect
Azalea plan

Builder
Garman Homes

Wall Library List

Name	Effective R-value
R 15 Adv. Framing G1 16" O.C	13.771

Glazing

Name	Library Type	Wall Assignment	Foundation Wall Assignment	Is Operable	Overhang Depth	Overhang Ft To Top	Overhang Ft To Bottom	Orientation	Surface Area
front 2nd unshaded	30/30	2nd floor ambient		Yes	0	0	0	West	41.3 ft ²
front shaded	30/30	1st floor ambient		Yes	6	1	7	West	36.0 ft ²
left 2nd unshaded	30/30	2nd floor ambient		Yes	0	0	0	North	23.0 ft ²
left unshaded	30/30	1st floor ambient		Yes	0	0	0	North	8.0 ft ²
rear 2nd unshaded	30/30	2nd floor ambient		Yes	0	0	0	East	30.0 ft ²
rear unshaded	30/30	1st floor ambient		Yes	0	0	0	East	90.0 ft ²
right unshaded	30/30	1st floor ambient		Yes	0	0	0	South	8.0 ft ²

Glazing Library List

Name	Shgc	U-factor
30/30	0.3	0.300

Skylight

None Present

Skylight Library List

None Present

Building Summary



**SOUTHERN ENERGY
MANAGEMENT**
ENERGY EFFICIENCY & SOLAR POWER

Property
NC 27546
Model: Azalea

Organization
Southern Energy Management
Justin Smith

Inspection Status
Results are projected

Garman Homes - Azalea 1850 plan - CZ 4 slab -
ecoSelect
Azalea plan

Builder
Garman Homes

Opaque Door

Name	Library Type	Wall Assignment	Foundation Wall Assignment	Emittance	Solar Absorptance	Surface Color	Surface Area	Location
front door	Fiberglass R-5	1st floor ambient		0.9	0.75	Medium	20.0 ft²	Exposed Exterior
garage door	Fiberglass R-5	1st floor garage		0.9	0.75	Medium	18.0 ft²	Unconditioned, attached garage

Opaque Door Library List

Name	Effective U-factor
Fiberglass R-5	0.200

Roof Insulation

Name	Library Type	Attic Exterior Area [ft²]	Clay or Concrete Roof Tiles	Surface Color	Surface Area	Location
attic	R 38 Attic BLOWN FG G1 2x10 24"OC NO Radiant Barrier	1,718.43	No	Dark	1,169.0 ft²	Attic

Roof Insulation Library List

Name	Has Radiant Barrier	Effective R-value
R 38 Attic BLOWN FG G1 2x10 24"OC NO Radiant Barrier	No	35.115

Whole House Infiltration

Infiltration	Measurement Type	Shelter Class
1403 CFM at 50 Pa	Blower-door tested	4

Mechanical Ventilation

Ventilation Type	Ventilation Rate [ft³ / Minute]	Operational hours per day	Fan Watts	Runs once every three hours	Energy Recovery Percent	Model Number	Manufacturer
Exhaust Only	147 CFM	8	51.45 Watts (Default)	Yes	0		

Building Summary



Property
NC 27546
Model: Azalea


Organization
Southern Energy Management
Justin Smith

Inspection Status
Results are projected

Garman Homes - Azalea 1850 plan - CZ 4 slab -
ecoSelect
Azalea plan

Builder
Garman Homes

Lighting

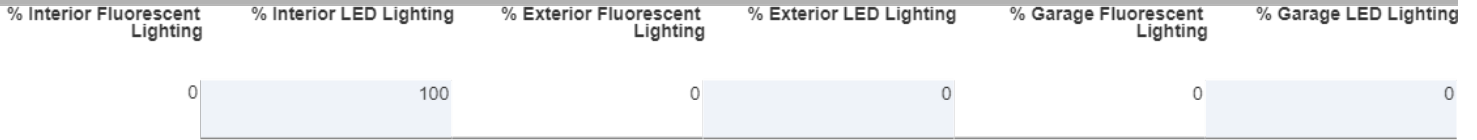

Onsite Generation

None Present

Onsite Generation Library List

None Present

Solar Generation

None Present

Dehumidifier

None Present

Dehumidifier Library List

None Present

Whole House Fan

None Present

Building Summary



Property
 , NC 27546
 Model: Azalea

Organization
 Southern Energy Management
 Justin Smith

Inspection Status
 Results are projected

Garman Homes - Azalea 1850 plan - CZ 4 slab -
 ecoSelect
 Azalea plan

Builder
 Garman Homes

Whole House Fan Library List

None Present

Conditioning Equipment

Name	Library Type	Serial Number	Heating Percent Load	Cooling Percent Load	Hot Water Percent Load	Location
Water Heater	RL94e (NG)		0%	0%	100%	Unconditioned Garage
whole house a/c	z 14 SEER A/C 3 ton		0%	100%	0%	Attic
whole house furnace	z 93 AFUE Gas Furn 48k		100%	0%	0%	Attic

Equipment Type: RL94e (NG)

Equipment Type	Residential Water Heater
Fuel Type	Natural Gas
Distribution Type	Hydronic Delivery (Radiant)
Hot Water Efficiency	0.81 Energy Factor
Tankless?	Yes

Equipment Type: z 14 SEER A/C 3 ton

Equipment Type	Air Conditioner
Fuel Type	Electric
Distribution Type	Forced Air
Motor Type	PSC (Single Speed)
Cooling Efficiency	14 SEER
Cooling Capacity [kBtu/h]	36

Equipment Type: z 93 AFUE Gas Furn 48k

Equipment Type	Furnace
Fuel Type	Natural Gas
Distribution Type	Forced Air
Motor Type	PSC (Single Speed)
Heating Efficiency	93 AFUE
Heating Capacity [kBtu/h]	48
Use default EAE	No
EAE [kWh]	411

Building Summary

Property
 , NC 27546
 Model: Azalea

Garman Homes - Azalea 1850 plan - CZ 4 slab -
 ecoSelect
 Azalea plan

Organization
 Southern Energy Management
 Justin Smith

Builder
 Garman Homes

Inspection Status
 Results are projected



SOUTHERN ENERGY
MANAGEMENT
 ENERGY EFFICIENCY & SOLAR POWER

Distribution System

Distribution Type	Forced Air
Heating Equipment	whole house furnace
Cooling Equipment	whole house a/c
Sq. Feet Served	1,850
# Return Grilles	2
Supply Duct R Value	8
Return Duct R Value	8
Supply Duct Area [ft ²]	499.5
Return Duct Area [ft ²]	185
Leakage to Outdoors	74 CFM @ 25Pa (4 / 100 ft ²)
Total Leakage	74 CFM25
Total Leakage Duct Test Conditions	Post-Construction
Use Default Flow Rate	Yes
Duct 1	
Duct Location	Attic (well vented)
Percent Supply Area	80
Percent Return Area	80
Duct 2	
Duct Location	Conditioned Space
Percent Supply Area	20
Percent Return Area	20
Duct 3	
Duct Location	Conditioned Space
Percent Supply Area	0
Percent Return Area	0
Duct 4	
Duct Location	Conditioned Space
Percent Supply Area	0
Percent Return Area	0
Duct 5	
Duct Location	Conditioned Space
Percent Supply Area	0
Percent Return Area	0
Duct 6	
Duct Location	Conditioned Space
Percent Supply Area	0
Percent Return Area	0

HVAC Grading

HVAC Grading Not Conducted

Ceiling Fan

Has Ceiling Fan	No
Cfm Per Watt	100

Building Summary



Property
. NC 27546
Model: Azalea

Organization
Southern Energy Management
Justin Smith

Inspection Status
Results are projected

Garman Homes - Azalea 1850 plan - CZ 4 slab -
ecoSelect
Azalea plan

Builder
Garman Homes

Water Distribution

Water Fixture Type	Standard
Use Default Hot Water Pipe Length	No
Hot Water Pipe Length [ft]	79
At Least R3 Pipe Insulation?	No
Hot Water Recirculation System?	No
Recirculation System Pipe Loop Length [ft]	170
Drain Water Heat Recovery?	No

Clothes Dryer

Cef	3.01
Fuel Type	Electric
Field Utilization	Timer Controls
Is Outside Conditioned Space	No
Clothes Dryer Available	Yes
Defaults Type	HERS Reference

Clothes Washer

Label Energy Rating	153 kWh/Year
Annual Gas Cost	\$12.00
Electric Rate	\$0.11/kWh
Gas Rate	\$1.22/Therm
Capacity	3.31
Imef	2.1547
Defaults Type	Custom
Load Type	Front-load
Loads Per Week	6
Is Outside Conditioned Space	No
Clothes Washer Available	Yes

Dishwasher

Dishwasher Efficiency	270 kWh
Dishwasher Size	Standard
Annual Gas Cost	\$22.23
Electric Rate	\$0.12/kWh
Gas Rate	\$1.09/Therm
Is Outside Conditioned Space	No

Appliances and Controls

Programmable thermostat?	Yes
Range/Oven Fuel	Electric
Convection Oven?	No
Induction Range?	No
Range/Oven Outside Conditioned Space?	No
Refrigerator Consumption	538 kWh/Year
Refrigerator Outside Conditioned Space?	No

Building Summary

Property
NC 27546
Model: Azalea

Garman Homes - Azalea 1850 plan - CZ 4 slab -
ecoSelect
Azalea plan

Organization
Southern Energy Management
Justin Smith

Builder
Garman Homes

Inspection Status
Results are projected



SOUTHERN ENERGY
MANAGEMENT
ENERGY EFFICIENCY & SOLAR POWER

Notes

Initial inputs by __AT 5/4/2022__

- confirm window specs
- ventilation modeled as exhaust, confirm this is accurate
- confirm cfl lighting percentage
- modeled to worst case orientation