

Trenco
818 Soundside Rd
Edenton, NC 27932

Re: 34999-34999A
4 SERENITY - ROOF

The truss drawing(s) referenced below have been prepared by Truss Engineering Co. under my direct supervision based on the parameters provided by 84 Components - #2383.

Pages or sheets covered by this seal: I56455752 thru I56455778

My license renewal date for the state of North Carolina is December 31, 2023.

North Carolina COA: C-0844



February 3, 2023

Liu, Xuegang

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

Job	Truss	Truss Type	Qty	Ply	4 SERENITY - ROOF	I56455752
34999-34999A	A1GE	Roof Special Supported Gable	1	1	Job Reference (optional)	

84 Components (Dunn), Dunn, NC - 28334,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Feb 2 13:46:26 2023 Page 1

ID:nxbot3WsxISjAw_FcBFB3yorwP-wazjBtt?v?rUjJulHRRvvDG52uiT9hYxgaNFaOzp9bh

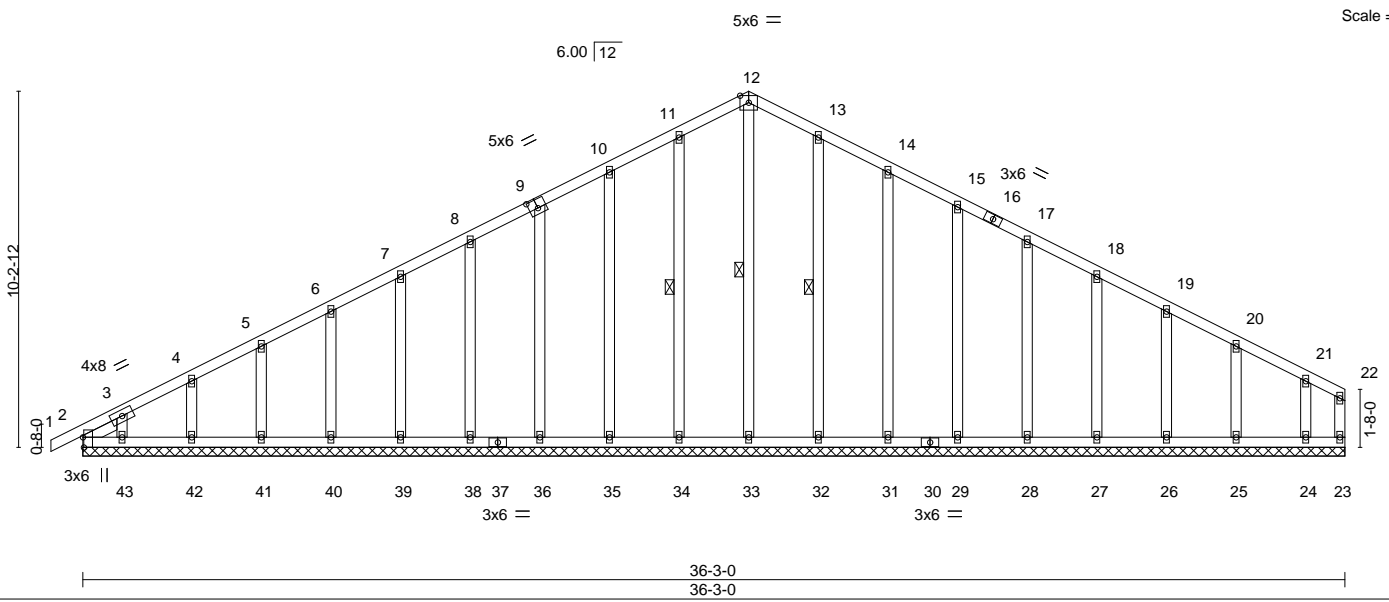


Plate Offsets (X,Y)-- [2:0-3-8,Edge], [9:0-3-0,0-3-0]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.08	Vert(LL) -0.00	1	n/r	120	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.05	Vert(CT) -0.00	1	n/r	90		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.14	Horz(CT) 0.00	23	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S						
							Weight: 258 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6'-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10'-0-0 oc bracing.
WEBS 2x4 SP No.3	WEBS 1 Row at midpt 12-33, 11-34, 13-32
OTHERS 2x4 SP No.3 *Except* 12-33,11-34,10-35,9-36,13-32,14-31,15-29: 2x4 SP No.2	
SLIDER Left 2x4 SP No.3 1-1-6	

REACTIONS. All bearings 36-3-0.
 (lb) - Max Horz 2=148(LC 10)
 Max Uplift All uplift 100 lb or less at joint(s) 2, 34, 35, 36, 38, 39, 40, 41, 42, 43, 32, 31, 29, 28, 27, 26, 25, 24
 Max Grav All reactions 250 lb or less at joint(s) 23, 2, 33, 34, 35, 36, 38, 39, 40, 41, 42, 43, 32, 31, 29, 28, 27, 26, 25, 24

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 10-11=-114/272, 11-12=-127/308, 12-13=-127/308, 13-14=-114/272

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCCL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Gable studs spaced at 2'-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-6-0 tall by 2'-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 34, 35, 36, 38, 39, 40, 41, 42, 43, 32, 31, 29, 28, 27, 26, 25, 24.



February 3, 2023

Job	Truss	Truss Type	Qty	Ply	4 SERENITY - ROOF	156455753
34999-34999A	A2	Roof Special	1	1	Job Reference (optional)	

84 Components (Dunn), Dunn, NC - 28334,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Feb 2 13:46:27 2023 Page 1
ID:nxbot3WsxISjrAw_FcBFB3yorwP-OnX5ODudgJzLLTTr8y8RRp9KHqyu3f4vE6o6qzp9bg

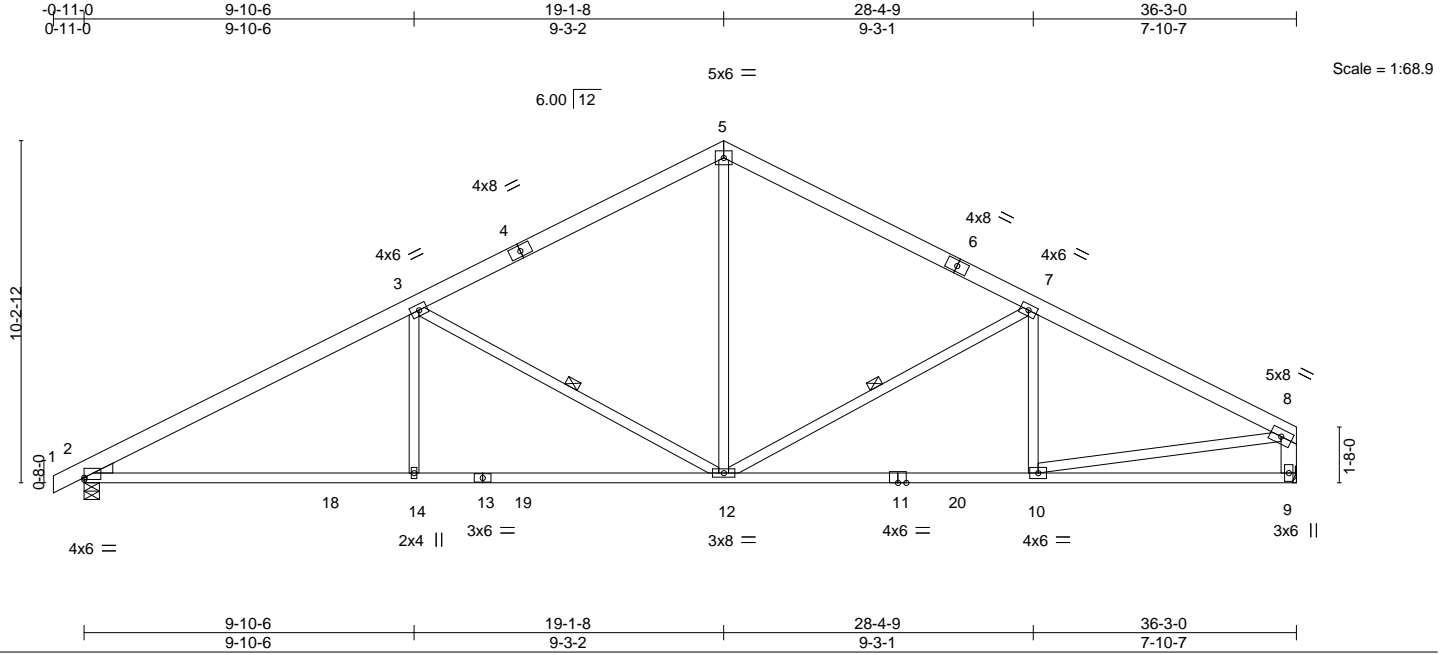


Plate Offsets (X,Y)-- [2:0-0-0,0-0-11]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.49	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.93	Vert(LL) -0.15 14-17 >999 240		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.47	Vert(CT) -0.33 14-17 >999 180		
BCDL 10.0	Rep Stress Incr YES	Matrix-MS	Horz(CT) 0.09 9 n/a n/a		
	Code IRC2015/TPI2014			Weight: 225 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.2	TOP CHORD Structural wood sheathing directly applied or 4-2-7 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing.
WEBS 2x4 SP No.2 *Except* 3-14,7-10: 2x4 SP No.3, 8-9: 2x6 SP No.2	WEBS 1 Row at midpt 3-12, 7-12
WEDGE Left: 2x4 SP No.3	

REACTIONS. (size) 2=0-5-8, 9=Mechanical
 Max Horz 2=150(LC 14)
 Max Uplift 2=-100(LC 10), 9=-71(LC 11)
 Max Grav 2=1497(LC 1), 9=1440(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-2470/412, 3-5=-1649/368, 5-7=-1646/367, 7-8=-2064/359, 8-9=-1371/260
 BOT CHORD 2-14=-262/2099, 12-14=-262/2099, 10-12=-207/1767
 WEBS 3-14=0/377, 3-12=-908/253, 5-12=-105/859, 7-12=-548/190, 8-10=-199/1635

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCCL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Refer to girder(s) for truss to truss connections.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 9 except (jt=lb) 2=100.




February 3, 2023

Job	Truss	Truss Type	Qty	Ply	4 SERENITY - ROOF	156455754
34999-34999A	A3	Common	5	1	Job Reference (optional)	

84 Components (Dunn), Dunn, NC - 28334,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Feb 2 13:46:29 2023 Page 1

ID:nxbot3Wwsx1SjrAw_FcFB3yorwP-K9erpvvtCwD3amdJyZ_cXsuVn5X2MydNNXbvBjzp9be



5x8 =

Scale = 1:66.2

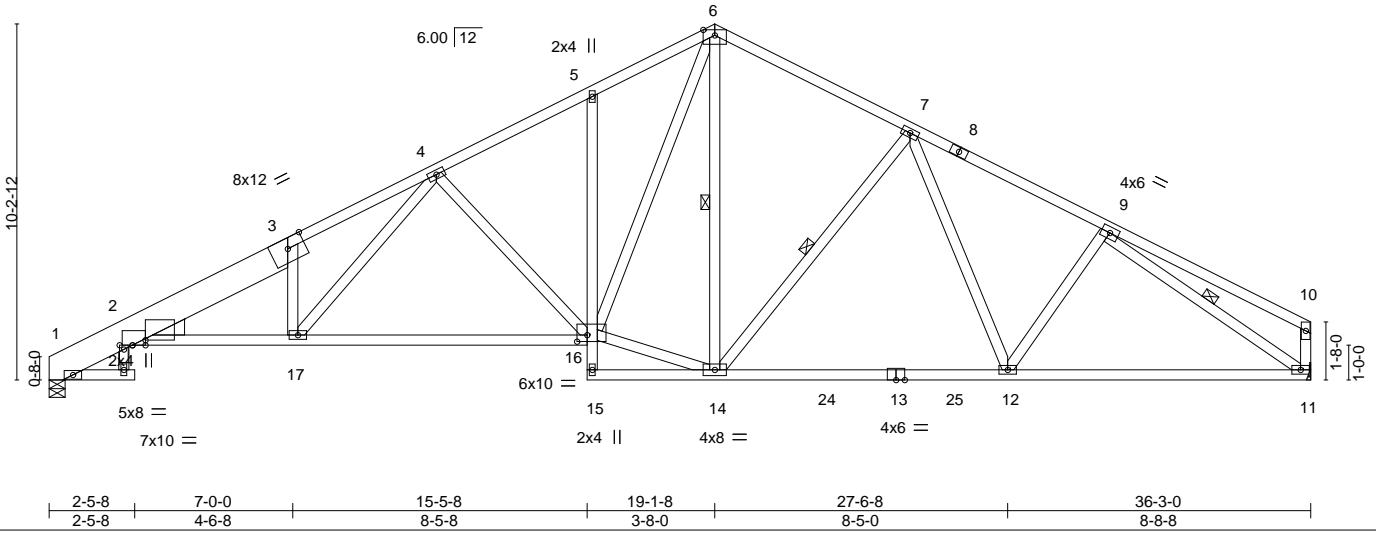


Plate Offsets (X,Y)-- [2:0-4-8,0-0-0], [2:0-4-8,0-1-12], [16:0-3-8,0-2-4], [19:0-1-8,0-1-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.49	Vert(LL) -0.23	12-14	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.83	Vert(CT) -0.47	16-17	>917	180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.56	Horz(CT) 0.18	11	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-MS						
							Weight: 247 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2 *Except*
1-3: 2x10 SP DSS
BOT CHORD 2x4 SP No.2 *Except*
2-16: 2x4 SP No.1
WEBS 2x4 SP No.2 *Except*
3-17,14-16,9-12,10-11: 2x4 SP No.3
OTHERS 2x4 SP No.3
WEDGE
Left: 2x6 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-1-8 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 1 Row at midpt 6-14, 7-14, 9-11

REACTIONS.

(size) 1=0-5-8, 11=Mechanical
Max Horz 1=140(LC 14)
Max Uplift 1=-74(LC 10), 11=-71(LC 11)
Max Grav 1=1452(LC 1), 11=1436(LC 1)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=-641/113, 2-3=-3093/454, 3-4=-3216/562, 4-5=-2055/414, 5-6=-2025/490, 6-7=-1550/385, 7-9=-1918/385
BOT CHORD 2-17=-341/2856, 16-17=-248/2219, 12-14=-141/1587, 11-12=-212/1631
WEBS 3-17=-534/194, 4-17=-129/949, 4-16=-648/194, 14-16=0/1360, 6-16=-231/1250, 6-14=-90/281, 7-14=-484/178, 7-12=-6/270, 9-11=-1896/280

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCCL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- All plates are 3x6 MT20 unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Refer to girder(s) for truss to truss connections.
- Bearing at joint(s) 1 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 11.



February 3, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	4 SERENITY - ROOF	156455755
34999-34999A	A4	COMMON	1	1	Job Reference (optional)	

84 Components (Dunn), Dunn, NC - 28334,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Feb 2 13:46:30 2023 Page 1

ID:nxbot3WsxISjrAw_FcBFB3yorwP-pMCE1FwWzELwCwCWWHvr33RgYVtH5PuWbBLSj9zp9bd

0-11-0 2-3-8 2-5-8 7-0-0 11-1-8 15-5-8 19-1-8 24-8-13 30-4-3 36-3-0 37-2-0
 0-11-0 2-3-8 0-2-0 4-6-8 4-1-8 4-4-0 3-8-0 5-7-5 5-7-5 5-10-13 0-11-0

Scale = 1:66.9

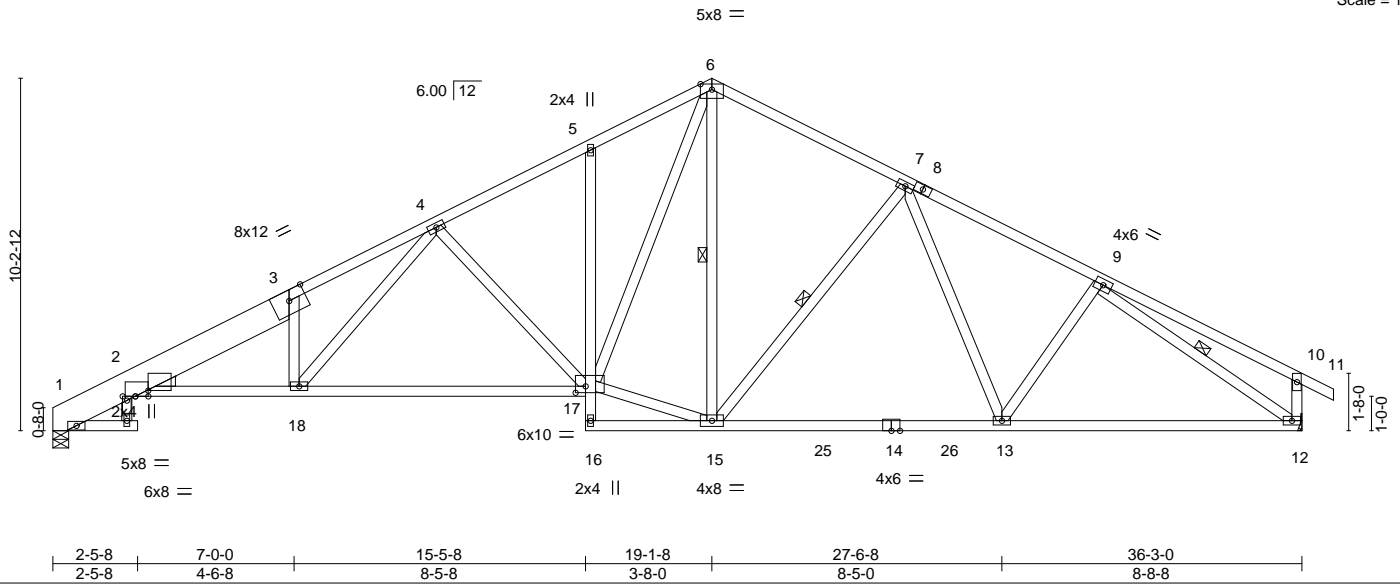


Plate Offsets (X,Y)-- [2:0-4-8,0-0-0], [2:0-4-8,0-2-0], [17:0-3-8,0-2-4], [20:0-1-8,0-1-8]

LOADING (psf)	SPACING-	CSL.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.49	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.83	Vert(LL) -0.23 13-15 >999 240		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.56	Vert(CT) -0.47 17-18 >917 180		
BCDL 10.0	Rep Stress Incr YES	Matrix-MS	Horz(CT) 0.18 12 n/a n/a		
	Code IRC2015/TPI2014			Weight: 247 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2 *Except*
 1-3: 2x10 SP DSS
 BOT CHORD 2x4 SP No.2 *Except*
 2-17: 2x4 SP No.1
 WEBS 2x4 SP No.2 *Except*
 3-18,15-17,9-13,10-12: 2x4 SP No.3
 OTHERS 2x4 SP No.3
 WEDGE
 Left: 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-1-8 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
 WEBS 1 Row at midpt 6-15, 7-15, 9-12

REACTIONS.

(size) 1=0-5-8, 12=Mechanical
 Max Horz 1=133(LC 14)
 Max Uplift 1=-74(LC 10), 12=-88(LC 11)
 Max Grav 1=1451(LC 1), 12=1501(LC 1)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-2=-641/140, 2-3=-3090/447, 3-4=-3213/552, 4-5=-2053/410, 5-6=-2023/487,
 6-7=-1549/386, 7-9=-1910/385, 10-12=-305/168
 BOT CHORD 2-18=-302/2854, 17-18=-212/2217, 13-15=-112/1584, 12-13=-181/1620
 WEBS 3-18=-534/190, 4-18=-124/948, 4-17=-648/191, 15-17=0/1358, 6-17=-221/1249,
 6-15=-95/281, 7-15=-483/179, 7-13=-5/267, 9-12=-1855/243

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCCL=6.0psf; BCCL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- All plates are 3x6 MT20 unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCCL = 10.0psf.
- Refer to girder(s) for truss to truss connections.
- Bearing at joint(s) 1 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 12.



February 3, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	4 SERENITY - ROOF	156455756
34999-34999A	A5	ROOF SPECIAL	5	1	Job Reference (optional)	

84 Components (Dunn), Dunn, NC - 28334,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Feb 2 13:46:32 2023 Page 1
 ID:xbot3WsxISjrAw_FcFB3yorwP-IkK_SwxmVrbdREMueiYJ8UW05IX7ZKup3VqZo2zp9bb

0-11-0 9-10-6 19-1-8 28-4-9 36-3-0 37-2-0
 0-11-0 9-10-6 9-3-2 9-3-1 7-10-7 0-11-0

Scale = 1:69.5

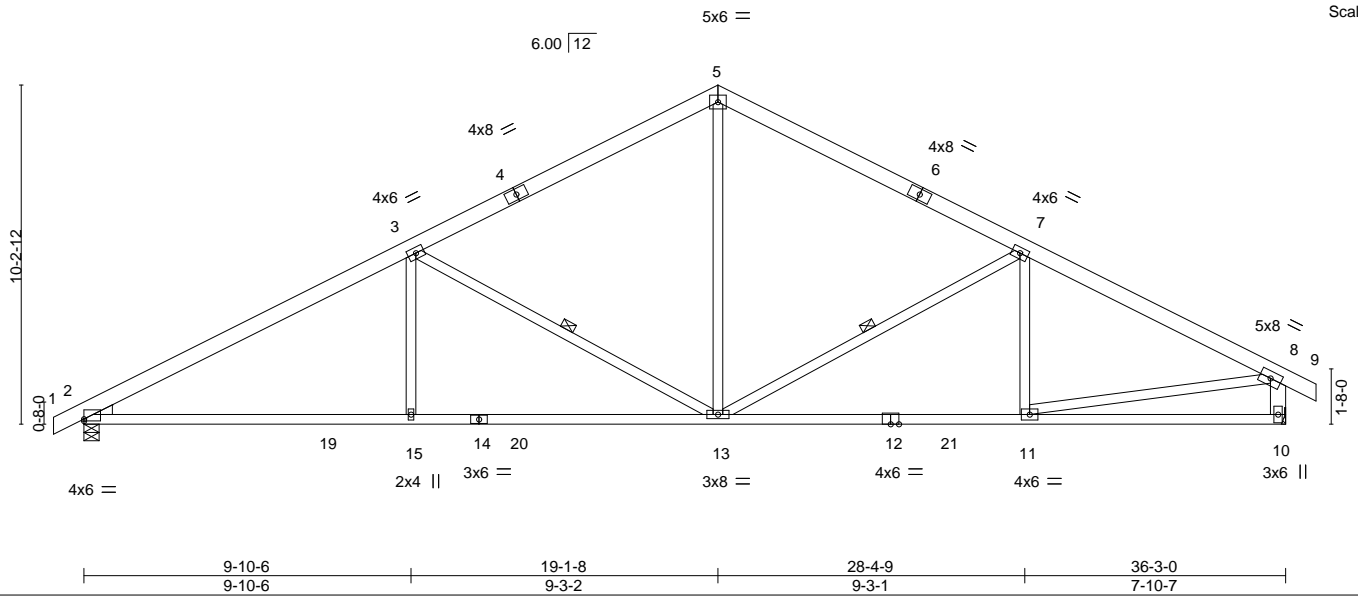


Plate Offsets (X,Y)-- [2:0-0-0-0-11]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.49	Vert(LL) -0.15 15-18 >999 240	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.93	Vert(CT) -0.33 15-18 >999 180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.47	Horz(CT) 0.09 10 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-MS		Weight: 228 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.2
 BOT CHORD 2x4 SP No.2
 WEBS 2x4 SP No.2 *Except*
 3-15,7-11: 2x4 SP No.3, 8-10: 2x6 SP No.2
 WEDGE
 Left: 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-2-7 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing.
 WEBS 1 Row at midpt 3-13, 7-13

REACTIONS.

(size) 2=0-5-8, 10=Mechanical
 Max Horz 2=142(LC 14)
 Max Uplift 2=-101(LC 10), 10=-89(LC 11)
 Max Grav 2=1495(LC 1), 10=1510(LC 1)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-2467/412, 3-5=-1647/369, 5-7=-1643/366, 7-8=-2060/361, 8-10=-1441/313
 BOT CHORD 2-15=-230/2097, 13-15=-230/2097, 11-13=-173/1757
 WEBS 3-15=0/377, 3-13=-908/253, 5-13=-104/855, 7-13=-539/188, 8-11=-158/1576

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCCL=6.0psf; BCCL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCCL = 10.0psf.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 10 except (jt=lb) 2=101.



February 3, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

Job 34999-34999A	Truss A6	Truss Type GABLE	Qty 1	Ply 1	4 SERENITY - ROOF	156455757
---------------------	-------------	---------------------	----------	----------	-------------------	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Feb 2 13:46:33 2023 Page 1
ID:nxbot3Wsx1SjrAw_FcBFB3yorwP-DwuMfGyOG9jU3Ow5BP3Yhi2BqitMIm8zI9Z6KUz9ba

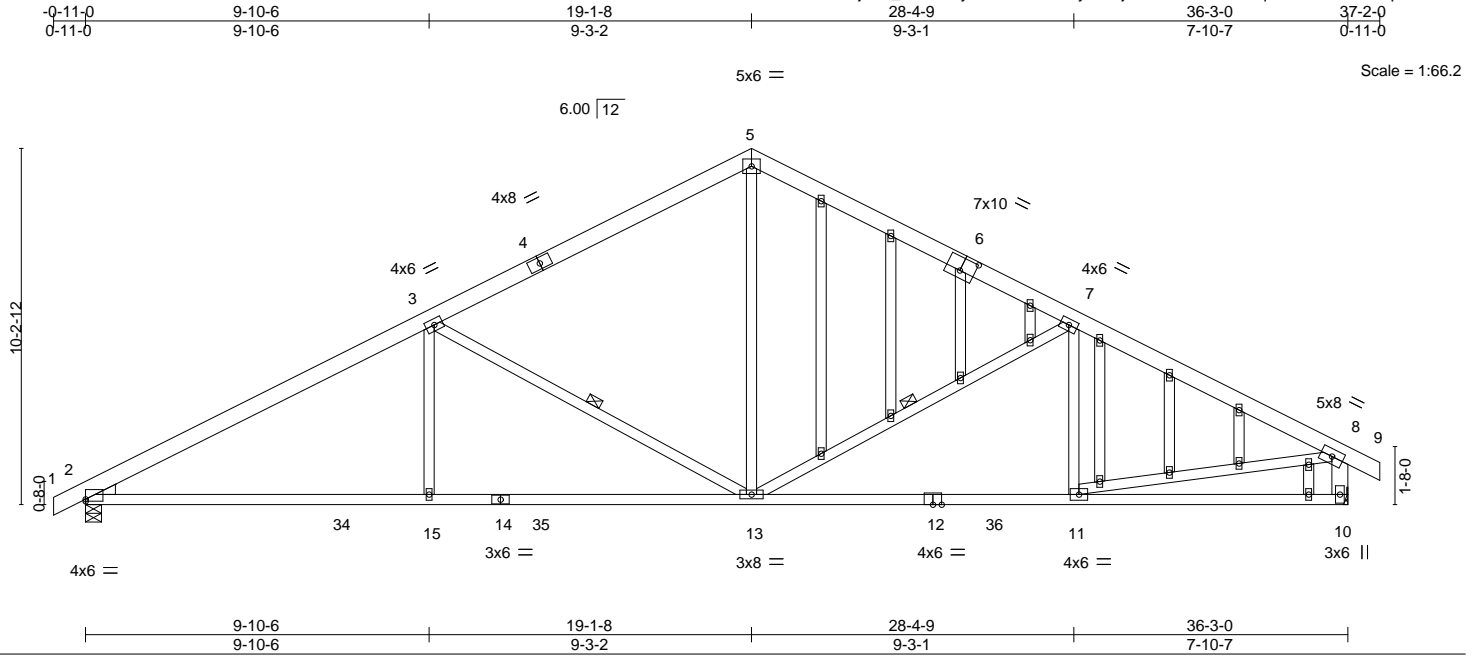


Plate Offsets (X,Y)-- [2:0-0-0,0-0-11], [6:0-5-0,0-4-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.49	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.93	Vert(LL) -0.15 15-33 >999 240		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.47	Vert(CT) -0.33 15-33 >999 180		
BCDL 10.0	Rep Stress Incr YES	Matrix-MS	Horz(CT) 0.09 10 n/a n/a		
	Code IRC2015/TPI2014			Weight: 267 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.2
 BOT CHORD 2x4 SP No.2
 WEBS 2x4 SP No.2 *Except*
 3-15,7-11: 2x4 SP No.3, 8-10: 2x6 SP No.2
 OTHERS 2x4 SP No.3 *Except*
 16-17: 2x4 SP No.2

WEDGE
 Left: 2x4 SP No.3

REACTIONS.

(size) 2=0-5-8, 10=Mechanical
 Max Horz 2=142(LC 14)
 Max Uplift 2=-101(LC 10), 10=-89(LC 11)
 Max Grav 2=1495(LC 1), 10=1510(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-2467/412, 3-5=-1647/369, 5-7=-1643/366, 7-8=-2060/361, 8-10=-1441/313
 BOT CHORD 2-15=-230/2097, 13-15=-230/2097, 11-13=-173/1757
 WEBS 3-15=0/377, 3-13=-908/253, 5-13=-104/855, 7-13=-539/188, 8-11=-158/1576

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCCL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 10 except (jt=lb) 2=101.



February 3, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

Job 34999-34999A	Truss A9E	Truss Type Common Supported Gable	Qty 1	Ply 1	4 SERENITY - ROOF	156455758
---------------------	--------------	--------------------------------------	----------	----------	-------------------	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Feb 2 13:46:38 2023 Page 1
ID:nxbot3Wsx1SjrAw_FcFB3yorwP-auhFi_0X5hMn99p2_yejOlm9Ljohz7viRRht?izp9bV

-0-11-0 17-7-8 35-3-0 36-2-0 0-11-0
0-11-0 17-7-8 17-7-8 0-11-0

Scale = 1:62.3

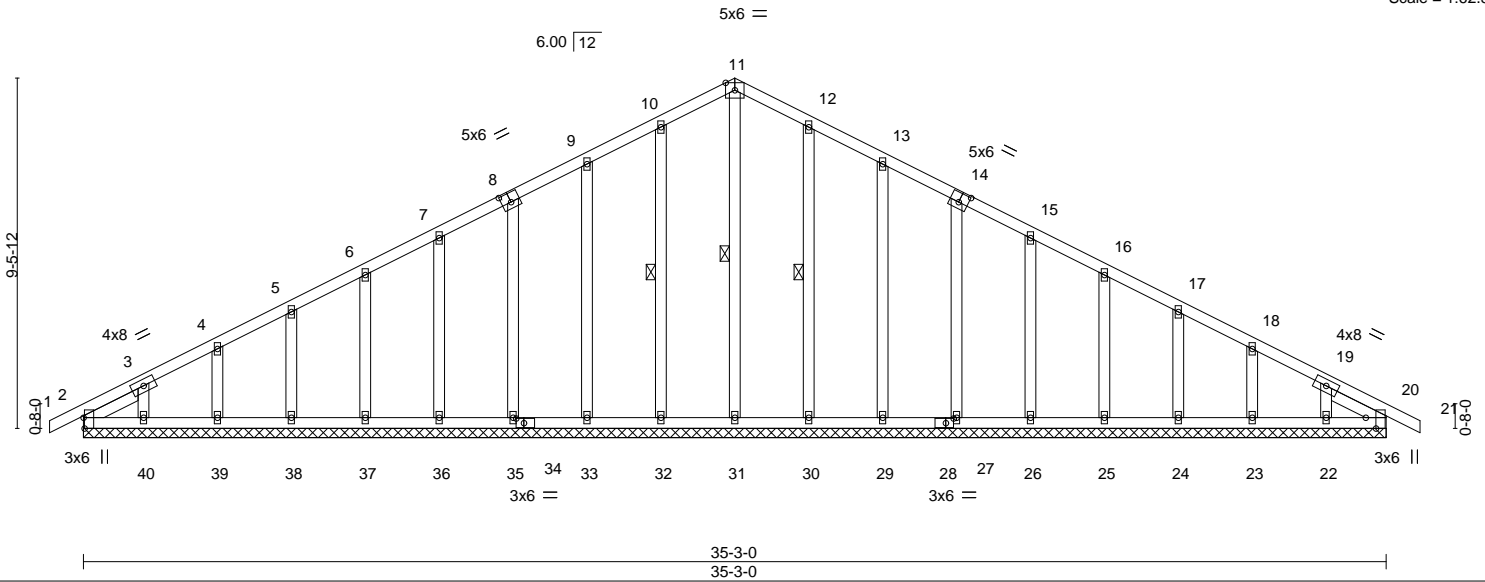


Plate Offsets (X,Y)-- [2:0-3-8,Edge], [8:0-3-0,0-3-0], [14:0-3-0,0-3-0], [20:0-3-8,Edge], [28:0-2-8,0-1-8], [34:0-2-8,0-1-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.06	Vert(LL) -0.00	20	n/r	120	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.03	Vert(CT) -0.00	21	n/r	90		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.11	Horz(CT) 0.01	20	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S					Weight: 238 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.3 *Except*
11-31,10-32,9-33,12-30,13-29: 2x4 SP No.2
SLIDER Left 2x4 SP No.3 1-8-2, Right 2x4 SP No.3 1-8-2

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 11-31, 10-32, 12-30

REACTIONS. All bearings 35-3-0.
(lb) - Max Horz 2=-132(LC 11)
Max Uplift All uplift 100 lb or less at joint(s) 2, 32, 33, 35, 36, 37, 38, 39, 40, 30, 29, 27, 26, 25, 24, 23, 22
Max Grav All reactions 250 lb or less at joint(s) 2, 31, 32, 33, 35, 36, 37, 38, 39, 40, 30, 29, 27, 26, 25, 24, 23, 22, 20

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCCL=6.0psf; TCCL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 32, 33, 35, 36, 37, 38, 39, 40, 30, 29, 27, 26, 25, 24, 23, 22.



February 3, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	4 SERENITY - ROOF	156455759
34999-34999A	C1E	GABLE	1	1	Job Reference (optional)	

84 Components (Dunn),

Dunn, NC - 28334,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Feb 2 13:46:39 2023 Page 1
ID:nxbot3Wsx1SjrAw_FcBFB3yorwP-24FdwK19s?UenJOEYgAyxzLHZ77NiaNrg50RY8zp9bU



3x6 =

Scale = 1:41.2

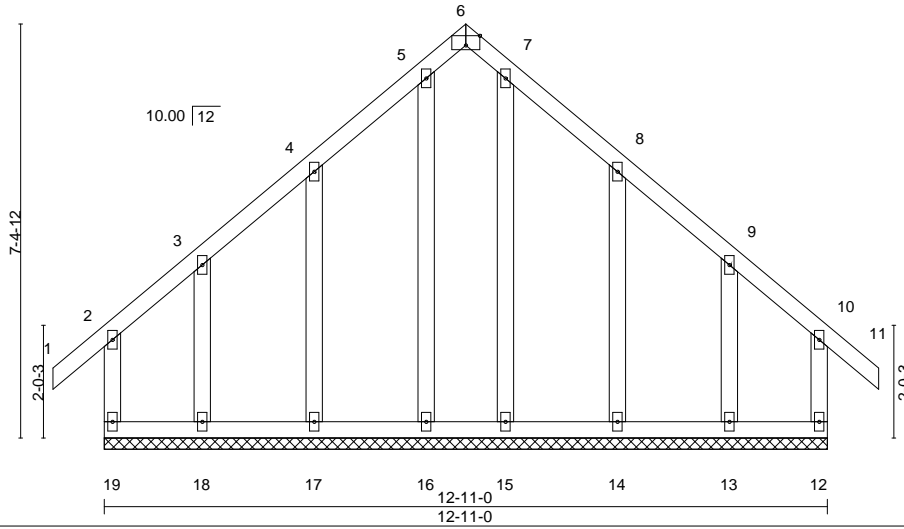


Plate Offsets (X,Y)-- [6:0-3:0,Edge]

LOADING (psf)	SPACING-	CSL.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.22	Vert(LL) -0.00	11	n/r	120	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.13	Vert(CT) -0.00	11	n/r	90		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.10	Horz(CT) -0.00	12	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-R					Weight: 94 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 WEBS 2x4 SP No.3
 OTHERS 2x4 SP No.3 *Except*
 5-16,7-15: 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS.

All bearings 12-11-0.
 (lb) - Max Horz 19=185(LC 8)
 Max Uplift All uplift 100 lb or less at joint(s) 17, 14 except 19=127(LC 6), 12=121(LC 7), 18=135(LC 7), 13=130(LC 6)
 Max Grav All reactions 250 lb or less at joint(s) 19, 12, 16, 17, 18, 15, 14, 13

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCCL=6.0psf; BCCL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 17, 14 except (jt=lb) 19=127, 12=121, 18=135, 13=130.



February 3, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	4 SERENITY - ROOF	156455760
34999-34999A	C2	Common	3	1	Job Reference (optional)	

84 Components (Dunn), Dunn, NC - 28334,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Feb 2 13:46:41 2023 Page 1

ID: nxbot3WsxISjrAw_FcFBF3yorwP_TNOK?2PNckM0cYdf4CQ0OOVCwiJAU187PVYc0zp9bS



4x6 =

Scale = 1:45.9

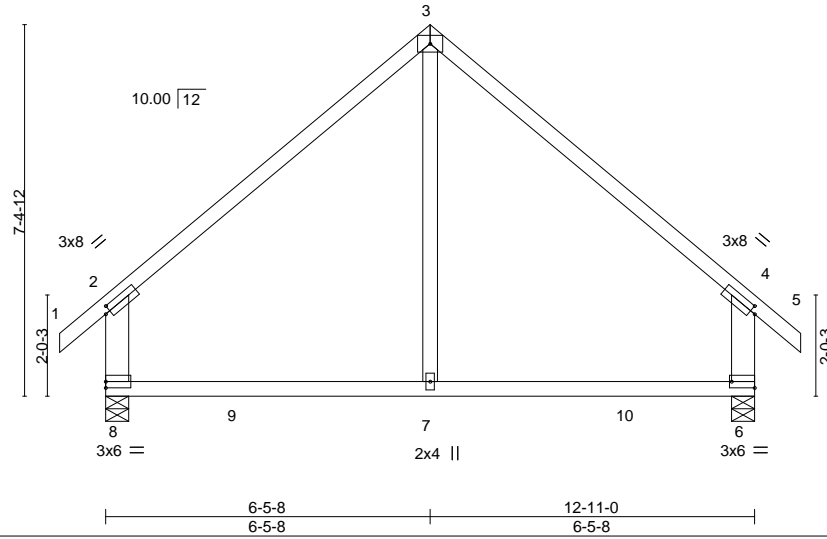


Plate Offsets (X,Y)-- [2:0-1-4,0-1-8], [4:0-1-4,0-1-8], [6:Edge,0-1-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.72	Vert(LL) -0.09	7	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.48	Vert(CT) -0.16	6-7	>941	180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.07	Horz(CT) 0.01	6	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-MR					Weight: 67 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 WEBS 2x6 SP No.2 *Except*
 3-7: 2x4 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 8=0-5-8, 6=0-5-8
 Max Horz 8=-187(LC 8)
 Max Uplift 8=-29(LC 10), 6=-29(LC 11)
 Max Grav 8=613(LC 17), 6=613(LC 18)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-521/122, 3-4=-520/122, 2-8=-506/159, 4-6=-506/159
 BOT CHORD 7-8=-18/334, 6-7=-18/334
 WEBS 3-7=0/310

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 8, 6.



February 3, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	4 SERENITY - ROOF	156455761
34999-34999A	C3G	COMMON GIRDER	1	2	Job Reference (optional)	

84 Components (Dunn), Dunn, NC - 28334,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Feb 2 13:46:42 2023 Page 1

ID: nxbot3WsxISjrAw_FcBFB3yorwP-SfxmYL318wsDem6pDofjYbwotK1AvpJHM3F58Tzp9bR



4x6 ||

Scale = 1:45.9


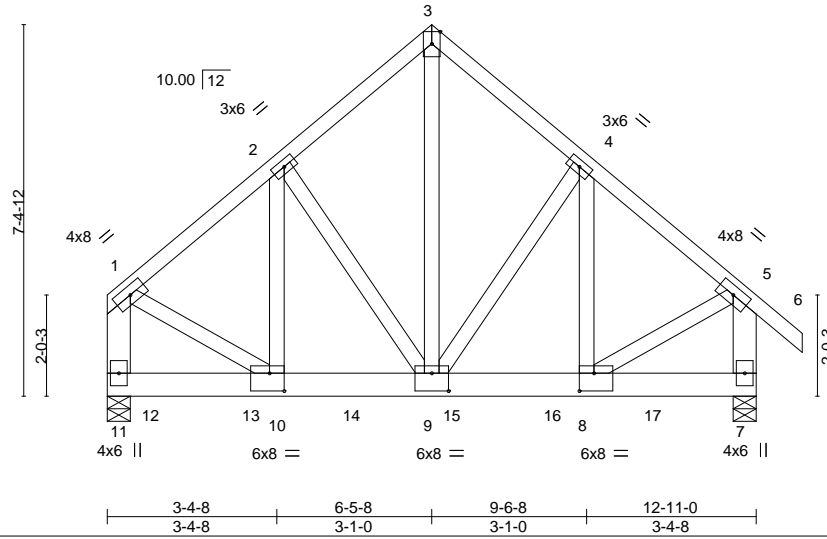


Plate Offsets (X,Y)-- [8:0-3-8,0-4-4], [9:0-4-0,0-4-4], [10:0-3-8,0-4-4]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.21	Vert(LL) -0.03 9-10 >999 240	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.57	Vert(CT) -0.05 9-10 >999 180		
BCLL 0.0 *	Rep Stress Incr NO	WB 0.60	Horz(CT) 0.01 7 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-MS		Weight: 222 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
 BOT CHORD 2x6 SP No.2
 WEBS 2x4 SP No.3 *Except*
 3-9: 2x4 SP No.2, 1-11,5-7: 2x6 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 11=0-5-8, 7=0-5-8
 Max Horz 11=-178(LC 23)
 Max Uplift 11=-284(LC 9), 7=-252(LC 9)
 Max Grav 11=5160(LC 1), 7=4410(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-3628/241, 2-3=-2994/256, 3-4=-2992/255, 4-5=-3594/242, 1-11=-3807/226,
 5-7=-3870/238
 BOT CHORD 10-11=-166/309, 9-10=-193/2732, 8-9=-118/2697
 WEBS 3-9=-262/3559, 4-9=-761/138, 4-8=-93/885, 2-9=-821/138, 2-10=-91/942,
 1-10=-141/2872, 5-8=-128/2885

NOTES-

- 1) N/A
- 2) All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- 3) Unbalanced roof live loads have been considered for this design.
- 4) Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TC DL=6.0psf; BC DL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 11=284, 7=252.
- 8) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 1420 lb down and 87 lb up at 0-10-4, 1416 lb down and 91 lb up at 2-10-4, 1416 lb down and 91 lb up at 4-10-4, 1416 lb down and 91 lb up at 6-10-4, and 1416 lb down and 91 lb up at 8-10-4, and 1420 lb down and 91 lb up at 10-10-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-3=-60, 3-5=-60, 5-6=-60, 7-11=-20



February 3, 2023

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSITPI Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	4 SERENITY - ROOF	I56455761
34999-34999A	C3G	COMMON GIRDER	1	2	Job Reference (optional)	

84 Components (Dunn), Dunn, NC - 28334,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Feb 2 13:46:42 2023 Page 2
 ID:nxbot3WsxISjrAw_FcBFB3yorwP-SfxmYL318wsDem6pDojYbwotK1AvpJHM3F58Tzp9bR

LOAD CASE(S) Standard

Concentrated Loads (lb)

Vert: 12=-1420(F) 13=-1416(F) 14=-1416(F) 15=-1416(F) 16=-1416(F) 17=-1420(F)

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	4 SERENITY - ROOF	156455762
34999-34999A	D1E	Common Supported Gable	1	1	Job Reference (optional)	

84 Components (Dunn), Dunn, NC - 28334,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Feb 2 13:46:45 2023 Page 1
 ID:nxbot3WsxISjrAw_FcBFB3yorwP-sEcvAN6wRrEnVrOuwGMAEYKSYBG6lck21Tllozp9bO
 39-11-0 40-10-0
 19-11-8 0-11-0

Scale = 1:70.1

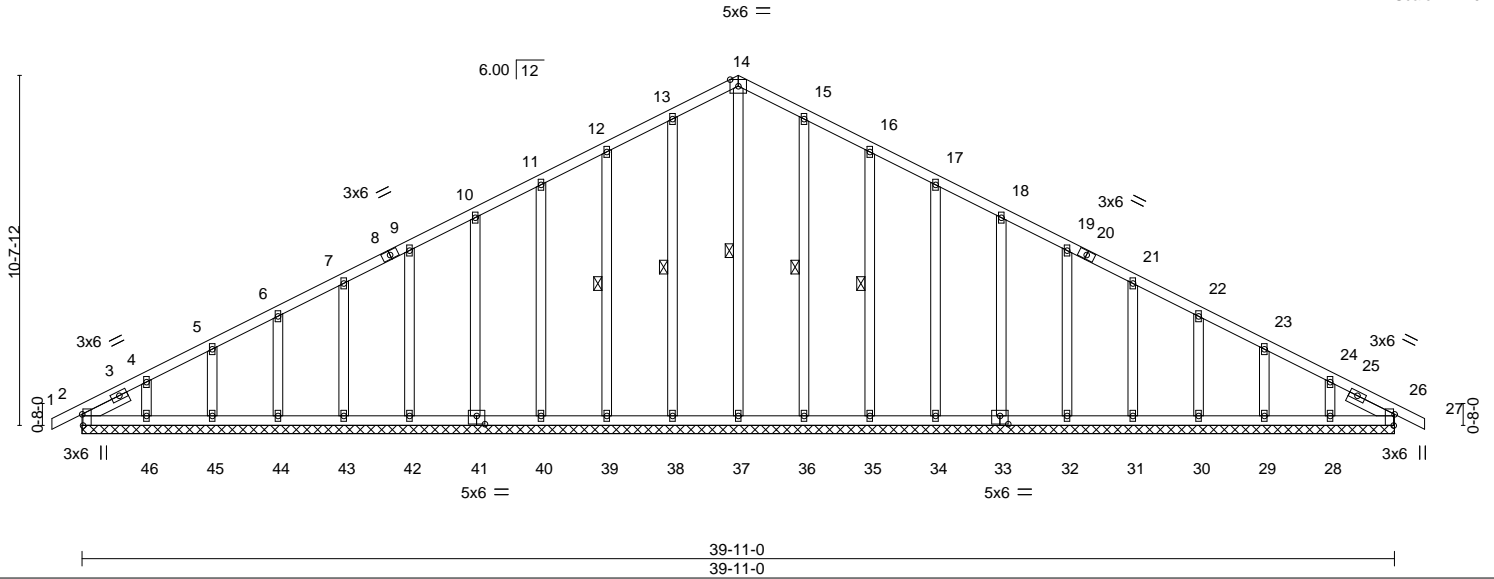


Plate Offsets (X,Y)-- [2:0-4-1,Edge], [26:0-4-1,Edge], [33:0-3-0,0-3-0], [41:0-3-0,0-3-0]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.06	Vert(LL) -0.00	26	n/r	120	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.03	Vert(CT) -0.00	26	n/r	90		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.11	Horz(CT) 0.01	26	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S					Weight: 285 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 OTHERS 2x4 SP No.3 *Except*
 14-37,13-38,12-39,11-40,10-41,15-36,16-35,17-34,18-33: 2x4 SP No.2
 SLIDER Left 2x4 SP No.3 1-6-7, Right 2x4 SP No.3 1-6-7

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
 WEBS 1 Row at midpt 14-37, 13-38, 12-39, 15-36, 16-35

REACTIONS. All bearings 39-11-0.
 (lb) - Max Horz 2=-148(LC 11)
 Max Uplift All uplift 100 lb or less at joint(s) 2, 38, 39, 40, 41, 42, 43, 44, 45, 46, 36, 35, 34, 33, 32, 31, 30, 29, 28
 Max Grav All reactions 250 lb or less at joint(s) 2, 37, 38, 39, 40, 41, 42, 43, 44, 45, 46, 36, 35, 34, 33, 32, 31, 30, 29, 28, 26

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 13-14=-103/259, 14-15=-103/259

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 4) All plates are 2x4 MT20 unless otherwise indicated.
 - 5) Gable requires continuous bottom chord bearing.
 - 6) Gable studs spaced at 2-0-0 oc.
 - 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 8) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 38, 39, 40, 41, 42, 43, 44, 45, 46, 36, 35, 34, 33, 32, 31, 30, 29, 28.



February 3, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	4 SERENITY - ROOF	156455763
34999-34999A	D2	Common	4	1	Job Reference (optional)	


84 Components (Dunn), Dunn, NC - 28334,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Feb 2 13:46:46 2023 Page 1

ID:nxbot3WsxISjrAw_FcBFB3yorwP-LRAHOj6YC9Me7OQbSeobjR5JMxJurgztHdDIHEzp9bN

-0-11-0 6-10-3 13-4-13 19-11-8 26-6-3 33-0-13 39-11-0 40-10-0
0-11-0 6-10-3 6-6-11 6-6-11 6-6-11 6-6-11 6-10-3 0-11-0

Scale = 1:70.1

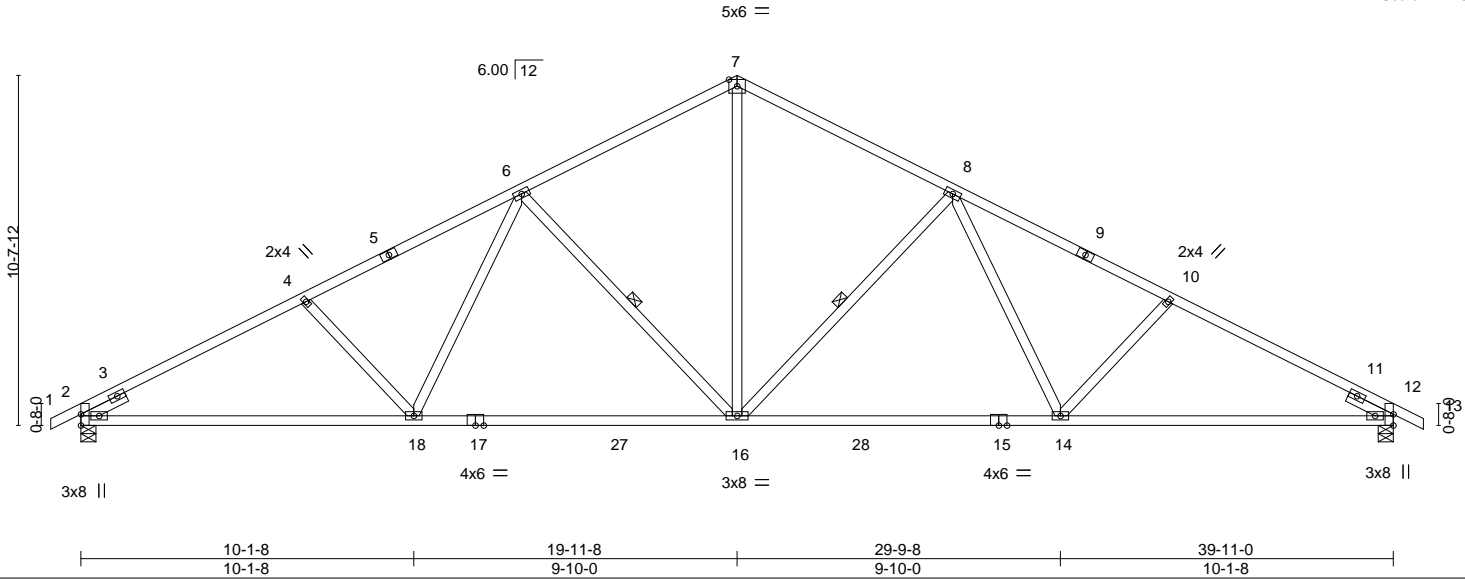

LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.89	Vert(LL) -0.36 16-18 >999 240	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.90	Vert(CT) -0.62 16-18 >771 180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.43	Horz(CT) 0.13 12 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-MS		Weight: 213 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2 *Except* 1-5,9-13: 2x4 SP No.1	TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins.
BOT CHORD 2x4 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.2 *Except* 10-14,4-18: 2x4 SP No.3	WEBS 1 Row at midpt 8-16, 6-16
SLIDER Left 2x4 SP No.3 1-6-0, Right 2x4 SP No.3 1-6-0	

REACTIONS. (size) 2=0-5-8, 12=0-5-8
Max Horz 2=-148(LC 15)
Max Uplift 2=-103(LC 10), 12=-103(LC 11)
Max Grav 2=1652(LC 1), 12=1652(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-4=-2783/482, 4-6=-2554/468, 6-7=-1851/427, 7-8=-1851/427, 8-10=-2554/468, 10-12=-2783/482
BOT CHORD 2-18=-319/2409, 16-18=-190/2035, 14-16=-190/2035, 12-14=-319/2409
WEBS 7-16=-226/1277, 8-16=-705/233, 8-14=-14/494, 10-14=-307/183, 6-16=-705/233, 6-18=-14/494, 4-18=-307/183

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - All plates are 3x6 MT20 unless otherwise indicated.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=103, 12=103.



February 3, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	4 SERENITY - ROOF	156455764
34999-34999A	E1E	Common Supported Gable	1	1	Job Reference (optional)	

84 Components (Dunn), Dunn, NC - 28334,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Feb 2 13:46:47 2023 Page 1
ID:nxbot3WxsI SjrAw_FcBFB3yorwP-pdkfb37AzSUVkX?n0LJqFeegmLtLaDO1WLysqgz9bM



Scale = 1:24.7

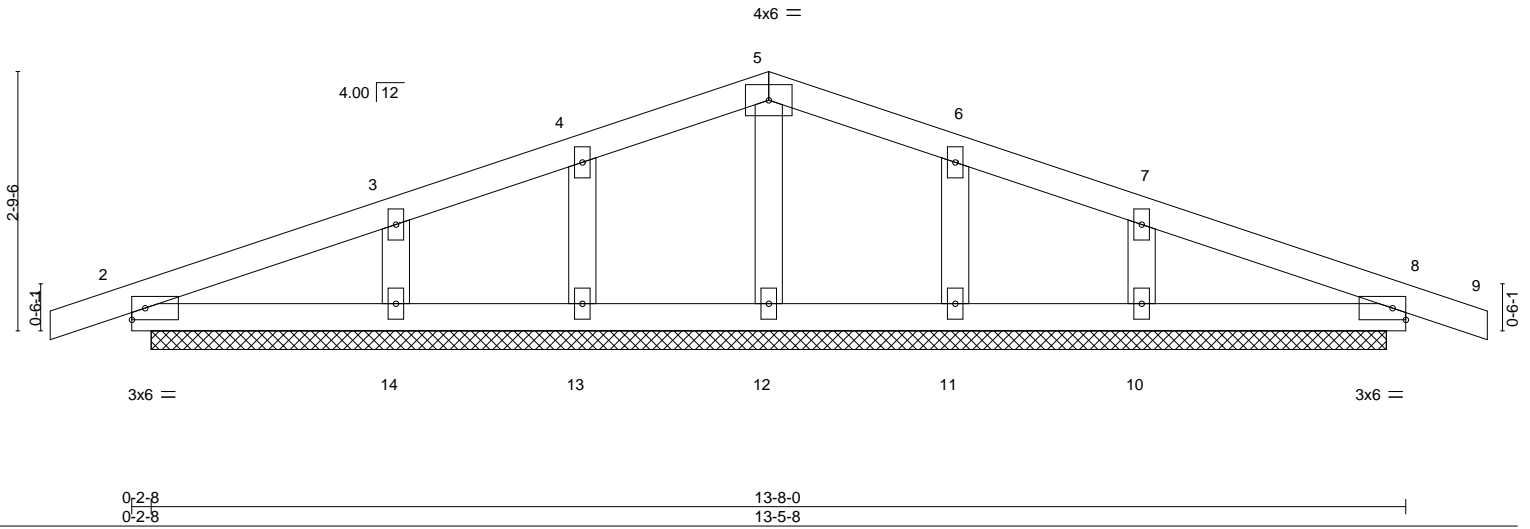

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.08	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.06	Vert(LL) 0.00 8 n/r 120		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.03	Vert(CT) 0.00 9 n/r 90		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.00 8 n/a n/a		
	Code IRC2015/TPI2014			Weight: 55 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
OTHERS 2x4 SP No.3	

REACTIONS. All bearings 13-3-0.
 (lb) - Max Horz 2=37(LC 10)
 Max Uplift All uplift 100 lb or less at joint(s) 2, 8, 13, 14, 11, 10
 Max Grav All reactions 250 lb or less at joint(s) 2, 8, 12, 13, 14, 11, 10

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCCL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 8, 13, 14, 11, 10.




February 3, 2023

Job	Truss	Truss Type	Qty	Ply	4 SERENITY - ROOF	156455765
34999-34999A	E2	Common	4	1	Job Reference (optional)	

84 Components (Dunn), Dunn, NC - 28334,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Feb 2 13:46:49 2023 Page 1
ID:nxbot3Wsx1SjrAw_FcBFB3yorwP-l?sP0k9QV4kD_r997mLiL3jvK9QN26eJzFRzuZzp9bK



Scale = 1:24.7

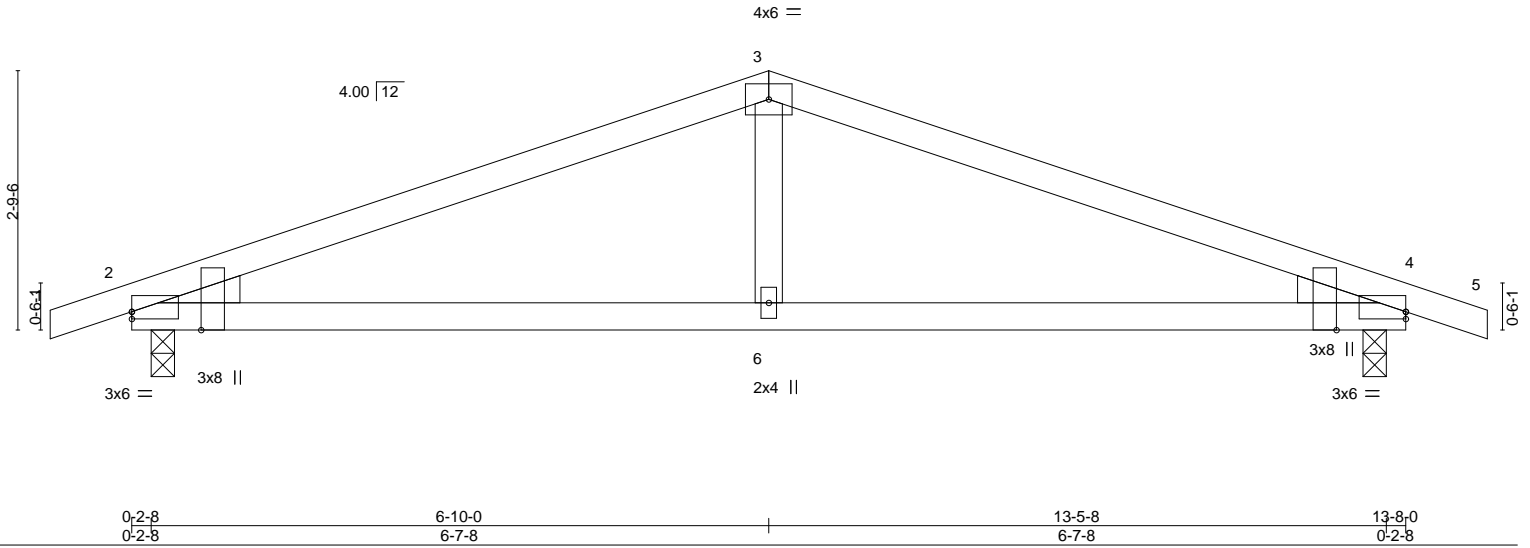


Plate Offsets (X,Y)-- [2:0-0-0,0-0-15], [2:0-2-6,Edge], [4:Edge,0-0-15], [4:0-2-6,Edge]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.52	Vert(LL) -0.07	6-12	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.53	Vert(CT) -0.13	6-9	>999	180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.11	Horz(CT) 0.01	2	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-MS					Weight: 51 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3
WEDGE
Left: 2x4 SP No.3 , Right: 2x4 SP No.3

BRACING-
TOP CHORD Structural wood sheathing directly applied or 5-0-10 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 2=0-3-0, 4=0-3-0
Max Horz 2=37(LC 14)
Max Uplift 2=-69(LC 6), 4=-69(LC 7)
Max Grav 2=599(LC 1), 4=599(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-951/189, 3-4=-951/189
BOT CHORD 2-6=-100/855, 4-6=-100/855
WEBS 3-6=0/292

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCCL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 4.



February 3, 2023


Job	Truss	Truss Type	Qty	Ply	4 SERENITY - ROOF	I56455766
34999-34999A	M1	MONO TRUSS	9	1	Job Reference (optional)	

84 Components (Dunn),

Dunn, NC - 28334,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Feb 2 13:46:49 2023 Page 1

ID:nxbot3WsxISjrAw_FcBFB3yorwP-l?sP0k9QV4kD_r997mLL3jxM9M32_tJzRzuZzp9bK



Scale = 1:23.2

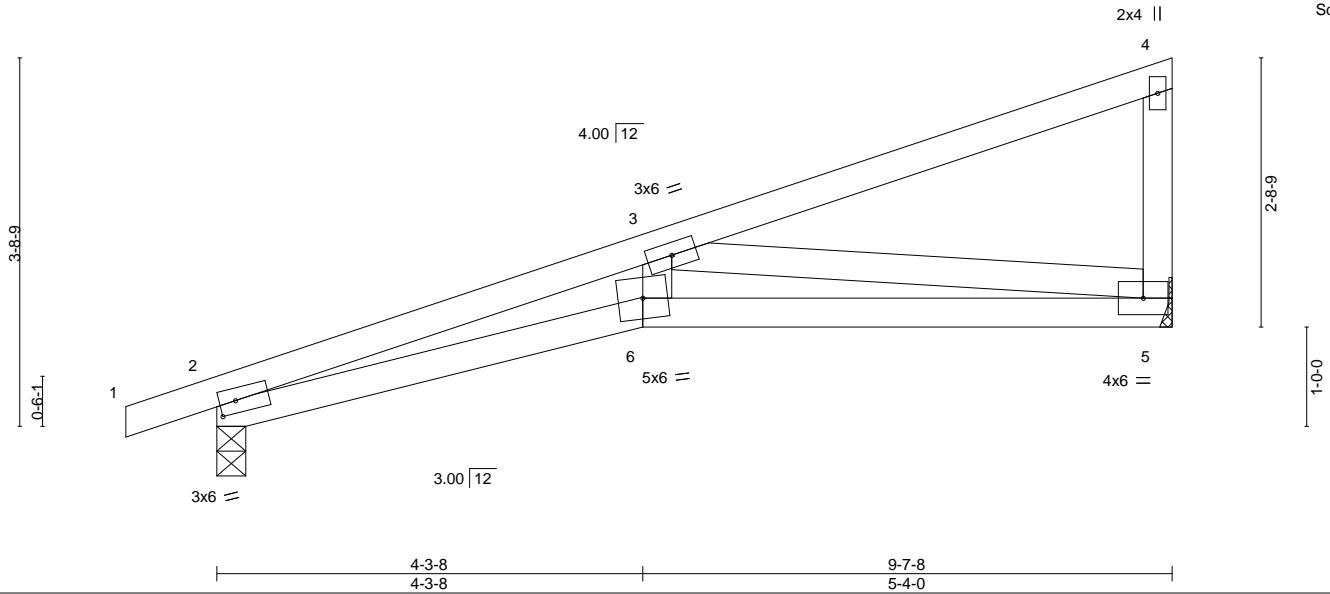


Plate Offsets (X,Y)--	[2:0-1-15,0-1-8]
-----------------------	------------------

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.39	Vert(LL)	-0.08	6	>999	240	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.81	Vert(CT)	-0.16	5-6	>690	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.61	Horz(CT)	0.06	5	n/a	n/a		
BCDL 10.0	Code	IRC2015/TPI2014	Matrix-MS						Weight: 42 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 4-7-5 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2 *Except* 5-6: 2x4 SP No.3	BOT CHORD Rigid ceiling directly applied or 9-5-3 oc bracing.
WEBS 2x4 SP No.3	

REACTIONS. (size) 5=Mechanical, 2=0-3-8
 Max Horz 2=108(LC 7)
 Max Uplift 5=53(LC 10), 2=62(LC 6)
 Max Grav 5=377(LC 1), 2=437(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-1424/357
 BOT CHORD 2-6=-370/1342, 5-6=-353/1227
 WEBS 3-6=-19/393, 3-5=-1185/381

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCCL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Bearing at joint(s) 2 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 2.



February 3, 2023


Job	Truss	Truss Type	Qty	Ply	4 SERENITY - ROOF	I56455767
34999-34999A	M1GE	MONOPITCH SUPPORTED	1	1	Job Reference (optional)	

84 Components (Dunn), Dunn, NC - 28334,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Feb 2 13:46:51 2023 Page 1
 ID:nxbot3WwsxISjrAw_FcBFB3yorwP-hOzARQAh1h?xD9IYFBNmQUoLjyDfW1FcQzw3zRzp9bl
 9-7-8
 9-7-8



Scale = 1:20.8

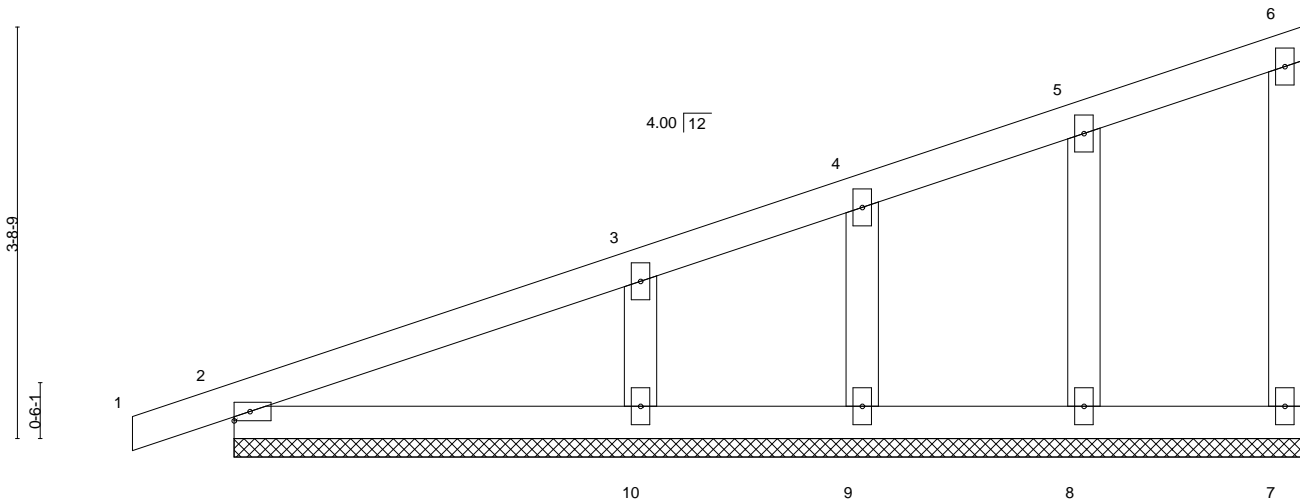

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.14	Vert(LL)	-0.00	1	n/r	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.10	Vert(CT)	0.00	1	n/r		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.04	Horz(CT)	-0.00	7	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S					Weight: 44 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 WEBS 2x4 SP No.3
 OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

All bearings 9-8-0.
 (lb) - Max Horz 2=123(LC 7)
 Max Uplift All uplift 100 lb or less at joint(s) 7, 2, 8, 9, 10
 Max Grav All reactions 250 lb or less at joint(s) 7, 2, 8, 9 except 10=285(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) All plates are 2x4 MT20 unless otherwise indicated.
- 4) Gable requires continuous bottom chord bearing.
- 5) Gable studs spaced at 2-0-0 oc.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 7, 2, 8, 9, 10.



February 3, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	4 SERENITY - ROOF	I56455768
34999-34999A	M2GE	GABLE	1	1	Job Reference (optional)	

84 Components (Dunn), Dunn, NC - 28334,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Feb 2 13:46:51 2023 Page 1
ID:nxbot3WsxISjrAw_FcBFB3yorwP-hOzARQA1h?x91YFBNmQUoIZyACWyDcQzw3zRzp9bl

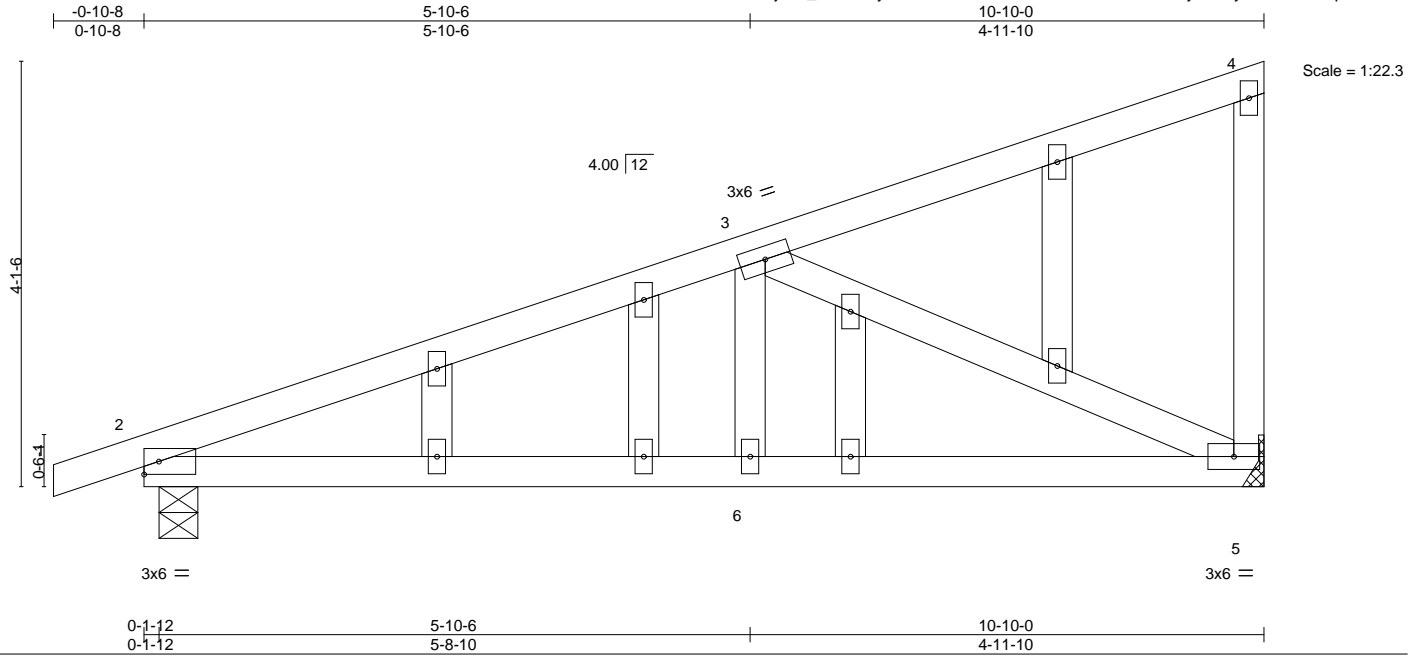

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.34	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.32	Vert(LL) -0.02 6-17 >999 240		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.36	Vert(CT) -0.06 6-17 >999 180		
BCDL 10.0	Rep Stress Incr YES	Matrix-MS	Horz(CT) 0.01 5 n/a n/a	Weight: 59 lb	FT = 20%
	Code IRC2015/TPI2014				

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3
OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 2=0-4-8, 5=Mechanical
Max Horz 2=138(LC 9)
Max Uplift 2=-66(LC 6), 5=-58(LC 10)
Max Grav 2=482(LC 1), 5=425(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-704/146
BOT CHORD 2-6=-119/622, 5-6=-119/622
WEBS 3-5=-667/191

NOTES-

- 1) Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) All plates are 2x4 MT20 unless otherwise indicated.
- 4) Gable studs spaced at 2-0-0 oc.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 7) Refer to girder(s) for truss to truss connections.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 5.



February 3, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	4 SERENITY - ROOF	I56455769
34999-34999A	M3	Monopitch	6	1	Job Reference (optional)	

84 Components (Dunn), Dunn, NC - 28334,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Feb 2 13:46:52 2023 Page 1
ID:xbot3WsxISjrAw_FcBFB3yorwP-9aXYemBJo?7orJtkpuu?yLTJMWRFOSmfcgdVuzp9bH

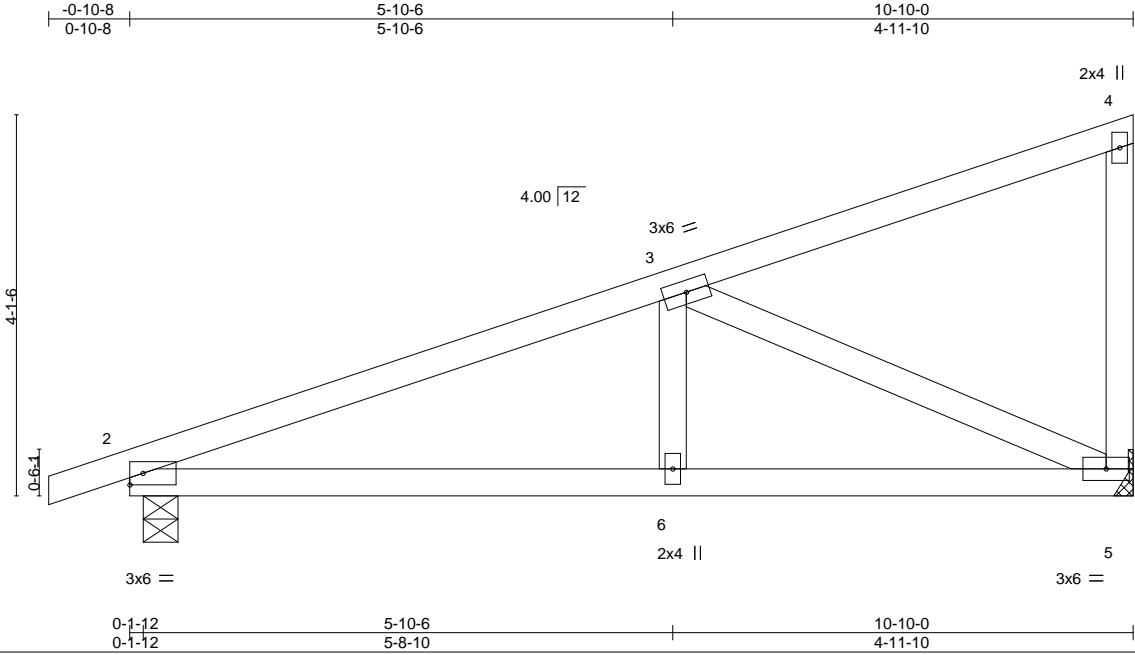

Scale = 1:24.9

LOADING (psf)	SPACING-	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.34	Vert(LL) -0.02	6-9	>999	240		MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.32	Vert(CT) -0.06	6-9	>999	180			
BCLL 0.0 *	Rep Stress Incr YES	WB 0.36	Horz(CT) 0.01	5	n/a	n/a			
BCDL 10.0	Code IRC2015/TPI2014	Matrix-MS						Weight: 50 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 2=0-4-8, 5=Mechanical
Max Horz 2=138(LC 9)
Max Uplift 2=-66(LC 6), 5=-58(LC 10)
Max Grav 2=482(LC 1), 5=425(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-704/146
BOT CHORD 2-6=-119/622, 5-6=-119/622
WEBS 3-5=-667/191

NOTES-

- 1) Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 5.



February 3, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	4 SERENITY - ROOF	I56455770
34999-34999A	M3GE	Monopitch Structural Gable	1	1	Job Reference (optional)	

84 Components (Dunn),

Dunn, NC - 28334,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Feb 2 13:46:53 2023 Page 1
 ID:nxbot3WsxISjrAw_FcBFB3yorwP-dn5ws6CxZIFfSSxMcQEvvfzmtR_wMvuGPA1Kzp9bG

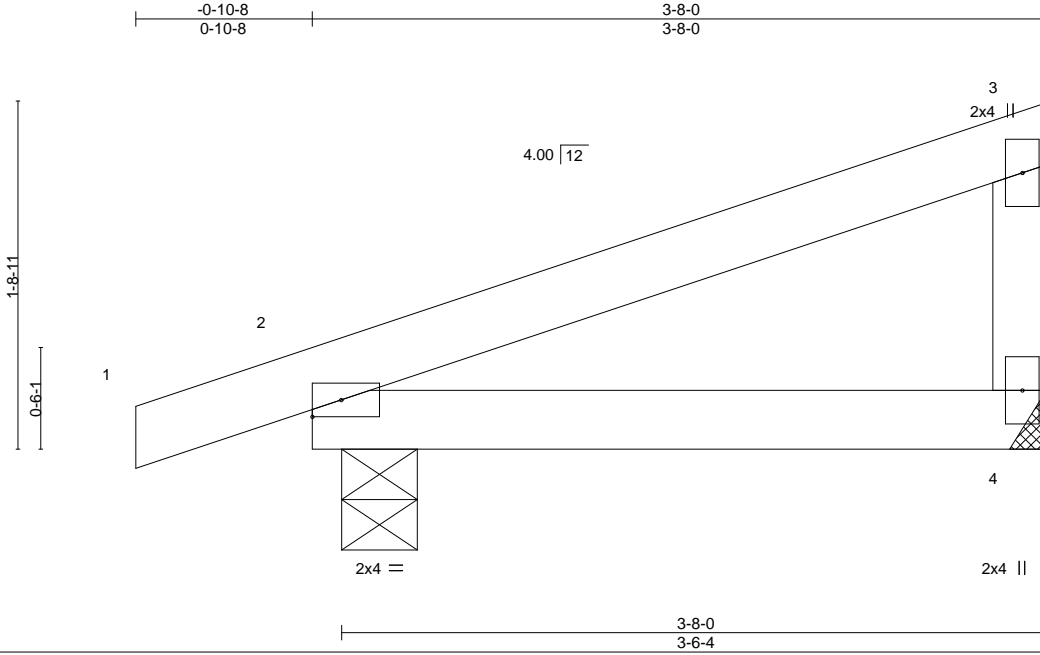

Scale = 1:11.4

LOADING (psf)	SPACING-	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.29	Vert(LL) -0.01	4-7	>999	240		MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.20	Vert(CT) -0.02	4-7	>999	180			
BCLL 0.0 *	Lumber DOL 1.15	WB 0.00	Horz(CT) 0.00	2	n/a	n/a			
BCDL 10.0	Rep Stress Incr YES	Matrix-MP						Weight: 14 lb	FT = 20%
	Code IRC2015/TPI2014								

LUMBER-

TOP CHORD 2x4 SP No.3
 BOT CHORD 2x4 SP No.3
 WEBS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-8-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 4=Mechanical, 2=0-4-8
 Max Horz 2=52(LC 9)
 Max Uplift 4=-18(LC 10), 2=-43(LC 6)
 Max Grav 4=134(LC 1), 2=200(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) Gable studs spaced at 2-0-0 oc.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Refer to girder(s) for truss to truss connections.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 2.



February 3, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	4 SERENITY - ROOF	I56455771
34999-34999A	V1	GABLE	1	1	Job Reference (optional)	

84 Components (Dunn), Dunn, NC - 28334,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Feb 2 13:46:54 2023 Page 1
ID:nxbot3WsxISjrAw_FcBFB3yorwP-6zfl3SDZJcNW4c17wJxT27QpdAE3jN137w9kamzp9bF



Scale = 1:14.8

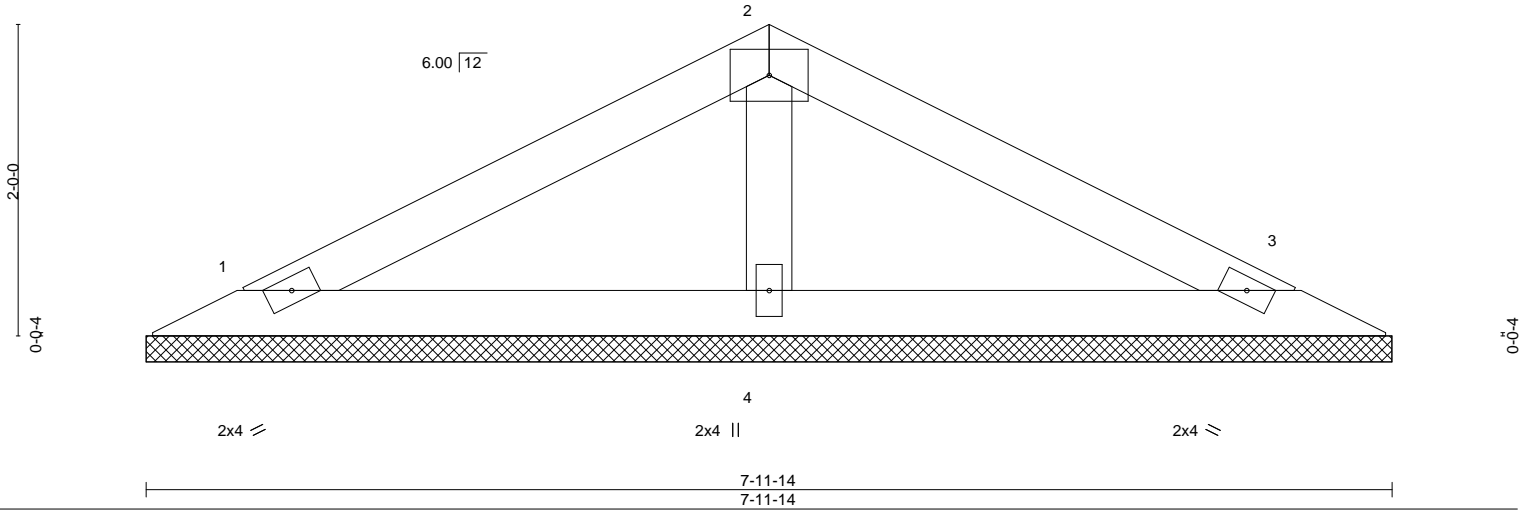

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.36	Vert(LL) n/a	-	n/a	999	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.11	Vert(CT) n/a	-	n/a	999		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.04	Horz(CT) 0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-P					Weight: 25 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.3
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=7-11-14, 3=7-11-14, 4=7-11-14
Max Horz 1=24(LC 14)
Max Uplift 1=-21(LC 10), 3=-25(LC 11)
Max Grav 1=136(LC 1), 3=136(LC 1), 4=266(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCCL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.



February 3, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	4 SERENITY - ROOF	I56455772
34999-34999A	V2	Valley	1	1	Job Reference (optional)	

84 Components (Dunn), Dunn, NC - 28334,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Feb 2 13:46:55 2023 Page 1

ID:nxbot3WsxISjrAw_FcBFB3yorwP-a9DhGoDB4wVNimcJU1SiaKz23aWcSqsCLauH6Dzp9bE



3x6 =

Scale = 1:11.1

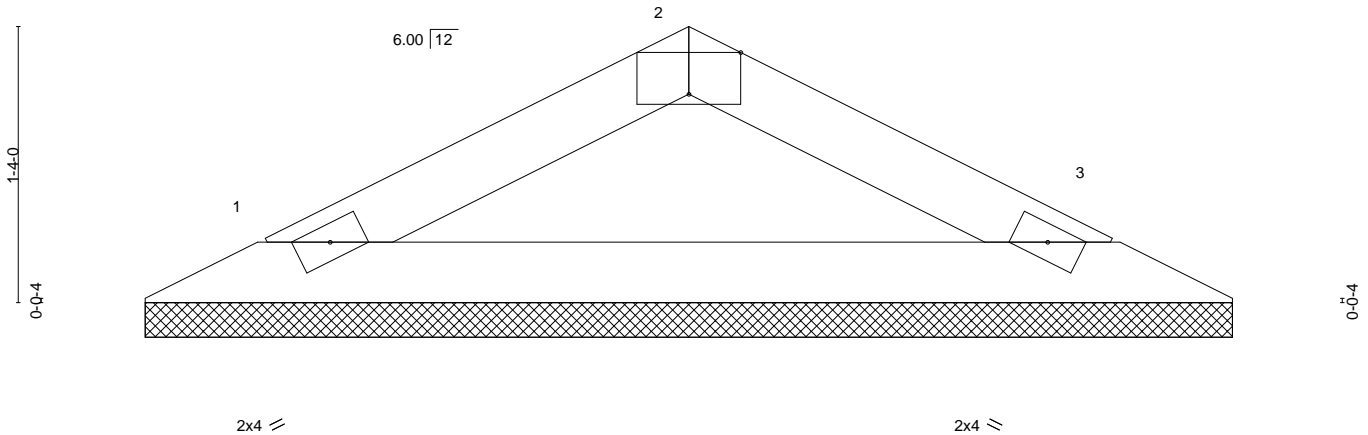


Plate Offsets (X,Y)--	0-0-8 0-0-8	5-3-14 5-3-6
-----------------------	----------------	-----------------

LOADING (psf)	SPACING-	CSL	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.12	Vert(LL) n/a	-	n/a	999	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.35	Vert(CT) n/a	-	n/a	999		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.00	Horz(CT) 0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-P					Weight: 15 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.3
BOT CHORD 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-3-14 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=5-2-14, 3=5-2-14
Max Horz 1=-15(LC 11)
Max Uplift 1=-9(LC 10), 3=-9(LC 11)
Max Grav 1=163(LC 1), 3=163(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCCL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.



February 3, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	4 SERENITY - ROOF	I56455773
34999-34999A	V3	Valley	1	1	Job Reference (optional)	

84 Components (Dunn),

Dunn, NC - 28334,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Feb 2 13:46:57 2023 Page 1

ID: nxbot3WsxISjrAw_FcBFB3yorwP-WYLRhTFRcXl4x4mibSUAfl2NXNGewkNVpuNOA5zp9bC

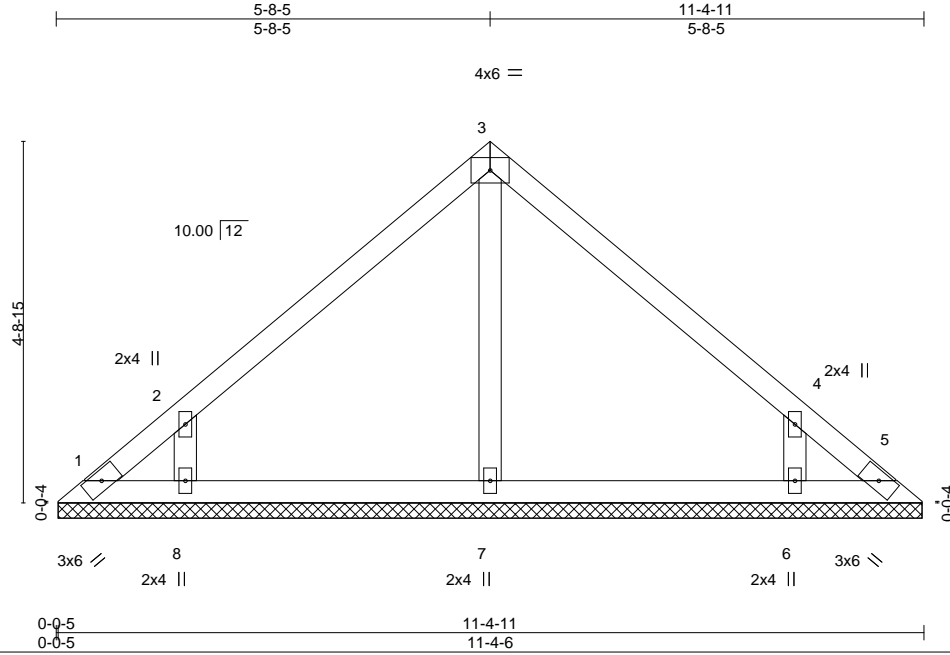

Scale = 1:30.2

LOADING (psf)	SPACING-	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.19	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.12	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.06	Horz(CT)	0.00	5	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S						Weight: 46 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

All bearings 11-4-1.

(lb) - Max Horz 1=-93(LC 6)

Max Uplift All uplift 100 lb or less at joint(s) 1, 5 except 8=-129(LC 10), 6=-129(LC 11)

Max Grav All reactions 250 lb or less at joint(s) 1, 5, 7 except 8=316(LC 17), 6=316(LC 18)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

WEBS 2-8=-257/175, 4-6=-257/175

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCCL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5 except (jt=lb) 8=129, 6=129.



February 3, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601


ENGINEERING BY
TRENCO
 A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932

Job 34999-34999A	Truss V4	Truss Type Valley	Qty 1	Ply 1	4 SERENITY - ROOF Job Reference (optional)	I56455774
---------------------	-------------	----------------------	----------	----------	---	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Feb 2 13:46:58 2023 Page 1
ID:nxbot3WsxISjrAw_FcBFB3yorwP-_kupvpG4NrtxZELu99?PCzbSTnb8fBpe1Y7xjXzp9bB

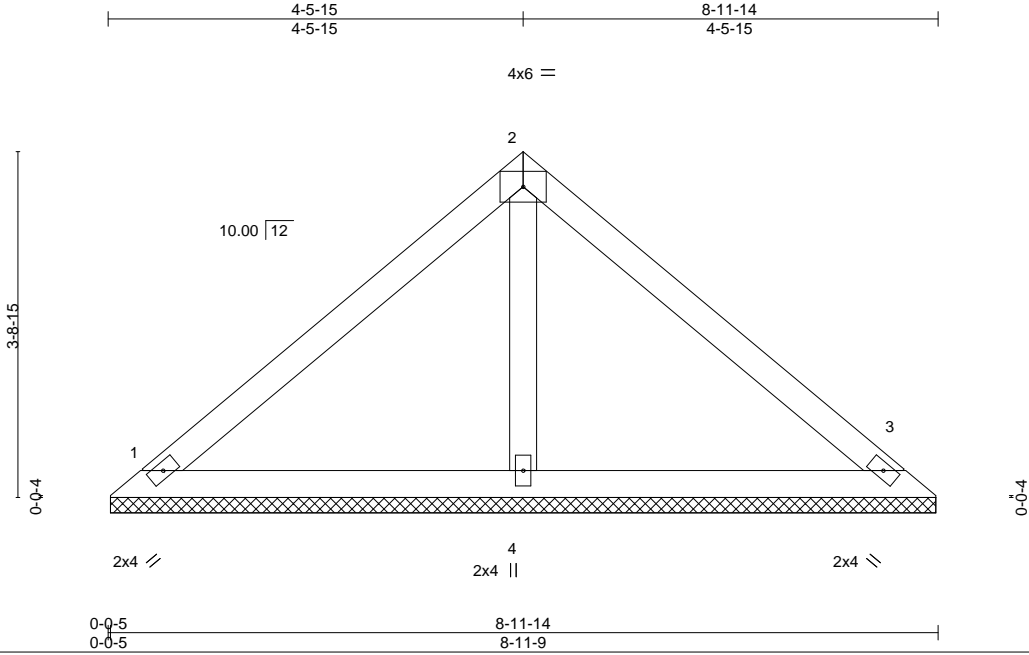

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)		l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.56	Vert(LL) n/a	-	n/a	999		MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.17	Vert(CT) n/a	-	n/a	999			
BCLL 0.0 *	Rep Stress Incr YES	WB 0.05	Horz(CT) 0.00	3	n/a	n/a			
BCDL 10.0	Code IRC2015/TPI2014	Matrix-P						Weight: 34 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.3
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=8-11-4, 3=8-11-4, 4=8-11-4
Max Horz 1=72(LC 7)
Max Uplift 1=-25(LC 10), 3=-34(LC 11)
Max Grav 1=187(LC 1), 3=187(LC 1), 4=282(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCCL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.



February 3, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	4 SERENITY - ROOF	I56455775
34999-34999A	V5	Valley	1	1	Job Reference (optional)	

84 Components (Dunn),

Dunn, NC - 28334,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Feb 2 13:47:00 2023 Page 1

ID:nxbot3WxslSjrAw_FcBFB3yorwP-w70aKVHKvS7foXVHHa2HOgrZbHw75gxVsc2nQzp9b9

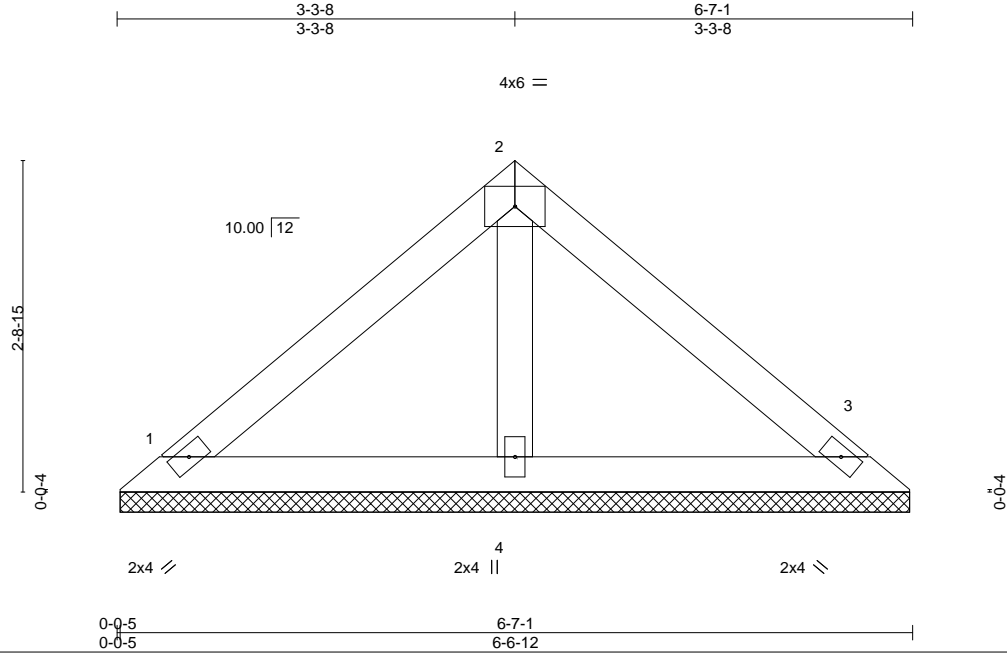

Scale = 1:19.1

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.26	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.09	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.03	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-P					Weight: 24 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.3
 BOT CHORD 2x4 SP No.2
 OTHERS 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=6-6-7, 3=6-6-7, 4=6-6-7
 Max Horz 1=51(LC 6)
 Max Uplift 1=18(LC 10), 3=24(LC 11)
 Max Grav 1=132(LC 1), 3=132(LC 1), 4=199(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCCL=6.0psf; BCCL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.



February 3, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component


Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

818 Soundside Road
Edenton, NC 27932

Job 34999-34999A	Truss V6	Truss Type Valley	Qty 1	Ply 1	4 SERENITY - ROOF	I56455776
---------------------	-------------	----------------------	----------	----------	-------------------	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Feb 2 13:47:01 2023 Page 1
ID:nxbot3WsxISjrAw_FcBFB3yorwP-OJayXrlygmFWQh3TqHZ6qbD37_bssYL4kWLbJszip9b8

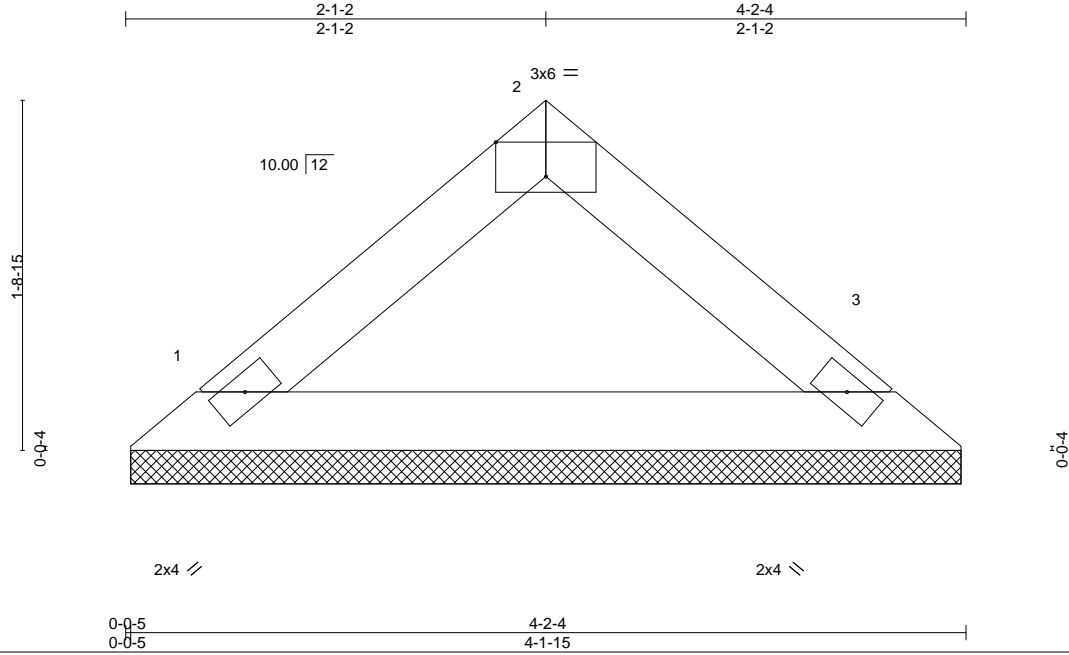

Scale = 1:11.5

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.08	Vert(LL) n/a - n/a 999	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.23	Vert(CT) n/a - n/a 999		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.00	Horz(CT) 0.00 3 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-P		Weight: 13 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SP No.3
BOT CHORD 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-2-4 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=4-1-11, 3=4-1-11
Max Horz 1=30(LC 9)
Max Uplift 1=5(LC 10), 3=5(LC 11)
Max Grav 1=135(LC 1), 3=135(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.



February 3, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932

Job 34999-34999A	Truss A7	Truss Type Common	Qty 3	Ply 1	4 SERENITY - ROOF	156455777
---------------------	-------------	----------------------	----------	----------	-------------------	-----------

84 Components (Dunn), Dunn, NC - 28334,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Feb 2 13:46:34 2023 Page 1

ID:nxbot3WsxISjrAw_FcBFB3yorwP-h7Skscz01TrLgYVHI6anEvbNP6IU1Gr6WpJgswzpz9bZ

0-11-0 9-1-6 17-7-8 26-1-10 35-3-0 36-2-0
0-11-0 9-1-6 8-6-2 8-6-2 9-1-6 0-11-0

5x6 =

Scale = 1:65.6

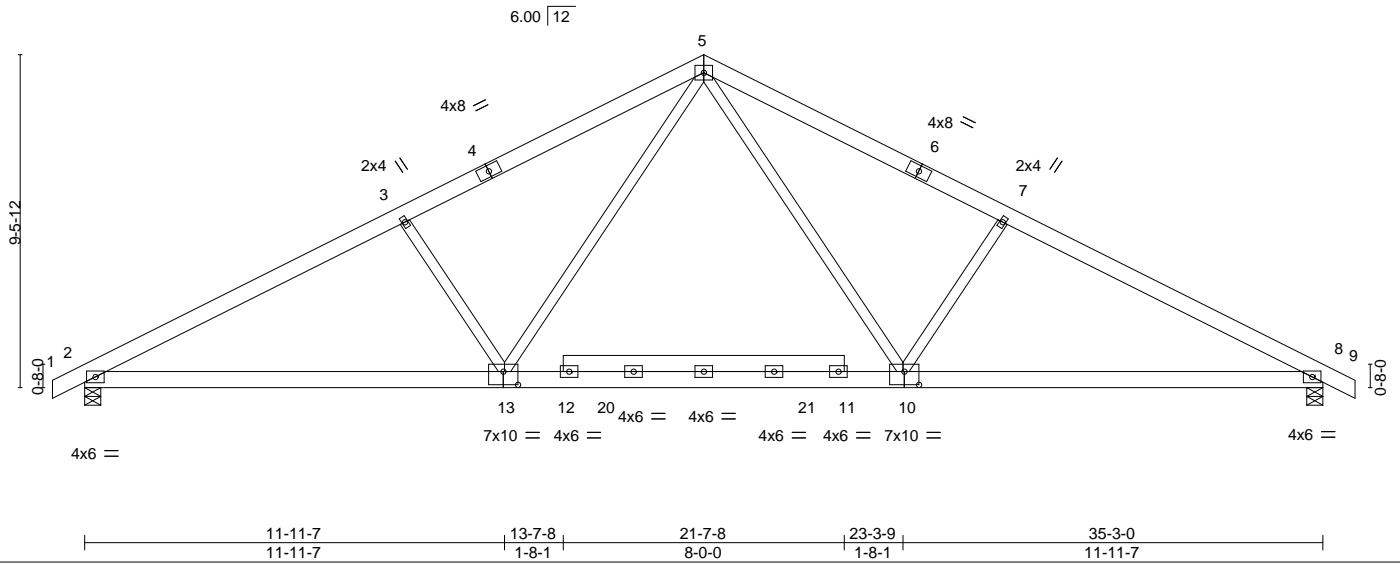


Plate Offsets (X,Y)-- [10:0-5-0,0-4-8], [13:0-5-0,0-4-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.44	Vert(LL) -0.13	10-13	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.62	Vert(CT) -0.27	13-16	>999	180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.31	Horz(CT) 0.05	8	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-MS					Weight: 245 lb	FT = 20%

LUMBER-

TOP CHORD 2x6 SP No.2
 BOT CHORD 2x6 SP No.2
 WEBS 2x4 SP No.2 or 2x4 SPF No.2 *Except*
 7-10,3-13: 2x4 SP No.3, 11-12: 2x6 SP No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-3-14 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 2=0-5-8, 8=0-5-8
 Max Horz 2=-132(LC 11)
 Max Uplift 2=-93(LC 10), 8=-93(LC 11)
 Max Grav 2=1465(LC 1), 8=1465(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-2431/433, 3-5=-2157/453, 5-7=-2157/453, 7-8=-2431/433
 BOT CHORD 2-13=-256/2088, 10-13=-49/1387, 8-10=-256/2088
 WEBS 5-10=-115/832, 7-10=-530/273, 5-13=-115/832, 3-13=-530/273

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 8.



February 3, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
 Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	4 SERENITY - ROOF	156455778
34999-34999A	A8	COMMON	6	1	Job Reference (optional)	

84 Components (Dunn), Dunn, NC - 28334,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Feb 2 13:46:36 2023 Page 1
 ID:nxbot3WxslSjrAw_FcFB3yorwP-dVZVHI?GZ463wrfgtXcFJKgijwzyVALP_7onxpp9bX

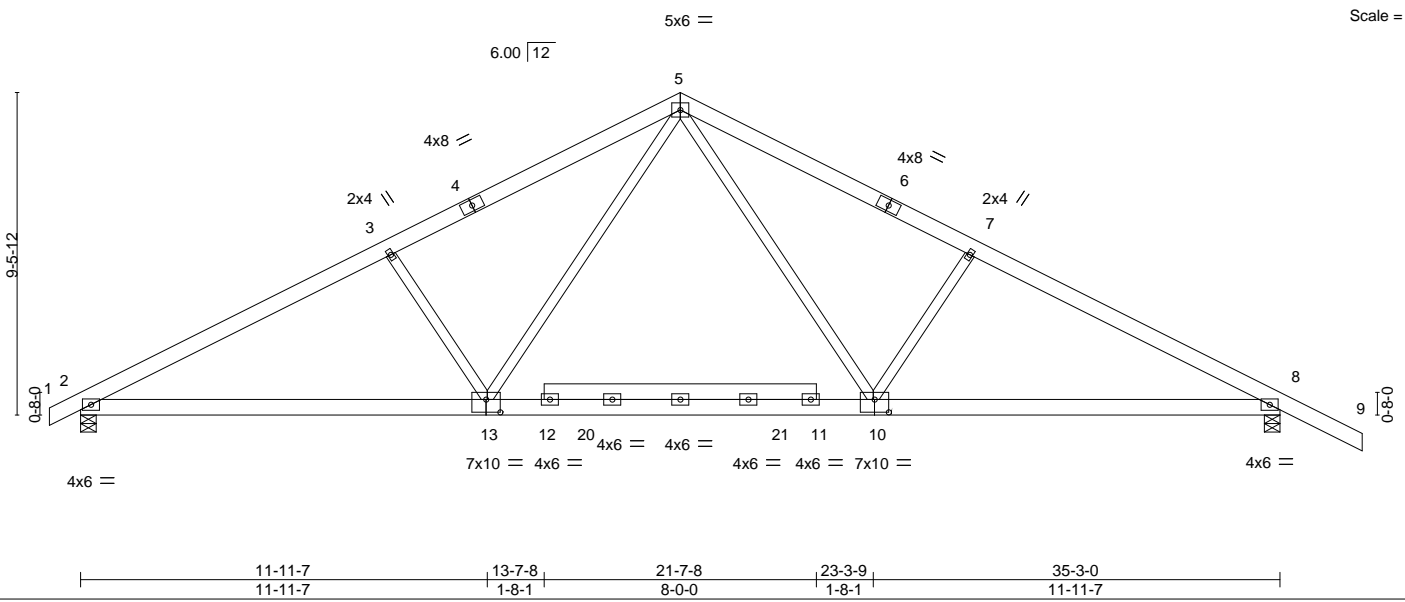


Plate Offsets (X,Y)-- [10:0-5-0,0-4-8], [13:0-5-0,0-4-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.44	Vert(LL) -0.13	10-13	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.62	Vert(CT) -0.27	13-16	>999	180		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.31	Horz(CT) 0.05	8	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-MS					Weight: 249 lb	FT = 20%

LUMBER-
 TOP CHORD 2x6 SP No.2
 BOT CHORD 2x6 SP No.2
 WEBS 2x4 SP No.2 or 2x4 SPF No.2 *Except*
 7-10,3-13: 2x4 SP No.3, 11-12: 2x6 SP No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 4-4-1 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 2=0-5-8, 8=0-5-8
 Max Horz 2=-153(LC 11)
 Max Uplift 2=-93(LC 10), 8=-119(LC 11)
 Max Grav 2=1461(LC 1), 8=1559(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-2422/425, 3-5=-2148/445, 5-7=-2131/429, 7-8=-2404/407
 BOT CHORD 2-13=-205/2080, 10-13=0/1378, 8-10=-186/2059
 WEBS 5-10=-92/812, 7-10=-518/262, 5-13=-118/833, 3-13=-530/273

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=120mph Vasd=95mph; TCDL=6.0psf; BCDL=6.0psf; h=30ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2 except (jt=lb) 8=119.




February 3, 2023

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.

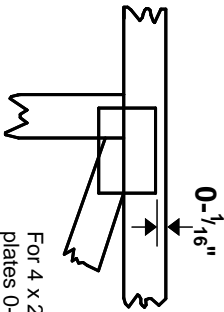

For 4 x 2 orientation, locate plates 0- 1/16" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

* Plate location details available in **MITek 20/20 software** or upon request.

PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur. Min size shown is for crushing only.

Industry Standards:

ANSI/TPI 1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-89: Design Standard for Bracing, Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

6-4-8
dimensions shown in ft-in-sixteenths
(Drawings not to scale)

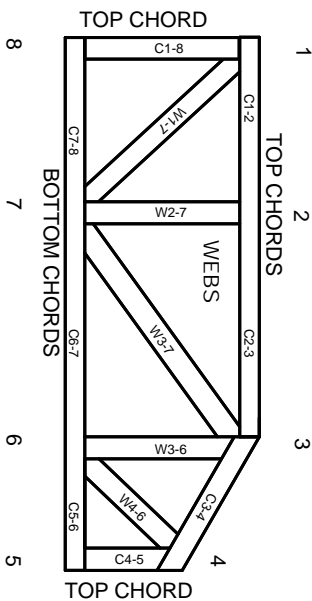

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ESR1988
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TPI 1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MITteK® All Rights Reserved



MITek Engineering Reference Sheet: MI1-7473 rev. 5/19/2020



General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TPI 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TPI 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Rewriting pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TPI 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.