


Job 72308729REP1	Truss A2H	Truss Type Truss	Qty 6	Ply 1	SD RALEIGH/ MCGINNIS BEH Job Reference (optional)
---------------------	--------------	---------------------	----------	----------	--

UFP Mid Atlantic LLC, 5631 S. NC 62, Burlington, NC, Chawn Duty

Run: 8.62 S Sep 22 2022 Print: 8.620 S Sep 22 2022 MiTek Industries, Inc. Wed Jul 19 11:11:58

Page: 1

ID:?PiPLDgeCQ?i0K7ZJRJBezeYtx-WRJkg12n4mdB0SomsJbPbY1XCuPGSmGal1SAtxyXV0

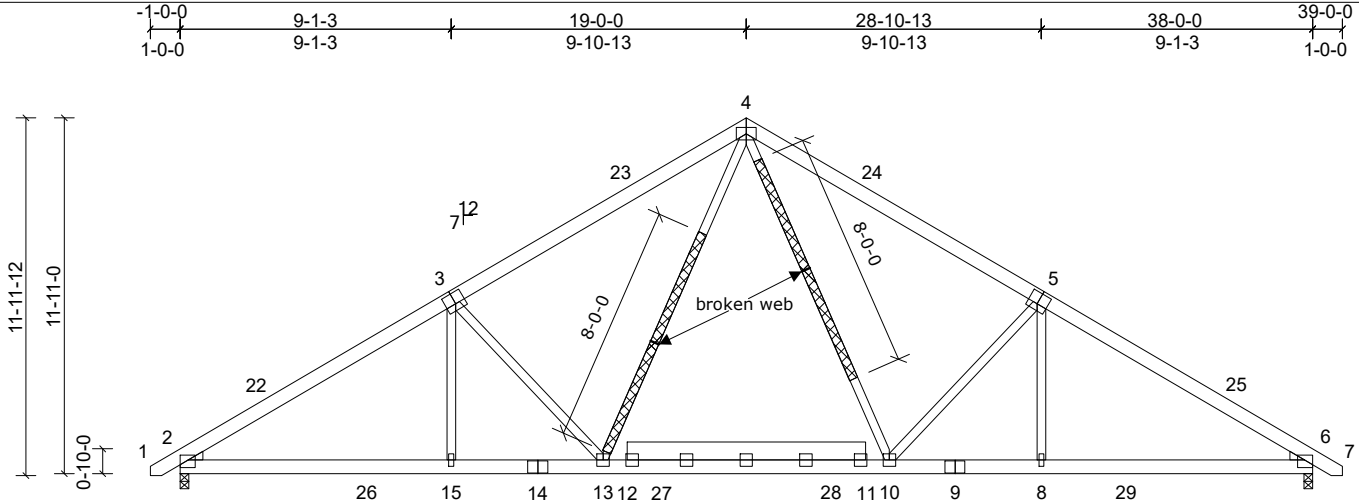

Repair for two broken webs as shown.

Attach 2x4 x 8' SPF No.2 scab to each face of truss centered on break as shown with 2 rows of 10d (.131" x 3") nails 4" oc.




Plate Offsets (X, Y): [2:Edge,0-1-1], [3:0-4-0,0-4-8], [5:0-4-0,0-4-8], [6:Edge,0-1-1]

Loading	(psf)	Spacing	2-3-0	CSI	DEFL	in	(oc)	V/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	Vert(LL)	-0.11	10-13	>999	240	MT20	244/190
Snow (Pf/Pg)	15.4/20.0	Lumber DOL	1.15	BC	Vert(CT)	-0.21	10-13	>999	180		
TCDL	10.0	Rep Stress Incr	NO	WB	Horz(CT)	0.07	6	n/a	n/a		
BCLL	0.0 *	Code	IRC2015/TPI2014	Matrix-MSH							
BCDL	10.0									Weight: 296 lb	FT = 20%

LUMBER		BRACING	
TOP CHORD	2x6 SP No.2	TOP CHORD	2-0-0 oc purlins (3-9-10 max.) (Switched from sheathed: Spacing > 2-0-0). Rigid ceiling directly applied or 10-0-0 oc bracing.
BOT CHORD	2x6 SP No.2 *Except* B3:2x8 SP No.2	BOT CHORD	
WEBS	2x4 SP No.3		
WEDGE	Left: 2x4 SP No.2 Right: 2x4 SP No.2		
REACTIONS	(lb/size)	2=1560/0-3-8, (min. 0-2-2), 6=1560/0-3-8, (min. 0-2-2)	
	Max Horiz	2=322 (LC 10)	
	Max Uplift	2=211 (LC 12), 6=211 (LC 13)	
	Max Grav	2=1827 (LC 24), 6=1827 (LC 25)	
FORCES	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.		
TOP CHORD	2-22=-2764/283, 3-22=-2538/325, 3-23=-2241/365, 4-23=-2069/394, 4-24=-2069/394, 5-24=-2241/365, 5-25=-2538/325, 6-25=-2764/283		
BOT CHORD	2-26=-355/2493, 15-26=-341/2493, 14-15=-341/2492, 13-14=-341/2492, 12-13=-47/1573, 12-27=-47/1573, 27-28=-47/1573, 11-28=-47/1573, 10-11=-47/1573, 9-10=-128/2251, 8-9=-128/2251, 8-29=-127/2252, 6-29=-127/2252		
WEBS	4-13=-170/954, 4-10=-170/954, 5-10=-824/344, 5-8=0/303, 3-13=-823/343, 3-15=0/303		

- NOTES (11)**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior (2) -0-9-12 to 2-11-13, Interior (1) 2-11-13 to 15-2-6, Exterior (2) 15-2-6 to 22-9-10, Interior (1) 22-9-10 to 35-0-3, Exterior (2) 35-0-3 to 38-9-12 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - TCLL: ASCE 7-10; Pr=20.0 psf (roof live load; Lumber DOL=1.15 Plate DOL=1.15); Pg=20.0 psf (ground snow); Pf=15.4 psf (flat roof snow; Lumber DOL=1.15 Plate DOL=1.15); Category II; Exp B; Partially Exp.; Ct=1.10
  - This truss has been checked for uniform snow load only, except as noted.
  - This truss has been designed for greater of min roof live load of 12.0 psf or 2.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 211 lb uplift at joint 2 and 211 lb uplift at joint 6.
  - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
  - This repair has been prepared based on information and use conditions supplied by client. Designer has made a good faith effort to outline damage and repair conditions as reported by client. When actual field conditions do not approximate those indicated on this drawing, client shall immediately inform the engineer and refrain from applying the repair.



This design is based upon parameters shown, and is for an individual building component to be installed and loaded vertically. Applicability of design parameters and proper incorporation of component is responsibility of the Building Designer. Building Designer shall verify all design information on this sheet for conformance with conditions and requirements of the specific building and governing codes and ordinances. Building Designer accepts responsibility for the correctness or accuracy of the design information as it may relate to a specific building. Certification is valid only when truss is fabricated by a UFP plant. Bracing shown is for lateral support of truss members only and does not replace erection and permanent bracing. Refer to Building Component Safety Information (BCSI) for general guidance regarding storage, erection and bracing available from SBCA and Truss Plate Institute.

