




THE NUNEZ

#1248

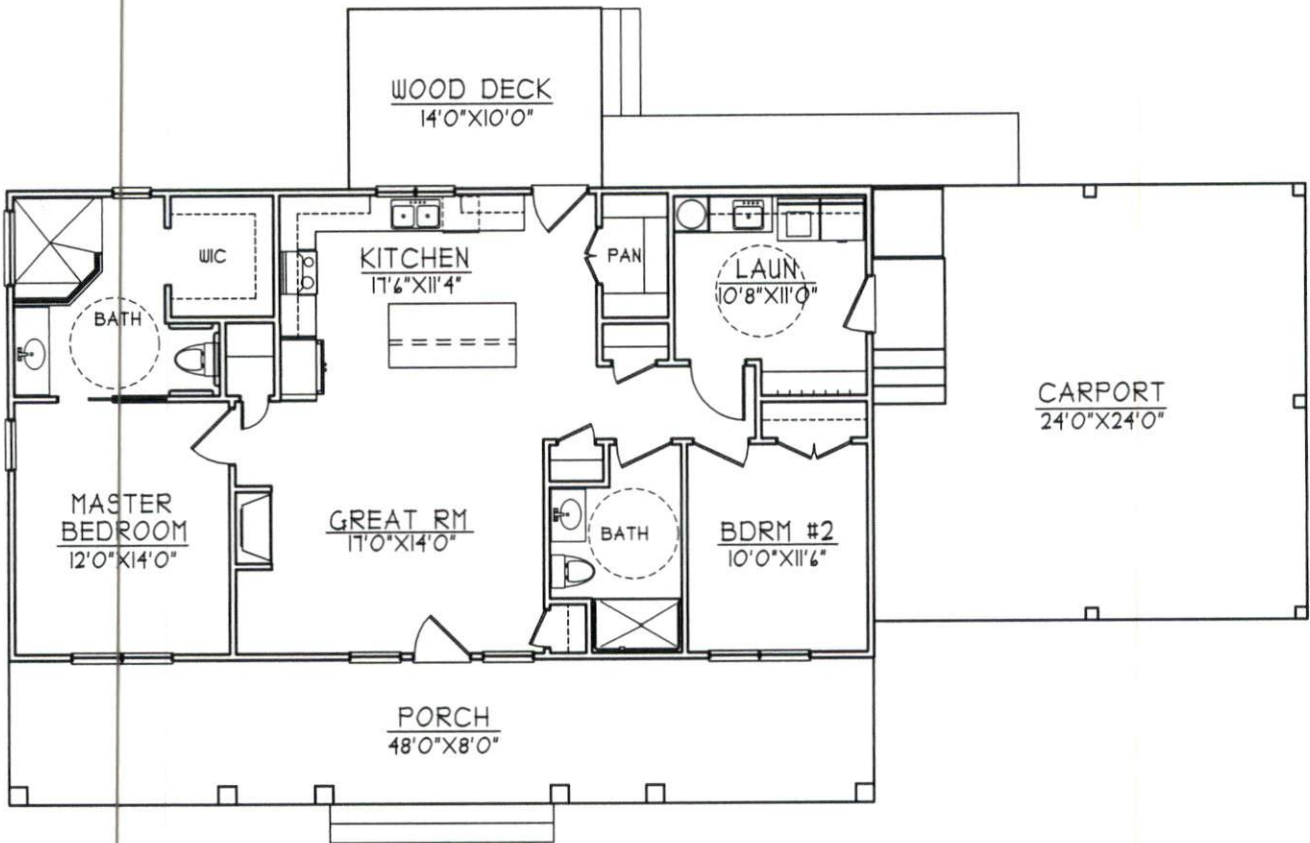

SQUARE FOOTAGE	
FIRST FLOOR	= 1248
CARPORT	= 576
WIDTH	= 12'-0"
DEPTH	= 44'-0"


CONSUMABLE ATTIC VENTILATION:

CONSUMABLE ATTIC VENTILATION:
 THE FREE VENTILATING AREA SHALL BE NOT LESS THAN 1/80 OF THE AREA OF THE SPACE VENTILATED EXCEPT THAT THE AREA MAY BE 1 TO 300 PROVIDED AT LEAST 80 PERCENT OF THE REQUIRED VENTILATING AREA IS PROVIDED BY VENTILATORS LOCATED IN THE UPPER PORTION OF THE SPACE TO BE VENTILATED AT LEAST 3 FEET ABOVE EAVE OR CORNICE VENTS WITH THE BALANCE OF THE REQUIRED VENTILATION TO BE PROVIDED BY EAVE OR CORNICE VENTS.
 GROSS ATTIC AREA TO BE VENTILATED 2208 SQ.FT.
 2208/80 = 4.12 SQ.FT. NET FREE AREA


ENERGY COMPLIANCE
 ZONE 3 = MAX. GLAZING U-FACTOR 35
 R-VALUE = CEILING R30, BALLS R9,
 FLOORS R9
 ZONE 4 = MAX. GLAZING U-FACTOR 35
 R-VALUE = CEILING R38, BALLS R8,
 FLOORS R9



FRONT ELEVATION
 SCALE 1/4" = 1'-0"

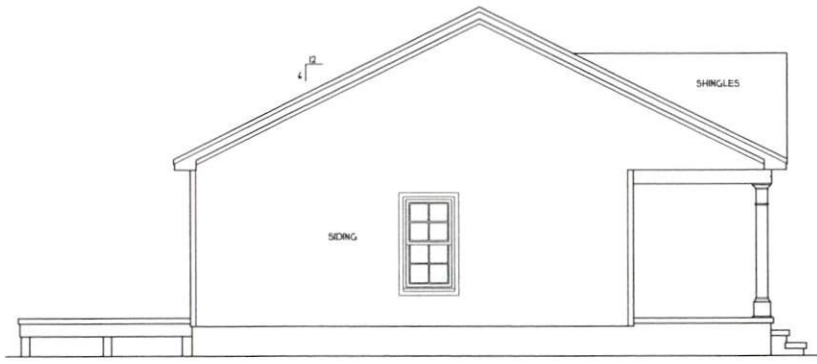


LEFT ELEVATION
 SCALE 1/4" = 1'-0"

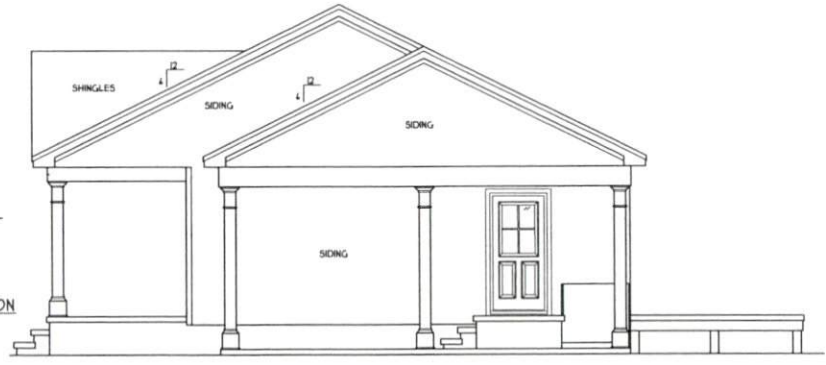


RIGHT ELEVATION
 SCALE 1/4" = 1'-0"



REAR ELEVATION
 SCALE 1/4" = 1'-0"

HEINER & ONDINA NUNEZ PRIVATE RESIDENCE	
HEATED FOOTAGE	#1248
SQUARE FOOTAGE	= 1248 = 298 = 578 = 40
DESIGNED BY:	HEATHER & JONATHAN HALL 195 HEATHERSTONE CT BENSON NC 27504 (866) 207-1403
ANY DEVIATION OF THIS PLAN DIMENSIONS OR OTHERWISE H. SQUARED HOME DESIGN, INC. IS NOT LIABLE.	H SQUARED HOME DESIGN, INC. 
This plan is to be built by the homeowner. Builder is to provide the site block only. Not intended for multiple builds.	THIS PLAN HAS BEEN DRAWN IN ACCORDANCE WITH NORTH CAROLINA STATE RESIDENTIAL BUILDING CODES 2018 EDITION
DATE:	03/08/2023
FILE:	012423

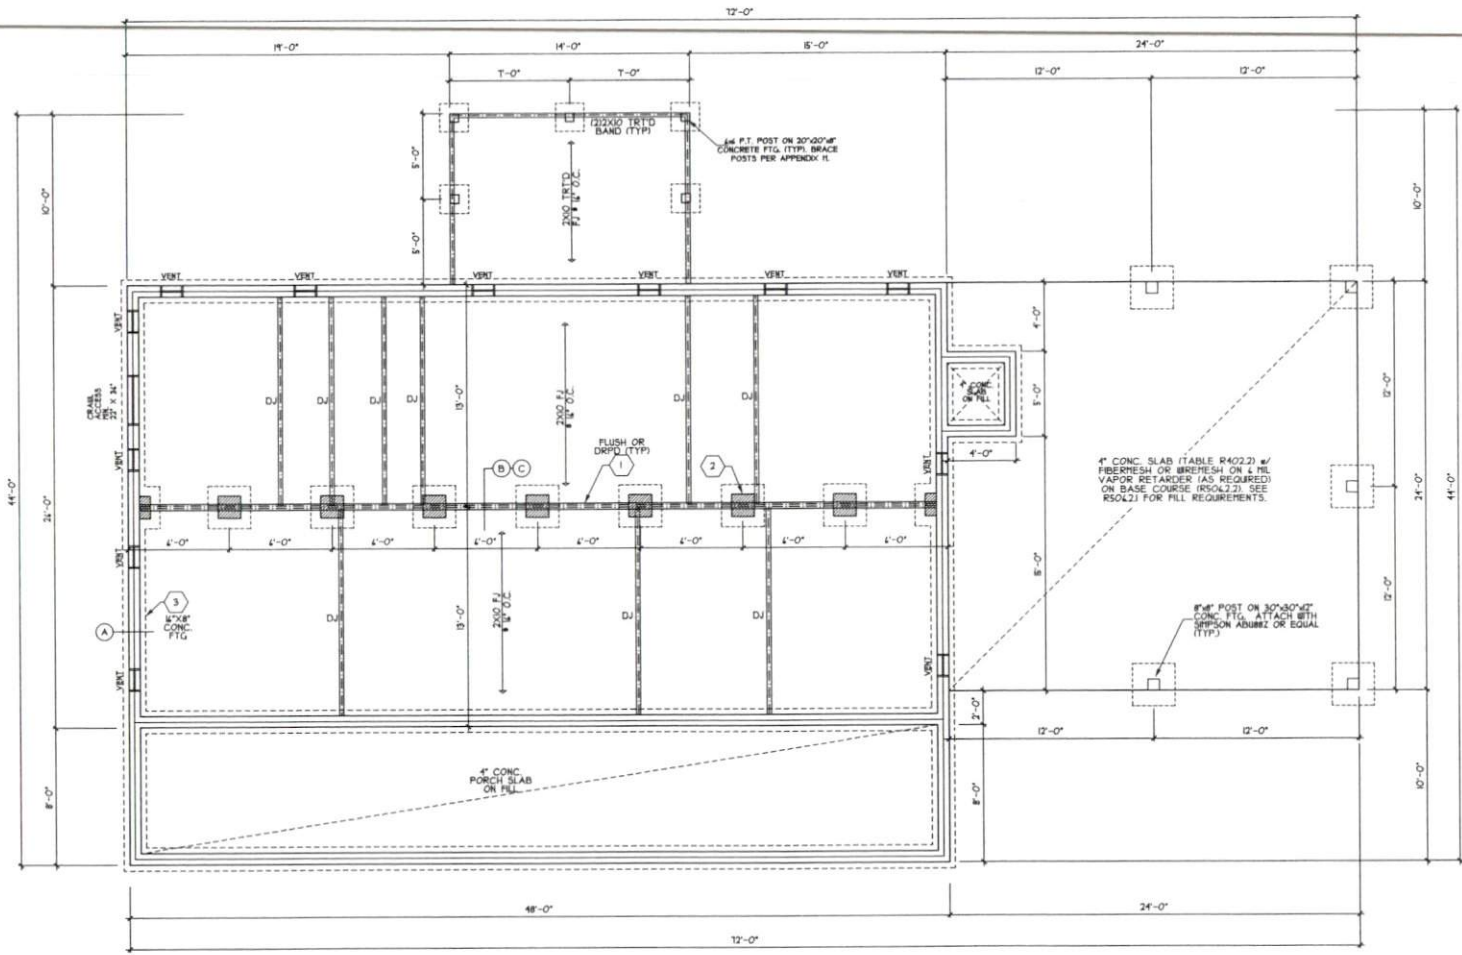

FOUNDATION STRUCTURAL NOTES:

NO ISOL BEARS 24x24x16 VENT

① 20 240 STPK 43 OR SPK43 GRID, TYPICAL I/O.

② CONCRETE BLOCK PER SIZE SHALL BE:
 SIZE HOLLOW MASONRY SOLID MASONRY
 8" x 8" UP TO 32" HIGH UP TO 8'-0" HIGH
 8" x 8" UP TO 48" HIGH UP TO 8'-0" HIGH
 8" x 8" UP TO 64" HIGH UP TO 12'-0" HIGH
 16" x 24" UP TO 56" HIGH
 WITH 30" x 30" x 10" CONCRETE FOOTING I/O.

③ WALL FOOTING AS FOLLOWS:
 DEPTH: 8" - UP TO 2-1/2 STORY
 10" - 3 STORY
 WIDTH: BONG (OR EQUAL):
 - 12" - 1 STORY
 - 20" - 2 STORY
 - 24" - 3 STORY
 BRICK VENEER:
 - 12" - 1 STORY
 - 20" - 2 STORY
 - 24" - 3 STORY

FOR FOUNDATION WALL HEIGHT AND BACKUP/REQUIREMENTS, REFER TO NORTH CAROLINA RESIDENTIAL CODE TABLE R402.1.5 (PART 4).
 NOTE: ASSUMED SOIL BEARING CAPACITY = 3000 PSF.
 CONTRACTOR MUST VERIFY SITE CONDITIONS AND CONTACT SOILS ENGINEER IF MARGINAL OR UNSTABLE SOILS ARE ENCOUNTERED.

④ 14 240 STPK 43 OR SPK43 GRID.
 ⑤ 12 18x15x15 LVL OR LSL GRID.
 ⑥ 12 18x15x15 LVL OR LSL GRID.
 ⑦ 12 18x15x15 LVL OR LSL GRID.

1. "M" DESIGNATES A SIGNIFICANT POINT LOAD TO HAVE SOLID BLOCKING TO PERM. SOLE BLOCK ALL BEAR BEARING POINTS NOTED TO HAVE THREE OR MORE STUDS TO FND. TYPICAL.

2. ABBREVIATIONS:
 "S" = SINGLE JOIST
 "D" = DOUBLE JOIST
 "T" = TRIPLE JOIST

ANCHOR BOLTS
 ANCHOR BOLTS TO BE PLACED WITHIN 12" OF EVERY CORNER AND FRONT EVERY SPICE AND AT 4'-0" O.C. WITH T MIN IN CONC.

FND VENTS
 246/80 = 832 SQ. FT. REQ'D
 832/88 = 10 VENTS
 18" VAPOR BARRIER
 10" VENT MUST BE WITHIN 3'-0" OF EVERY CRNR.

REFER TO BASIC DETAILS SHEET FOR STANDARD DETAILS, BRACING DETAILS, AND STRUCTURAL NOTES.
FOUNDATION PLAN
 SCALE 1/4" = 1'-0"

DAHP PROOFING
 FOR DAHP PROOFING, I WATER PROOFING REFER TO SECTION 405.1.404 IN 2008 EDITION NC RES. CODES

HEINER & ONDINA NUNEZ
 PRIVATE RESIDENCE

#1248

HEATED FOOTAGE = 1248
 SQUARE FOOTAGE = 398
 FIRST FLOOR = 398
 FRONT PORCH = 576
 DBL. CARPORT = 40
 REAR DECK = 40

DESIGNED BY:
 HEATHER W. JOHNSON HALL
 185 HEATHERSTONE CT
 BENSON, NC 27504
 (919) 207-1403


H SQUARED HOME DESIGN, INC.



THIS PLAN HAS BEEN DRAWN IN ACCORDANCE WITH NORTH CAROLINA STATE RESIDENTIAL BUILDING CODED 2008 EDITION.

ANY DEVIATION OF THIS PLAN DIMENSIONS OR OTHERWISE, H SQUARED HOME DESIGN, INC. IS NOT LIABLE.
 This plan is to be built by the licensee. It shall be located on the site block only. Not released for multiple builds.

DATE: 03/09/2023
 I STORY
 FILE: 012423

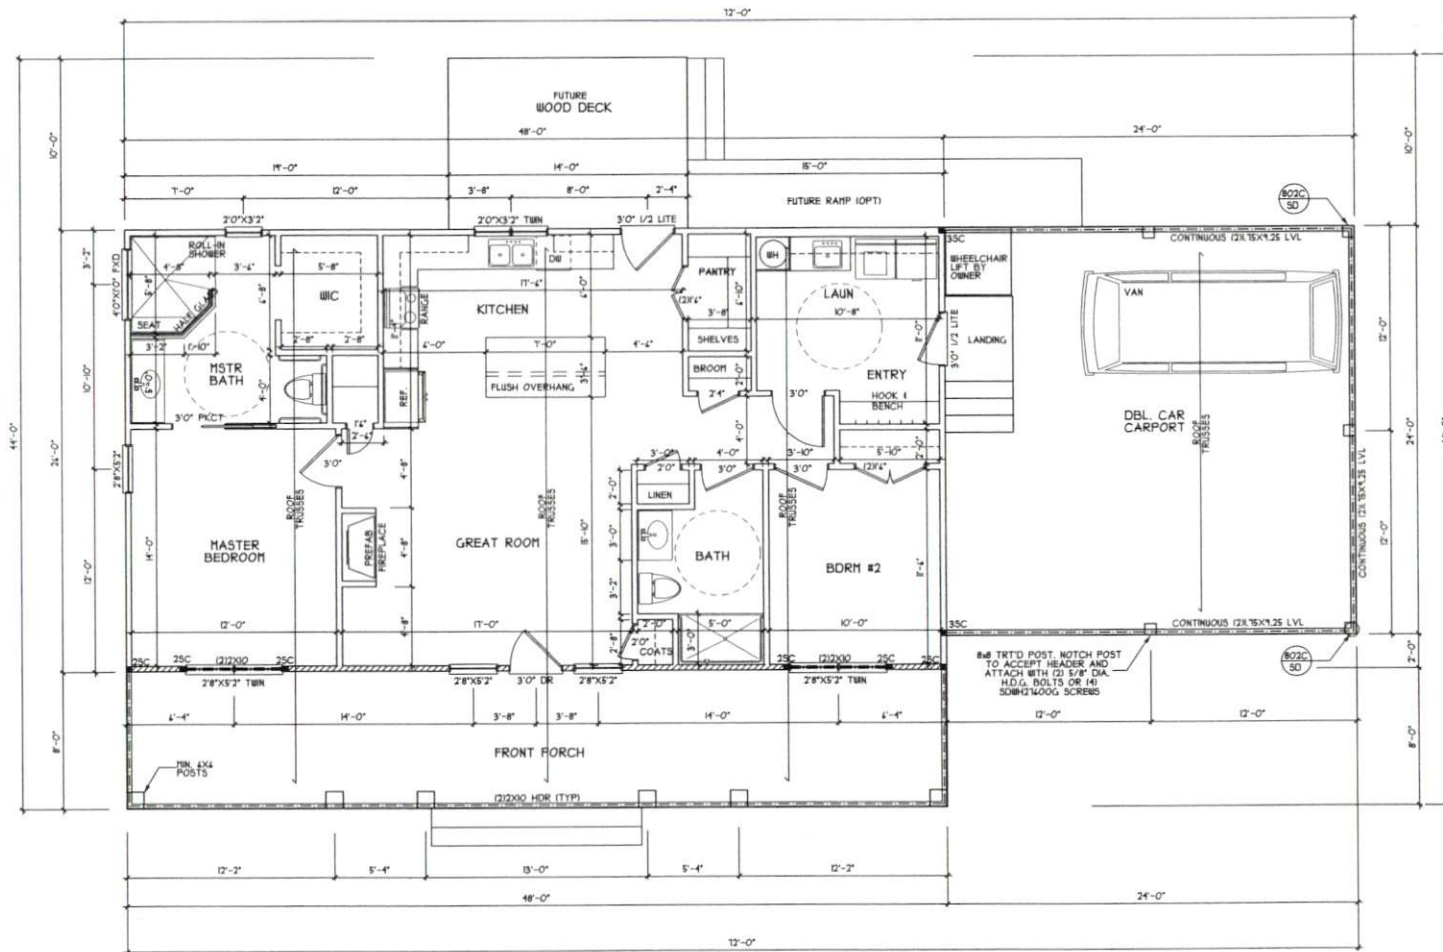

HEADER/DECK & COLUMN NOTES


1. ALL EXTERIOR AND LOAD BEARING HEADERS SHALL BE 11" (2" OVER 4" WALL) OR 12" (2" OVER 4" WALL) WITH SUPPORT STUDS, UNLESS NOTED OTHERWISE.
2. THE NUMBER SHOWN AT HEAD AND HEADER SPACINGS INDICATES THE NUMBER OF STUDS REQUIRED AT EACH END OF HEADERS IN EXTERIOR WALLS SHALL BE ACCORDING TO TABLE R402.3(1) OR AS BELOW:
 - 8" TO 4" SPAN: 4 KING STUDS
 - OVER 4" UP TO 8" SPAN: (2) KING STUDS
 - OVER 8" SPAN: (4) KING STUDS

TRUSS SYSTEM REQUIREMENTS
NC (2006 NCRC) & 8-00 TRP

1. TRUSS SYSTEM LAYOUTS (PLACEMENT PLANS) SHALL BE DESIGNED IN ACCORDANCE WITH SEALED TRUSS PROFILES ANY NEED TO CHANGE TRUSSES SHALL BE COORDINATED WITH THE TRUSS MANUFACTURER.
2. TRUSS SCHEMATICS (PROFILES) SHALL BE PREPARED AND SEALED BY TRUSS MANUFACTURER.
3. ALL TRUSSES SHALL BE DERIGED FOR BEARING ON SPP #2 OR #3 PLATES OR LEDGERS (ONLY).
4. ALL REQUIRED ANCHORS FOR TRUSSES DUE TO BEARING OR BEARING SHALL MEET THE REQUIREMENTS AS SPECIFIED ON THE TRUSS SCHEMATICS.

REFER TO BASIC DETAILS SHEET FOR STANDARD DETAILS, BRACING DETAILS AND STRUCTURAL NOTES

FIRST FLOOR PLAN
SCALE 1/4" = 1'-0"



H SQUARED HOME DESIGN, INC.

HEINER & ONDINA NUNEZ
PRIVATE RESIDENCE

PROJECT # 1248

DEVELOPER BY:
HEATHER & JOHNATHAN HALL
185 HEATHERSTONE CT
BENSON NC 27504
(919) 207-1403

RELATED FOOTAGE:
= 1248
= 296
= 578
= HD

SQUARE FOOTAGE:
FIRST FLOOR
FRONT PORCH
DBL. CARPORT
REAR DECK

THIS PLAN HAS BEEN DRAWN IN ACCORDANCE WITH NORTH CAROLINA STATE RESIDENTIAL BUILDING CODES 308 EDITION.


ANY DEVIATION OF THIS PLAN DIMENSIONS OR OTHERWISE IS SQUARED HOME DESIGN, INC.'S NOT LABEL.

This plan is to be built by the home-owner or builder as shown on this site block only. Not released for multiple builds.

DATE: 03/08/2023

1 STORY

FILE: 012423

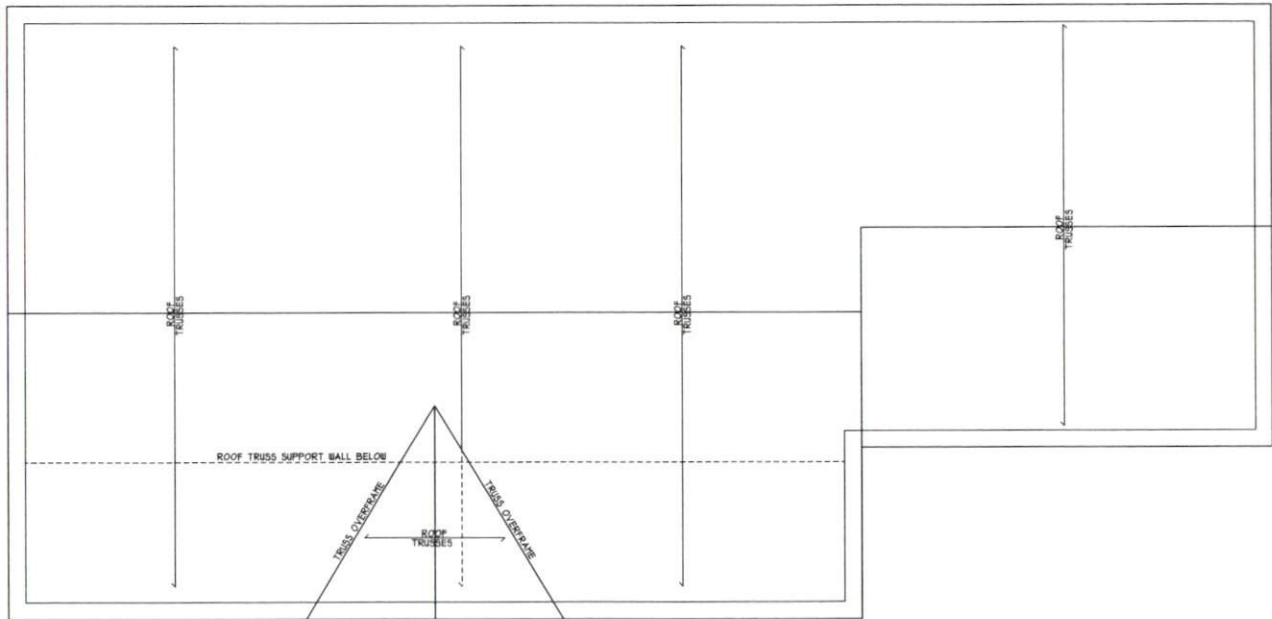

TRUSS SYSTEM REQUIREMENTS

- NC DOW NICKEL 846 8F-30 TRN
1. TRUSS SYSTEM LAYOUTS (PLACEMENT PLANS) SHALL BE DESIGNED IN ACCORDANCE WITH SEALED TRUSS PROFILES. ANY NEED TO CHANGE TRUSSES SHALL BE COORDINATED WITH THE TRUSS MANUFACTURER.
 2. TRUSS SCHEMATICS (PROFILES) SHALL BE PREPARED AND SEALED BY TRUSS MANUFACTURER.
 3. ALL TRUSSES SHALL BE DESIGNED FOR BEARING ON SPP #2 OR #3 PLATES OR LEGGERS (SNG).
 4. ALL REQUIRED ANCHORS FOR TRUSSES DUE TO UPLIFT OR BEARING SHALL MEET THE REQUIREMENTS AS SPECIFIED ON THE TRUSS SCHEMATICS.

REFER TO BASIC DETAILED SHEET FOR STANDARD DETAILS, BRACING DETAILS, AND STRUCTURAL NOTES


ROOF PLAN
SCALE 1/4" = 1'-0"

HEINER & ONDINA NUNEZ
PRIVATE RESIDENCE

#1248

RELATED FOOTAGE
= 1248
= 298
= 578
= HO

DEVELOPED BY:
HEATHER W. JOHNSON HALL
185 HEATHERSTONE CT
BENSON NC 27504
(998) 207-1403



THIS PLAN HAS BEEN DRAWN IN ACCORDANCE WITH NORTH CAROLINA STATE RESIDENTIAL BUILDING CODES 306 EDITION

ANY DEVIATION OF THIS PLAN DIMENSIONS OR OTHERWISE IS SQUARED HOME DESIGN INC. IS NOT LIABLE.
This plan is to be built by the homeowner or builder as shown on this site block only. Not released for multiple builds.

DATE: 03/08/2023
STORY: 1 STORY
FILE: 012423

STRUCTURAL NOTES

1. ALL CONSTRUCTION SHALL CONFORM TO THE LATEST REQUIREMENTS OF THE NORTH CAROLINA STATE RESIDENTIAL CODE - 2008 EDITION, PLUS ALL LOCAL CODES AND REGULATIONS. THE STRUCTURAL ENGINEER OR DESIGNER IS NOT RESPONSIBLE FOR, AND WILL NOT HAVE CONTROL OF, CONSTRUCTION METHODS, TECHNIQUES, SEQUENCES OR PROCEDURES, OR FOR SAFETY PRECAUTIONS AND PROGRAMS IN CONNECTION WITH THE CONSTRUCTION WORK. NOR WILL THE ENGINEER OR DESIGNER BE RESPONSIBLE FOR THE CONTRACTOR'S FAILURE TO CARRY OUT THE CONSTRUCTION WORK IN ACCORDANCE WITH THE CONTRACT DOCUMENTS. "CONSTRUCTION REVIEW" SERVICES ARE NOT PART OF OUR CONTRACT. ALL MEMBERS SHALL BE FRAMED, ANCHORED, TIED AND BRACED IN ACCORDANCE WITH GOOD CONSTRUCTION PRACTICE AND THE BUILDING CODE.

2) LIVE LOADS (R302.4)	LIVE LOAD (PSF)	DEAD LOAD (PSF)	DEFLECTION (I/D)
ROOFS OTHER THAN SLEEPING ROOFS	40	10	L/340
SLEEPING ROOFS	30	10	L/340
ATTIC WITH PERMANENT STAIR	40	10	L/240
ATTIC WITH OUT PERMANENT STAIR	20	10	L/340
ATTIC WITH OUT STORAGE	40	10	L/240
STAIRS	40	10	L/340
EXTERIOR BALCONIES	40	10	L/340
DECKS	40	10	L/340
GUARDRAILS AND HANDRAILS	400	---	---
PASSENGER VEHICLE GARAGES	50	10	L/340
WRE ESCAPES	40	10	L/340
SNOW	20	---	---

WIND LOAD (BASED ON 15/20 MPH WIND VELOCITY 1 EXPOSURE B)

3) WALL BRACING: BRACED WALL PANELS SHALL BE CONSTRUCTED ACCORDING TO SECTION R402.3. THE ANCHOR AND LOCATION OF BRACING SHALL COMPLY WITH TABLE R402.3.4. THE LENGTH OF BRACED PANELS SHALL BE DETERMINED BY SECTION R402.3.4. LATERAL BRACING SHALL BE SATISFIED PER METHOD 3 BY CONTINUOUS SHEATHING WALLS WITH STRUCTURAL SHEATHING PER SECTION R402.3.3. NOTE THAT ANY SPECIFIC BRACED WALL DETAIL SHALL BE INSTALLED AS SPECIFIED.

4) CONCRETE SHALL HAVE A MINIMUM 28 DAY STRENGTH OF 3000 PSI AND A MAXIMUM SLUMP OF 6 INCHES UNLESS NOTED OTHERWISE (IND). AIR ENTRAINMENT PER TABLE 402.2. ALL CONCRETE SHALL BE PROPORTIONED, MIXED, HANDLED, SAMPLED, TESTED, AND PLACED IN ACCORDANCE WITH ACI STANDARDS. ALL SAMPLES FOR CURING SHALL BE TAKEN FROM THE EXT. END OF THE PUMP.

5) ALLOWABLE SOIL BEARING PRESSURE ASSUMED TO BE 2000 PSF. THE CONTRACTOR MUST CONTACT A GEOTECHNICAL ENGINEER AND THE STRUCTURAL ENGINEER IF UNSATISFACTORY SUBSURFACE CONDITIONS ARE ENCOUNTERED. THE SURFACE AREA ADJACENT TO THE FOUNDATION WALL SHALL BE PROVIDED WITH ADEQUATE DRAINAGE AND SHALL BE GRADED SO AS TO DRAIN SURFACE WATER AWAY FROM FOUNDATION WALLS.

6) ALL BRACING LUMBER SHALL BE SYP #2 (F_v = 85 PSF UNLESS NOTED OTHERWISE (IND)). ALL TREATED LUMBER SHALL BE SYP # 2 (F_v = 75 PSF). PLATE MATERIAL MAY BE SYP # 3 OR SYP #3 (F_v = 425 PSF - 175K).

7) ALL WOODEN BEAMS AND HEADERS SHALL HAVE THE FOLLOWING END SUPPORTS: (1) 2x4 STUD COLUMN FOR 4'-0" MAX. BEAM SPAN (IND); (2) 2x4 STUDS FOR BEAM SPAN GREATER THAN 4'-0" (IND).

8) L.V.L. SHALL BE LAMINATED VENEER LUMBER: F_b = 2400 PSI, F_v = 285 PSI, E = 1.940 PSI. P.S.L. SHALL BE PARALLEL STRAND LUMBER: F_b = 2700 PSI, F_v = 270 PSI, E = 2.040 PSI. L.S.L. SHALL BE LAMINATED STRAND LUMBER: F_b = 2250 PSI, F_v = 400 PSI, E = 1.550 PSI. INSTALL ALL CONNECTIONS PER MANUFACTURERS INSTRUCTIONS.

9) ALL ROOF TRUSS AND I-JOIST LAYOUTS SHALL BE PREPARED IN ACCORDANCE WITH ANY SEALED STRUCTURAL DRAWINGS. TRUSSES AND I-JOISTS SHALL BE INSTALLED ACCORDING TO THE MANUFACTURER'S SPECIFICATIONS. ANY CHANGE IN TRUSS OR I-JOIST LAYOUT SHALL BE COORDINATED WITH DESIGNER OR ENGINEER.

10) ALL STRUCTURAL STEEL SHALL BE ASTM A-36. STEEL BEAMS SHALL BE SUPPORTED AT EACH END WITH A MINIMUM BEARING LENGTH OF 3 1/2" INCHES AND FULL FLANGE WIDTH. PROVIDE SOLID BEARING FROM BEAM SUPPORT TO FOUNDATION. BEAMS SHALL BE ATTACHED TO EACH SUPPORT WITH TWO LAG SCREWS 1/2" DIAMETER x 4" LONG. LATERAL SUPPORT IS CONSIDERED ADEQUATE PROVIDED THE JOIST ARE TOE NAILED TO THE SOLE PLATE, AND SOLE PLATE IS NAILED OR BOLTED TO THE BEAM FLANGE x 4" O.C.

11) ALL STEEL TURNING SHALL BE ASTM A501.

12) REBAR SHALL BE DEFORMED STEEL, ASTM A615, GRADE 40.

13) FLITCH BEAMS SHALL BE BOLTED TOGETHER USING (2) ROWS OF 1/2" DIAMETER BOLTS (ASTM A307) WITH WASHERS PLACED UNDER THE THREADED END OF BOLT. BOLTS SHALL BE SPACED AT 24" O.C. (MAX.) AND STAGGERED AT THE TOP AND BOTTOM OR BEAR 12" EDGE DISTANCE, WITH 2 BOLTS LOCATED AT 4" FROM EACH END.

14) BRICK LINTELS SHALL BE 3 1/2" x 1/2" x 4" STEEL ANGLE FOR UP TO 4'-0" SPAN AND 4" x 4" x 1/4" STEEL ANGLE WITH 4" LEG VERTICAL FOR SPANS UP TO 4'-0" (IND).

15) THE POSITIVE AND NEGATIVE DESIGN PRESSURE FOR DOORS AND WINDOWS FOR A REAR ROOF HEIGHT OF 36 FEET OR LESS SHALL BE 25 PSF.

16) THE POSITIVE AND NEGATIVE DESIGN PRESSURES REQUIRED FOR ANY ROOF OR WALL CLADDING APPLICATION NOT SPECIFICALLY ADDRESSED IN THE NORTH CAROLINA STATE RESIDENTIAL CODE - 2008 EDITION SHALL BE AS FOLLOWS:

ROOF:
4:1 PSF - 2:12:12 PITCH OR LESS
3:4:1 PSF - 2:12:12 TO 12:12 PITCH
2:1 PSF - 12:12 TO 12:12 PITCH

WALLS:
2:1 PSF - WALLS

FOUNDATION STRUCTURAL NOTES

NC (2008 NCR) AND 15-00 MPH

(1) (3) 240 SYP #2 OR SYP #2 GRIDER, TYPICAL, UNO.

(2) CONCRETE BLOCK PIER SIZE SHALL BE:
SIZE HOLLOW MASONRY SOLID MASONRY
8 x 8 UP TO 32" HIGH UP TO 5'-0" HIGH
12 x 8 UP TO 48" HIGH UP TO 7'-0" HIGH
16 x 8 UP TO 64" HIGH UP TO 12'-0" HIGH
24 x 24 UP TO 96" HIGH
WITH 30" x 30" x 10" CONCRETE FOOTING, UNO.

(3) DESIGN FOOTING AS FOLLOWS:
DEPTH: 8" - UP TO 2-1/2 STORY
10" - 3 STORY
12" - 4 STORY

(4) 240 SYP #2 OR SYP #2 GRIDER:
- 20" - 3 STORY
- 12" - 1 STORY
- 20" - 2 STORY
- 24" - 3 STORY

FOR FOUNDATION WALL HEIGHT AND BACKFILL REQUIREMENTS, REFER TO NORTH CAROLINA RESIDENTIAL CODE TABLE R401.1 (1) THROUGH (4). NOTE: ASSUMED SOIL BEARING CAPACITY = 2000 PSF. CONTRACTOR MUST VERIFY SITE CONDITIONS AND CONTACT SOILS ENGINEER IF HAZARDOUS OR UNSTABLE SOILS ARE ENCOUNTERED.

(5) (1) 240 SYP #2 OR SYP #2 GRIDER
(2) 1.5X1.25 LVL OR LSL GRIDER
(3) 1.5X1.25 LVL OR LSL GRIDER

1. 'M' DESIGNATES A SIGNIFICANT POINT LOAD TO HAVE SOLID BLOCKING TO PER. SOLID BLOCK AT BEAR BEARING POINTS NOTED TO HAVE THREE OR MORE STUDS TO FND, TYPICAL.

8. ABBREVIATIONS:
'S' = SINGLE JOIST
'D' = DOUBLE JOIST
'T' = TRIPLE JOIST

TRUSS SYSTEM REQUIREMENTS

NC (2008 NCR)

1. TRUSS SYSTEM LAYOUTS (PLACEMENT PLANS) SHALL BE DESIGNED IN ACCORDANCE WITH SEALED TRUSS PROFILES. ANY NEED TO CHANGE TRUSSES SHALL BE COORDINATED WITH THE TRUSS MANUFACTURER.

2. TRUSS SCHEMATICS (PROFILES) SHALL BE PREPARED AND SEALED BY TRUSS MANUFACTURER.

3. ALL TRUSSES SHALL BE DESIGNED FOR BEARING ON SYP #2 OR #3 PLATES OR LEDGERS (IND).


4. ALL REQUIRED ANCHORS FOR TRUSSES (UP TO 120 LB OR BEARING SHALL MEET THE REQUIREMENTS AS SPECIFIED ON THE TRUSS SCHEMATICS.

HEADER/BEAM & COLUMN NOTES


1. ALL EXTERIOR AND LOAD BEARING HEADERS SHALL BE MIN. (2) 2x10 (4" WALL) OR (3) 2x10 (4" WALL) WITH (1) SUPPORT STUD, UNLESS NOTED OTHERWISE.

2. THE NUMBER SHOWN AT BEAM AND HEADER SUPPORTS INDICATES THE NUMBER OF SUPPORT STUDS REQUIRED IN STUD POCKET OR COLUMN. THE NUMBER OF KING STUDS AT EACH END OF HEADERS IN EXTERIOR WALLS SHALL BE ACCORDING TO ITEM "d" IN TABLE R402.3(5) OR AS BELOW:


- UP TO 4' SPAN: (1) KING STUD
- OVER 4' UP TO 8' SPAN: (2) KING STUDS
- OVER 8' UP TO 12' SPAN: (3) KING STUDS
- OVER 12' SPAN: (4) KING STUDS

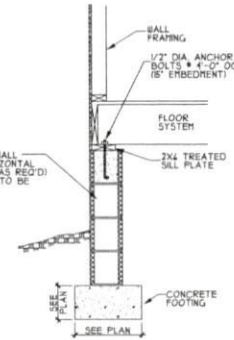



(A) CRAWL SPACE FOOTING (INDIC)

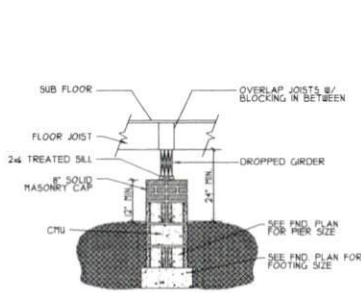

(B) DROPPED GIRDER NTS

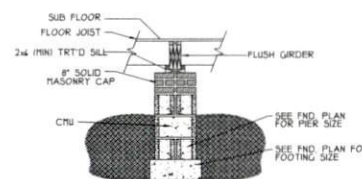

(C) FLUSH GIRDER



(INDIC) POST/POST CONNECTION AT CORNER



BASIC BUILDING
DETAIL SHEET (115-120 MPH)

PLEASE NOTE THAT NOT ALL DETAILS APPLY TO EVERY PLAN.

HEATHER HALL
185 HEATHERSTONE CT
BENSON, NC 27504
(919) 207-4003

H SQUARED HOME DESIGN, INC.



ANY REVISED PERMITS OR LOCAL CODES SHALL BE OBTAINED BY THE CONTRACTOR. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND LOCAL CODES. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND LOCAL CODES.

DATE: _____
FILE: _____