

Joe E Godwin Sr. , P.E., P.L.S.

Jason E Godwin , P.L.S.

**E**NOCH  
ENGINEERS, P.A.  
1403 NC Highway 50 South  
Benson, North Carolina 27504  
919.894.7765

Email: [general@enochengineers.com](mailto:general@enochengineers.com)

[www.enochengineers.com](http://www.enochengineers.com)

## MATERIALS & TEST DIVISION

### FIELD REPORT

#### PROJECT

CLIENT: KEN DAWSON HOMES  
PROJECT: RESI FOOTING  
ADDRESS: 6983 US-401  
LOT #: FUQUAY VARINA NC

DATE: 5.24.23  
CONTRACTOR: C. GILBERT  
TECHNICIAN: BH

#### TEST SUMMARY

PERFORMED SOIL BEARING CAPACITY EVALUATION AT SITE NOTED ABOVE.  
FOOTING SOILS CONFIRMED A MINIMUM ALLOWABLE BEARING CAPACITY OF 2000PSF AT ALL FOOTING LOCATIONS.  
BACKFILL UNDERCUT AREAS WITH WASHED #57 STONE TO GRADE.  
FORM FOOTING ATOP STONE.


#### TESTING RESULTS

SERVICE PERFORMED	TEST NO.	COMP %	WD PCF	DD PCF	MOISTURE %

#### RETURN VISIT REQUIRED

YES   
NO

TECHNICIAN:

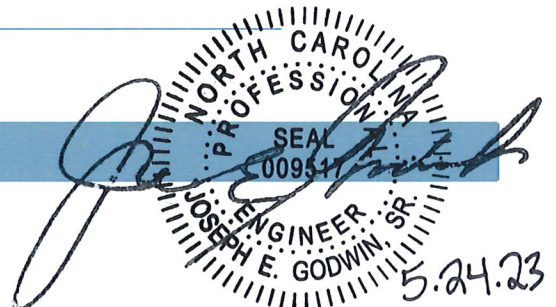

Disclaimer:

Soils & Material inspections, testing results and on-site determinations contained in this report become void after 30 days of non-use of this report and/or following any inclement weather which causes structural soil or material deterioration. Additional testing will be required following a voided report determined by a North Carolina Building Code enforcement official or Enoch Engineers P.A. The client/contractor is responsible for notifying Enoch Engineers P.A. of any soil & material condition changes which could void this report.