

# Harnett County Department of Public Health

PERMIT # SFD 2304-0075

## Operation Permit

New Installation     Septic Tank     Nitrification Line     Repair     Expansion

PROPERTY LOCATION: 358 Hazel Wood Rd, Lillington

Name: (owner) Jw Sealey and Associates    SUBDIVISION South Creek    LOT # 108

System Installer: Jones Septic

Basement with plumbing:     Garage      Number of Bedrooms 3


Type of Water Supply:  Community     Public     Well    Distance from well \_\_\_\_\_ feet

System Type: 25% Reduction Type III (3) Chamber    Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

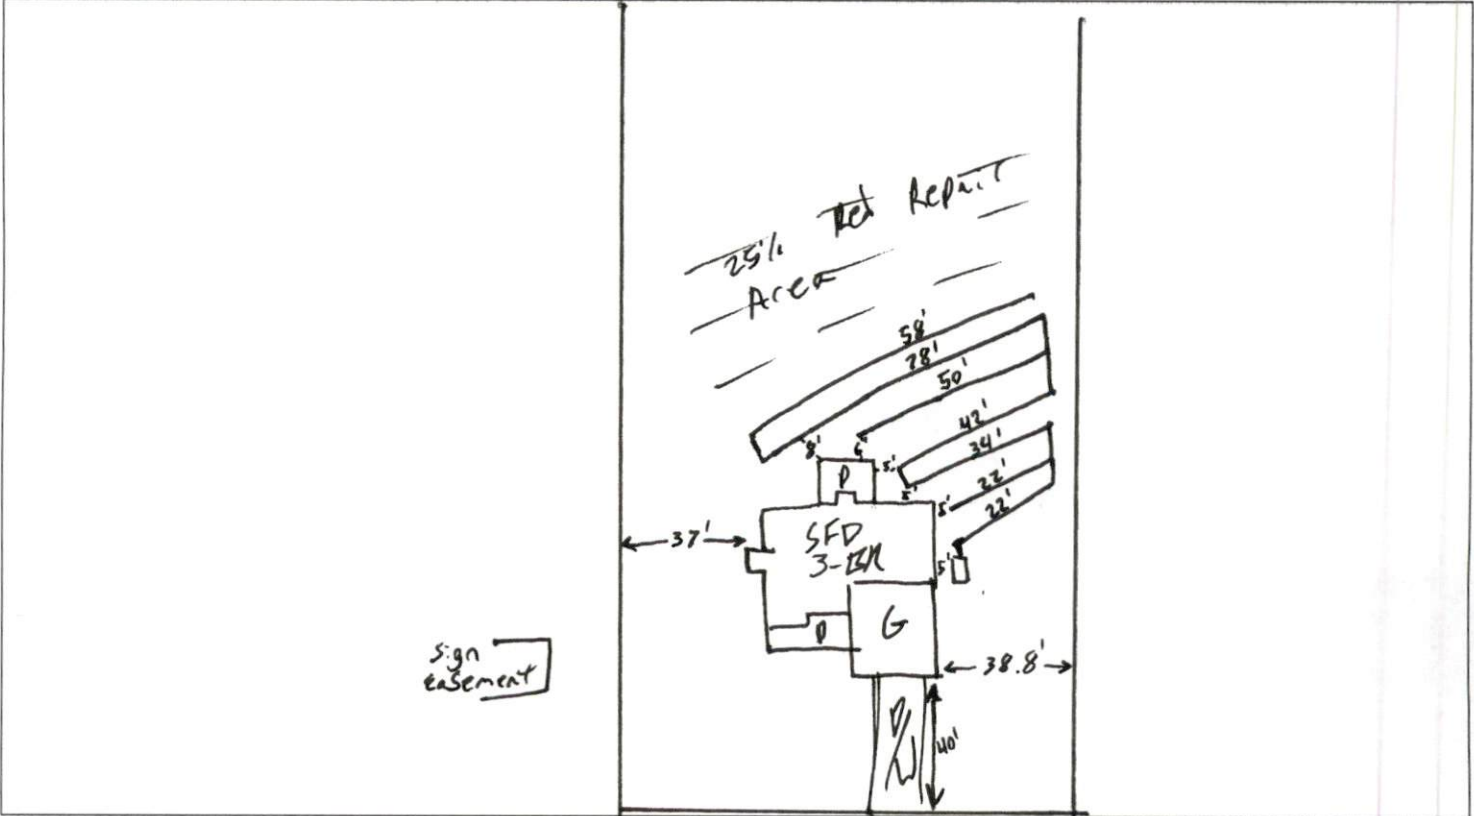

**PERMIT CONDITIONS:**

I. Performance: System shall perform in accordance with Rule .1961

II. Monitoring: As required by Rule .1961.

III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_

Subsurface system operator required? Yes  No

If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: \_\_\_\_\_

V. Other: \_\_\_\_\_

D-Box     Pump     Alarm     H2O Line     PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional     Other Type III (3) Chamber    Septic Tank: 1400 gallons    Pump Tank: \_\_\_\_\_ gallons

Subsurface    No. of    exact length    width of    depth of  
Drainage Field    ditches 1    of each ditch 306' feet    ditches 3' feet    ditches 22" inches

French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent: REHS    Date 4-9-24