


THIS IS A TRUSS/COMPONENT PLACEMENT DIAGRAM (TPD) ONLY; NOT AN ENGINEERED DOCUMENT. Trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual truss design drawings (TDD's) for each truss design identified on the TPD. The building designer is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the support structure including but not limited to headers, beams, walls, and columns is also the responsibility of the building designer. For general guidance regarding installation and bracing, consult "Building Component Safety Information" (BCSI) available from the SBC Association (www.sbcassociation.com). It is the responsibility of the General Contractor to verify that the provided component layout matches the final intended construction plans, loading conditions, and use. If they do not, it is the responsibility of the General Contractor to notify UFP and provide plans containing the latest specifications and designs. UFP will not be responsible for plan changes by others after final approval of shop drawings, or for errors or modifications made on-site during construction. DO NOT CUT, NOTCH, DRILL, OR OTHERWISE "REPAIR" MANUFACTURED TRUSSES IN ANY WAY WITHOUT PRIOR WRITTEN AUTHORIZATION BY A LICENSED PROFESSIONAL DESIGNATED BY UFP. The Framing is responsible to verify all dimensions, including adjusting member spacing within tolerances to allow for the drop and rise of plumbing/HVAC, unless noted otherwise. Truss-to-wall connections, if shown, are for uplift only and do not consider lateral loads. All connectors on this project are to be installed per the connector manufacturer's specifications. All connectors shown that are not truss-to-truss are suggestions only and are to be verified by the Building Designer or Engineer of Record for suitability to this particular project. UFP accepts no responsibility for the specific application or suitability of any connector that is not truss-to-truss as they apply to this specific structure.

ROOF TRUSS CRITERIA	
BUILDING CODE	IRC2015
SNOW LOAD	
TOP CHORD DEAD LOAD	10.000 lb/ft <sup>2</sup>
BOTTOM CHORD LIVE LOAD	0.000 lb/ft <sup>2</sup>
BOTTOM CHORD DEAD LOAD	10.000 lb/ft <sup>2</sup>
LIVE LOAD DEFLECTION	240
TOTAL LOAD DEFLECTION	180
ROOF AREA	3773.33 sq ft
RIDGE LINE	0 ft
VALLEY LINES	0 ft
HIP LINES	0 ft
△ INDICATES LEFT END OF TRUSS	

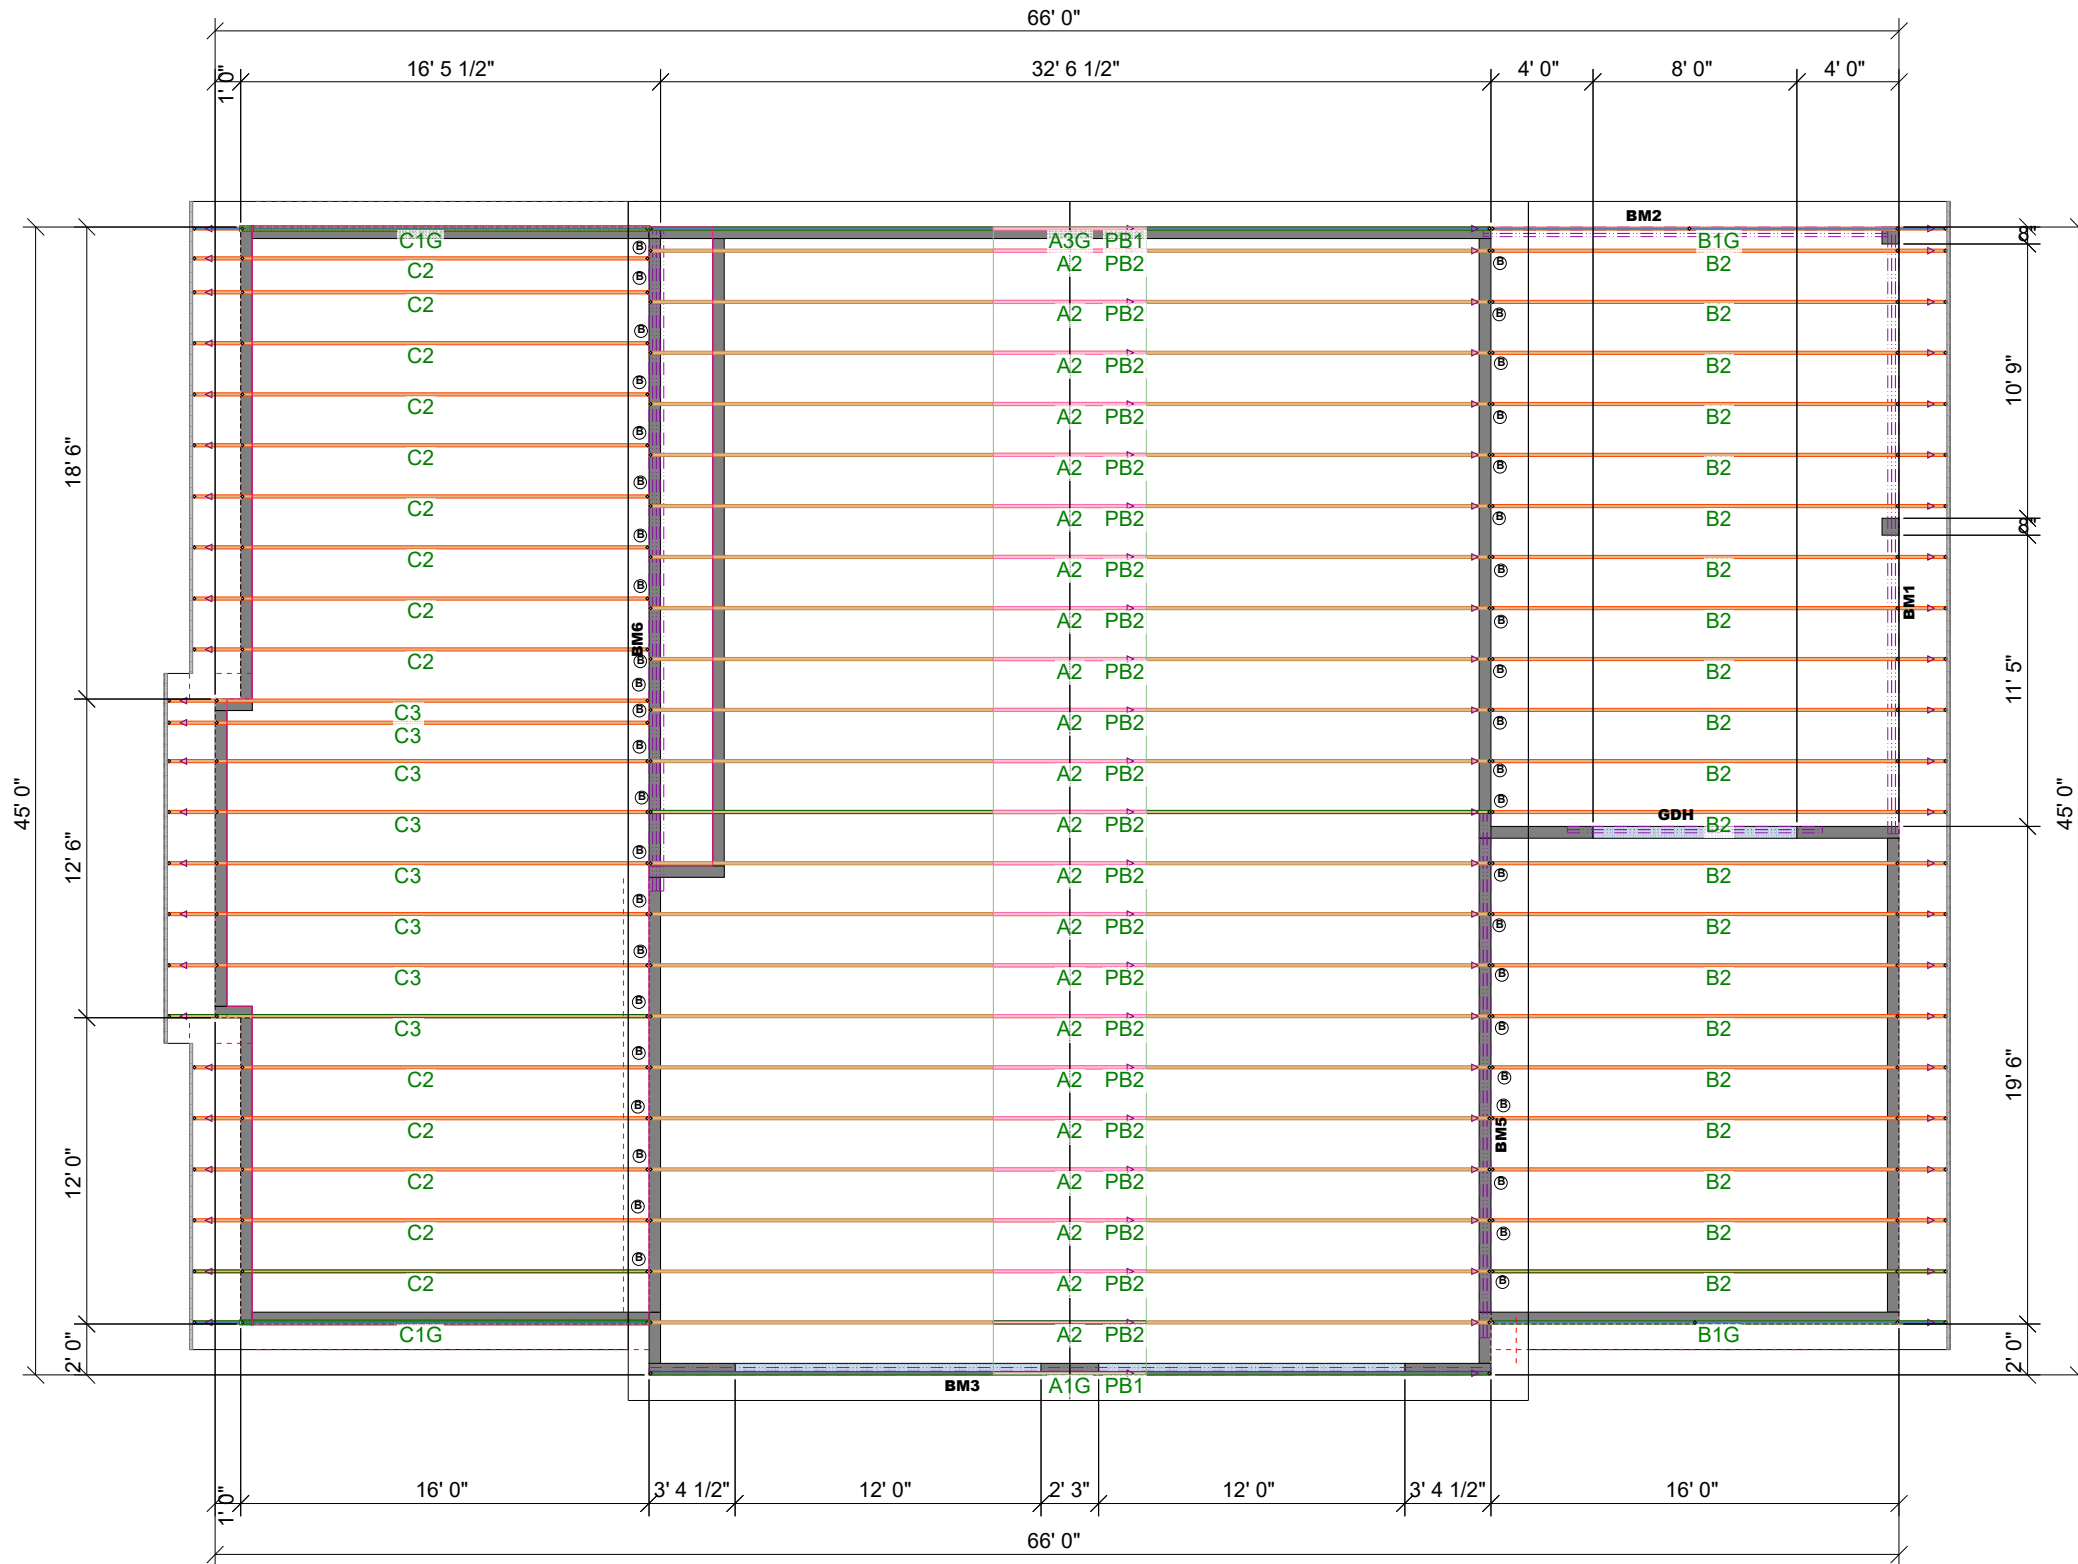

Roof Hanger List			
MARK	TYPE	DESCRIPTION	QTY
(B)	JUS26	FACE MOUNT HANGER	43

Products					
PlotID	Length	Product	Plies	Net Qty	Fab Type
BM3	34' 0"	1 3/4" x 9 1/4" 2.0E Microllam® LVL	2	2	MFD
BM1	24' 0"	1 3/4" x 9 1/4" 2.0E Microllam® LVL	3	3	MFD
BM5	22' 0"	1 3/4" x 20" 2.0E Microllam® LVL	3	3	MFD
BM6	28' 0"	1 3/4" x 24" 2.0E Microllam® LVL	4	4	MFD

**PLACEMENT PLAN**

SCALE: N.T.S

REVISIONS	
DATE	DESCRIPTION

DESIGNER E. GRAHAM  
 LAYOUT DATE 4/28/2023  
 ARCH DATE -  
 STRUC DATE -

JOB #: 23042507

**POPE BUILDERS**

**THOMPSON BARN**

This drawing is property of UFP Site Built, LLC. Any unauthorized use of this document without written permission is prohibited. UFP relinquishes ownership of delivered product upon delivery. Owner of product must obtain UFP's authorization prior to any alteration or modification of product. UFP will not be held responsible for any unauthorized modifications done or costs incurred without prior written authorization from UFP.



TRUSS TRAX  
 UFP CONSTRUCTION  
 TrussTraxufp.com

**UFP SITE BUILT**  
 A UFP INDUSTRIES COMPANY

Burlington, NC  
 Chesapeake, VA  
 Clinton, NC  
 Conway, SC  
 Jefferson, GA

Locust, NC  
 Liberty, NC  
 Ooltewah, TN  
 Pearisburg, VA  
 Stanfield, NC

Customer Service (800) 476-9356

