

FRONT ELEVATION

Scale: 1/4" = 1'0"

9'0" CEILING HEIGHT FIRST FLOOR (HEADER HEIGHT 7'6") 8'0" CEILING HEIGHT SECOND FLOOR (2X10" HEADERS FRAMED TO TOP PLATES')

FRAME WINDOWS TO HEADER HEIGHT



LEFT ELEVATION

Scale: 1/8" = 1'0"



REAR ELEVATION

Scale: 1/8" = 1'0"



RIGHT ELEVATION

Scale: 1/8" = 1'0"

PLAN: Rand

ELEVATIONS

35 PROJECT ADDRESS: 16 Hancock Ct. Liberty Meadows Lot 35

Precision Custom Hom Raeford, NC In@PrecisionCustomHom

DATE:

8/15/23

SCALE:


1/4" = 1'

SHEET:



FOUNDATION

PROJECT ADDRESS: 16 Hancock Ct. Liberty Meadows Lot 35

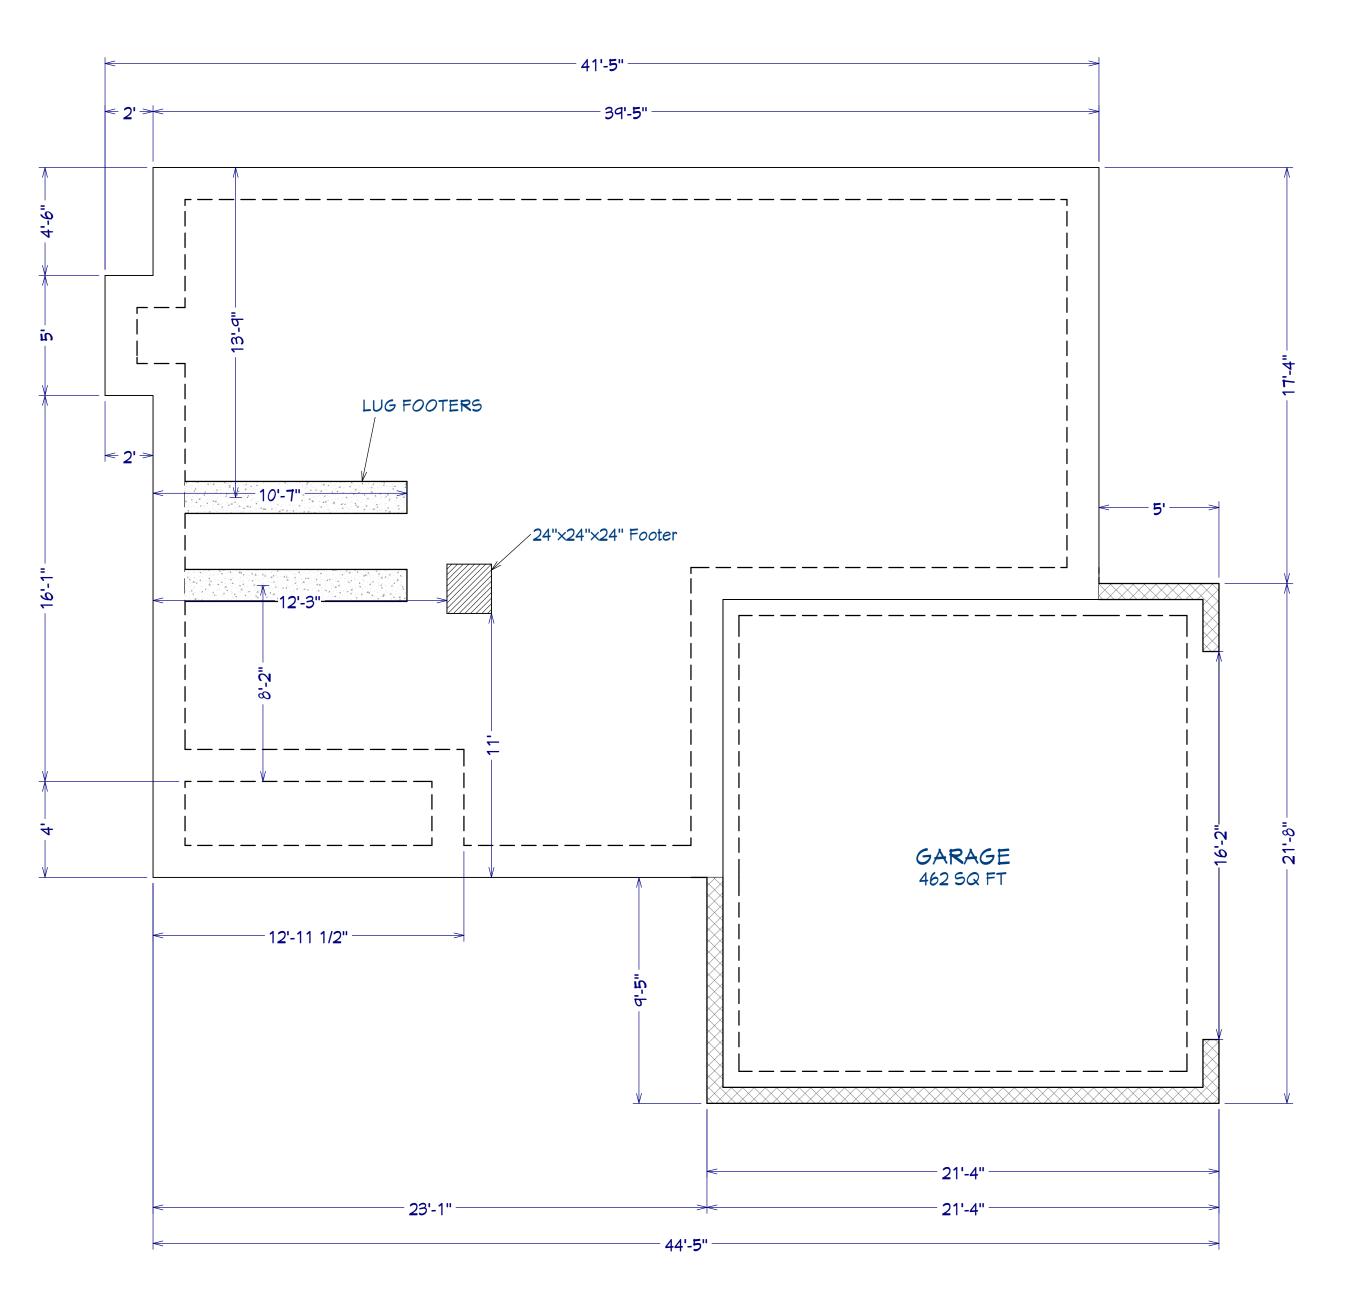

AREA SCHEDULE	
NAME	AREA
1st FLOOR	1,001 SF
2nd FLOOR	1,074 SF
GARAGE	422 SF
FRONT PORCH	51 SF
TOTAL HEATED	2,075 SF
TOTAL UNDER ROOF	= 2.548 SF

FOUNDATION PLAN

Scale: 1/4" = 1'0"


DATE:

8/15/23


SCALE:

1/4" = 1'


SHEET:

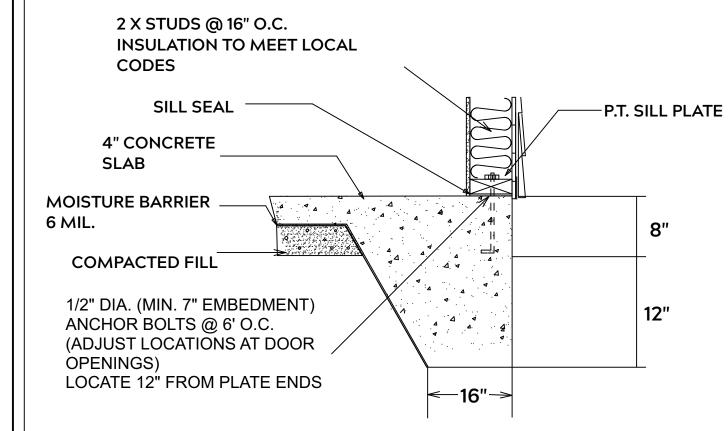

MONOLITHIC SLAB

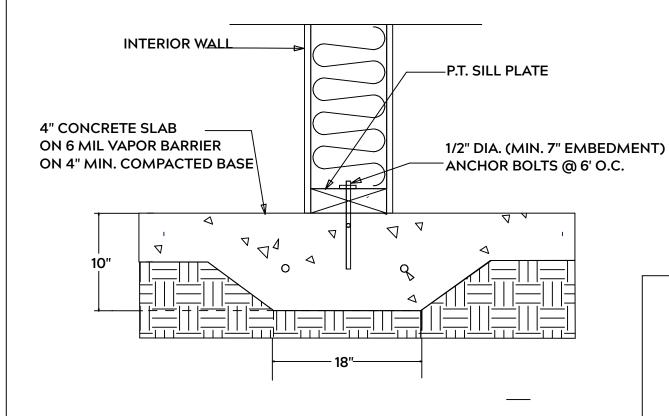

LUG FOOTING

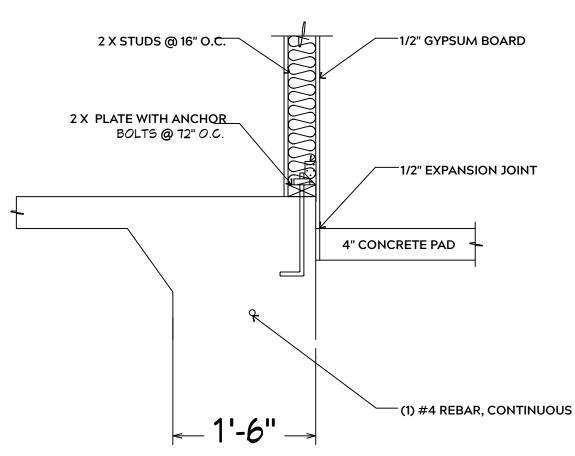

INTERIOR WALL @ GARAGE STEP DOWN

FOUNDATION NOTES:


ALL FOOTINGS SHALL BEAR ON ORIGINAL UNDISTURBED SOIL THE 28 DAY COMPRESSIVE STRENGTH OF ALL **FOOTINGS IS 3000 PSI**

PROVIDE WATER PROOFING AND PERIMTER **DRAINS AS REQUIRED**

FOOTING WIDTHS ARE BASED ON A LOAD BEARING SOIL CAPACITY OF 2000 PSI


PROVIDE 6 MIL POLY VAPOR BARRIER TO COVER GROUND IN CRAWL SPACE AND **GROUND UNDER POURED CONCRETE**

ALL ANCHOR BOLTS TO BE 1/2" X 12" LONG. ANCHOR BOLTS SHALL BE SPACED AT A MAXIMUM OF 6' ON CENTER AND NO MORE THEN 1' FROM EACH CORNER

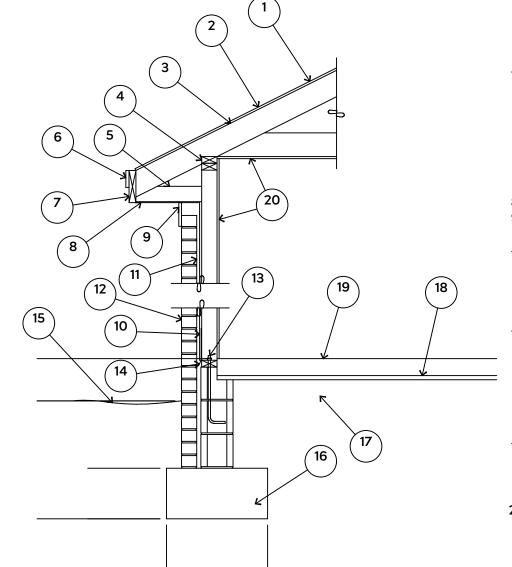

- 15# FELT UNDERLAYMENT UNDER COMPOSITION SHINGLES.
- 2. ROOF DECKING.
- 3. 2 X RAFTERS / ENGINEERED TRUSSES
- DOUBLE TOP PLATE.
- 5. 2 X 4 RETURN. 6. 3/4" FASCIA OR PVC TRIM COIL
- 7. 2 X FASCIA
- 1/4" PLYWOOD OR VINYL SOFFIT
- 9. 1X FREIZE BOARD (TO BE USED WITH **BRICK VENEERS)**
- 10. INSULATION BOARD OR HOUSE WRAP
- 11. AIR SPACE.
- 12 BRICK WITH BRICK TIES PER MANUFACTURER'S SPECIFICATIONS.
- 13. 1/2" X 12" ANCHOR BOLTS, 6'-0" O.C., 12" FROM CORNERS.
- 4. FLASHING WITH WEEP HOLES @ 48" O.C.
- 15. FINISHED GRADE.
- 16. FOOTING
- 17. COMPACTED EARTH FILL
- 18. 6 MIL. VAPOR BARRIER
- 19. 4" CONCRETE SLAB, 3,000 P.S.I. WITH 6" X 6" 10 GA. X 10 GA. WELDED WIRE FABRIC.
- 20. 1/2" GYPSUM BOARD.

EXTERIOR WALL SECTION

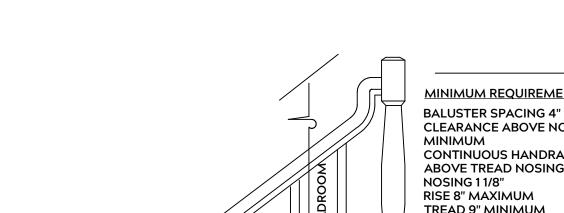

PLAN:

SHEETS

AIL

ET

PROJECT ADDRESS: 16 Hancock Ct. Liberty Meadows Lot 3

35

Rand

Precision Custom Hor Raeford, NC @PrecisionCustomHor

DATE:

8/15/23

SCALE:

1/4" = 1'

SHEET:

A-3

GENERAL FRAMING NOTES:

ALL LUMBER IN CONTACT WITH CONCRETE OR MASONRY SHALLE BE PRESSURE TREATED

FRAMING LUMBER SHALL BE SYP #2 GRADE AND / OR SPRUCE PINE FIR #1 AND / OR KILN DRIED

WHERE PRE-ENGINEERED JOISTS AND TRUSSES ARE USED, MANUFACTURER SHALL PROVIDE DRAWINGS / SCHEMATICS, WHICH SHALL BEAR OF A N.C. **ENGINEER**

STUDS AND JOISTS SHALL NOT BE CUT TO INSTALL PLUMBING OR WIRING WITHOUT ADDING METAL OR WOOD SIDE PANELS TO STRENGTHEN MEMBER TO ITS ORIGINAL CAPACITY

NAIL MULTIPLE MEMBERS WITH 2 ROWS OF 16d NAILS STAGGERED 32" O.C. AND USE 3 X 16d NAILS 2" IN AT EACH END.


NAIL FLOOR JOISTS TO SILL PLATE WITH WITH 8d TOE NAILS

ALL EXPOSED FRAMING ON PORCHES OR DECKS SHALL BE PRESSURE **TREATED**


PROVIDE WATERPROOFING AND DRAINS AS REQUIRED

ALL FRAMING TO BE 16" O.C. WALL FRAMING DIMENSIONS ARE BASED ON 2X4 OR 2X6 EXTERIOR WALLS AND 2X4 INTERIOR WALLS. DOULBE / TRIPLE JACK STUDS AS NECESSARY UNDER HEADERS AS REQUIRED

LVL'S TO BE SIZED BY OTHERS (TRUSS MANUFACTURER)

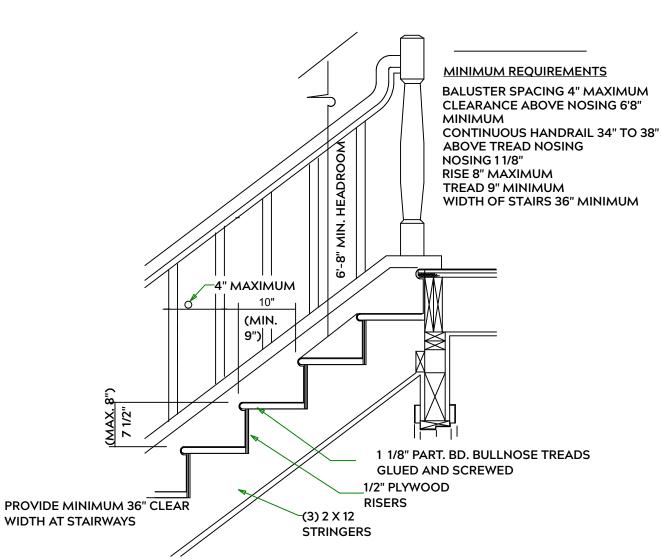

STAIR DETAIL

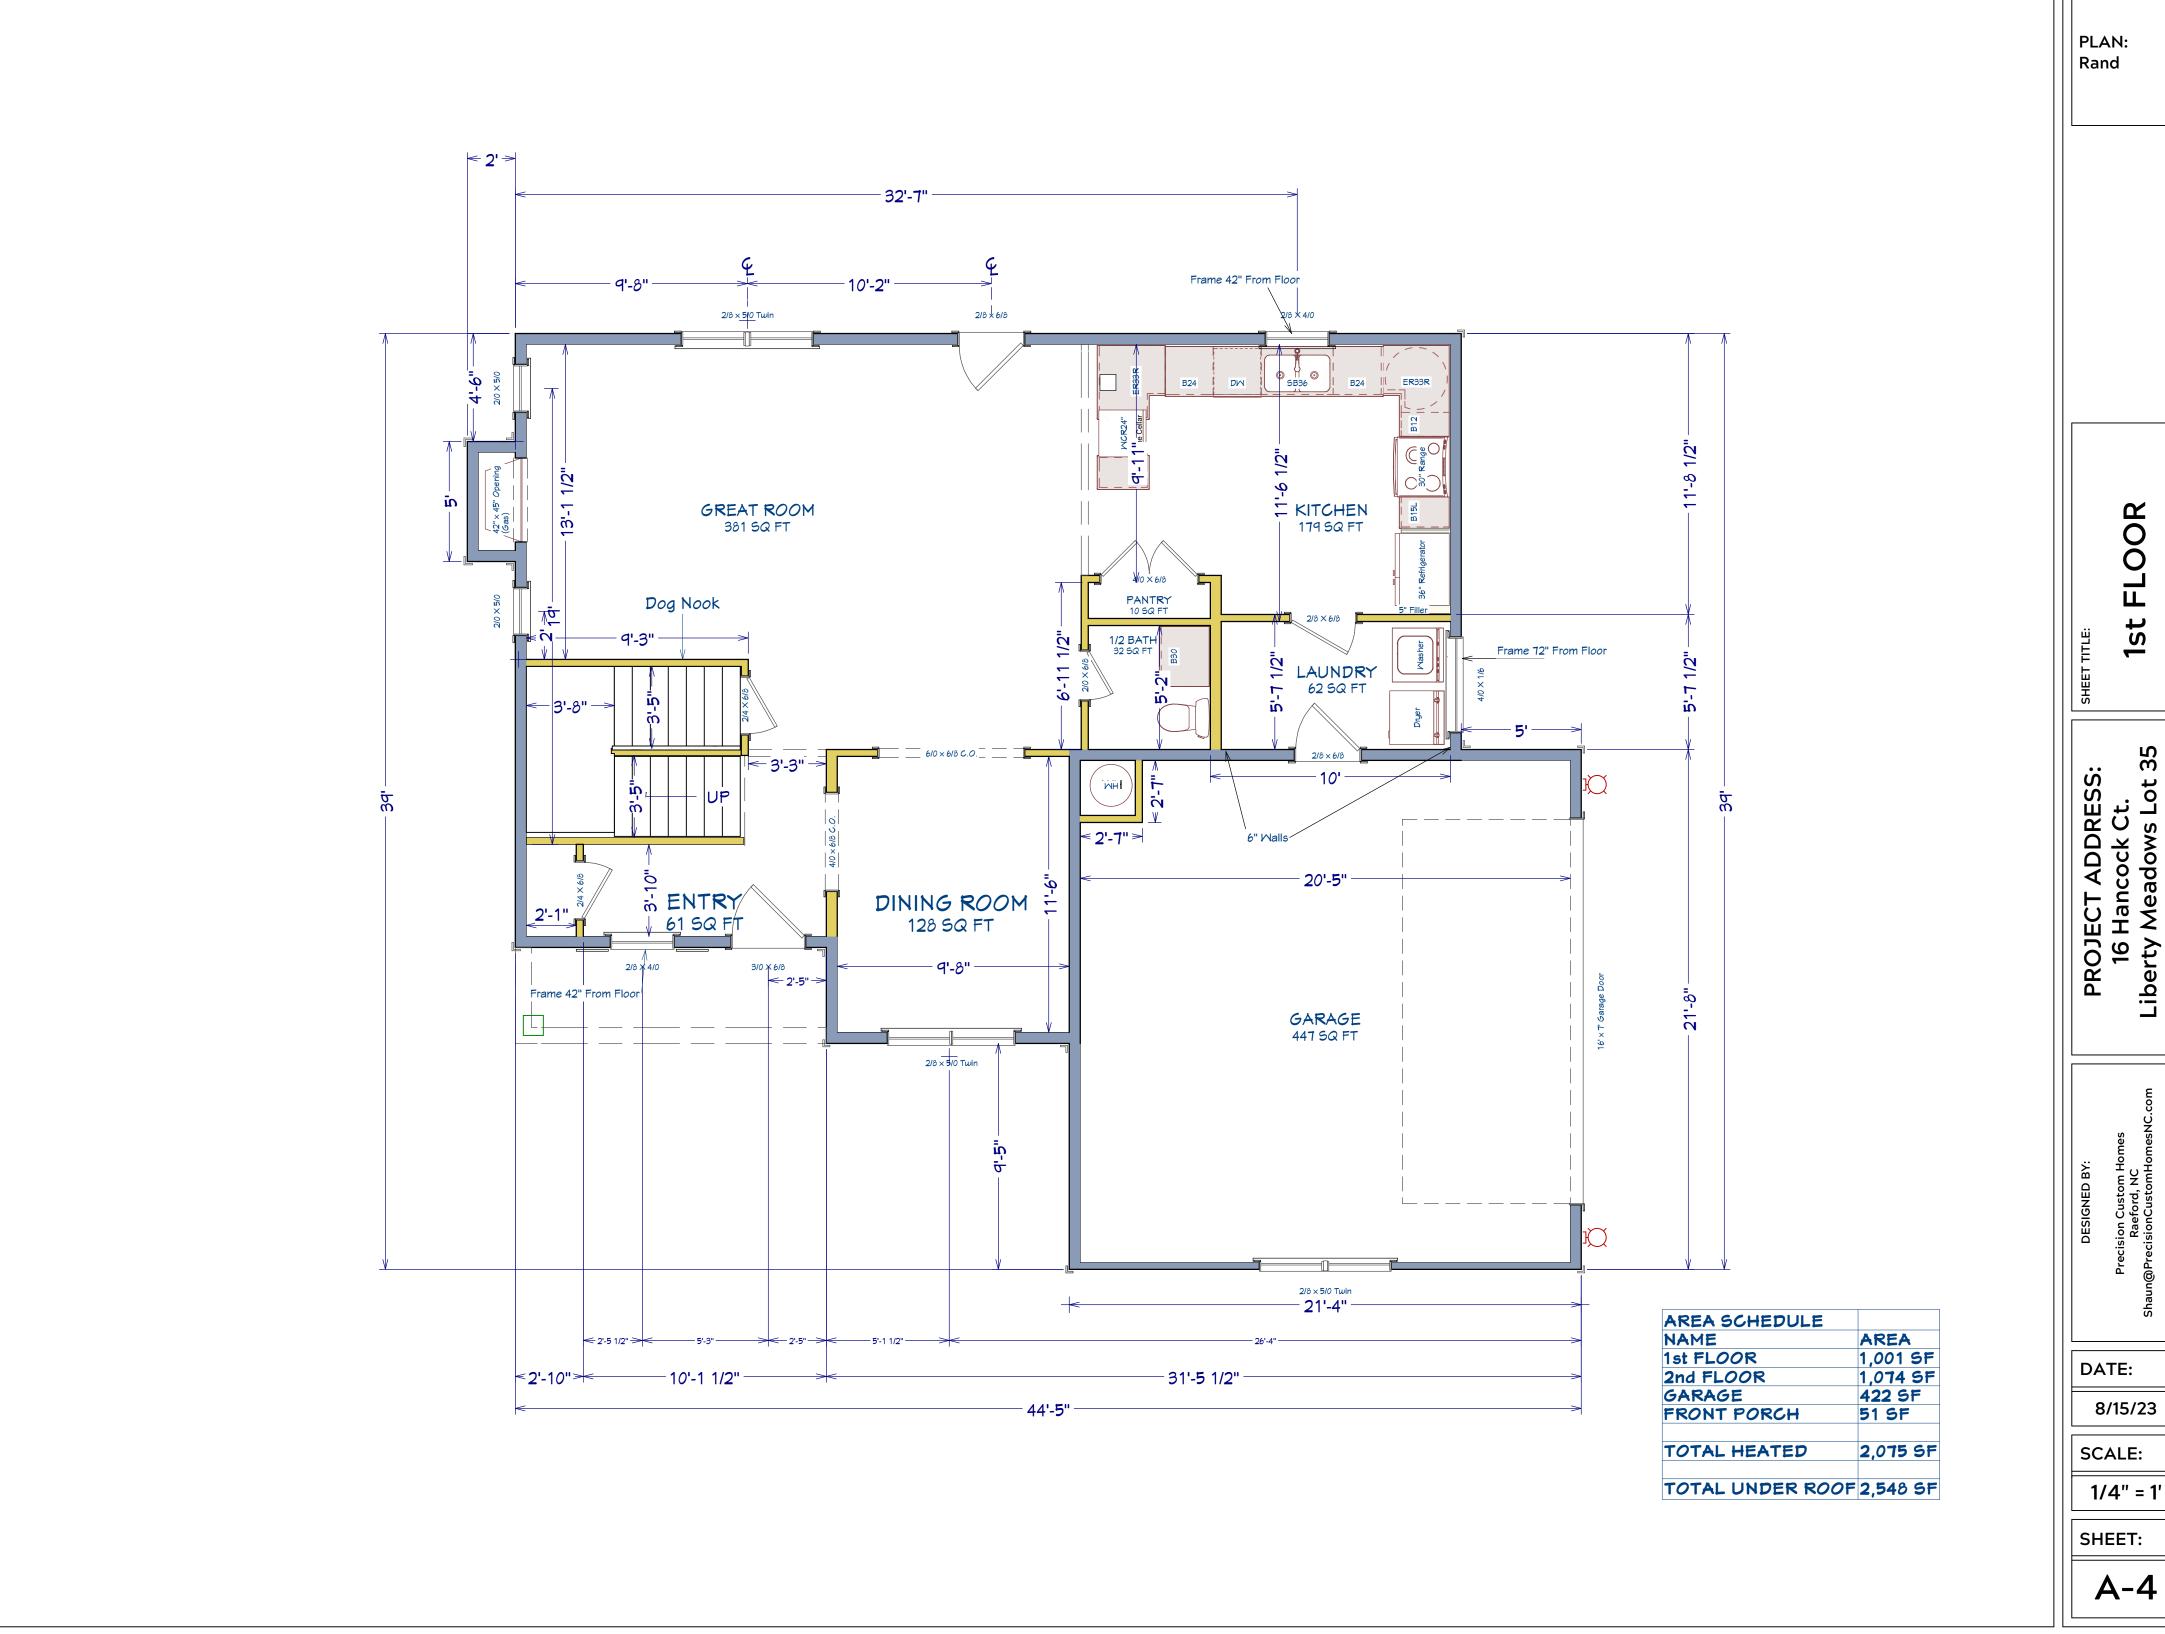

PLAN: Rand


1st FLOOR

PROJECT ADDRESS: 16 Hancock Ct. Liberty Meadows Lot 35

DATE:

1/4" = 1'

SHEET:

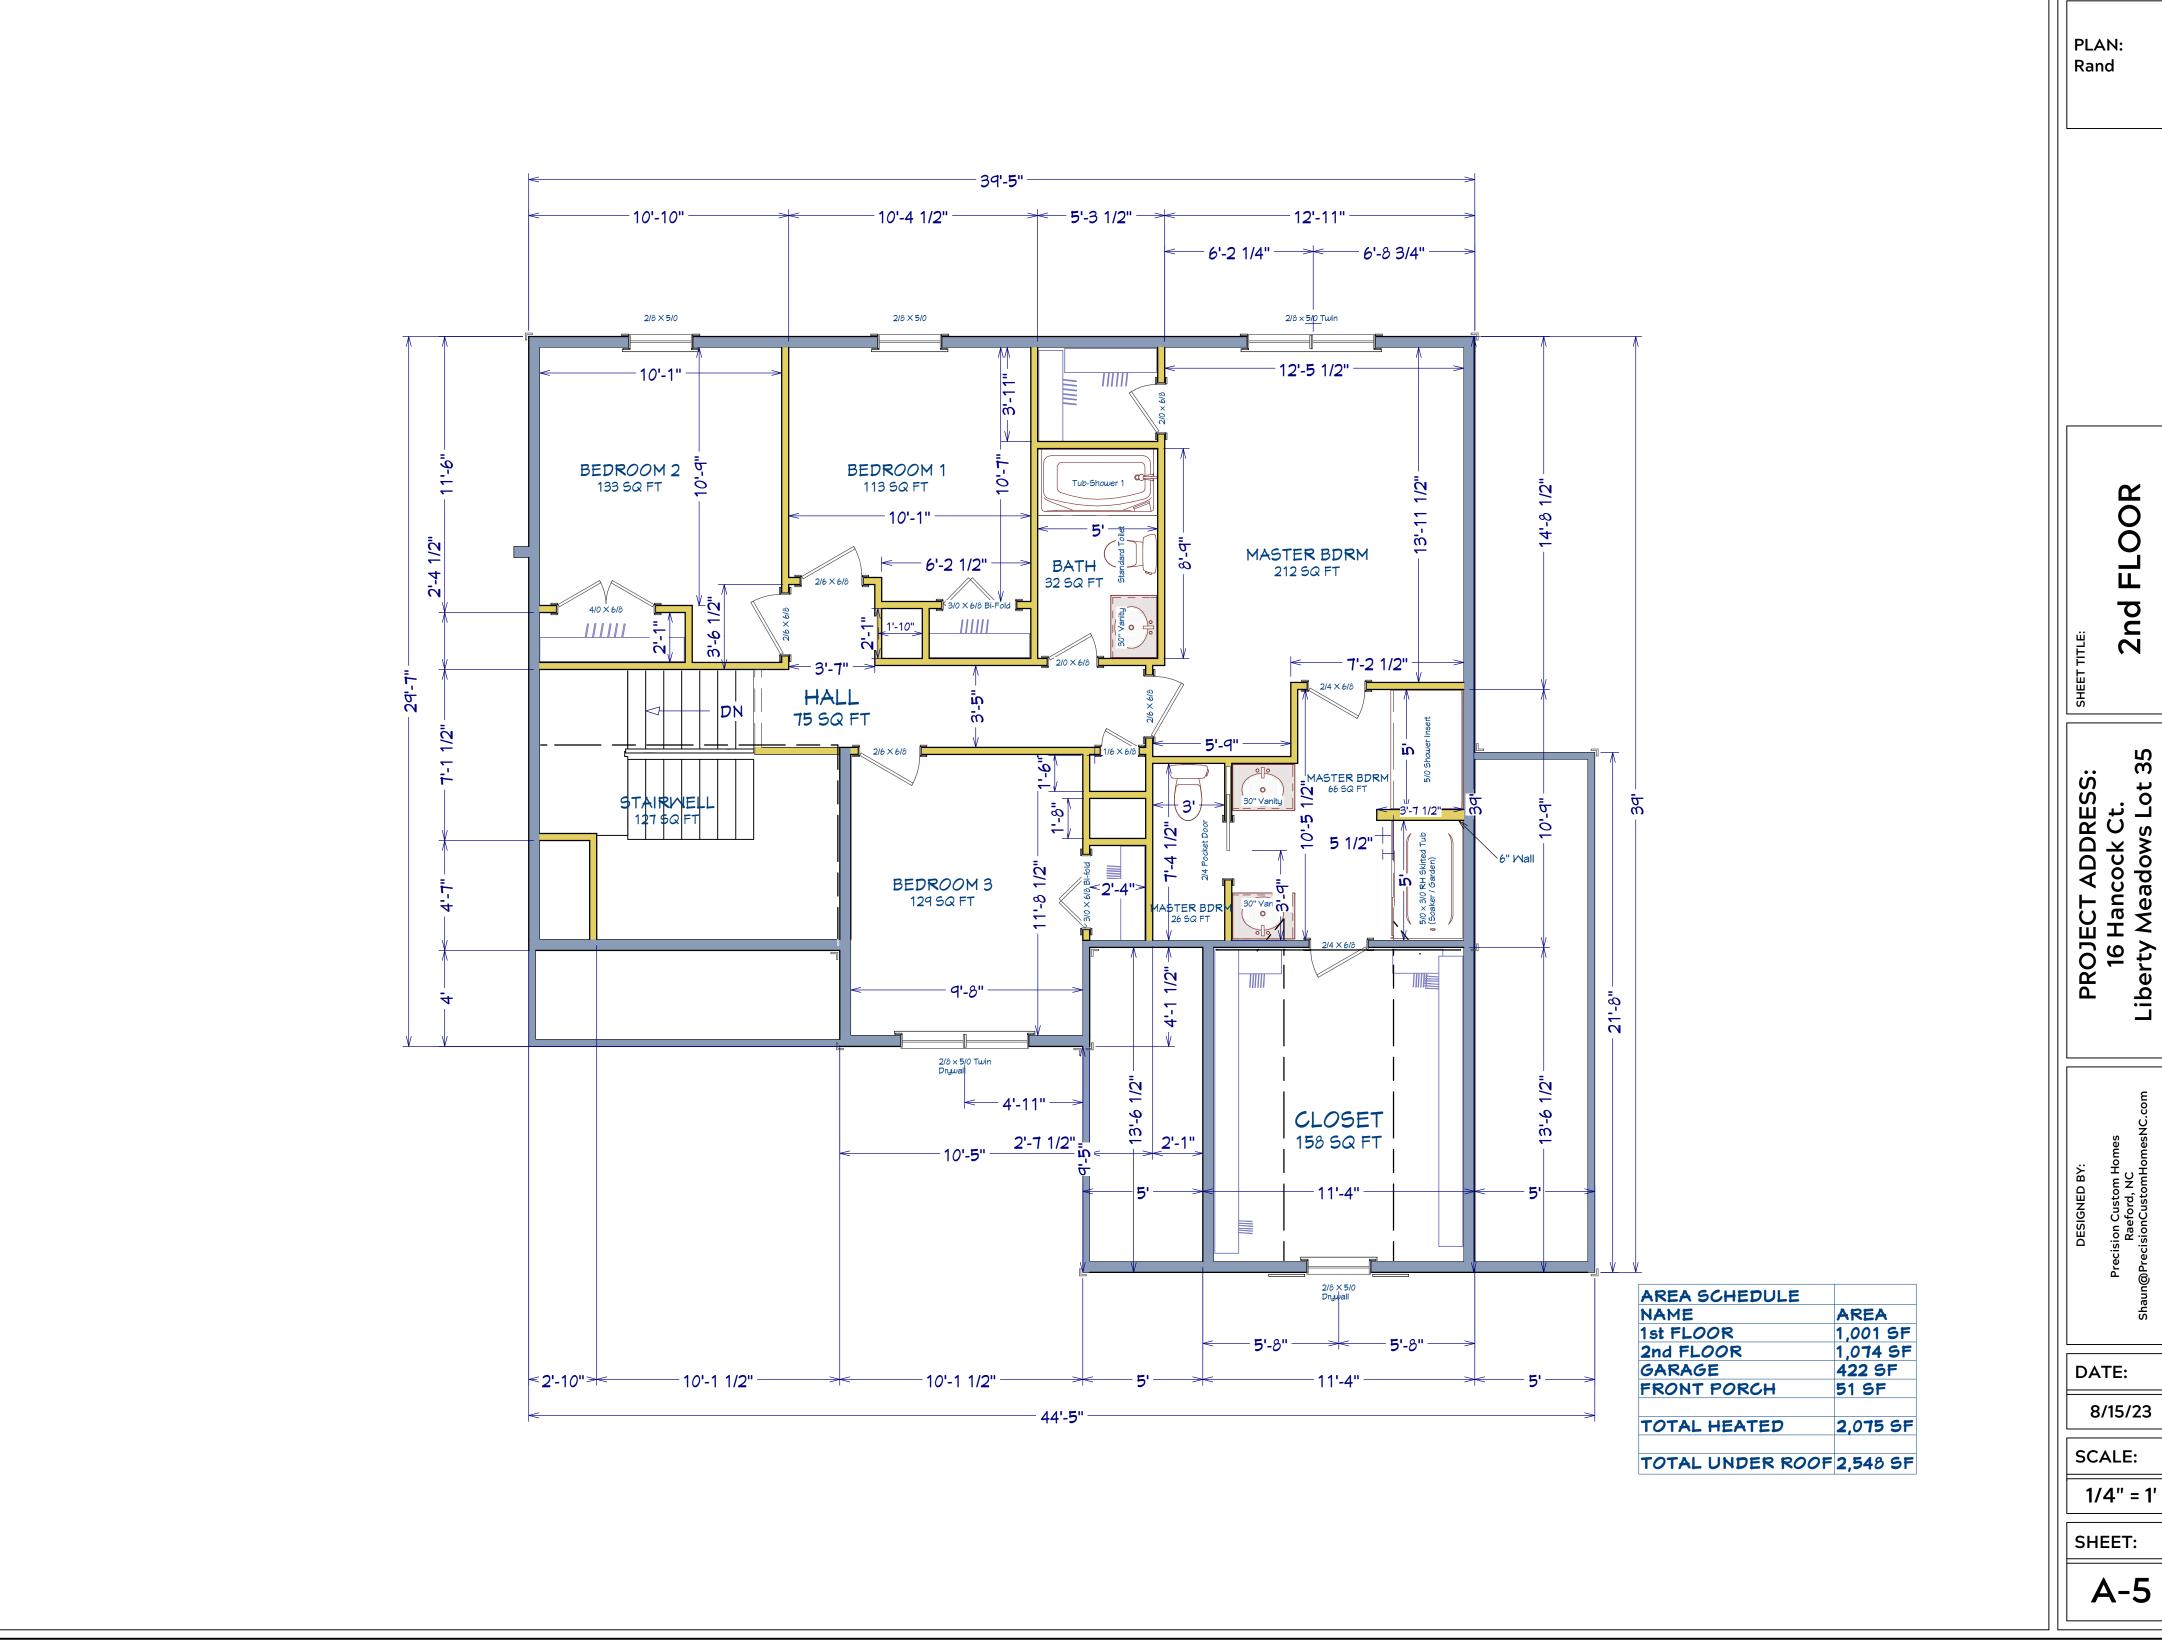

PLAN:

2nd FLOOR

DATE:

SHEET: