

APPENDIX G

DESIGN PROFESSIONAL INSPECTION FORM

RECORD OF THE INSPECTION OF A **COMPONENT OR ELEMENT** BY A NC LICENSED ARCHITECT OR ENGINEER

Project Information:

Residential Single-Family Project: Y <input checked="" type="checkbox"/> N <input type="checkbox"/>	Commercial Project: Y <input type="checkbox"/> N <input checked="" type="checkbox"/>
Code Enforcement Project No:	Permit No: SFD2306-0058
Project Name: 794 Cobb Road	Owner:
Project Address: 794 Cobb Road, Benson	Suite No:
Date Inspected: 07/25/2023	Contractor Name: Schumacher Homes of NC Inc
Component Inspected: residential home footings prior to concrete placement	

Responsible Licensed NC Architect or NC Engineer

Name:	W. Shawn Sullivan, P.E.		
Firm Name:	GTA Associates, Inc.		
Phone Numbers:	Office: 984-200-2104	Mobile: 984-500-6192	
Email Address:	Shawnsullivan@gtaeng.com		
Mailing Address:	530 Hinton Pond Road, Suite 104, Knightdale, NC 27545		

APPLICABLE CODE:

2018 NCRC

2018 NCBC = 2018 NC Building Code; 2018 NCRC = 2018 NC Residential Code

Describe Element/Component/Type of Inspection: *

strip ftgs, pier ftgs, lug ftgs, under code R403.1. Soil Bearing Capacity = 2,000 psf(see attached report)


*(subgrade form/letter may also be required)

Attestation/Signature:

By signing below, I certify that the component and/or element of the building as identified on this form has been inspected by me or someone under my direct supervision per G.S. 160D-11-6 and is in compliance with the Code or other proposal of the architect or engineer for the project. This inspection is in compliance with all of the requirements of the above referenced code. Attach any additional documents if needed.

W. Shawn Sullivan, P.E. Digitally signed by W. Shawn Sullivan, P.E.
Date: 2023.08.03 15:05:55 -04'00'

Licensed Architect or Engineer

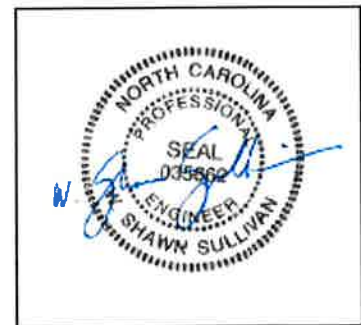

Inspection Department disclaimer:

Upon the receipt of a signed written document as required by G.S. 160D-11-6, Code Enforcement shall be discharged and released from any liabilities, duties and responsibilities imposed by this article or in common law from any claim arising out of or attributed to the component or element in the construction of the building for which the signed written document was submitted. Be aware that this inspection will be noted in all inspection records including the Certificate of Occupancy or Certificate of Compliance. This inspection does not address any local ordinances or zoning requirements.

Effective January 1st, 2021



GTA Associates, Inc.
 Geotechnical and Environmental Consultants
 www.gtaeng.com

530 Hinton Pond Road, Suite 104
 Knightdale, NC 27545
 (984) 200-2104

Foundation Subgrade Report

Date: 07/25/2023 **Project No.:** 201253x100 **Client:** McGee Brothers
Lot No.: N/A **Address:** 794 Cobb Road, Benson

Subdivision: N/A
Permit No.: SFD2306-0058

Foundation Subgrade Excavations For:

- | | |
|--|---|
| <input type="checkbox"/> Monolithic Slab Turn-Down Footings | <input type="checkbox"/> Stem-Wall Footings |
| <input checked="" type="checkbox"/> Crawl Space Footings (Walls and Piers) | <input type="checkbox"/> Deck Footings |
| <input type="checkbox"/> Below Grade Wall Footings | <input type="checkbox"/> Other: _____ |

Design Bearing Capacity: 2000 psf _____

Discrepancies Observed? Yes No

If yes, details: soft/loose soils at 9 isolated areas _____

Over-Excavation (If applicable): roughly 6- to 24-inches to expose competent bearing subgrade _____

Location: isolated locations in wall footing excavations _____


Approximate dimensions: (18'x2'x2'), (22'x2'x1.5'), (9'x2'x1'), (13.5'x2'x0.5')

Backfilled with: No. 57 Stone Concrete Other _____

As requested, GTA Associates, Inc. (GTA) visited the subject project to observe the exposed soil subgrade in open footing excavations, and to test the bearing capacity of soils at, and below, the exposed bottom of footing elevation. Hand-auger borings supplemented with Dynamic Cone Penetrometer (DCP) testing was performed at various locations within the open footing excavations in general accordance with ASTM STP-399. As the hand-auger borings were advanced, DCP tests were conducted at one-foot intervals to a depth of 3-feet below bottom of footing elevation, or prior refusal. Based on the results of GTA visual observations and the testing performed, it is GTA's professional opinion that the soils, at the locations and elevations observed, are capable of supporting a foundation designed utilizing the design bearing pressure outlined above.

Please note, GTA test results are only indicative of soil conditions at the specific GTA test locations and depths explored. GTA hand-auger borings supplemented with Dynamic Cone Penetrometer (DCP) testing on this date, was performed to a maximum depth of 3-feet below bottom of footing elevation. Where deeper fill soils are present, GTA has assumed the fill soils were placed and compacted properly. At the time of our site visit, GTA has not been provided with documentation regarding the placement and compaction of fill soils for the referenced lot.

Foundation observations and soil bearing capacity testing are only valid between rain events. If foundation bearing materials are exposed to inclement weather or disturbed due to construction activity, GTA should be contacted to re-evaluate the foundation bearing materials prior to the placement of concrete.

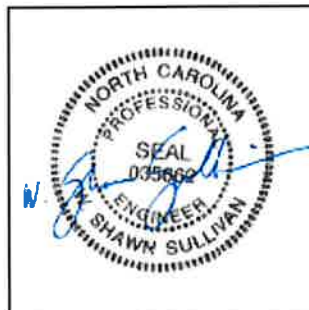

Shawn Sullivan
 Professional Engineer Seal