


DATE:	6/27/2023	COMPANY:	Schumacher Homes
STRUCALC BUILD:	StruCalc Plus	DESIGNED BY:	Dan Fishorn
CUSTOMER:	Miceli DU700 023 0222	REVIEWED BY:	--
PROJ. ADDRESS:	--	PROJECT NAME:	Miceli DU700 023 0222
LEVEL:	Main Floor	LOADING:	ASD
MEMBER NAME:	Garage Door Header	CODE:	2021 International Building Code
MEMBER TYPE:	FLOOR BEAM	NDS:	2018 NDS
MATERIAL:	Structural Composite Lumber		
Louisiana Pacific	2.0E LVL	(2) 1.75 X 14	DRY

Garage Door Header DIAGRAM

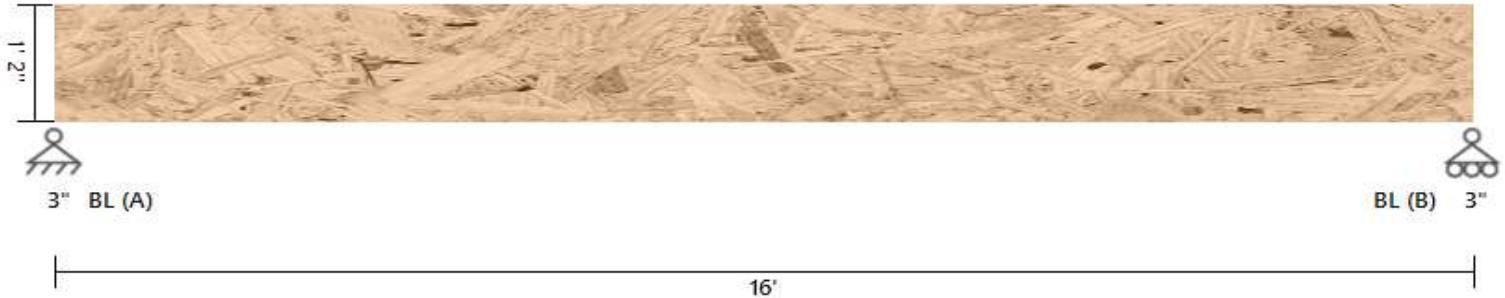

BEAM PROPERTIES

Start (ft): 0 End (ft): 16 Member Slope: 0/12 Actual Length (ft): 16

Area	Ix	Iy	BSW	Lams	Cfn	Kcr
(in ²)	(in ⁴)	(in ⁴)	(lbf/ft)			Creep Factor
49	800.33	12.51	13.95	2	9	1

STRENGTH PROPERTIES

	Fb (psi)	Ft (psi)	Fv (psi)	Fc (psi)	Fc⊥ (psi)	E (psi) x10 ³	Emin (psi) x10 ³
Base Values	2900	1800	285	3200	750	2000	1000
Adjusted Values	2900	1800	285	3200	750	2000	1000
C _M	1	1	1	1	1	1	1
C _T	1	1	1	1	1	1	1

Bending Adjustment Factors C_V = 0.98 C_r = 1 Volume factor Is applied on a load combination basis And Is Not reflected in the adjusted values

BEAM DATA

Span	Length (ft)	Unbraced Length (ft)		Beam End				
		Top	Bottom	Elev. Diff (ft)	CL(Top)	CL(Bottom)	CL(Left)	CL(Right)
1	16	0	16	0	1.00	0.87	1.00	1.00

PASS-FAIL

	PASS/FAIL	MAGNITUDE	STRENGTH	LOCATION (ft)	LOAD COMBO	DURATION FACTOR CD
Shear Stress Y (psi)	PASS (88.0%)	34.3	285.0	0	D+L	1
Bending Stress Y (psi)	PASS (83.5%)	470.0	2850.8	8	D+L	1
Deflection (in)	PASS (83.9%)	0.129 (=L/1490)	0.800 (=L/240)	8	D+L	
Bearing Stress (psi)	PASS (85.8%)	106.6	750.0	0	D+L	1

REACTIONS

Units for V: lbf Units for M: lbf-ft

Y axis	DEAD	LIVE	TOTAL
A	544	576	1120
B	544	576	1120

Reaction Location

A

B

LOAD LIST

Type	Name	Left Magnitude	Right Magnitude	Load Start (ft)	Load End (ft)	Load Type	Direction
Uniform (lbf/ft)	Uniform	72	72	0	16	Live	Y
Uniform (lbf/ft)	Uniform	54	54	0	16	Dead	Y
Self Weight (lbf/ft)	-	13.95	13.95	0	16	Dead	Y