

RE: MP8
 DRHORTON/WILMINGTON; LOT 8 MCKAY PLACE

Trenco
 818 Soundside Rd
 Edenton, NC 27932

Site Information:

Customer: Project Name: MP8
 Lot/Block: Model:
 Address: Subdivision:
 City: State:

General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):

Design Code: IRC2015/TPI2014 Design Program: MiTek 20/20 8.6
 Wind Code: ASCE 7-10 Wind Speed: 115 mph
 Roof Load: 40.0 psf Floor Load: N/A psf

This package includes 10 individual, dated Truss Design Drawings and 0 Additional Drawings.

No.	Seal#	Truss Name	Date
1	I58690794	A01G	6/1/2023
2	I58690795	A02	6/1/2023
3	I58690796	A03	6/1/2023
4	I58690797	A04V	6/1/2023
5	I58690798	A05V	6/1/2023
6	I58690799	A06VG	6/1/2023
7	I58690800	B01G	6/1/2023
8	I58690801	B02GR	6/1/2023
9	I58690802	P01G	6/1/2023
10	I58690803	P02	6/1/2023

The truss drawing(s) referenced above have been prepared by Truss Engineering Co. under my direct supervision based on the parameters provided by Builders FirstSource-Apex,NC.
 Truss Design Engineer's Name: Gilbert, Eric
 My license renewal date for the state of North Carolina is December 31, 2023.
 North Carolina COA: C-0844

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to TRENCO. Any project specific information included is for TRENCO customers file reference purpose only, and was not taken into account in the preparation of these designs. TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.



Job	Truss	Truss Type	Qty	Ply	DRHORTON/WILMINGTON; LOT 8 MCKAY PLACE
MP8	A01G	GABLE	99	1	158690794

Builders FirstSource (Apex, NC), Apex, NC - 27523, 8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 1 13:59:51 2023 Page 1

ID:VULCYJU7zpRLimSP7MPFXTyf?FT-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f



Scale = 1:73.5

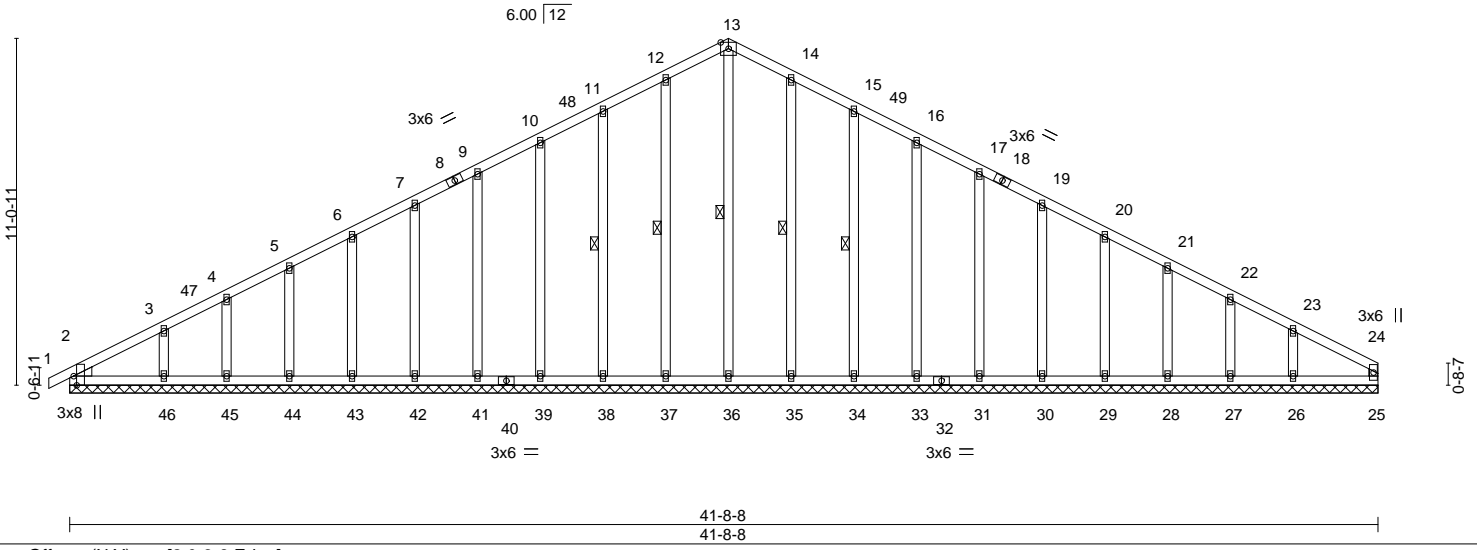


Plate Offsets (X,Y)--	[2:0-3-8,Edge]
-----------------------	----------------


LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.10	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.08	Vert(LL) -0.00 1 n/r 120		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.14	Vert(CT) 0.00 1 n/r 120		
BCDL 10.0	Rep Stress Incr NO	Matrix-S	Horz(CT) 0.01 25 n/a n/a		
	Code IRC2015/TPI2014			Weight: 297 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	WEBS 1 Row at midpt 13-36, 12-37, 11-38, 14-35, 15-34
OTHERS 2x4 SP No.3	
WEDGE	
Left: 2x4 SP No.3	

REACTIONS. All bearings 41-8-8.
 (lb) - Max Horz 2=146(LC 12)
 Max Uplift All uplift 100 lb or less at joint(s) 2, 37, 38, 39, 41, 42, 43, 44, 45, 46, 35, 34, 33, 31, 30, 29, 28, 27, 26
 Max Grav All reactions 250 lb or less at joint(s) 25, 2, 36, 37, 38, 39, 41, 42, 43, 44, 45, 46, 35, 34, 33, 31, 30, 29, 28, 27, 26

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 11-12=-104/280, 12-13=-116/313, 13-14=-116/307, 14-15=-104/274

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) -0-8-0 to 4-1-10, Exterior(2) 4-1-10 to 21-0-0, Corner(3) 21-0-0 to 25-9-10, Exterior(2) 25-9-10 to 41-6-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 37, 38, 39, 41, 42, 43, 44, 45, 46, 35, 34, 33, 31, 30, 29, 28, 27, 26.
 - Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 2.

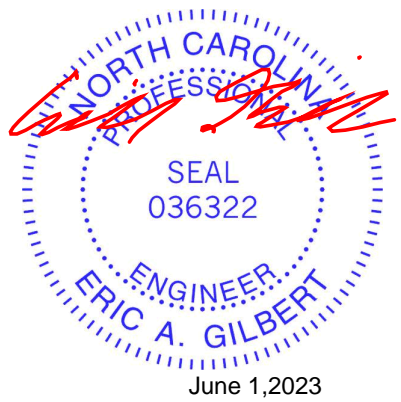

Job	Truss	Truss Type	Qty	Ply	DRHORTON/WILMINGTON; LOT 8 MCKAY PLACE	158690795
MP8	A02	COMMON	99	1	Job Reference (optional)	


Builders FirstSource (Apex, NC), Apex, NC - 27523, 8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 1 13:59:53 2023 Page 1

ID:VULCYJU7zpRLimSP7MPFXTyf?IT-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f



5x6 =

Scale = 1:74.1

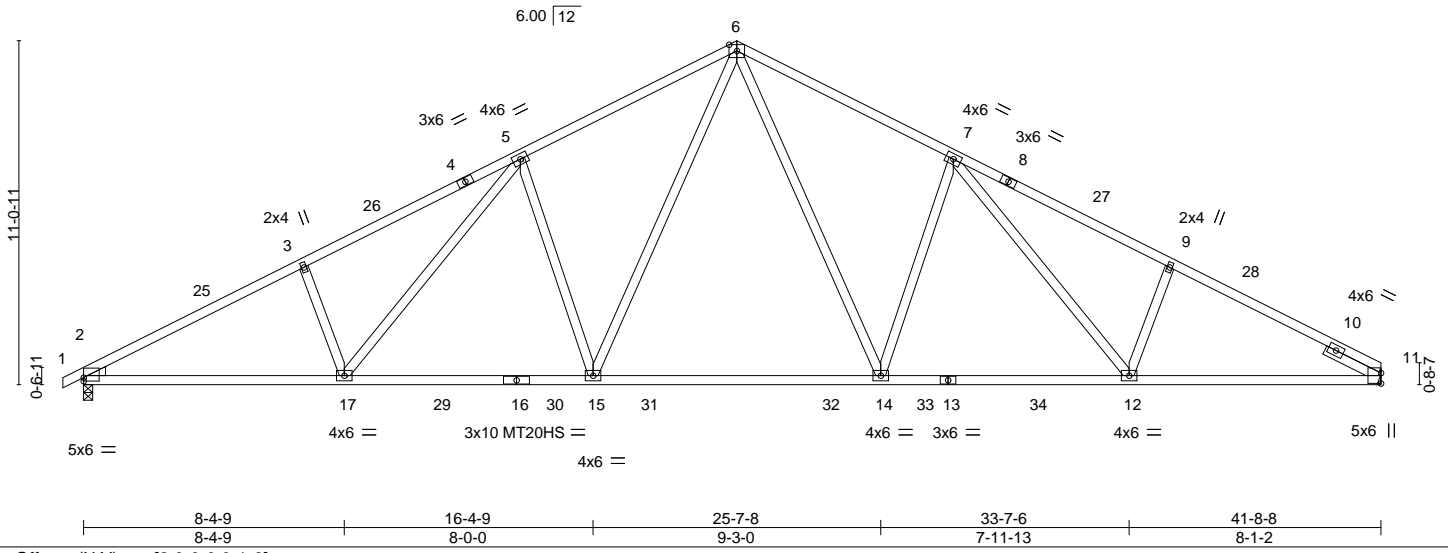

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.97	Vert(LL)	-0.33 14-15	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.85	Vert(CT)	-0.61 14-15	>827	240	MT20HS	187/143
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.76	Horz(CT)	0.15 11	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MS	Wind(LL)	0.10 15-17	>999	240	Weight: 230 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2 *Except* 8-11: 2x4 SP No.1	TOP CHORD Structural wood sheathing directly applied.
BOT CHORD 2x4 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	
WEDGE	
Left: 2x4 SP No.3	
SLIDER Right 2x4 SP No.3 1-11-12	

REACTIONS. (size) 2=0-3-8, 11=Mechanical
 Max Horz 2=139(LC 12)
 Max Grav 2=1709(LC 1), 11=1668(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-3068/146, 3-5=-2946/198, 5-6=-2417/230, 6-7=-2406/228, 7-9=-2848/208, 9-11=-2940/155
 BOT CHORD 2-17=-60/2661, 15-17=-23/2259, 14-15=0/1698, 12-14=-10/2239, 11-12=-64/2557
 WEBS 3-17=-344/159, 5-17=-79/581, 5-15=-673/171, 6-15=-63/988, 6-14=-62/964, 7-14=-646/171, 7-12=-84/492, 9-12=-287/158

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-8-0 to 4-1-10, Interior(1) 4-1-10 to 21-0-0, Exterior(2) 21-0-0 to 27-11-8, Interior(1) 27-11-8 to 41-8-8 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) All plates are MT20 plates unless otherwise indicated.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 6) Refer to girder(s) for truss to truss connections.
 - 7) See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.



Job	Truss	Truss Type	Qty	Ply	DRHORTON/WILMINGTON; LOT 8 MCKAY PLACE	158690796
MP8	A03	COMMON	99	1	Job Reference (optional)	

Builders FirstSource, Apex, NC

ID:VULCYJU7zpRLimSP7MPFXTyf?FT-bZz_JOXxEakEmooYwQdUuK1gGP3YLyE_U4sRThzAdPe
8.630 s Mar 9 2023 MITEK Industries, Inc. Thu Jun 1 14:23:01 2023 Page 1

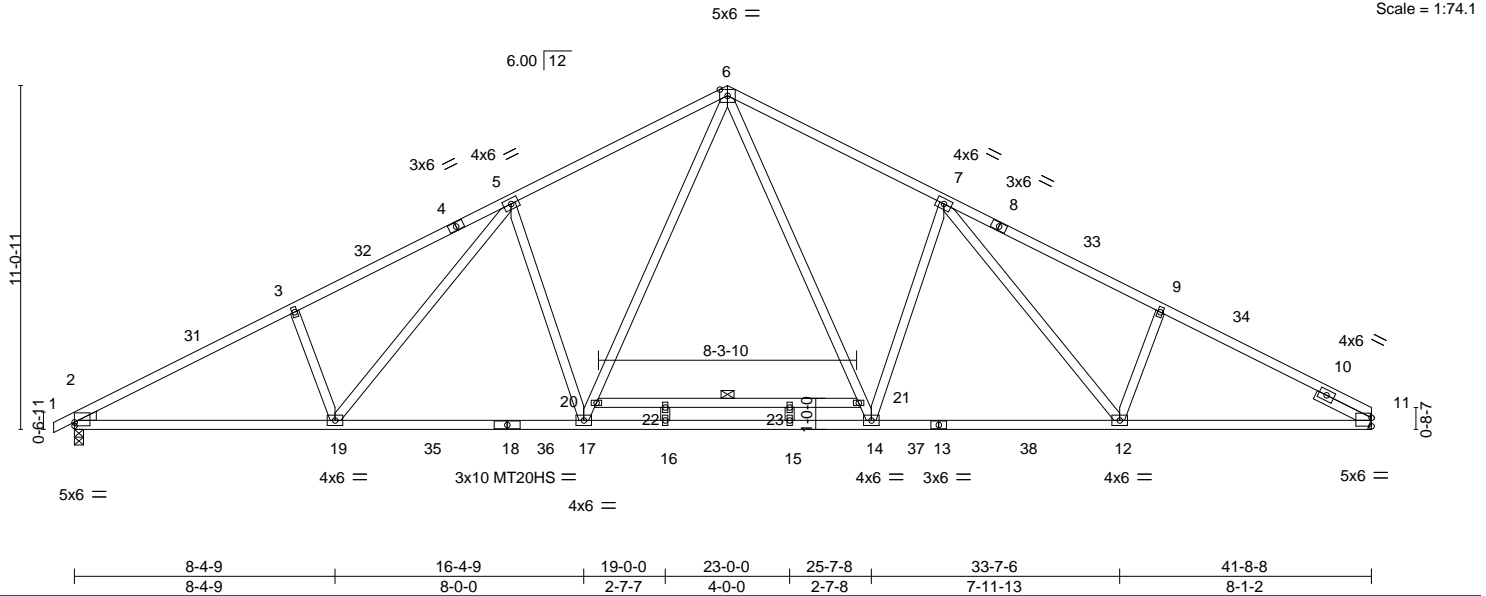



Plate Offsets (X,Y)--	[2:0-0-0,0-1-6], [11:0-0-0,0-3-4]
-----------------------	-----------------------------------


LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.97	Vert(LL)	-0.45	15-16	>999	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.94	Vert(CT)	-0.69	15-16	>722	MT20HS	187/143
BCLL 0.0 *	Lumber DOL 1.15	WB 0.99	Horz(CT)	0.16	11	n/a		
BCDL 10.0	Rep Stress Incr NO	Matrix-MS	Wind(LL)	0.09	17-19	>999		
	Code IRC2015/TPI2014						Weight: 244 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2 *Except* 1-4: 2x4 SP No.1, 8-11: 2x4 SP SS	TOP CHORD Structural wood sheathing directly applied.
BOT CHORD 2x4 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3	WEBS 1 Row at midpt 20-21
WEDGE Left: 2x4 SP No.3	
SLIDER Right 2x4 SP No.3 1-11-12	

REACTIONS. (lb/size) 2=1709/0-3-8 (min. 0-2-1), 11=1668/Mechanical
Max Horz 2=139(LC 12)
Max Grav 2=1732(LC 2), 11=1701(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-31=-3160/126, 3-31=-3065/145, 3-32=-3037/164, 4-32=-2966/180, 4-5=-2896/198,
5-6=-2508/231, 6-7=-2497/229, 7-8=-2795/207, 8-33=-2871/189, 9-33=-2921/173,
9-34=-2945/155, 10-34=-3030/137, 10-11=-1009/0
BOT CHORD 2-19=-59/2742, 19-35=-24/2341, 18-35=-24/2341, 18-36=-24/2341, 17-36=-24/2341,
16-17=0/1827, 15-16=0/1827, 14-15=0/1827, 14-37=-10/2320, 13-37=-10/2320,
13-38=-10/2320, 12-38=-10/2320, 11-12=-64/2634
WEBS 3-19=-343/160, 5-19=-77/585, 5-17=-673/169, 17-20=-70/962, 6-20=-63/1033,
6-21=-62/1008, 14-21=-69/937, 7-14=-646/170, 7-12=-83/496, 9-12=-286/159

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-8-0 to 4-1-10, Interior(1) 4-1-10 to 21-0-0, Exterior(2) 21-0-0 to 27-11-8, Interior(1) 27-11-8 to 41-8-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) All plates are MT20 plates unless otherwise indicated.
 - 4) All plates are 2x4 MT20 unless otherwise indicated.
 - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 7) Refer to girder(s) for truss to truss connections.
 - 8) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 9) N/A
 - 10) See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.
 - 11) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

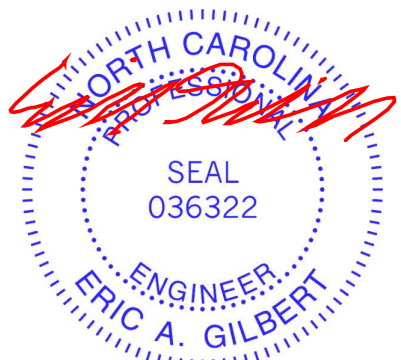

June 1, 2023

Continued on page 2

LOAD CASE(S)

Design valid for use only with MITEK® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	DRHORTON/WILMINGTON; LOT 8 MCKAY PLACE	158690796
MP8	A03	COMMON	99	1	Job Reference (optional)	

Builders FirstSource, Apex, NC

ID:VULCYJU7zpRLimSP7MPFXTyft-bZz_JOXxEaEmooYwQdUuK1gGP3YLyE_U4sRThzAdPe
8.630 s Mar 9 2023 MiTek Industries, Inc. Thu Jun 1 14:23:01 2023 Page 2

LOAD CASE(S)

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-6=-60, 6-11=-60, 24-27=-20
- 2) Dead + 0.75 Roof Live (balanced) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-6=-50, 6-11=-50, 24-35=-20, 35-36=-50, 36-37=-20, 37-38=-50, 27-38=-20, 20-21=-30(F)
- 3) Dead + Uninhabitable Attic Without Storage: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-6=-20, 6-11=-20, 24-27=-40, 20-21=-40(F)
- 4) Dead + 0.6 C-C Wind (Pos. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=42, 2-31=22, 6-31=12, 6-7=22, 7-11=12, 24-27=-12
Horz: 1-2=-54, 2-31=-34, 6-31=-24, 6-7=34, 7-11=24
- 5) Dead + 0.6 C-C Wind (Pos. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=8, 2-5=12, 5-6=22, 6-34=12, 11-34=22, 24-27=-12
Horz: 1-2=-20, 2-5=-24, 5-6=-34, 6-34=24, 11-34=34
- 6) Dead + 0.6 C-C Wind (Neg. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-13, 2-6=-32, 6-11=-32, 24-27=-20
Horz: 1-2=-7, 2-6=12, 6-11=-12
- 7) Dead + 0.6 C-C Wind (Neg. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-27, 2-6=-32, 6-11=-32, 24-27=-20
Horz: 1-2=7, 2-6=12, 6-11=-12
- 8) Dead + 0.6 MWFRS Wind (Pos. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=7, 2-6=-3, 6-11=7, 24-27=-12
Horz: 1-2=-19, 2-6=-9, 6-11=19
- 9) Dead + 0.6 MWFRS Wind (Pos. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=2, 2-6=7, 6-11=-3, 24-27=-12
Horz: 1-2=-14, 2-6=-19, 6-11=9
- 10) Dead + 0.6 MWFRS Wind (Neg. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-15, 2-6=-20, 6-11=-10, 24-27=-20
Horz: 1-2=-5, 2-6=-0, 6-11=10
- 11) Dead + 0.6 MWFRS Wind (Neg. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-6, 2-6=-10, 6-11=-20, 24-27=-20
Horz: 1-2=-14, 2-6=-10, 6-11=0
- 12) Dead + 0.6 MWFRS Wind (Pos. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=14, 2-32=19, 6-32=9, 6-11=2, 24-27=-12
Horz: 1-2=-26, 2-32=-31, 6-32=-21, 6-11=14
- 13) Dead + 0.6 MWFRS Wind (Pos. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-3, 2-6=2, 6-33=9, 11-33=19, 24-27=-12
Horz: 1-2=-9, 2-6=-14, 6-33=21, 11-33=31
- 14) Dead + 0.6 MWFRS Wind (Pos. Internal) 3rd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=5, 2-6=9, 6-11=2, 24-27=-12
Horz: 1-2=-17, 2-6=-21, 6-11=14
- 15) Dead + 0.6 MWFRS Wind (Pos. Internal) 4th Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-3, 2-6=2, 6-11=9, 24-27=-12
Horz: 1-2=-9, 2-6=-14, 6-11=21
- 16) Dead + 0.6 MWFRS Wind (Neg. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=6, 2-32=2, 6-32=-7, 6-11=-15, 24-27=-20
Horz: 1-2=-26, 2-32=-22, 6-32=-13, 6-11=5
- 17) Dead + 0.6 MWFRS Wind (Neg. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-11, 2-6=-15, 6-33=-7, 11-33=2, 24-27=-20
Horz: 1-2=-9, 2-6=-5, 6-33=13, 11-33=22
- 18) Dead + Uninhabitable Attic Storage: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-6=-20, 6-11=-20, 24-35=-20, 35-36=-60, 36-37=-20, 37-38=-60, 27-38=-20, 20-21=-40(F)
- 19) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) Left): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-2=-46, 2-6=-50, 6-11=-43, 24-35=-20, 35-36=-50, 36-37=-20, 37-38=-50, 27-38=-20, 20-21=-30(F)
Horz: 1-2=-4, 2-6=-0, 6-11=7
- 20) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) Right): Lumber Increase=1.60, Plate Increase=1.60

Continued on page 3

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	DRHORTON/WILMINGTON; LOT 8 MCKAY PLACE	158690796
MP8	A03	COMMON	99	1	Job Reference (optional)	

Builders FirstSource, Apex, NC

ID:VULCYJU7zpRLimSP7MPFXTyf?ft-bZz_JOXxEakEmooYwQdUuK1gGP3YLyE_U4sRThzAdPe
8.630 s Mar 9 2023 MiTek Industries, Inc. Thu Jun 1 14:23:01 2023 Page 3

LOAD CASE(S)

Uniform Loads (plf)

Vert: 1-2=-39, 2-6=-43, 6-11=-50, 24-35=-20, 35-36=-50, 36-37=-20, 37-38=-50, 27-38=-20, 20-21=-30(F)
Horz: 1-2=-11, 2-6=-7, 6-11=0

21) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 1-2=-30, 2-32=-34, 6-32=-41, 6-11=-46, 24-35=-20, 35-36=-50, 36-37=-20, 37-38=-50, 27-38=-20, 20-21=-30(F)
Horz: 1-2=-20, 2-32=-16, 6-32=-9, 6-11=4

22) Dead + 0.75 Roof Live (bal.) + 0.75 Uninhab. Attic Storage + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60

Uniform Loads (plf)

Vert: 1-2=-43, 2-6=-46, 6-33=-41, 11-33=-34, 24-35=-20, 35-36=-50, 36-37=-20, 37-38=-50, 27-38=-20, 20-21=-30(F)
Horz: 1-2=-7, 2-6=-4, 6-33=9, 11-33=16

23) 1st Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-6=-60, 6-11=-20, 24-27=-20

24) 2nd Dead + Roof Live (unbalanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-6=-20, 6-11=-60, 24-27=-20

25) 3rd Dead + 0.75 Roof Live (unbalanced) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-6=-50, 6-11=-20, 24-35=-20, 35-36=-50, 36-37=-20, 37-38=-50, 27-38=-20, 20-21=-30(F)

26) 4th Dead + 0.75 Roof Live (unbalanced) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-6=-20, 6-11=-50, 24-35=-20, 35-36=-50, 36-37=-20, 37-38=-50, 27-38=-20, 20-21=-30(F)

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



818 Soundside Road
Edenton, NC 27932

Job MP8	Truss A04V	Truss Type SPECIAL	Qty 99	Ply 1	DRHORTON/WILMINGTON; LOT 8 MCKAY PLACE 158690797
------------	---------------	-----------------------	-----------	----------	---

Builders FirstSource (Apex, NC), Apex, NC - 27523, 8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 1 13:59:56 2023 Page 1

ID:VULCYJU7zpRLimSP7MPFxTyf?FT-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f



5x6 =

Scale = 1:77.5

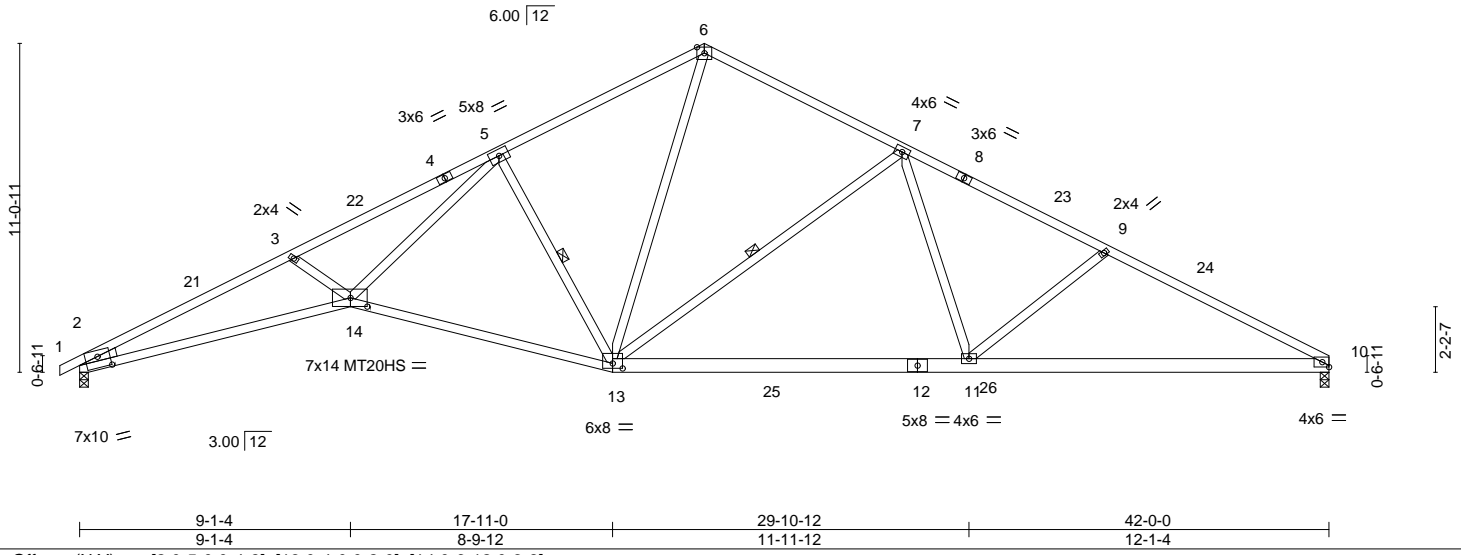


Plate Offsets (X, Y)--	[2:0-5-0,0-4-8], [13:0-4-0,0-2-0], [14:0-6-12,0-3-8]
------------------------	--


LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.93	Vert(LL)	-0.44 11-13	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.86	Vert(CT)	-0.94 13-14	>537	240	MT20HS	187/143
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.70	Horz(CT)	0.35 10	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-MS	Wind(LL)	0.21 13-14	>999	240		Weight: 236 lb FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP SS *Except* 8-10: 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied.
BOT CHORD 2x6 SP No.2 *Except* 2-14: 2x4 SP SS, 13-14: 2x4 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.3 *Except* 5-14: 2x4 SP No.2	WEBS 1 Row at midpt 5-13, 7-13
WEDGE Left: 2x4 SP No.3	

REACTIONS. (size) 2=0-3-8, 10=0-3-8
 Max Horz 2=137(LC 12)
 Max Grav 2=1720(LC 1), 10=1680(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-5379/193, 3-5=-5101/177, 5-6=-2199/214, 6-7=-1766/209, 7-9=-2728/155,
 9-10=-3079/173
 BOT CHORD 2-14=-124/4846, 13-14=-44/2602, 11-13=0/2193, 10-11=-72/2671
 WEBS 3-14=-264/167, 5-14=0/2862, 5-13=-1377/170, 6-13=-69/1379, 7-13=-896/106,
 7-11=0/671, 9-11=-410/164


- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-8-0 to 4-1-10, Interior(1) 4-1-10 to 21-0-0, Exterior(2) 21-0-0 to 27-7-12, Interior(1) 27-7-12 to 42-0-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) All plates are MT20 plates unless otherwise indicated.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 6) Bearing at joint(s) 2 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - 7) See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

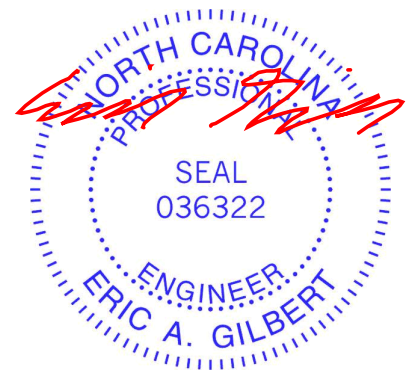

Job	Truss	Truss Type	Qty	Ply	DRHORTON/WILMINGTON; LOT 8 MCKAY PLACE
MP8	A05V	SPECIAL	99	1	158690798

Builders FirstSource (Apex, NC), Apex, NC - 27523, 8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 1 13:59:57 2023 Page 1

ID:VULCYJU7zpRLimSP7MPFxFyTf?FT-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f



Scale = 1:77.9


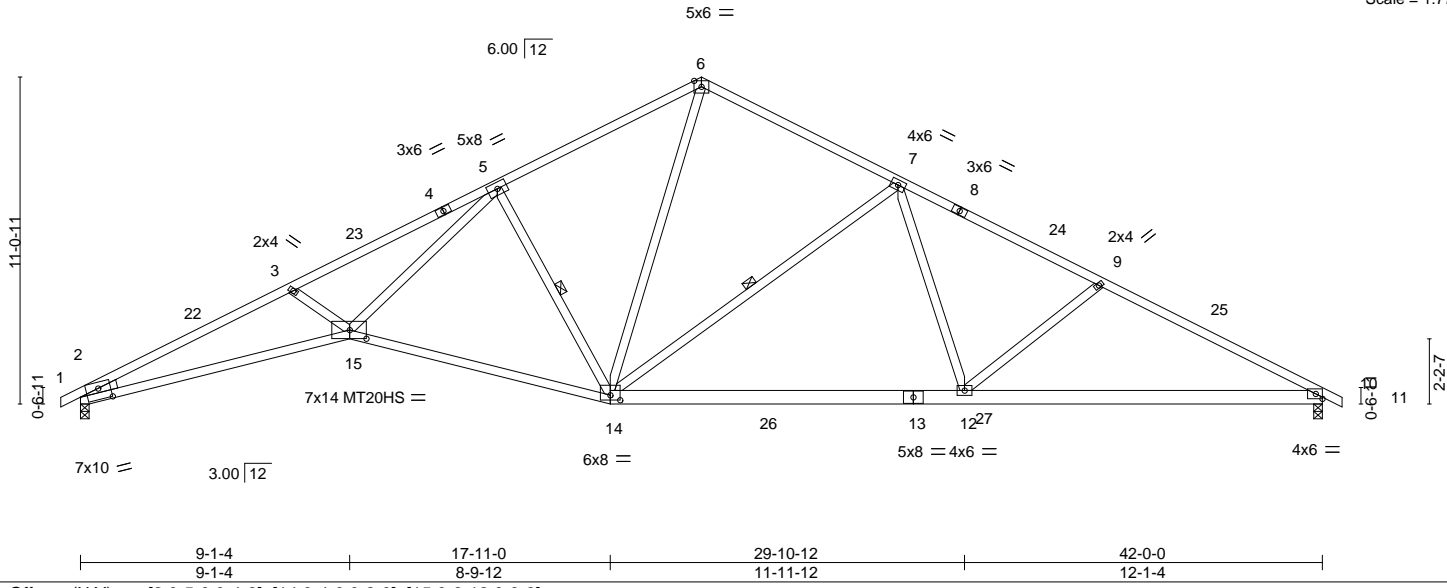


Plate Offsets (X,Y)--	[2:0-5-0,0-4-8], [14:0-4-0,0-2-0], [15:0-6-12,0-3-8]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.93	Vert(LL) -0.43 12-14 >999 360	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.86	Vert(CT) -0.93 14-15 >542 240	MT20HS	187/143
BCLL 0.0 *	Rep Stress Incr YES	WB 0.70	Horz(CT) 0.35 10 n/a n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-MS	Wind(LL) 0.21 14-15 >999 240	Weight: 237 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP SS	TOP CHORD Structural wood sheathing directly applied.
BOT CHORD 2x6 SP No.2 *Except*	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
2-15: 2x4 SP SS, 14-15: 2x4 SP No.1	WEBS 1 Row at midpt 5-14, 7-14
WEBS 2x4 SP No.3 *Except*	
5-15: 2x4 SP No.2	
WEDGE	
Left: 2x4 SP No.3	

REACTIONS.	(size) 2=0-3-8, 10=0-3-8
	Max Horz 2=134(LC 12)
	Max Grav 2=1720(LC 1), 10=1720(LC 1)
FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-3=-5378/187, 3-5=-5100/169, 5-6=-2199/213, 6-7=-1766/207, 7-9=-2726/148, 9-10=-3077/164
BOT CHORD	2-15=-93/4845, 14-15=-24/2601, 12-14=0/2191, 10-12=-48/2670
WEBS	3-15=-264/167, 5-15=0/2861, 5-14=-1377/164, 6-14=-67/1377, 7-14=-893/106, 7-12=0/671, 9-12=-412/164

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-8-0 to 4-1-10, Interior(1) 4-1-10 to 21-0-0, Exterior(2) 21-0-0 to 27-7-12, Interior(1) 27-7-12 to 42-8-0 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) All plates are MT20 plates unless otherwise indicated.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 6) Bearing at joint(s) 2 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - 7) See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

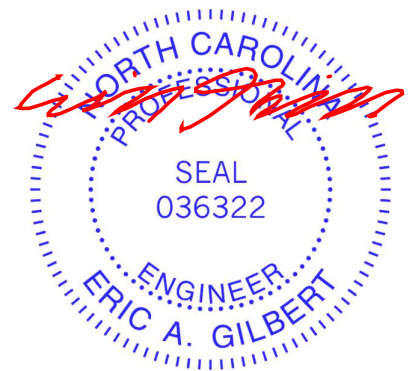

Job	Truss	Truss Type	Qty	Ply	DRHORTON/WILMINGTON; LOT 8 MCKAY PLACE
MP8	A06VG	GABLE	99	1	158690799

Builders FirstSource (Apex, NC), Apex, NC - 27523,


8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 1 13:59:59 2023 Page 1

ID:VULCYJU7zpRLimSP7MPFXTyf?IT-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Job Reference (optional)

-0-8-0	21-8-0	42-8-0	43-4-0
0-8-0	21-0-0	21-0-0	0-8-0

Scale = 1:74.8

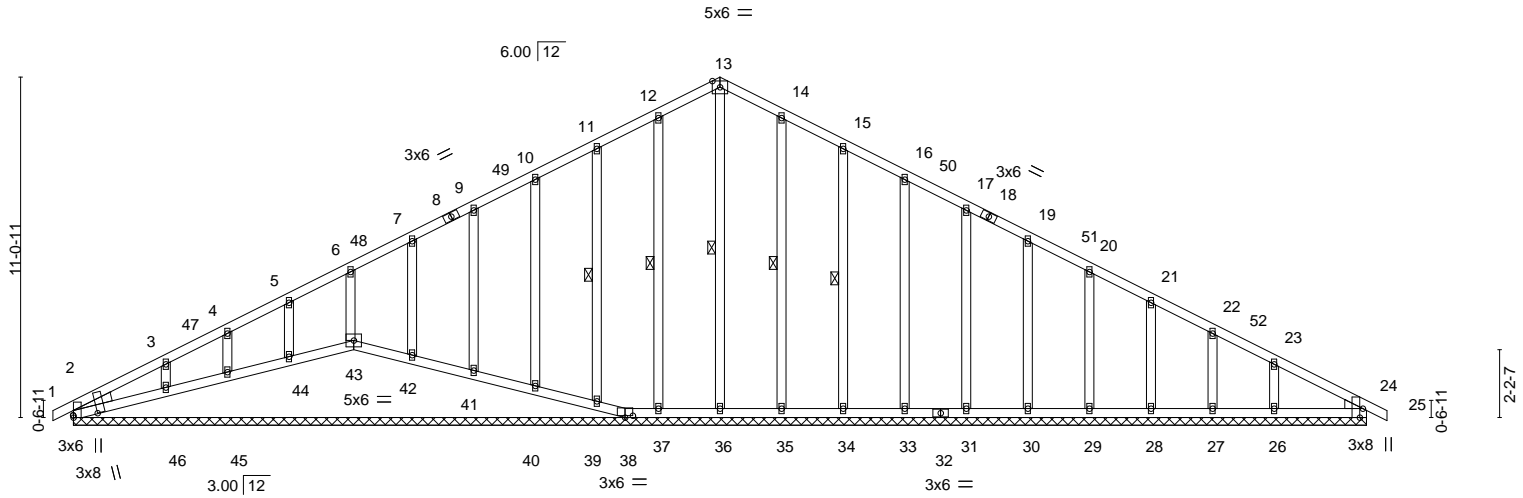

-0-8-0	9-9-4	18-7-0	42-8-0	43-4-0
0-8-0	9-1-4	8-9-12	24-1-0	0-8-0

Plate Offsets (X, Y)-- [2:0-0-14,Edge], [2:0-1-8,0-9-8], [24:0-3-8,Edge], [38:0-3-0,0-12]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.09	Vert(LL)	0.00	25	n/r	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.07	Vert(CT)	0.00	25	n/r		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.14	Horz(CT)	0.01	24	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-S						
								Weight: 288 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 OTHERS 2x4 SP No.3
 WEDGE
 Left: 2x4 SP No.3 , Right: 2x4 SP No.3


BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
 WEBS 1 Row at midpt 13-36, 12-37, 11-39, 14-35, 15-34

REACTIONS. All bearings 42-0-0.
 (lb) - Max Horz 2=134(LC 12)
 Max Uplift All uplift 100 lb or less at joint(s) 43, 38, 2, 37, 39, 40, 41, 42, 44, 45, 46, 34, 33, 31, 30, 29, 28, 27, 26
 Max Grav All reactions 250 lb or less at joint(s) 43, 38, 2, 24, 36, 37, 39, 40, 41, 42, 44, 45, 46, 35, 34, 33, 31, 30, 29, 28, 27, 26

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-8-0 to 4-1-10, Interior(1) 4-1-10 to 21-0-0, Exterior(2) 21-0-0 to 27-9-7, Interior(1) 27-9-7 to 42-8-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 4) All plates are 2x4 MT20 unless otherwise indicated.
- 5) Gable requires continuous bottom chord bearing.
- 6) Gable studs spaced at 2-0-0 oc.
- 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 8) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 43, 38, 2, 37, 39, 40, 41, 42, 44, 45, 46, 34, 33, 31, 30, 29, 28, 27, 26.
- 10) See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

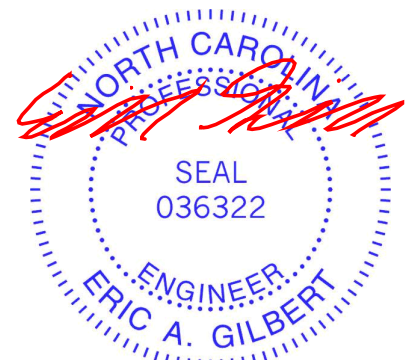


June 1, 2023

Job MP8	Truss B01G	Truss Type GABLE	Qty 99	Ply 1	DRHORTON/WILMINGTON; LOT 8 MCKAY PLACE 158690800
------------	---------------	---------------------	-----------	----------	---

Builders FirstSource (Apex, NC), Apex, NC - 27523, 8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 1 14:00:01 2023 Page 1

ID:VULCYJU7zpRLimSP7MPFXTyf?FT-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f



Scale = 1:41.0

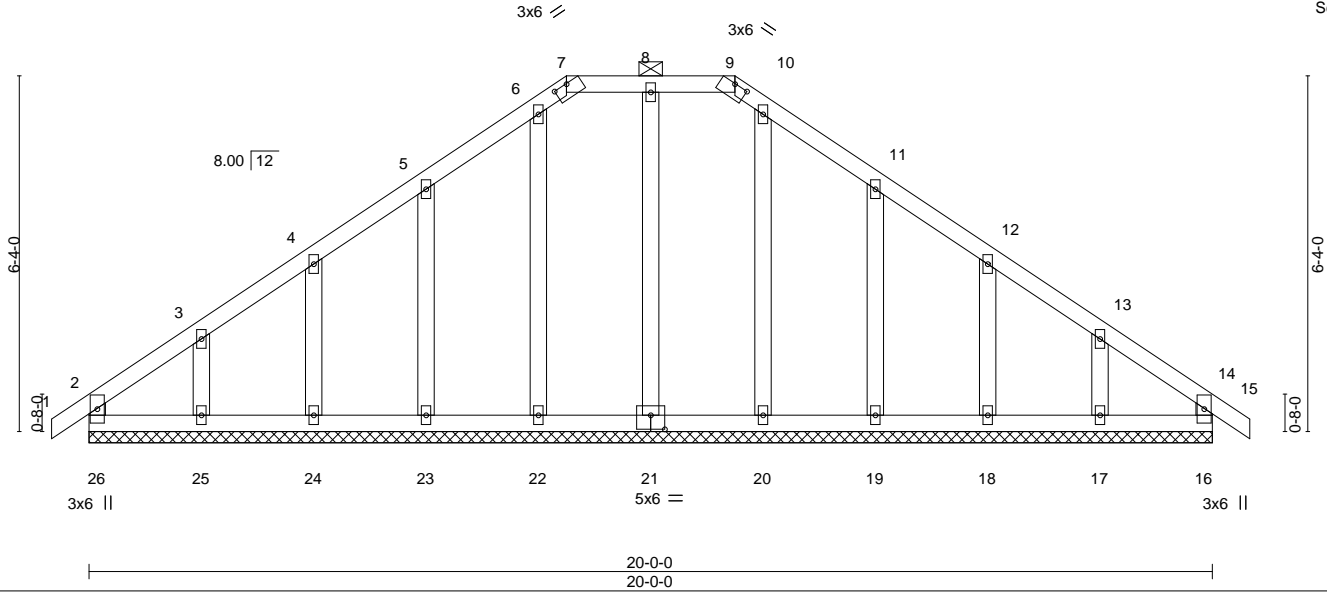


Plate Offsets (X,Y)--	[7:0-3-0,0-0-2], [9:0-3-0,0-0-2], [21:0-3-0,0-3-0]
-----------------------	--

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL	1.15	TC 0.05	Vert(LL)	-0.00	14	n/r	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.04	Vert(CT)	-0.00	15	n/r		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.08	Horz(CT)	0.00	16	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-R						

Weight: 118 lb FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SP No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 7-9.
BOT CHORD 2x4 SP No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.2	
OTHERS 2x4 SP No.3	

REACTIONS. All bearings 20-0-0.
 (lb) - Max Horz 26=134(LC 11)
 Max Uplift All uplift 100 lb or less at joint(s) 26, 16, 21, 23, 24, 25, 19, 18, 17
 Max Grav All reactions 250 lb or less at joint(s) 26, 16, 21, 22, 23, 24, 25, 20, 19, 18, 17

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) 0-8-0 to 4-0-0, Exterior(2) 4-0-0 to 8-6-0, Corner(3) 8-6-0 to 16-0-0, Exterior(2) 16-0-0 to 20-8-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - Provide adequate drainage to prevent water ponding.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - Gable studs spaced at 2-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 26, 16, 21, 23, 24, 25, 19, 18, 17.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



Job MP8	Truss B02GR	Truss Type COMMON	Qty 99	Ply 3	DRHORTON/WILMINGTON; LOT 8 MCKAY PLACE 158690801
------------	----------------	----------------------	-----------	----------	---

Builders FirstSource (Apex, NC), Apex, NC - 27523, 8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 1 14:00:03 2023 Page 1

ID:VULCYJU7zpRLimSP7MPFXTyf?IT-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

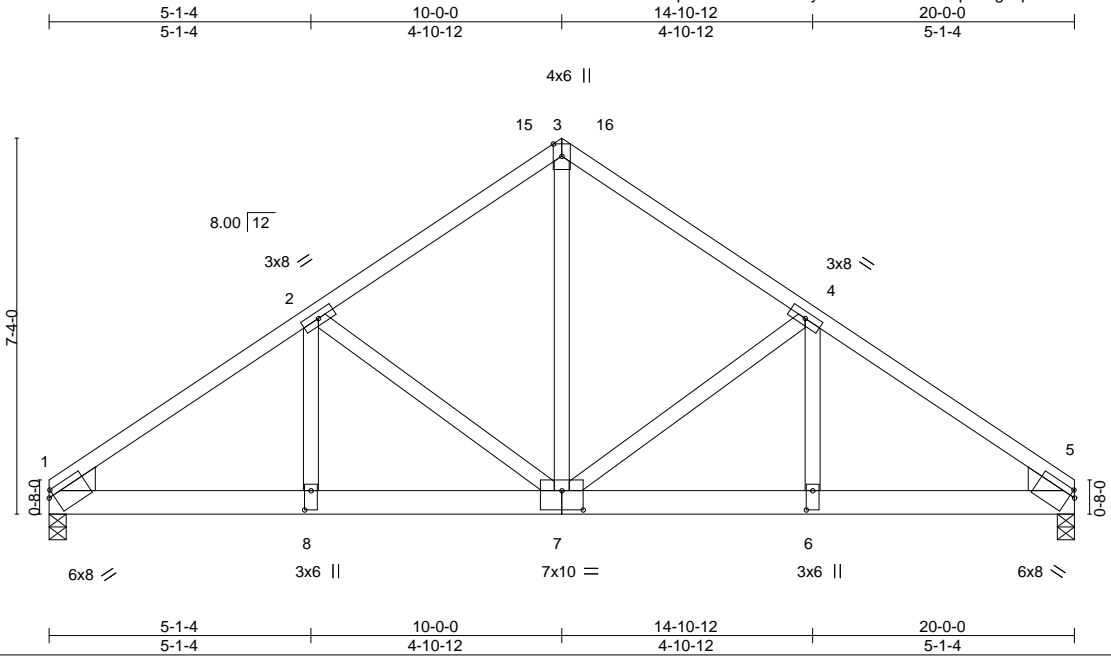


Plate Offsets (X, Y)--	[1:0-1-3,0-1-8], [5:0-1-3,0-1-8], [6:0-4-8,0-1-8], [7:0-5-0,0-4-8], [8:0-4-8,0-1-8]
------------------------	---

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.50	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.49	Vert(LL) -0.10 7-8 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.74	Vert(CT) -0.21 7-8 >999 240		
BCDL 10.0	Rep Stress Incr NO	Matrix-MS	Horz(CT) 0.05 5 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.08 7-8 >999 240	Weight: 369 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 SP No.2
BOT CHORD 2x6 SP DSS
WEBS 2x4 SP No.3 *Except*
3-7: 2x4 SP No.2

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

WEDGE
Left: 2x6 SP No.2 , Right: 2x6 SP No.2

REACTIONS. (size) 1=0-4-0, 5=0-4-0
Max Horz 1=-131(LC 4)
Max Uplift 1=-726(LC 8), 5=-726(LC 9)
Max Grav 1=9300(LC 1), 5=9300(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=-12048/948, 2-3=-8468/713, 3-4=-8468/713, 4-5=-12048/948
BOT CHORD 1-8=-834/9933, 7-8=-834/9933, 6-7=-726/9933, 5-6=-726/9933
WEBS 3-7=-717/8989, 4-7=-3678/402, 4-6=-284/3944, 2-7=-3678/401, 2-8=-284/3944

- NOTES-**
- 3-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-4-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=726, 5=726.

LOAD CASE(S) Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-3=-60, 3-5=-60, 9-12=-870(F=-850)




Job MP8	Truss P01G	Truss Type GABLE	Qty 99	Ply 1	DRHORTON/WILMINGTON; LOT 8 MCKAY PLACE 158690802
------------	---------------	---------------------	-----------	----------	---

Builders FirstSource (Apex, NC),


Apex, NC - 27523,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 1 14:00:03 2023 Page 1

ID:VULCYJU7zpRLimSP7MPFXTyf?FT-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f



Scale = 1:11.1

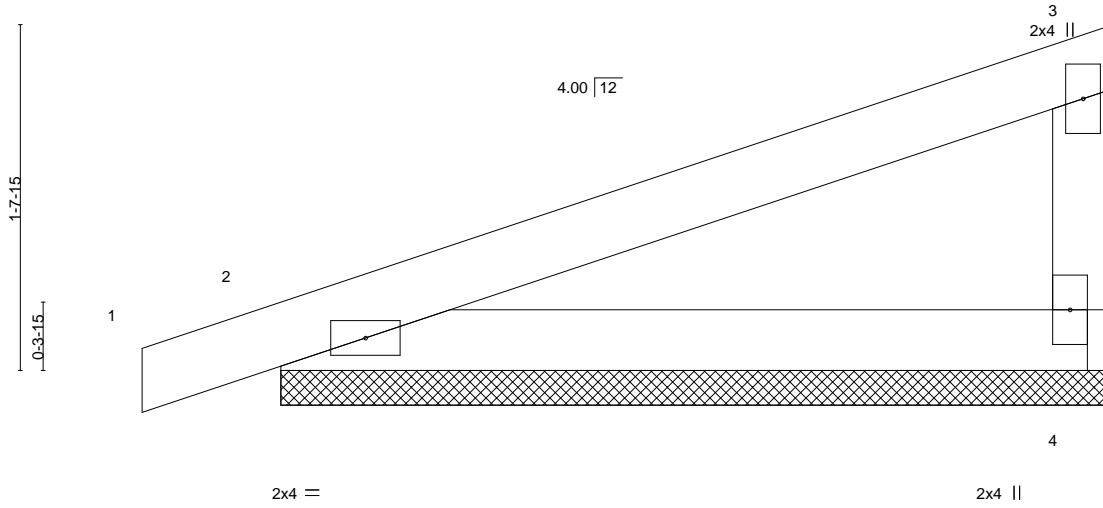

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 20.0	Plate Grip DOL	1.15	TC 0.26	Vert(LL)	-0.00	1	n/r	120	MT20	244/190
TCDL 10.0	Lumber DOL	1.15	BC 0.18	Vert(CT)	0.01	1	n/r	120		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	4	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014		Matrix-P						Weight: 15 lb	FT = 20%


LUMBER-
 TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 WEBS 2x4 SP No.3

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 4-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 2=4-0-0, 4=4-0-0
 Max Horz 2=47(LC 9)
 Max Uplift 2=31(LC 8), 4=16(LC 12)
 Max Grav 2=198(LC 1), 4=151(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 3) Gable requires continuous bottom chord bearing.
 - 4) Gable studs spaced at 2-0-0 oc.
 - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 4.

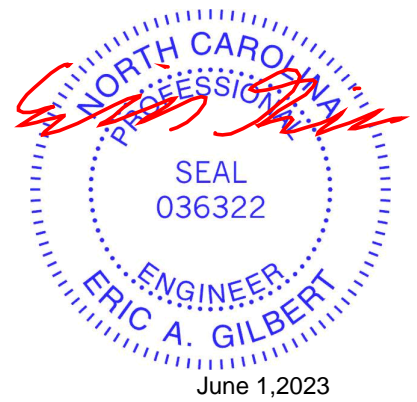


Job MP8	Truss P02	Truss Type MONO TRUSS	Qty 99	Ply 1	DRHORTON/WILMINGTON; LOT 8 MCKAY PLACE 158690803
------------	--------------	--------------------------	-----------	----------	---

Builders FirstSource (Apex, NC),

Apex, NC - 27523,

8.630 s Nov 19 2022 MiTek Industries, Inc. Thu Jun 1 14:00:04 2023 Page 1

ID:VULCYJU7zprLimSP7MPFXTyf?FT-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

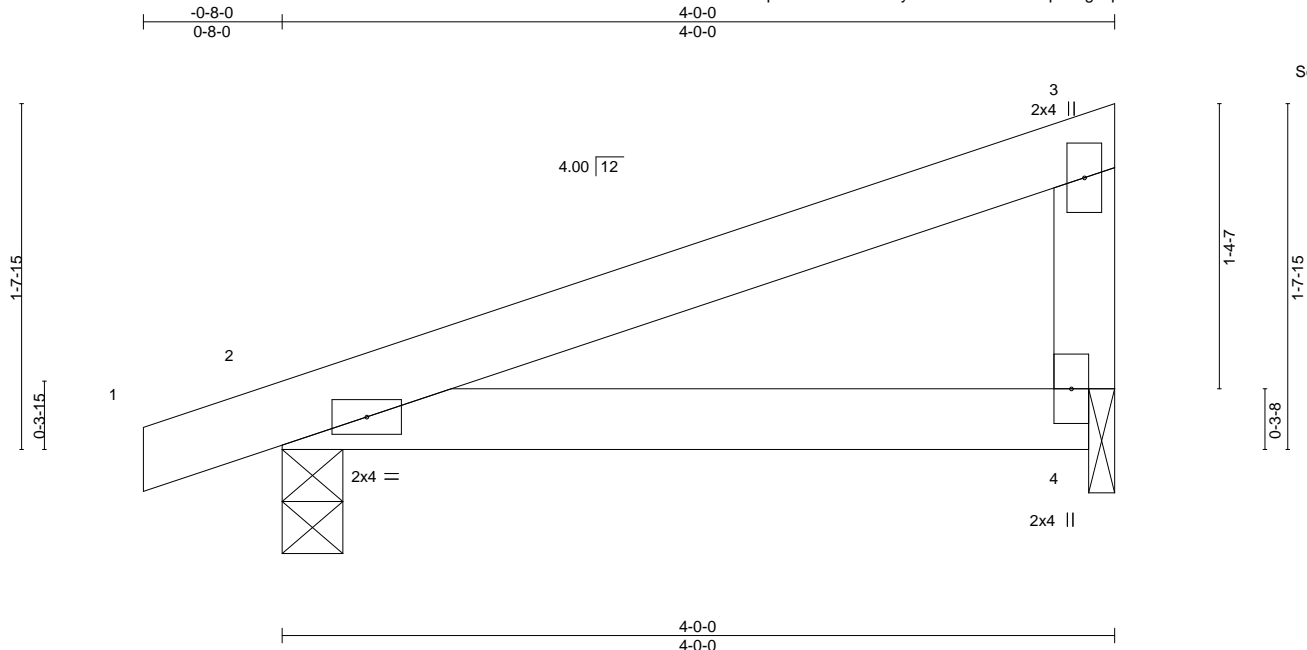

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.19	Vert(LL)	-0.01	4-7	>999	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.17	Vert(CT)	-0.02	4-7	>999		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.00	Horz(CT)	0.00	2	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-MP	Wind(LL)	0.01	4-7	>999		
	Code IRC2015/TPI2014						Weight: 15 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SP No.2
 BOT CHORD 2x4 SP No.2
 WEBS 2x4 SP No.3

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 4-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 2=0-3-8, 4=0-1-8
 Max Horz 2=47(LC 11)
 Max Uplift 2=31(LC 8), 4=16(LC 12)
 Max Grav 2=198(LC 1), 4=151(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Wind: ASCE 7-10; Vult=115mph Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=32ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 4) Bearing at joint(s) 4 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - 5) Provide mechanical connection (by others) of truss to bearing plate at joint(s) 4.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 4.



June 1, 2023

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0- 1/16" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

* Plate location details available in **MITek 20/20 software** or upon request.

PLATE SIZE

4 X 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING



Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur. Min size shown is for crushing only.

Industry Standards:

ANSI/TFP 1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-89: Design Standard for Bracing, Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

6-4-8
dimensions shown in ft-in-sixteenths
(Drawings not to scale)



JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ESR1988
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TFP 1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MITteK® All Rights Reserved



MITek Engineering Reference Sheet: Mill-7473 rev. 5/19/2020



General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TFP 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TFP 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Rewriting pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TFP 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.