

# Harnett County Department of Public Health

PERMIT # SFD2307-0023

## Operation Permit

New Installation  
  Septic Tank  
  Nitrification Line  
  Repair  
  Expansion

PROPERTY LOCATION: 143 DECOY SPREAD PL

Name: (owner) SMITH DOUGLAS HOMES    SUBDIVISION DUNCANS CROSSING    LOT # 33

System Installer: A+R


Basement with plumbing:     Garage     Number of Bedrooms 4

Type of Water Supply:  Community     Public     Well    Distance from well \_\_\_\_\_ feet

System Type: IIIb    Types V and VI Systems expire in 5 years.

(In accordance with Table V a)    Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

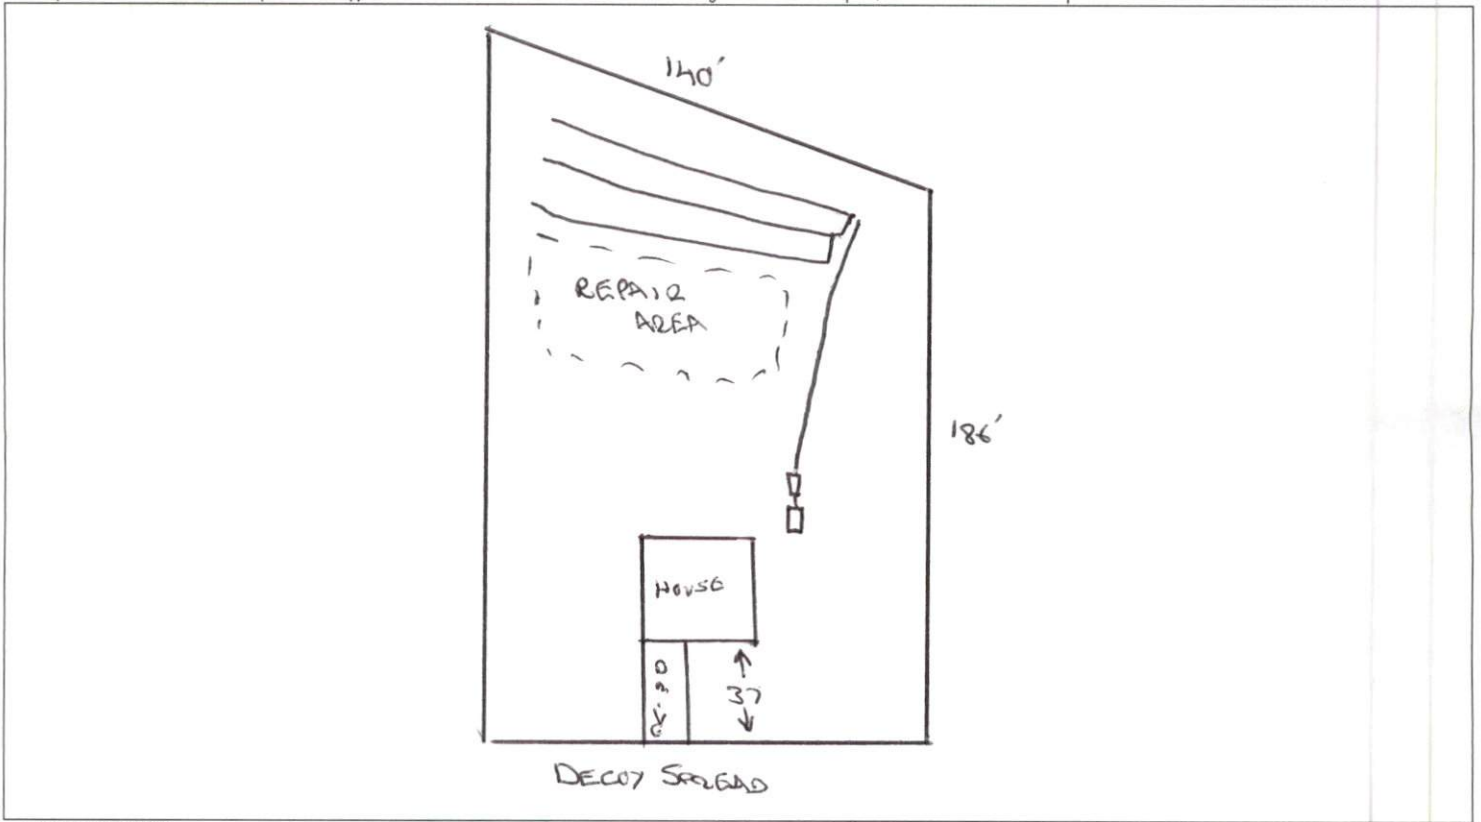

**PERMIT CONDITIONS:**

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: \_\_\_\_\_  
 Subsurface system operator required? Yes  No   
 If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: \_\_\_\_\_  
 V. Other: \_\_\_\_\_

D-Box  
  Pump  
  Alarm  
  H2O Line  
  PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system:  Conventional     Other Pump To Chamber (34')    Septic Tank: 1000 gallons    Pump Tank: 1000 gallons

Subsurface Drainage Field: No. of ditches 1    exact length of each ditch 300 feet    width of ditches 3 feet    depth of ditches 24 inches

French Drain Required: \_\_\_\_\_ Linear feet

Authorized State Agent: [Signature]    Date: 11/14/23