


Job J0321-1553	Truss A1	Truss Type Common	Qty 1	Ply 1	LOT 7 WOODBURY FARM Job Reference (optional)
-------------------	-------------	----------------------	----------	----------	---

Comtech, Inc., Fayetteville, NC 28309, Bob Lewis

Run: 8.300 s Mar 22 2019 Print: 8.300 s Mar 22 2019 MiTek Industries, Inc. Wed Mar 24 15:08:57 2021 Page 1  
ID:oc86cjOn3j\_xrZlawBNe\_4zXIAc-QwnCfdwqWvNONp3YxyaxRPDRieP\_?HC4xNyUstzXiAq



Scale = 1:73.2

Plate Offsets (X,Y)-- [2:0-0-13,0-1-0], [2:0-1-11,0-4-13], [2:0-5-8,Edge]

LOADING (psf)	SPACING	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.25	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.49	Vert(LL) -0.12 2-13 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.47	Vert(CT) -0.20 2-13 >999 240		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.02 10 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.04 2-13 >999 240		
				Weight: 226 lb	FT = 20%

**LUMBER-**

TOP CHORD 2x6 SP No.1  
BOT CHORD 2x6 SP No.1  
WEBS 2x4 SP No.2 \*Except\*  
W6: 2x6 SP No.1

WEDGE  
Left: 2x4 SP No.2

**REACTIONS.** (size) 2=0-4-0 (min. 0-1-9), 10=Mechanical  
Max Horz 2=319(LC 9)  
Max Uplift 2=-70(LC 12), 10=-54(LC 12)  
Max Grav 2=1309(LC 19), 10=1270(LC 19)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1509/336, 3-5=-1380/489, 5-7=-1143/460  
BOT CHORD 2-13=-216/1241, 11-13=-2/757, 10-11=-138/744  
WEBS 3-13=-527/371, 5-13=-229/946, 5-11=-146/399, 7-11=-171/263, 7-10=-1236/252

**NOTES-**

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=18ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-8-10 to 5-7-0, Interior(1) 5-7-0 to 14-11-0, Exterior(2) 14-11-0 to 21-2-10, Interior(1) 21-2-10 to 26-8-12 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 10.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard


**BRACING-**

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
WEBS 1 Row at midpt 5-13, 7-10

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

Job J0321-1553	Truss A1A	Truss Type COMMON	Qty 1	Ply 1	LOT 7 WOODBURY FARM
Comtech, Inc., Fayetteville, NC 28309, Bob Lewis					Job Reference (optional)

Run: 8.300 s Mar 22 2019 Print: 8.300 s Mar 22 2019 MiTek Industries, Inc. Wed Mar 24 15:08:58 2021 Page 1  
ID:oc86cjOn3j\_xrZlawBNe\_4zXIAc-u7LatzxSHDVF\_zekVf5AzdmcQ2k7kkPDA11iOJzXiAp

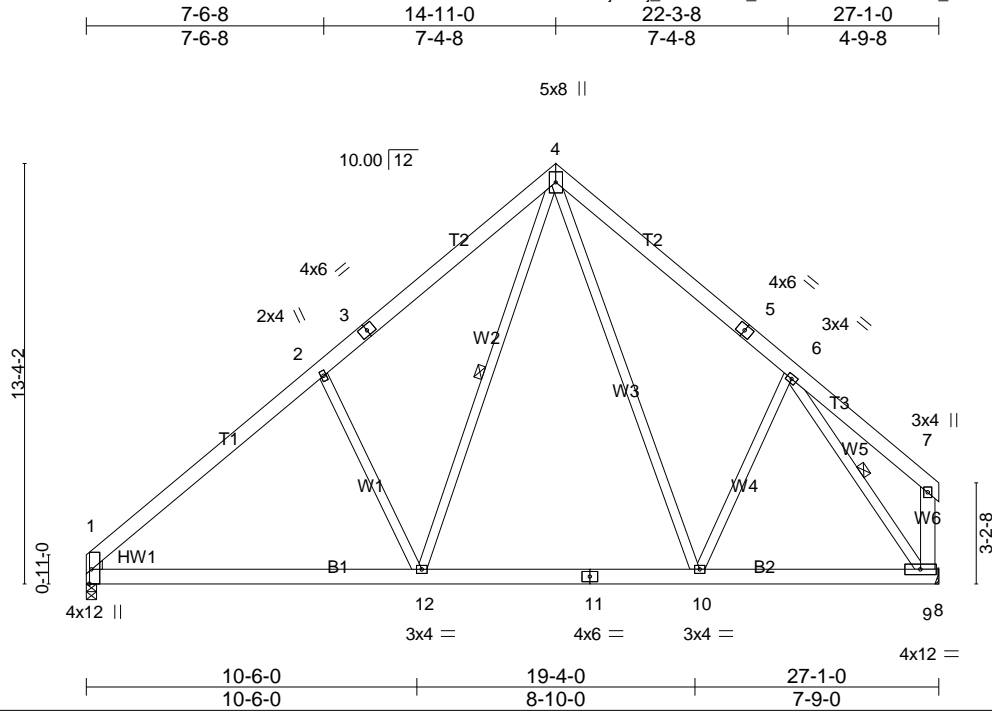

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.25	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.49	Vert(LL) -0.12 1-12 >999 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.47	Vert(CT) -0.21 1-12 >999 240		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.02 9 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.03 1-12 >999 240		
				Weight: 224 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SP No.1	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x6 SP No.1	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SP No.2 *Except* W6: 2x6 SP No.1	WEBS 1 Row at midpt 4-12, 6-9
WEDGE Left: 2x4 SP No.2	MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** (size) 1=0-4-0 (min. 0-1-8), 9=Mechanical  
Max Horz 1=316(LC 9)  
Max Uplift 1=-56(LC 12), 9=-54(LC 12)  
Max Grav 1=1259(LC 19), 9=1270(LC 19)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-2=-1511/342, 2-4=-1383/499, 4-6=-1143/461  
BOT CHORD 1-12=-218/1243, 10-12=-2/757, 9-10=-138/744  
WEBS 2-12=-528/376, 4-12=-232/949, 4-10=-147/397, 6-10=-171/262, 6-9=-1236/256


- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=18ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-2-0 to 6-5-10, Interior(1) 6-5-10 to 14-11-0, Exterior(2) 14-11-0 to 21-2-10, Interior(1) 21-2-10 to 26-8-12 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - Refer to girder(s) for truss to truss connections.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 9.
  - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard

Job J0321-1553	Truss A1B	Truss Type Common	Qty 4	Ply 1	LOT 7 WOODBURY FARM Job Reference (optional)
-------------------	--------------	----------------------	----------	----------	---

Comtech, Inc., Fayetteville, NC 28309, Bob Lewis

Run: 8.300 s Mar 22 2019 Print: 8.300 s Mar 22 2019 MiTek Industries, Inc. Wed Mar 24 15:08:59 2021 Page 1  
ID:oc86cjOn3j\_xrZlawBNe\_4zXIAC-MJuy4Jy42Wd6c6Dx3NcPWqJlQR3wT7BNPhRbwIzXiAo

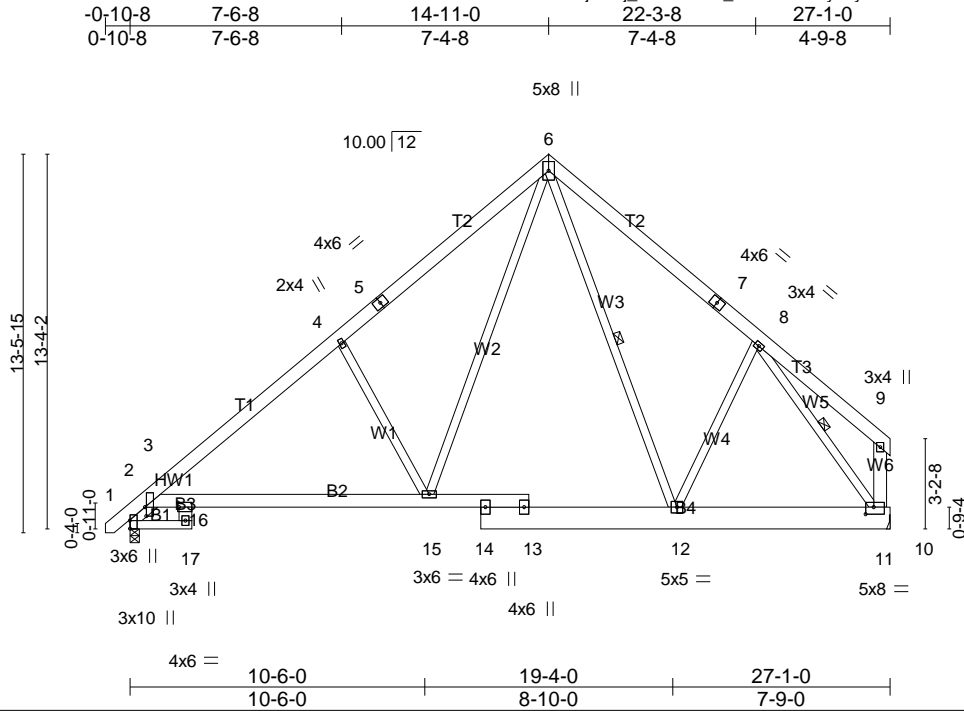

Scale = 1:82.1

Plate Offsets (X,Y)-- [2:0-3-8,Edge], [3:0-3-13,0-0-8], [11:0-3-8,0-3-0], [16:0-0-8,0-2-0]

LOADING (psf)	SPACING	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.36	Vert(LL) -0.14	15-16	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.52	Vert(CT) -0.27	15-16	>999	240		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.69	Horz(CT) 0.08	11	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S	Wind(LL) 0.10	15-16	>999	240		
							Weight: 254 lb	FT = 20%

**LUMBER-**

TOP CHORD 2x6 SP No.1  
 BOT CHORD 2x6 SP No.1 \*Except\*  
 B1: 2x4 SP No.1, B4: 2x10 SP No.1  
 WEBS 2x4 SP No.2 \*Except\*  
 W6: 2x6 SP No.1  
 SLIDER Left 2x4 SP No.2 -t 1-0-14

**BRACING-**

TOP CHORD Structural wood sheathing directly applied or 5-5-15 oc purlins, except end verticals.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
 WEBS 1 Row at midpt 6-12, 8-11

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.**

(size) 2=0-4-0 (min. 0-1-8), 11=Mechanical  
 Max Horz2=320(LC 9)  
 Max Uplift2=-68(LC 12), 11=-55(LC 12)  
 Max Grav2=1259(LC 19), 11=1256(LC 19)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1218/312, 3-4=-1607/380, 4-6=-1506/505, 6-8=-1131/459  
 BOT CHORD 2-17=-246/466, 3-16=-39/931, 15-16=-245/1397, 12-15=-4/781, 11-12=-141/743  
 WEBS 4-15=-578/366, 6-15=-250/1121, 6-12=-151/342, 8-12=-186/269, 8-11=-1208/236


**NOTES-**

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=18ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-8-10 to 5-7-0, Interior(1) 5-7-0 to 14-11-0, Exterior(2) 14-11-0 to 21-2-10, Interior(1) 21-2-10 to 26-8-12 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 11.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard

Job J0321-1553	Truss A1GE	Truss Type GABLE	Qty 1	Ply 1	LOT 7 WOODBURY FARM
Comtech, Inc., Fayetteville, NC 28309, Bob Lewis					Job Reference (optional)

Run: 8.300 s Mar 22 2019 Print: 8.300 s Mar 22 2019 MiTek Industries, Inc. Wed Mar 24 15:09:00 2021 Page 1  
ID:oc86cjOn3j\_xrZlawBNe\_4zXlAc-qVSKHezjppqzEGo7d47e32rxQrPICe4WeLB8SBzXlAn



5x12 ||

Scale = 1:73.8

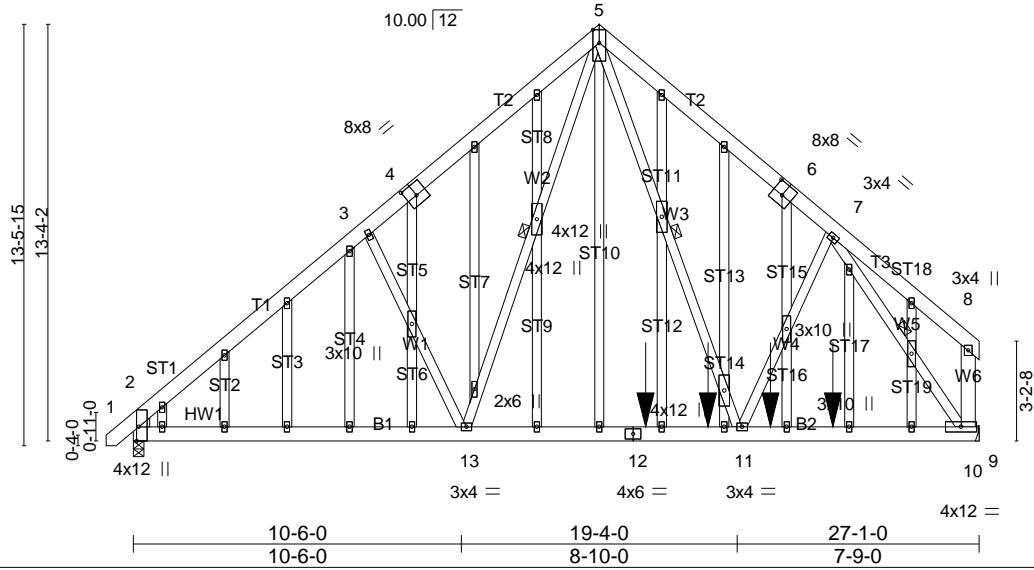


Plate Offsets (X,Y)-- [2:0-5-8,Edge], [2:0-1-11,0-4-13], [2:0-0-13,0-1-0], [4:0-4-0,0-4-8], [6:0-4-0,0-4-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.28	Vert(LL) -0.12	2-13	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.55	Vert(CT) -0.20	2-13	>999	240		
BCLL 0.0 *	Rep Stress Incr NO	WB 0.39	Horz(CT) 0.02	10	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S	Wind(LL) 0.05	2-13	>999	240		
							Weight: 357 lb	FT = 20%

**LUMBER-**

TOP CHORD 2x6 SP No.1  
 BOT CHORD 2x6 SP No.1  
 WEBS 2x4 SP No.2 \*Except\*  
 W6: 2x6 SP No.1  
 OTHERS 2x4 SP No.2  
 WEDGE  
 Left: 2x4 SP No.2

**BRACING-**

TOP CHORD Structural wood sheathing directly applied or 5-11-15 oc purlins, except end verticals.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
 WEBS 1 Row at midpt 5-13, 5-11, 7-10

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.**

(size) 2=0-4-0 (min. 0-1-10), 10=Mechanical  
 Max Horz 2=393(LC 5)  
 Max Uplift 2=-265(LC 8), 10=-293(LC 8)  
 Max Grav 2=1360(LC 33), 10=1400(LC 33)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1583/341, 3-5=-1453/497, 5-7=-1265/485  
 BOT CHORD 2-13=-422/1338, 11-13=-116/835, 10-11=-182/826  
 WEBS 3-13=-447/471, 5-13=-332/979, 5-11=-325/550, 7-11=-183/399, 7-10=-1366/324

**NOTES-**

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=18ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=265, 10=293.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 48 lb down and 39 lb up at 16-4-12, 48 lb down and 39 lb up at 18-4-12, and 48 lb down and 39 lb up at 20-4-12, and 48 lb down and 39 lb up at 22-4-12 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

Continued on page 2

Job	Truss	Truss Type	Qty	Ply	LOT 7 WOODBURY FARM
J0321-1553	A1GE	GABLE	1	1	Job Reference (optional)

Comtech, Inc., Fayetteville, NC 28309, Bob Lewis

Run: 8.300 s Mar 22 2019 Print: 8.300 s Mar 22 2019 MiTek Industries, Inc. Wed Mar 24 15:09:00 2021 Page 2  
ID:oc86cjOn3j\_xrZlawBNe\_4zXIAc-qVSKHezjppqzEGo7d47e32rxQrPICe4WeLB8SBzXiAn

**LOAD CASE(S)** Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-5=-60, 5-8=-60, 2-9=-20


Concentrated Loads (lb)

Vert: 46=-38(B) 48=-38(B) 49=-38(B) 51=-38(B)

Job J0321-1553	Truss A2	Truss Type Roof Special	Qty 2	Ply 1	LOT 7 WOODBURY FARM Job Reference (optional)
-------------------	-------------	----------------------------	----------	----------	---

Comtech, Inc., Fayetteville, NC 28309, Bob Lewis

Run: 8.300 s Mar 22 2019 Print: 8.300 s Mar 22 2019 MiTek Industries, Inc. Wed Mar 24 15:09:01 2021 Page 1  
ID:oc86cjOn3j\_xrZlawBNe\_4zXIac-li0iV\_zLa8tqrQNJAoetbFO1yFI?xy1fs?wh?ezXiAm



5x8 ||

Scale = 1:78.7

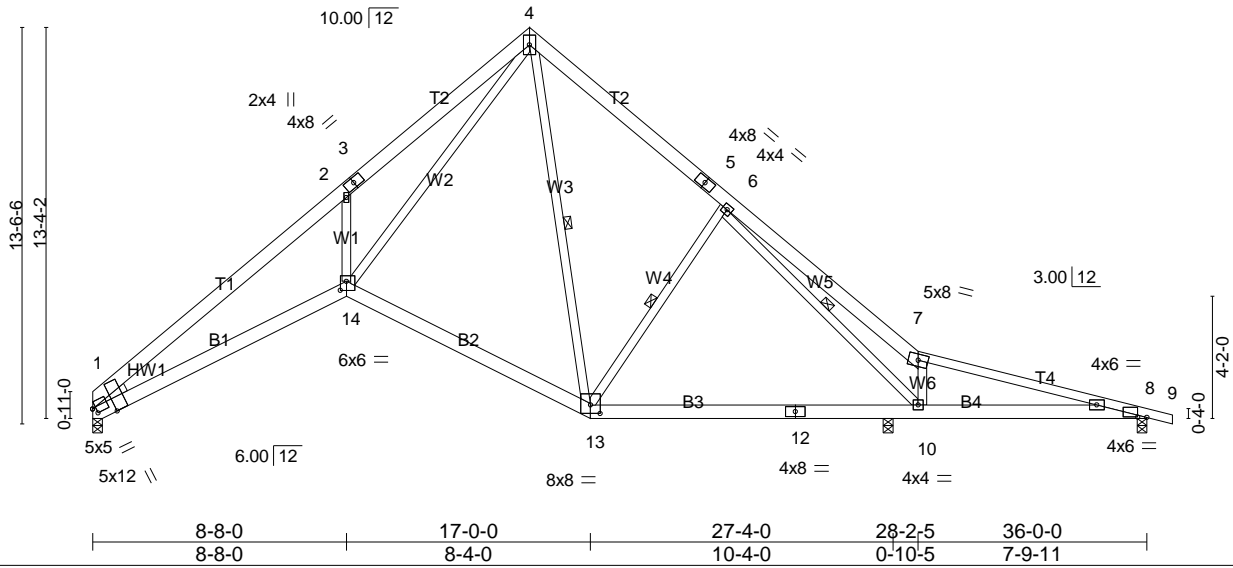


Plate Offsets (X,Y)-- [1:0-1-5,0-2-7], [1:0-5-3,Edge], [8:0-3-12,0-0-3], [13:0-4-0,0-3-8], [14:0-2-8,0-3-12]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.55	Vert(LL) -0.16	11-13	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.74	Vert(CT) -0.31	13-14	>999	240		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.99	Horz(CT) 0.22	8	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S	Wind(LL) 0.16	8-10	>648	240		
							Weight: 259 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x6 SP No.1 \*Except\*  
T4: 2x4 SP No.1  
BOT CHORD 2x6 SP No.1  
WEBS 2x4 SP No.2  
WEDGE  
Left: 2x4 SP No.2

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 3-10-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
WEBS 1 Row at midpt 4-13, 6-13, 6-10

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** (size) 1=0-4-0 (min. 0-1-8), 8=0-4-0 (min. 0-1-8), 11=0-4-0 (min. 0-1-10)  
Max Horz 1=-325(LC 10)  
Max Uplift 1=-66(LC 12), 8=-176(LC 9), 11=-60(LC 13)  
Max Grav 1=1114(LC 1), 8=518(LC 1), 11=1352(LC 2)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-2=-2914/476, 2-4=-2939/836, 4-6=-1101/448, 6-7=-754/597, 7-8=-501/286  
BOT CHORD 1-14=-241/2599, 13-14=0/868, 11-13=-104/806, 10-11=-104/806, 8-10=-203/435  
WEBS 2-14=-585/483, 4-14=-509/2623, 4-13=-250/263, 6-13=-422/371, 6-10=-804/31, 7-10=-715/502

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=18ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-2-0 to 6-5-10, Interior(1) 6-5-10 to 14-11-0, Exterior(2) 14-11-0 to 21-2-10, Interior(1) 21-2-10 to 36-10-8 zone; porch right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - Bearing at joint(s) 1 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 11 except (jt=lb) 8=176.
  - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.


**LOAD CASE(S)** Standard

Job	Truss	Truss Type	Qty	Ply	LOT 7 WOODBURY FARM
J0321-1553	A2A	Roof Special	6	1	Job Reference (optional)

Comtech, Inc., Fayetteville, NC 28309, Bob Lewis

Run: 8.300 s Mar 22 2019 Print: 8.300 s Mar 22 2019 MiTek Industries, Inc. Wed Mar 24 15:09:01 2021 Page 1

ID:oc86cjOn3j\_xrZlawBNe\_4zXlAc-li0iV\_zLa8tqrQNJAoetbFO0\_Fh7xzVfs?wh?ezXiAm

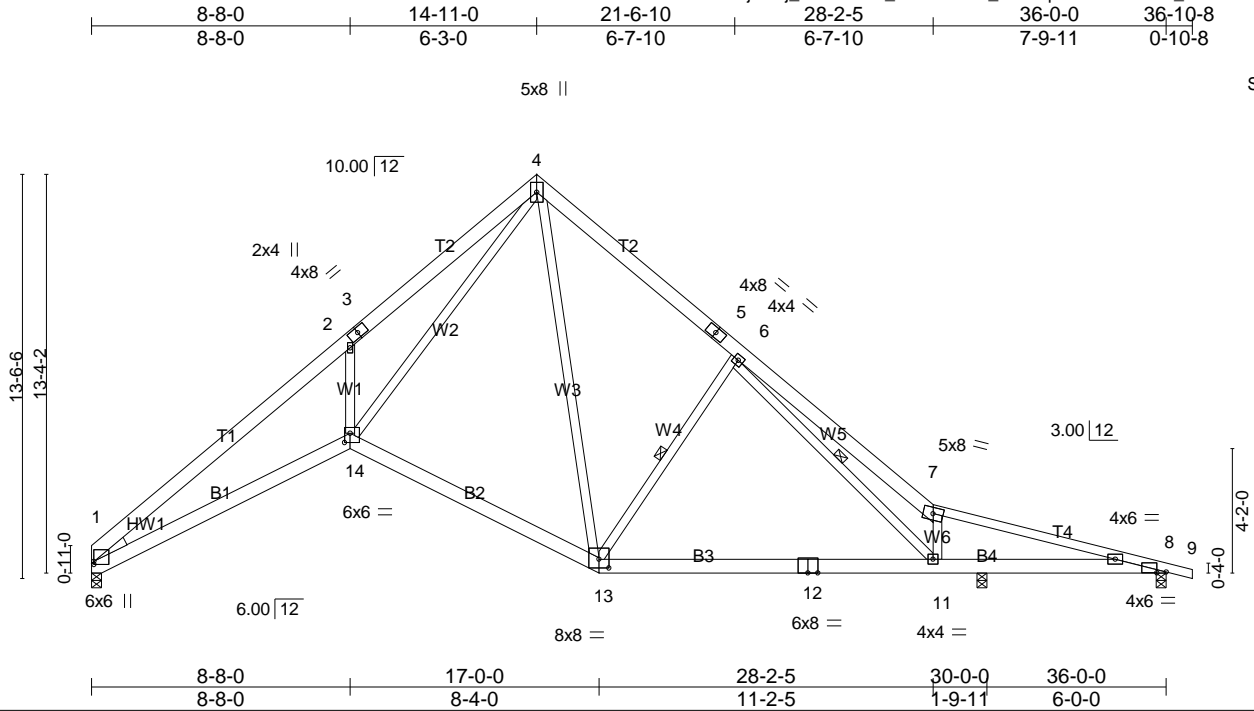

Scale = 1:77.2

Plate Offsets (X,Y)-- [1:0-0-7,0-0-8], [1:0-5-4,0-9-14], [1:0-1-4,0-0-0], [8:0-3-12,0-0-5], [13:0-4-0,0-3-8], [14:0-2-4,0-3-12]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.61	Vert(LL)	-0.37	11-13	>957	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.79	Vert(CT)	-0.66	11-13	>540		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.96	Horz(CT)	0.24	8	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Wind(LL)	0.13	11-13	>999		
	Code IRC2015/TPI2014						Weight: 259 lb	FT = 20%

**LUMBER-**

TOP CHORD 2x6 SP No.1 \*Except\*  
T4: 2x4 SP No.1  
BOT CHORD 2x6 SP No.1 \*Except\*  
B4: 2x6 SP 2400F 2.0E  
WEBS 2x4 SP No.2  
WEDGE  
Left: 2x4 SP No.2

**BRACING-**

TOP CHORD Structural wood sheathing directly applied or 3-7-9 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
WEBS 1 Row at midpt 6-13, 6-11

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.**

(size) 1=0-4-0 (min. 0-1-8), 8=0-4-0 (min. 0-1-8), 10=0-4-0 (min. 0-1-8)  
Max Horz 1=-325(LC 10)  
Max Uplift 1=-63(LC 12), 8=-121(LC 9), 10=-104(LC 13)  
Max Grav 1=1185(LC 1), 8=313(LC 24), 10=1429(LC 1)

**FORCES.**

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-2=-3222/466, 2-4=-3235/827, 4-6=-1267/453, 6-7=-1434/219, 7-8=-1040/0  
BOT CHORD 1-14=-232/2852, 13-14=0/1005, 11-13=-79/1028, 10-11=0/980, 8-10=0/980  
WEBS 2-14=-572/483, 4-14=-494/2783, 4-13=-242/426, 6-13=-481/321, 7-11=-894/315

**NOTES-**


- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=18ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-2-0 to 6-5-10, Interior(1) 6-5-10 to 14-11-0, Exterior(2) 14-11-0 to 21-2-10, Interior(1) 21-2-10 to 36-10-8 zone; porch right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Bearing at joint(s) 1 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1 except (jt=lb) 8=121, 10=104.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard

Job J0321-1553	Truss A3	Truss Type Roof Special	Qty 4	Ply 1	LOT 7 WOODBURY FARM Job Reference (optional)
-------------------	-------------	----------------------------	----------	----------	---

Comtech, Inc., Fayetteville, NC 28309, Bob Lewis

Run: 8.300 s Mar 22 2019 Print: 8.300 s Mar 22 2019 MiTek Industries, Inc. Wed Mar 24 15:09:02 2021 Page 1  
ID:oc86cjOn3j\_xrZlawBNe\_4zXIAC-mua4iK\_zLR?hTayWkVA78TxCif3egVbp5fgFX4zXiAl

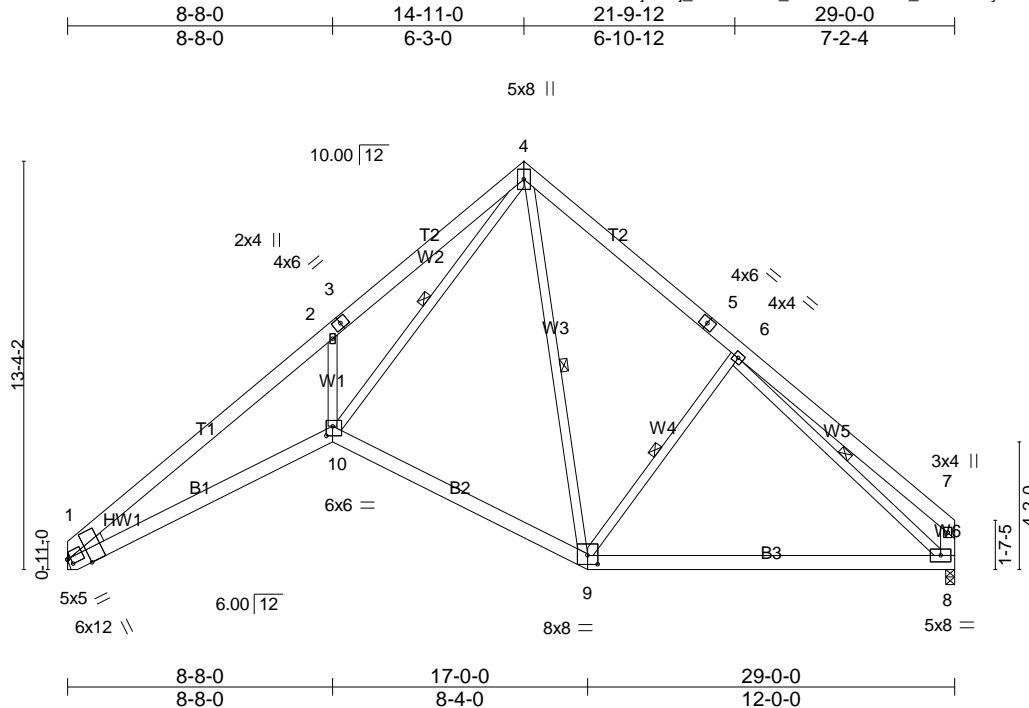

Scale = 1:75.3

Plate Offsets (X,Y)-- [1:0-1-5,0-2-7], [1:0-5-3,Edge], [9:0-4-0,0-3-8], [10:0-2-8,0-3-12]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.55	Vert(LL) -0.29	8-9	>999	360	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.65	Vert(CT) -0.47	8-9	>741	240		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.58	Horz(CT) 0.23	8	n/a	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Wind(LL) 0.12	10	>999	240		
	Code IRC2015/TPI2014						Weight: 231 lb	FT = 20%

**LUMBER-**

TOP CHORD 2x6 SP No.1  
BOT CHORD 2x6 SP No.1  
WEBS 2x4 SP No.2 \*Except\*  
W6: 2x6 SP No.1

WEDGE  
Left: 2x4 SP No.2

**REACTIONS.** (size) 1=Mechanical, 8=0-3-8 (min. 0-1-8)  
Max Horz 1=320(LC 9)  
Max Uplift 1=-63(LC 12), 8=-59(LC 13)  
Max Grav 1=1148(LC 1), 8=1211(LC 20)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-3080/561, 2-4=-3106/919, 4-6=-1186/471, 6-7=-652/217, 7-8=-542/223  
BOT CHORD 1-10=-353/2727, 9-10=-8/929, 8-9=-151/900  
WEBS 2-10=-588/480, 4-10=-619/2713, 4-9=-206/340, 6-9=-429/334, 6-8=-872/213

**NOTES-**

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=18ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-0-12 to 6-4-6, Interior(1) 6-4-6 to 14-11-0, Exterior(2) 14-11-0 to 21-2-10, Interior(1) 21-2-10 to 28-9-4 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 8.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard

**BRACING-**

TOP CHORD Structural wood sheathing directly applied or 3-8-5 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
WEBS 1 Row at midpt 4-10, 4-9, 6-9, 6-8

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.



Job J0321-1553	Truss A4	Truss Type Common	Qty 6	Ply 1	LOT 7 WOODBURY FARM Job Reference (optional)
-------------------	-------------	----------------------	----------	----------	---

Comtech, Inc., Fayetteville, NC 28309, Bob Lewis

Run: 8.300 s Mar 22 2019 Print: 8.300 s Mar 22 2019 MiTek Industries, Inc. Wed Mar 24 15:09:03 2021 Page 1  
ID:oc86cjOn3j\_xrZlawBNe\_4zXIAc-E48Tgw?b617Y5kXilDhMggTS93SHP\_myKJPo3WzXiAk



5x8 ||

Scale = 1:73.2

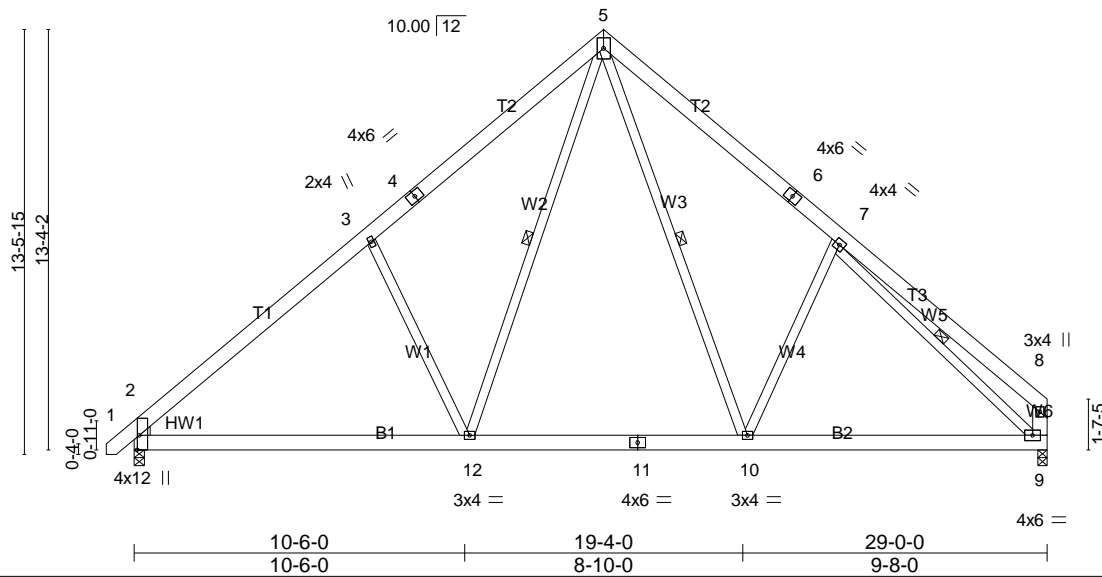


Plate Offsets (X,Y)-- [2:0-0-13,0-1-0], [2:0-1-11,0-4-13], [2:0-5-8,Edge]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.25	Vert(LL) -0.12	2-12	>999	360	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.49	Vert(CT) -0.21	2-12	>999	240		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.46	Horz(CT) 0.03	9	n/a	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Wind(LL) 0.04	2-12	>999	240		
	Code IRC2015/TPI2014						Weight: 235 lb	FT = 20%

**LUMBER-**

TOP CHORD 2x6 SP No.1  
BOT CHORD 2x6 SP No.1  
WEBS 2x4 SP No.2 \*Except\*  
W6: 2x6 SP No.1

WEDGE  
Left: 2x4 SP No.2

**REACTIONS.** (size) 2=0-4-0 (min. 0-1-11), 9=0-3-8 (min. 0-1-9)  
Max Horz 2=321(LC 9)  
Max Uplift 2=-76(LC 12), 9=-59(LC 13)  
Max Grav 2=1408(LC 19), 9=1342(LC 20)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1658/369, 3-5=-1523/521, 5-7=-1439/522, 7-8=-474/225, 8-9=-419/220  
BOT CHORD 2-12=-172/1361, 10-12=0/885, 9-10=-149/1082  
WEBS 3-12=-522/371, 5-12=-233/928, 5-10=-211/721, 7-10=-421/345, 7-9=-1193/178

**NOTES-**

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=18ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-8-10 to 5-7-0, Interior(1) 5-7-0 to 14-11-0, Exterior(2) 14-11-0 to 21-2-10, Interior(1) 21-2-10 to 28-9-4 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 9.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard

**BRACING-**

TOP CHORD Structural wood sheathing directly applied or 5-10-5 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
WEBS 1 Row at midpt 5-12, 5-10, 7-9

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

Job J0321-1553	Truss A4GE	Truss Type GABLE	Qty 1	Ply 1	LOT 7 WOODBURY FARM
Comtech, Inc., Fayetteville, NC 28309, Bob Lewis					Job Reference (optional)

Run: 8.300 s Mar 22 2019 Print: 8.300 s Mar 22 2019 MiTek Industries, Inc. Wed Mar 24 15:09:04 2021 Page 1  
ID:oc86cjOn3j\_xrZlawBNe\_4zXIAc-iHir700Dt3GPiu6uswCbDu0c5SI28Rf6Zz9MbzzXIAj



5x12 ||

Scale = 1:73.8

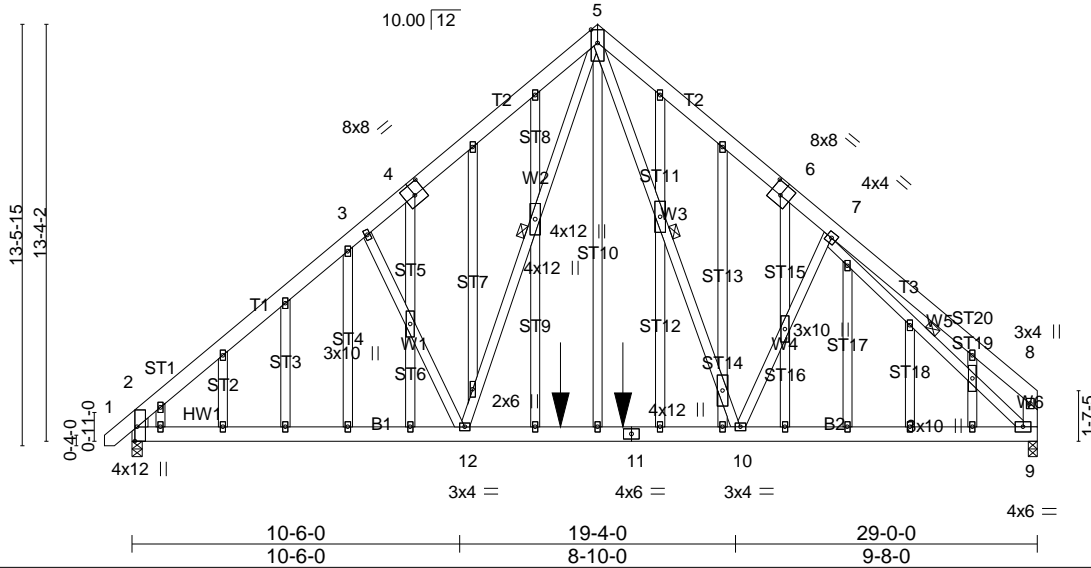


Plate Offsets (X,Y)-- [2:0-5-8,Edge], [2:0-1-11,0-4-13], [2:0-0-13,0-1-0], [4:0-4-0,0-4-8], [6:0-4-0,0-4-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.30	Vert(LL) -0.12	2-12	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.59	Vert(CT) -0.20	2-12	>999	240		
BCLL 0.0 *	Rep Stress Incr NO	WB 0.48	Horz(CT) 0.03	9	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S	Wind(LL) 0.09	10-12	>999	240		
							Weight: 367 lb	FT = 20%

**LUMBER-**

TOP CHORD 2x6 SP No.1  
 BOT CHORD 2x6 SP No.1  
 WEBS 2x4 SP No.2 \*Except\*  
 W6: 2x6 SP No.1  
 OTHERS 2x4 SP No.2  
 WEDGE  
 Left: 2x4 SP No.2

**BRACING-**

TOP CHORD Structural wood sheathing directly applied or 5-7-15 oc purlins, except end verticals.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
 WEBS 1 Row at midpt 5-12, 5-10, 7-9

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.**

(size) 2=0-4-0 (min. 0-1-12), 9=0-3-8 (min. 0-1-11)  
 Max Horz 2=399(LC 5)  
 Max Uplift 2=-293(LC 8), 9=-261(LC 9)  
 Max Grav 2=1486(LC 33), 9=1421(LC 34)

**FORCES.**

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 2-3=-1784/393, 3-5=-1647/544, 5-7=-1560/531, 7-8=-482/215, 8-9=-428/212  
 BOT CHORD 2-12=-410/1500, 10-12=-90/982, 9-10=-197/1174  
 WEBS 3-12=-443/475, 5-12=-379/1042, 5-10=-348/824, 7-10=-330/457, 7-9=-1340/266

**NOTES-**

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=18ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=293, 9=261.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 83 lb down and 54 lb up at 13-8-12, and 83 lb down and 54 lb up at 15-8-12 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

Continued on page 2  
 LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	LOT 7 WOODBURY FARM
J0321-1553	A4GE	GABLE	1	1	Job Reference (optional)

Comtech, Inc., Fayetteville, NC 28309, Bob Lewis

Run: 8.300 s Mar 22 2019 Print: 8.300 s Mar 22 2019 MiTek Industries, Inc. Wed Mar 24 15:09:04 2021 Page 2  
ID:oc86cjOn3j\_xrZlawBNe\_4zXIAc-iHir700Dt3GPiu6uswCbDu0c5Si28Rf6Zz9MbzzXiAj

**LOAD CASE(S)** Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-5=-60, 5-8=-60, 2-9=-20


Concentrated Loads (lb)

Vert: 11=-74(F) 47=-74(F)

Job J0321-1553	Truss A5	Truss Type Common	Qty 1	Ply 1	LOT 7 WOODBURY FARM Job Reference (optional)
-------------------	-------------	----------------------	----------	----------	---

Comtech, Inc., Fayetteville, NC 28309, Bob Lewis

Run: 8.300 s Mar 22 2019 Print: 8.300 s Mar 22 2019 MiTek Industries, Inc. Wed Mar 24 15:09:05 2021 Page 1  
ID:oc86cjOn3j\_xrZlawBNe\_4zXIAC-BTGDLMOGK1g5Pejqm5Ymhs8rtt\_Fnduv8PzXiAi



5x8 ||

Scale = 1:74.7

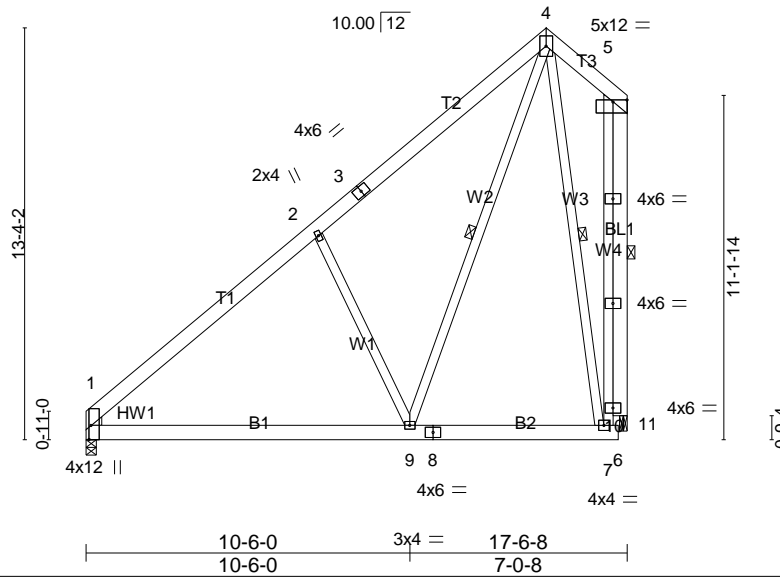


Plate Offsets (X,Y)-- [1:0-5-8,Edge], [1:0-1-11,0-4-13], [1:0-0-13,0-1-0], [5:Edge,0-0-12]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.38	Vert(LL) -0.13	1-9	>999	360	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.42	Vert(CT) -0.22	1-9	>948	240		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.54	Horz(CT) 0.01	11	n/a	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Wind(LL) 0.03	1-9	>999	240		
	Code IRC2015/TPI2014						Weight: 184 lb	FT = 20%

**LUMBER-**

TOP CHORD 2x6 SP No.1  
 BOT CHORD 2x6 SP No.1  
 WEBS 2x4 SP No.2  
 OTHERS 2x6 SP No.1  
 WEDGE  
 Left: 2x4 SP No.2

**BRACING-**

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
 WEBS 1 Row at midpt 4-9, 4-7, 5-11

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** (size) 1=0-4-0 (min. 0-1-8), 11=0-3-0 (min. 0-1-8)  
 Max Horz 1=398(LC 12)  
 Max Uplift 11=-190(LC 12)  
 Max Grav 1=794(LC 19), 11=917(LC 19)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-808/10, 2-4=-705/180, 7-10=-288/853, 5-10=-288/853  
 BOT CHORD 1-9=-317/671  
 WEBS 2-9=-580/402, 4-9=-263/947, 4-7=-754/316, 5-11=-918/306

**NOTES-**

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=18ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-2-0 to 6-5-10, Interior(1) 6-5-10 to 14-11-0, Exterior(2) 14-11-0 to 16-11-4 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Bearing at joint(s) 11 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 11=190.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard

Job J0321-1553	Truss B1	Truss Type Attic	Qty 8	Ply 1	LOT 7 WOODBURY FARM Job Reference (optional)
-------------------	-------------	---------------------	----------	----------	---

Comtech, Inc., Fayetteville, NC 28309, Bob Lewis

Run: 8.300 s Mar 22 2019 Print: 8.300 s Mar 22 2019 MiTek Industries, Inc. Wed Mar 24 15:09:06 2021 Page 1

ID:oc86cjOn3j\_xrZlawBNe\_4zXIAc-ffqbY1TOgW7yBFHzLE3U5trGQQcPwPOHeSgrzXiAh

0-10-8	5-0-0	7-7-15	8-10-11	11-4-0	13-9-5	15-0-1	17-8-0	22-8-0	23-6-8
0-10-8	5-0-0	2-7-15	1-2-12	2-5-5	2-5-5	1-2-12	2-7-15	5-0-0	0-10-8

6x8 =

Scale = 1:69.3

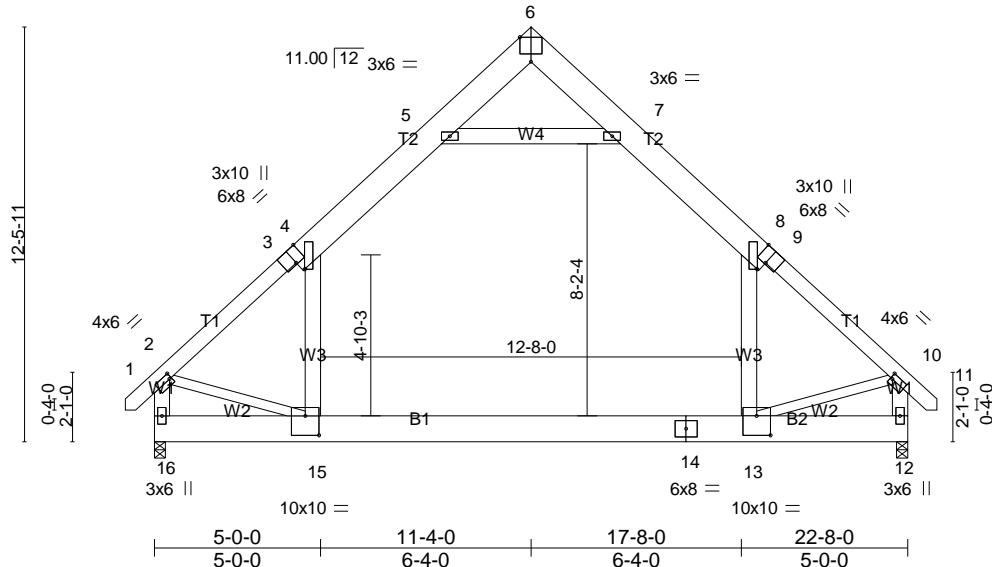


Plate Offsets (X,Y)--	[2:0-0-12,0-2-0], [3:0-3-10,Edge], [4:0-0-4,Edge], [6:0-4-0,Edge], [8:0-0-4,Edge], [9:0-3-10,Edge], [10:0-0-12,0-2-0], [13:0-5-0,0-7-0], [15:0-5-0,0-7-0]
-----------------------	---

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.61	Vert(LL)	-0.23	13-15	>999	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.66	Vert(CT)	-0.31	13-15	>861		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.24	Horz(CT)	0.01	12	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Wind(LL)	0.05	13-15	>999		
	Code IRC2015/TPI2014						Weight: 252 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x10 SP No.1 \*Except\*  
T1: 2x6 SP No.1  
BOT CHORD 2x10 SP No.1  
WEBS 2x6 SP No.1 \*Except\*  
W2: 2x4 SP No.2

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 4-11-2 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** (size) 16=0-4-0 (min. 0-1-11), 12=0-4-0 (min. 0-1-11)  
Max Horz 16=-328(LC 10)  
Max Grav 16=1429(LC 20), 12=1429(LC 21)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-4=-1617/95, 4-5=-1088/233, 5-6=-38/407, 6-7=-38/407, 7-8=-1088/233, 8-10=-1616/95, 2-16=-1587/135, 10-12=-1588/136  
BOT CHORD 15-16=-320/482, 13-15=0/1085  
WEBS 8-13=-38/711, 4-15=-38/711, 5-7=-1451/357, 2-15=0/957, 10-13=-3/962


- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=18ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-8-10 to 5-7-0, Interior(1) 5-7-0 to 11-4-0, Exterior(2) 11-4-0 to 17-11-2, Interior(1) 17-11-2 to 23-4-10 zone; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 4) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - 5) Ceiling dead load (10.0 psf) on member(s). 4-5, 7-8, 5-7; Wall dead load (5.0psf) on member(s).8-13, 4-15
  - 6) Bottom chord live load (40.0 psf) and additional bottom chord dead load (0.0 psf) applied only to room. 13-15
  - 7) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - 8) Attic room checked for L/360 deflection.

**LOAD CASE(S)** Standard

Job	Truss	Truss Type	Qty	Ply	LOT 7 WOODBURY FARM
J0321-1553	B1GE	GABLE	1	1	Job Reference (optional)

Comtech, Inc., Fayetteville, NC 28309, Bob Lewis

Run: 8.300 s Mar 22 2019 Print: 8.300 s Mar 22 2019 MiTek Industries, Inc. Wed Mar 24 15:09:06 2021 Page 1  
ID:oc86cjOn3j\_xrZlawBNe\_4zXlAc-ffqbY11TOgW7yBFHzLE3lU5trGQQcPwPOHeSgrzXiAh

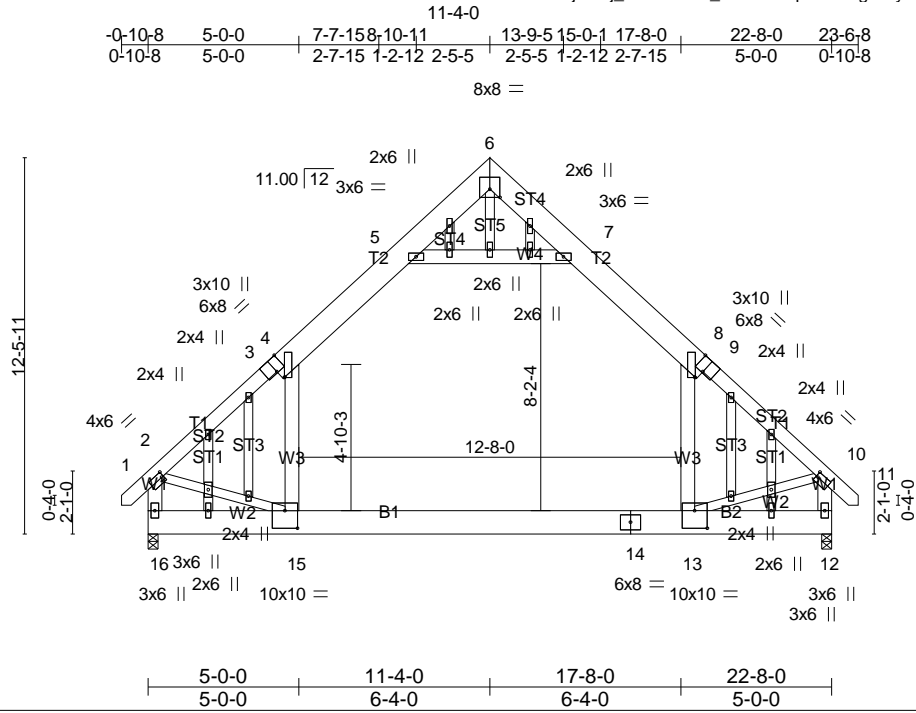

Scale = 1:76.4

Plate Offsets (X,Y)-- [2:0-0-12,0-2-0], [3:0-3-10,Edge], [4:0-0-4,Edge], [6:0-4-0,0-3-4], [8:0-0-4,Edge], [9:0-3-10,Edge], [10:0-0-12,0-2-0], [13:0-5-0,0-7-0], [15:0-5-0,0-7-0]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.61	Vert(LL)	-0.23	13-15	>999	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.66	Vert(CT)	-0.31	13-15	>861		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.24	Horz(CT)	0.01	12	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Wind(LL)	0.07	13-15	>999		
	Code IRC2015/TPI2014						Weight: 276 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x10 SP No.1 \*Except\*  
T1: 2x6 SP No.1  
BOT CHORD 2x10 SP No.1  
WEBS 2x6 SP No.1 \*Except\*  
W2: 2x4 SP No.2  
OTHERS 2x4 SP No.2

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 4-11-2 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** (size) 16=0-4-0 (min. 0-1-11), 12=0-4-0 (min. 0-1-11)  
Max Horz 16=-410(LC 10)  
Max Uplift 16=-49(LC 12), 12=-49(LC 13)  
Max Grav 16=1422(LC 20), 12=1422(LC 21)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-4=-1632/123, 4-5=-1092/257, 5-6=-60/407, 6-7=-60/407, 7-8=-1092/257,  
8-10=-1631/123, 2-16=-1596/152, 10-12=-1597/152  
BOT CHORD 15-16=-414/549, 13-15=0/1113  
WEBS 8-13=-38/711, 4-15=-38/711, 5-7=-1441/415, 2-15=-52/996, 10-13=-59/1002


- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=18ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) -0-8-10 to 5-7-0, Exterior(2) 5-7-0 to 11-4-0, Corner(3) 11-4-0 to 17-11-2, Exterior(2) 17-11-2 to 23-4-10 zone; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
  - Gable studs spaced at 1-4-0 oc.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - Ceiling dead load (10.0 psf) on member(s). 4-5, 7-8, 5-7; Wall dead load (5.0psf) on member(s).8-13, 4-15
  - Bottom chord live load (40.0 psf) and additional bottom chord dead load (0.0 psf) applied only to room. 13-15
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 16, 12.
  - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - Attic room checked for L/360 deflection.

**LOAD CASE(S)** Standard

Job J0321-1553	Truss B2	Truss Type ATTIC	Qty 3	Ply 1	LOT 7 WOODBURY FARM
Comtech, Inc., Fayetteville, NC 28309, Bob Lewis					Job Reference (optional)

Run: 8.300 s Mar 22 2019 Print: 8.300 s Mar 22 2019 MiTek Industries, Inc. Wed Mar 24 15:09:07 2021 Page 1

ID:oc86cjOn3j\_xrZlawBNe\_4zXIAC-7sNzl2269\_e\_aLqTX2llrWe2YgmdLs7YFxn0CHzXiAg



6x8 =

Scale = 1:69.3

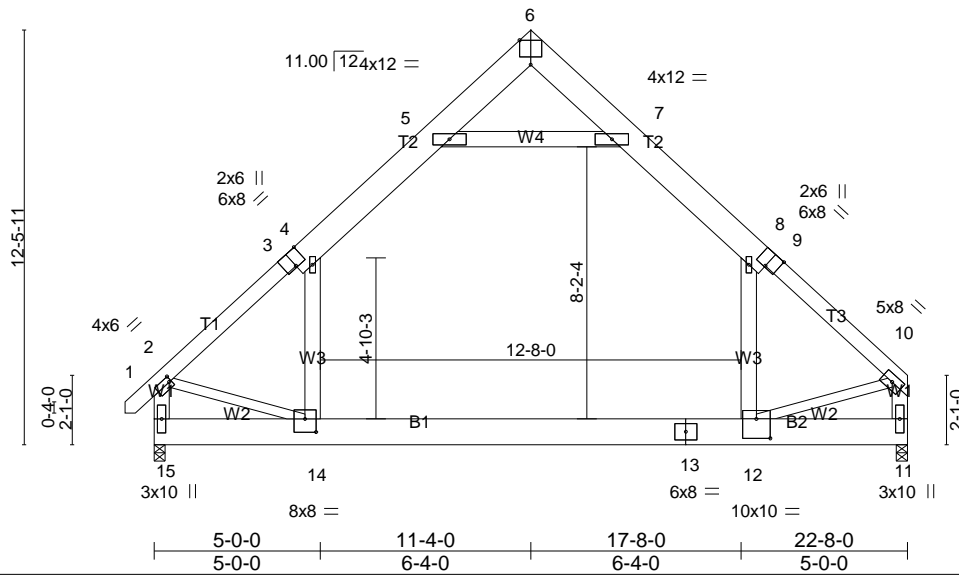


Plate Offsets (X,Y)-- [2:0-0-12,0-2-0], [3:0-4-0,Edge], [6:0-4-0,Edge], [9:0-4-0,Edge], [12:0-5-0,0-7-0], [14:0-4-0,0-4-12]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.61	Vert(LL)	-0.23	12-14	>999	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.66	Vert(CT)	-0.31	12-14	>852		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.25	Horz(CT)	0.01	11	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Wind(LL)	0.16	12-14	>999		
	Code IRC2015/TPI2014						Weight: 250 lb	FT = 20%

**LUMBER-**

TOP CHORD 2x10 SP No.1 \*Except\*  
T1,T3: 2x6 SP No.1  
BOT CHORD 2x10 SP No.1  
WEBS 2x6 SP No.1 \*Except\*  
W2: 2x4 SP No.2

**BRACING-**

TOP CHORD Structural wood sheathing directly applied or 4-10-14 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.**

(size) 15=0-4-0 (min. 0-1-11), 11=0-4-0 (min. 0-1-10)  
Max Horz 15=263(LC 9)  
Max Grav 15=1406(LC 2), 11=1357(LC 2)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-4=-1580/714, 4-5=-1068/523, 5-6=-303/416, 6-7=-297/412, 7-8=-1071/529,  
8-10=-1562/688, 2-15=-1554/733, 10-11=-1508/676  
BOT CHORD 14-15=-313/431, 12-14=-337/1042  
WEBS 8-12=-372/680, 4-14=-419/716, 5-7=-1436/1116, 2-14=-137/944, 10-12=-215/994

**NOTES-**


- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=18ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-8-10 to 5-7-0, Interior(1) 5-7-0 to 11-4-0, Exterior(2) 11-4-0 to 17-11-2, Interior(1) 17-11-2 to 22-5-4 zone; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Ceiling dead load (10.0 psf) on member(s), 4-5, 7-8, 5-7; Wall dead load (5.0psf) on member(s).8-12, 4-14
- Bottom chord live load (40.0 psf) and additional bottom chord dead load (0.0 psf) applied only to room. 12-14
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Attic room checked for L/360 deflection.

**LOAD CASE(S)** Standard

Job J0321-1553	Truss C1	Truss Type Common	Qty 3	Ply 1	LOT 7 WOODBURY FARM Job Reference (optional)
-------------------	-------------	----------------------	----------	----------	---

Comtech, Inc., Fayetteville, NC 28309, Bob Lewis

Run: 8.300 s Mar 22 2019 Print: 8.300 s Mar 22 2019 MiTek Industries, Inc. Wed Mar 24 15:09:08 2021 Page 1  
ID:oc86cjOn3j\_xrZlawBNe\_4zXlAc-b2xMzN3kwHmqBVPf5mGXNkAFd47j4GFhTb7ZkkzXiAf



Scale = 1:68.6

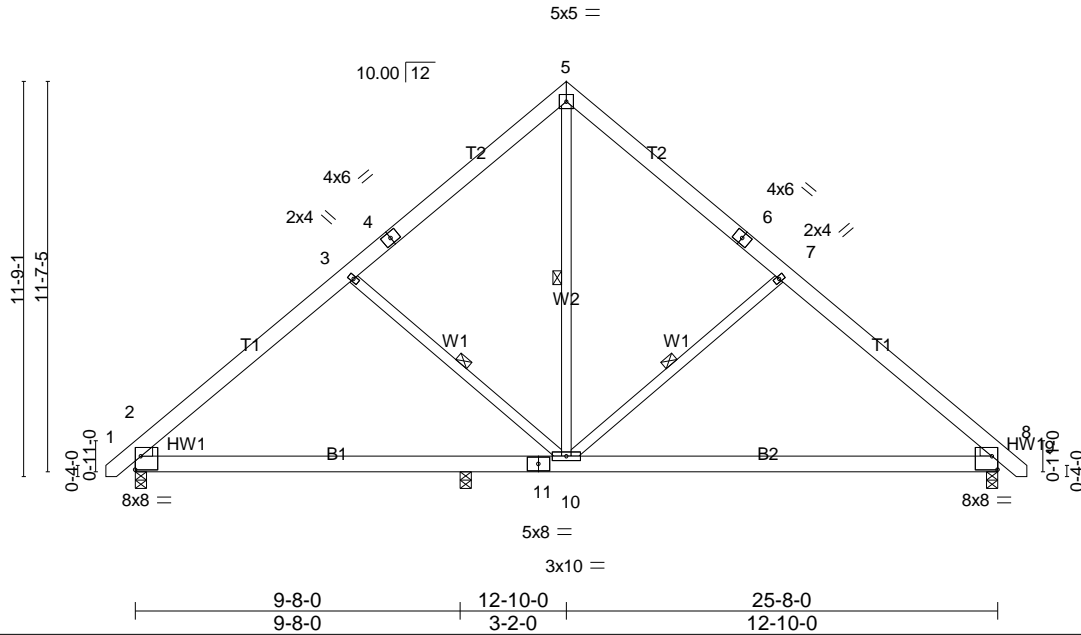


Plate Offsets (X,Y)-- [2:0-1-0,0-0-13], [2:0-4-13,0-1-11], [2:Edge,0-4-13], [8:0-1-0,0-0-13], [8:0-4-13,0-1-11], [8:Edge,0-4-13]

LOADING (psf)	SPACING	CSI	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.46	Vert(LL) -0.24	8-10	>769	360	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.61	Vert(CT) -0.42	8-10	>446	240		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.45	Horz(CT) 0.02	8	n/a	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Wind(LL) 0.33	8-10	>565	240		
	Code IRC2015/TPI2014						Weight: 185 lb	FT = 20%

**LUMBER-**

TOP CHORD 2x6 SP No.1  
BOT CHORD 2x6 SP No.1  
WEBS 2x4 SP No.2  
WEDGE  
Left: 2x4 SP No.2, Right: 2x4 SP No.2

**BRACING-**

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 9-2-1 oc bracing.  
WEBS 1 Row at midpt 5-10, 7-10, 3-10

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** (size) 2=0-4-0 (min. 0-1-8), 8=0-4-0 (min. 0-1-8), 12=0-4-0 (min. 0-1-8)

Max Horz 2=-281(LC 10)  
Max Uplift 2=-113(LC 9), 8=-137(LC 8), 12=-68(LC 9)  
Max Grav 2=972(LC 1), 8=1016(LC 2), 12=256(LC 18)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1106/796, 3-5=-842/805, 5-7=-844/813, 7-8=-1110/808  
BOT CHORD 2-12=-463/817, 10-12=-463/817, 8-10=-482/770  
WEBS 5-10=-830/667, 7-10=-452/350, 3-10=-438/325

**NOTES-**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=18ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-8-10 to 5-7-0, Interior(1) 5-7-0 to 12-10-0, Exterior(2) 12-10-0 to 19-4-2, Interior(1) 19-4-2 to 26-4-10 zone; porch left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 12 except (jt=lb) 2=113, 8=137.
- 6) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard



Job J0321-1553	Truss C1GE	Truss Type GABLE	Qty 1	Ply 1	LOT 7 WOODBURY FARM Job Reference (optional)
-------------------	---------------	---------------------	----------	----------	---

Comtech, Inc., Fayetteville, NC 28309, Bob Lewis

Run: 8.300 s Mar 22 2019 Print: 8.300 s Mar 22 2019 MiTek Industries, Inc. Wed Mar 24 15:09:09 2021 Page 1  
ID:oc86cjOn3j\_xrZlawBNe\_4zXIAc-3EVkAj4Mhbuhpf\_seTomwxjQFTTzpn4riFs6HAzXiAe

0-10-8 6-6-0 12-10-0 19-2-0 25-8-0 26-6-8  
0-10-8 6-6-0 6-4-0 6-4-0 6-6-0 0-10-8

Scale = 1:69.0

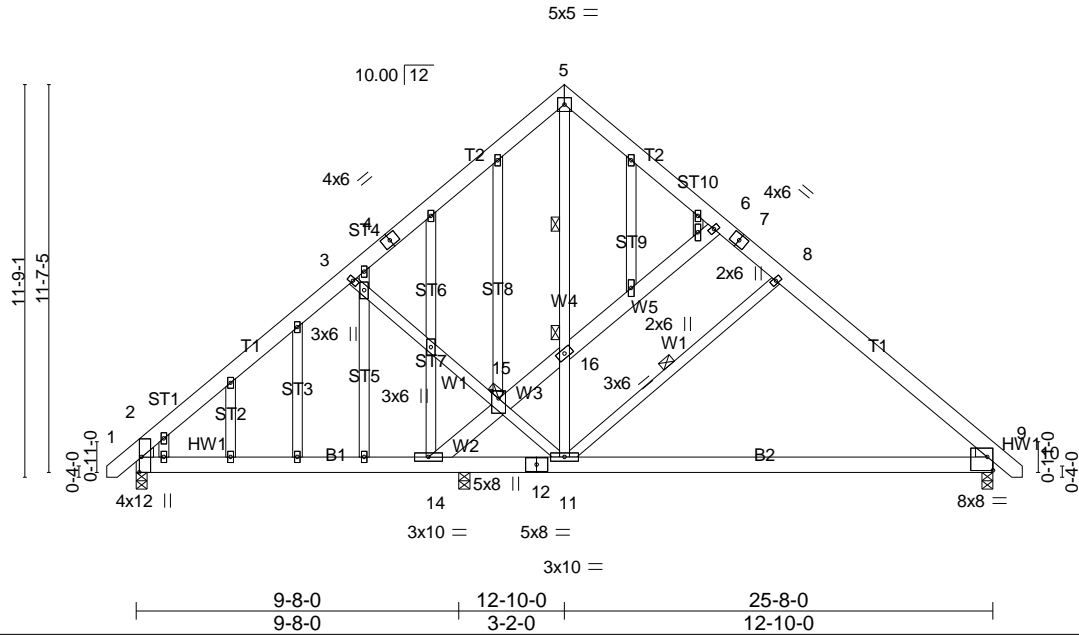


Plate Offsets (X,Y)-- [2:0-13,0-1-0], [2:0-1-11,0-4-13], [2:0-5-8,Edge], [9:0-1-0,0-0-13], [9:0-4-13,0-1-11], [9:Edge,0-4-13], [15:0-2-12,0-2-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.47	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.60	Vert(LL) -0.24 9-11 >772 360		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.15	Vert(CT) -0.42 9-11 >446 240		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.02 9 n/a n/a		
	Code IRC2015/TPI2014		Wind(LL) 0.33 9-11 >576 240		
				Weight: 258 lb	FT = 20%

**LUMBER-**

TOP CHORD 2x6 SP No.1  
 BOT CHORD 2x6 SP No.1  
 WEBS 2x6 SP No.1 \*Except\*  
 W4,W1: 2x4 SP No.2  
 OTHERS 2x4 SP No.2  
 WEDGE  
 Left: 2x4 SP No.2, Right: 2x4 SP No.2

**BRACING-**

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 9-2-3 oc bracing.  
 WEBS 1 Row at midpt 5-16, 8-11  
 JOINTS 1 Brace at Jt(s): 15, 16

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.**

(size) 2=0-4-0 (min. 0-1-8), 9=0-4-0 (min. 0-1-8), 13=0-4-0 (min. 0-1-8)  
 Max Horz 2=-352(LC 10)  
 Max Uplift 2=-195(LC 12), 9=-192(LC 13), 13=-76(LC 13)  
 Max Grav 2=936(LC 2), 9=1003(LC 2), 13=359(LC 20)

**FORCES.**

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 2-3=-1019/793, 3-5=-794/801, 5-6=-748/854, 6-8=-818/836, 8-9=-1049/852  
 BOT CHORD 2-14=-457/834, 13-14=-550/843, 11-13=-550/843, 9-11=-495/733  
 WEBS 11-16=-886/605, 5-16=-881/604, 8-11=-318/254, 3-15=-456/394, 11-15=-455/392

**NOTES-**


- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=18ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2) -0-8-10 to 5-7-0, Interior(1) 5-7-0 to 12-10-0, Exterior(2) 12-10-0 to 19-4-2, Interior(1) 19-4-2 to 26-4-10 zone; porch right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 13 except (jt=lb) 2=195, 9=192.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard

Job J0321-1553	Truss C2GR	Truss Type Monopitch Girder	Qty 1	Ply 2	LOT 7 WOODBURY FARM Job Reference (optional)
-------------------	---------------	--------------------------------	----------	----------	---

Comtech, Inc., Fayetteville, NC 28309, Bob Lewis

Run: 8.300 s Mar 22 2019 Print: 8.300 s Mar 22 2019 MiTek Industries, Inc. Wed Mar 24 15:09:09 2021 Page 1  
ID:oc86cjOn3j\_xrZlawBNe\_4zXIAc-3EVkAj4Mhbuhpf\_seTomwxjW\_TWZpjnriFs6HAzXiAe

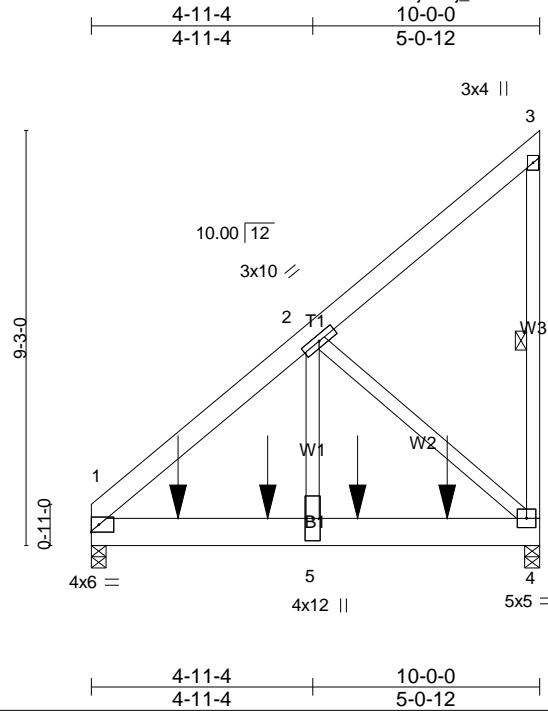

Scale = 1:51.4

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.10	Vert(LL)	-0.02	4-5	>999	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.44	Vert(CT)	-0.04	4-5	>999		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.43	Horz(CT)	0.01	4	n/a		
BCDL 10.0	Rep Stress Incr NO	Matrix-S	Wind(LL)	0.02	4-5	>999		
	Code IRC2015/TPI2014						Weight: 178 lb	FT = 20%

**LUMBER-**

TOP CHORD 2x6 SP No.1  
BOT CHORD 2x8 SP No.1  
WEBS 2x4 SP No.2

**BRACING-**

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
WEBS 1 Row at midpt 3-4

**REACTIONS.**

(size) 1=0-4-0 (min. 0-1-9), 4=0-4-0 (min. 0-1-9)  
Max Horz 1=289(LC 8)  
Max Uplift 1=-73(LC 8), 4=-323(LC 8)  
Max Grav 1=2685(LC 1), 4=2617(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-2772/78  
BOT CHORD 1-5=-241/2001, 4-5=-241/2001  
WEBS 2-5=-147/3280, 2-4=-2683/323

**NOTES-**

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc, 2x4 - 1 row at 0-9-0 oc.  
Bottom chords connected as follows: 2x8 - 2 rows staggered at 0-9-0 oc.  
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=18ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3'-6" tall by 2'-0" wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1 except (jt=lb) 4=323.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 1132 lb down and 83 lb up at 1-11-4, 1132 lb down and 83 lb up at 3-11-4, and 1132 lb down and 83 lb up at 5-11-4, and 1132 lb down and 83 lb up at 7-11-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

**LOAD CASE(S)** Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15

Job	Truss	Truss Type	Qty	Ply	LOT 7 WOODBURY FARM
J0321-1553	C2GR	Monopitch Girder	1	2	Job Reference (optional)

Comtech, Inc., Fayetteville, NC 28309, Bob Lewis

Run: 8.300 s Mar 22 2019 Print: 8.300 s Mar 22 2019 MiTek Industries, Inc. Wed Mar 24 15:09:09 2021 Page 2  
ID:oc86cjOn3j\_xrZlawBNe\_4zXIAc-3EVkAj4Mhbuhpf\_seTomwxjW\_TWZpinriFs6HAzXiAe

**LOAD CASE(S)** Standard

Uniform Loads (plf)

Vert: 1-3=-60, 1-4=-20

Concentrated Loads (lb)

Vert: 6=-1132(F) 7=-1132(F) 8=-1132(F) 9=-1132(F)

Job J0321-1553	Truss D1	Truss Type Common	Qty 1	Ply 1	LOT 7 WOODBURY FARM Job Reference (optional)
-------------------	-------------	----------------------	----------	----------	---

Comtech, Inc., Fayetteville, NC 28309, Bob Lewis

Run: 8.300 s Mar 22 2019 Print: 8.300 s Mar 22 2019 MiTek Industries, Inc. Wed Mar 24 15:09:10 2021 Page 1  
ID:oc86cjOn3j\_xrZlawBNe\_4zXIAC-XR36O34\_Sv0YRpZ2CBJ?T9GeqtusYEf\_xucgpczXiAd

0-10-8 8-0-0 16-0-0 16-10-8  
0-10-8 8-0-0 8-0-0 0-10-8

5x5 =

Scale = 1:42.2

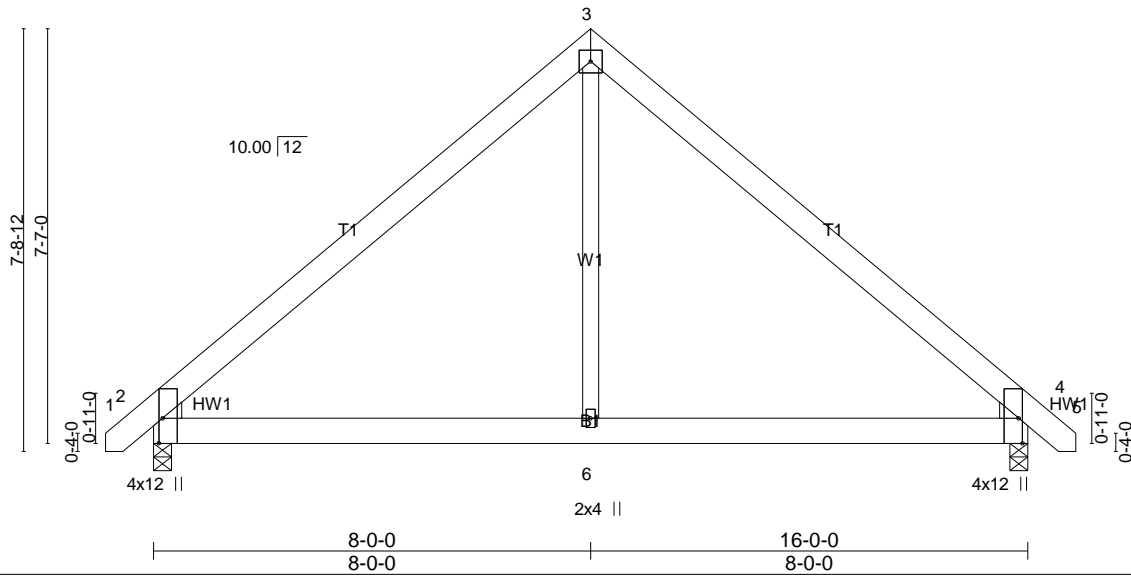


Plate Offsets (X,Y)-- [2:0-0-13,0-1-0], [2:0-1-11,0-4-13], [2:0-5-8,Edge], [4:0-0-13,0-1-0], [4:0-1-11,0-4-13], [4:0-5-8,Edge]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.29	Vert(LL) -0.03	4-6	>999	360	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.31	Vert(CT) -0.06	4-6	>999	240		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.13	Horz(CT) 0.01	4	n/a	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Wind(LL) 0.03	2-6	>999	240		
	Code IRC2015/TPI2014						Weight: 103 lb	FT = 20%

**LUMBER-**

TOP CHORD 2x6 SP No.1  
BOT CHORD 2x6 SP No.1  
WEBS 2x4 SP No.2  
WEDGE  
Left: 2x4 SP No.2 , Right: 2x4 SP No.2

**BRACING-**

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** (size) 2=0-4-0 (min. 0-1-8), 4=0-4-0 (min. 0-1-8)

Max Horz 2=-181(LC 10)  
Max Uplift 2=-47(LC 12), 4=-47(LC 13)  
Max Grav 2=785(LC 19), 4=785(LC 20)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-874/202, 3-4=-874/202  
BOT CHORD 2-6=0/590, 4-6=0/590  
WEBS 3-6=0/584

**NOTES-**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=18ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) -0-8-10 to 5-7-0, Interior(1) 5-7-0 to 8-0-0, Exterior(2) 8-0-0 to 14-3-10, Interior(1) 14-3-10 to 16-8-10 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 4.
- 6) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard

Job J0321-1553	Truss D1GE	Truss Type Common Supported Gable	Qty 1	Ply 1	LOT 7 WOODBURY FARM Job Reference (optional)
-------------------	---------------	--------------------------------------	----------	----------	---

Comtech, Inc., Fayetteville, NC 28309, Bob Lewis

Run: 8.300 s Mar 22 2019 Print: 8.300 s Mar 22 2019 MiTek Industries, Inc. Wed Mar 24 15:09:11 2021 Page 1  
ID:oc86cjOn3j\_xrZlawBNe\_4zXlAc-?ddUbP5cDC8P2y8EmuqE?MotbHHWHIM8AYLDL3zXiAc

0-10-8 8-0-0 16-0-0 16-10-8  
0-10-8 8-0-0 8-0-0 0-10-8

5x5 =

Scale = 1:41.6

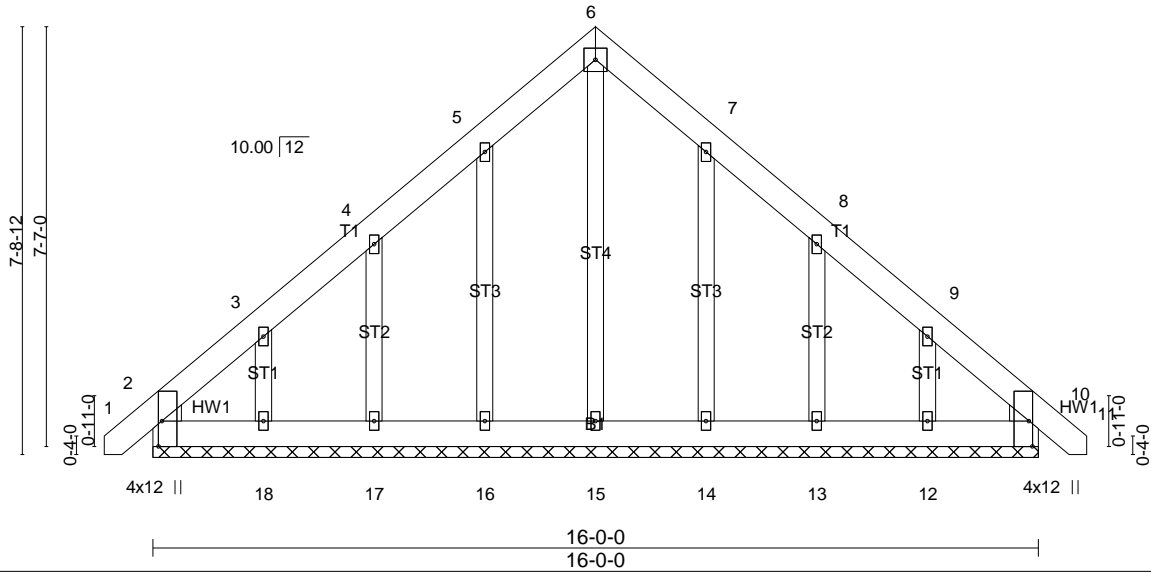


Plate Offsets (X,Y)-- [2:0-0-13,0-1-0], [2:0-1-11,0-4-13], [2:0-5-8,Edge], [10:0-0-13,0-1-0], [10:0-1-11,0-4-13], [10:0-5-8,Edge]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.03	Vert(LL) 0.00	10	n/r	120	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.02	Vert(CT) 0.00	10	n/r	120		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.10	Horz(CT) 0.00	10	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S						
							Weight: 133 lb	FT = 20%

**LUMBER-**

TOP CHORD 2x6 SP No.1  
BOT CHORD 2x6 SP No.1  
OTHERS 2x4 SP No.2  
WEDGE  
Left: 2x4 SP No.2 , Right: 2x4 SP No.2

**BRACING-**

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.**

All bearings 16-0-0.  
(lb) - Max Horz 2=-226(LC 10)  
Max Uplift All uplift 100 lb or less at joint(s) 2, 10, 14 except 16=-101(LC 12),  
17=-123(LC 12), 18=-166(LC 12), 13=-124(LC 13), 12=-161(LC 13)  
Max Grav All reactions 250 lb or less at joint(s) 2, 10, 15, 16, 17, 18, 14, 13, 12

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**


- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=18ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) -0-8-10 to 5-7-0, Exterior(2) 5-7-0 to 8-0-0, Corner(3) 8-0-0 to 14-0-0, Exterior(2) 14-0-0 to 16-8-10 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 10, 14 except (jt=lb) 16=101, 17=123, 18=166, 13=124, 12=161.
- Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 2, 10.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard

Job J0321-1553	Truss E1GE	Truss Type Common Girder	Qty 1	Ply 1	LOT 7 WOODBURY FARM Job Reference (optional)
-------------------	---------------	-----------------------------	----------	----------	---

Comtech, Inc., Fayetteville, NC 28309, Bob Lewis

Run: 8.300 s Mar 22 2019 Print: 8.300 s Mar 22 2019 MiTek Industries, Inc. Wed Mar 24 15:09:11 2021 Page 1  
ID:oc86cjOn3j\_xrZlawBNe\_4zXlAc-?ddUbP5cDC8P2y8EmuqE?MoswHHKHIZ8AYL3zXiAc

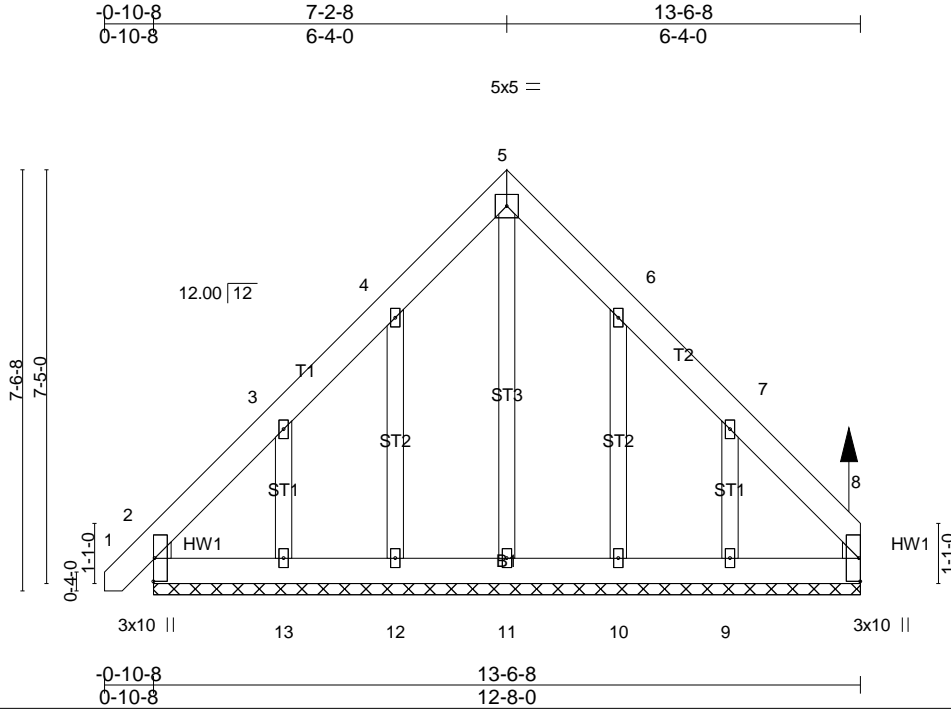

Scale = 1:41.3

Plate Offsets (X,Y)-- [2:0-0-2,0-0-2], [2:0-0-5,0-2-10], [8:0-0-2,0-0-2], [8:0-0-5,0-2-10]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.07	Vert(LL) -0.00	1	n/r	120	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.04	Vert(CT) 0.00	1	n/r	120		
BCLL 0.0 *	Rep Stress Incr NO	WB 0.09	Horz(CT) 0.00	8	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S						
							Weight: 107 lb	FT = 20%

**LUMBER-**

TOP CHORD 2x6 SP No.1  
BOT CHORD 2x6 SP No.1  
OTHERS 2x4 SP No.2  
WEDGE  
Left: 2x4 SP No.2 , Right: 2x4 SP No.2

**BRACING-**

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.**

All bearings 12-8-0.  
(lb) - Max Horz 2=218(LC 7)  
Max Uplift All uplift 100 lb or less at joint(s) 2 except 12=-122(LC 34), 13=-235(LC 34), 10=-126(LC 35), 9=-264(LC 9), 8=-112(LC 7)  
Max Grav All reactions 250 lb or less at joint(s) 2, 11, 12, 13, 10, 8 except 9=256(LC 41)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 7-8=-276/168  
WEBS 7-9=-195/271

**NOTES-**

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=18ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2 except (jt=lb) 12=122, 13=235, 10=126, 9=264, 8=112.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 100 lb down and 269 lb up at 12-0-12 on top chord. The design/selection of such connection device(s) is the responsibility of others.

Continued on page 2  
LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	LOT 7 WOODBURY FARM
J0321-1553	E1GE	Common Girder	1	1	Job Reference (optional)

Comtech, Inc., Fayetteville, NC 28309, Bob Lewis

Run: 8.300 s Mar 22 2019 Print: 8.300 s Mar 22 2019 MiTek Industries, Inc. Wed Mar 24 15:09:12 2021 Page 2  
ID:oc86cjOn3j\_xrZlawBNe\_4zXIAc-TpBspl6E\_WGGg6jRKcLTyaL1fhdZ09pHOC5nuVzXiAb

**LOAD CASE(S)** Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-5=-60, 5-8=-60, 2-8=-20

Concentrated Loads (lb)

Vert: 14=132

Job J0321-1553	Truss E2	Truss Type Common	Qty 1	Ply 1	LOT 7 WOODBURY FARM Job Reference (optional)
-------------------	-------------	----------------------	----------	----------	---

Comtech, Inc., Fayetteville, NC 28309, Bob Lewis

Run: 8.300 s Mar 22 2019 Print: 8.300 s Mar 22 2019 MiTek Industries, Inc. Wed Mar 24 15:09:12 2021 Page 1  
ID:oc86cjOn3j\_xrZlawBNe\_4zXIAc-TpBspI6E\_WGGg6jRKcLTYaL?VhbH09cHOC5nuVzXiAb

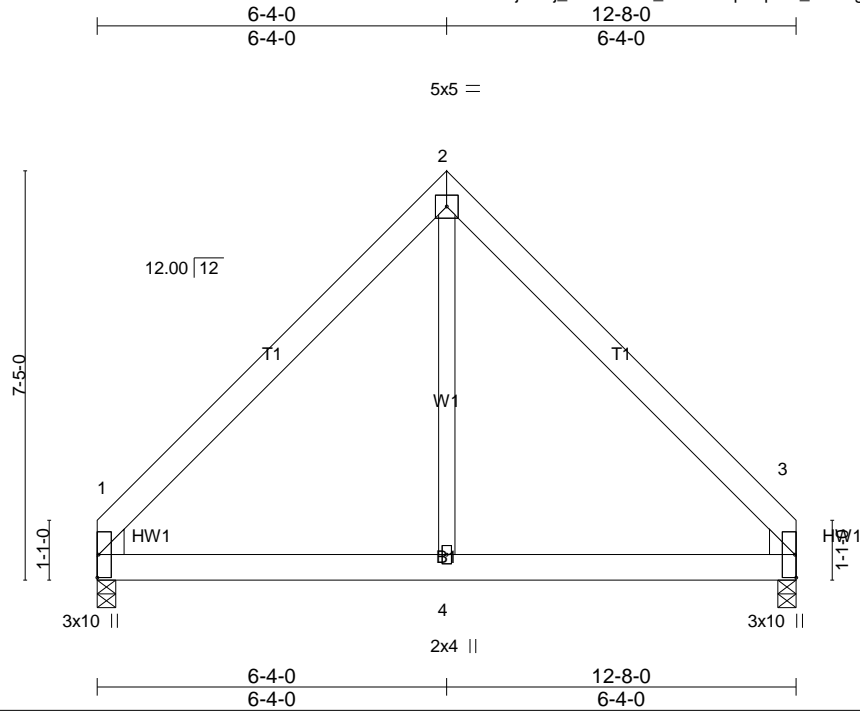


Plate Offsets (X,Y)-- [1:0-0-2,0-0-2], [1:0-0-5,0-3-15], [3:0-0-2,0-0-2], [3:0-0-5,0-3-15]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	Plate Grip DOL 1.15	TC 0.21	Vert(LL) -0.01	3-4	>999	360	MT20	244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.18	Vert(CT) -0.03	3-4	>999	240		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.10	Horz(CT) 0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S	Wind(LL) 0.01	1-4	>999	240		
							Weight: 85 lb	FT = 20%

**LUMBER-**

TOP CHORD 2x6 SP No.1  
 BOT CHORD 2x6 SP No.1  
 WEBS 2x4 SP No.2  
 WEDGE  
 Left: 2x6 SP No.1 , Right: 2x6 SP No.1

**BRACING-**

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** (size) 1=0-4-0 (min. 0-1-8), 3=0-4-0 (min. 0-1-8)

Max Horz 1=-171(LC 10)  
 Max Uplift1=-27(LC 13), 3=-27(LC 12)  
 Max Grav 1=578(LC 20), 3=578(LC 19)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-629/166, 2-3=-629/166  
 BOT CHORD 1-4=-10/394, 3-4=-10/394  
 WEBS 2-4=0/455

**NOTES-**

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=18ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.


**LOAD CASE(S)** Standard



Job J0321-1553	Truss E2GR	Truss Type Common Girder	Qty 1	Ply 2	LOT 7 WOODBURY FARM Job Reference (optional)
-------------------	---------------	-----------------------------	----------	----------	---

Comtech, Inc., Fayetteville, NC 28309, Bob Lewis

Run: 8.300 s Mar 22 2019 Print: 8.300 s Mar 22 2019 MiTek Industries, Inc. Wed Mar 24 15:09:13 2021 Page 1  
ID:oc86cjOn3j\_xrZlawBNe\_4zXIAc-y?IF057slqO7IGldtJsi4nu7S5q2IWmQdsqkQxzXiAa

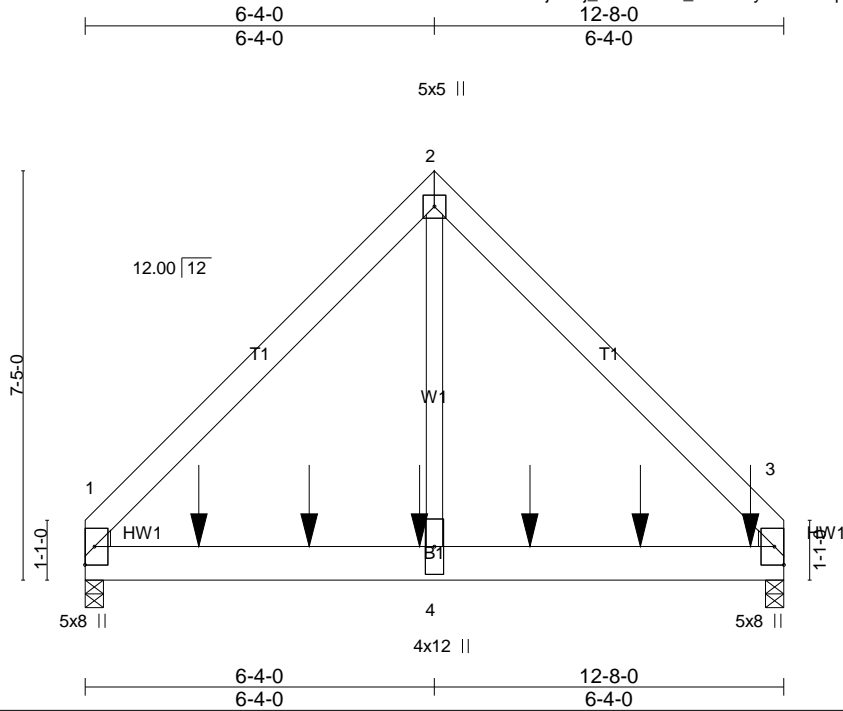

Scale = 1:41.8

Plate Offsets (X,Y)-- [1:0-1-0,0-1-0], [1:0-2-1,0-4-6], [3:0-1-0,0-1-0], [3:0-2-1,0-4-6]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.39	Vert(LL)	-0.04	3-4	>999	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.60	Vert(CT)	-0.08	3-4	>999		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.49	Horz(CT)	0.01	3	n/a		
BCDL 10.0	Rep Stress Incr NO	Matrix-S	Wind(LL)	0.03	3-4	>999		
	Code IRC2015/TPI2014						Weight: 186 lb	FT = 20%

**LUMBER-**

TOP CHORD 2x6 SP No.1  
 BOT CHORD 2x8 SP No.1  
 WEBS 2x4 SP No.2  
 WEDGE  
 Left: 2x4 SP No.2 , Right: 2x4 SP No.2

**BRACING-**

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.**

(size) 1=0-4-0 (min. 0-1-15), 3=0-4-0 (min. 0-2-6)  
 Max Horz 1=169(LC 24)  
 Max Uplift 1=-208(LC 9), 3=-257(LC 8)  
 Max Grav 1=3248(LC 1), 3=4045(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-3106/261, 2-3=-3101/260  
 BOT CHORD 1-4=-126/2038, 3-4=-126/2038  
 WEBS 2-4=-201/4016

**NOTES-**

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
 Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.  
 Bottom chords connected as follows: 2x8 - 2 rows staggered at 0-6-0 oc.  
 Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=18ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=208, 3=257.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 1194 lb down and 77 lb up at 2-0-12, 1050 lb down and 77 lb up at 4-0-12, 1050 lb down and 77 lb up at 6-0-12, 1050 lb down and 77 lb up at 8-0-12, and 1050 lb down and 77 lb up at 10-0-12, and 1201 lb down and 72 lb up at 12-0-12 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

Continued on page 2  
 LOAD CASE(S) Standard

Job	Truss	Truss Type	Qty	Ply	LOT 7 WOODBURY FARM
J0321-1553	E2GR	Common Girder	1	2	Job Reference (optional)

Comtech, Inc., Fayetteville, NC 28309, Bob Lewis

Run: 8.300 s Mar 22 2019 Print: 8.300 s Mar 22 2019 MiTek Industries, Inc. Wed Mar 24 15:09:13 2021 Page 2  
ID:oc86cjOn3j\_xrZlawBNe\_4zXIAc-y?IF057slqO7IGldtJsi4nu7S5q2IWmQdsqKQxzXiAa

**LOAD CASE(S)** Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-2=-60, 2-3=-60, 1-3=-20


Concentrated Loads (lb)

Vert: 4=-1050(F) 5=-1050(F) 7=-1050(F) 8=-1050(F) 10=-1050(F) 11=-1057(F)

Job J0321-1553	Truss V1	Truss Type Valley	Qty 1	Ply 1	LOT 7 WOODBURY FARM Job Reference (optional)
-------------------	-------------	----------------------	----------	----------	---

Comtech, Inc., Fayetteville, NC 28309, Bob Lewis

Run: 8.300 s Mar 22 2019 Print: 8.300 s Mar 22 2019 MiTek Industries, Inc. Wed Mar 24 15:09:14 2021 Page 1  
ID:oc86cjOn3j\_xrZlawBNe\_4zXIAc-QCIdDR7VW7W\_vQspR1Nxd?QM?UH3U15asWatyNzXiAZ

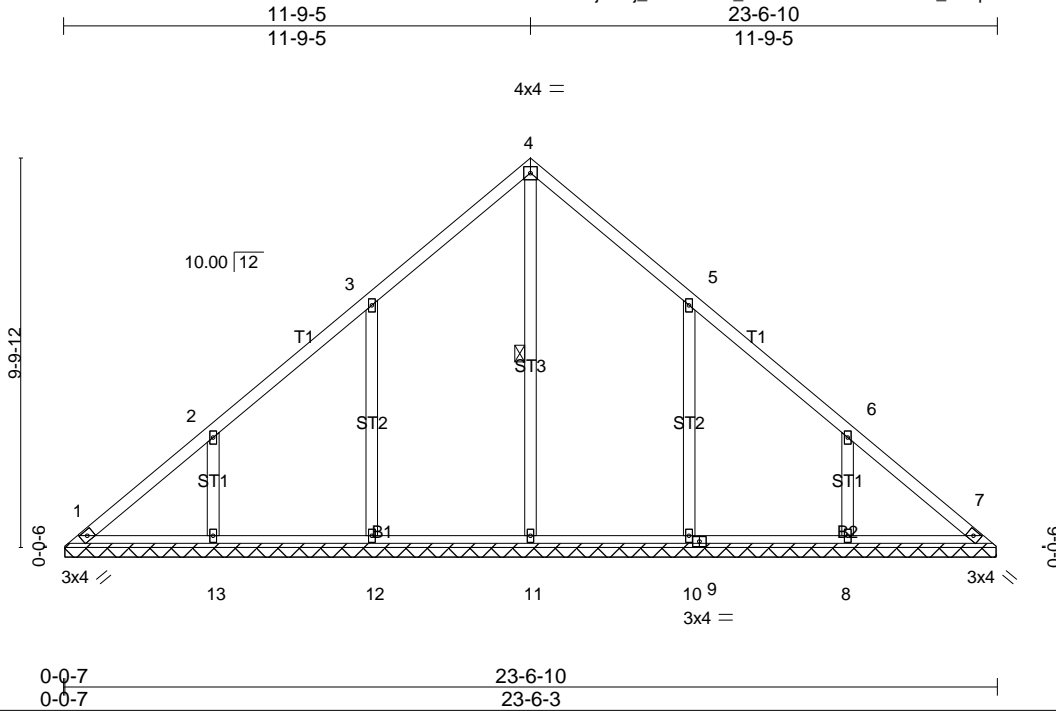

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.15	in (loc) l/def L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.16	Vert(LL) n/a - n/a 999		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.23	Vert(CT) n/a - n/a 999		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.01 7 n/a n/a		
	Code IRC2015/TPI2014			Weight: 118 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SP No.1  
BOT CHORD 2x4 SP No.1  
OTHERS 2x4 SP No.2

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
WEBS 1 Row at midpt 4-11

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** All bearings 23-5-12.  
(lb) - Max Horz 1=236(LC 11)  
Max Uplift All uplift 100 lb or less at joint(s) 1 except 12=145(LC 12), 13=134(LC 12), 10=145(LC 13), 8=134(LC 13)  
Max Grav All reactions 250 lb or less at joint(s) 1, 7 except 11=433(LC 22), 12=560(LC 19), 13=399(LC 19), 10=548(LC 20), 8=399(LC 20)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
WEBS 3-12=-357/278, 2-13=-335/261, 5-10=-357/278, 6-8=-335/261


- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=18ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-4-13 to 6-8-7, Interior(1) 6-8-7 to 11-9-5, Exterior(2) 11-9-5 to 18-0-15, Interior(1) 18-0-15 to 23-1-13 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) All plates are 2x4 MT20 unless otherwise indicated.
  - 4) Gable requires continuous bottom chord bearing.
  - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 6) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1 except (jt=lb) 12=145, 13=134, 10=145, 8=134.
  - 8) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard

Job J0321-1553	Truss V2	Truss Type Valley	Qty 1	Ply 1	LOT 7 WOODBURY FARM Job Reference (optional)
-------------------	-------------	----------------------	----------	----------	---

Comtech, Inc., Fayetteville, NC 28309, Bob Lewis

Run: 8.300 s Mar 22 2019 Print: 8.300 s Mar 22 2019 MiTek Industries, Inc. Wed Mar 24 15:09:14 2021 Page 1  
ID:oc86cjOn3j\_xrZlawBNe\_4zXIAC-QCldDR7VW7W\_vQspR1Nxd?QKzUHU2AasWatyNzXiAZ

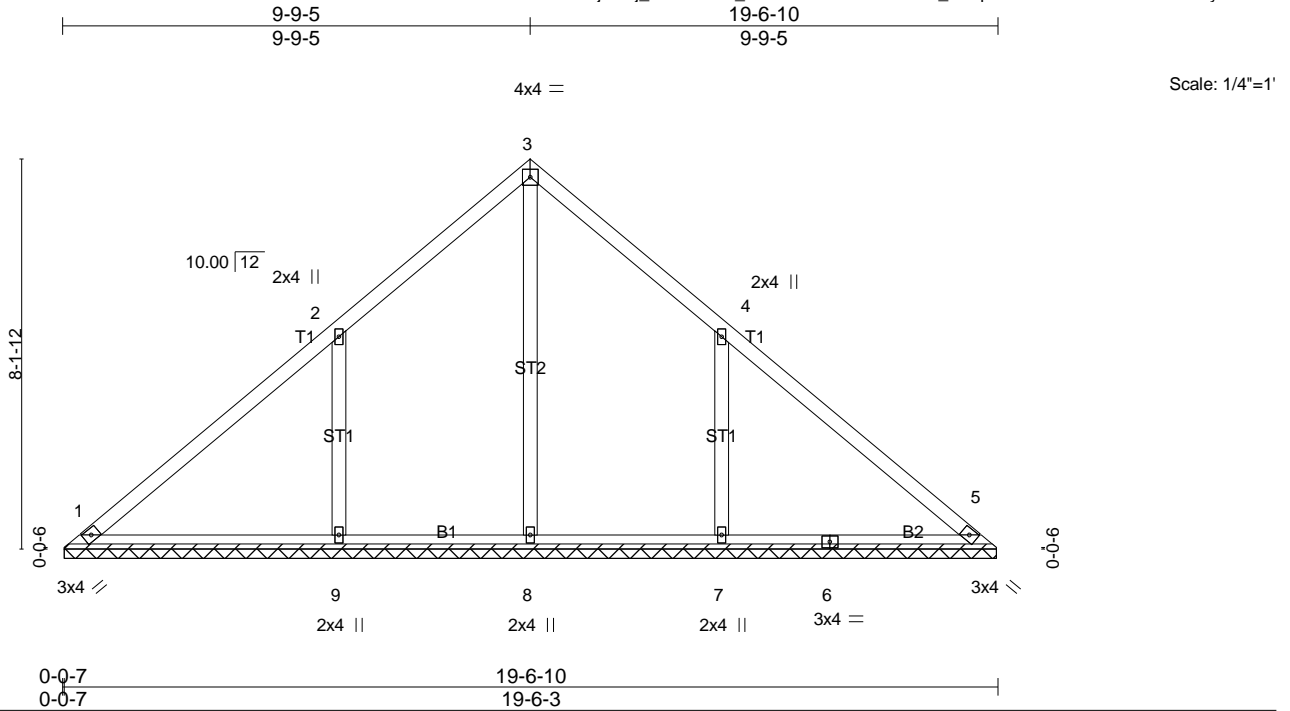

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.28	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.17	Vert(LL) n/a - n/a 999		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.16	Vert(CT) n/a - n/a 999		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.00 5 n/a n/a		
	Code IRC2015/TPI2014			Weight: 89 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SP No.1  
BOT CHORD 2x4 SP No.1  
OTHERS 2x4 SP No.2

**BRACING-**  
TOP CHORD  
BOT CHORD

Structural wood sheathing directly applied or 6'-0-0 oc purlins.  
Rigid ceiling directly applied or 10'-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** All bearings 19-5-12.  
(lb) - Max Horz 1=-195(LC 8)  
Max Uplift All uplift 100 lb or less at joint(s) 1 except 9=-197(LC 12), 7=-197(LC 13)  
Max Grav All reactions 250 lb or less at joint(s) 1, 5 except 8=404(LC 22), 9=602(LC 19), 7=602(LC 20)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
WEBS 2-9=-474/349, 4-7=-474/349

**NOTES-**


- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=18ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-4-13 to 6-8-7, Interior(1) 6-8-7 to 9-9-5, Exterior(2) 9-9-5 to 16-0-15, Interior(1) 16-0-15 to 19-1-13 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3'-6-0 tall by 2'-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1 except (jt=lb) 9=197, 7=197.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard

Job J0321-1553	Truss V3	Truss Type Valley	Qty 1	Ply 1	LOT 7 WOODBURY FARM Job Reference (optional)
-------------------	-------------	----------------------	----------	----------	---

Comtech, Inc., Fayetteville, NC 28309, Bob Lewis

Run: 8.300 s Mar 22 2019 Print: 8.300 s Mar 22 2019 MiTek Industries, Inc. Wed Mar 24 15:09:15 2021 Page 1  
ID:oc86cjOn3j\_xrZlawBNe\_4zXIAC-uOs?Rn87HRerXaR0?kuAACzXjudEDWOj4AJRUqzXiAY

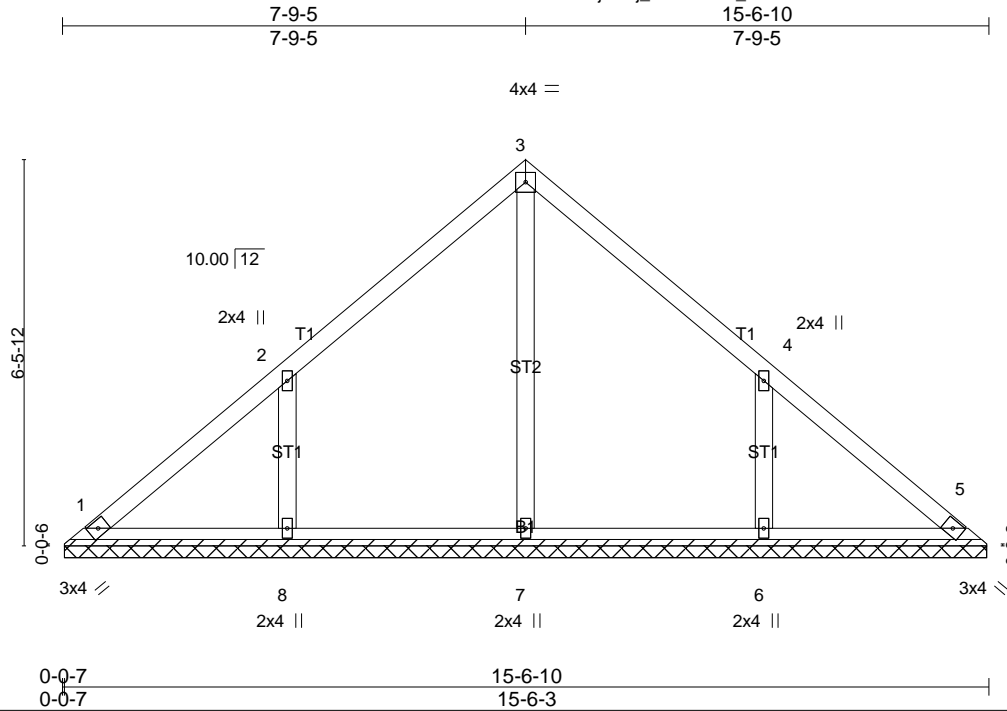

Scale = 1:38.7

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.15	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.17	Vert(LL) n/a - n/a 999		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.10	Vert(CT) n/a - n/a 999		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.00 5 n/a n/a		
	Code IRC2015/TPI2014			Weight: 68 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SP No.1  
BOT CHORD 2x4 SP No.1  
OTHERS 2x4 SP No.2

**BRACING-**  
TOP CHORD  
BOT CHORD

Structural wood sheathing directly applied or 6-0-0 oc purlins.  
Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** All bearings 15-5-12.  
(lb) - Max Horz 1=153(LC 9)  
Max Uplift All uplift 100 lb or less at joint(s) 1 except 8=-151(LC 12), 6=-150(LC 13)  
Max Grav All reactions 250 lb or less at joint(s) 1, 5 except 7=410(LC 19), 8=425(LC 19), 6=425(LC 20)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
WEBS 2-8=-363/281, 4-6=-363/281

**NOTES-**


- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=18ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-4-13 to 6-8-7, Interior(1) 6-8-7 to 7-9-5, Exterior(2) 7-9-5 to 14-0-15, Interior(1) 14-0-15 to 15-1-13 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1 except (jt=lb) 8=151, 6=150.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard

Job J0321-1553	Truss V4	Truss Type Valley	Qty 1	Ply 1	LOT 7 WOODBURY FARM Job Reference (optional)
-------------------	-------------	----------------------	----------	----------	---

Comtech, Inc., Fayetteville, NC 28309, Bob Lewis

Run: 8.300 s Mar 22 2019 Print: 8.300 s Mar 22 2019 MiTek Industries, Inc. Wed Mar 24 15:09:15 2021 Page 1  
ID:oc86cjOn3j\_xrZlawBNe\_4zXIAc-uOs?Rn87HRerXaR0?kuAACzVCucUDWdj4AJRUqzXiY

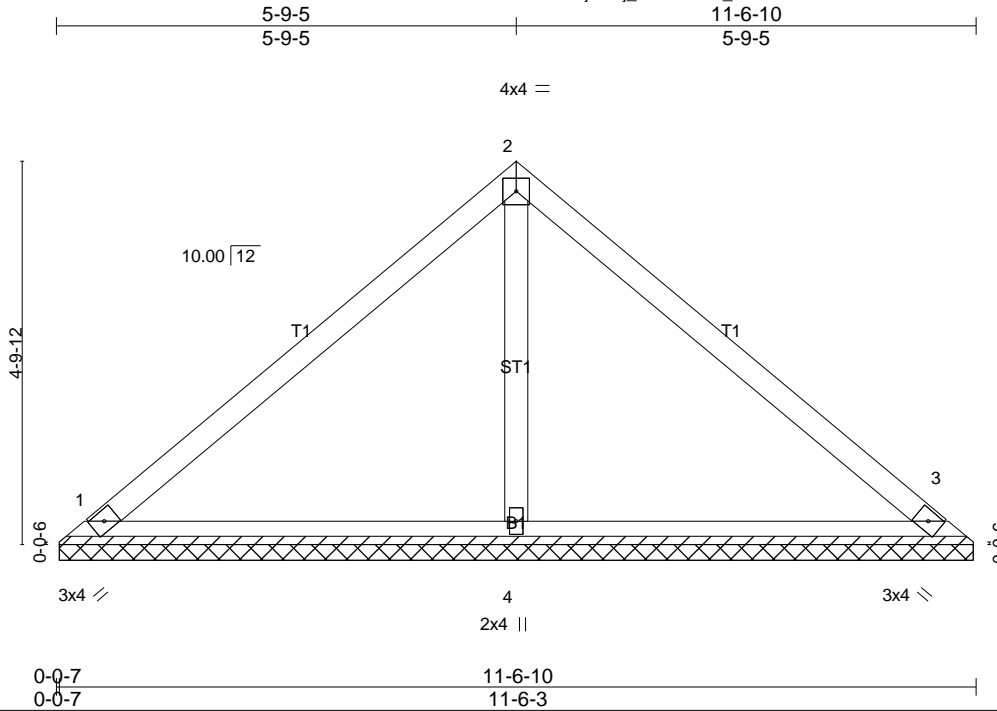

Scale = 1:28.9

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.31	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.21	Vert(LL) n/a - n/a 999		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.08	Vert(CT) n/a - n/a 999		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.00 3 n/a n/a		
	Code IRC2015/TPI2014			Weight: 44 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SP No.1  
BOT CHORD 2x4 SP No.1  
OTHERS 2x4 SP No.2

**BRACING-**  
TOP CHORD  
BOT CHORD

Structural wood sheathing directly applied or 6-0-0 oc purlins.  
Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** (size) 1=11-5-12 (min. 0-1-8), 3=11-5-12 (min. 0-1-8), 4=11-5-12 (min. 0-1-8)  
Max Horz 1=112(LC 9)  
Max Uplift 1=-29(LC 13), 3=-39(LC 13)  
Max Grav 1=230(LC 1), 3=230(LC 1), 4=401(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**


- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=18ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard

Job J0321-1553	Truss V5	Truss Type Valley	Qty 1	Ply 1	LOT 7 WOODBURY FARM Job Reference (optional)
-------------------	-------------	----------------------	----------	----------	---

Comtech, Inc., Fayetteville, NC 28309, Bob Lewis

Run: 8.300 s Mar 22 2019 Print: 8.300 s Mar 22 2019 MiTek Industries, Inc. Wed Mar 24 15:09:16 2021 Page 1  
ID:oc86cjOn3j\_xrZlawBNe\_4zXIAc-MaQNe79I2Imi9k0CZRQPiQWi8I\_ky\_qtJq3\_1GzXiAX

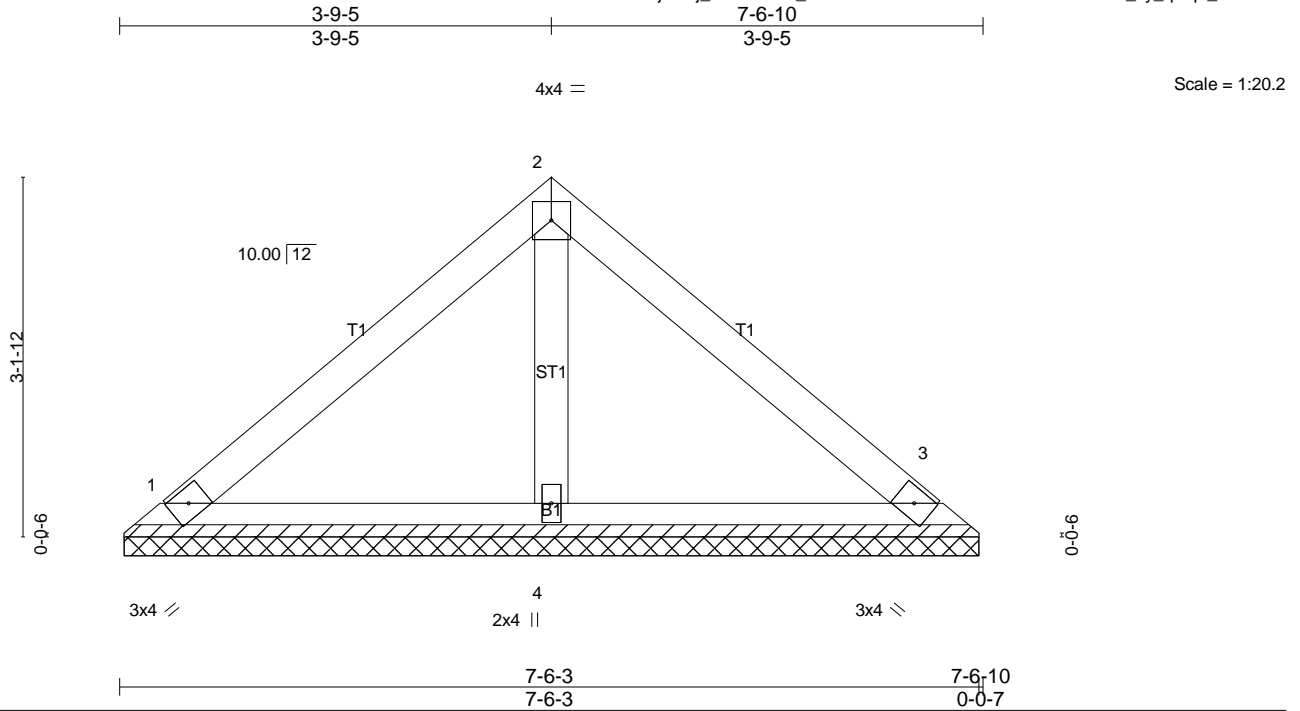

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.17	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.08	Vert(LL) n/a - n/a 999		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.02	Vert(CT) n/a - n/a 999		
BCDL 10.0	Rep Stress Incr YES	Matrix-P	Horz(CT) 0.00 3 n/a n/a		
	Code IRC2015/TPI2014			Weight: 28 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SP No.1  
BOT CHORD 2x4 SP No.1  
OTHERS 2x4 SP No.2

**BRACING-**  
TOP CHORD  
BOT CHORD

Structural wood sheathing directly applied or 6-0-0 oc purlins.  
Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** (size) 1=7-5-12 (min. 0-1-8), 3=7-5-12 (min. 0-1-8), 4=7-5-12 (min. 0-1-8)  
Max Horz 1=-70(LC 10)  
Max Uplift 1=-26(LC 13), 3=-32(LC 13)  
Max Grav 1=156(LC 1), 3=156(LC 1), 4=228(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=18ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard

Job J0321-1553	Truss V6	Truss Type Valley	Qty 1	Ply 1	LOT 7 WOODBURY FARM Job Reference (optional)
-------------------	-------------	----------------------	----------	----------	---

Comtech, Inc., Fayetteville, NC 28309, Bob Lewis

Run: 8.300 s Mar 22 2019 Print: 8.300 s Mar 22 2019 MiTek Industries, Inc. Wed Mar 24 15:09:17 2021 Page 1  
ID:oc86cjOn3j\_xrZlawBNe\_4zXIAc-qn\_lsSANp2uZmtbO69xeFd2u8iJHhRR0YUoYZizXiAW

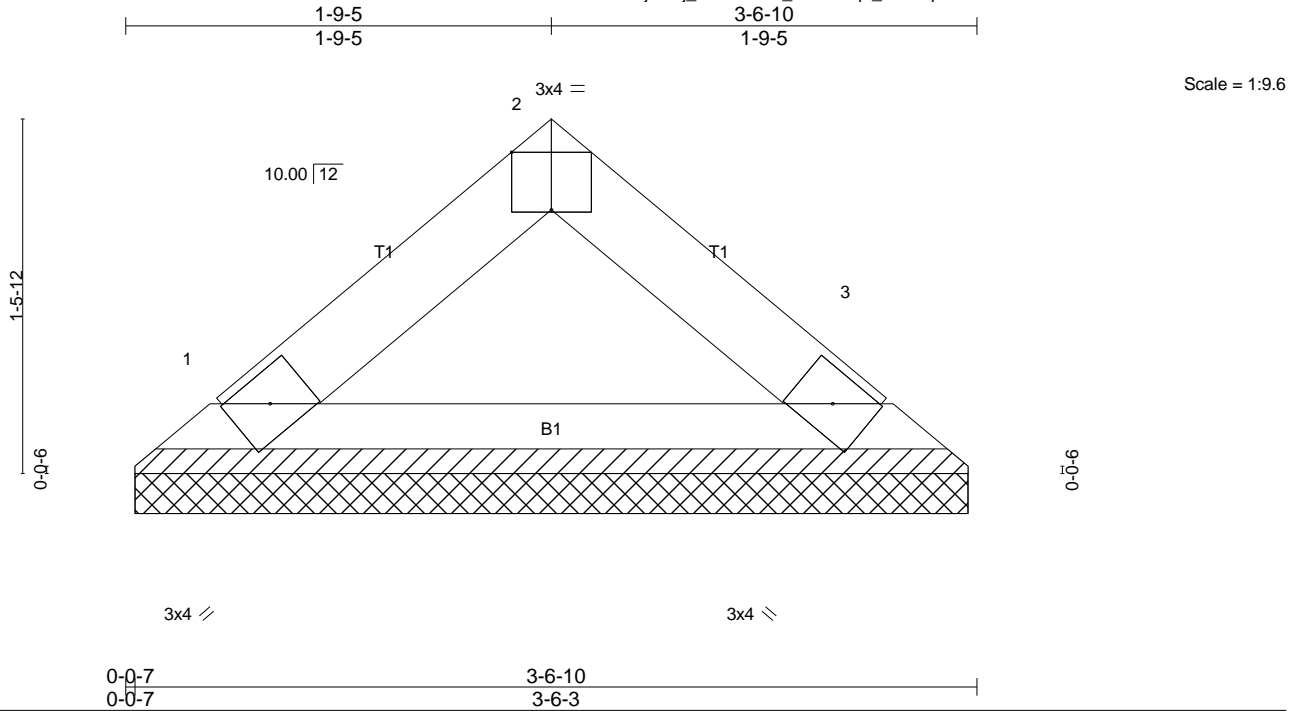


Plate Offsets (X,Y)-- [2:0-2-0,Edge]
--------------------------------------

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.03	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.06	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.00	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-P						
	Code IRC2015/TPI2014						Weight: 11 lb	FT = 20%

**LUMBER-**

TOP CHORD 2x4 SP No.1  
BOT CHORD 2x4 SP No.1

**BRACING-**

TOP CHORD Structural wood sheathing directly applied or 3-6-10 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** (size) 1=3-5-12 (min. 0-1-8), 3=3-5-12 (min. 0-1-8)  
Max Horz 1=-29(LC 10)  
Max Uplift 1=-6(LC 12), 3=-6(LC 13)  
Max Grav 1=110(LC 1), 3=110(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=18ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Gable requires continuous bottom chord bearing.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.
- 7) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.


**LOAD CASE(S)** Standard



Job J0321-1553	Truss VA1	Truss Type Valley	Qty 1	Ply 1	LOT 7 WOODBURY FARM Job Reference (optional)
-------------------	--------------	----------------------	----------	----------	---

Comtech, Inc., Fayetteville, NC 28309, Bob Lewis

Run: 8.300 s Mar 22 2019 Print: 8.300 s Mar 22 2019 MiTek Industries, Inc. Wed Mar 24 15:09:17 2021 Page 1  
ID:oc86cjOn3j\_xrZlawBNe\_4zXlAc-qn\_lsSANp2uZmtbO69xeFd2sdlbhNU0YUoYzizXiAW

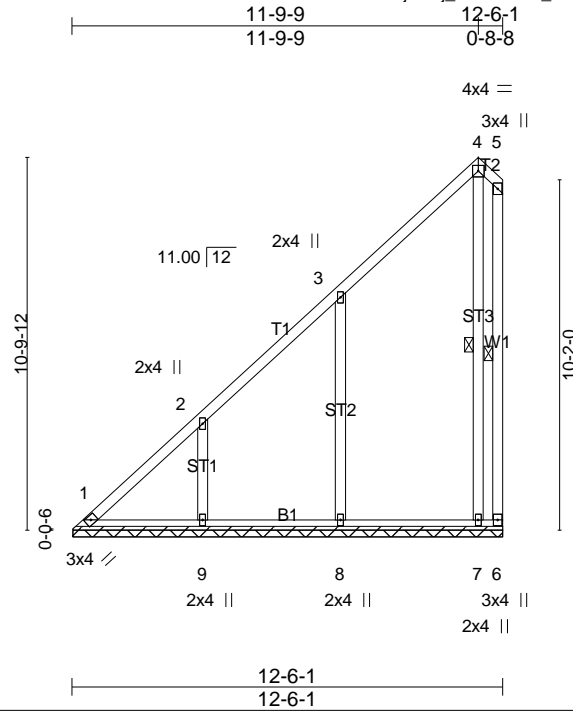

Scale = 1:66.9

<b>LOADING</b> (psf)	<b>SPACING-</b> 2-0-0	<b>CSI.</b>	<b>DEFL.</b> in (loc) l/defl L/d	<b>PLATES GRIP</b>
TCLL 20.0	Plate Grip DOL 1.15	TC 0.19	Vert(LL) n/a - n/a 999	MT20 244/190
TCDL 10.0	Lumber DOL 1.15	BC 0.17	Vert(CT) n/a - n/a 999	
BCLL 0.0 *	Rep Stress Incr YES	WB 0.32	Horz(CT) 0.00 6 n/a n/a	
BCDL 10.0	Code IRC2015/TPI2014	Matrix-S		Weight: 87 lb FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SP No.1  
BOT CHORD 2x4 SP No.1  
WEBS 2x4 SP No.2  
OTHERS 2x4 SP No.2

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
WEBS 1 Row at midpt 5-6, 4-7

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** All bearings 12-5-11.  
(lb) - Max Horz 1=344(LC 12)  
Max Uplift All uplift 100 lb or less at joint(s) 1, 7 except 6=-163(LC 18), 8=-168(LC 12), 9=-155(LC 12)  
Max Grav All reactions 250 lb or less at joint(s) 6 except 1=264(LC 12), 7=447(LC 19), 8=579(LC 19), 9=425(LC 19)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-2=-540/487, 2-3=-343/295  
WEBS 3-8=-399/330, 2-9=-364/303


- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=18ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-4-8 to 6-8-2, Interior(1) 6-8-2 to 11-9-9, Exterior(2) 11-9-9 to 12-4-5 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Gable requires continuous bottom chord bearing.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 7 except (jt=lb) 6=163, 8=168, 9=155.
  - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard

Job J0321-1553	Truss VA2	Truss Type Valley	Qty 1	Ply 1	LOT 7 WOODBURY FARM Job Reference (optional)
-------------------	--------------	----------------------	----------	----------	---

Comtech, Inc., Fayetteville, NC 28309, Bob Lewis

Run: 8.300 s Mar 22 2019 Print: 8.300 s Mar 22 2019 MiTek Industries, Inc. Wed Mar 24 15:09:18 2021 Page 1  
ID:oc86cjOn3j\_xrZlawBNe\_4zXIAC-lzY83oB?aMQO1AagsStnrb\_h6ebQvAn8Y559zXiAV

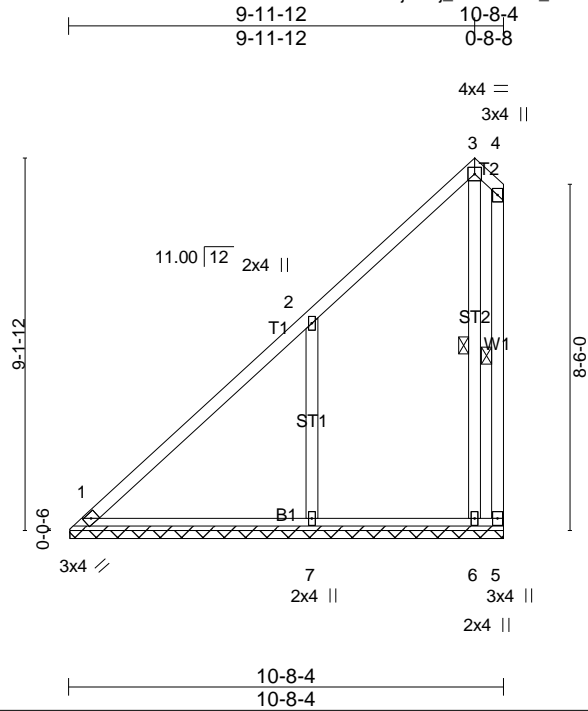

Scale = 1:56.6

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.36	in (loc) l/defl L/d	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.19	Vert(LL) n/a - n/a 999		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.24	Vert(CT) n/a - n/a 999		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) -0.00 5 n/a n/a		
	Code IRC2015/TPI2014			Weight: 69 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SP No.1  
BOT CHORD 2x4 SP No.1  
WEBS 2x4 SP No.2  
OTHERS 2x4 SP No.2

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.  
WEBS 1 Row at midpt 4-5, 3-6

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** All bearings 10-7-14.  
(lb) - Max Horz 1=287(LC 12)  
Max Uplift All uplift 100 lb or less at joint(s) 6 except 5=-174(LC 18), 7=-235(LC 12)  
Max Grav All reactions 250 lb or less at joint(s) 1, 5 except 6=385(LC 19), 7=635(LC 19)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-2=-410/369  
WEBS 2-7=-543/431


- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=18ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-4-8 to 6-8-2, Interior(1) 6-8-2 to 9-11-12, Exterior(2) 9-11-12 to 10-6-8 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Gable requires continuous bottom chord bearing.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 6 except (jt=lb) 5=174, 7=235.
  - This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard

Job J0321-1553	Truss VA3	Truss Type Valley	Qty 1	Ply 1	LOT 7 WOODBURY FARM Job Reference (optional)
-------------------	--------------	----------------------	----------	----------	---

Comtech, Inc., Fayetteville, NC 28309, Bob Lewis

Run: 8.300 s Mar 22 2019 Print: 8.300 s Mar 22 2019 MiTek Industries, Inc. Wed Mar 24 15:09:18 2021 Page 1  
ID:oc86cjOn3j\_xrZlawBNe\_4zXlAc-lzY83oB?aM0QO1AagsStnrb0j6e3QstAn8Y559zXiAV

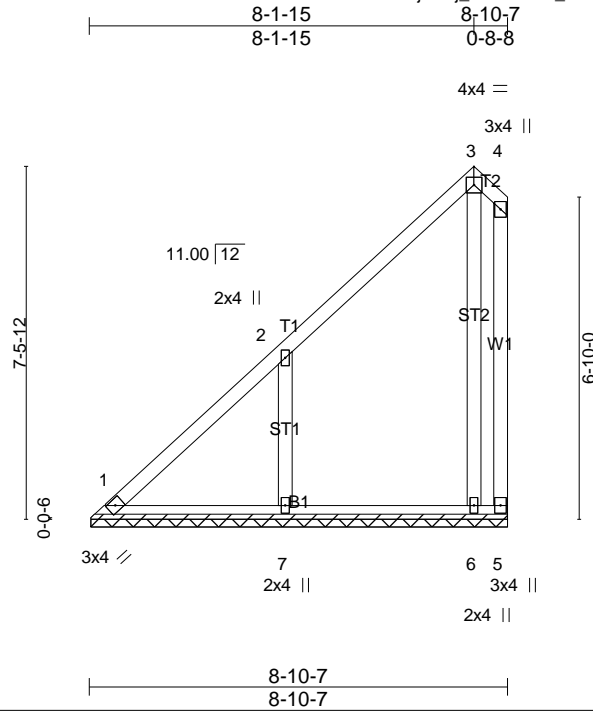

Scale = 1:48.9

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.23	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.16	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.12	Horz(CT)	0.00	n/a	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-P					Weight: 55 lb	FT = 20%
	Code IRC2015/TPI2014							

**LUMBER-**

TOP CHORD 2x4 SP No.1  
BOT CHORD 2x4 SP No.1  
WEBS 2x4 SP No.2  
OTHERS 2x4 SP No.2

**BRACING-**

TOP CHORD Structural wood sheathing directly applied or 6'-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10'-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** (size) 1=8-10-1 (min. 0-1-8), 5=8-10-1 (min. 0-1-8), 6=8-10-1 (min. 0-1-8), 7=8-10-1 (min. 0-1-8)  
Max Horz 1=231(LC 12)  
Max Uplift 1=8(LC 10), 5=180(LC 18), 6=17(LC 12), 7=191(LC 12)  
Max Grav 1=159(LC 12), 6=420(LC 19), 7=505(LC 19)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-371/325  
WEBS 2-7=-459/387

**NOTES-**


- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=18ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-4-8 to 6-8-2, Interior(1) 6-8-2 to 8-1-15, Exterior(2) 8-1-15 to 8-8-11 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3'-6-0 tall by 2'-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 6 except (jt=lb) 5=180, 7=191.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard

Job J0321-1553	Truss VA4	Truss Type Valley	Qty 1	Ply 1	LOT 7 WOODBURY FARM Job Reference (optional)
-------------------	--------------	----------------------	----------	----------	---

Comtech, Inc., Fayetteville, NC 28309, Bob Lewis

Run: 8.300 s Mar 22 2019 Print: 8.300 s Mar 22 2019 MiTek Industries, Inc. Wed Mar 24 15:09:19 2021 Page 1  
ID:oc86cjOn3j\_xrZlawBNe\_4zXIAc-m96WH8BdKg8H0BlnEaz6K284zVz19lmJ?oHedbzXIAU

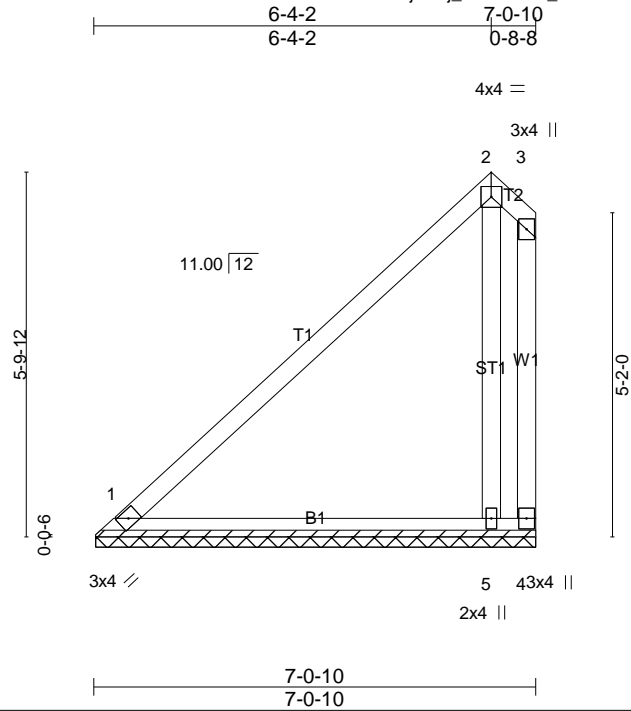

Scale = 1:36.8

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.64	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.24	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.14	Horz(CT)	0.00		n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-P						
	Code IRC2015/TPI2014						Weight: 39 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SP No.1  
BOT CHORD 2x4 SP No.1  
WEBS 2x4 SP No.2  
OTHERS 2x4 SP No.2

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 7-0-10 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** (size) 1=7-0-3 (min. 0-1-8), 4=7-0-3 (min. 0-1-8), 5=7-0-3 (min. 0-1-8)  
Max Horz 1=174(LC 12)  
Max Uplift 4=-273(LC 3), 5=-3(LC 12)  
Max Grav 1=225(LC 1), 5=513(LC 3)


**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
WEBS 2-5=-274/224

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=18ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Gable requires continuous bottom chord bearing.
  - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 5) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5 except (jt=lb) 4=273.
  - 7) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard

Job J0321-1553	Truss VA5	Truss Type Valley	Qty 1	Ply 1	LOT 7 WOODBURY FARM
Comtech, Inc., Fayetteville, NC 28309, Bob Lewis					Job Reference (optional)

Run: 8.300 s Mar 22 2019 Print: 8.300 s Mar 22 2019 MiTek Industries, Inc. Wed Mar 24 15:09:19 2021 Page 1  
ID:oc86cjOn3j\_xrZlawBNe\_4zXIAC-m96WH8BdKg8H0BlnEaz6K28ALV?09KDJ?oHedbzXIAU

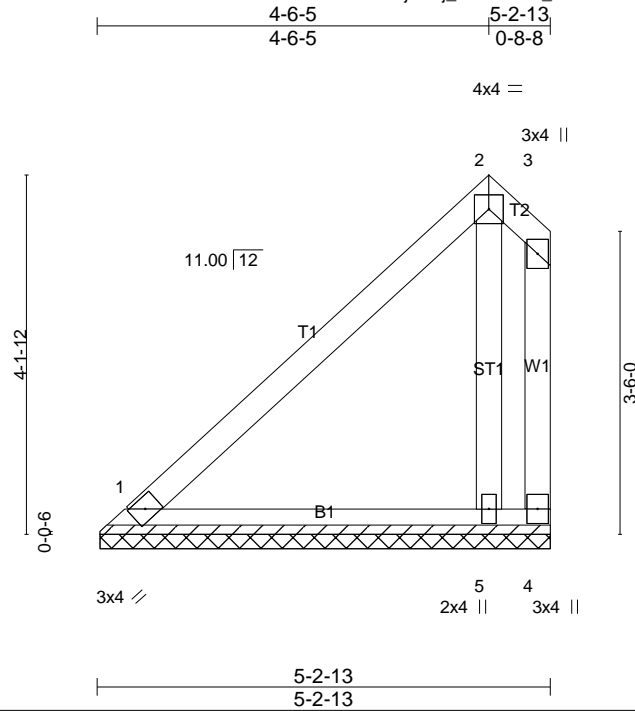

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.30	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.11	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.05	Horz(CT)	0.00		n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-P					Weight: 28 lb	FT = 20%
	Code IRC2015/TPI2014							

**LUMBER-**  
TOP CHORD 2x4 SP No.1  
BOT CHORD 2x4 SP No.1  
WEBS 2x4 SP No.2  
OTHERS 2x4 SP No.2

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 5-2-13 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** (size) 1=5-2-6 (min. 0-1-8), 4=5-2-6 (min. 0-1-8), 5=5-2-6 (min. 0-1-8)  
Max Horz 1=118(LC 12)  
Max Uplift 4=118(LC 3), 5=118(LC 12)  
Max Grav 1=157(LC 1), 5=295(LC 3)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**


- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=18ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5 except (jt=lb) 4=118.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard


Job J0321-1553	Truss VA6	Truss Type Valley	Qty 1	Ply 1	LOT 7 WOODBURY FARM Job Reference (optional)
-------------------	--------------	----------------------	----------	----------	---

Comtech, Inc., Fayetteville, NC 28309, Bob Lewis

Run: 8.300 s Mar 22 2019 Print: 8.300 s Mar 22 2019 MiTek Industries, Inc. Wed Mar 24 15:09:20 2021 Page 1  
ID:oc86cjOn3j\_xrZlawBNe\_4zXIAc-EMguUUCF5zH8dLKzoHULsGgOQvMUun\_SEs1CA1zXiAT



Scale = 1:14.5

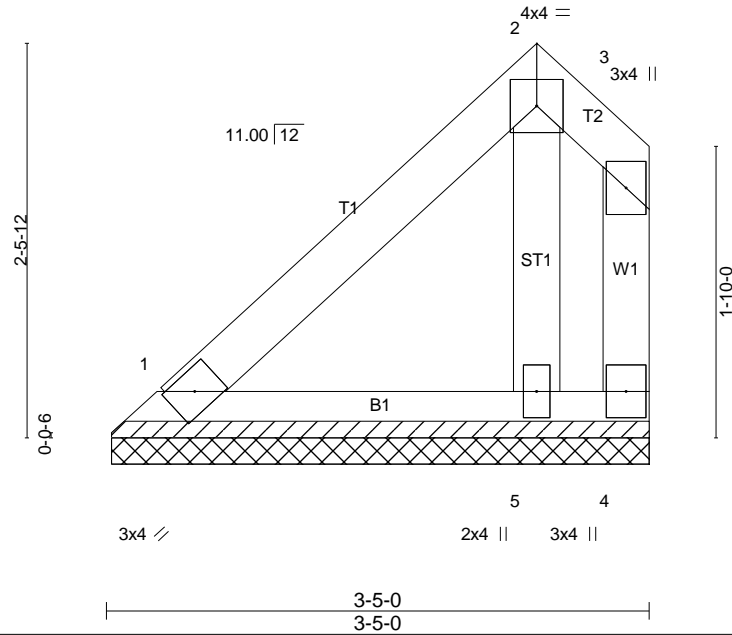

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.09	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.03	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.01	Horz(CT)	0.00		n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-P					Weight: 16 lb	FT = 20%
	Code IRC2015/TPI2014							

**LUMBER-**  
TOP CHORD 2x4 SP No.1  
BOT CHORD 2x4 SP No.1  
WEBS 2x4 SP No.2  
OTHERS 2x4 SP No.2

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 3-5-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** (size) 1=3-4-9 (min. 0-1-8), 4=3-4-9 (min. 0-1-8), 5=3-4-9 (min. 0-1-8)  
Max Horz 1=61(LC 12)  
Max Uplift 4=-23(LC 3), 5=-14(LC 12)  
Max Grav 1=89(LC 1), 4=6(LC 20), 5=153(LC 19)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**


- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=18ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Gable requires continuous bottom chord bearing.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 5.
- 7) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard

Job J0321-1553	Truss VB1	Truss Type Valley	Qty 1	Ply 1	LOT 7 WOODBURY FARM Job Reference (optional)
-------------------	--------------	----------------------	----------	----------	---

Comtech, Inc., Fayetteville, NC 28309, Bob Lewis

Run: 8.300 s Mar 22 2019 Print: 8.300 s Mar 22 2019 MiTek Industries, Inc. Wed Mar 24 15:09:21 2021 Page 1  
ID:oc86cjOn3j\_xrZlawBNe\_4zXIAC-jYEGhqDusHP\_FVv9L??aPTDYZJgidEscT6mliUzXiAS

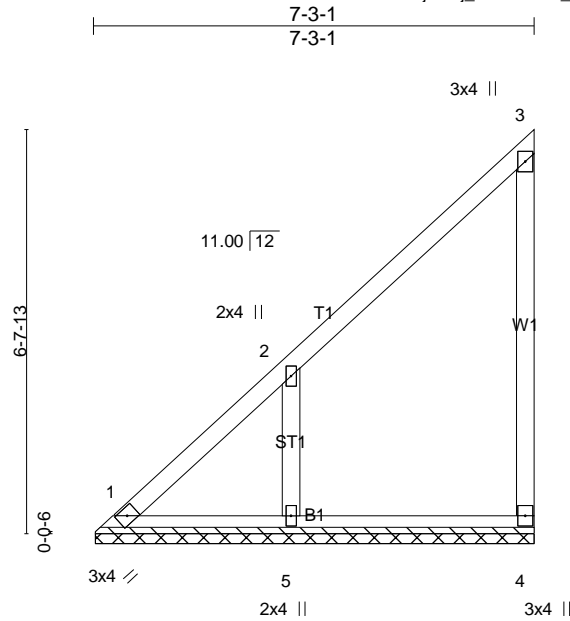

Scale = 1:37.9

LOADING (psf)	SPACING-		CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0		TC 0.19	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15		BC 0.16	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Lumber DOL 1.15		WB 0.06	Horz(CT)	0.00		n/a		
BCDL 10.0	Rep Stress Incr YES		Matrix-P						
	Code IRC2015/TPI2014							Weight: 37 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SP No.1  
BOT CHORD 2x4 SP No.1  
WEBS 2x4 SP No.2  
OTHERS 2x4 SP No.2

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** (size) 1=7-2-11 (min. 0-1-8), 4=7-2-11 (min. 0-1-8), 5=7-2-11 (min. 0-1-8)  
Max Horz 1=209(LC 12)  
Max Uplift 1=-23(LC 10), 4=-59(LC 12), 5=-164(LC 12)  
Max Grav 1=156(LC 12), 4=208(LC 19), 5=446(LC 19)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-2=-380/324  
WEBS 2-5=-409/356

**NOTES-**


- 1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=18ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) 0-4-8 to 6-8-2, Interior(1) 6-8-2 to 7-1-5 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 4 except (jt=lb) 5=164.
- 6) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard

Job J0321-1553	Truss VB2	Truss Type Valley	Qty 1	Ply 1	LOT 7 WOODBURY FARM Job Reference (optional)
-------------------	--------------	----------------------	----------	----------	---

Comtech, Inc., Fayetteville, NC 28309, Bob Lewis

Run: 8.300 s Mar 22 2019 Print: 8.300 s Mar 22 2019 MiTek Industries, Inc. Wed Mar 24 15:09:21 2021 Page 1  
ID:oc86cjOn3j\_xrZlawBNe\_4zXIAC-jYEGhqDusHP\_FVv9L??aPTDUJfndEQcT6mliUzXiAS

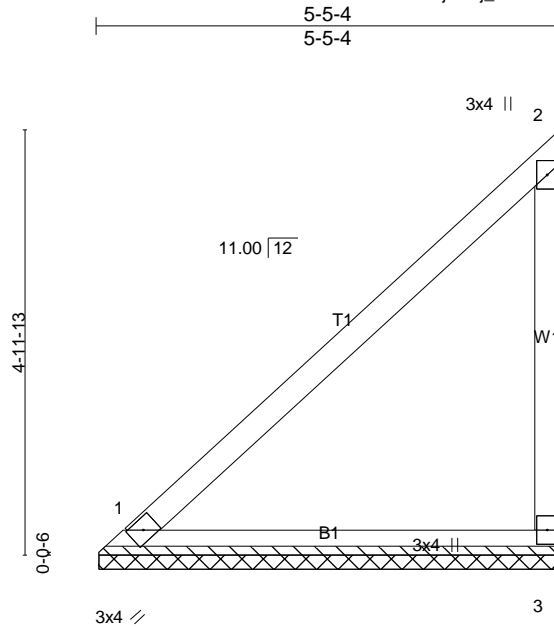

Scale = 1:27.0

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.43	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.22	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.00	Horz(CT)	0.00		n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-P						
	Code IRC2015/TPI2014						Weight: 25 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SP No.1  
BOT CHORD 2x4 SP No.1  
WEBS 2x4 SP No.2

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 5-5-4 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** (size) 1=5-4-14 (min. 0-1-8), 3=5-4-14 (min. 0-1-8)  
Max Horz 1=153(LC 12)  
Max Uplift 3=94(LC 12)  
Max Grav 1=197(LC 1), 3=224(LC 19)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**

- 1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=18ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3.
- 6) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.


**LOAD CASE(S)** Standard



Job J0321-1553	Truss VB3	Truss Type Valley	Qty 1	Ply 1	LOT 7 WOODBURY FARM Job Reference (optional)
-------------------	--------------	----------------------	----------	----------	---

Comtech, Inc., Fayetteville, NC 28309, Bob Lewis

Run: 8.300 s Mar 22 2019 Print: 8.300 s Mar 22 2019 MiTek Industries, Inc. Wed Mar 24 15:09:22 2021 Page 1  
ID:oc86cjOn3j\_xrZlawBNe\_4zXIAc-BknevAEWdaXrtfUMviWpyhmjkj1BMhgIhmWIEwzXIAR

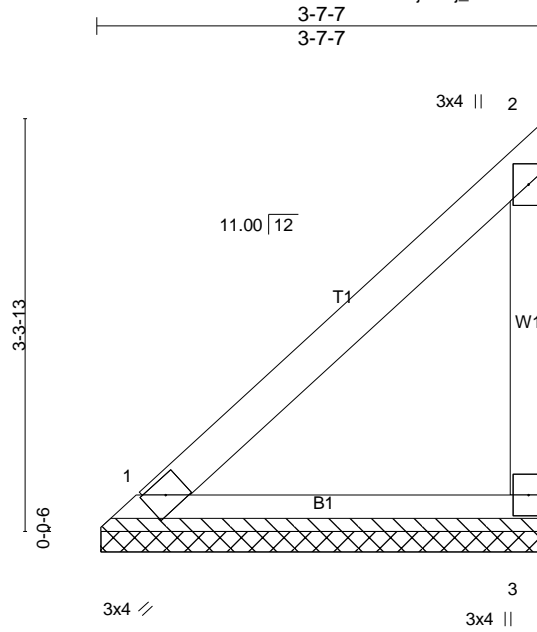

Scale = 1:18.5

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.16	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.08	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.00	Horz(CT)	0.00		n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-P						
	Code IRC2015/TPI2014						Weight: 16 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SP No.1  
BOT CHORD 2x4 SP No.1  
WEBS 2x4 SP No.2

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 3-7-7 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** (size) 1=3-7-1 (min. 0-1-8), 3=3-7-1 (min. 0-1-8)  
Max Horz 1=96(LC 12)  
Max Uplift 3=-59(LC 12)  
Max Grav 1=124(LC 1), 3=141(LC 19)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**


- 1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=18ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3.
- 6) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard

Job J0321-1553	Truss VC1	Truss Type Valley	Qty 1	Ply 1	LOT 7 WOODBURY FARM Job Reference (optional)
-------------------	--------------	----------------------	----------	----------	---

Comtech, Inc., Fayetteville, NC 28309, Bob Lewis

Run: 8.300 s Mar 22 2019 Print: 8.300 s Mar 22 2019 MiTek Industries, Inc. Wed Mar 24 15:09:22 2021 Page 1  
ID:oc86cjOn3j\_xrZlawBNe\_4zXlAc-BknevAEWdaXrtfUMviWpyhmksj2pMhUlhWIEwXiAR

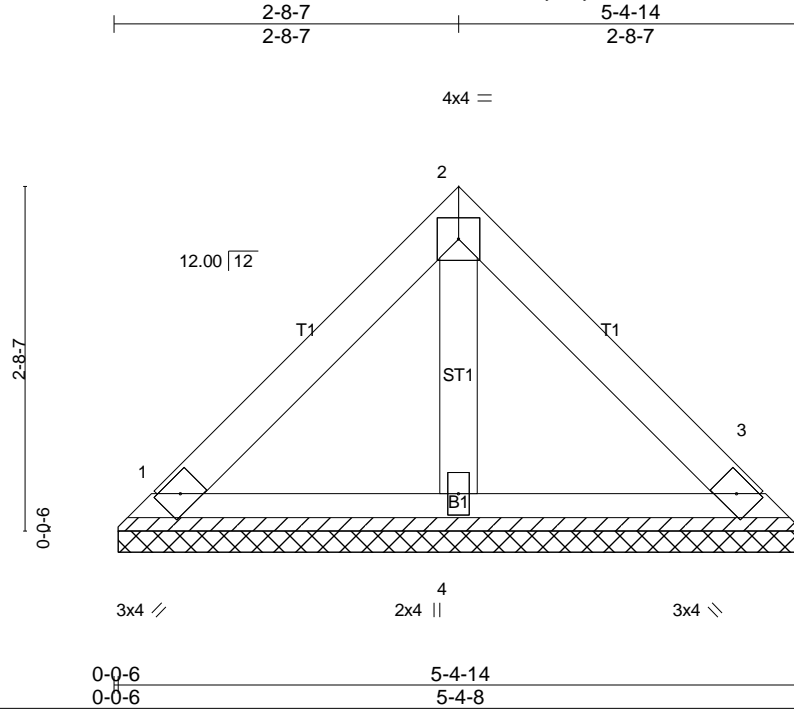

Scale = 1:18.1

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.09	Vert(LL)	n/a	-	n/a	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.04	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.01	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-P					Weight: 21 lb	FT = 20%
	Code IRC2015/TPI2014							

**LUMBER-**  
TOP CHORD 2x4 SP No.1  
BOT CHORD 2x4 SP No.1  
OTHERS 2x4 SP No.2

**BRACING-**  
TOP CHORD  
BOT CHORD

Structural wood sheathing directly applied or 5-4-14 oc purlins.  
Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** (size) 1=5-4-2 (min. 0-1-8), 3=5-4-2 (min. 0-1-8), 4=5-4-2 (min. 0-1-8)  
Max Horz 1=59(LC 9)  
Max Uplift 1=-22(LC 13), 3=-22(LC 13)  
Max Grav 1=115(LC 1), 3=115(LC 1), 4=147(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**


- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=18ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.
- This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard

Job J0321-1553	Truss X1	Truss Type Jack-Open	Qty 2	Ply 1	LOT 7 WOODBURY FARM Job Reference (optional)
-------------------	-------------	-------------------------	----------	----------	---

Comtech, Inc., Fayetteville, NC 28309, Bob Lewis

Run: 8.300 s Mar 22 2019 Print: 8.300 s Mar 22 2019 MiTek Industries, Inc. Wed Mar 24 15:09:23 2021 Page 1  
ID:oc86cjOn3j\_xrZlawBNe\_4zXIAC-fxL16WE8OufiUo2YTQ22Uulvh7Nm58gvwQFsmMzXIAQ

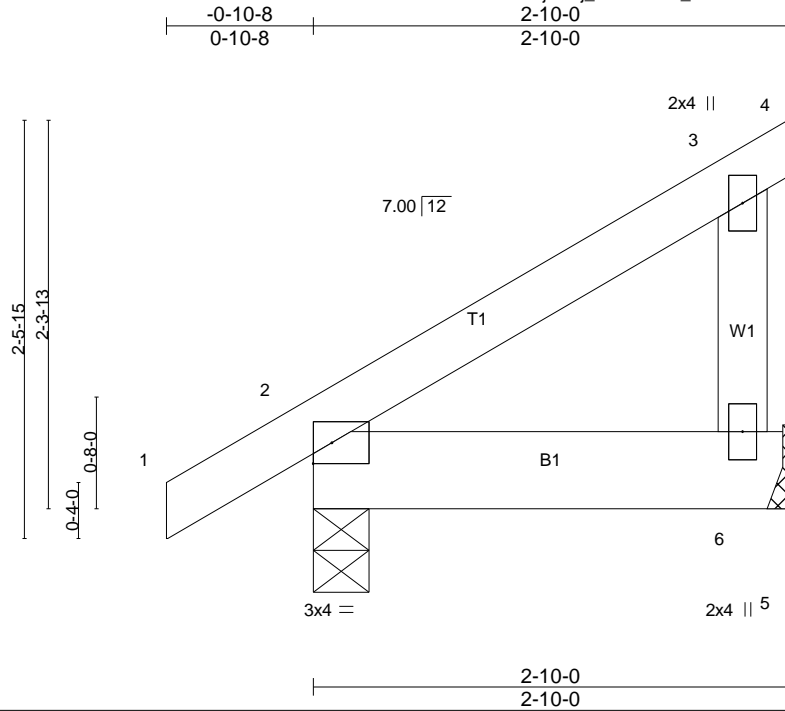

Scale = 1:13.7

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.09	Vert(LL) -0.00	2	>999	360	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.06	Vert(CT) -0.00	2	>999	240		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.02	Horz(CT) 0.00		n/a	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-P	Wind(LL) 0.00	2	****	240		
	Code IRC2015/TPI2014						Weight: 15 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SP No.1  
BOT CHORD 2x6 SP No.1  
WEBS 2x4 SP No.2

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 2-10-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 2=0-4-0 (min. 0-1-8), 6=Mechanical  
Max Horz 2=70(LC 12)  
Max Uplift 2=-6(LC 12), 6=-34(LC 12)  
Max Grav 2=171(LC 1), 6=106(LC 19)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**


- 1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=18ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 6.
- 6) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard

Job J0321-1553	Truss X1GE	Truss Type GABLE	Qty 2	Ply 1	LOT 7 WOODBURY FARM Job Reference (optional)
-------------------	---------------	---------------------	----------	----------	---

Comtech, Inc., Fayetteville, NC 28309, Bob Lewis

Run: 8.300 s Mar 22 2019 Print: 8.300 s Mar 22 2019 MiTek Industries, Inc. Wed Mar 24 15:09:23 2021 Page 1  
ID:oc86cjOn3j\_xrZlawBNe\_4zXIAc-fxL16WE8OufiUo2YTQ22Uulvh7Nm58gwwQFsmMzXIAQ

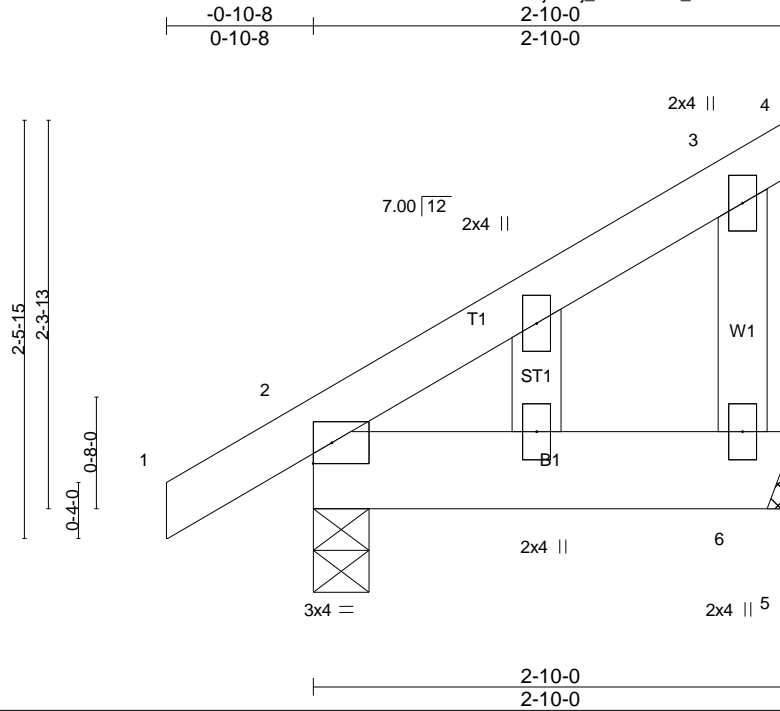

Scale = 1:13.7

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.09	Vert(LL) -0.00	2	>999	360	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.06	Vert(CT) -0.00	2	>999	240		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.02	Horz(CT) 0.00		n/a	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-P	Wind(LL) 0.00	2	****	240		
	Code IRC2015/TPI2014						Weight: 16 lb	FT = 20%

**LUMBER-**

TOP CHORD 2x4 SP No.1  
BOT CHORD 2x6 SP No.1  
WEBS 2x4 SP No.2  
OTHERS 2x4 SP No.2

**BRACING-**

TOP CHORD Structural wood sheathing directly applied or 2-10-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.**

(size) 2=0-4-0 (min. 0-1-8), 6=Mechanical  
Max Horz 2=102(LC 12)  
Max Uplift 2=-31(LC 12), 6=-64(LC 12)  
Max Grav 2=171(LC 1), 6=110(LC 19)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**


- 1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=18ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) Gable studs spaced at 1-4-0 oc.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Refer to girder(s) for truss to truss connections.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 6.
- 8) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard

Job J0321-1553	Truss X2	Truss Type Jack-Open	Qty 4	Ply 1	LOT 7 WOODBURY FARM Job Reference (optional)
-------------------	-------------	-------------------------	----------	----------	---

Comtech, Inc., Fayetteville, NC 28309, Bob Lewis

Run: 8.300 s Mar 22 2019 Print: 8.300 s Mar 22 2019 MiTek Industries, Inc. Wed Mar 24 15:09:24 2021 Page 1  
ID:oc86cjOn3j\_xrZlawBNe\_4zXIAc-77vPKsFm9CnZ6ydk17ZH16r55Wjlqb?294?PJozXiAP

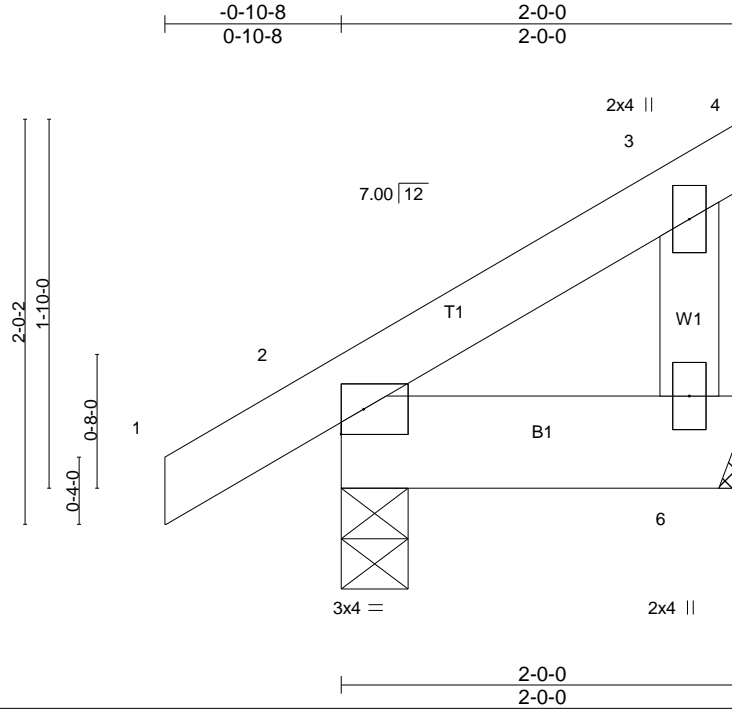

Scale = 1:11.4

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.04	Vert(LL)	-0.00	2	>999	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.04	Vert(CT)	-0.00	2	>999		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.01	Horz(CT)	0.00		n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-P	Wind(LL)	0.00	2	>999	Weight: 11 lb	FT = 20%
	Code IRC2015/TPI2014							

**LUMBER-**

TOP CHORD 2x4 SP No.1  
BOT CHORD 2x6 SP No.1  
WEBS 2x4 SP No.2

**BRACING-**

TOP CHORD Structural wood sheathing directly applied or 2-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.**

(size) 2=0-4-0 (min. 0-1-8), 5=Mechanical  
Max Horz 2=54(LC 12)  
Max Uplift 2=-9(LC 12), 5=-22(LC 12)  
Max Grav 2=144(LC 1), 5=65(LC 19)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**


- 1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=18ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Exterior(2) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 5.
- 6) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard

Job J0321-1553	Truss X2GE	Truss Type GABLE	Qty 2	Ply 1	LOT 7 WOODBURY FARM Job Reference (optional)
-------------------	---------------	---------------------	----------	----------	---

Comtech, Inc., Fayetteville, NC 28309, Bob Lewis

Run: 8.300 s Mar 22 2019 Print: 8.300 s Mar 22 2019 MiTek Industries, Inc. Wed Mar 24 15:09:24 2021 Page 1  
ID:oc86cjOn3j\_xrZlawBNe\_4zXIAC-77vPKsFm9CnZ6ydk17ZH16r55Wjlqb?294?PJozXiAP

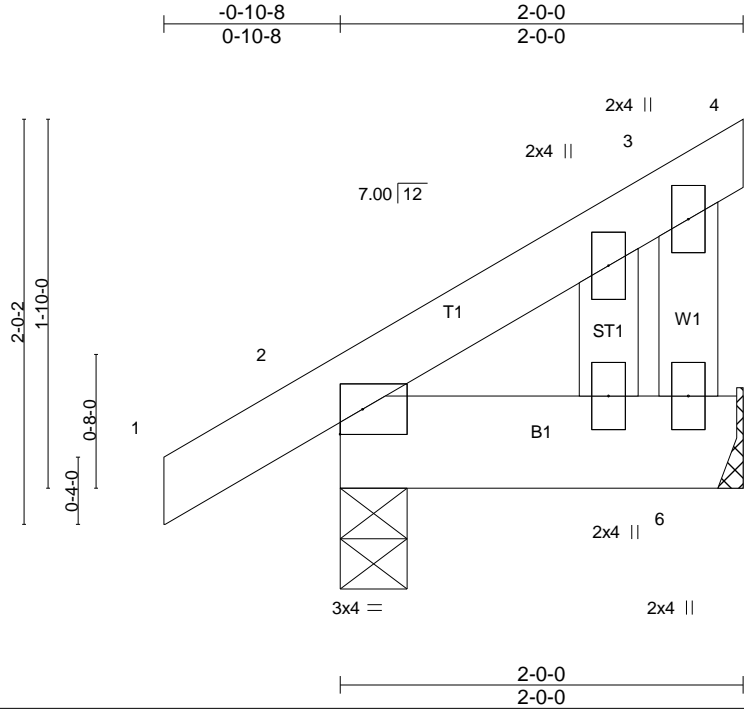

Scale = 1:11.4

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.04	Vert(LL) -0.00	2	>999	360	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.04	Vert(CT) -0.00	2	>999	240		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.01	Horz(CT) 0.00		n/a	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-P	Wind(LL) 0.00	2	>999	240		
	Code IRC2015/TPI2014						Weight: 12 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SP No.1  
BOT CHORD 2x6 SP No.1  
WEBS 2x4 SP No.2  
OTHERS 2x4 SP No.2

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 2-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 2=0-4-0 (min. 0-1-8), 5=Mechanical  
Max Horz 2=79(LC 12)  
Max Uplift 2=-33(LC 12), 5=-41(LC 12)  
Max Grav 2=144(LC 1), 5=67(LC 19)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**


- 1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=18ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) Gable studs spaced at 1-4-0 oc.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Refer to girder(s) for truss to truss connections.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 5.
- 8) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard

Job J0321-1553	Truss X3GE	Truss Type GABLE	Qty 1	Ply 1	LOT 7 WOODBURY FARM Job Reference (optional)
-------------------	---------------	---------------------	----------	----------	---

Comtech, Inc., Fayetteville, NC 28309, Bob Lewis

Run: 8.300 s Mar 22 2019 Print: 8.300 s Mar 22 2019 MiTek Industries, Inc. Wed Mar 24 15:09:25 2021 Page 1  
ID:oc86cjOn3j\_xrZlawBNe\_4zXIAC-bJTnXCGOwVvQk6Cxaq4WZJNEjw2YZ1sBOKkzrFzXIAO

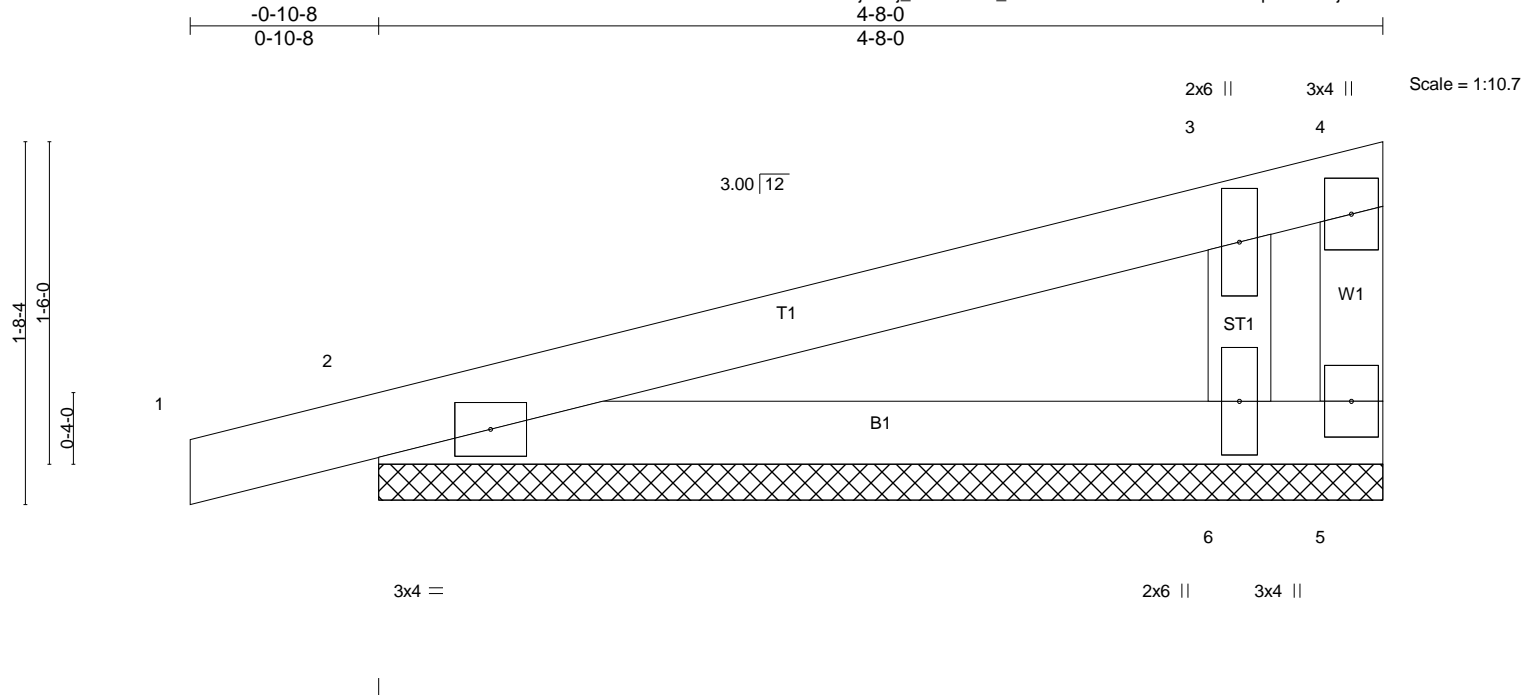

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 20.0	2-0-0	TC 0.18	Vert(LL) -0.00	1	n/r	120	MT20	244/190
TCDL 10.0	Plate Grip DOL 1.15	BC 0.10	Vert(CT) 0.00	1	n/r	120		
BCLL 0.0 *	Lumber DOL 1.15	WB 0.10	Horz(CT) 0.00		n/a	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-P						
	Code IRC2015/TPI2014						Weight: 18 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SP No.1  
BOT CHORD 2x4 SP No.1  
WEBS 2x4 SP No.2  
OTHERS 2x4 SP No.2

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 4-8-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** (size) 5=4-8-0 (min. 0-1-8), 2=4-8-0 (min. 0-1-8), 6=4-8-0 (min. 0-1-8)  
Max Horz 2=69(LC 8)  
Max Uplift 5=-221(LC 1), 2=-84(LC 8), 6=-148(LC 12)  
Max Grav 5=70(LC 12), 2=187(LC 1), 6=449(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 4-5=-276/158  
WEBS 3-6=-326/567

**NOTES-**

- 1) Wind: ASCE 7-10; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=18ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) Gable requires continuous bottom chord bearing.
- 4) Gable studs spaced at 1-4-0 oc.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) \* This truss has been designed for a live load of 30.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2 except (jt=lb) 5=221, 6=148.
- 8) This truss is designed in accordance with the 2015 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard