Residence for

Garman Homes Lot 0271 Serenity Fuquay Varina, North Carolina

INDEX TO DRAWINGS

SD2

- COVER SHEET FRONT & LEFT SIDE ELEVATIONS REAR & RIGHT SIDE ELEVATIONS FIRST & SECOND FLOOR PLANS
- FIRST & SECOND FLOOR ELECTRICAL PLANS
- FIRST & SECOND FLOOR MECHANICAL PLANS FIRST FLOOR PLUMBING PLAN
- D CONSTRUCTION DETAILS

GENERAL NOTES

1. ALL WORK TO BE DONE IN STRICT ACCORDANCE WITH NORTH CAROLINA STATE RESIDENTIAL BUILDING CODE, 2018 EDITION (HEREWITH SHOWN AS N.C.S.R.B.C.).

2. DIMENSIONS SHOWN ON DRAWINGS GOVERN OVER SCALE.

3. STUD WALL DESIGN SHALL CONFORM TO ALL N.C.S.R.B.C. REQUIREMENTS

4. CONTRACTOR SHALL USE TEMPERED SAFETY GLASS IN ALL LOCATIONS AS REQUIRED BY N.C.S.R.B.C., 2018 EDITION, SECTION R308.4.

5. ANY HABITABLE ROOM SHALL MEET ALL LIGHT/VENTILATION AND EGRESS AS REQUIRED BY N.C.S.R.B.C. 2018 EDITION, SECTIONS R-303.1 AND R-310.1

6. ALL EXTERIOR WALLS SHOWN ON FLOOR PLANS ARE 2X6 FRAME UNLESS NOTED OTHERWISE. ALL INTERIOR WALLS SHOWN ON FLOOR PLANS ARE 2X4 FRAME UNLESS NOTED OTHERWISE

7. ALL ANGLED WALLS SHOWN ON FLOOR PLANS ARE 45 UNLESS NOTED OTHERWISE.

8. ALL WINDOWS SHALL HAVE A MINIMUM DPI RATING OF 25. BUILDER SHALL VERIFY WITH WINDOW MANUFACTURER THAT UNITS INSTALLED MEET THESE REQUIREMENTS AS PER N.C.S.R.B.C., 2018 EDITION, TABLE 301.2(4).

9. ENERGY EFFICIENCY REQUIREMENTS FOR THE SPECIFIC CLIMATE ZONE WHERE STRUCTURE IS BEING BUILT SHALL BE IN ACCORDANCE WITH CHAPTER 11 OF THE N.C.S.R.B.C., 2018 EDITION, AS SHOWN IN SECTION N1101.2

MATERIALS LEGEND

TOILET ACCESSORIES LEGEND

PROVIDE 2X4 BLOCKING IN THE WALL FOR THE FOLLOWING:

MEDICINE CABINET

MAGAZINE RACK

TOWEL RING

TOWEL BAR TOILET PAPER HOLDER

EARTH/COMPACT

FILL

CONCRETE

CONCRETE

BLOCK/STONE

TP TR

MC

MR

BRICK

STEEL

FINISH WOOD

ROUGH WOOD

BLOCKING

PLYWOOD

RIGID INSULATION

BATT INSULATION

 h_{00000}

FOUNDATION PLAN - CRAWLSPACE STANDARD S1 S2 S3 FIRST FLOOR FRAMING PLAN SECOND FLOOR FRAMING ROOF FRAMING PLAN S4 S5

- OPTIONAL IN-LAW SUITE DETAILS SD1
 - STRUCTURAL DETAILS
 - STRUCTURAL DETAILS STRUCTURAL DETAILS
- SD3 SPEC CONSTRUCTION SPECIFICATIONS

RESIDENTIAL BUILDING CODE SUMMARY

1. PLANS ARE DESIGNED TO THE 2018 N.C.S.R.B.C.

2. HOUSE IS DESIGNED FOR 115 MPH ULTIMATE DESIGN WIND SPEED (89 MPH NOMINAL DESIGN WIND SPEED), EXPOSURE B.

3. ANCHOR BOLTS SHALL BE MIN. 1/2" DIAMETER AND SHALL EXTEND 7" MIN. INTO MASONRY OR CONCRETE. BOLTS TO BE NO MORE THAN 6' O.C. AND WITHIN 12" FROM THE CORNER.

- 4. MEAN ROOF HEIGHT: 29'-3"
- 5. COMPONENT & CLADDING DESIGNED FOR THE FOLLOWING LOADS:

MEAN ROOF HGT:	<u>UP TO 30'</u>	30'-1" TO 35'	<u>35'-1" TO 40'</u>	40'-1" TO 45'
ZONE 1	16.5,-18.0	17.3,-18.9	17.3,-18.9	17.3,-18.9
ZONE 2	16.5,-21.0	17.3,-22.1	17.3,-22.1	17.3,-22.1
ZONE 3	16.5,-21.0	17.3,-22.1	17.3,-22.1	17.3,-22.1
ZONE 4	18.0,-19.5	18.9,-20.5	18.9,-20.5	18.9,-20.5
ZONE 5	18.0,-24.1	18.9,-25.3	18.9,-25.3	18.9,-25.3

- 6. MINIMUM VALUES FOR ENERGY COMPLIANCE: Zone 4
- 7. MAXIMUM GLAZING U-FACTOR: .35
- 8. INSULATING VALUES: CEILING: R-49 / WALLS: R-15 / FLOOR: R-19 SLABS: R-10. CODE REFERENCE: TABLE N1102.1



HEATED (SQ. FT.)		UNHEATED (SQ. FT.)		UNFINISHED (SQ. FT.)	
BASEMENT: 1ST FLOOR: 2ND FLOOR:	N/A 894 750	GARAGE: FRONT PORCH: SCREEN PORCH:	280 38 100	BASEMENT: 1ST FLOOR: 2ND FLOOR: ATTIC:	N/A N/A N/A N/A
TOTAL:	1644	TOTAL:	418	TOTAL:	N/A
				WIDTH: DEPTH:	43'-0" 54'-0"
FOUNDATION VENTILATION CALCULATIONS					
(REFERENCE: N.C.S.R.B.C. 2018 EDITION SECTION R408)					

NOT APPLICABLE WITH SLAB FOUNDATIONS


ATTIC VENTILATION REQUIREMENTS


NATURAL ROOF VENTILATION CALCULATIONS MECHANICAL ROOF VENTILATION CALCULATIONS

1212 SQ. FT. = 8.08 SQ. FT. VENT REQ'D 150 BUILDER TO PROVIDE APPROPRIATE VENTILATING AS REQUIRED PER CODE

<u>1212 SQ. FT.</u> = 4.04 SQ. FT. VENT REQ'D 300 BUILDER TO PROVIDE APPROPRIATE VENTILATING AS REQUIRED PER CODE



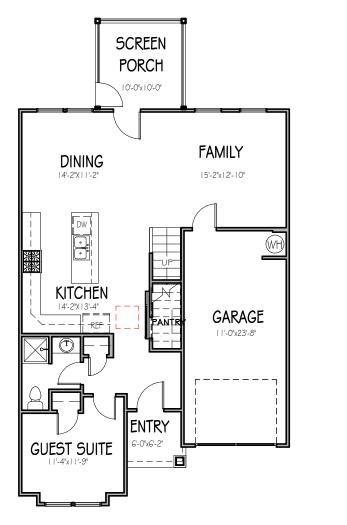

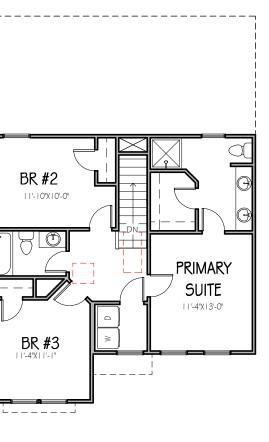




This document is property of Garman Homes Inc, and was prepared for their use only The plans, elevations, illustrations, and other material contained within this set may not be reproduced, either in part or wholly, in any manner without the express written permission of Garman Homes Inc. All right reserved and protected under federal law.



Drawn By	
MMH	
Checked By	
JM	
Date Drawn	
2/16/20	
Revision Date	
7/1/20	
4/5/22	
11/22/22	
2/21/23	

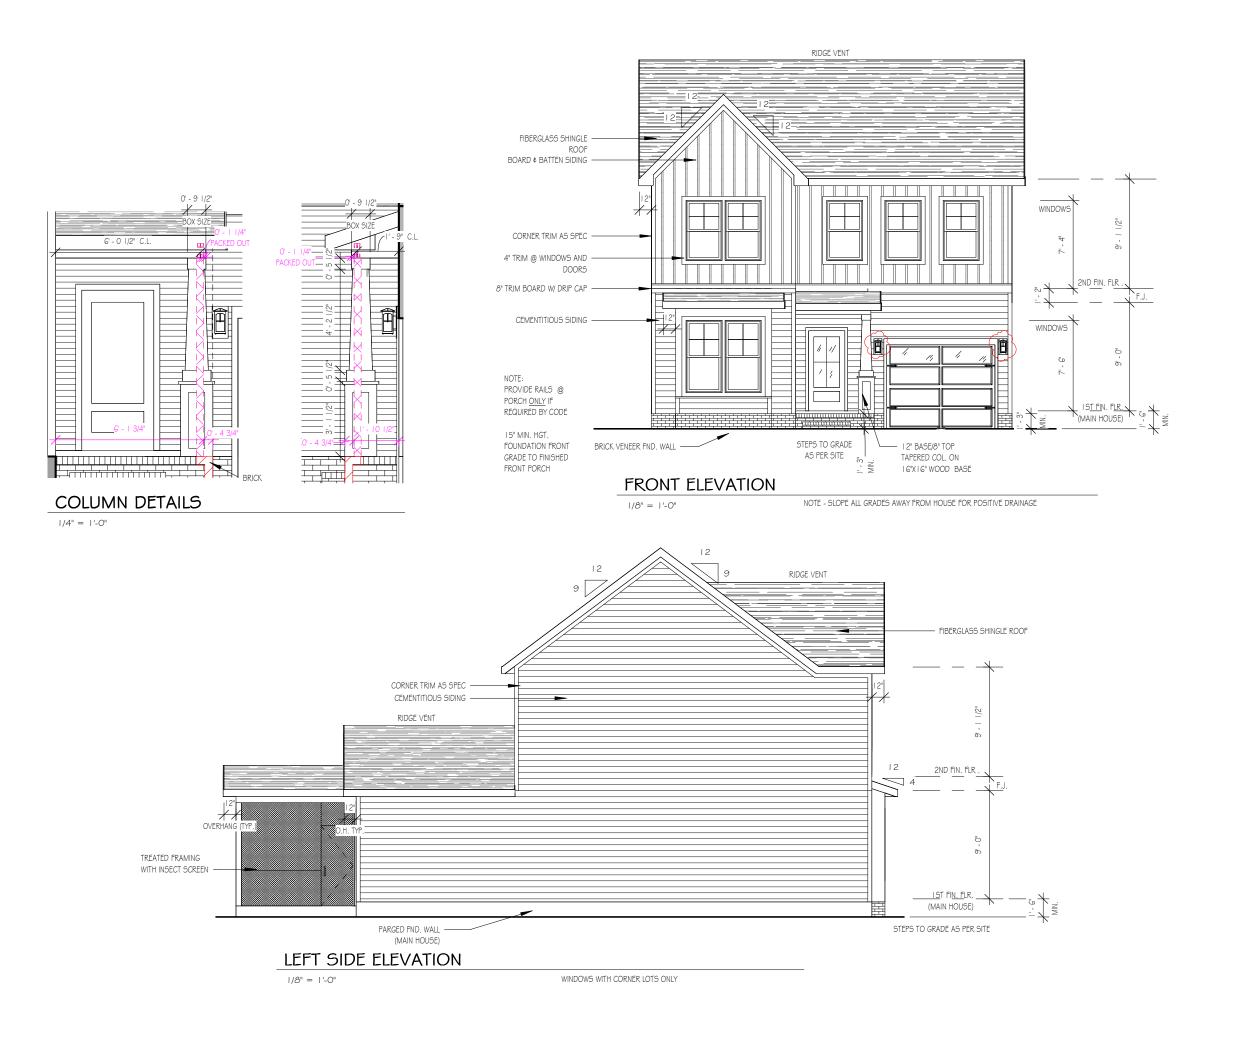

THE PURPOSE OF THESE DRAWINGS IS TO SHOW THE INTENT OF THE DESIGN AND CONSTRUCTION OF THIS HOME. CONTRACTOR SHOULD VERIFY ALL CONDITIONS AND DIMENSIONS PRIOR TO CONSTRUCTION. ONCE A PERMIT HAS BEEN ISSUED, CONTRACTOR SHALL ASSUME ALL RESPONSIBILITY TO THE ACCURACY OF THE PLANS AND ANY CHANGES MADE DURING CONSTRUCTION.




This document is property of Garman Homes Inc, and was prepared for their use only. The plans, elevations, illustrations, and other material contained within this set may not be reproduced, either in part or wholly, in any manner without the express written permission of Garman Homes, Inc. All right reserved and protected under federal law.

Project Number Project Number

Project Number
Plan Number
FP-1644



Drawn By
MH
Checked By
CM
Date Drawn
4/8/20
Revision Date
7/1/20
4/5/22
2/21/23

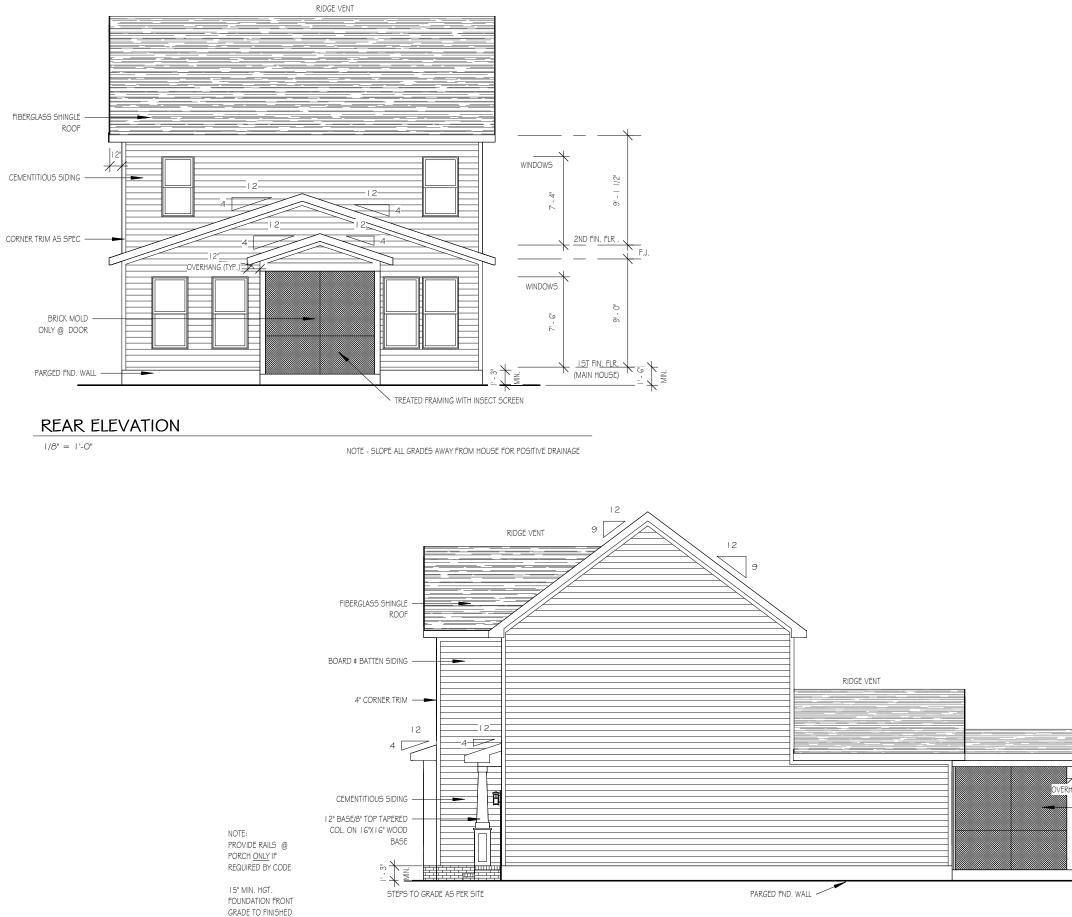

RIGHT SIDE ELEVATION

|/8" = |'-0"

FRONT PORCH

WINDOWS WITH CORNER LOTS ONLY

THE PURPOSE OF THESE DRAWINGS IS TO SHOW THE INTENT OF THE DESIGN AND CONSTRUCTION OF THIS HOME. CONTRACTOR SHOULD VERIFY ALL CONDITIONS AND DIMENSIONS PRIOR TO CONSTRUCTION. ONCE A PERMIT HAS BEEN ISSUED, CONTRACTOR SHALL ASSUME ALL RESPONSIBILITY TO THE ACCURACY OF THE PLANS AND ANY CHANGES MADE DURING CONSTRUCTION.



This document is property of Garman Homes Inc, and was prepared for their use only. The plans, elevations, illustrations, and other material contained within this set may not be reproduced, either in part or wholly, in any manner without the express written permission of Garman Homes, Inc. All right reserved and protected under federal law.

Project Number Project Number Plan Number


Plan Number	
FP-1644	




Drawn By
MH
Checked By
СМ
Date Drawn
4/8/20
Revision Date
7/1/20
4/5/22
2/21/23

Sheet

2



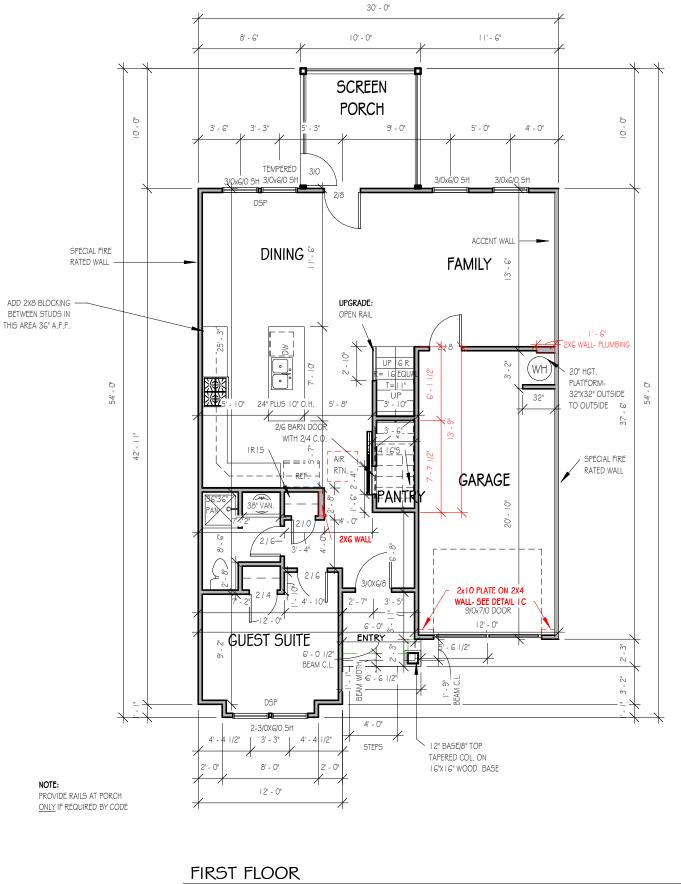

1/8" = 1'-0"

9'-0" CLG. HGT. U.N.O. SET WINDOWS @ 7'-6" U.N.O.

NOTES:

ROUGH FRAME ALL CASED OPENINGS 2" BIGGER THAN FINISHED OPENING CALLS FOR

ROUGH FRAME ALL WINDOW OPENINGS 1/2" LARGER THAN FINISHED WINDOW CALLS FOR, WHEN PAIRED WITH ANOTHER WINDOW THAT CALLS FOR DSP, ADD EXTRA TO OUTSIDE MEASUREMENT OF WINDOW

FRAME ALL INTERIOR DOOR HEADERS AT 84" A.F.F.

ALL EXTERIOR WALLS 2X4

TOP OF ALL WINDOWS SILLS SHALL BE 24" MINIMUM ABOVE THE FINISHED FLOOR <u>OR</u> A FALL PREVENTION DEVICE SHALL BE INSTALLED IN ACCORDANCE WITH SECTION R312.2 OF N.C.S.R.B.C., 2018 EDITION

GBG (GRILLS BETWEEN GLASS) TO BE ADDED TO CORNER LOT WINDOWS

THE PURPOSE OF THESE DRAWINGS IS TO SHOW THE INTENT OF THE DESIGN AND CONSTRUCTION OF THIS HOME. CONTRACTOR SHOULD VERIFY ALL CONDITIONS AND DIMENSIONS PRIOR TO CONSTRUCTION. ONCE A PERMIT HAS BEEN ISSUED, CONTRACTOR SHALL ASSUME ALL RESPONSIBILITY TO THE ACCURACY OF THE PLANS AND ANY CHANGES MADE DURING CONSTRUCTION.



This document is property of Garman Homes Inc, and was prepared for their use only. The plans, elevations, illustrations, and other material contained within this set may not be reproduced, either in part or wholly, in any manner without the express written permission of Garman Homes, Inc. All right reserved and protected under federal law.


Project Number Project Number Plan Number FP-1644



Drawn By	
MH	
Checked By	
CM	
Date Drawn	1
4/8/20	
Revision Da	te
7/1/20	
4/5/22	
2/21/23	

Sheet

3

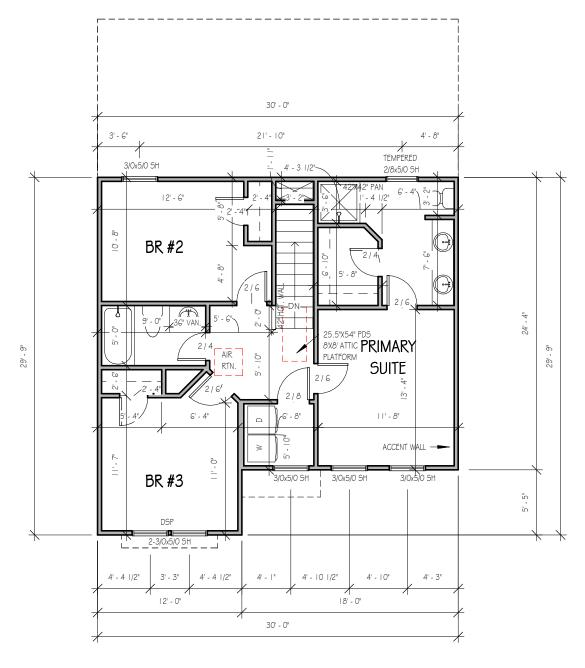

SECOND FLOOR

1/8" = 1'-0"

9'-0" CLG. HGT. U.N.O. SET WINDOWS @ 7'-4" U.N.O. ROUGH FRAME ALL CASED OPENINGS 2" BIGGER

THAN FINISHED OPENING CALLS FOR

NOTES:

ROUGH FRAME ALL WINDOW OPENINGS 1/2" LARGER

THAN FINISHED WINDOW CALLS FOR, WHEN PAIRED

WITH ANOTHER WINDOW THAT CALLS FOR DSP, ADD EXTRA TO OUTSIDE MEASUREMENT OF WINDOW

FRAME ALL INTERIOR DOOR HEADERS AT 84" A.F.F.

TOP OF ALL WINDOWS SILLS SHALL BE 24" MINIMUM

ABOVE THE FINISHED FLOOR OR A FALL PREVENTION DEVICE SHALL BE INSTALLED IN ACCORDANCE WITH SECTION R312.2 OF N.C.S.R.B.C., 2018 EDITION

ALL EXTERIOR WALLS 2X4

THE PURPOSE OF THESE DRAWINGS IS TO SHOW THE INTENT OF THE DESIGN AND CONSTRUCTION OF THIS HOME. CONTRACTOR SHOULD VERIFY ALL CONDITIONS AND DIMENSIONS PRIOR TO CONSTRUCTION. ONCE A PERMIT HAS BEEN ISSUED, CONTRACTOR SHALL ASSUME ALL RESPONSIBILITY TO THE ACCURACY OF THE PLANS AND ANY CHANGES MADE DURING CONSTRUCTION.




This document is property of Garman Homes Inc, and was prepared for their use only. The plans, elevations, illustrations, and other material contained within this set may not be reproduced, either in part or wholly, in any manner without the express written permission of Garman Homes, Inc. All right reserved and protected under federal law.

Project Number

Project Number
Plan Number
FP-1644



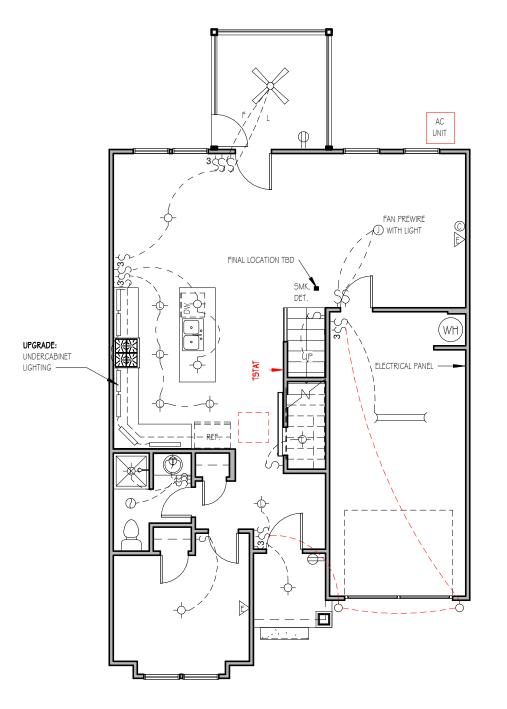


**NOTE: THREE ETHERNET OUTLETS IN THESE PREDETERMINED LOCATIONS ARE STANDARD. ANY ADDITIONAL OUTLETS ARE AN UPGRADE.

FIRST FLOOR ELECTRICAL PLAN

1/8" = 1'-0"


NOTE - ELECTRICAL RECEPTACLE AND SWITCH QUANTITIES AND LOCATIONS SHOWN ON PLAN ARE FOR ILLUSTRATION PURPOSES ONLY. ACTUAL NUMBER AN D LOCATIONS SHALL BE FIELD DETERMINED AS PER CLIENT AND BUILDER EXCEPT WHERE CODE REQUIREMENTS APPLY.

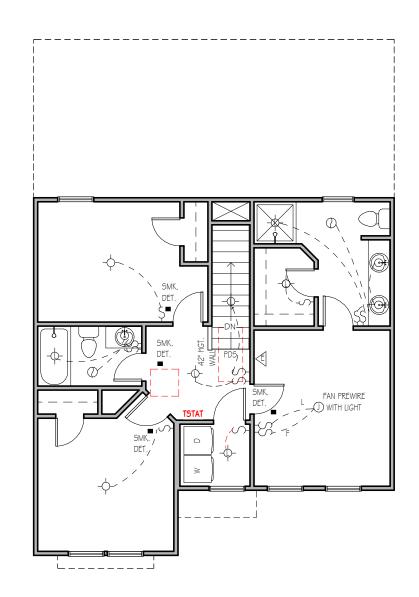

SECOND FLOOR ELECTRICAL PLAN

|/8" = |'-0"


NOTE - ELECTRICAL RECEPTACLE AND SWITCH QUANTITIES AND LOCATIONS SHOWN ON PLAN ARE FOR ILLUSTRATION PURPOSES ONLY. ACTUAL NUMBER AN D LOCATIONS SHALL BE FIELD DETERMINED AS PER CLIENT AND BUILDER EXCEPT WHERE CODE REQUIREMENTS APPLY. THE PURPOSE OF THESE DRAWINGS IS TO SHOW THE INTENT OF THE DESIGN AND CONSTRUCTION OF THIS HOME. CONTRACTOR SHOULD VERIFY ALL CONDITIONS AND DIMENSIONS PRIOR TO CONSTRUCTION. ONCE A PERMIT HAS BEEN ISSUED, CONTRACTOR SHALL ASSUME ALL RESPONSIBILITY TO THE ACCURACY OF THE PLANS AND ANY CHANGES MADE DURING CONSTRUCTION.

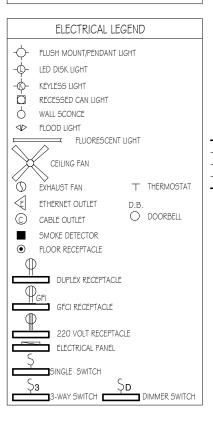



This document is property of Garman Homes Inc, and was prepared for their use only. The plans, elevations, illustrations, and other material contained within this set may not be reproduced, either in part or wholly, in any manner without the express written permission of Garman Homes, Inc. All right reserved and protected under federal law.


Project Number
Project Number
Plan Number
FP-1644



SER ELEVATION A LOT 0271 SERENITY

Drawn By
MH
Checked By
CM
Date Drawn
4/8/20
Revision Date
7/1/20
4/5/22
2/21/23



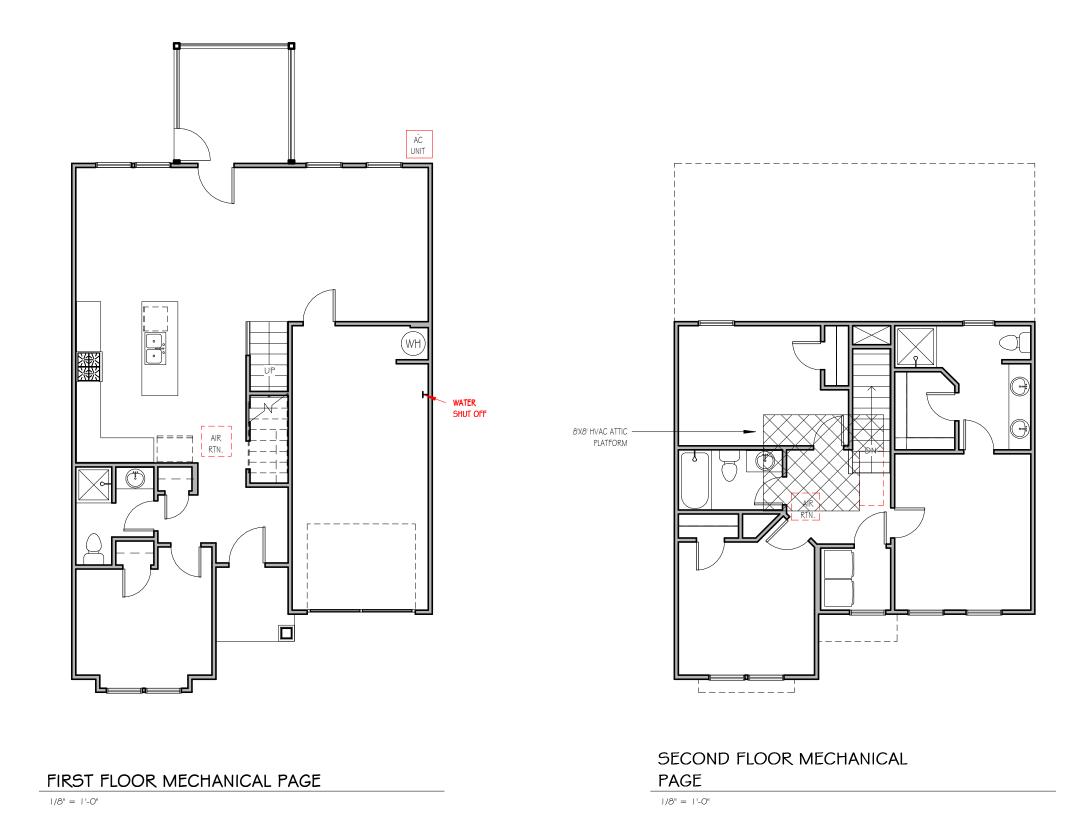

THE PURPOSE OF THESE DRAWINGS IS TO SHOW THE INTENT OF THE DESIGN AND CONSTRUCTION OF THIS HOME. CONTRACTOR SHOULD VERIFY ALL CONDITIONS AND DIMENSIONS PRIOR TO CONSTRUCTION. ONCE A PERMIT HAS BEEN ISSUED, CONTRACTOR SHALL ASSUME ALL RESPONSIBILITY TO THE ACCURACY OF THE PLANS AND ANY CHANGES MADE DURING CONSTRUCTION.



This document is property of Garman Homes Inc, and was prepared for their use only. The plans, elevations, illustrations, and other material contained within this set may not be reproduced, either in part or wholly, in any manner without the express written permission of Garman Homes, Inc. All right reserved and protected under federal law.

Project Number

Project Number
Plan Number
FP-1644




Drawn By
MH
Checked By
CM
Date Drawn
4/8/20
Revision Date
7/1/20
4/5/22
2/21/23

Sheet

M



1/8" = 1'-0"

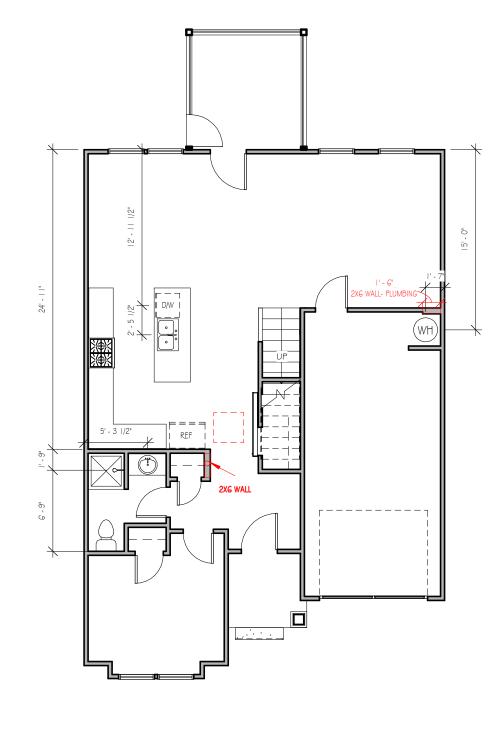

THE PURPOSE OF THESE DRAWINGS IS TO SHOW THE INTENT OF THE DESIGN AND CONSTRUCTION OF THIS HOME. CONTRACTOR SHOULD VERIFY ALL CONDITIONS AND DIMENSIONS PRIOR TO CONSTRUCTION. ONCE A PERMIT HAS DEFENJED.CONTRACTOR SHALL BEEN ISSUED, CONTRACTOR SHALL ASSUME ALL RESPONSIBILITY TO THE ACCURACY OF THE PLANS AND ANY CHANGES MADE DURING CONSTRUCTION.



This document is property of Garman Homes Inc, and was prepared for their use only. The plans, elevations, illustrations, and other material contained within this set may not be reproduced, either in part or wholly, in any manner without the express written permission of Garman Homes, Inc. All right reserved and protected under federal law.


Project Number

Project Number
Plan Number
FP-1644



Drawn By
MH
Checked By
CM
Date Drawn
4/8/20
Revision Date
7/1/20
4/5/22
2/21/23

Ρ

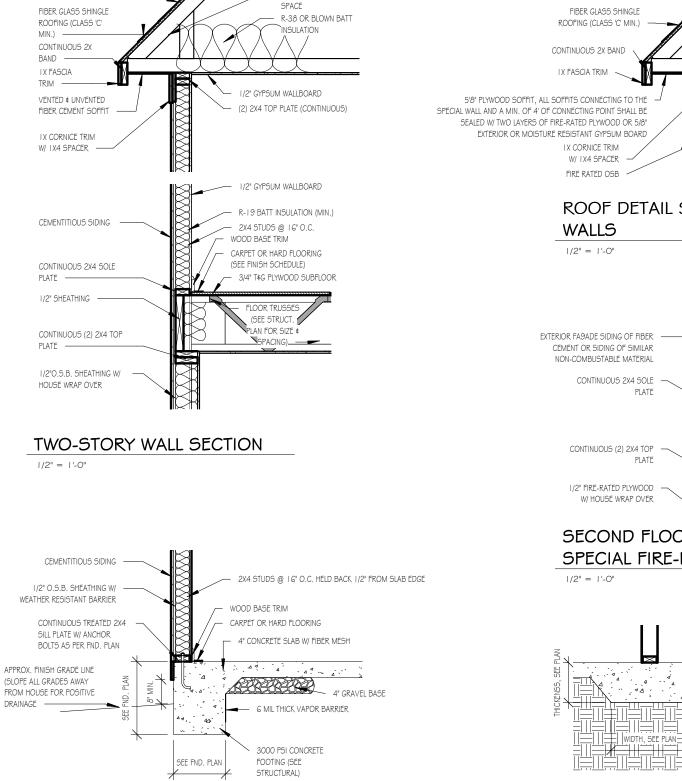

ROOF TRUSSES PER TRUSS

MAINTAIN 2" CLEAR AIR

MANUFACTURER

FOUNDATION DETAIL - SLAB

1/2" = 1'-0"

5/8" PLYWOOD


AT JOINTS


DECKING W/ PLY CLIPS

15# BLDG. PAPER

UNDER SHINGLES

1/2" = 1'-0"



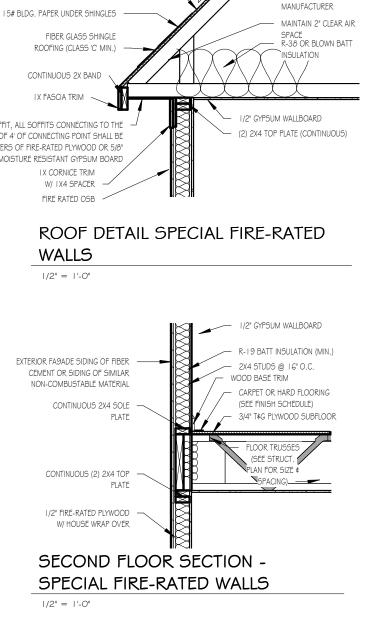

ROOF TRUSSES PER TRUSS

1/2" FIRE-RATED PLYWOOD -

FROM WALL ASSEMBLY

DECKING W/ PLY CLIPS AT JOINTS

EXTENDING AMIN. OF 4' AWAY

1/2" = 1'-0"

FRONT PORCH COLUMNS SUPPORT ATTACHMENT


Sheet

Drawn By
ММН
Checked By
JM
Date Drawn
10/28/20
Revision Date
9/14/22
9/20/22





FRESH : PAINT
• P A I IN I by Garman Homes
This document is property of Garman Homes Inc, and was prepared for their use only. The plans, elevations, illustrations, and other material contained within this set may not be reproduced, either in part or wholly, in any manner without the express written permission of Garman Homes, Inc. All right reserved and protected under federal law.
Project Number
Project Number
Plan Number

THE PURPOSE OF THESE DRAWINGS IS TO SHOW THE INTENT OF THE DESIGN AND CONSTRUCTION OF THIS HOME. CONTRACTOR SHOULD VERIFY ALL CONDITIONS AND DIMENSIONS PRIOR TO CONSTRUCTION. ONCE A PERMIT HAS BEEN ISSUED, CONTRACTOR SHALL ASSUME ALL RESPONSIBILITY TO THE ACCURACY OF THE PLANS AND ANY CHANGES MADE DURING CONSTRUCTION.

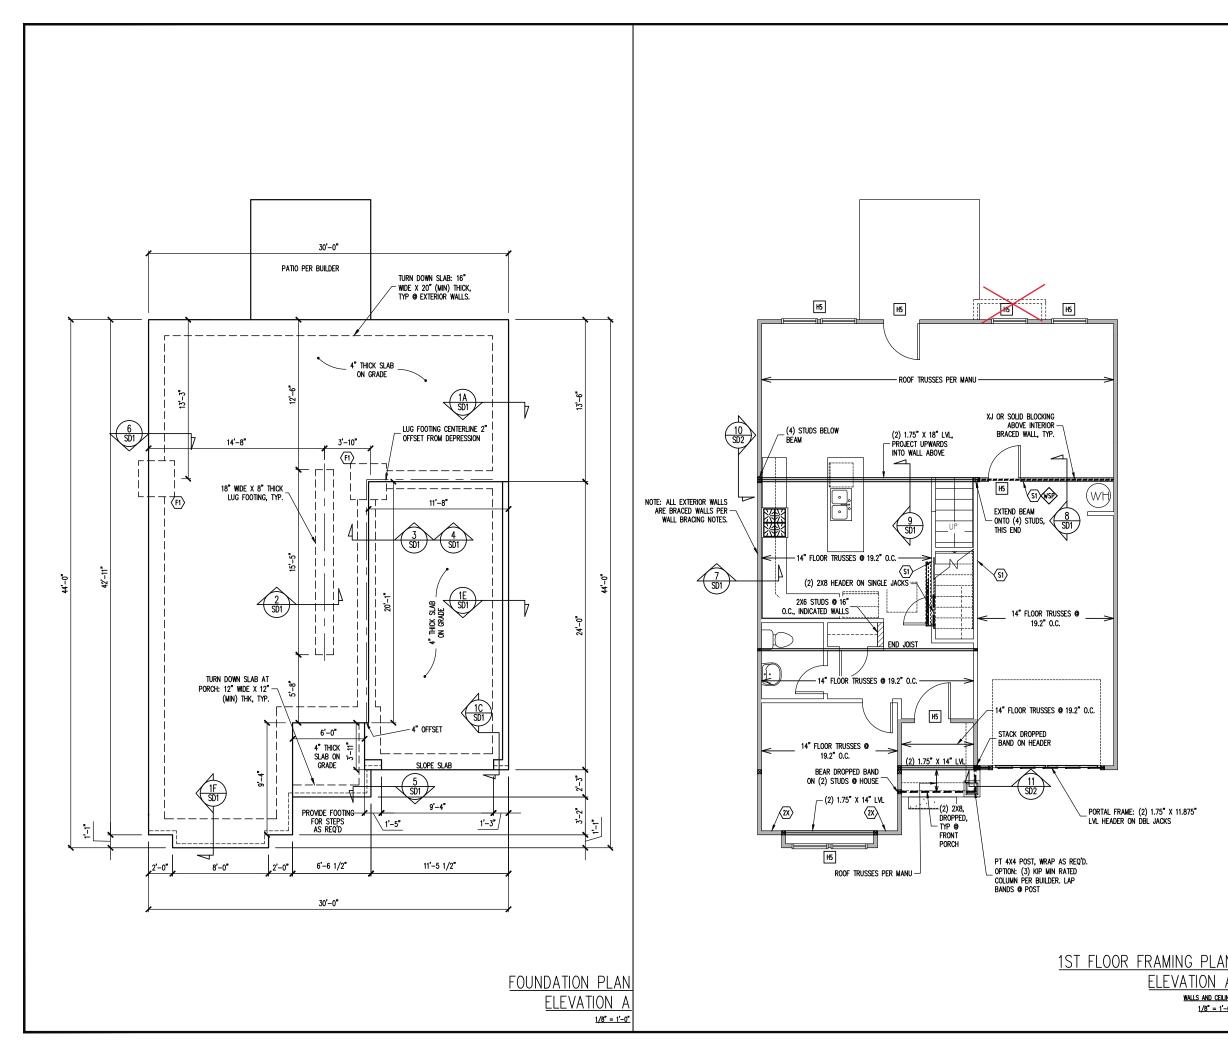



FRAMING SCEDULE S1 INTERIOR LOAD BEARING WALL: SECURE TO THICKENED SLAB BELOW WITH 1/2"\$ RED HEADER ANCHOR (OR EQUAL) @ 6'-0" O.C., 12" MAX FROM ENDS / CORNERS OF WALL, 7" MIN EMBEDMENT INTO SLAB BELOW. JOIST SUBSTITUTION 14" FLOOR TRUSSES PERMITTED TO BE SUBSTITUTED WITH 14" 1-JOISTS. MAINTAIN MINIMUM SPACING AS CALLED OUT ON	SEAL CARD		
PLANS. SIMP. IUS/ITS3.56/14 HANGERS TO BE SUBSTITUTED WITH SIMP. IUS/ITS2.06/14 HANGER WHEN I-JOISTS HAVE BEEN INSTALLED. CONSTRUCTION SPECIFICATIONS INSTANT REFERENCES REFER TO THE CONSTRUCTION SPECIFICATIONS SECTIONS FOR THE FOLLOWING INFORMATION: PART 1.01: CURRENT GOVERNING CODE PART 1.4: STUD SUPPORT FOR BEAMS PART 1.7: KING STUDS FOR EXTERIOR WALLS SEE DETAIL / CONSTRUCTION SPECIFICATIONS SHEETS FOR I-JOISTS ALLOWABLE SUBSTITUTIONS WALL BRACING SHADED WALLS:	Engineering Tech Associates, P.A. assumes no from Engineering Tech Associates, P.A. Ingineering STRUCTURAL ENGINEERS 318 W Millbrook Rd, Suite 201 ASSOCIATES, P.A. Phone (979) 844-1661		
ALL EXTERIOR STUD WALLS, EXTERIOR SIDE, ARE TO BE CONTINUOUSLY SHEATHED WITH 7/16 APA RATED OSB NALED TO STUDS WITH 8d NAILS @ 6° O.C. AT PANEL EDGES, 12° O.C. IN PANEL FIELD. WSP – ONE SIDE OF INTERIOR WALL OR INSIDE OF EXTERIOR WALL WITH 3/6° MIN. THICKNESS WOOD STRUCTURAL PANELING, ATTACH WSP TO STUD WALL WITH 3/6° MIN. THICKNESS WOOD STRUCTURAL PANELING, ATTACH WSP TO STUD WALL WITH 8/6 NAILS @ 4° O.C. AT PANEL EDGES, 8° O.C. IN PANEL FIELD. 2X – SHEATH BOTH SIDES OF STUD WALL WITH 7/6 APA RATED CSB, NAILED TO STUDS WITH 8d NAILS @ 6° O.C. AT PANEL EDGES, 12° O.C. IN PANEL FIELD. NOTES: PROVIDED CONTINUOUS SHEATHING = 155' MIN. REFERENCE PART 16.02 OF CONSTRUCTION SPECIFICATIONS FOR GENERAL WIND BRACING INFORMATION. <u>HEADER SCHEDULE</u> H1 SINGLE 2X4 TURNED FLAT (A) H2 (2) 2X4'S ON SINGLE JACKS (B) H3 (2) 2X10'S ON SINGLE JACKS (C) H4 (2) 1.75" X 9.25" LVL'S ON DEL JACKS H5 (2) 2X8'S ON SINGLE JACKS (A) TYPICAL FOR INTERIOR NON LOAD BEARING	LONLY. In or permitting takes place more than 1 year after the seal date without written permission RESH PAINT SCOPE STRUCTURAL ADDENDUM LOC TBD PLAN: FORCET ME NOT PLAN: FORCET ME NOT		
WALLS ONLY, ROUGH OPENING 38" MAX. (B) TYPICAL FOR INTERIOR NON LOAD BEARING WALLS ONLY, ROUGH OPNG 38" TO 74" MAX. (C) TYPICAL FOR ALL CONDITIONS NOT LISTED IN (A) OR (B) UNO. NOTES: -HEADERS IN NON LOAD BEARING INTERIOR WALLS ARE NOT LABELED. FOUNDATION SCHEDULE	DATE 4/17/2023		
F1 ENLARGE FOOTING TO 36" SQ. X 12" THK 	PROJECT NO. 23-30-027 SHEET NO. SHEET NO. SHEET NO. SHEET NO. SHEET NO. SHEET NO. SHEET NO. SHEET NO. SHEET NO.		

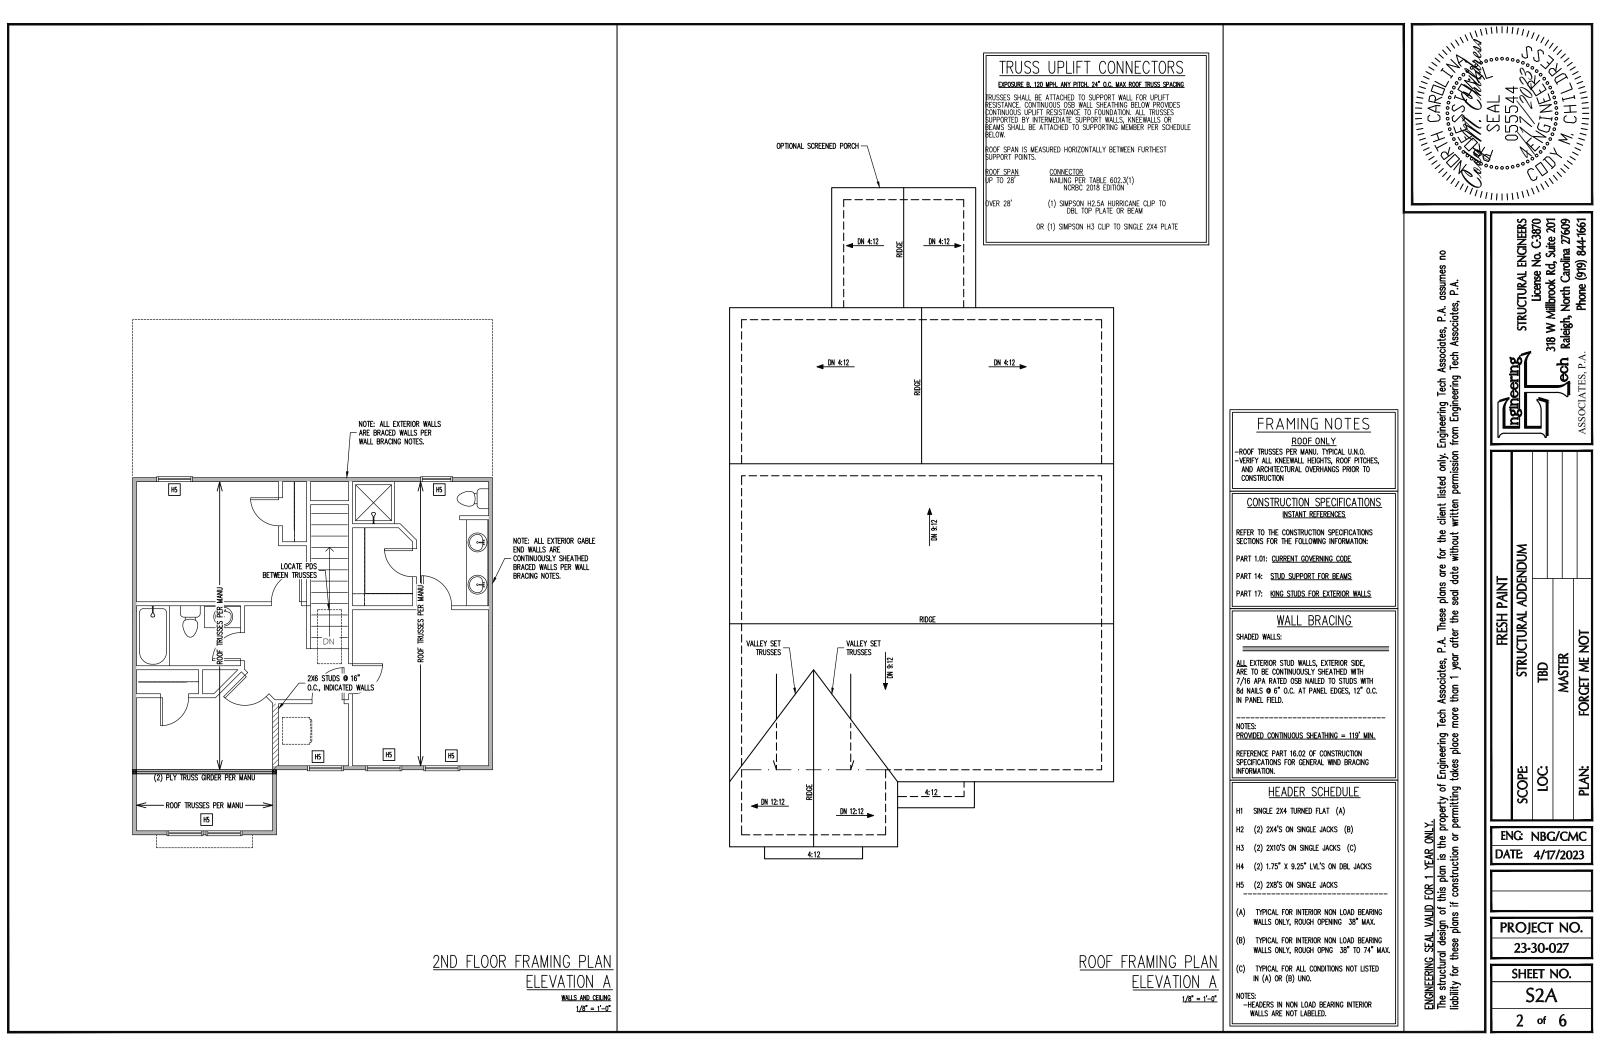

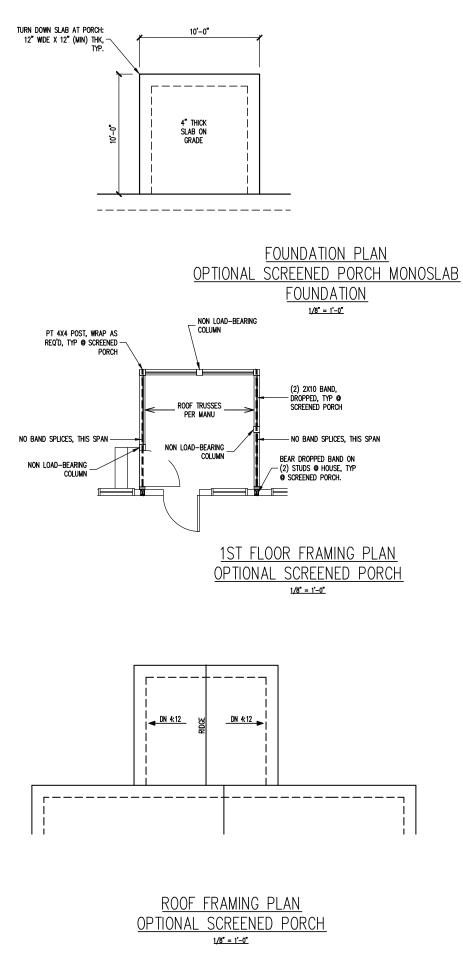




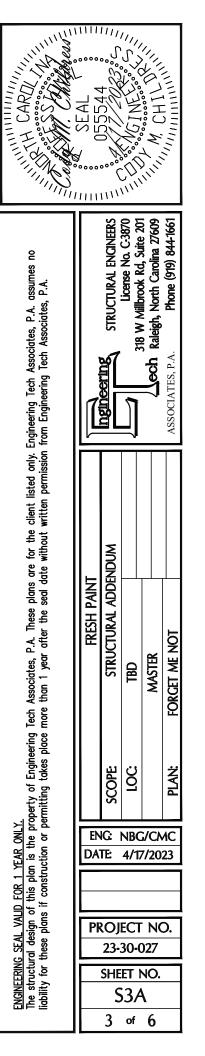

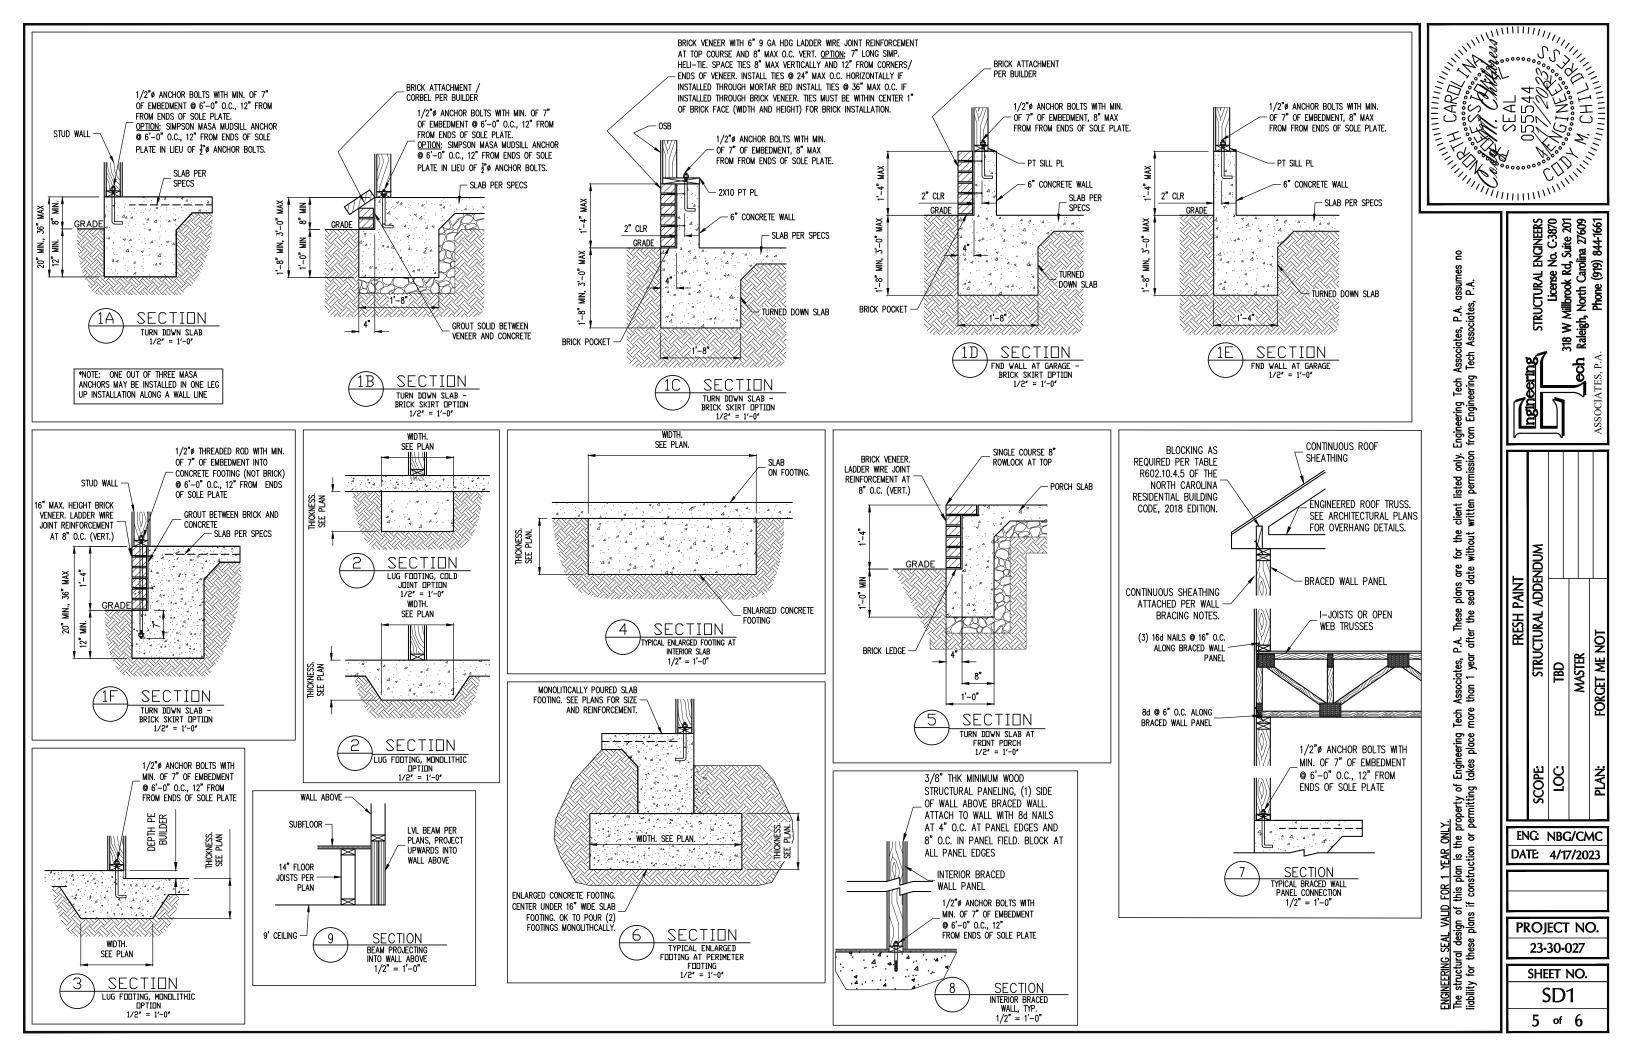

		VERT 2X4. ONE		
	SPECIFICATIONS	SIDE OF BEAM		
PART 1: GENERAL 1.01 CONSTRUCTION SHALL MEET THE REQUIREMENTS OF THE NORTH CAROLINA RESIDENTIAL CODE, 2018 EDITION.	1-WHEN THE BEAM IS PERPENDICULAR TO, OR SKEWED RELATIVE TO THE WALL, THE BEAM SHALL BEAR FULL WIDTH ON THE SUPPORTING WALL NOICATED AND SHALL BE SUPPORTED BY A MINIMUM OF THREE GANGED STUDS, OR A GANGED STUD COLUMN IS AL LEAST AS WODE AS THE TRUE WIDTH OF THE BEAM BEING SUPPORTED, WHICHEVER IS GREATER, TYP UNO. FOR THE SKEWED	(2) ROWS OF 10d NAILS @ 2" O.C. VIII BEAM PER PLAN	(2) CONT. 2X TOP PLATES, EXTEND EACH END INTO ADJACENT WALL. NAIL SPLICES WITH 8–16d NAILS PER SPLICE/LAP.	
 1.02 DIMENSIONS SHOWN SHALL GOVERN OVER SCALE ON THESE DRAWINGS. 1.05 METHODS, PROCEDURES AND SEQUENCES OF CONSTRUCTION ARE THE RESPONSIBILITY OF THE CONTRACTOR, WHO SHALL TAKE ALL NECESSARY PRECAUTIONS TO MAINTAIN AND INSURE THE INTEGRITY OF THE STRUCTURE AT ALL STAGES OF CONSTRUCTION. 	CONDITION PARTICULAR CARE SHALL BE TAKEN TO ENSURE STUD COLUMN IS CENTERED ON THE BEAM 2-BEAMS BEARING ONTO THE END OF A STUD WALL PARALLEL TO THE BEAM SHALL BEAR A MINIMUM OF 4 1/2" ONTO THE WALL AND BE SUPPORTED BY A TRPL STUD GANGED COLUMN TYP UNO.			
PART 2: DESIGN LOADS	14.02 DIMENSIONAL LUMBER BEAMS BEARING ON A STUD WALL SHALL BEAR AS FOLLOWS:		7/16" O.S.B. OR 15/32" PLYWOOD EXTERIOR WALL	
2.01 DESIGN LOADS SHALL CONFORM WITH THE TABLE BELOW: USE LIVE LOAD (PSF) DEAD LOAD (PSF) BALCONIES, DECKS, ATTICS WITH FIXED STAIR	1-WHEN THE BEAM IS PERPENDICULAR TO, OR SKEWED RELATIVE TO THE WALL, THE BEAM SHALL BEAR <u>FULL WIDTH</u> ON THE SUPPORTING WALL INDICATED (LESS 1 1/2 ⁻ TO ALLOW FOR A CONTINUOUS RIM JOIST WHERE APPLICABLE) AND SHALL BE SUPPORTED BY A GANGED STUD COLUMN THE SAME WIDTH AS THE BEAM TYP UNO. (E.G. A TRIPLE 2X10 IS TO BE SUPPORTED BY (3) STUDS). FOR THE SKEWED CONDITION PARTICULAR CARE SHALL	SUPPORTING	SHEATHING AT UNSHADED AREAS (BEAM, INFILL WALL ABOVE BEAM, AND CENTER WALL). NAIL SHEATHING TO ALL SUPPORTS (STUDS, PLATES, BLOCKING, ETC.) WITH 8d NAILS AT 6" O.C. AT	
ACCESS, DWELLING UNITS INCLUDING ATTICS WITH FIXED STAIR ACCESS, STAIRS, FIRE ESCAPES 40 10 GARAGES (PASSENGER CARS ONLY) 50 ATTICS (NO STORAGE, LESS THAN 5' HEADROOM) 10 10	BE TAKEN TO ENSURE STUD COLUMN IS CENTERED ON THE BEAM 2-BEAMS BEARING ONTO THE END OF A STUD WALL PARALLEL TO THE BEAM SHALL BEAR A MINIMUM OF 3" ONTO THE WALL AND BE SUPPORTED BY A DBL STUD GANGED COLUMN TYP UNO.	10 SECTION REINFORCEMENT OF BEAM	SHEET EDGES AND 12" O.C. IN THE FIELD.	
ATTICS (WTH STORAGE) 20 10 ROOF 20 10 (15 FOR VAULTS)	14.03 EXTRA JOISTS BEARING ON A STUD WALL PERPENDICULAR TO OR SKEWED RELATIVE TO THE BEAM SHALL BE SUPPORTED BY ONE ADDITIONAL STUD.	FOR BEARING AT TOP PL 1/2" = 1'-0"	WHERE FULL HEIGHT PANEL WIDTH	
NOTES: - INDIVIDUAL STAIR TREADS ARE TO BE DESIGNED FOR THE UNIFORMLY DISTRIBUTED LIVE LOAD OF 40 PSF OR A 300 LB. CONCENTRATED LOAD ACTING OVER AN AREA OF 4 SQ. WHICHEVER PRODUCES THE GREATER STRESS. - BUILDER TO VERIFY DEAD LOAD DOES NOT EXCEED 10 PSF WHEN HEAVY FLOOR OR ROOF FINISHES SUCH AS TILE OR SLATE ARE UTILIZED. NOTIFY ENGINEERING UNDER	14.04 STUDS THAT ARE GANGED TO FORM A COLUMN SHALL HAVE ADJACENT STUDDS WITHIN THE COLUMN NAILED TOGETHER WITH ONE ROW OF 10d NAILS AT 8" O.C. (TWO ROWS OF 10d NAILS @ 8" O.C., 3" APART, FOR 2X8 OR 2X10 STUDS) ALL COLUMNS SHALL BE CONTINUOUS DOWN TO THE FOUNDATION OR OTHER PROPERLY DESIGNED STRUCTURAL ELEMENT SUCH AS A BEAM. COLUMNS TRANSFERRING LOADS THROUGH FLOOR LEVELS SHALL BE SOLIDLY BLOCKED FOR THE FULL WIDTH OF THE STUD COLUMN			
THESE CONDITIONS	WITHIN THE CAUTY FORMED BY THE FLOOR JOISTS.		PANEL EDGES SHALL OCCUR OVER AND BE NAILED TO COMMON BLOCKING AND	
2.02 INTERIOR WALLS: 5 PSF LATERAL. 2.03 BASIC WIND DESIGN VELOCITY OF 120 MPH.	PART 15: NAILING OF MULTI PLY WOOD BEAMS		OCCUR WITHIN MIDDLE 24" OF WALL	
2.03 BASIC WIND DESIGN VELOCITI OF 120 WHT. 2.04 SOIL BEARING CAPACITY 2000 PSF (PRESUMPTIVE). PART 5: CONCRETE AND SLABS ON GRADE	15.01 SOLD SAWN LUMBER JOISTS THAT ARE GANGED TO FORM A BEAM SHALL HAVE ADJACENT MEMBERS IN THE BEAM NAILED TOGETHER WITH THREE ROWS OF 100 NAILS ● 16" O.C. FOR 2X10 OR LARGER, TWO ROWS OF 100 NAILS ● 16" O.C. FOR 2X8, ONE ROW OF 100 NAILS ● 16" O.C. FOR 2X6 OR SMALLER. STAGGER ROWS 5" MIN.		HEIGHT. ONE ROW OF 3" O.C. NAILING IS REQUIRED IN EACH PANEL EDGE. 7/16" O.S.B. OR 15/32" PLYWOOD	
5.01 CAST IN PLACE CONCRETE SHALL BE OF NORMAL WEIGHT, 6% AIR ENTRAINMENT, AND SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI AT 28 DAYS TYP UNO. ALL CONCRETE, INCLUDING CONCRETE FOR FOOTINGS, IS TO BE CAST IN PLACE, TYP UNO.	15.02 LV. MEMBERS THAT ARE GANGED TO FORM A BEAM SHALL HAVE ADJACENT MEMBERS IN THE BEAM FASTENED TOGETHER PER MANUFACTURERS RECOMMENDATIONS, TYP UNO PART 16: WALL FRAMING AND BRACING		EXTERIOR WALL SHEATHING. AT SHADED AREAS NAIL SHEATHING TO ALL SUPPORTS (STUDS, PLATES, BLOCKING, ETC.) WITH 8d	
5.03 SLABS ON GRADE, IF ANY, SHALL CONTAIN SYNTHETIC POLYPROPYLENE FIBRILLATED	16.01 STUD WALLS SHALL CONSIST OF 2X4 STUDS SPACED AT 16" O.C. UNO. STUDS SHALL		NAILS AT 3" O.C.	
MICRO FIBERS, FIBER LENGTH 1 1/2", DOSAGE RATE 1 1/2 LBS/CU YD. SLAB TO BE PLACED ON A 6 MIL VAPOR BARRIER ON 2" MIN GRANULAR FILL ON SOIL WITH 90% MIN STANDARD PROCTOR DENSITY. VAPOR BARRIER MAY BE OMITTED FOR SLABS NOT IN ENCLOSED AREAS	BE CONTINUOUS FROM SOLE PLATE AT FLOOR TO DOUBLE TOP PLATE AT THE CELING OR ROOF. NO INTERMEDIATE BANDS OR PLATES SHALL CAUSE DISCONTINUITIES IN A STUD WALL EXCEPT AS REQUIRED FOR DOOR OR WINDOW OPENINGS. THE KING STUDS FOR SUCH OPENINGS SHALL BE CONTINUOUS, TYP UND. MAX ALLOWABLE WALL HEIGHTS FOR EXTERIOR STUD WALLS, WITH SOLE PLATE		(2)2x STUD MIN. AT START AND END OF WALL SEGMENTS EACH SIDE OF OPENING.	
PART 7: MASONRY 7.03 MORTAR SHALL BE TYPE S. MORTAR AND GROUT SHALL CONFORM TO ASTM C476, MIN	AND DBL TOP PLATE AND $7/16^{\circ}$ OSB exterior bracing and row of 2x4 / 2x6 purlins at 8' height (and at 16' height for tall walls), typ uno:		SEE PLANS FOR ADDITIONAL STUDS	
7.05 LADDER WIRE REINFORCEMENT SHALL CONFORM TO ASTM C470, MINU COMPRESSIVE STRENGTH OF 2000 PSI. 7.05 LADDER WIRE REINFORCEMENT SHALL CONFORM TO ASTM A951. 6" MIN LAPS FOR CONTINUOUS WALL APPLICATIONS	16.02 FOR WALL BRACING THE FOLLOWING SHALL APPLY: -BLOCKING AT UNSUPPORTED PANEL EDGES IS REQUIRED TYP UNO. -WALL BRACING IS BY ENGINEERED DESIGN AND NOT PRESCRIPTIVE PER SECTION 602.10 OF THE 2018 NGC. CONTINUOUS SHEATHING HAS BEEN PROVIDED, ALONG		2x4 P.T. PLATE WITH TWO 1/2" DIA x 7" EMBED ANCHOR BOLTS WITH A 3/16"x2"x2" PLATE WASHERS OR ADDITIONAL HOLDOWN PER PLANS.	
PART 8: BOLTS AND LAG SCREWS 8.03 ANCHOR RODS AND BOLTS SHALL CONFORM TO ASTM F1554-15 GRADE 36 UNO. BENT ANCHOR BOLTS SHALL HAVE A 2" MIN HOOK UNO	WITH ALTERNATIVE METHODS TO INSURE THE MINIMUM INTENT OF SECTION 602.10 OF THE 2018 NCRC HAS BEEN MET AND EXCEEDED. -BRACED WALL PANELS SHALL BE FASTENED IN ACCORDANCE WITH TABLE 602.3(1) TO PROVIDE CONTINUOUS PANEL UPLIFT RESISTANCE AND COMPLIANCE WITH NCRC ^C R602.35 AND R802.11 UNLESS NOTED OTHERWISE ON STRUCTURAL PLANS.		OPTION: (2) 5/8" DIA. THREADED RODS INSTALLED PER SECTION R602.10.4.3 OF THE NCRBC, LATEST EDITION.	4
PART 9: DRIVEN FASTENERS 9.01 NAILS, SPIKES AND STAPLES SHALL CONFORM TO ASTM F 1667- 05. NAILS ARE TO BE	MAY SUBSTITUTE WSP FOR GB SINGLE JOIST, CONTINUOUS RIM JOIST, OR BLOCKING OF EQUAL DEPTH IS REQUIRED ABOVE AND BELOW ALL BRACED WALLS. NAIL BLOCKING ABOVE WALL TO TOP PLATE WITH 16d TOE NAILS @ 6" O.C. NAIL SOLE PLATE OF BRACED WALL TO BLOCKING			1
COMMÓN WIRE OR BOX <u>Part 10: Dimensional Lumber</u>	BELOW WITH (3) 16d NAILS @ 16" O.C. BLOCKING AT HORIZONTAL JOINTS IN BRACED WALL LINES ONLY REQUIRED AT SHADED WALLS, UNO.		<u>NOTES</u>	
10.01 SOLID SAWN WOOD FRAMING DESIGN IS BASED ON NO. 2 SPRUCE PINE FIR \underline{OR} SYP #2 FOR JOISTS, RAFTERS, GIRDERS, BEAMS, STUDS, ETC.	PART 17: KING STUDS 17.01 KING STUDS FOR OPENINGS IN EXTERIOR WALLS SHALL BE AS FOLLOWS:	SHALL IMMEDIATEL	ESPONSIBLE FOR REVIEWING PLANS PRIOR TO CONSTRUCTION. THE BUILDER Y CONTACT THE ENGINEER OF RECORD (EOR) BEFORE PROCEEDING IF THE TIONS ARE NOTED BEFORE OR DURING CONSTRUCTION:	ABV ABOVE B. BOTH B.E. BOTH ENDS
PART 11: ENGINEERED LUMBER 11.01 LVL OR PSL MINIMUM ALLOWABLE DESIGN STRESSES ARE AS FOLLOWS:	NUMBER OF KING STUDS MAX OPENING WIDTH 5'-0" 9'-0" 13'-0" 17'-0" 21'-0"	1) THE WORKING	S PLANS DO NOT BEAR THE SEAL OF THE EOR CONTAIN DISCREPANT OR INCOMPLETE INFORMATION	BTWN BETWEEN CIP CAST IN PLACE CONC CONCRETE
E= 1.9 X 10E6 PSI, Fb = 2600 PSI, Fv = 285 PSI, Fc = 750 PSI LSL MINIMUM ALLOWABLE DESIGN STRESSES ARE AS FOLLOWS: E= 1.3 X 10E6 PSI, Fb = 1700 PSI, Fv = 400 PSI, Fc = 680 PSI 11.02 LVL OR PSL MEMBERS MAY BE RIPPED FROM DEEPER MEMBERS TO MATCH THE MEMBER	2X4 1 2 3 4 5 STUD SIZE 2X6 1 1 2 2 2 2X8 1 1 1 2 2 PART 18: SUBSTITUTIONS	RESPONSIBILITY OF	to a failure to follow the above procedures shall not be the F the Eor. Furthermore, it is the responsibility of the builder to Y revisions issued by the Eor are promply distributed to the	CS CONTINUOUS SHEA DIA DIAMETER DBL DOUBLE DJ DOUBLE JOIST
DEPTH SPECIFIED IN THE PLANS PART 12: PRESSURE TREATED LUMBER	18.01 MATERIAL OR MEMBER SIZE SUBSTITUTIONS OR PLAN DEVIATIONS REQUIRE THE WRITTEN AUTHORIZATION OF THE DESIGNERS. UNAUTHORIZED DEVIATIONS ARE THE SOLE	THE EOR DOES NO) DT PERFORM FENESTRATION OR VENTING CALCULATIONS OR ANY OTHER AT ARE NOT DIRECTLY RELATED TO STRUCTURAL ENGINEERING.	DSP DBL STUD POCKET EQ EQUAL EA EACH
12.01 LUMBER IN CONTACT WITH THE GROUND, CONCRETE OR MASONRY SHALL BE PRESSURE TREATED IN ACCORDANCE WITH AWPA STANDARD C-15. ALL OTHER EXPOSED LUMBER SHALL BE TREATED IN ACCORDANCE WITH AWPA STANDARD C-2 OR BY ANY METHOD SHALL BE TREATED IN ACCORDANCE WITH AWPA STANDARD C-2 OR BY ANY METHOD	RESPONSIBILITY OF THE CONTRACTOR. PART 19: OWNERSHIP OF STRUCTURAL DESIGN	ROOF AND FLOOR	TRUSSES TO BE DESIGNED BY AN ENGINEER REGISTERED BY THE STATE. FINAL SHOULD BE SUBWITTED TO THE EOR FOR REVIEW	FLG FLANGE FL PL FLITCH PLATE FLR FLOOR
GIVING EQUAL PROTECTION. THE BUILDING CODE OFFICE MAY ALSO APPROVE A NATURAL DECAY RESISTANT WOOD PER SECTION 19-6(A)	19.01 THE STRUCTURAL DESIGN OF THIS PLAN IS THE PROPERTY OF ENGINEERING TECH ASSOCIATES (ETA). THESE PLANS		WABLE I-JOIST SUBSTITUTION	
PART 14: STUD SUPPORTS FOR BEAMS 14.01 STEEL, ENGINEERED LUMBER, AND FLITCH PLATE BEAMS BEARING ON A STUD WALL SHALL BEAR AS FOLLOWS:	ARE FOR THE ONE TIME USE AT THE LOCATION INDICATED AND FOR THE CUENT LISTED. ETA ASSUMES NO LIABILITY FOR THESE PLANS IF THEY ARE REPRODUCED, IN WHOLE OR IN PART, FOR CONSTRUCTION AT ANY OTHER LOCATION WITHOUT WRITTEN PERMISSION FROM ETA		JOIST DEPTH, DIRECTION, AND SPACING SPECIFIED ON	
			SIMPSON FACE SIMPSON TOP DEPTH SERIES MOUNT HGR FLANGE HGR	
		BLUELINX BOISE CASCADE	14" BLI 40 IUS2.56/14 ITS2.56/14 14" BCI 5000s IUS2.06/14 ITS2.06/14	
		BOISE CASCADE 14" BCI 6000S IUS2.37/14 ITS2.37/14 LP CORP 14" LPI 20+ IUS2.56/14 ITS2.56/14		
		NORDIC ROSEBURG WEYERHAEUSER WEYERHAEUSER	14" NI 40X IUS2.56/14 ITS2.56/14 14" RFPI 40s IUS2.56/14 ITS2.56/14 14" TJI 210 IUS2.06/14 ITS2.06/14 14" EI 20 IUS2.05/14 ITS2.06/14	
			14" EEI-20 IUS2.37/14 ITS2.73/14 D IN THE ABOVE TABLE MAY BE USED PROVIDED THEY	
			THE PROPERTES OF THOSE LISTED. SUBSTITUTE USP WITH EQUIVALENT VALUES AS DESIRED.	

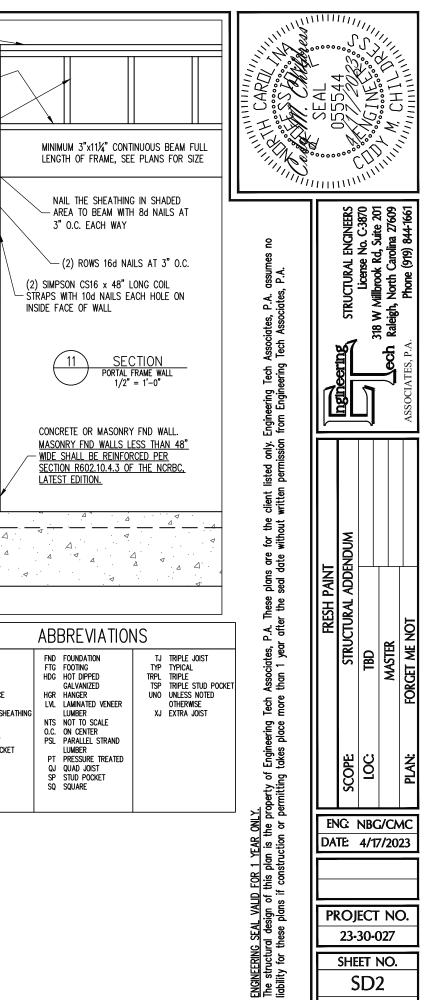

6 of 6