

HTE# _____

Harnett County Department of Public Health

No. 26579

PERMIT # SFD2309.0002

Operation Permit

New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: 56 Great Smokey Pl (SR 1516)

Name: (owner) DRB Homes N.C. LLC SUBDIVISION Blake Pond LOT # 101

System Installer: C+M Registration # _____

Basement with plumbing: Garage Number of Bedrooms 4 (8 people)

Type of Water Supply: Community Public Well Distance from well _____ feet


System Type: TYPE III G Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

* 12-22-23 (M Osborne RETS)
Retention Pond will have to be filled in to allow for usable repair area.

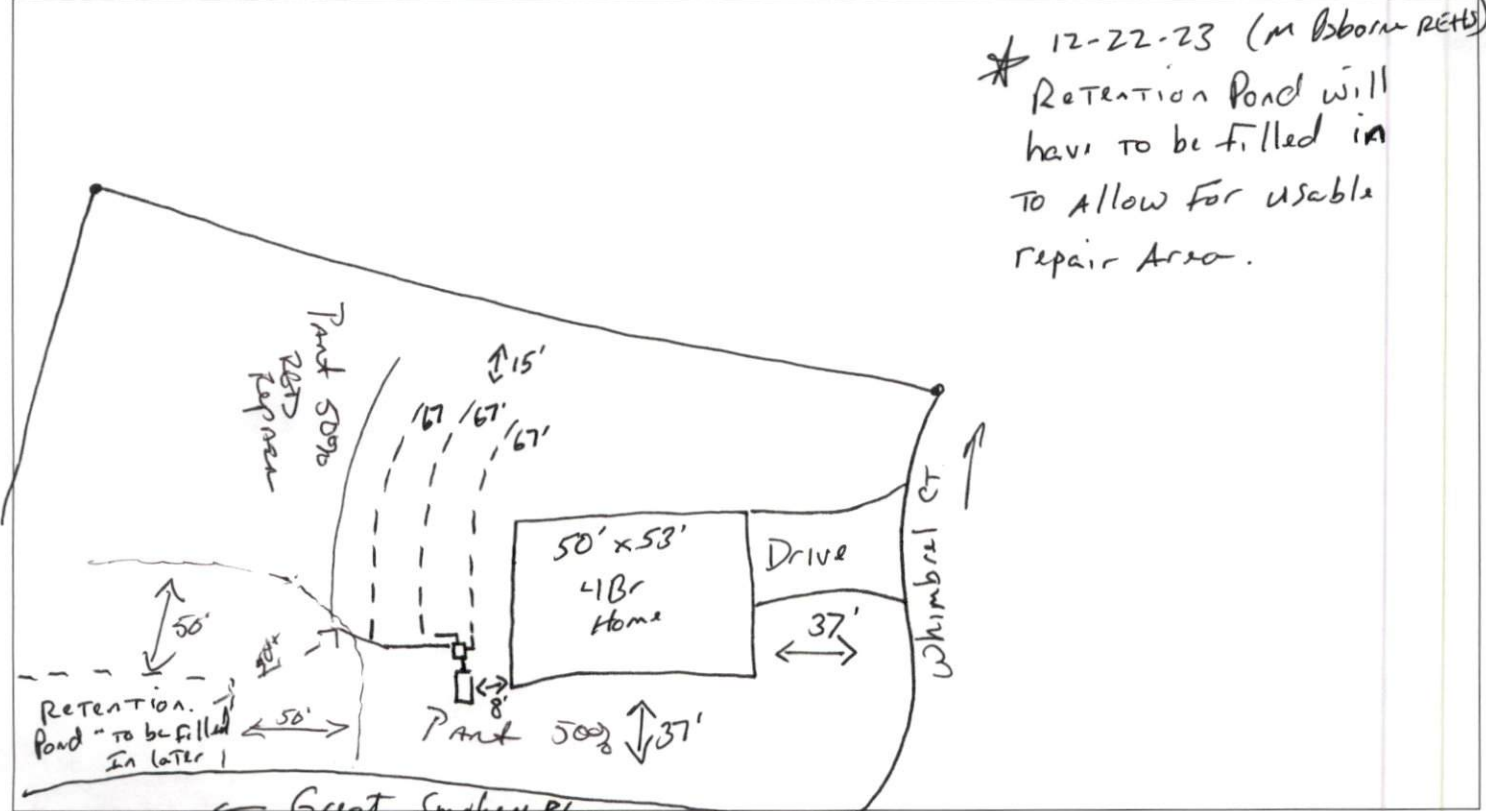

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.
- IV. Operation: _____
- V. Other: _____

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other 50% reduction PPBPS Septic Tank: 1000 gallons Pump Tank: _____ gallons
 Subsurface Drainage Field: No. of ditches 4 exact length of each ditch 67 feet width of ditches 3 feet depth of ditches 18 inches
 French Drain Required: _____ Linear feet

Authorized State Agent James E. Manhattan Date 1-2-24