



ECS Southeast, LLP

6151 Raeford Road, Suite A
Fayetteville, NC 28304
9104013288
9103230539

LETTER OF TRANSMITTAL

October 13, 2023
Precision Custom Homes

Raeford, NC 28376
ATTN: Shaun Gardner


RE: **Liberty Meadows Lot 41**
ECS Job # **33:6442-L**

Permits:
Location: **365 Solomon Rd**
Cameron, NC 28326

Field Reports For your use As requested

CC: Precision Custom Homes - Allen Peterson Precision Custom Homes - Lauren Ceruti

ENCL: Field Report # 1 10/12/2023

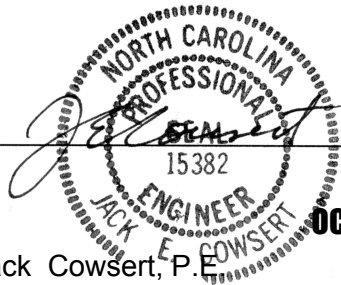

Jack Cowsert, P.E.
Office Manager

Aaron Kyle Adair
Team Leader

Disclaimer

1. This report (and any attachments) shall not be reproduced except in full without prior written approval of ECS.
2. The information in this report relates only to the activities performed on the report date.
3. Where appropriate, this report includes statements as to compliance with applicable project drawings, and specifications for the activities, performed on this report date.
4. Incomplete or non-conforming work will be reported for future resolution.
5. The results of samples and/or specimens obtained or prepared for subsequent laboratory testing will be presented in separate reports/documents.



ECS Southeast, LLP
 6151 Raeford Road, Suite A
 Fayetteville, NC 28304
 (910) 401-3288 [Phone]
 (910) 323-0539 [Fax]

FIELD REPORT

Project **Liberty Meadows Lot 41**
 Location **Cameron, NC**
 Client **Precision Custom Homes**
 Contractor **Precision Custom Homes**

Project No. **33:6442-L**
 Report No. **1**
 Day & Date **Thursday 10/12/2023**
 Weather **68 °/ Rain**
 On-Site Time **2.00**
 Lab Time **0.00**
 Travel Time* **0.00**
 Total **2.00**
 Re Obs Time **0.00**

Remarks

Trip Charges*	Tolls/Parking*	Mileage*	Time of Arrival	Departure
Chargeable Items			7:30A	9:30A

* Travel time and mileage will be billed in accordance with the contract.

Summary of Services Performed (field test data, locations, elevations & depths are estimates) & Individuals Contacted.

ECS arrived on site, as requested, to check the bearing capacity of soils via hand auger/DCP (ASTM STP-399) method for the monolithic slab foundation. Footings have not been excavated. Please see the attached sketch and data sheet for details.

A total of 4 hand auger/DCP evaluations were performed to a depth of approximately 3 feet below the current footing sub grade elevation. Test results indicated that the materials in place (at the locations and elevations tested) did appear to be suitable to support the design bearing capacity 2,000 psf.

Locations and elevations of all tests are based on stakeout provided by others. We cannot be responsible for structures located off of the observed engineered pad, misaligned utilities or stakeout errors causing uncontrolled fill to be placed in structural areas.

ECS will return for further testing.



Report of Spread Footing - Foundation Observations

Project: Liberty Meadows Lot 41
 Location: 365 Solomon Rd
 Cameron - Moore - NC - 28326
 Contractor: Precision Custom Homes

Project No.: 33:6442-L
 Day/Date: 10/12/2023

Footing Number	Location	Size (W x H x L)		Footing Bottom Elevation		Description of Steel Placed	Description of Subgrade Material	Required Blow Counts	Design Bearing Pressure
		Design	Actual	Design **	Depth of Undercut (in)			# of Blows / Increment	
1	S.W corner	x x	x x	N/A	N/A		(0)/ Orange Sand(-1)Orange Gray Sand(-2)/-3TanSand	6 (0)7,13,13(-1)10,14,15(-2)13,13,12(-3)11,11,11	2000
2	N.W corner	x x	x x	N/A	N/A		(0)/-1 Orange Sand(-2)/Orange Tan Sand(-3)/Tan Sand	6 (0)8,15,17(-1)15,11,10(-2)14,17,18(-3)8,7,5	2000
3	N.E corner	x x	x x	N/A	N/A		(0)/-1 Orange Sand(-2)/-3 gray tan sand	6 (0)6,9,15(-1)6,9,15(-2)18,22,18(-3)11,11,12	2000
4	S.E corner	x x	x x	N/A	N/A		(0)/-1 Orange Sand(-2)/-3 gray tan sand	6 (0)18,15,14(-1)15,14,13(-2)13,20,23(-3)13,15,13	2000

** SGE: Subgrade Elevation to be determined by surveyor.

By: George Pate Oxendine Jr.

ECS Southeast, LLP

WO: 74705