

THIS PLAN HAS BEEN DRAWN TO CONFORM TO THE 2018 NORTH CAROLINA RESIDENTIAL CODE


CONTRACTOR SHALL VERIFY ALL DIMENSIONS AND CONDITIONS PRIOR TO BEGINNING WORK. CONTRACTOR IS RESPONSIBLE FOR COMPLIANCE WITH ALL STATE AND LOCAL BUILDING CODES AND ORDINANCES. KADS CUSTOM HOME DESIGNS ASSUMES NO LIABILITY FOR SITE CONDITIONS, CONSTRUCTION METHODS OR ANY DEVIATION OF THESE PLANS.

NOTE:
ALL WINDOWS TO BE INSTALLED MUST MEET A MAXIMUM OF .32 U VALUE OR BETTER, UNLESS ENERGY CALCULATIONS ARE SUBMITTED WITH PLANS PROVIDED BY BUILDER AT TIME OF PLAN REVIEW.




FRONT ELEVATION

SCALE: 1/4"=1'-0"

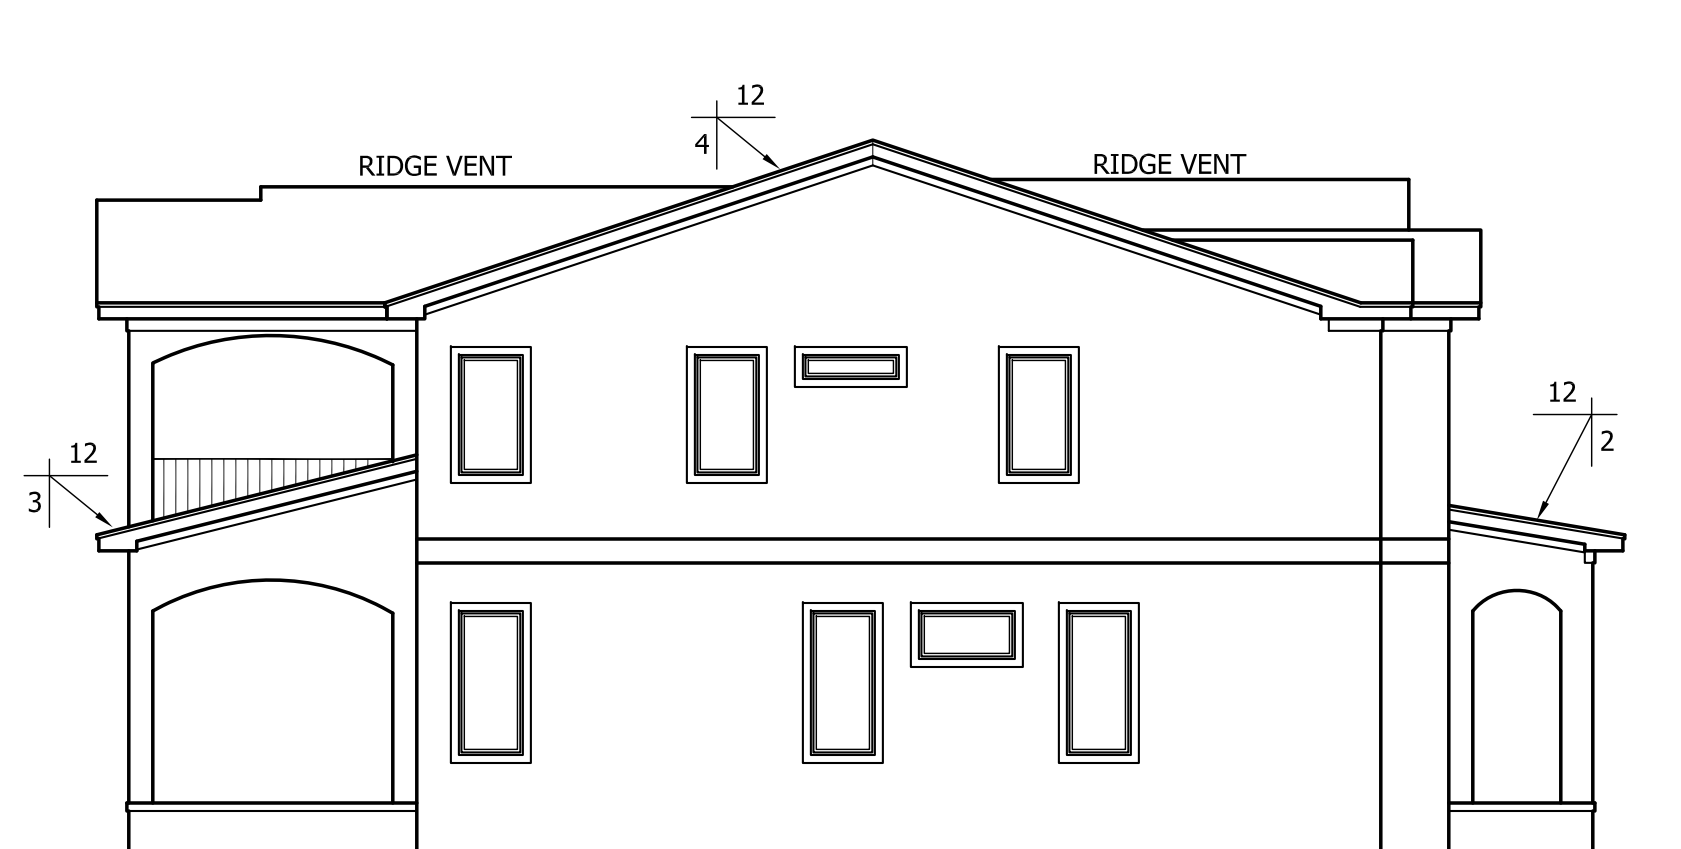


LEFT ELEVATION

SCALE: 1/8"=1'-0"

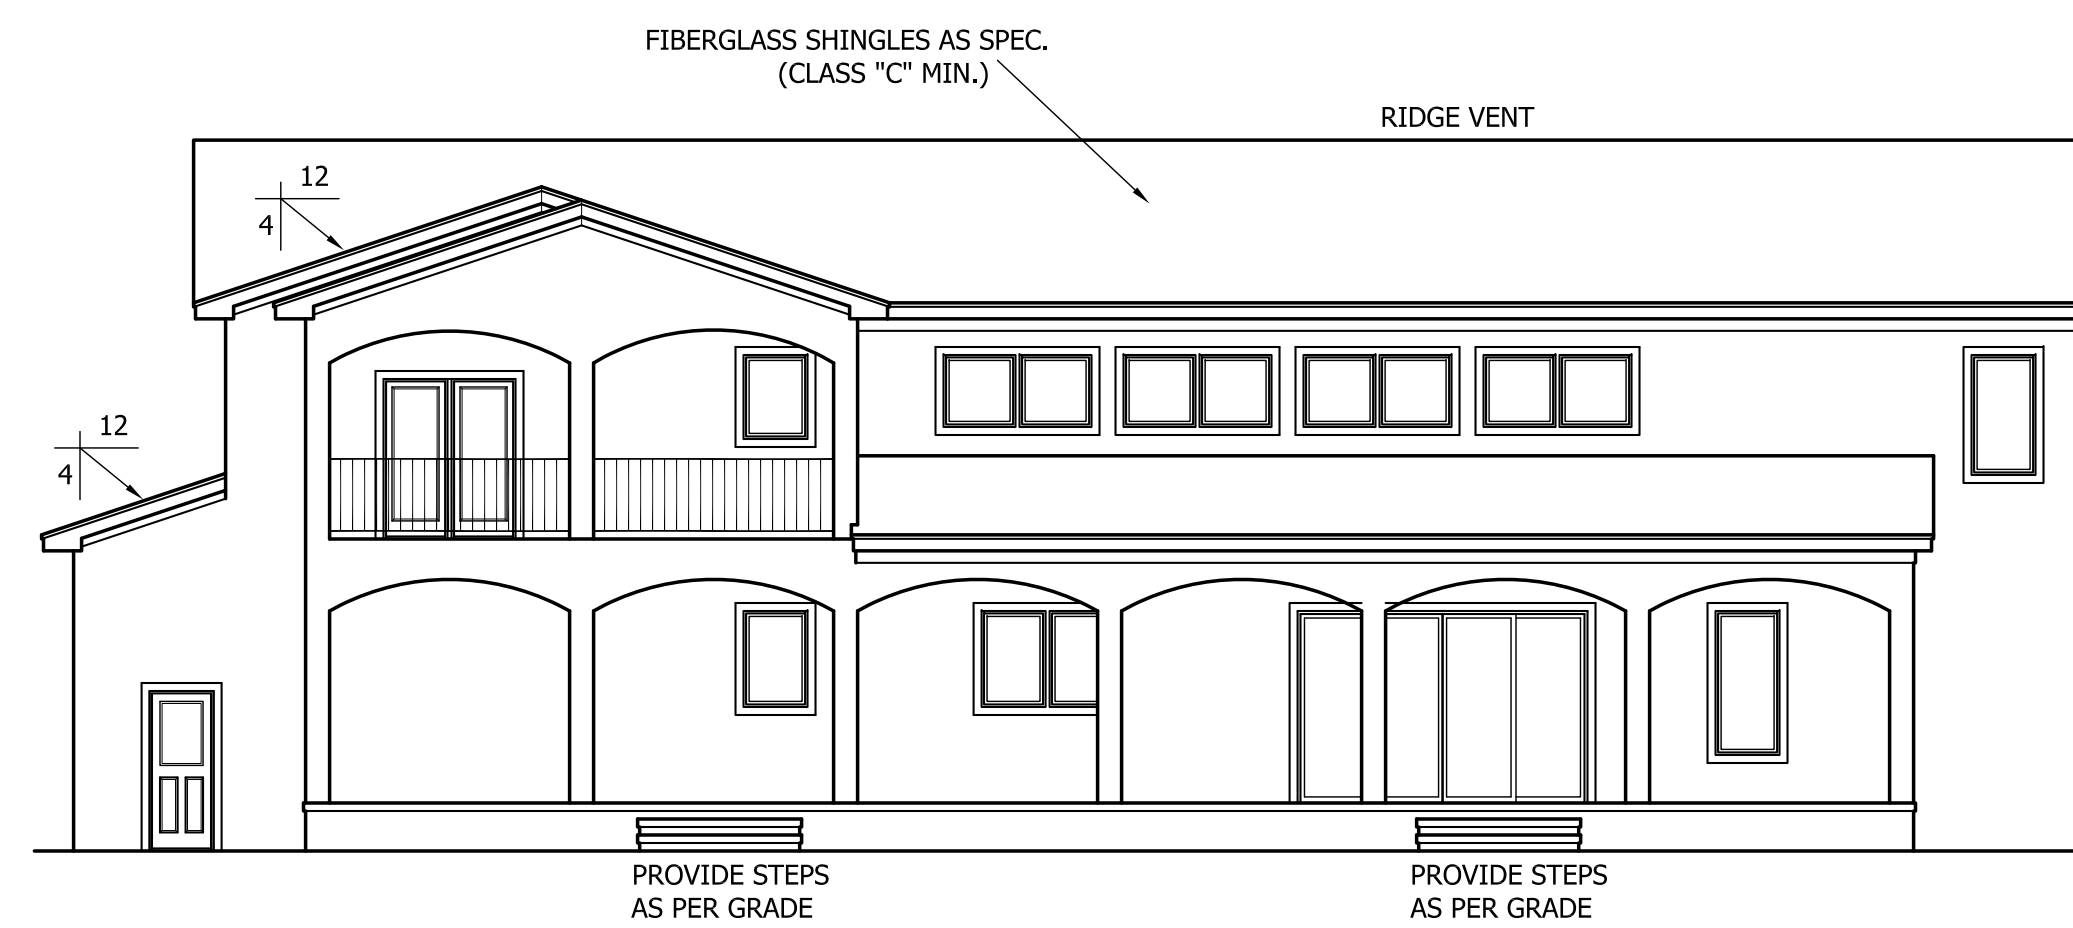

REAR ELEVATION


SCALE: 1/8"=1'-0"

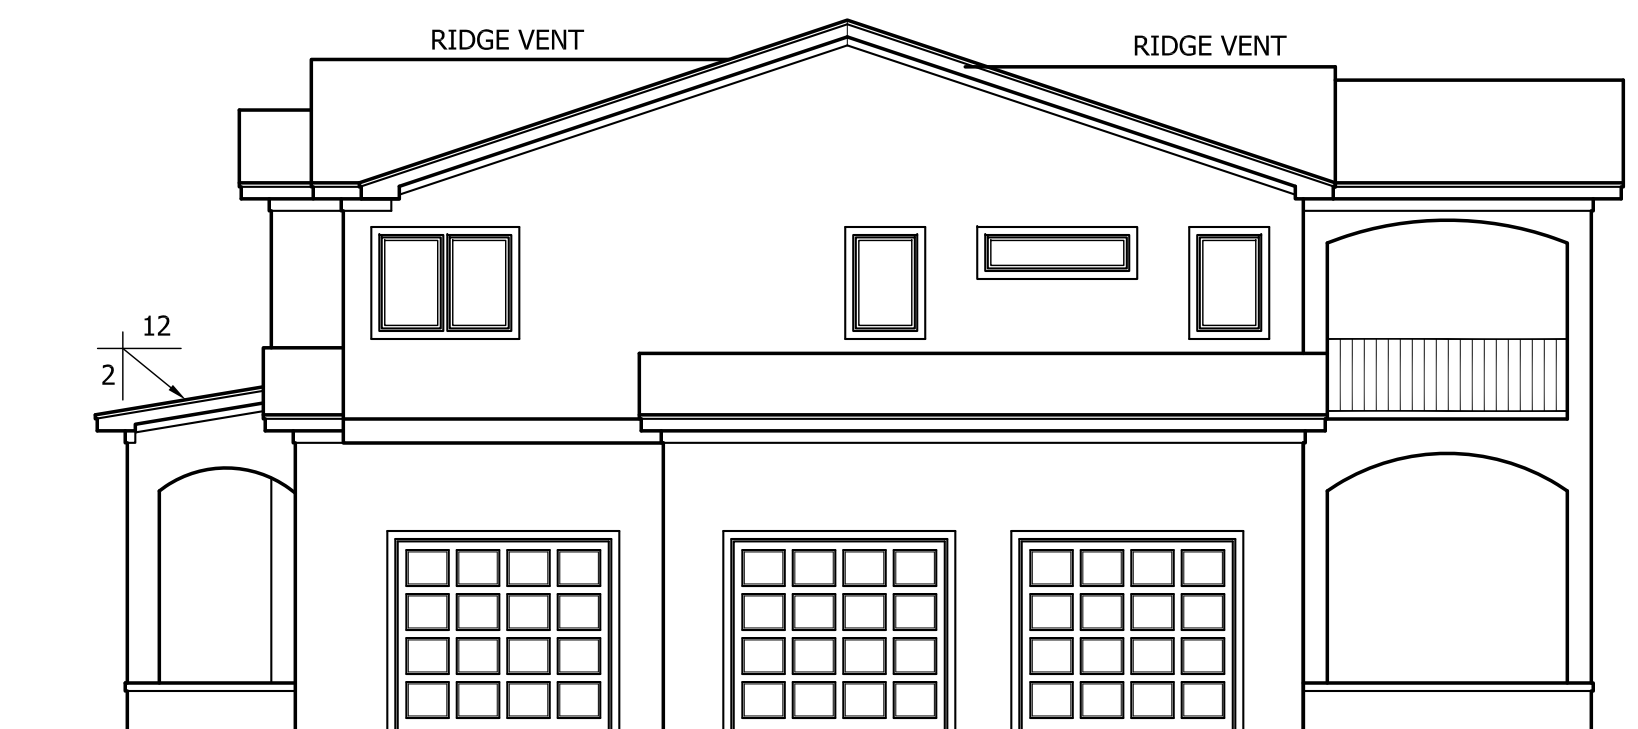

RIGHT ELEVATION

SCALE: 1/8"=1'-0"

HERNANDEZ-JAIMES RESIDENCE

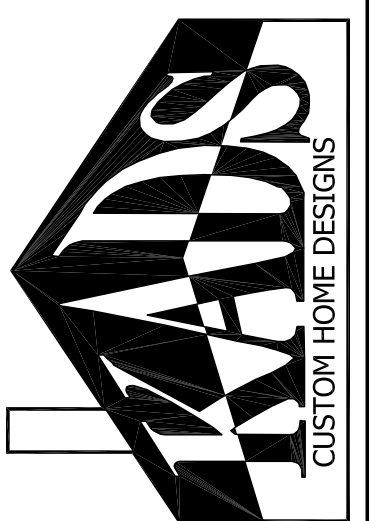

ANGIER, NC
919-369-7181

DRAWN BY:
D.W.O.

DATE:
8/9/23


PAGE NO

1

OF


5

PLAN NO.
DK4288

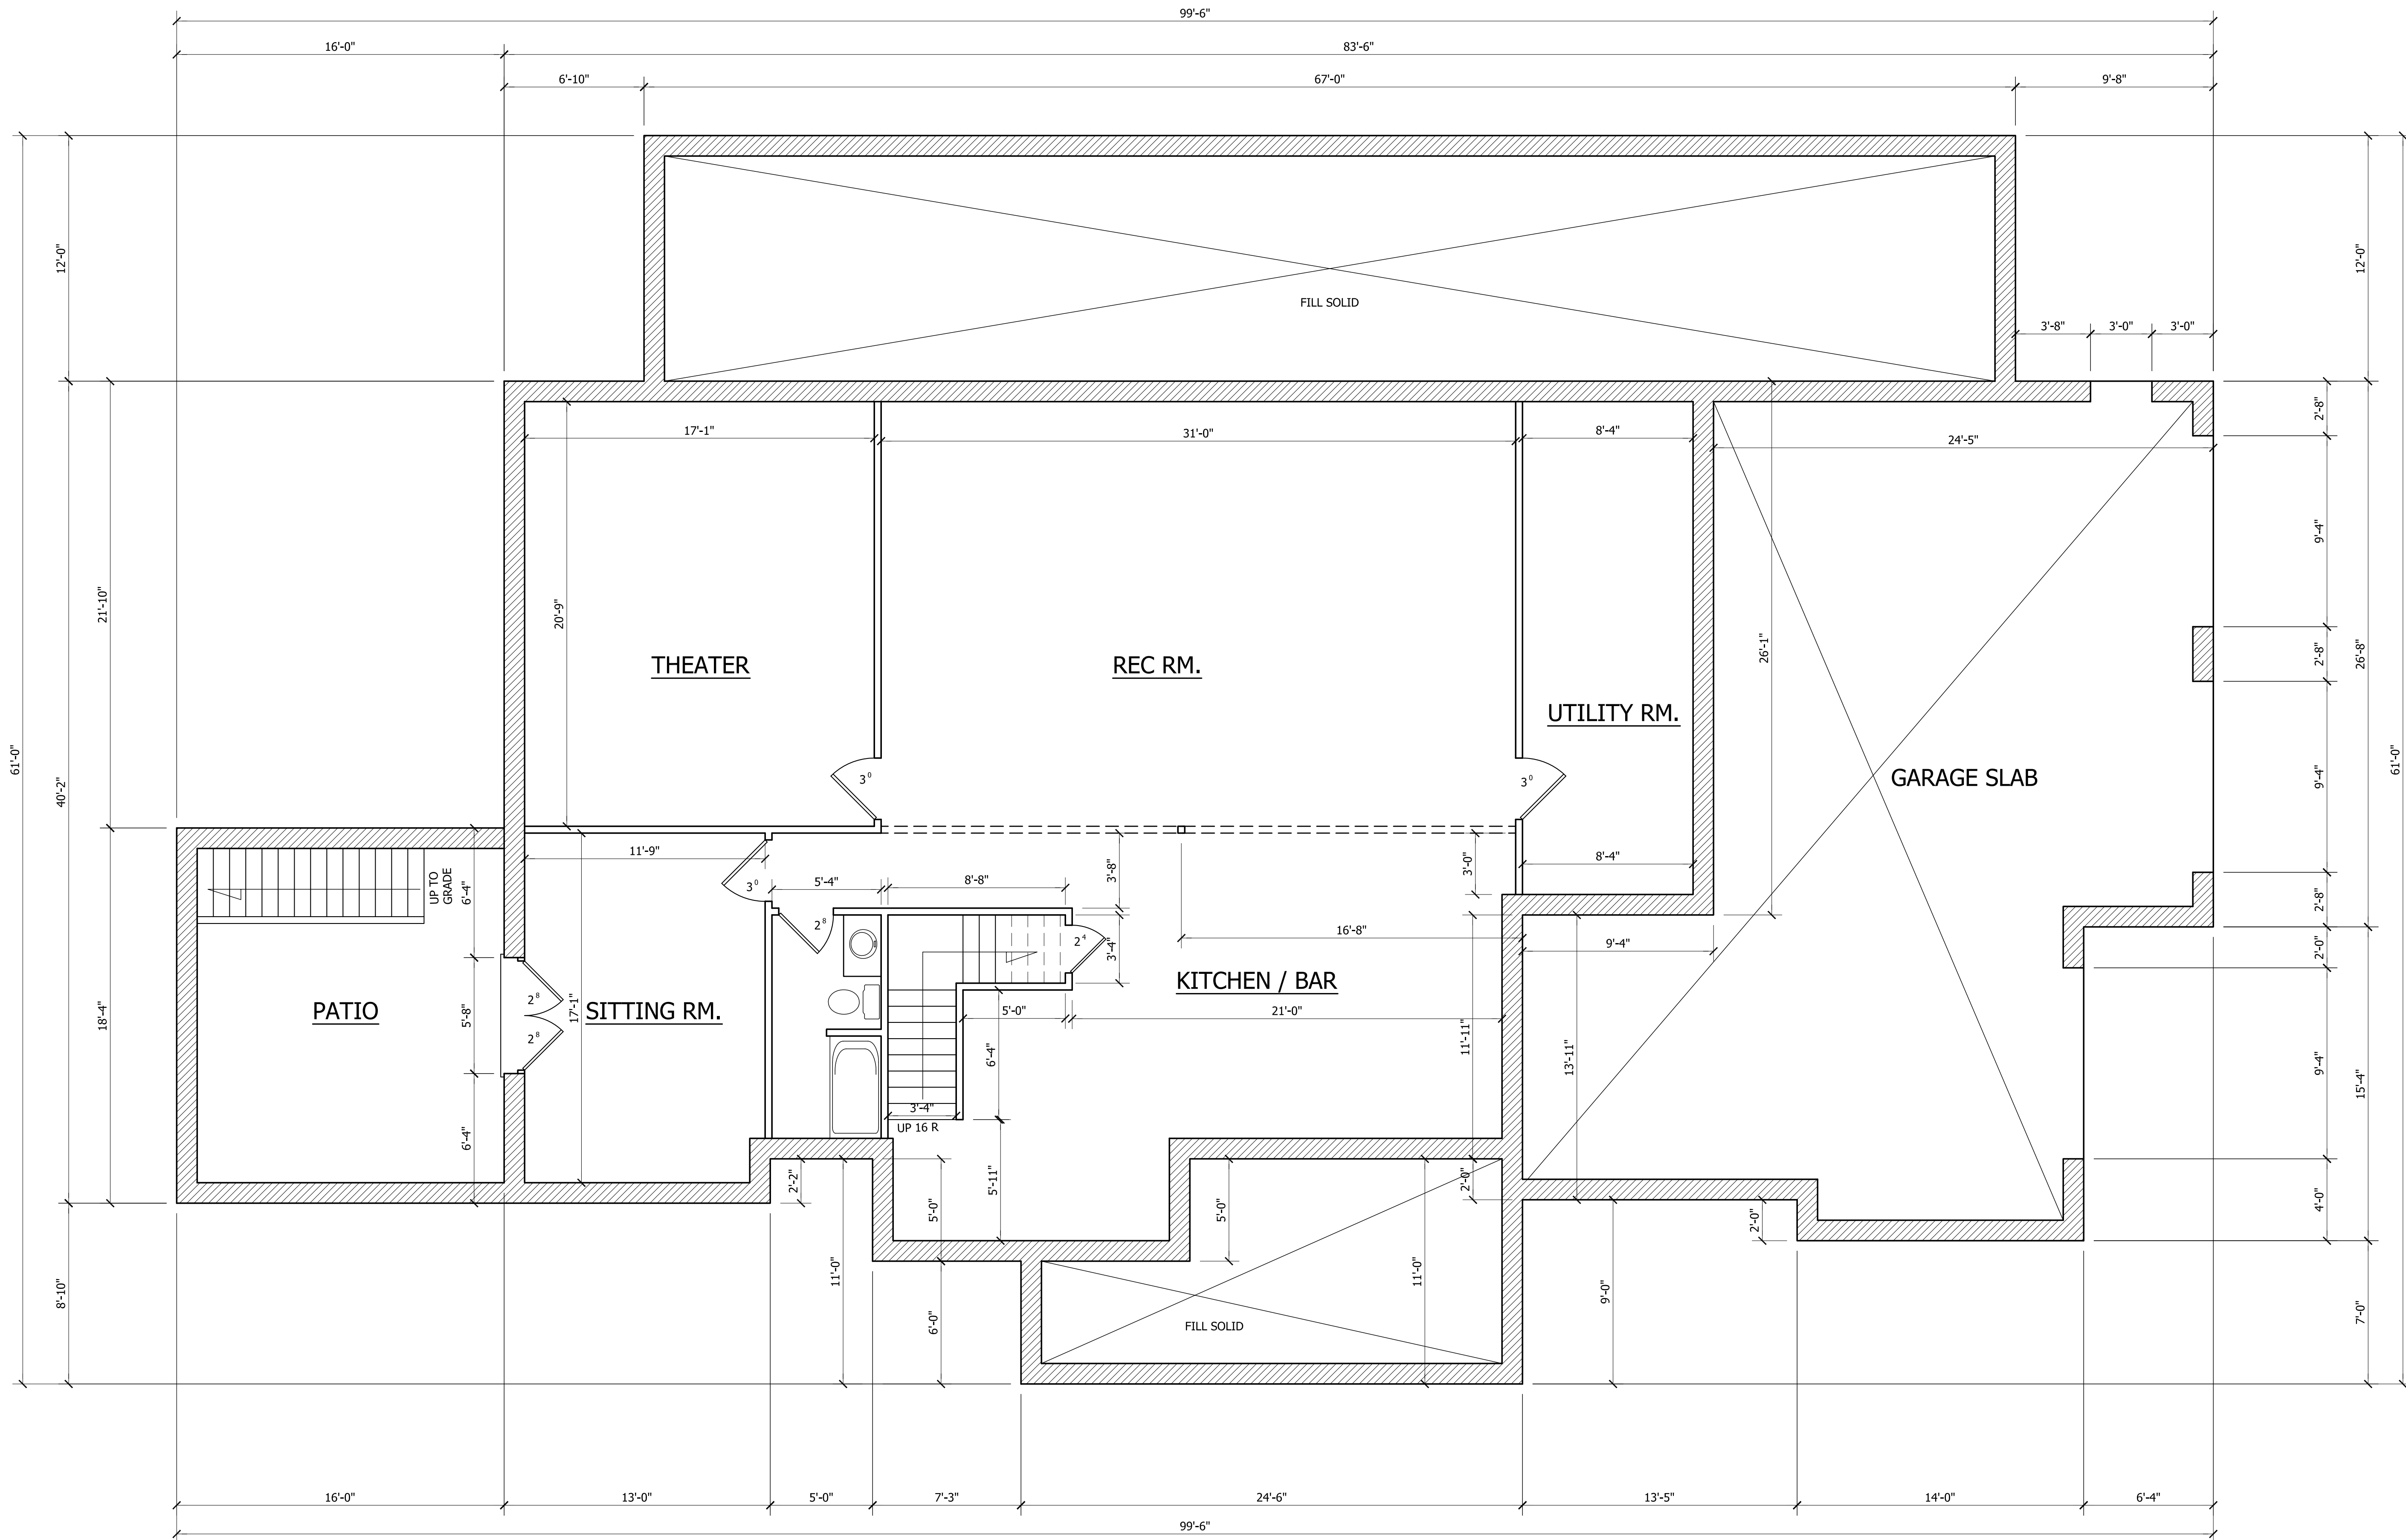

BASEMENT / CELLAR FLOOR PLAN
 SCALE: 1/4"=1'-0"
 9'-0" CLG. HGT.

HERNANDEZ-JAIMES RESIDENCE

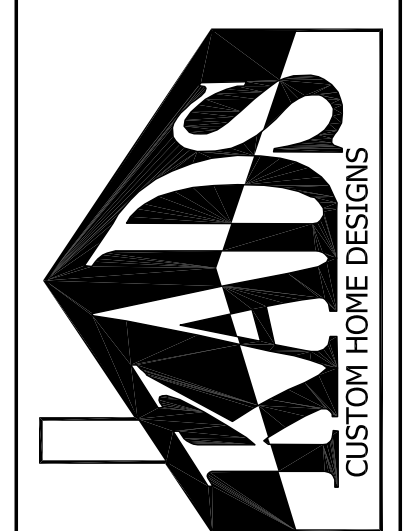

ANGIER, NC
 919-369-7181


DRAWN BY:
 D.W.O.

DATE:
 8/9/23

PAGE NO

2
 OF
 5

PLAN NO.
 DK4288

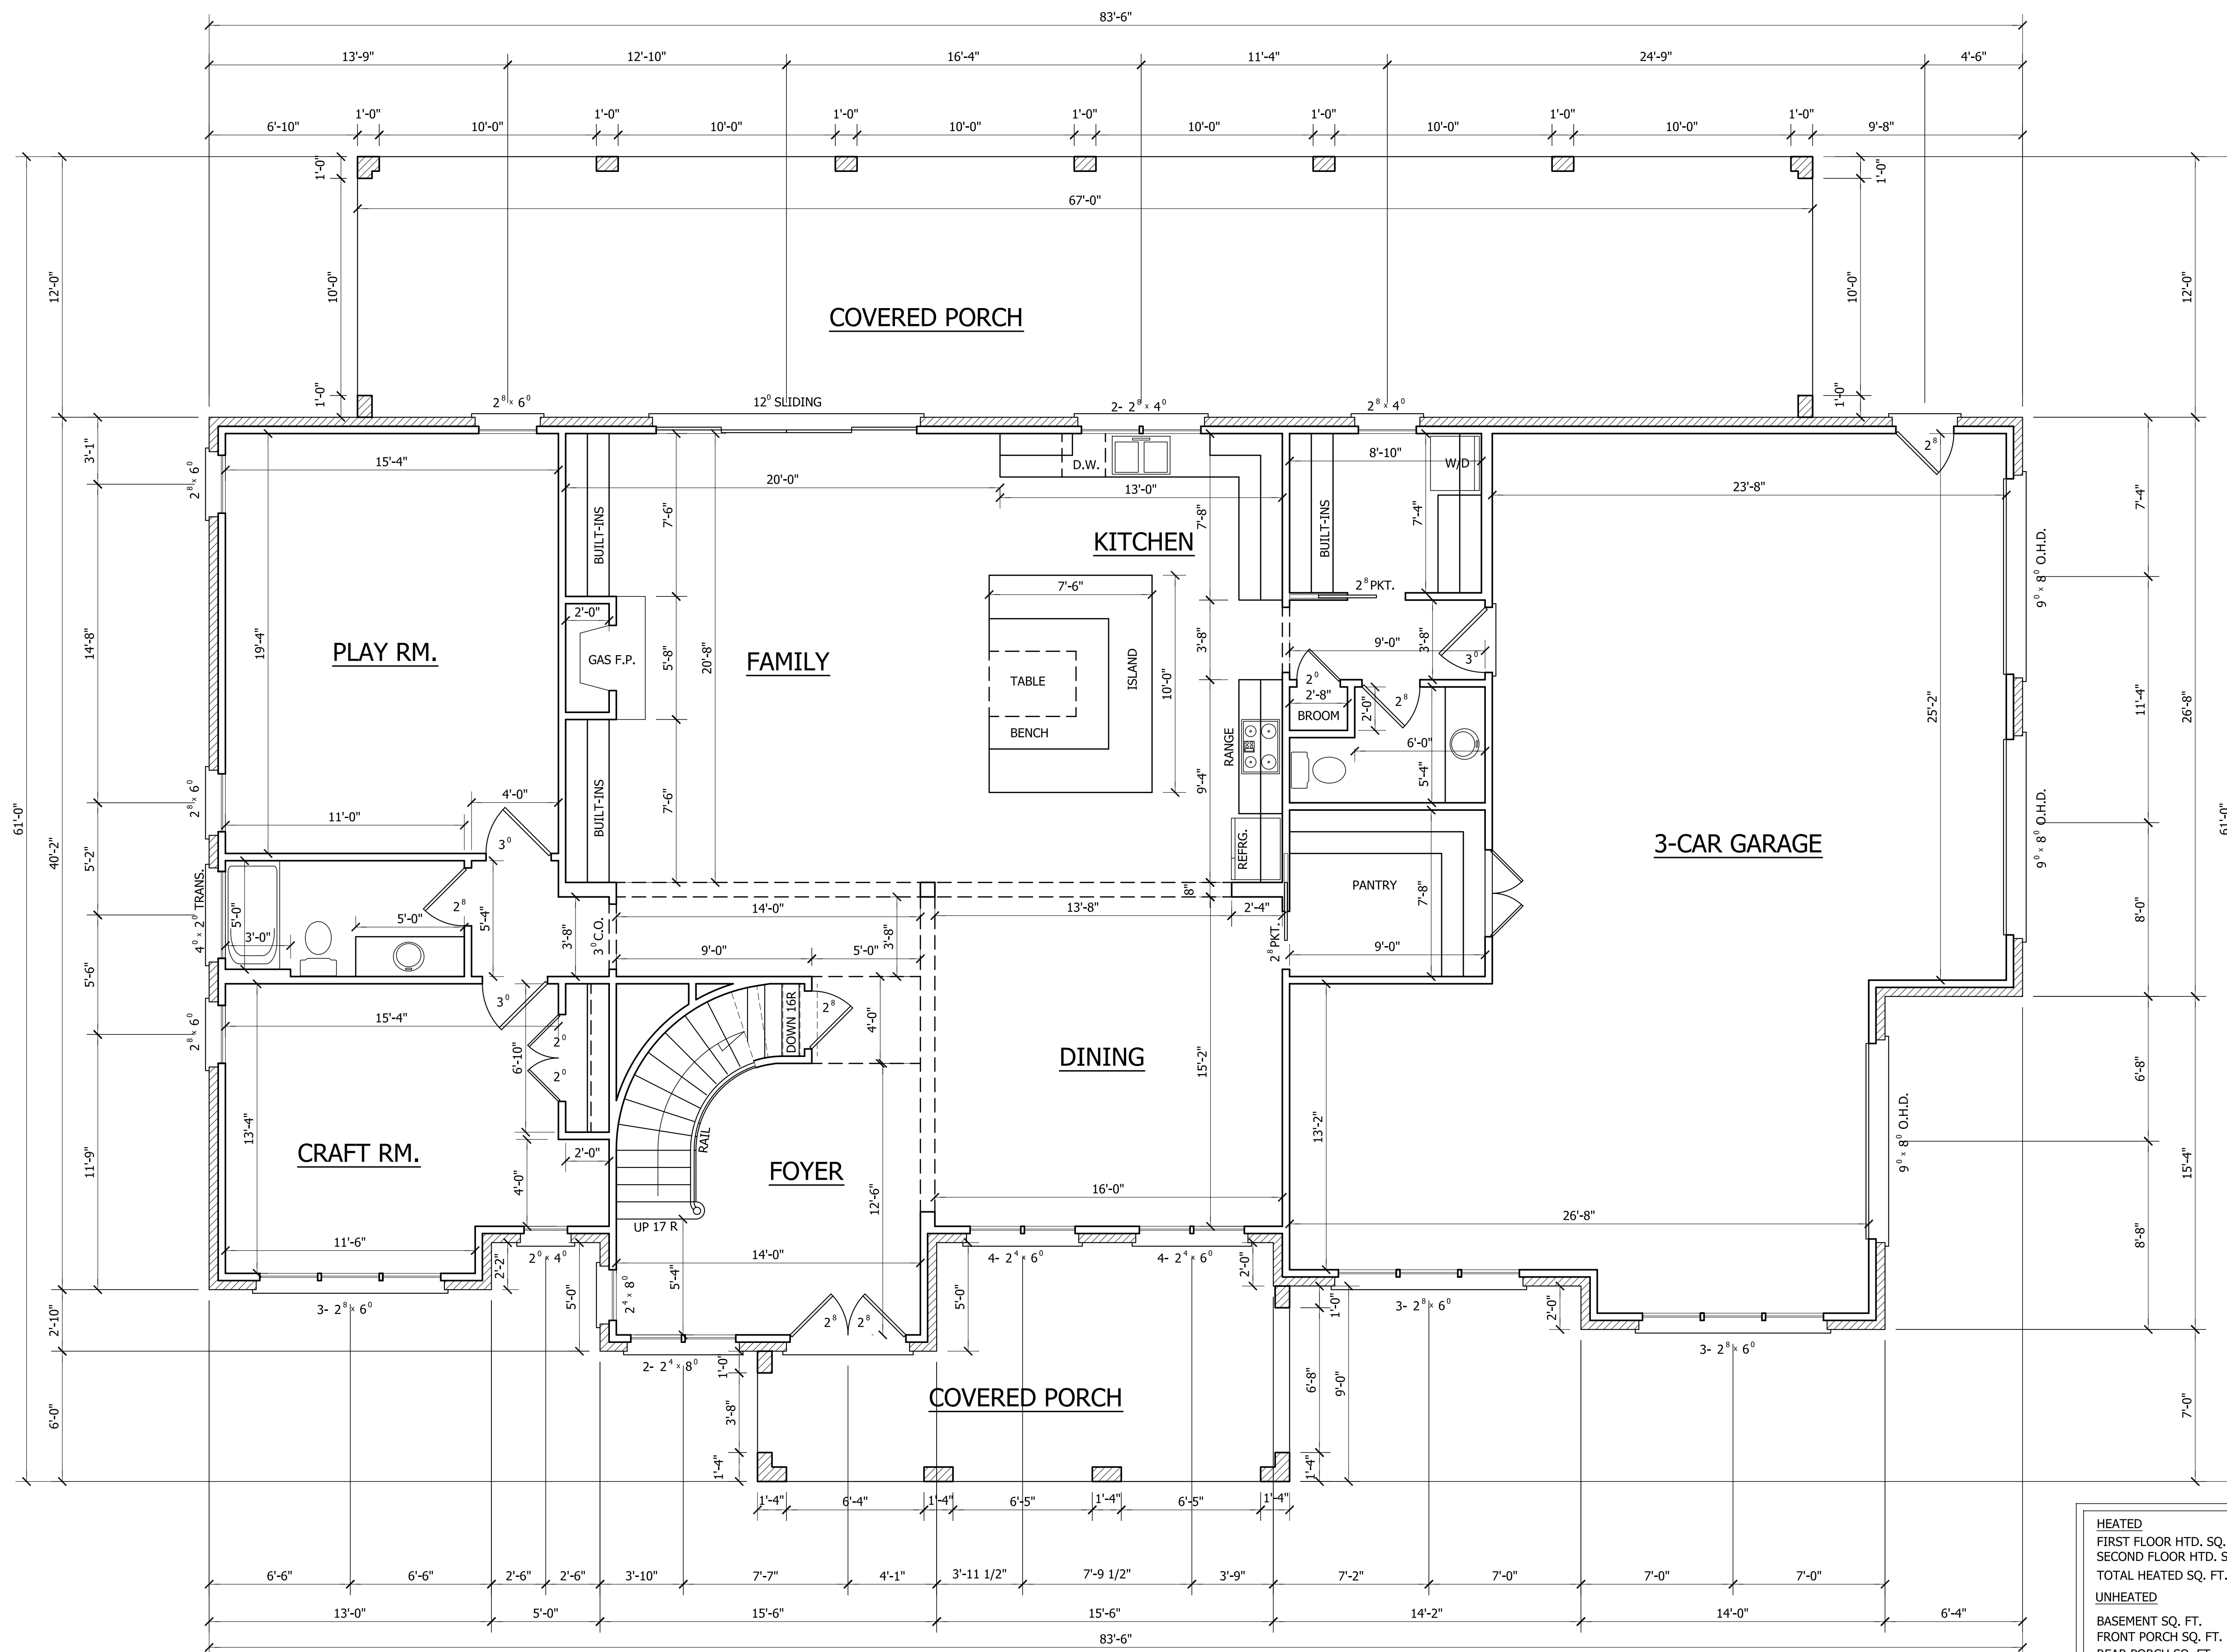


HEATED	
FIRST FLOOR HTD. SQ. FT.	= 2173
SECOND FLOOR HTD. SQ. FT.	= 2115
TOTAL HEATED SQ. FT.	= 4288
UNHEATED	
BASEMENT SQ. FT.	= 2028
FRONT PORCH SQ. FT.	= 227
REAR PORCH SQ. FT.	= 804
MASTER PORCH SQ. FT.	= 276
GARAGE SQ. FT.	= 1009

FIRST FLOOR PLAN

SCALE: 1/4"=1'-0"
 10'-0" CLG. HGT.
 SET WINDOWS AT 8'-0" A.F.F.

HERNANDEZ-JAIMES RESIDENCE

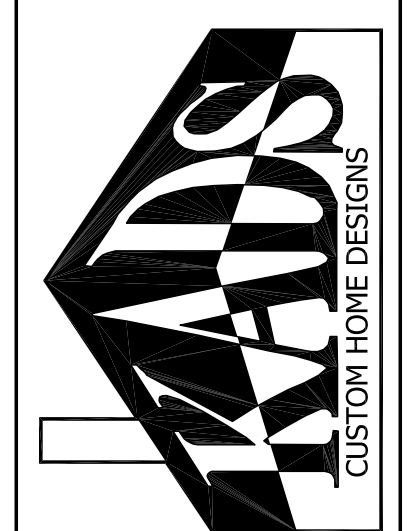

ANGIER, NC
 919-369-7181

DRAWN BY:
 D.W.O.

DATE:
 8/9/23


PAGE NO

3

OF

5


PLAN NO.
 DK4288

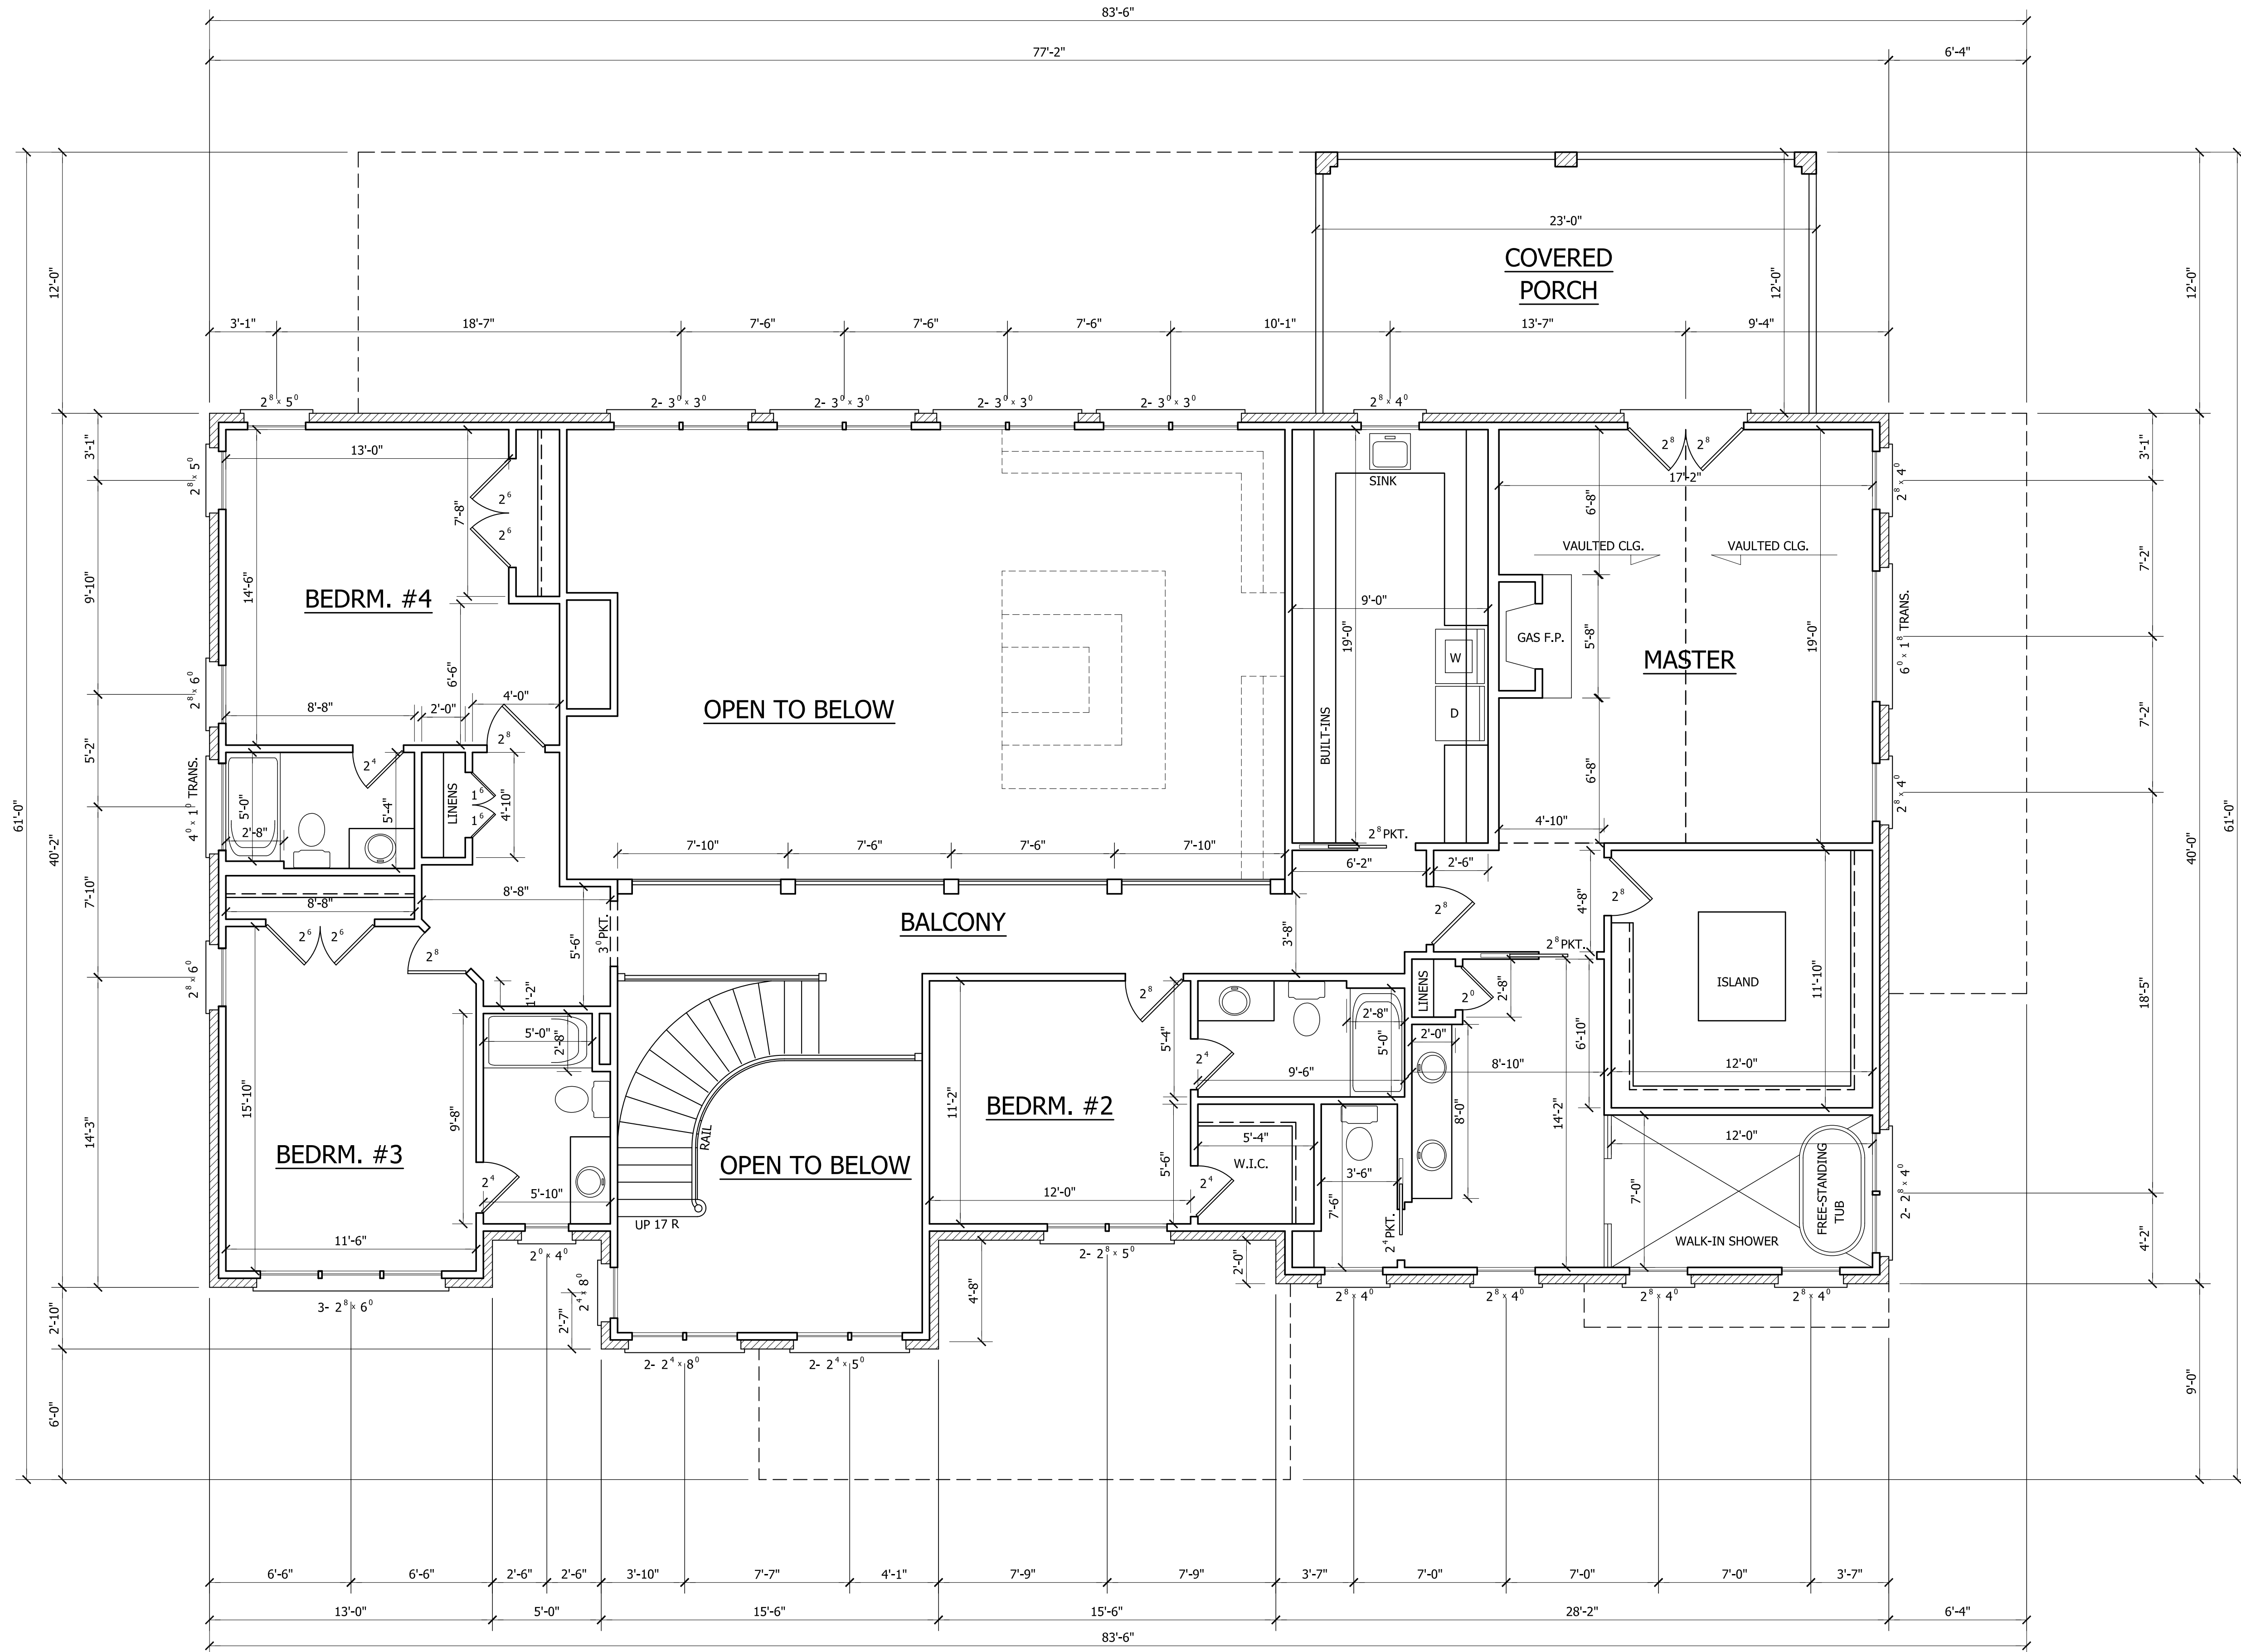

SECOND FLOOR PLAN

SCALE: 1/4"=1'-0"
 9'-0" CLG. HGT.
 SET WINDOWS AT 7'-8" A.F.F.

HERNANDEZ-JAIMES RESIDENCE

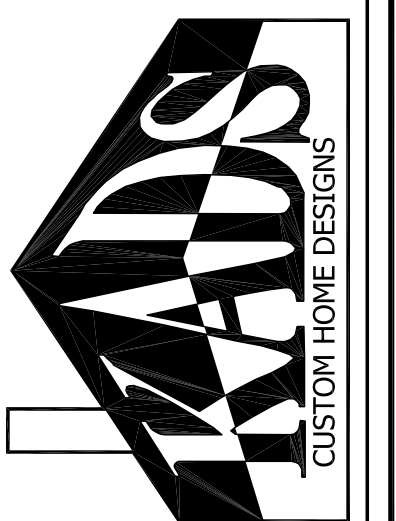

ANGIER, NC
 919-369-7181

DRAWN BY:
D.W.O.

DATE:
8/9/23


PAGE NO

4

OF

5

PLAN NO.
DK4288

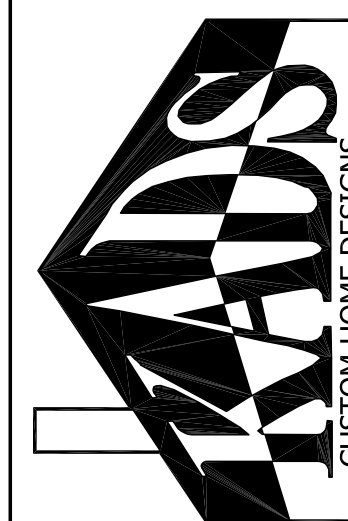

ANGIER, NC
919-369-7181

DRAWN BY:
D.W.O.



DATE:
8/9/23

PAGE NO

5

OF
5

PLAN NO.
DK4288

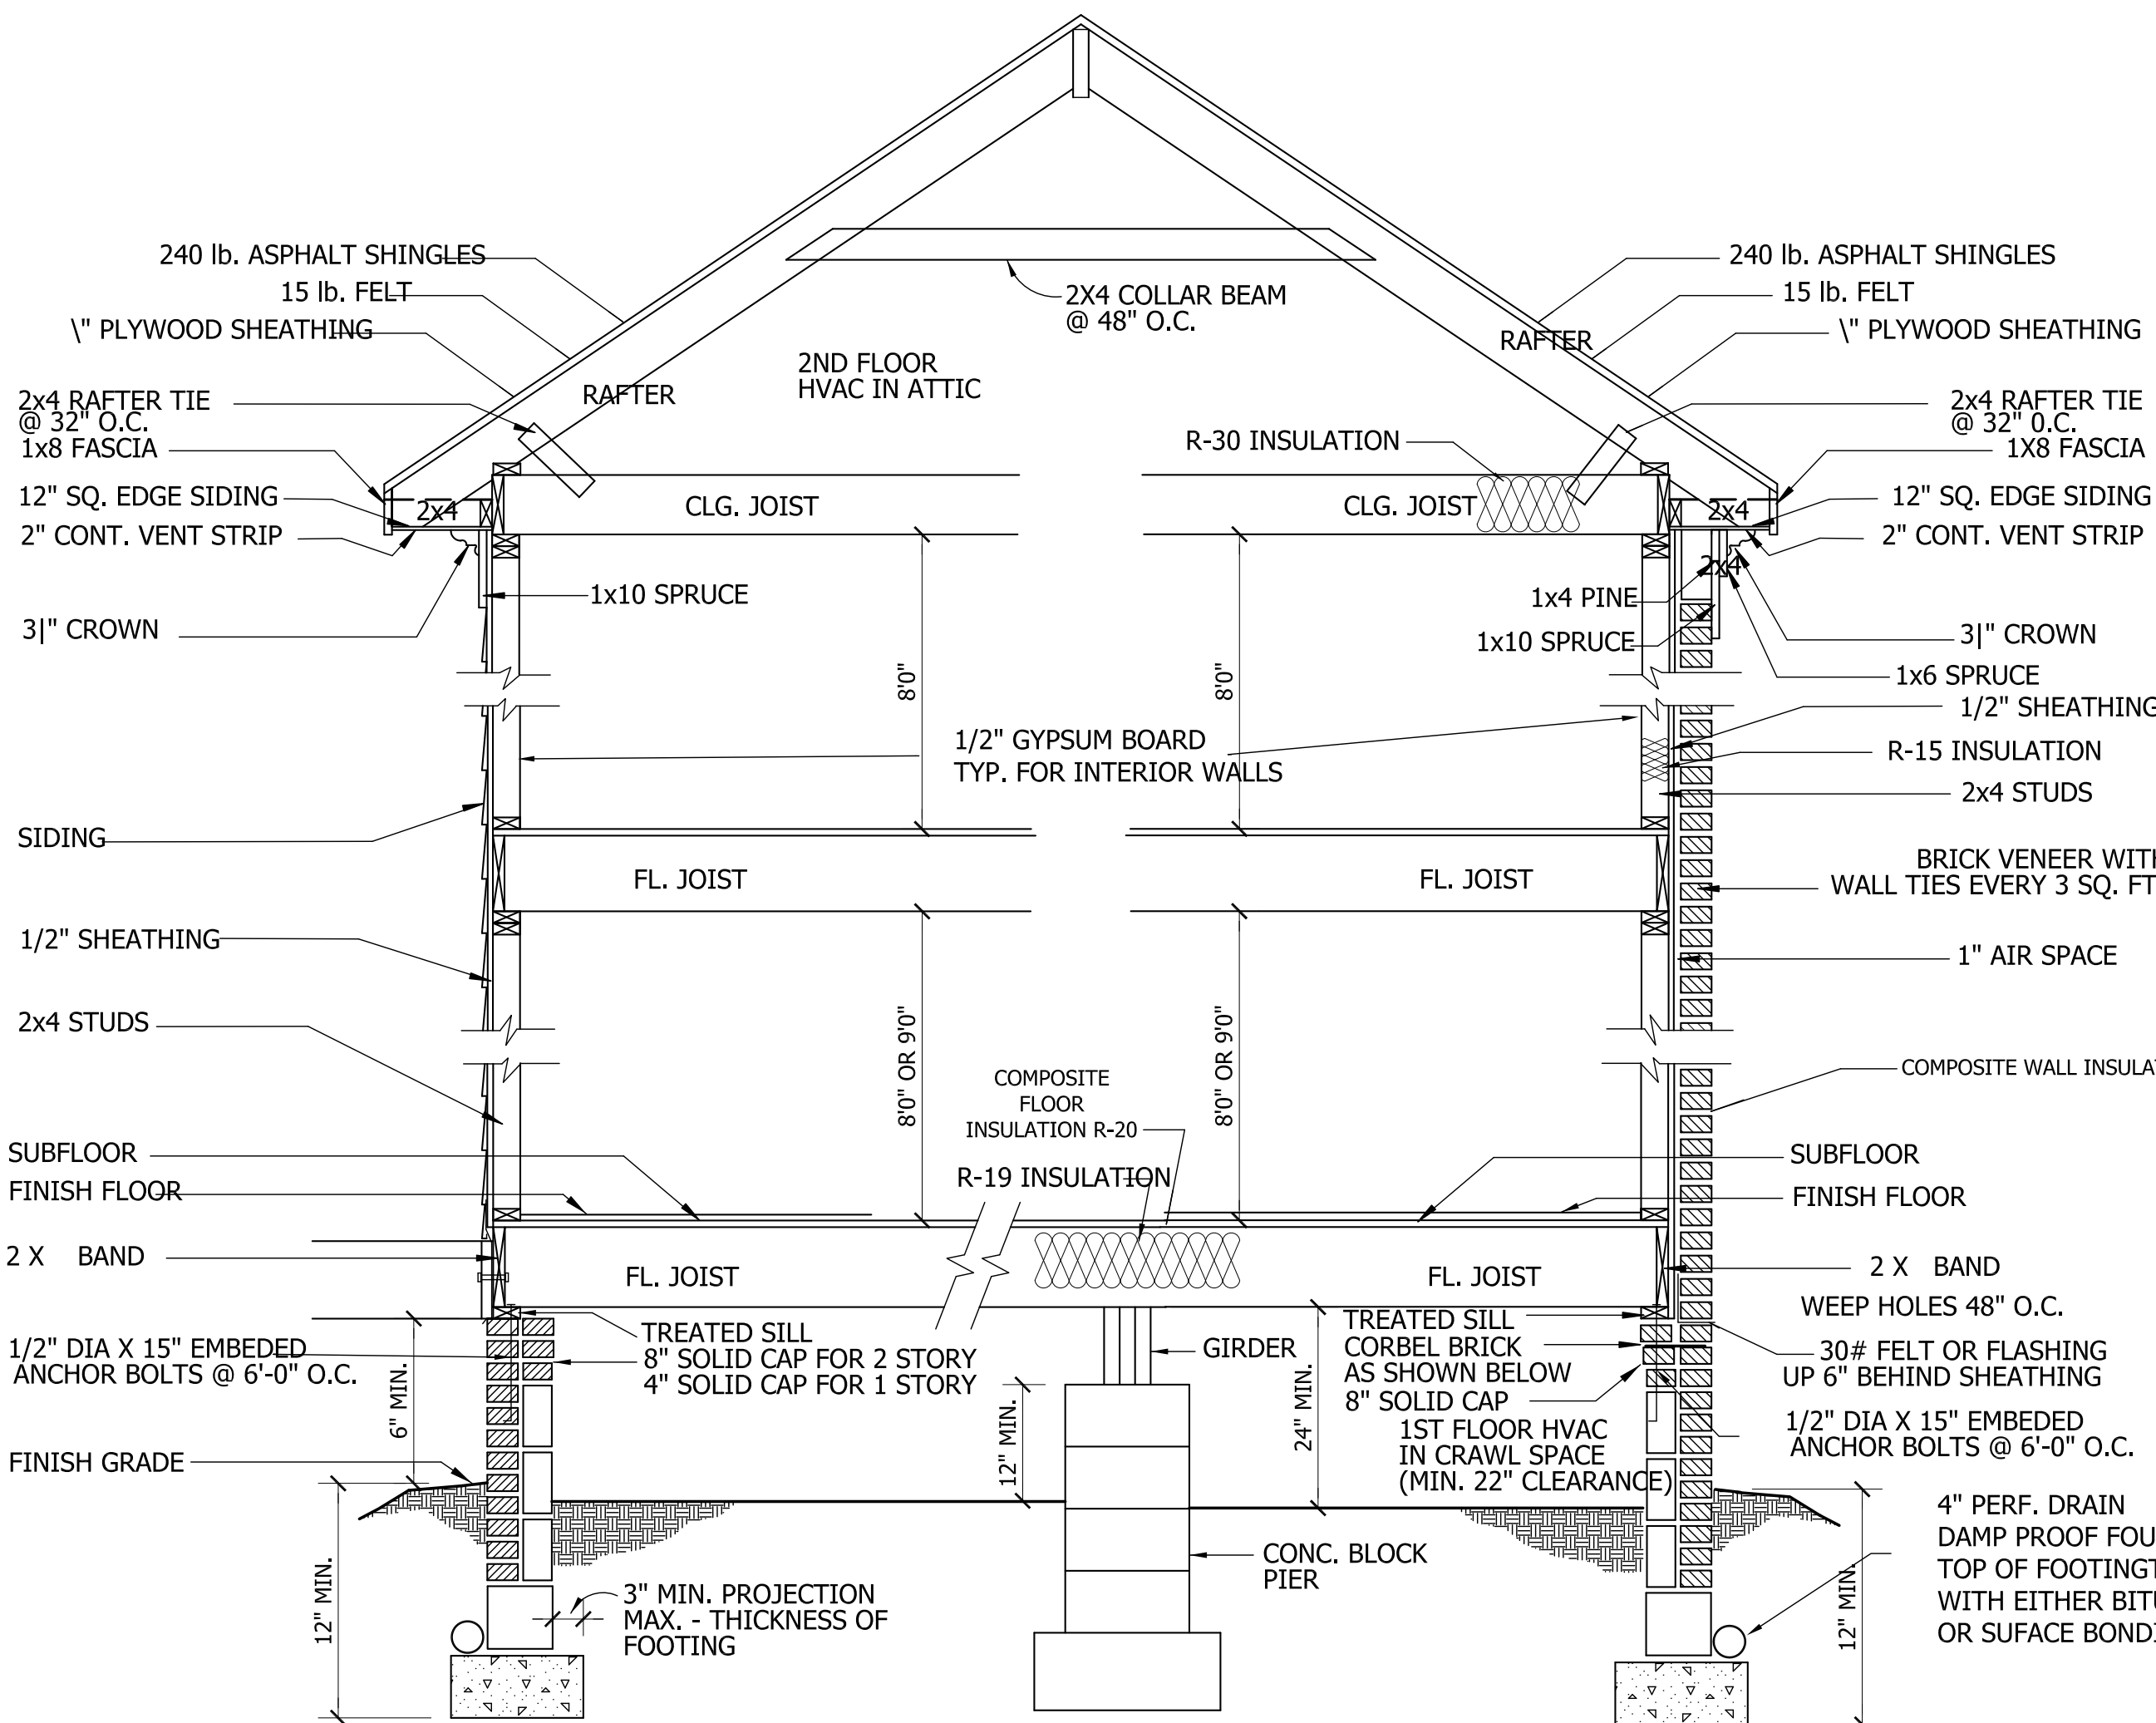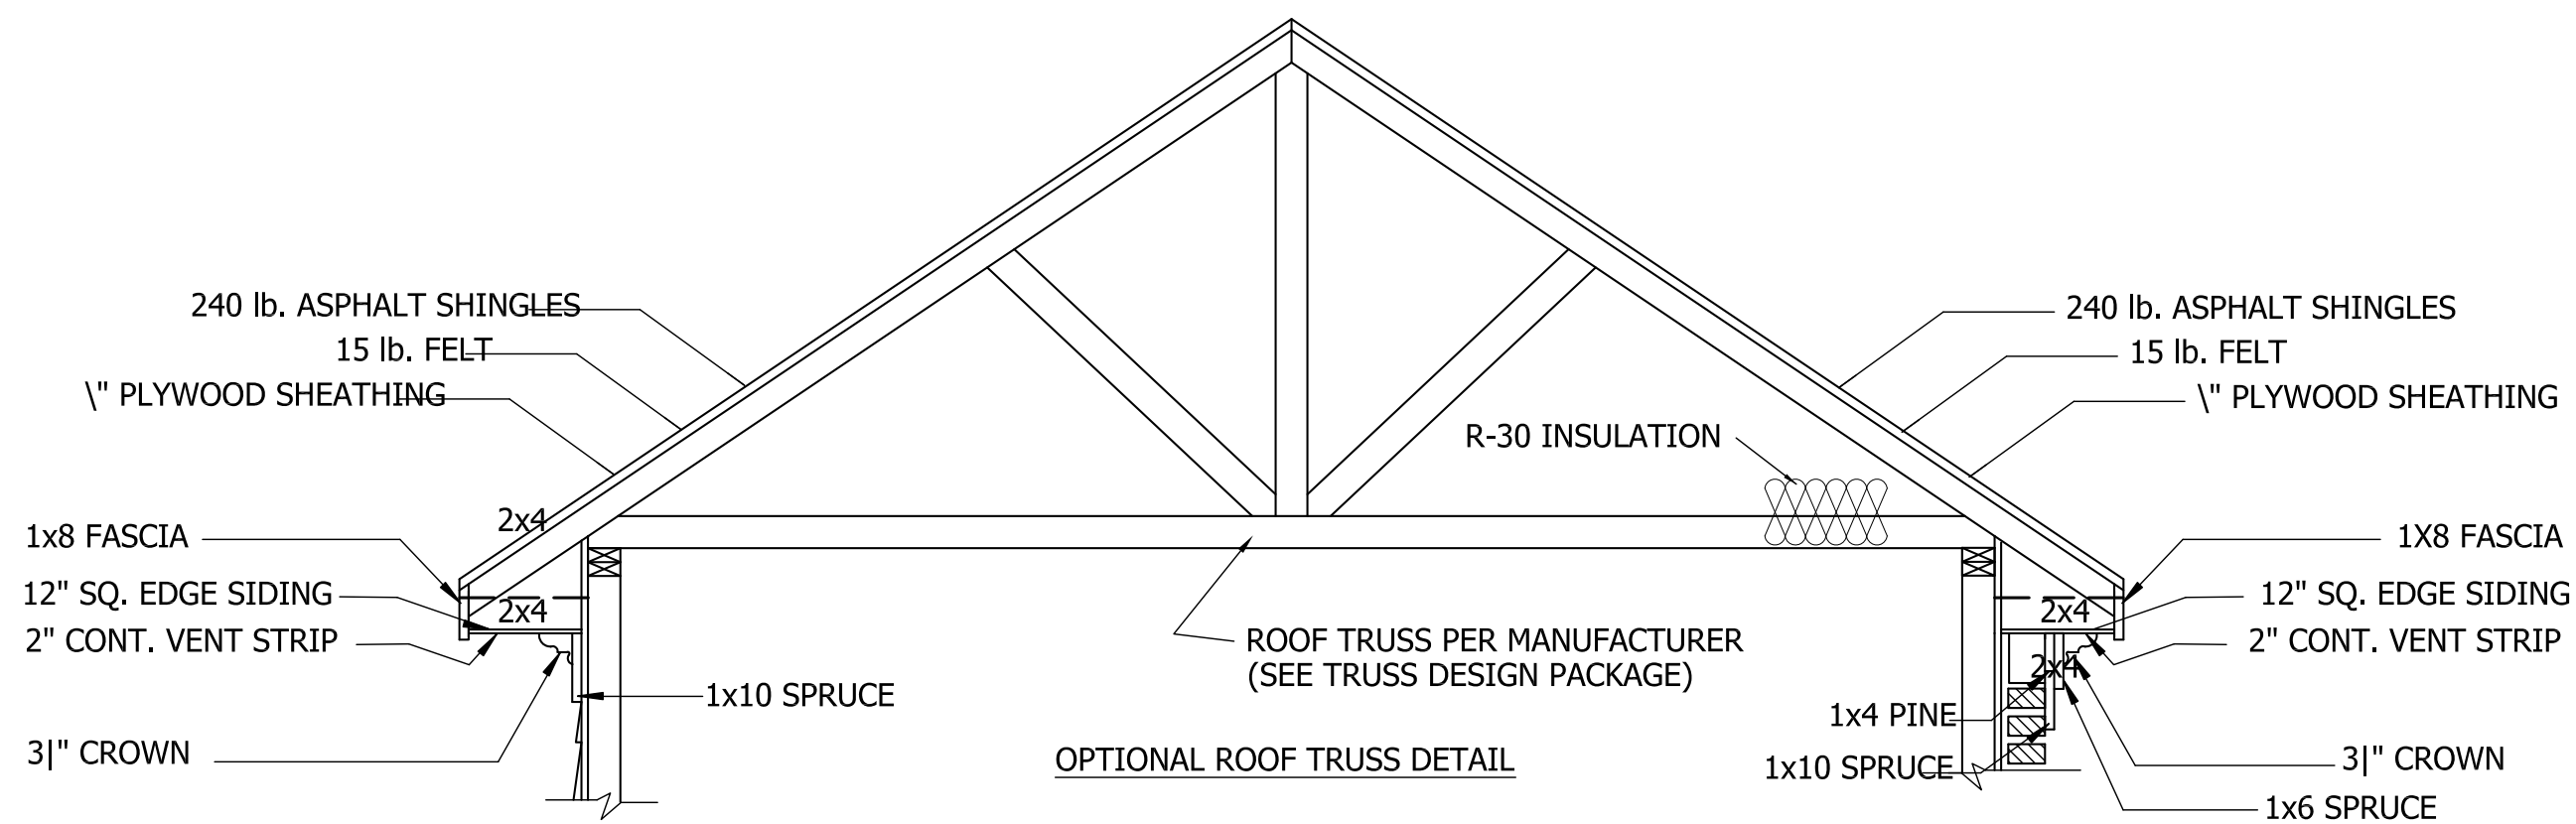


SIDING SECTION

BRICK SECTION

WALL SECTION

SCALE: 1/4" = 1'-0"

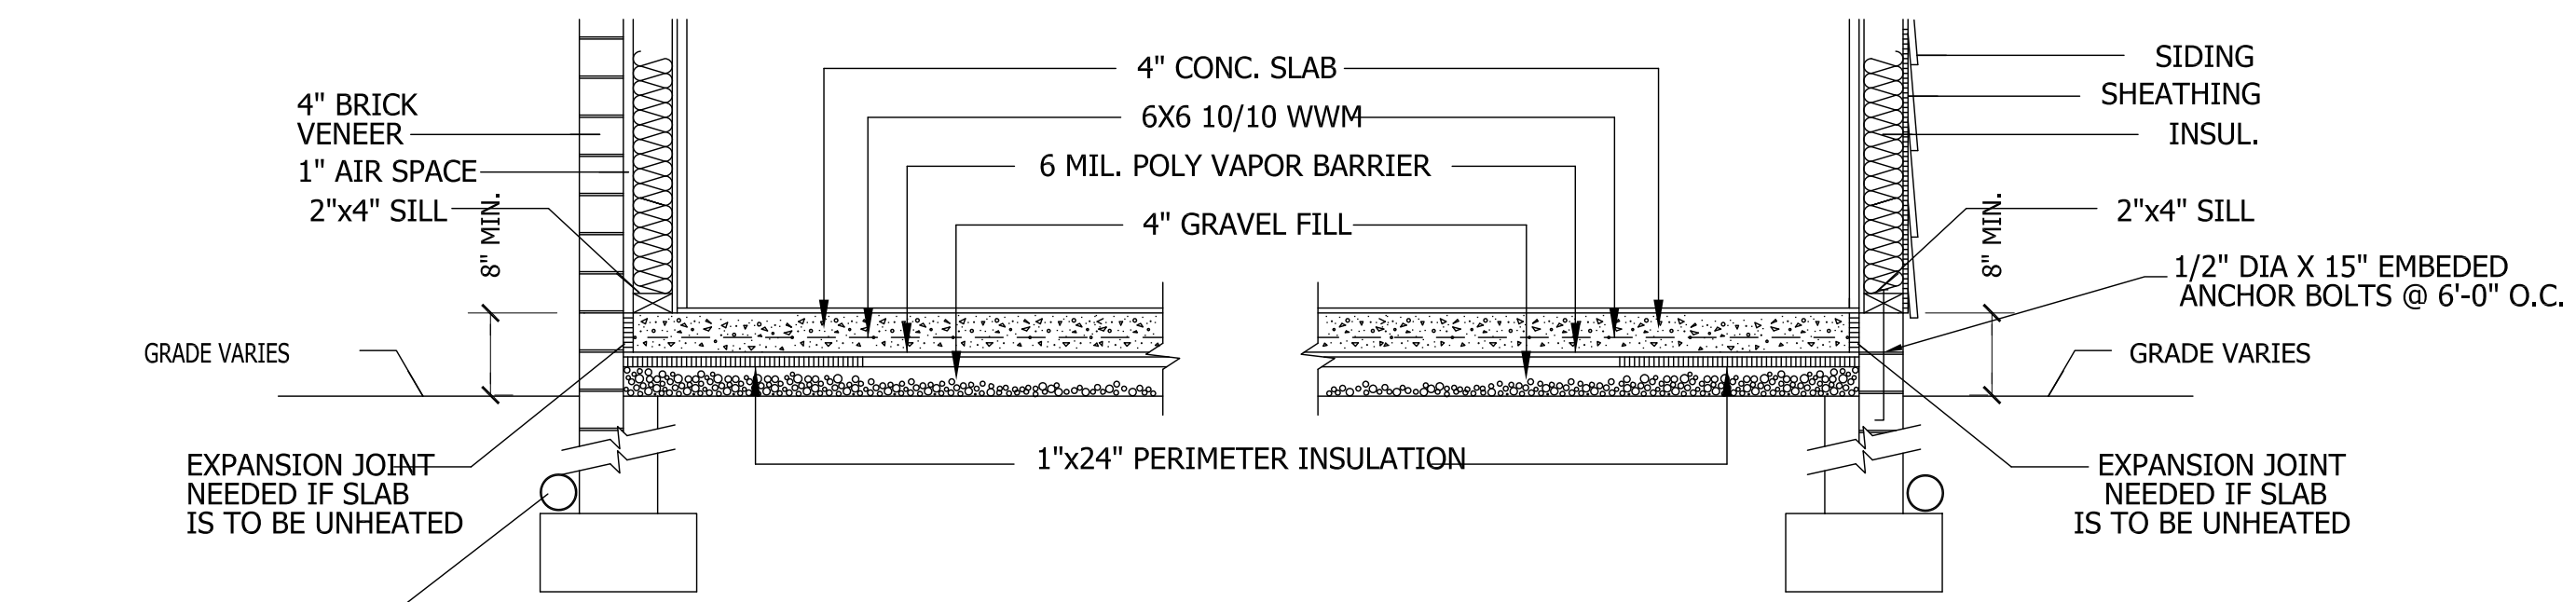

BRICK VENEER

SIDING


SLAB FDN. DETAIL

SCALE: 1" = 1'-0"

ROOF VENTILATING REQUIREMENTS	
$\frac{4213}{150}$	= 28.08 SQ. FT. REQ'D


ROOF VENTILATING REQUIREMENTS (POWER ROOF VENTILATOR REQUIRED)	
$\frac{4213}{300}$	= 14.04 SQ. FT. REQ'D

BUILDER TO PROVIDE APPROPRIATE VENTILATING AS REQUIRED.

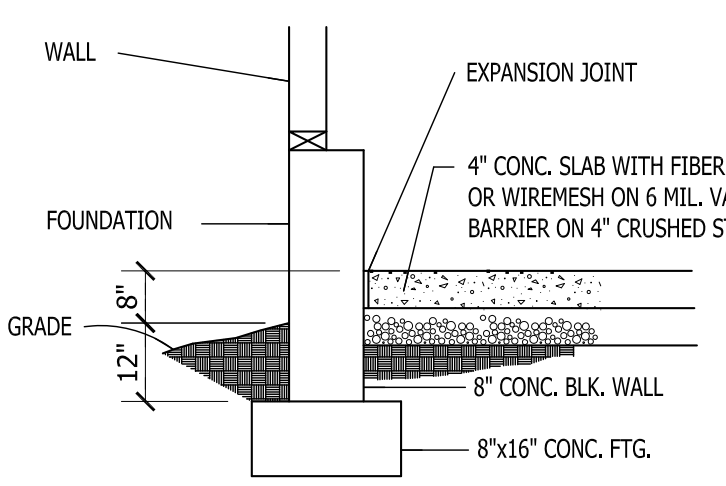

GARAGE SLAB

SCALE: NTS

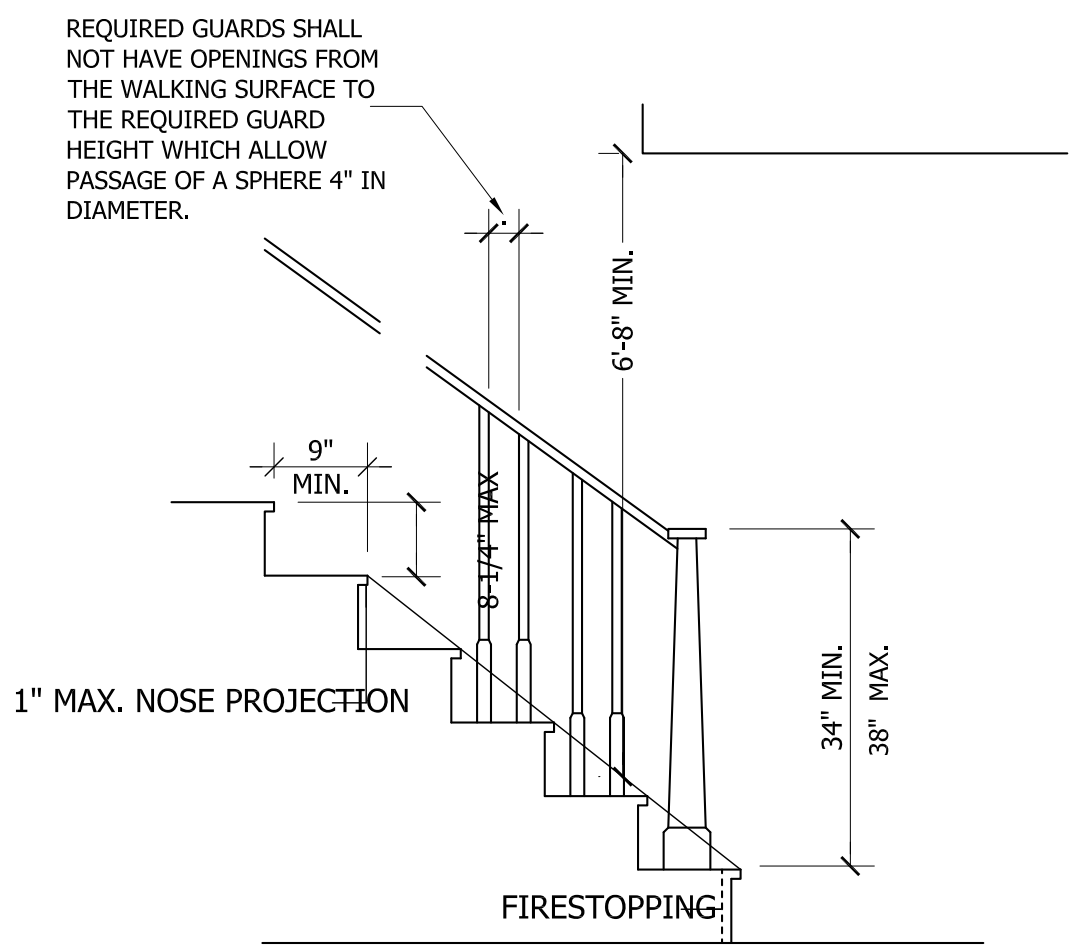

NOTE:
Stairways shall not be less than 36 inches in clear width at all points above the permitted handrail height and below the required headroom height. Handrails shall not project more than 4.5 inches on either side of the stairway and the minimum clear width of the stairway at and below the handrail height, including treads and landings, shall not be less than 31-1/2 inches where a handrail is installed on one side and 27 inches where handrails are provided on both sides

STAIR DETAIL


SCALE: NTS

GENERAL FOUNDATION NOTES:

1. THIS PLAN DESIGNED IN ACCORDANCE WITH THE NORTH CAROLINA RESIDENTIAL BUILDING CODE, 2018 EDITION.
2. EXTERIOR WALL FOOTING TO BE A MINIMUM OF 16" WIDE AND CONSTRUCTED WITH 3000 PSI CONCRETE. FOR FOUNDATION WALL HEIGHT, THICKNESS AND BACKFILL REQUIREMENTS REFER TO STATE AND LOCAL BUILDING CODES. THE ASSUMED SOIL BEARING CAPACITY FOR THIS PROJECT IS 2000 PSF. THE CONTRACTOR MUST VERIFY THE SITE CONDITIONS AND CONTACT A SOILS ENGINEER IF MARGINAL OR UNSTABLE SOILS ARE ENCOUNTERED.
3. ALL FOOTINGS SHALL BEAR ON UNDISTURBED SUB-GRADE A MINIMUM OF 12" BELOW ADJACENT FINISHED GRADE OR AS OTHERWISE DIRECTED BY THE LOCAL INSPECTOR.
4. FOUNDATION DRAINAGE SHALL BE IN ACCORDANCE WITH SECTION R405 "FOUNDATION DRAINAGE" AND SECTION R406 "FOUNDATION WATERPROOFING AND DAMPPROOFING".
5. ANCHOR BOLTS SHALL BE 1/2" DIAMETER AND INSTALLED AT 12" ON CENTER AND 12" FROM EACH CORNER OR SILL PLATE SPICE LOCATIONS.

STRUCTURAL EVALUATION BY:



WILKINS ENGINEERING, P.C.
 Post Office Box 31446
 Raleigh, North Carolina 27621



FILE:

8/22/2023

*THE ENGINEER'S SEAL AND SIGNATURE APPLY ONLY TO THE STRUCTURAL ELEMENTS OF THIS DOCUMENT. ENGINEER'S APPROVAL DOES NOT INCLUDE CONSTRUCTION REVIEW, MEANS, METHODS, TECHNIQUES OR SEQUENCES OF CONSTRUCTION OR SAFETY REQUIREMENTS. THE CONTRACTOR IS REQUIRED TO ENSURE PROPER SAFETY PRECAUTIONS.
 *ANY DEVIATIONS OR DISCREPANCIES IN THESE DRAWINGS ARE TO BE BROUGHT TO THE IMMEDIATE ATTENTION OF THE ENGINEER AND FAILURE TO DO SO WILL VOID THE ENGINEER'S LIABILITY. CHANGES TO THE DESIGN ARE ONLY ALLOWED WITH THE WRITTEN APPROVAL OF THE ENGINEER.
 *DO NOT SCALE THESE DRAWINGS. ENGINEERING APPROVAL EXPIRES IN ONE YEAR.

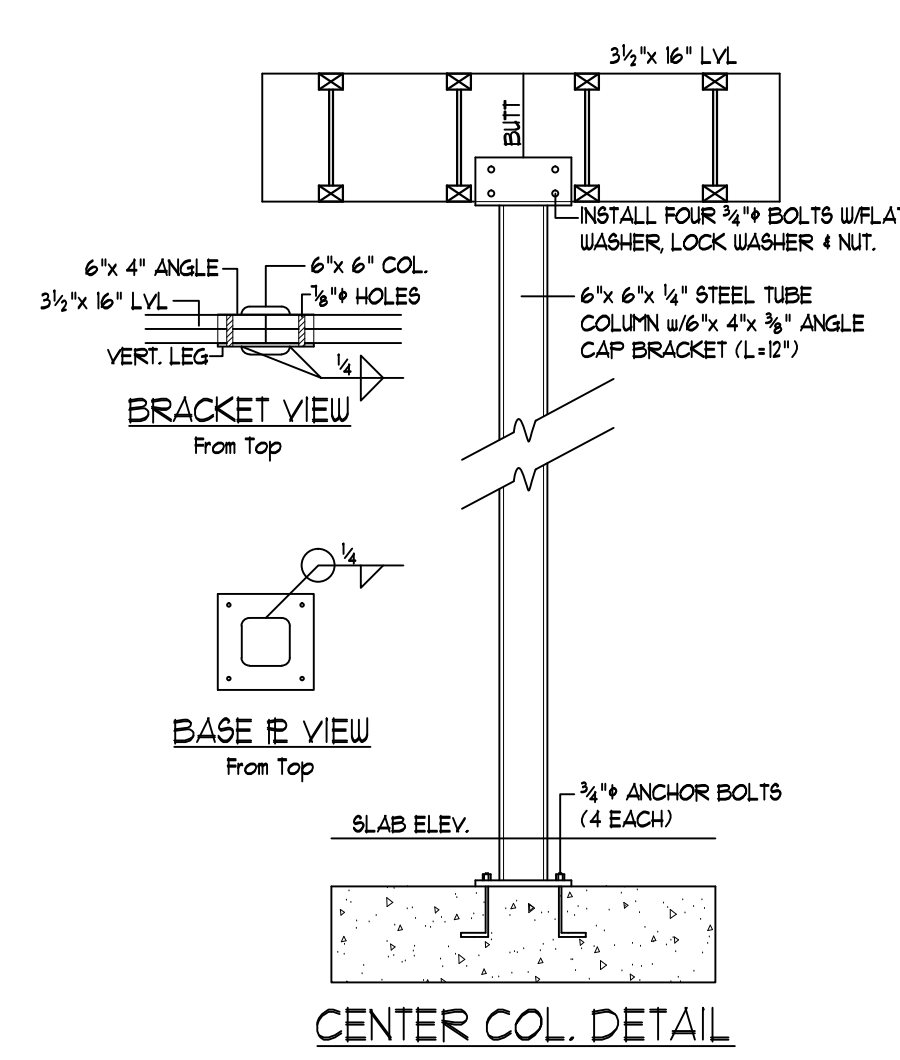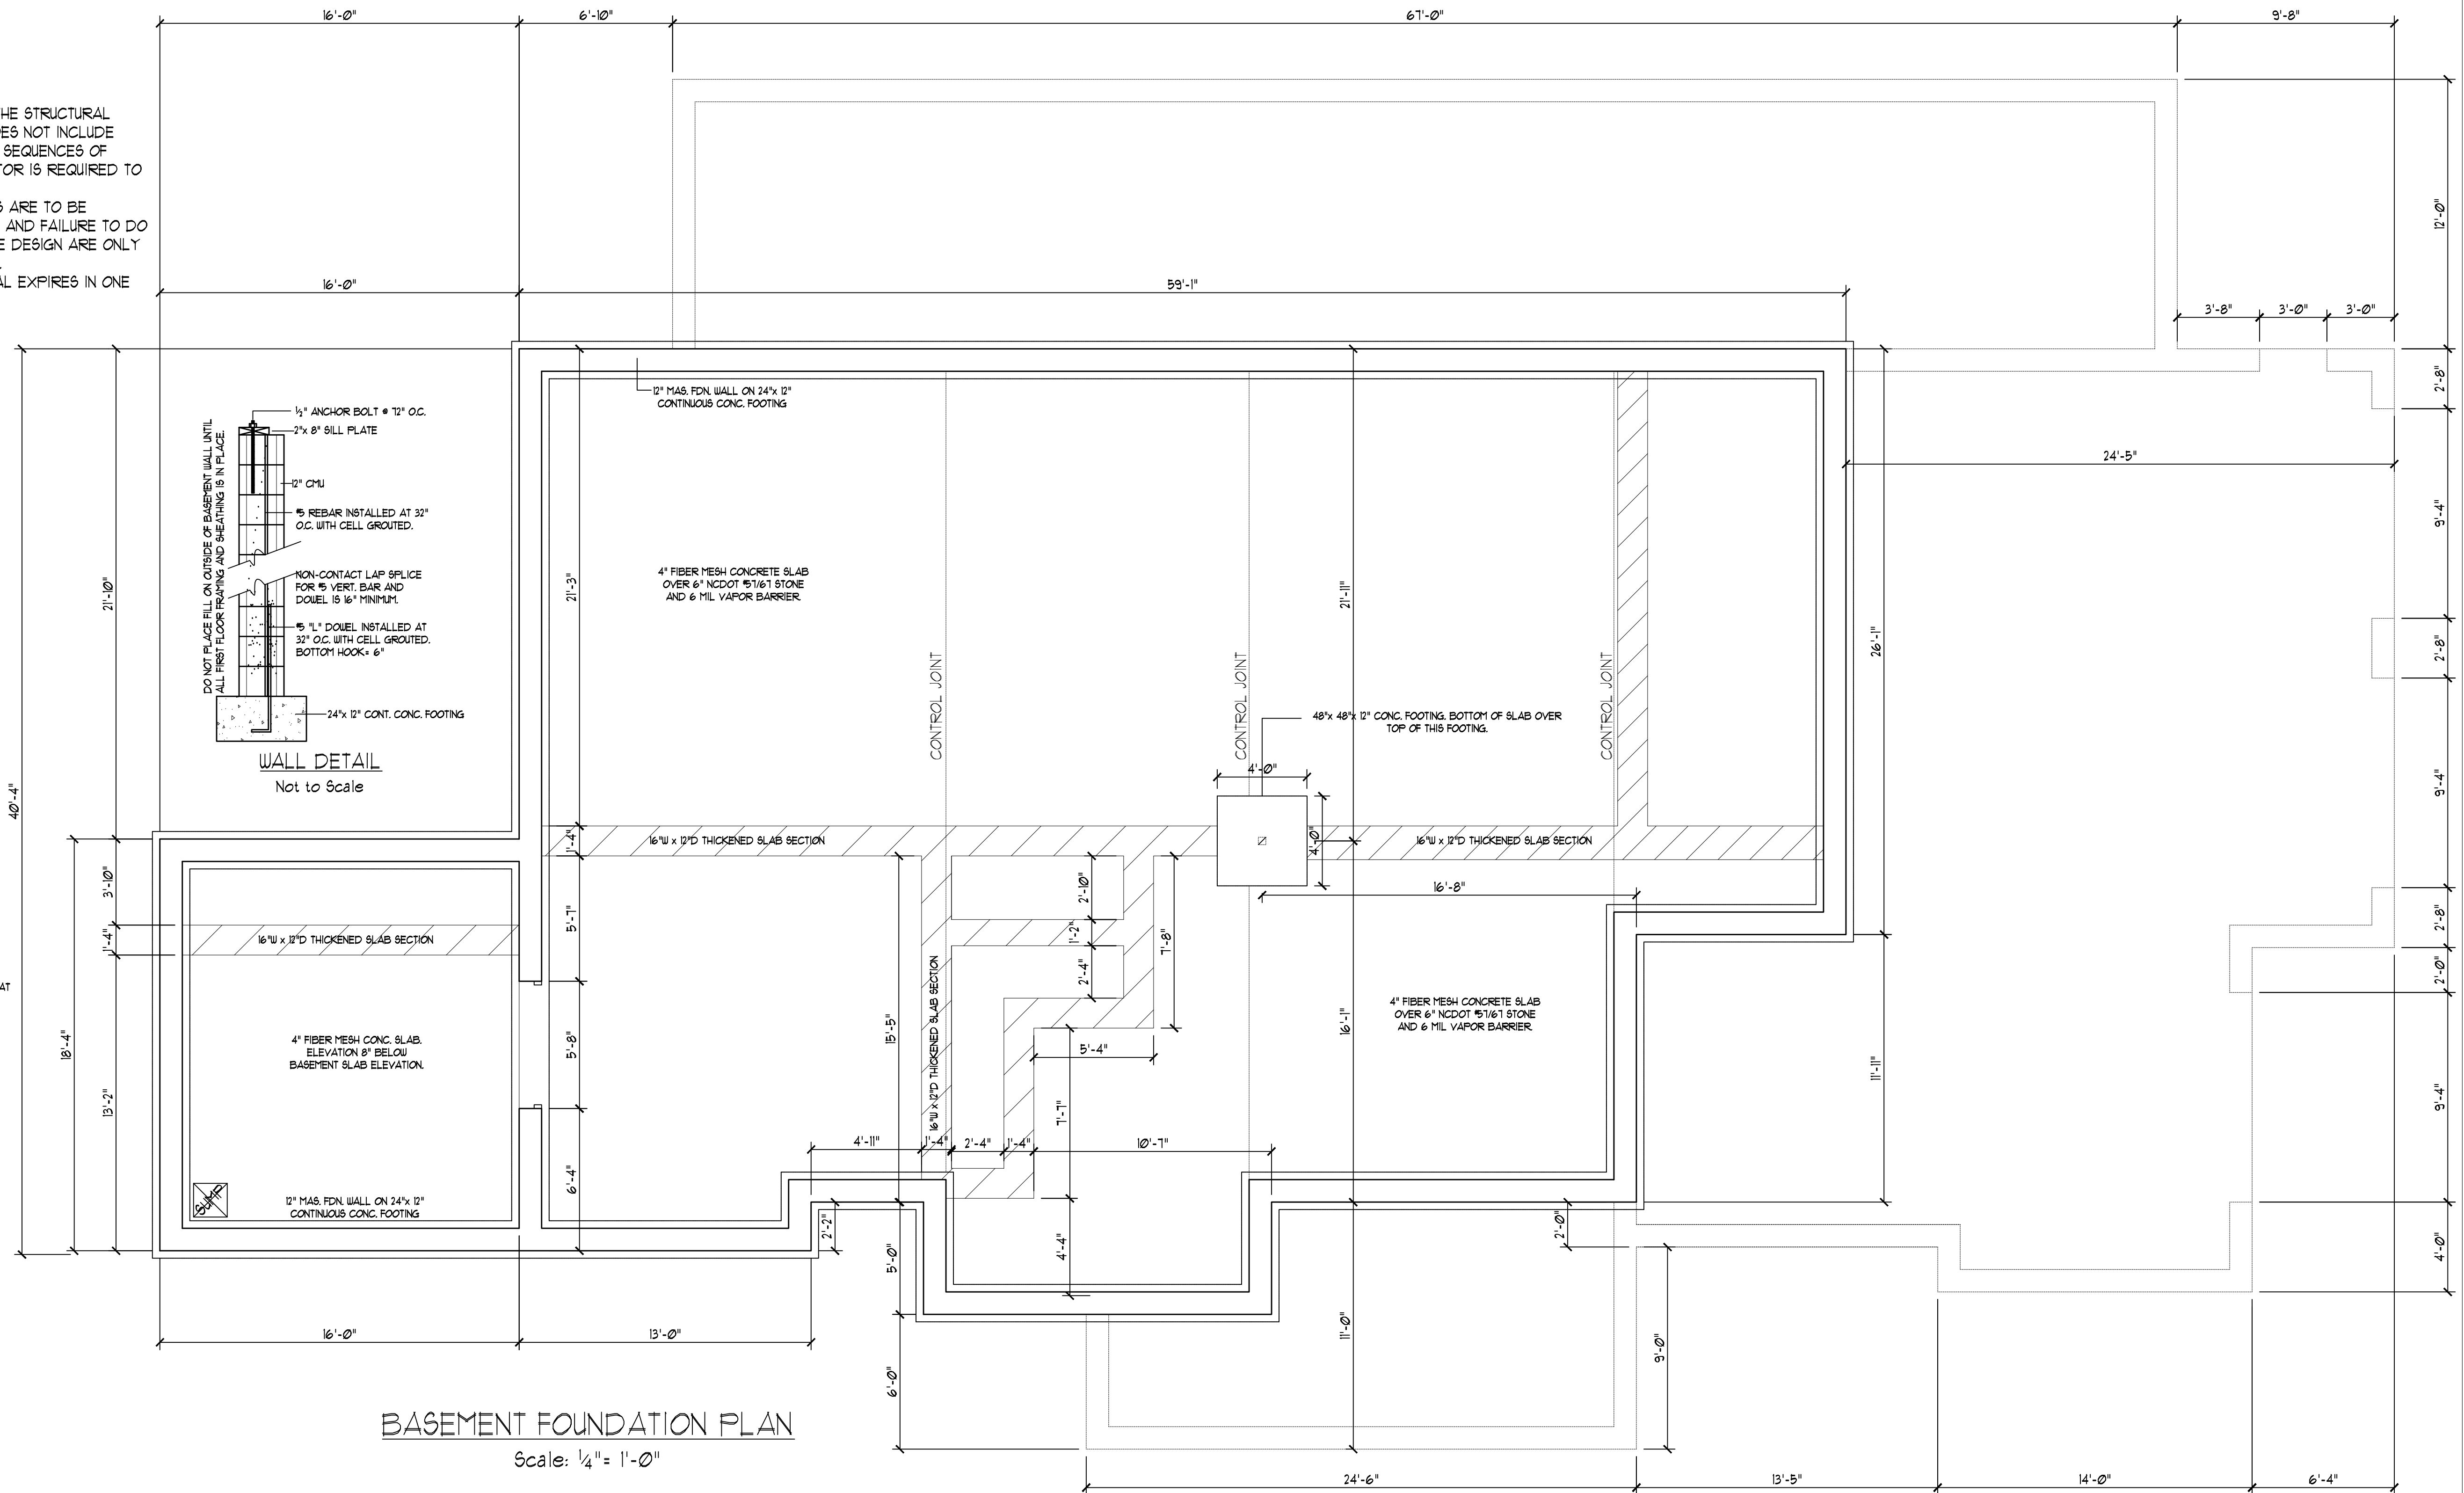

DO NOT SCALE THESE DRAWINGS. ALL DIMENSIONS AND SPACING ARE TO BE TAKEN FROM THESE DRAWINGS. ANY DISCREPANCIES OR OMISSIONS NOTED BY THE BUILDER AGREE TO NOTIFY THE ENGINEER IMMEDIATELY. THE ENGINEER'S LIABILITY IS LIMITED TO STRUCTURAL ITEMS ONLY. THE ENGINEER'S LIABILITY FOR CODE COMPLIANCE OF NON-STRUCTURAL ITEMS IS NOT ASSUMED.

COPYRIGHT 2020 WILKINS ENGINEERING, P.C. ALL RIGHTS RESERVED. THESE DRAWINGS ARE THE PROPERTY OF WILKINS ENGINEERING, P.C. AND ARE NOT TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, WITHOUT THE WRITTEN CONSENT OF THE ENGINEER. THE ENGINEER'S LIABILITY IS LIMITED TO STRUCTURAL ITEMS ONLY. THE ENGINEER'S LIABILITY FOR CODE COMPLIANCE OF NON-STRUCTURAL ITEMS IS NOT ASSUMED.

WILKINS ENGINEERING
 Post Office Box 31446
 Raleigh, NC 27621
 wilkinsengr@aol.com
 919.777.2840

ORIANA PLAN
 DO-4218


Sheet No.
 51

GENERAL FOUNDATION NOTES:

1. THIS PLAN DESIGNED IN ACCORDANCE WITH THE NORTH CAROLINA RESIDENTIAL BUILDING CODE, 2018 EDITION.
2. EXTERIOR WALL FOOTING TO BE A MINIMUM OF 16" WIDE AND CONSTRUCTED WITH 3000 PSI CONCRETE. FOR FOUNDATION WALL HEIGHT, THICKNESS AND BACKFILL REQUIREMENTS REFER TO STATE AND LOCAL BUILDING CODES. THE ASSUMED SOIL BEARING CAPACITY FOR THIS PROJECT IS 2000 PSF. THE CONTRACTOR MUST VERIFY THE SITE CONDITIONS AND CONTACT A SOILS ENGINEER IF MARGINAL OR UNSTABLE SOILS ARE ENCOUNTERED.
3. ALL FOOTINGS SHALL BEAR ON UNDISTURBED SUB-GRADE. A MINIMUM OF 12" BELOW ADJACENT FINISHED GRADE OR AS OTHERWISE DIRECTED BY THE LOCAL INSPECTOR.
4. FOUNDATION DRAINAGE SHALL BE IN ACCORDANCE WITH SECTION R405 "FOUNDATION DRAINAGE" AND SECTION R406 "FOUNDATION WATERPROOFING AND DAMPPROOFING".
5. ANCHOR BOLTS SHALL BE 1/2" DIAMETER AND INSTALLED AT 12" ON CENTER AND 12" FROM EACH CORNER OR SILL PLATE SPICE LOCATIONS.


STRUCTURAL EVALUATION BY:

WILKINS ENGINEERING, P.C.
 Post Office Box 31446
 Raleigh, North Carolina 27621



FILE:

*THE ENGINEER'S SEAL AND SIGNATURE APPLY ONLY TO THE STRUCTURAL ELEMENTS OF THIS DOCUMENT. ENGINEER'S APPROVAL DOES NOT INCLUDE CONSTRUCTION REVIEW, MEANS, METHODS, TECHNIQUES OR SEQUENCES OF CONSTRUCTION OR SAFETY REQUIREMENTS. THE CONTRACTOR IS REQUIRED TO ENSURE PROPER SAFETY PRECAUTIONS.
 *ANY DEVIATIONS OR DISCREPANCIES IN THESE DRAWINGS ARE TO BE BROUGHT TO THE IMMEDIATE ATTENTION OF THE ENGINEER AND FAILURE TO DO SO WILL VOID THE ENGINEER'S LIABILITY. CHANGES TO THE DESIGN ARE ONLY ALLOWED WITH THE WRITTEN APPROVAL OF THE ENGINEER.
 *DO NOT SCALE THESE DRAWINGS. ENGINEERING APPROVAL EXPIRES IN ONE YEAR.

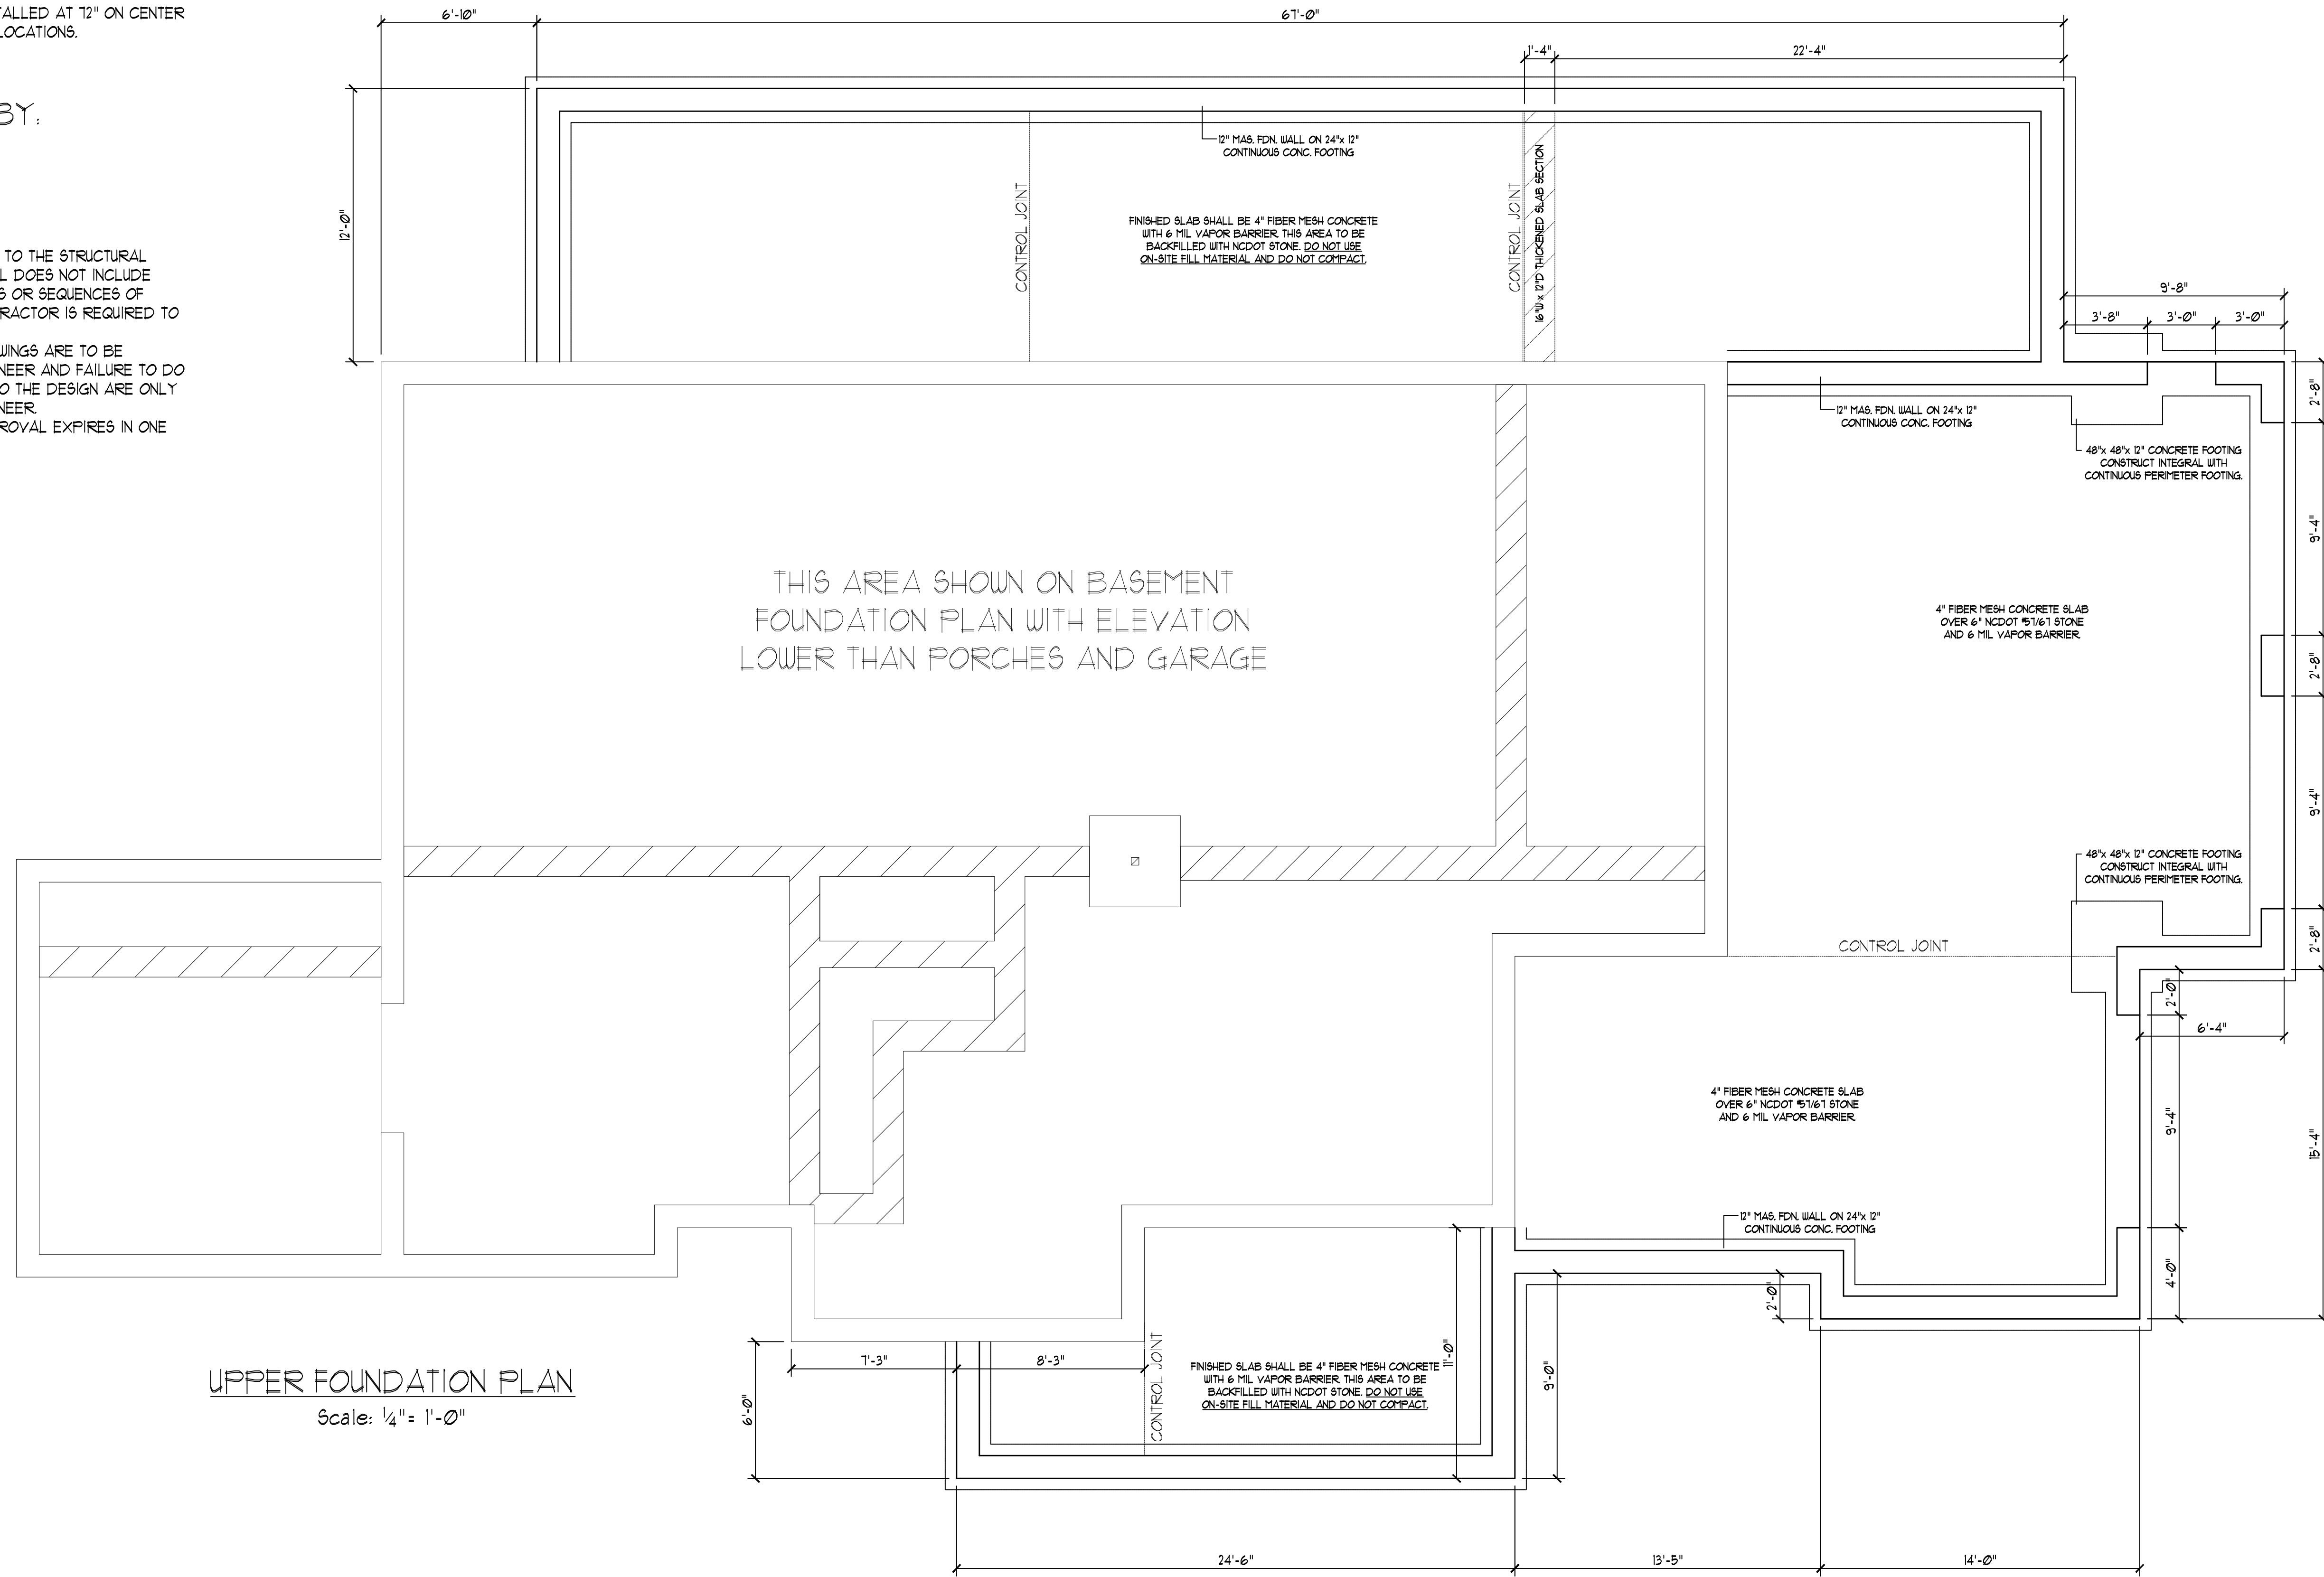

UPPER FOUNDATION PLAN
 Scale: 1/4" = 1'-0"

DO NOT SCALE THESE DRAWINGS. ALL DIMENSIONS AND SITE DIRECTIONS ARE TO BE VERIFIED BEFORE CONSTRUCTION BEGINS. SHOULD ANY DISCREPANCIES OR OMISSIONS BE NOTED, THE CONTRACTOR SHALL NOTIFY THE ENGINEER IMMEDIATELY. THE ENGINEER ASSUMES NO RESPONSIBILITY FOR CODE COMPLIANCE OF NON-STRUCTURAL ITEMS.

COPYRIGHT 2020 WILKINS ENGINEERING, P.C. THESE DRAWINGS ARE PROTECTED UNDER FEDERAL COPYRIGHT LAWS. THE ORIGINAL PURCHASER OF THESE DRAWINGS IS LICENSED TO USE THE PLANS FOR THE PROJECT AND SITE SPECIFICALLY IDENTIFIED. ANY REPRODUCTION OR MODIFICATION OF THESE DRAWINGS WITHOUT THE WRITTEN CONSENT OF THE ENGINEER IS EXPRESSLY PROHIBITED.

WILKINS ENGINEERING
 Post Office Box 31446
 Raleigh, NC 27621
 919.712.3540
 wilkinsengr@aol.com

ORIANA PLAN
 DO-4218

Sheet No.

5/1/21

GENERAL FOUNDATION NOTES:

1. THIS PLAN DESIGNED IN ACCORDANCE WITH THE NORTH CAROLINA RESIDENTIAL BUILDING CODE, 2018 EDITION.
2. EXTERIOR WALL FOOTING TO BE A MINIMUM OF 16" WIDE AND CONSTRUCTED WITH 3000 PSI CONCRETE. FOR FOUNDATION WALL HEIGHT, THICKNESS AND BACKFILL REQUIREMENTS REFER TO STATE AND LOCAL BUILDING CODES. THE ASSUMED SOIL BEARING CAPACITY FOR THIS PROJECT IS 2000 PSF. THE CONTRACTOR MUST VERIFY THE SITE CONDITIONS AND CONTACT A SOILS ENGINEER IF MARGINAL OR UNSTABLE SOILS ARE ENCOUNTERED.
3. ALL FOOTINGS SHALL BEAR ON UNDISTURBED SUB-GRADE A MINIMUM OF 1' BELOW ADJACENT FINISHED GRADE OR AS OTHERWISE DIRECTED BY THE LOCAL INSPECTOR.

GENERAL NOTES:

1. THIS PLAN IS DESIGNED IN ACCORDANCE WITH THE NORTH CAROLINA RESIDENTIAL BUILDING CODE, 2018 EDITION.
2. WALL CLADDING IS DESIGNED FOR A POSITIVE/NEGATIVE PRESSURE OF NOT LESS THAN 241 PSF.
3. ROOF CLADDING DESIGN VALUES (POSITIVE/NEGATIVE) SHALL BE AS FOLLOWS:
45.9 PSF FOR ROOF PITCHES FROM 0/12 TO 1/12
34.5 PSF FOR ROOF PITCHES FROM 1/12 TO 1/12
21.0 PSF FOR ROOF PITCHES FROM 1/12 TO 1/12
MEAN ROOF HEIGHT FOR THIS STRUCTURE IS 14'
5. DESIGN CRITERIA IS AS FOLLOWS:

	DEAD LOAD (PSF)	LIVE LOAD (PSF)
PRIMARY FLOOR	10	40
SECONDARY FLOOR	10	40
SLEEPING AREAS	10	40
ATTIC (W/ STAIRS)	10	30
ATTIC (W/O STAIRS)	10	20
ROOF	10	20

WIND LOADING IS BASED ON 3 SECOND GUST OF 130 MPH PER HOUR
LIVE LOAD DEFLECTION LIMITS (LIVE LOAD) ARE L/360 FOR FLOORS, L/240 FOR ROOF
6. ALL HEADERS IN LOAD BEARING WALL SHALL BE 2-2"x 10" UNLESS NOTED OTHERWISE.
FULL HEIGHT KING STUDS SHALL BE INSTALLED ON EACH SIDE OF EXTERIOR WALL HEADERS AND BEAMS AS FOLLOWS:

HEADER SPAN	STUDS @ 16" O.C.	STUDS @ 24" O.C.
3'-0"	1	1
4'-0"	2	1
8'-0"	3	2
12'-0"	5	3
16'-0"	6	4

7. ALL LUMBER USED FOR JOISTS AND RAFTERS SHALL BE #2 SYP OR BETTER LUMBER USED FOR STUD WALL SHALL BE #2 SYP OR BETTER.
8. LVL SHALL BE LAMINATED VENEER LUMBER OR PARALLEL STRAND LUMBER WITH THE FOLLOWING MINIMUM PROPERTIES: Fv=2000 PSI, Fv=205 PSI, E=1,000,000 PSI. MULTIPLE LVL PLIES CAN BE USED TO ACHIEVE THE SPECIFIED SIZE SHOWN ON THESE PLANS AND IS CONSIDERED TO BE STRUCTURALLY EQUIVALENT.


GENERAL ROOF NOTES:

1. THIS PLAN DESIGNED IN ACCORDANCE WITH THE NORTH CAROLINA RESIDENTIAL BUILDING CODE, 2018 EDITION.
2. ROOF CLADDING DESIGN VALUES (POSITIVE/NEGATIVE) SHALL BE AS FOLLOWS:
45.9 PSF FOR ROOF PITCHES FROM 0/12 TO 1/12
34.5 PSF FOR ROOF PITCHES FROM 1/12 TO 1/12
21.0 PSF FOR ROOF PITCHES FROM 1/12 TO 1/12
MEAN ROOF HEIGHT FOR THIS STRUCTURE IS 14'
3. ALL ROOFING ELEMENTS SHALL MEET THE REQUIREMENTS OF CHAPTER 8 OF THE BUILDING CODE.
4. ALL LUMBER SHALL BE #2 SYP OR BETTER.
5. THIS ROOF AND STRUCTURE ARE DESIGNED FOR A DESIGN WIND SPEED OF 130 MPH.
6. ROOF TRUSSES (IF USED) SHALL BE DESIGNED BY THE MANUFACTURER AND THE ANALYSIS SHALL BE PROVIDED TO THE ENGINEER FOR REVIEW AND APPROVAL PRIOR TO CONSTRUCTION.


STRUCTURAL EVALUATION BY:

WILKINS ENGINEERING, P.C.
Post Office Box 31449
Raleigh North Carolina 27621
8/7/2023

- *THE ENGINEER'S SEAL AND SIGNATURE APPLY ONLY TO THE STRUCTURAL ELEMENTS OF THIS DOCUMENT. ENGINEER'S APPROVAL DOES NOT INCLUDE CONSTRUCTION REVIEW, MEANS, METHODS, TECHNIQUES OR SEQUENCES OF CONSTRUCTION OR SAFETY REQUIREMENTS. THE CONTRACTOR IS REQUIRED TO ENSURE PROPER SAFETY PRECAUTIONS.
- *ANY DEVIATIONS OR DISCREPANCIES IN THESE DRAWINGS ARE TO BE BROUGHT TO THE IMMEDIATE ATTENTION OF THE ENGINEER AND FAILURE TO DO SO WILL VOID THE ENGINEER'S LIABILITY. CHANGES TO THE DESIGN ARE ONLY ALLOWED WITH THE WRITTEN APPROVAL OF THE ENGINEER.
- *DO NOT SCALE THESE DRAWINGS. ENGINEERING APPROVAL EXPIRES IN ONE YEAR.

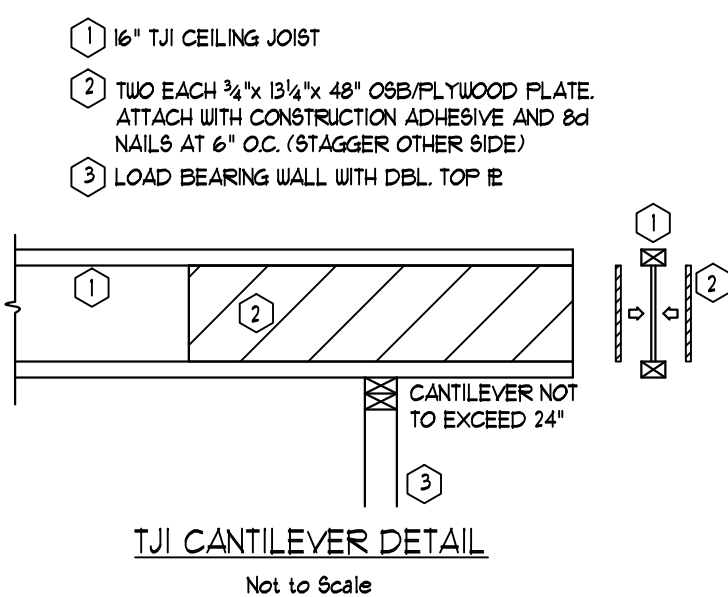

NOTE TO BUILDER: THIS DESIGN UTILIZES AN ENGINEERED FLOOR FRAMING SYSTEM AND CEILING JOIST AS WELL AS DIMENSIONAL LUMBER. THE BUILDER MAY ELECT TO UTILIZE MANUFACTURED FLOOR TRUSSES DESIGNED BY OTHERS. GIRDER TRUSSES MAY BE USED IN LIEU OF SPECIFIED BEAMS.

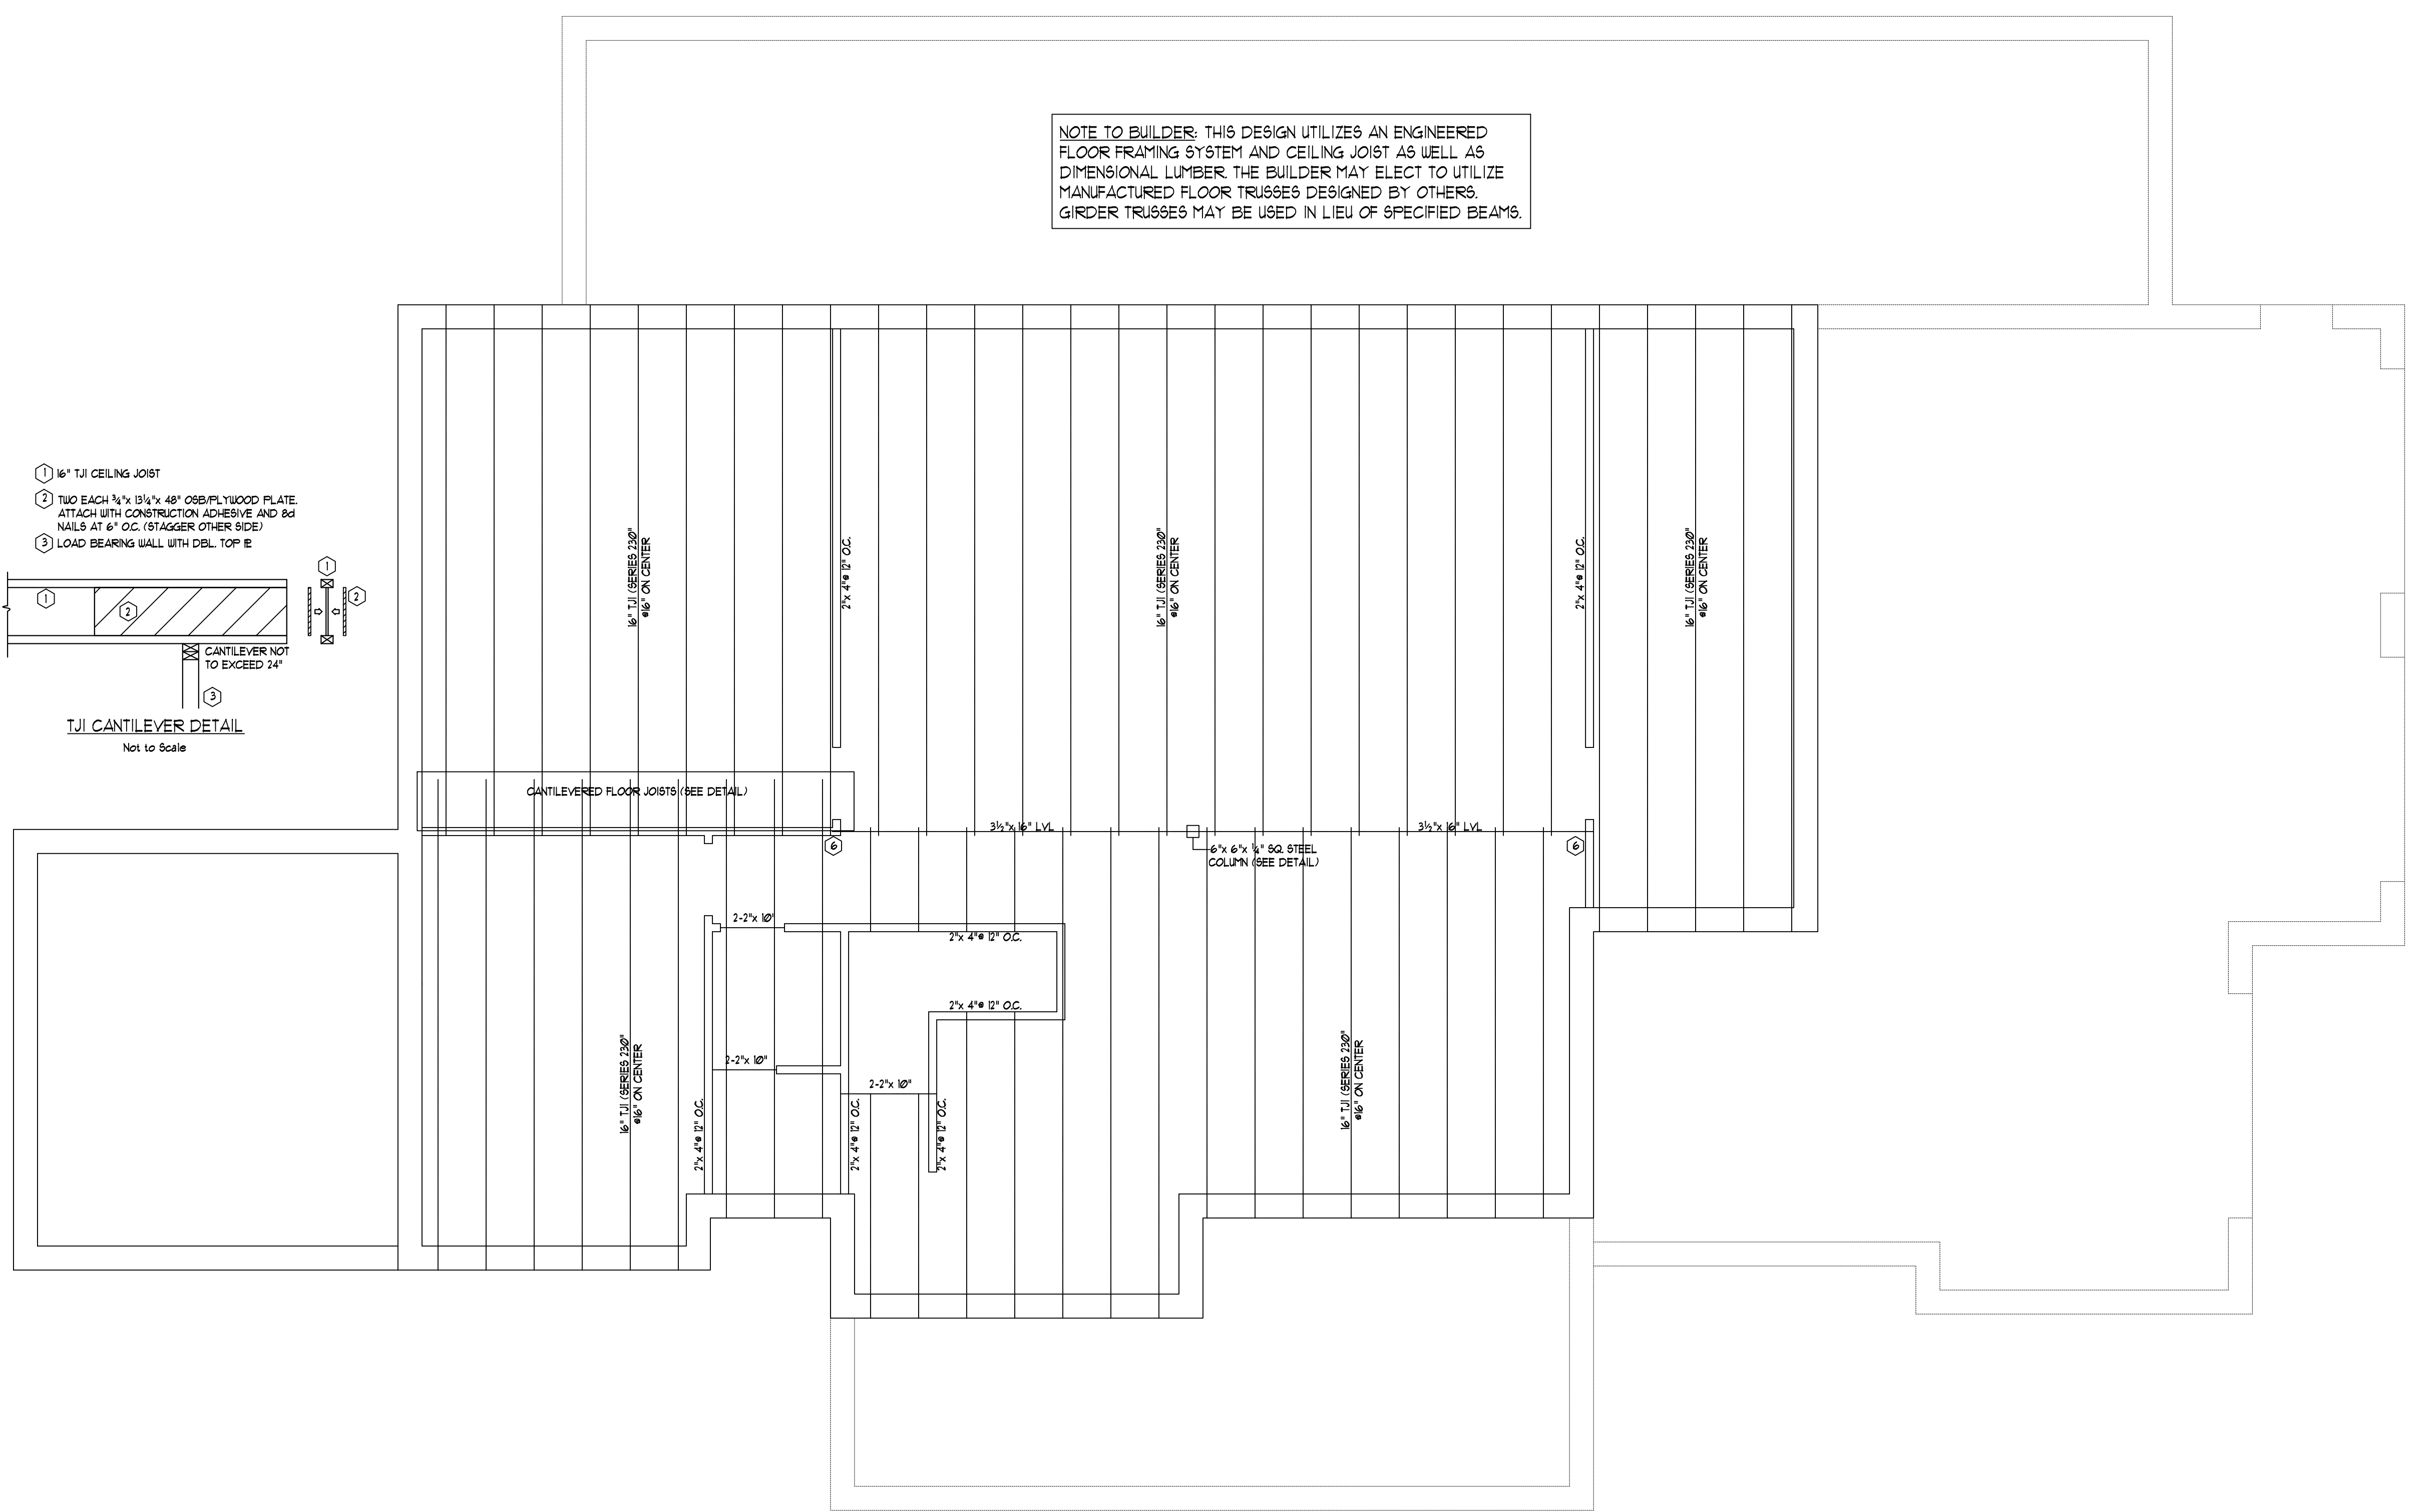

BASEMENT CEILING PLAN
Scale: 1/4" = 1'-0"

WILKINS ENGINEERING, P.C.
 THESE DRAWINGS ARE PROTECTED UNDER FEDERAL COPYRIGHT LAWS. THE ORIGINAL PURCHASER OF THESE DRAWINGS OR ONE WHO OBTAINS THEM FROM THE ORIGINAL PURCHASER SHALL BE RESPONSIBLE FOR THE PROTECTION OF THESE DRAWINGS WITHOUT THE WRITTEN CONSENT OF THE ENGINEER. REPRODUCTION, MODIFICATION, OR REUSE OF THESE DRAWINGS WITHOUT THE WRITTEN CONSENT OF THE ENGINEER IS EXPRESSLY PROHIBITED.
 WILKINS ENGINEERING, P.C.
 Post Office Box 31446
 Raleigh, NC 27621
 919.771.3540
 wilkinsengr@aol.com
 ORIANA PLAN
 DO-4218
 Sheet No.
 S2

GENERAL NOTES:

- 1. THIS PLAN IS DESIGNED IN ACCORDANCE WITH THE NORTH CAROLINA RESIDENTIAL BUILDING CODE, 2018 EDITION.
- 2. WALL CLADDING IS DESIGNED FOR A POSITIVE/NEGATIVE PRESSURE OF NOT LESS THAN 241 PSF.
- 3. ROOF CLADDING DESIGN VALUES (POSITIVE/NEGATIVE) SHALL BE AS FOLLOWS:
 - 45.5 PSF FOR ROOF PITCHES FROM 0/12 TO 2.25/12
 - 34.5 PSF FOR ROOF PITCHES FROM 2.25/12 TO 1/12
 - 21.0 PSF FOR ROOF PITCHES FROM 1/12 TO 0/12
 MEAN ROOF HEIGHT FOR THIS STRUCTURE IS 18'.
- 4. ALL WALLS, CEILINGS, AND FLOORS SHALL BE INSULATED IN ACCORDANCE WITH PART IV, ENERGY CONSERVATION, CHAPTER II, ENERGY EFFICIENCY OF THE CODE FOR ZONE 4I (TABLE n1601.21)
- 5. DESIGN CRITERIA IS AS FOLLOWS:

PRIMARY FLOOR	DEAD LOAD (PSF)	LIVE LOAD (PSF)
SECONDARY FLOOR	10	40
SLEEPING AREAS	10	40
ATTIC (W/ STAIRS)	10	30
ATTIC (W/O STAIRS)	10	20
ROOF	10	20




 WIND LOADING IS BASED ON 3 SECOND GUST OF 15 MILES PER HOUR. LIVE LOAD DEFLECTION LIMITS (LIVE LOAD) ARE L/360 FOR FLOORS, L/240 FOR ROOF. 6. ALL HEADERS IN LOAD BEARING WALL SHALL BE 2-2"x 10" UNLESS NOTED OTHERWISE. FULL HEIGHT KING STUDS SHALL BE INSTALLED ON EACH SIDE OF EXTERIOR WALL HEADERS AND BEAMS AS FOLLOWS:

HEADER SPAN	STUDS @ 16" O.C.	STUDS @ 24" O.C.
3'-0"	1	1
4'-0"	2	1
8'-0"	3	2
12'-0"	5	3
16'-0"	6	4
- 7. ALL LUMBER USED FOR JOISTS AND RAFTERS SHALL BE #2 SFF OR BETTER LUMBER USED FOR STUD WALL SHALL BE #3 SFF OR BETTER.
- 8. LVL SHALL BE LAMINATED VENEER LUMBER OR PARALLEL STRAND LUMBER WITH THE FOLLOWING MINIMUM PROPERTIES: F_b=2800 PSI, F_v=285 PSI, E=2,000,000 PSI. MULTIPLE LVL PLIES CAN BE USED TO ACHIEVE THE SPECIFIED SIZE SHOWN ON THESE PLANS AND IS CONSIDERED TO BE STRUCTURALLY EQUIVALENT.
- 9. THE FOLLOWING SHALL APPLY TO ALL BRACED WALL LINES: ALL EXTERIOR WALLS SHALL BE CONTINUOUSLY SHEATHED WITH 1/2" OSB OR CDX WSP SHALL BE IN ACCORDANCE WITH R-602.10.3 AND SHALL BE COVERED WITH 1/2" GYPSUM BOARD ON THE INTERIOR FACE. ALL WSP PANELS SHALL BE FASTENED WITH 8d NAILS AT 12" ON CENTER (FIELD) AND 6" ON CENTER (EDGES). ALL EXTERIOR WALLS SHALL BE 2"x 4" AT 16" ON CENTER AS A MINIMUM (EXCEPT FOR BALLOON FRAMED WALL SECTIONS AS NOTED) AND CONTINUOUSLY SHEATHED.

STRUCTURAL EVALUATION BY:

WILKINS ENGINEERING, P.C.
 Post Office Box 31449
 Raleigh North Carolina 27621
 FILE: ORIANA
 8/7/2023

THE ENGINEER'S SEAL AND SIGNATURE APPLY ONLY TO THE STRUCTURAL ELEMENTS OF THIS DOCUMENT. ENGINEER'S APPROVAL DOES NOT INCLUDE CONSTRUCTION REVIEW, MEANS, METHODS, TECHNIQUES OR SEQUENCES OF CONSTRUCTION OR SAFETY REQUIREMENTS. THE CONTRACTOR IS REQUIRED TO ENSURE PROPER SAFETY PRECAUTIONS.
 ANY DEVIATIONS OR DISCREPANCIES IN THESE DRAWINGS ARE TO BE BROUGHT TO THE IMMEDIATE ATTENTION OF THE ENGINEER AND FAILURE TO DO SO WILL VOID THE ENGINEER'S LIABILITY. CHANGES TO THE DESIGN ARE ONLY ALLOWED WITH THE WRITTEN APPROVAL OF THE ENGINEER.
 DO NOT SCALE THESE DRAWINGS. ENGINEERING APPROVAL EXPIRES IN ONE YEAR.

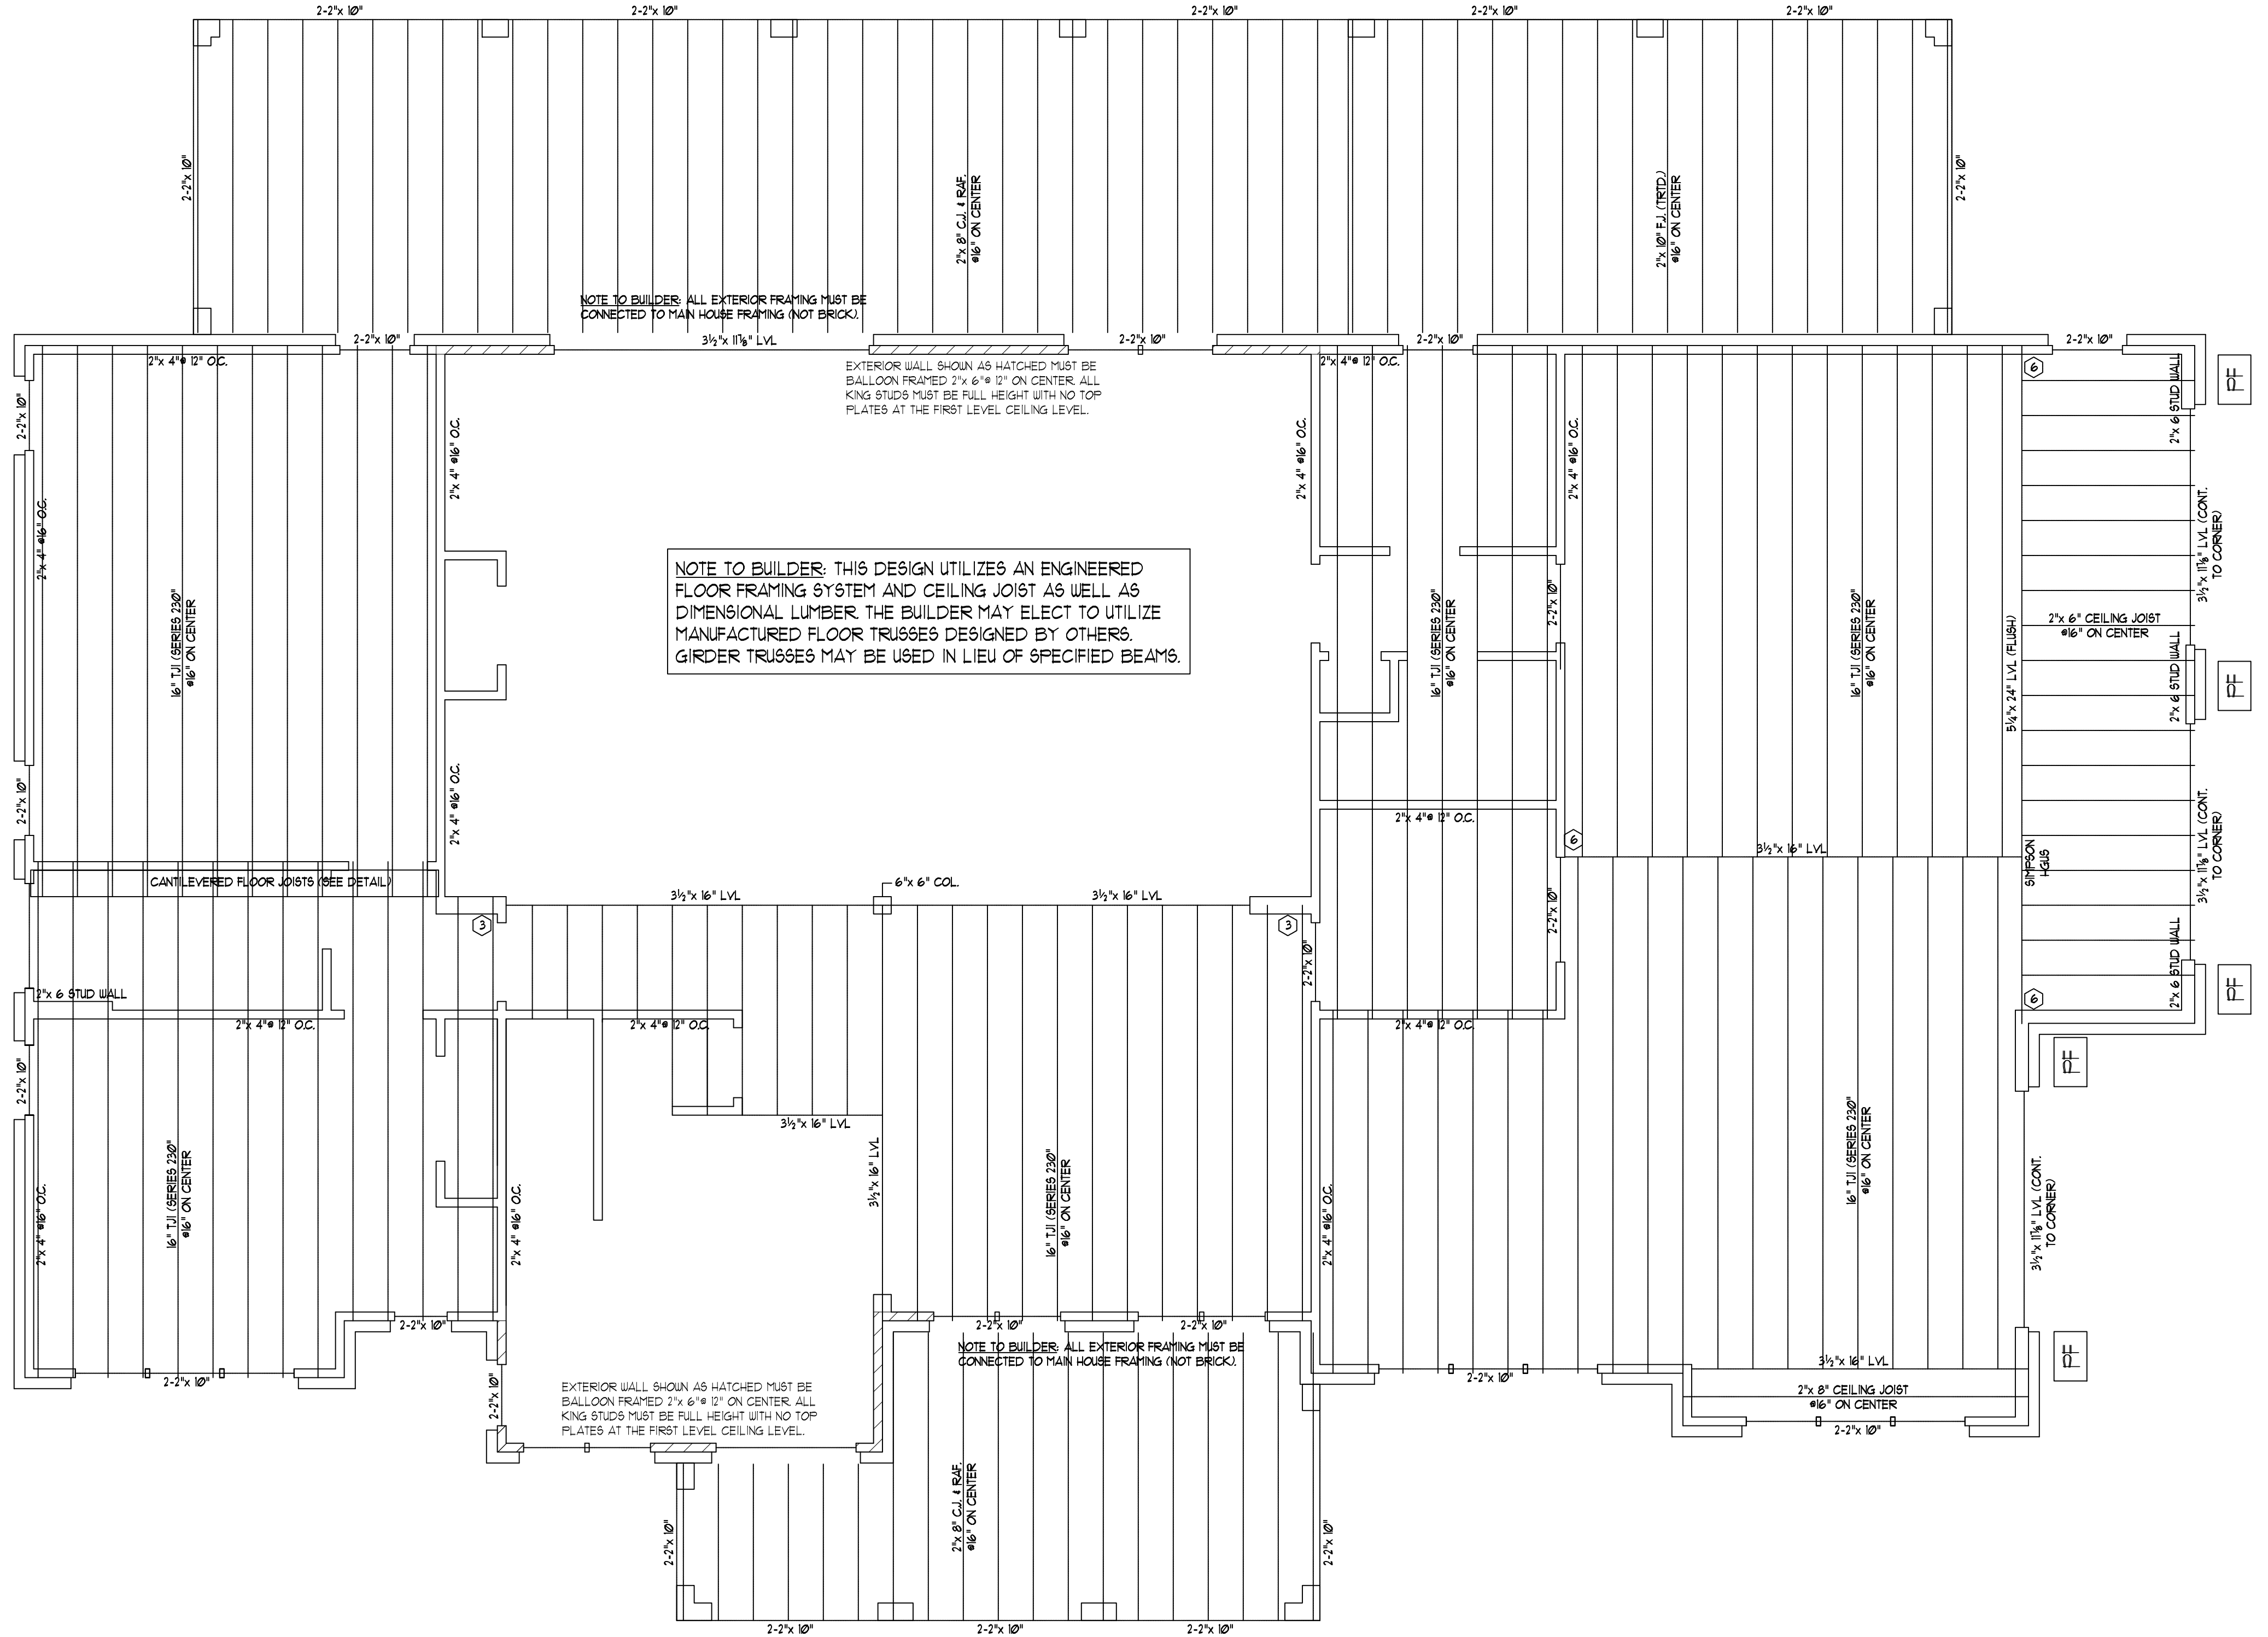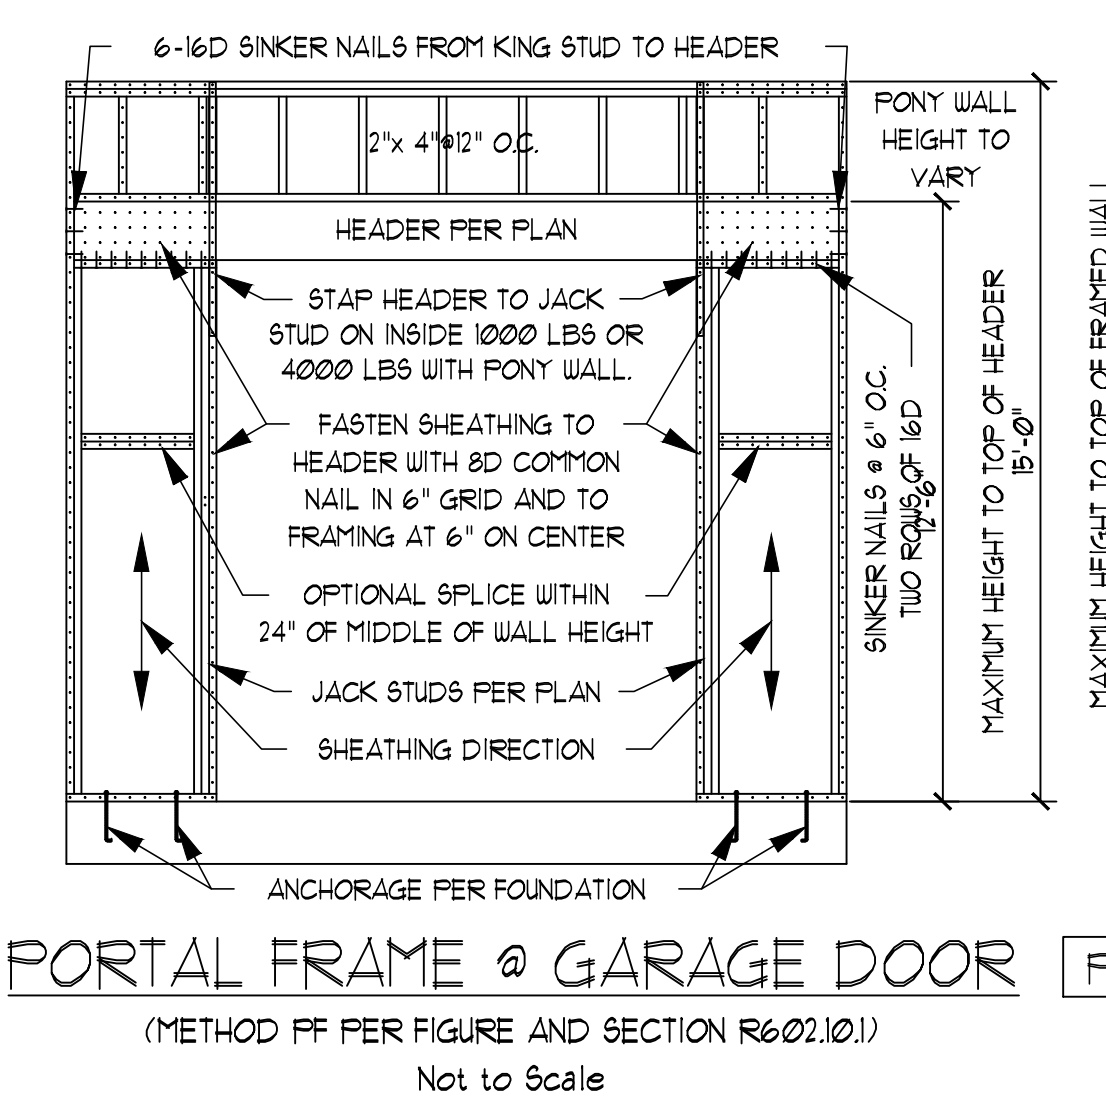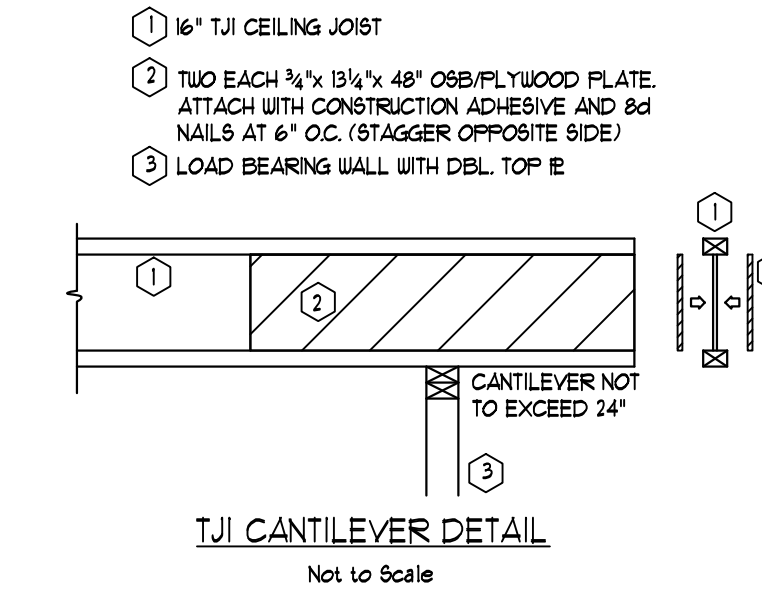

FIRST FLOOR PLAN
 Scale: 1/4" = 1'-0"

DO NOT SCALE THESE DRAWINGS. ALL DIMENSIONS AND SITE DIMENSIONS ARE TO BE VERIFIED BEFORE CONSTRUCTION BEGINS. SHOULD CONSTRUCTION DISCREPANCIES BE IDENTIFIED, THE BUILDER AGREES TO NOTIFY THE ENGINEER IMMEDIATELY. THESE DRAWINGS APPLY TO STRUCTURAL ELEMENTS ONLY. THE ENGINEER ASSUMES NO RESPONSIBILITY FOR CODE COMPLIANCE OF NON-STRUCTURAL ITEMS.

COPYRIGHT 2020 WILKINS ENGINEERING, P.C. THESE DRAWINGS ARE PROTECTED UNDER FEDERAL COPYRIGHT LAWS. THE ORIGINAL PURCHASER OF THESE DRAWINGS IS THE ONLY PARTY PERMITTED TO REPRODUCE OR TRANSMIT THESE DRAWINGS IN ANY FORM OR BY ANY MEANS, WITHOUT THE WRITTEN CONSENT OF THE ENGINEER. THIS AGREEMENT IS PROHIBITED.

WILKINS ENGINEERING
 Post Office Box 31446
 Raleigh, NC 27621
 919.712.3540
 wilkinsengr@aol.com

ORIANA PLAN
 DO-4218

Sheet No.

53

GENERAL NOTES:

- THIS PLAN IS DESIGNED IN ACCORDANCE WITH THE NORTH CAROLINA RESIDENTIAL BUILDING CODE, 2018 EDITION.
- WALL CLADDING IS DESIGNED FOR A POSITIVE/NEGATIVE PRESSURE OF NOT LESS THAN 241 PSF.
- ROOF CLADDING DESIGN VALUES (POSITIVE/NEGATIVE) SHALL BE AS FOLLOWS:
 - 45.5 PSF FOR ROOF PITCHES FROM 0/12 TO 2.25/12
 - 34.5 PSF FOR ROOF PITCHES FROM 2.25/12 TO 1/12
 - 21.0 PSF FOR ROOF PITCHES FROM 1/12 TO 12/12
 MEAN ROOF HEIGHT FOR THIS STRUCTURE IS 10'.
- ALL WALLS, CEILINGS, AND FLOORS SHALL BE INSULATED IN ACCORDANCE WITH PART IV, ENERGY CONSERVATION, CHAPTER 11, ENERGY EFFICIENCY OF THE CODE FOR ZONE 4I (TABLE 1102.1).
- DESIGN CRITERIA IS AS FOLLOWS:

PRIMARY FLOOR	DEAD LOAD (PSF)	LIVE LOAD (PSF)
PRIMARY FLOOR	10	40
SECONDARY FLOOR	10	40
SLEEPING AREAS	10	40
ATTIC (W/ STAIRS)	10	30
ATTIC (W/O STAIRS)	10	20
ROOF	10	20

 WIND LOADING IS BASED ON 3 SECOND GUST OF 115 MILES PER HOUR. LIVE LOAD DEFLECTION LIMITS (LIVE LOAD) ARE L/360 FOR FLOORS, L/240 FOR ROOF.
- ALL HEADERS IN LOAD BEARING WALL SHALL BE 2"x 10" UNLESS NOTED OTHERWISE. FULL HEIGHT KING STUDS SHALL BE INSTALLED ON EACH SIDE OF EXTERIOR WALL. HEADERS AND BEAMS AS FOLLOWS:

HEADER SPAN	STUDS @ 16" O.C.	STUDS @ 24" O.C.
3'-0"	1	1
4'-0"	2	1
5'-0"	3	2
12'-0"	5	3
16'-0"	6	4
- ALL LUMBER USED FOR JOISTS AND RAFTERS SHALL BE #2 SFF OR BETTER LUMBER. USED FOR STUD WALL SHALL BE #3 SFF OR BETTER.


- L.V.L. SHALL BE LAMINATED VENEER LUMBER OR PARALLEL STRAND LUMBER WITH THE FOLLOWING MINIMUM PROPERTIES: Fb+2800 PSI, Fv+285 PSI, E+2,000,000 PSI. MULTIPLE L.V.L. PLIES CAN BE USED TO ACHIEVE THE SPECIFIED SIZE SHOWN ON THESE PLANS AND IS CONSIDERED TO BE STRUCTURALLY EQUIVALENT.
- THE FOLLOWING SHALL APPLY TO ALL BRACED WALL LINES: ALL EXTERIOR WALLS SHALL BE CONTINUOUSLY SHEATHED WITH 1/2" OSB OR CDX USFP SHALL BE IN ACCORDANCE WITH R-50/103 AND SHALL BE COVERED WITH 1/2" GYPSUM BOARD ON THE INTERIOR FACE. ALL USFP PANELS SHALL BE FASTENED WITH 8d NAILS AT 12" ON CENTER (FIELD) AND 6" ON CENTER (EDGES). ALL EXTERIOR WALLS SHALL BE 2"x 4" AT 16" ON CENTER AS A MINIMUM (EXCEPT FOR BALLOON FRAMED WALL SECTIONS AS NOTED) AND CONTINUOUSLY SHEATHED.

STRUCTURAL EVALUATION BY:

WILKINS ENGINEERING, P.C.
 Post Office Box 37446
 Raleigh, North Carolina 27627

FILE: ORIANA
8/7/2023

*THE ENGINEER'S SEAL AND SIGNATURE APPLY ONLY TO THE STRUCTURAL ELEMENTS OF THIS DOCUMENT. ENGINEER'S APPROVAL DOES NOT INCLUDE CONSTRUCTION REVIEW, MEANS, METHODS, TECHNIQUES OR SEQUENCES OF CONSTRUCTION OR SAFETY REQUIREMENTS. THE CONTRACTOR IS REQUIRED TO ENSURE PROPER SAFETY PRECAUTIONS.
 *ANY DEVIATIONS OR DISCREPANCIES IN THESE DRAWINGS ARE TO BE BROUGHT TO THE IMMEDIATE ATTENTION OF THE ENGINEER AND FAILURE TO DO SO WILL VOID THE ENGINEER'S LIABILITY. CHANGES TO THE DESIGN ARE ONLY ALLOWED WITH THE WRITTEN APPROVAL OF THE ENGINEER.
 *DO NOT SCALE THESE DRAWINGS. ENGINEERING APPROVAL EXPIRES IN ONE YEAR.

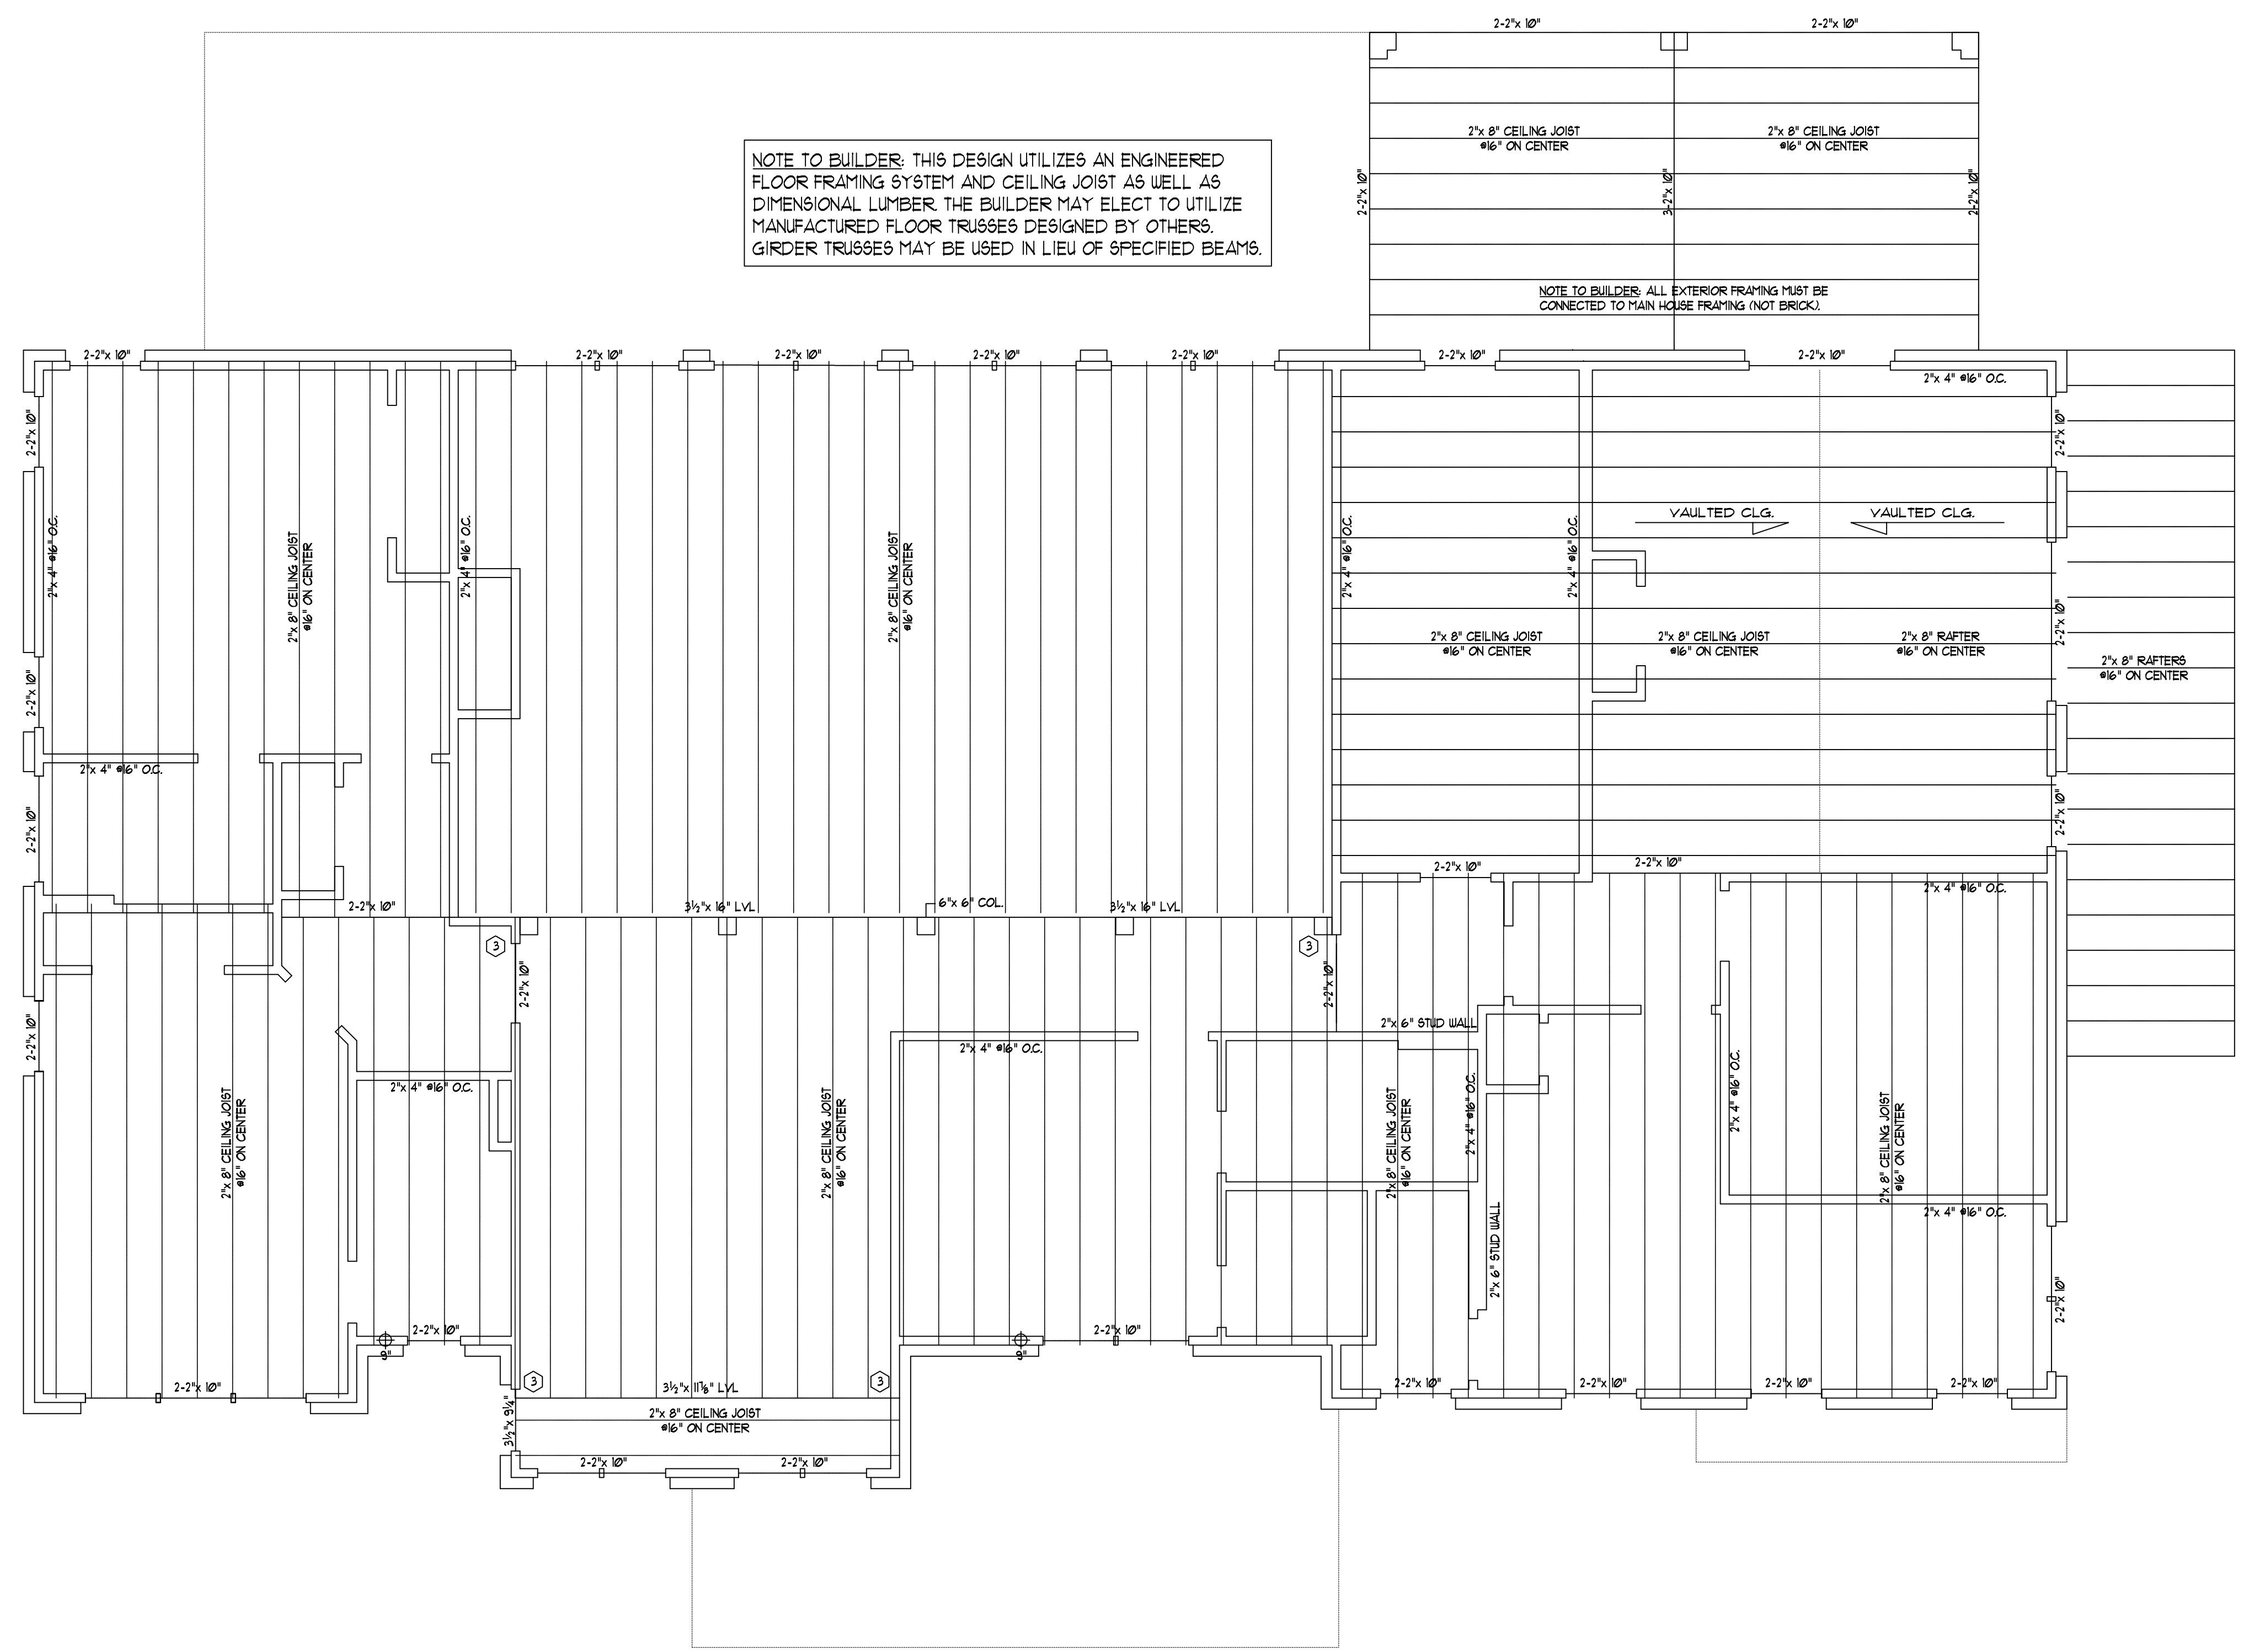


GENERAL ROOF NOTES:

1. THIS PLAN DESIGNED IN ACCORDANCE WITH THE NORTH CAROLINA RESIDENTIAL BUILDING CODE, 2018 EDITION.
2. ROOF CLADDING DESIGN VALUES (POSITIVE/NEGATIVE) SHALL BE AS FOLLOWS:
45.5 PSF FOR ROOF PITCHES FROM 0/12 TO 2/25/12
34.5 PSF FOR ROOF PITCHES FROM 2/25/12 TO 1/12
21.0 PSF FOR ROOF PITCHES FROM 1/12 TO 0/12
MEAN ROOF HEIGHT FOR THIS STRUCTURE IS 18'
3. ALL ROOFING ELEMENTS SHALL MEET THE REQUIREMENTS OF CHAPTER 8 OF THE BUILDING CODE.
4. ALL LUMBER SHALL BE #2 SPF, SYP, OR BETTER.
5. THIS ROOF AND STRUCTURE ARE DESIGNED FOR A DESIGN WIND SPEED OF 115 MPH.
6. ROOF TRUSSES (IF USED) SHALL BE DESIGNED BY THE MANUFACTURER AND THE ANALYSIS SHALL BE PROVIDED TO THE ENGINEER FOR REVIEW AND APPROVAL PRIOR TO CONSTRUCTION.


STRUCTURAL EVALUATION BY:

WILKINS ENGINEERING, P.C.
Post Office Box 31446
Raleigh, North Carolina 27621



FILE: ORIANA
8/7/2023

THE ENGINEER'S SEAL AND SIGNATURE APPLY ONLY TO THE STRUCTURAL ELEMENTS OF THIS DOCUMENT. ENGINEER'S APPROVAL DOES NOT INCLUDE CONSTRUCTION REVIEW, MEANS, METHODS, TECHNIQUES OR SEQUENCES OF CONSTRUCTION OR SAFETY REQUIREMENTS. THE CONTRACTOR IS REQUIRED TO ENSURE PROPER SAFETY PRECAUTIONS.
ANY DEVIATIONS OR DISCREPANCIES IN THESE DRAWINGS ARE TO BE BROUGHT TO THE IMMEDIATE ATTENTION OF THE ENGINEER AND FAILURE TO DO SO WILL VOID THE ENGINEER'S LIABILITY. CHANGES TO THE DESIGN ARE ONLY ALLOWED WITH THE WRITTEN APPROVAL OF THE ENGINEER.
DO NOT SCALE THESE DRAWINGS. ENGINEERING APPROVAL EXPIRES IN ONE YEAR.

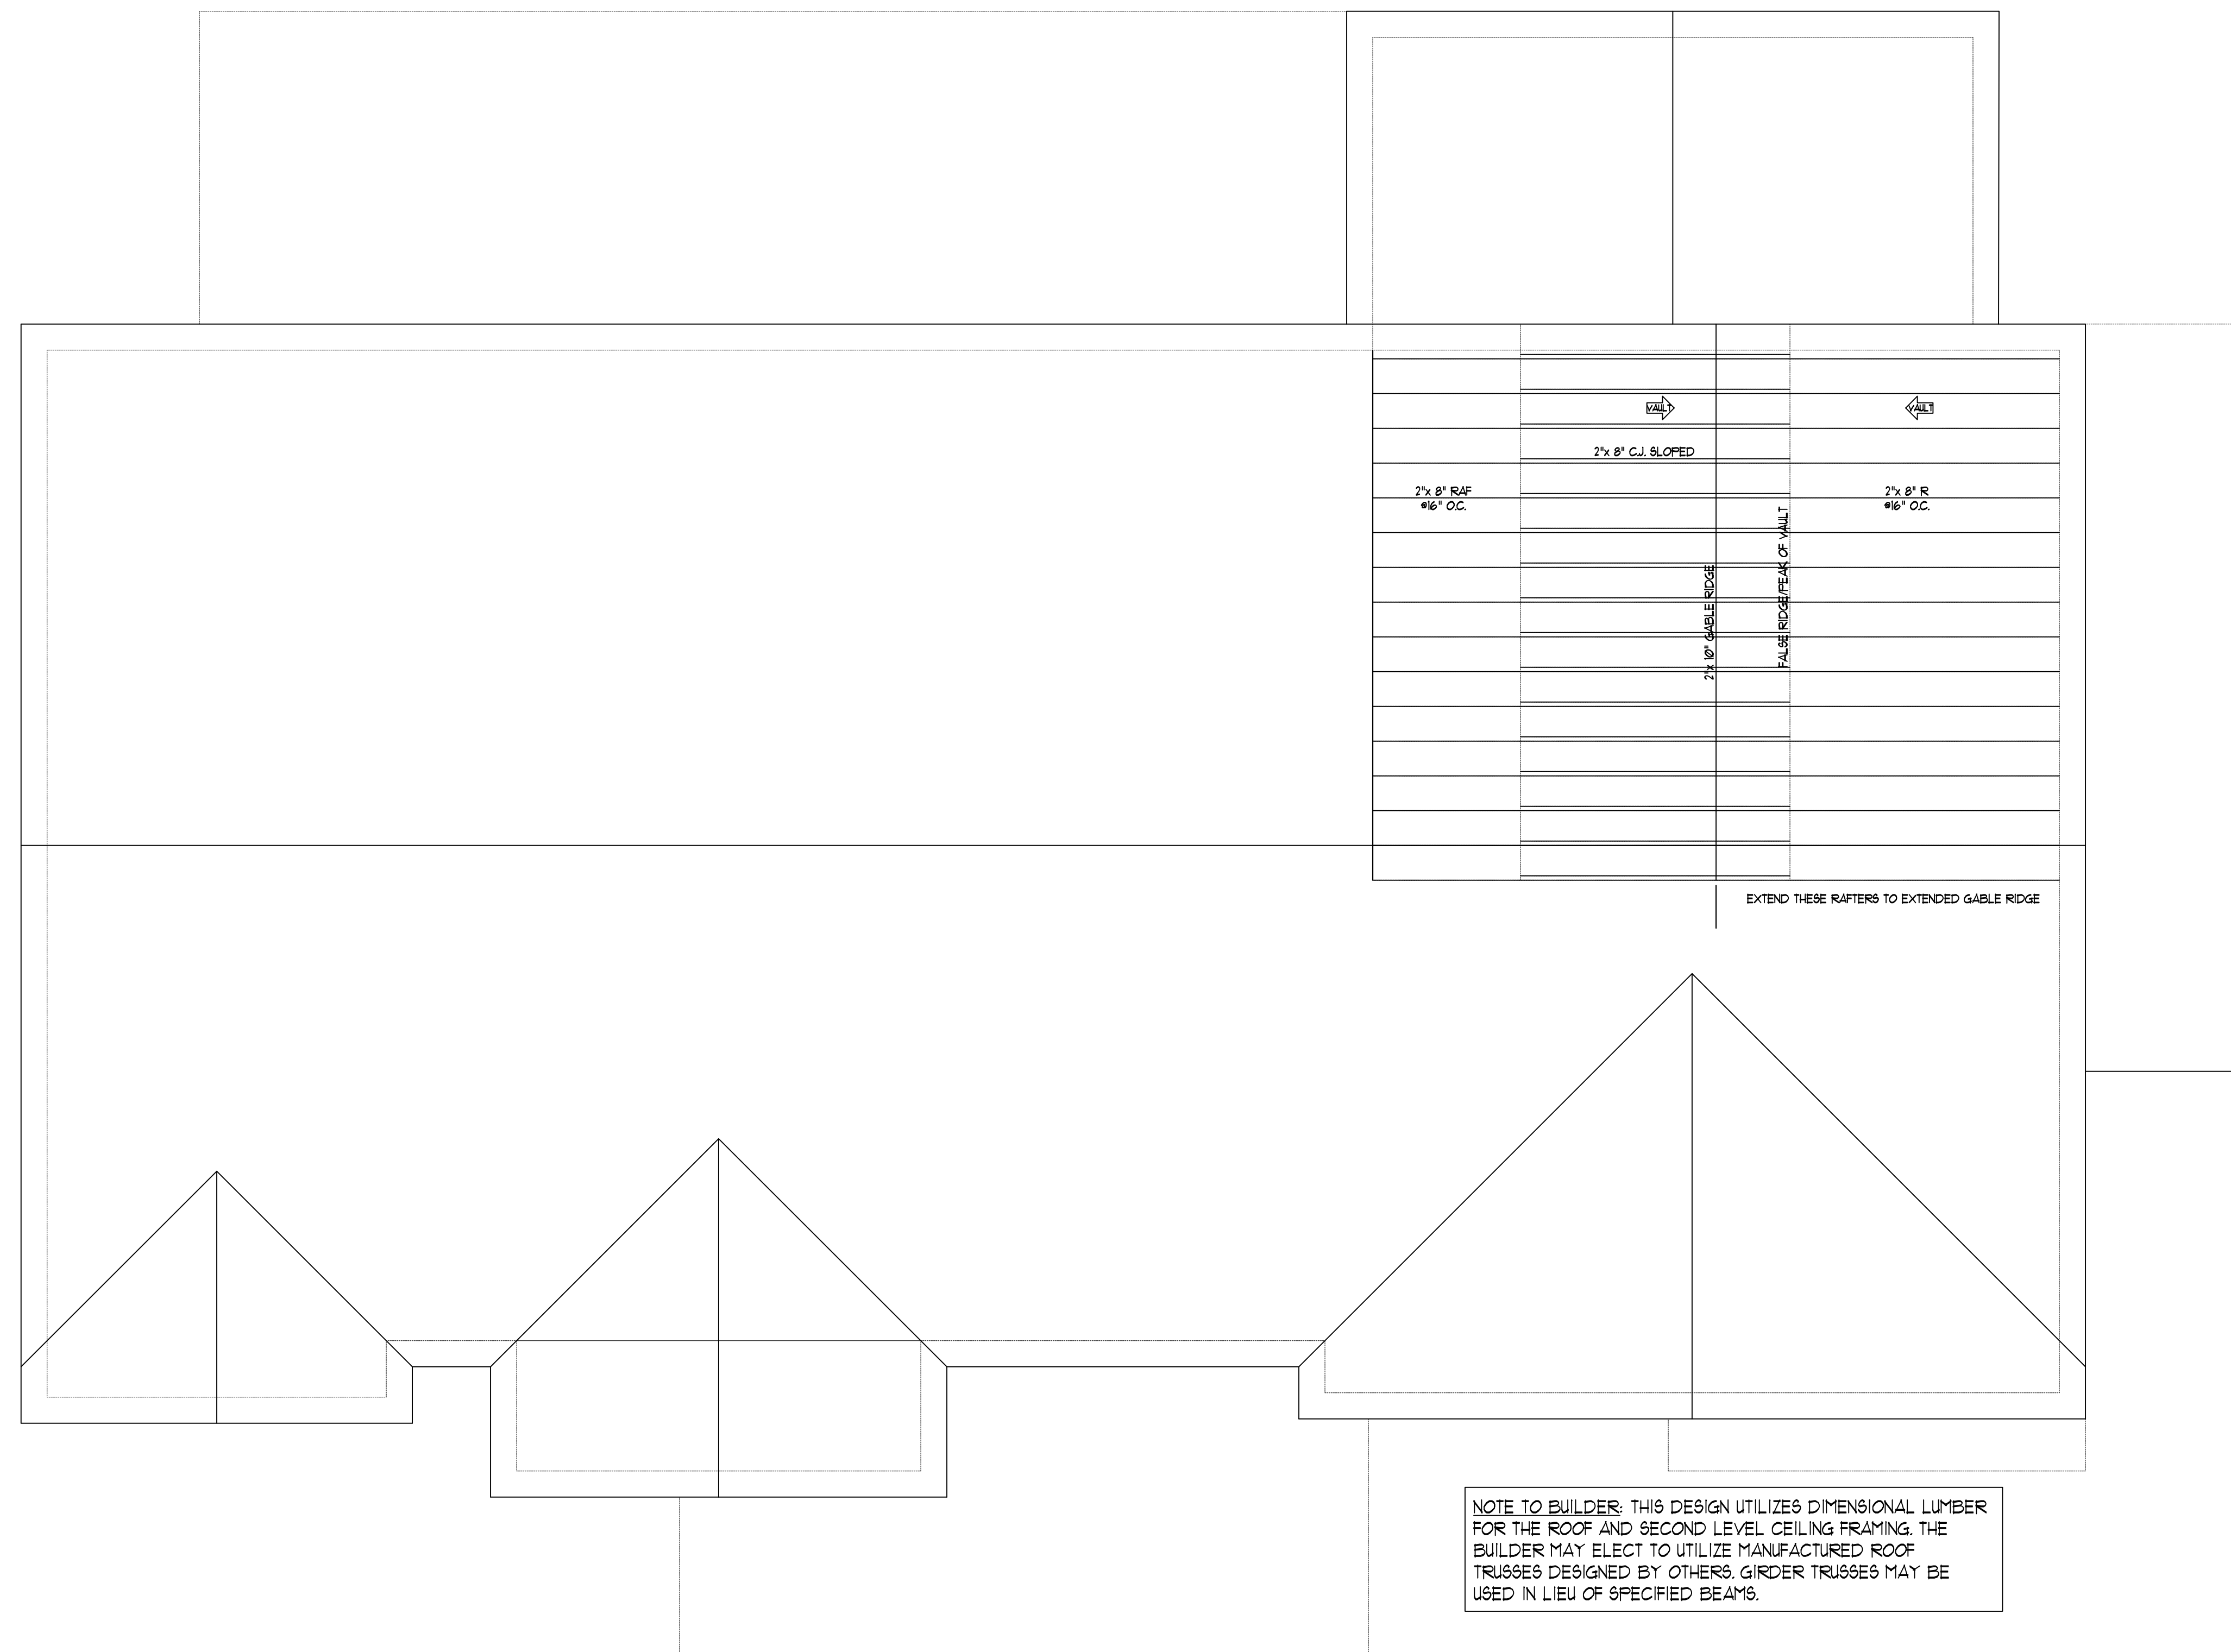

NOTE TO BUILDER: THIS DESIGN UTILIZES DIMENSIONAL LUMBER FOR THE ROOF AND SECOND LEVEL CEILING FRAMING. THE BUILDER MAY ELECT TO UTILIZE MANUFACTURED ROOF TRUSSES DESIGNED BY OTHERS. GIRDER TRUSSES MAY BE USED IN LIEU OF SPECIFIED BEAMS.

ROOF FRAMING PLAN-STAGE 1

Scale: 1/4" = 1'-0"

DO NOT SCALE THESE DRAWINGS.
ALL DIMENSIONS AND SITE OVERLAYS ARE TO BE VERIFIED BEFORE CONSTRUCTION BEGINS. SHOULD ANY DISCREPANCIES OR OMISSIONS BE NOTED, THE BUILDER AGREES TO NOTIFY THE ENGINEER IMMEDIATELY. THE ENGINEER ASSUMES NO RESPONSIBILITY FOR CODE COMPLIANCE OF NON-STRUCTURAL ITEMS.

COPYRIGHT 2020 WILKINS ENGINEERING, P.C.
THESE DRAWINGS ARE PROTECTED UNDER FEDERAL COPYRIGHT LAWS. THE ORIGINAL PURCHASER OF THESE DRAWINGS IS LICENSED TO USE THE PLANS FOR THE PROJECT AND SITE SPECIFICALLY IDENTIFIED IN THE FAMILY NOTE. REPRODUCTION, MODIFICATION, OR REUSE OF THESE DRAWINGS WITHOUT THE WRITTEN CONSENT OF THE ENGINEER IS EXPRESSLY PROHIBITED.

WILKINS ENGINEERING
Post Office Box 31446
Raleigh, NC 27621
919.772.3540
wilkinsonengr@aol.com

ORIANA PLAN
DO-4218


Sheet No.
55 of 51

GENERAL ROOF NOTES:

1. THIS PLAN DESIGNED IN ACCORDANCE WITH THE NORTH CAROLINA RESIDENTIAL BUILDING CODE, 2018 EDITION.
2. ROOF CLADDING DESIGN VALUES (POSITIVE/NEGATIVE) SHALL BE AS FOLLOWS:
45.5 PSF FOR ROOF PITCHES FROM 0/12 TO 2/12
34.5 PSF FOR ROOF PITCHES FROM 2/12 TO 1/12
21.0 PSF FOR ROOF PITCHES FROM 1/12 TO 0/12
MEAN ROOF HEIGHT FOR THIS STRUCTURE IS 18'
3. ALL ROOFING ELEMENTS SHALL MEET THE REQUIREMENTS OF CHAPTER 8 OF THE BUILDING CODE.
4. ALL LUMBER SHALL BE #2 SPF, SYP, OR BETTER.
5. THIS ROOF AND STRUCTURE ARE DESIGNED FOR A DESIGN WIND SPEED OF 115 MPH.
6. ROOF TRUSSES (IF USED) SHALL BE DESIGNED BY THE MANUFACTURER AND THE ANALYSIS SHALL BE PROVIDED TO THE ENGINEER FOR REVIEW AND APPROVAL PRIOR TO CONSTRUCTION.

STRUCTURAL EVALUATION BY:

WILKINS ENGINEERING, P.C.
Post Office Box 31449
Raleigh, North Carolina 27621




FILE: ORIANA

8/7/2023

THE ENGINEER'S SEAL AND SIGNATURE APPLY ONLY TO THE STRUCTURAL ELEMENTS OF THIS DOCUMENT. ENGINEER'S APPROVAL DOES NOT INCLUDE CONSTRUCTION REVIEW, MEANS, METHODS, TECHNIQUES OR SEQUENCES OF CONSTRUCTION OR SAFETY REQUIREMENTS. THE CONTRACTOR IS REQUIRED TO ENSURE PROPER SAFETY PRECAUTIONS.


ANY DEVIATIONS OR DISCREPANCIES IN THESE DRAWINGS ARE TO BE BROUGHT TO THE IMMEDIATE ATTENTION OF THE ENGINEER AND FAILURE TO DO SO WILL VOID THE ENGINEER'S LIABILITY. CHANGES TO THE DESIGN ARE ONLY ALLOWED WITH THE WRITTEN APPROVAL OF THE ENGINEER.

DO NOT SCALE THESE DRAWINGS. ENGINEERING APPROVAL EXPIRES IN ONE YEAR.

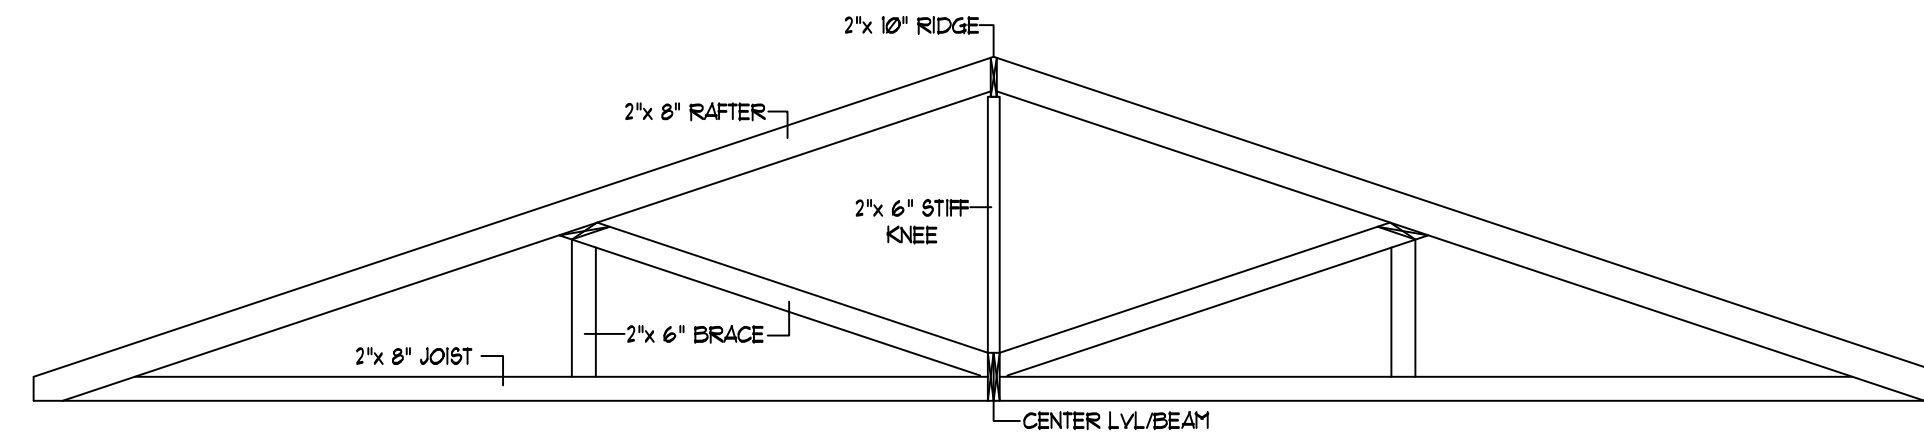

MAIN ROOF FRAMING DETAIL

Not to Scale

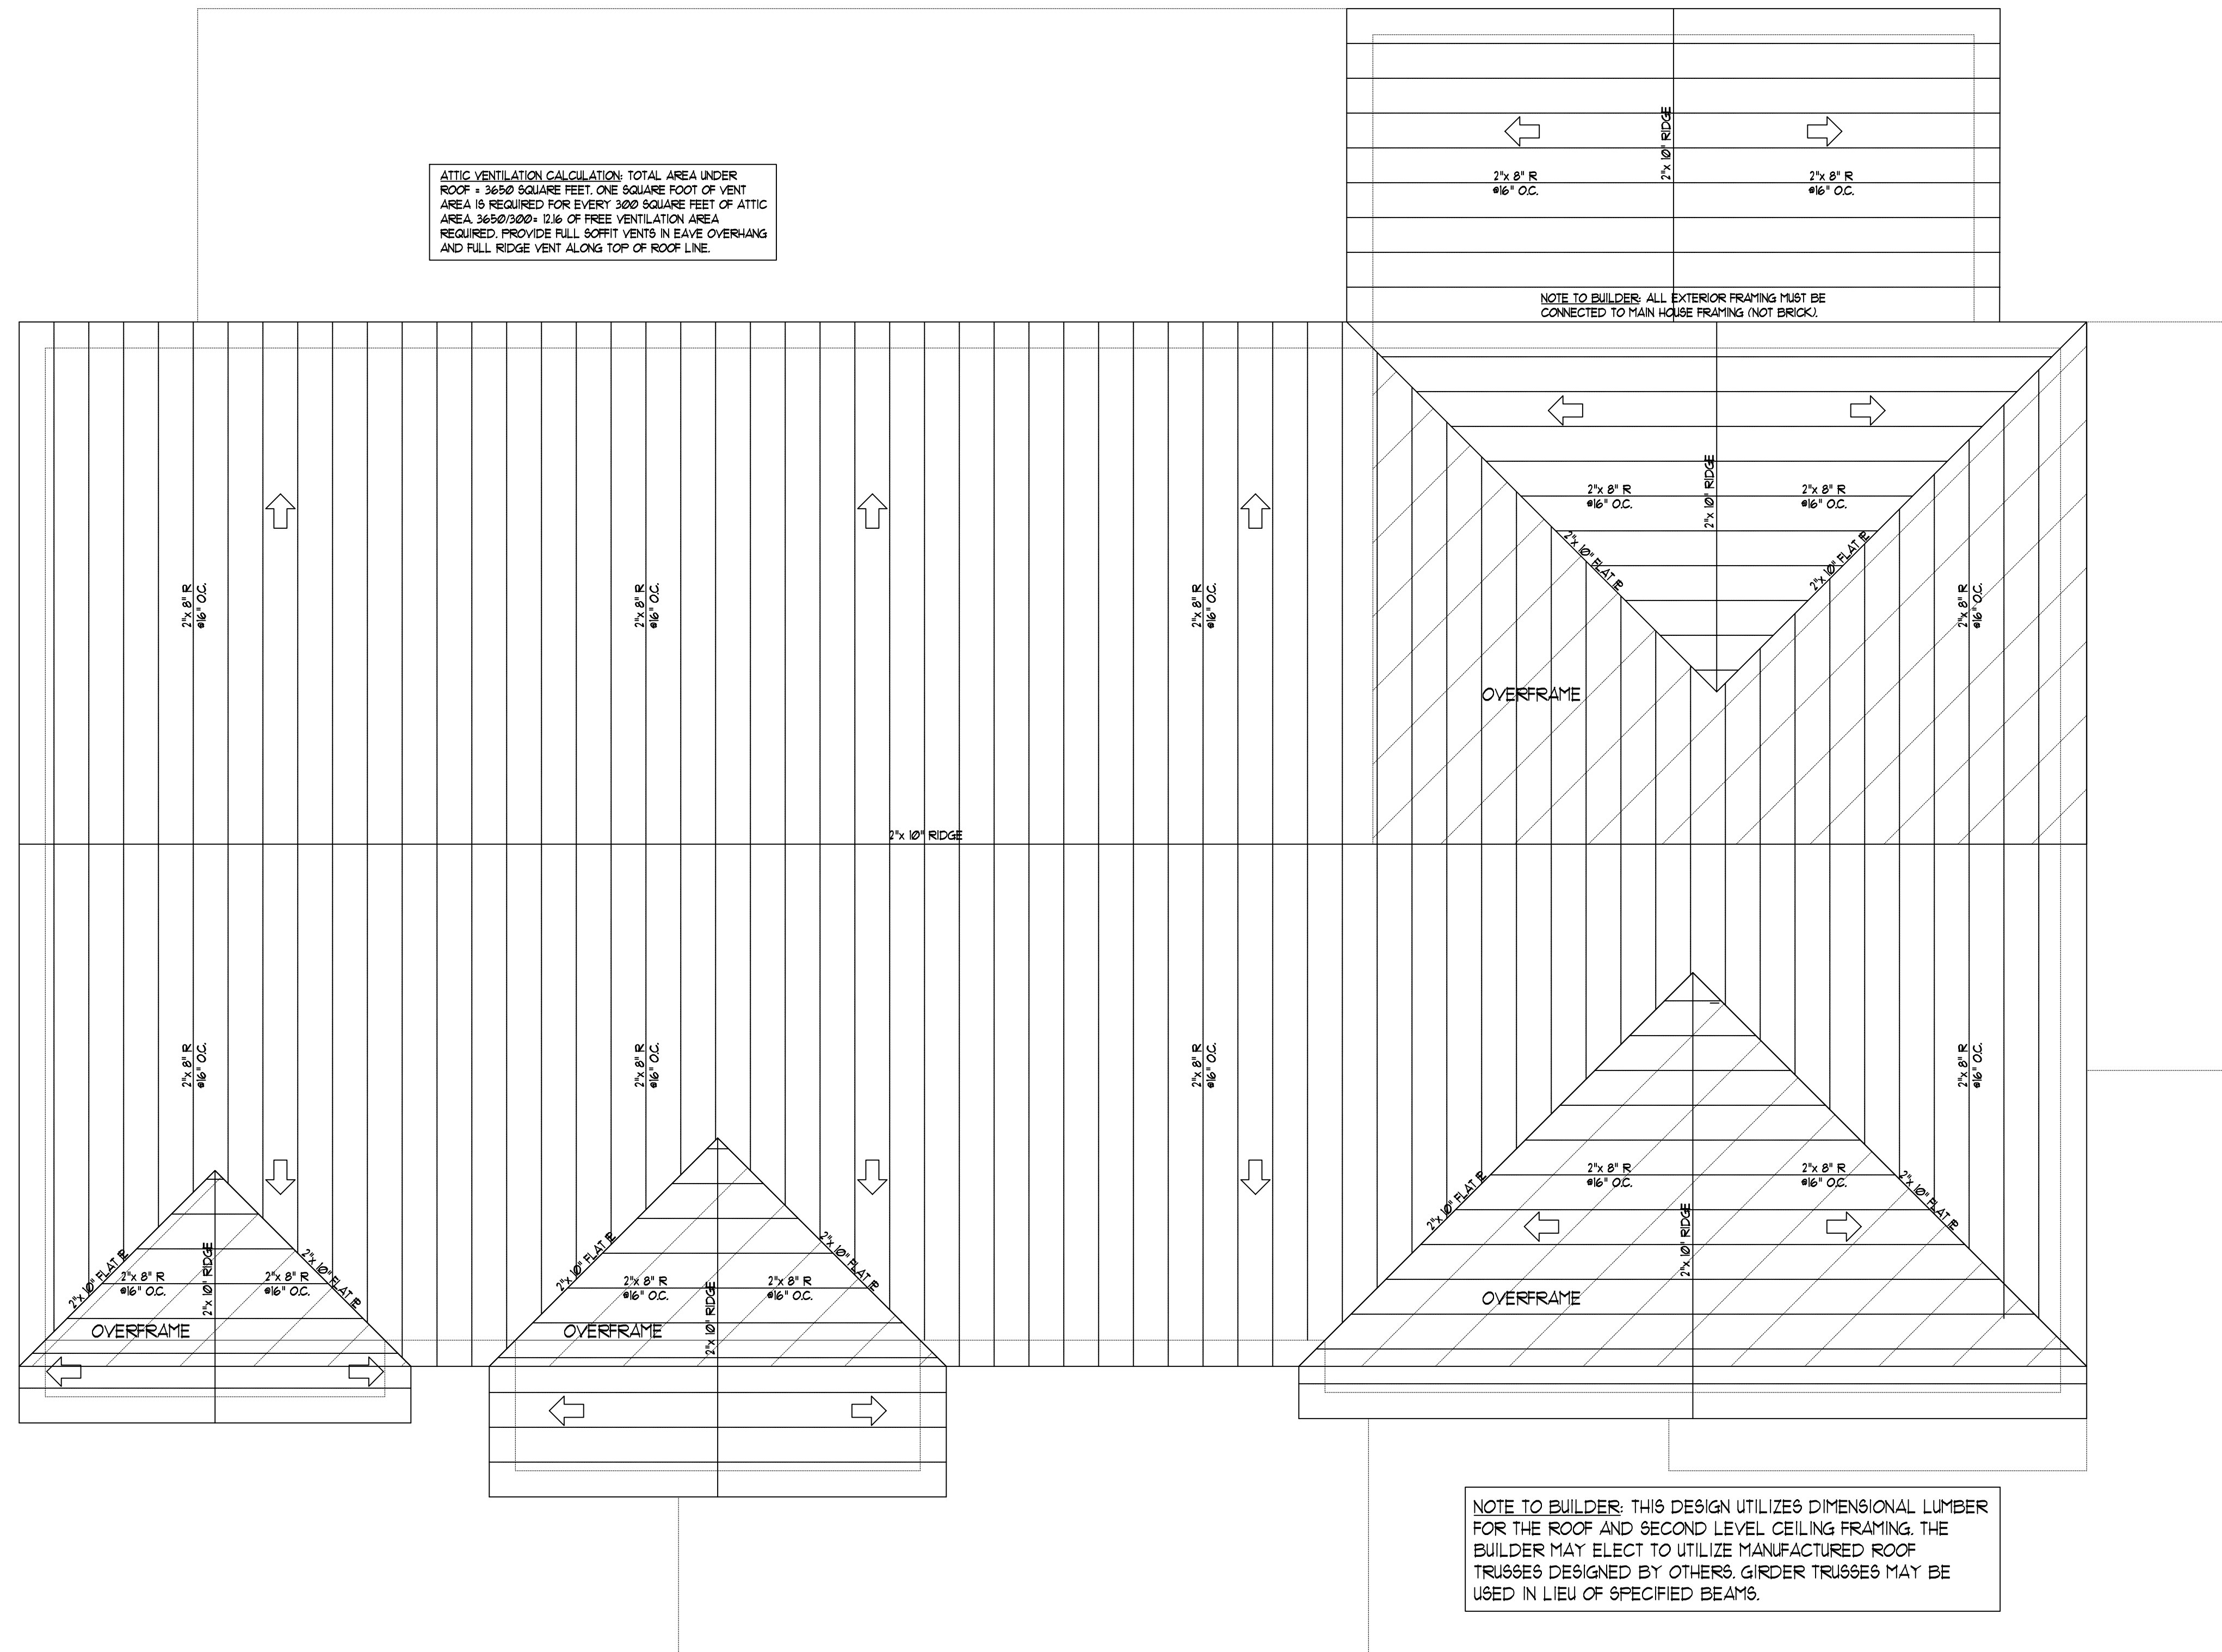

ATTIC VENTILATION CALCULATION: TOTAL AREA UNDER ROOF = 3650 SQUARE FEET. ONE SQUARE FOOT OF VENT AREA IS REQUIRED FOR EVERY 3000 SQUARE FEET OF ATTIC AREA. 3650/3000 = 1.216 OF FREE VENTILATION AREA REQUIRED. PROVIDE FULL SOFFIT VENTS IN EAVE OVERHANG AND FULL RIDGE VENT ALONG TOP OF ROOF LINE.

NOTE TO BUILDER: ALL EXTERIOR FRAMING MUST BE CONNECTED TO MAIN HOUSE FRAMING (NOT BRICK).

NOTE TO BUILDER: THIS DESIGN UTILIZES DIMENSIONAL LUMBER FOR THE ROOF AND SECOND LEVEL CEILING FRAMING. THE BUILDER MAY ELECT TO UTILIZE MANUFACTURED ROOF TRUSSES DESIGNED BY OTHERS. GIRDER TRUSSES MAY BE USED IN LIEU OF SPECIFIED BEAMS.

ROOF FRAMING PLAN-STAGE 2

Scale: 1/4" = 1'-0"

DO NOT SCALE THESE DRAWINGS. ALL DIMENSIONS AND SITE DIMENSIONS ARE TO BE VERIFIED BEFORE CONSTRUCTION BEGINS. SHOULD ANY DISCREPANCIES OR ERRORS BE IDENTIFIED, THESE DRAWINGS APPLY TO STRUCTURAL ELEMENTS ONLY. THE ENGINEER ASSUMES NO RESPONSIBILITY FOR CODE COMPLIANCE OF NON-STRUCTURAL ITEMS.

COPYRIGHT 2020 WILKINS ENGINEERING, P.C. THESE DRAWINGS ARE PROTECTED UNDER FEDERAL COPYRIGHT LAWS. THE ORIGINAL PURCHASER OF THESE DRAWINGS IS THE ONLY PARTY AUTHORIZED FOR THE CONSTRUCTION OF ONE AND ONLY ONE SINGLE FAMILY HOME. REPRODUCTION, MODIFICATION, OR REUSE OF THESE DRAWINGS WITHOUT THE WRITTEN CONSENT OF THE ENGINEER IS EXPRESSLY PROHIBITED.

WILKINS ENGINEERING
Post Office Box 31446
Raleigh, NC 27621
wilkinsengr@aol.com
919.712.3540

ORIANA PLAN
DO-4218

Sheet No.

ST