

Harnett County Department of Public Health

PERMIT # SFD 2309-0029

Operation Permit

New Installation Septic Tank Nitrification Line Repair Expansion

PROPERTY LOCATION: 51538 Mabry RD

Name: (owner) STEPHENSON BIDS

SUBDIVISION _____

LOT # _____

System Installer: Jay Adcock

Basement with plumbing: Garage Number of Bedrooms 4

Type of Water Supply: Community Public Well Distance from well _____ feet


System Type: 25% RSD Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

BZPION

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

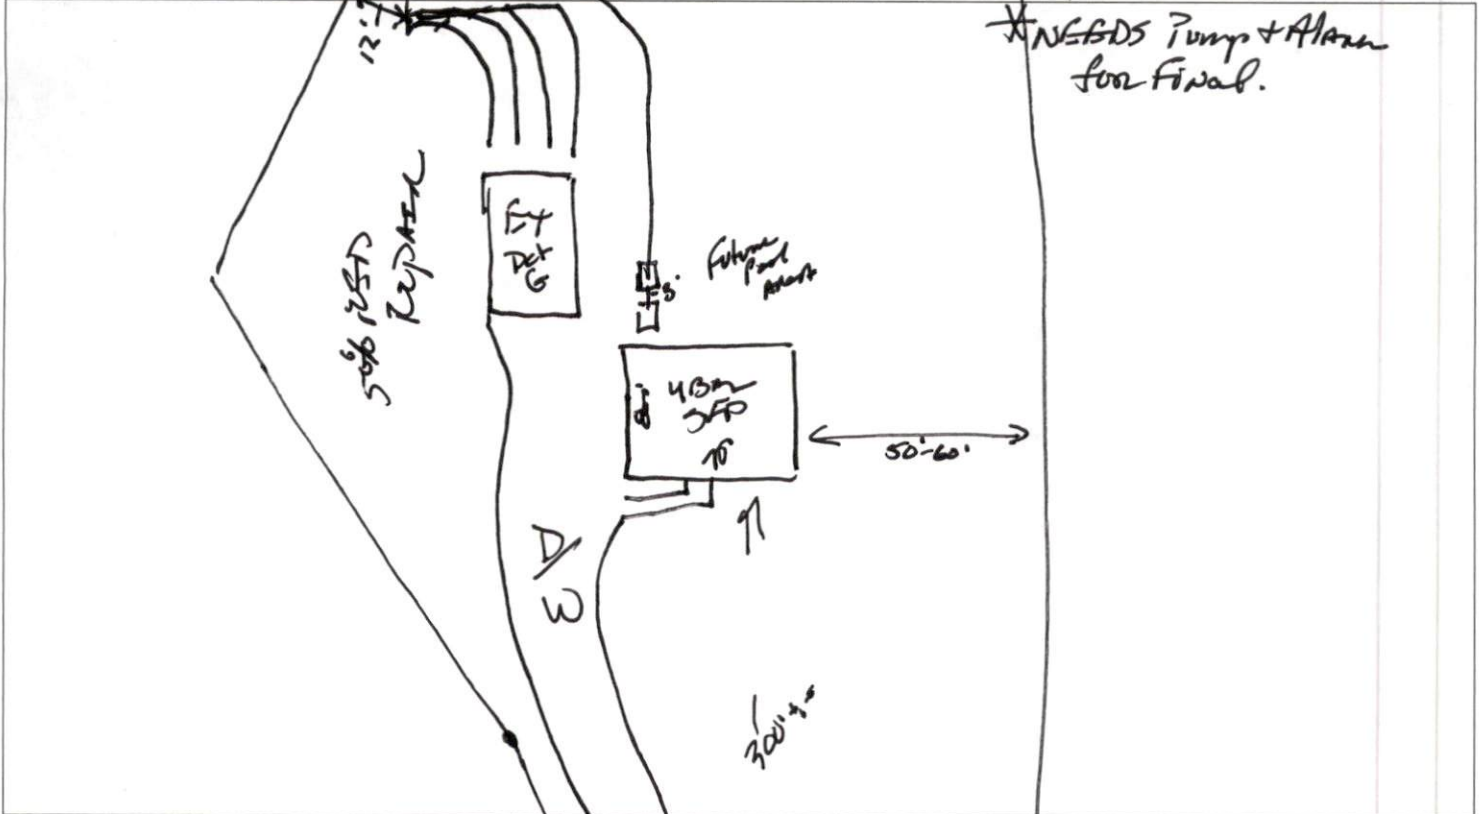

*NEEDS Pump + Alarm for final.

PERMIT CONDITIONS:

- I. Performance: System shall perform in accordance with Rule .1961.
- II. Monitoring: As required by Rule .1961.
- III. Maintenance: As required by Rule .1961. Other: _____
Subsurface system operator required? Yes No
If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: _____
51538 Mabry RD

V. Other: _____

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other 25% RSD RSD Septic Tank: 1250 gallons Pump Tank: 1250 gallons

Subsurface No. of exact length width of depth of
Drainage Field ditches 4 of each ditch 75 feet ditches 3 feet ditches 18 inches

French Drain Required: _____ Linear feet

Authorized State Agent James E. Manhart III RPHS

Date 4-17-24