

Trenco  
818 Soundside Rd  
Edenton, NC 27932

Re: 23070131-01  
90 Serenity-Roof-B326 A CP

The truss drawing(s) referenced below have been prepared by Truss Engineering Co. under my direct supervision based on the parameters provided by Carter Components (Sanford, NC)).

Pages or sheets covered by this seal: I60667304 thru I60667340

My license renewal date for the state of North Carolina is December 31, 2023.

North Carolina COA: C-0844



September 8, 2023

Gilbert, Eric

**IMPORTANT NOTE:** The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.



Job	Truss	Truss Type	Qty	Ply	90 Serenity-Roof-B326 A CP	160667304
23070131-01	A01	Piggyback Base Supported Gable	1	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Fri Sep 08 15:07:23  
ID:HvYYHe4LpHmiz2Dld9nw5TzRQov-RC?PsB70Hq3NSgPqnL8w3uITXbGKwRCDoi7J4zJC?#

Page: 2

**BOT CHORD** 61-62=-87/181, 60-61=-87/181, 59-60=-87/181, 58-59=-87/181, 57-58=-87/181, 56-57=-87/181, 55-56=-87/181, 53-55=-87/181, 52-53=-87/181, 51-52=-87/181, 50-51=-87/181, 49-50=-87/181, 48-49=-87/181, 46-48=-87/181, 45-46=-87/181, 44-45=-87/181, 43-44=-87/181, 42-43=-87/181, 40-42=-87/181, 39-40=-87/181, 38-39=-87/181, 37-38=-87/181, 36-37=-87/181, 35-36=-87/181, 34-35=-87/181, 33-34=-87/181

**WEBS** 17-49=-176/57, 18-48=-178/62, 19-46=-180/60, 20-45=-152/14, 22-44=-171/10, 23-43=-191/88, 24-42=-189/81, 25-40=-190/77, 27-39=-181/77, 28-38=-132/77, 29-37=-120/77, 30-36=-121/80, 31-35=-113/103, 32-34=-149/155, 16-50=-178/62, 15-51=-180/60, 14-52=-152/8, 12-53=-174/0, 11-55=-195/88, 10-56=-193/81, 9-57=-193/77, 7-58=-192/77, 6-59=-148/77, 5-60=-122/90, 4-61=-120/162, 3-62=-177/99

- 15) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 16) Warning: Additional permanent and stability bracing for truss system (not part of this component design) is always required.

**LOAD CASE(S)** Standard

**NOTES**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Corner(3E) -0-9-14 to 4-6-8, Exterior(2N) 4-6-8 to 12-4-3, Corner(3R) 12-4-3 to 22-11-13, Exterior (2N) 22-11-13 to 26-1-3, Corner(3R) 26-1-3 to 36-6-8, Exterior(2N) 36-6-8 to 47-10-3, Corner(3E) 47-10-3 to 53-2-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 4) T CLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- 5) Unbalanced snow loads have been considered for this design.
- 6) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- 7) Provide adequate drainage to prevent water ponding.
- 8) All plates are 2x4 MT20 unless otherwise indicated.
- 9) Gable requires continuous bottom chord bearing.
- 10) Gable studs spaced at 2-0-0 oc.
- 11) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 12) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 13) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 33 lb uplift at joint 62, 25 lb uplift at joint 49, 28 lb uplift at joint 48, 29 lb uplift at joint 46, 51 lb uplift at joint 43, 46 lb uplift at joint 42, 43 lb uplift at joint 40, 44 lb uplift at joint 39, 44 lb uplift at joint 38, 43 lb uplift at joint 37, 47 lb uplift at joint 36, 28 lb uplift at joint 35, 96 lb uplift at joint 34, 28 lb uplift at joint 50, 28 lb uplift at joint 51, 53 lb uplift at joint 55, 46 lb uplift at joint 56, 43 lb uplift at joint 57, 44 lb uplift at joint 58, 45 lb uplift at joint 59, 27 lb uplift at joint 60, 116 lb uplift at joint 61, 36 lb uplift at joint 33 and 36 lb uplift at joint 33.
- 14) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcacomponents.com](http://www.sbcacomponents.com))




818 Soundside Road  
Edenton, NC 27932

Job 23070131-01	Truss A03	Truss Type Piggyback Base	Qty 8	Ply 1	90 Serenity-Roof-B326 A CP Job Reference (optional)	160667305
--------------------	--------------	------------------------------	----------	----------	--------------------------------------------------------	-----------

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Fri Sep 08 15:07:26  
ID:OFJfX3IDTxFBWWzrBxohbzzRCTM-RfC?PsB70Hq3NSgPqnL8w3uITxBGKwCDoi7J4zJC7f

Page: 1

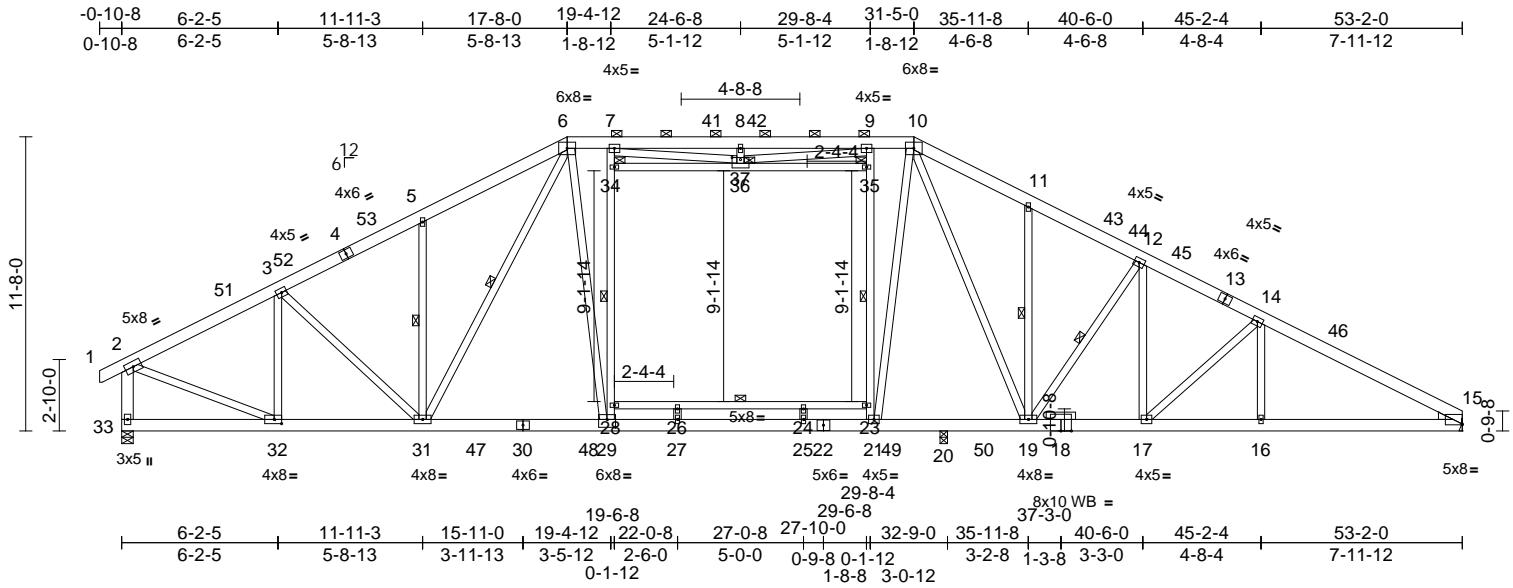

Scale = 1:91.4

Plate Offsets (X, Y): [15:Edge,0-0-7], [29:0-4-0,0-3-12], [32:0-3-8,0-2-0], [36:0-4-0,0-1-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.64	Vert(LL)	-0.35	24-26	>999	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.65	Vert(CT)	-0.66	24-26	>586	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.85	Horz(CT)	0.10	15	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 503 lb	FT = 20%

- LUMBER**
- TOP CHORD 2x6 SP No.2
- BOT CHORD 2x6 SP 2400F 2.0E \*Except\* 28-23:2x4 SP No.2
- WEBS 2x4 SP No.3 \*Except\* 33-2:2x6 SP No.2, 2-32:2x4 SP No.2
- OTHERS 2x4 SP No.3
- WEDGE Right: 2x4 SP No.3
- BRACING**
- TOP CHORD Structural wood sheathing directly applied or 3-3-2 oc purlins, except end verticals, and 2-0-0 oc purlins (3-5-3 max.): 6-10.
- BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing. Except: 6-0-0 oc bracing: 23-28
- WEBS 1 Row at midpt 5-31, 11-19, 12-19, 6-31, 29-34, 21-35
- JOINTS 1 Brace at Jt(s): 34, 35, 36
- REACTIONS** (size) 15= Mechanical, 20=0-3-8, 33=0-5-8
- Max Horiz 33=187 (LC 12)
- Max Uplift 20=198 (LC 15), 33=116 (LC 14)
- Max Grav 15=2251 (LC 45), 20=1009 (LC 37), 33=2651 (LC 35)
- FORCES** (lb) - Maximum Compression/Maximum Tension
- TOP CHORD 6-7=2920/122, 7-8=3232/324, 8-9=3296/330, 9-10=2899/120, 10-11=3273/209, 11-12=3263/144, 12-14=3751/109, 14-15=4061/100, 2-33=2537/142, 1-2=0/28, 2-3=2976/118, 3-5=3373/163, 5-6=3396/284
- BOT CHORD 32-33=-114/231, 31-32=-133/2600, 29-31=0/2776, 27-29=0/2966, 25-27=0/2966, 21-25=0/2966, 20-21=0/2701, 19-20=0/2701, 17-19=0/3313, 16-17=-1/3535, 15-16=-57/3535, 26-28=-92/37, 24-26=-92/37, 23-24=-92/37
- WEBS 24-25=-224/0, 14-16=0/165, 26-27=-218/0, 3-32=-828/106, 5-31=-591/201, 3-31=0/521, 12-17=-73/649, 14-17=-364/187, 11-19=-453/167, 12-19=-878/180, 2-32=-21/2696, 6-31=-296/536, 10-19=-233/588, 28-29=-546/206, 28-34=-499/226, 7-34=-483/224, 21-23=-924/201, 23-35=-884/224, 9-35=-869/221, 6-29=0/1182, 34-36=-11/46, 35-36=-124/16, 36-37=-31/5, 8-37=-221/83, 7-37=-346/652, 9-37=-294/825, 10-21=0/1411
- NOTES**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-9-14 to 4-5-15, Interior (1) 4-5-15 to 10-1-12, Exterior(2R) 10-1-12 to 38-11-4, Interior (1) 38-11-4 to 47-10-3, Exterior(2E) 47-10-3 to 53-2-0 zone; end vertical left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
  - Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
  - 200.0lb AC unit load placed on the bottom chord, 24-6-8 from left end, supported at two points, 5-0-0 apart.
  - Provide adequate drainage to prevent water ponding.
  - All plates are 2x4 MT20 unless otherwise indicated.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - Refer to girder(s) for truss to truss connections.
  - One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 33 and 20. This connection is for uplift only and does not consider lateral forces.
  - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



September 8, 2023

Continued on page 2

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



818 Soundside Road  
Edenton, NC 27932

Job 23070131-01	Truss A03	Truss Type Piggyback Base	Qty 8	Ply 1	90 Serenity-Roof-B326 A CP Job Reference (optional)	I60667305
--------------------	--------------	------------------------------	----------	----------	--------------------------------------------------------	-----------

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Fri Sep 08 15:07:26  
ID:OFJfX3IDTxFbWWzrBXohbzzRCTM-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

Page: 2

- 14) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

**LOAD CASE(S)** Standard

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbccomponents.com](http://www.sbccomponents.com))



818 Soundside Road  
Edenton, NC 27932




Job 23070131-01	Truss A04	Truss Type Piggyback Base	Qty 3	Ply 1	90 Serenity-Roof-B326 A CP Job Reference (optional)	160667306
--------------------	--------------	------------------------------	----------	----------	--------------------------------------------------------	-----------

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Fri Sep 08 15:07:27  
ID: DGN6a6f8caCKWpHw1clz1BzRCZx-RfC?PsB70Hq3NSgPqnl8w3ulTXbGKWvCDoi7J4zJC?f

Page: 1

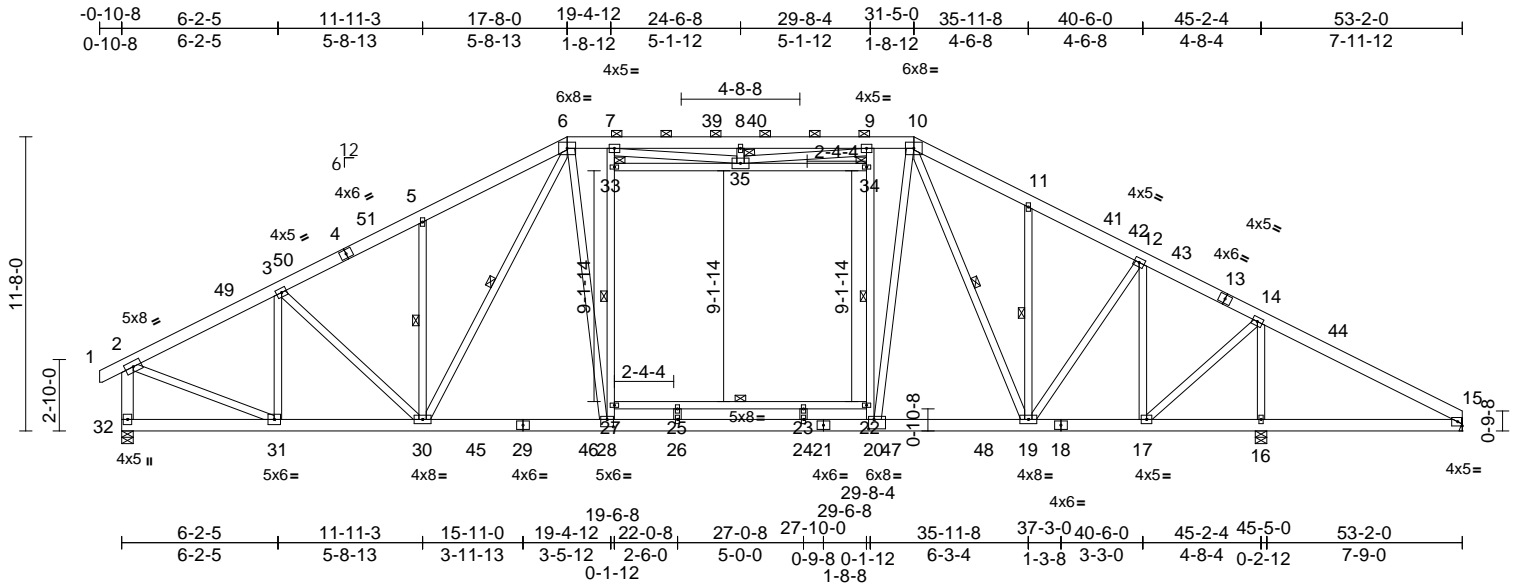

Scale = 1:91.4

Plate Offsets (X, Y): [20:0-2-8,0-4-8], [28:0-3-0,0-3-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.63	Vert(LL)	-0.33	25-27	>999	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.64	Vert(CT)	-0.59	23-25	>911	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.99	Horz(CT)	0.09	15	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 500 lb	FT = 20%

LUMBER	TOP CHORD	2x6 SP No.2	BOT CHORD	2x6 SP No.2 *Except* 18-21,21-29:2x6 SP	WEBS	2x4 SP No.3 *Except* 32-2:2x6 SP No.2, 2-31:2x4 SP No.2	BRACING	TOP CHORD	Structural wood sheathing directly applied or 3-10-10 oc purlins, except end verticals, and 2-0-0 oc purlins (3-6-1 max.): 6-10.	BOT CHORD	2-0-0 oc purlins directly applied or 10-0-0 oc bracing. Except: 6-0-0 oc bracing: 22-27	WEBS	1 Row at midpt 5-30, 6-30, 11-19, 10-19, 28-33, 20-34	JOINTS	1 Brace at Jt(s): 33, 34, 35	REACTIONS	(size) 15= Mechanical, 16=0-5-8, 32=0-5-8	Max Horiz	32=187 (LC 12)	Max Uplift	15=-195 (LC 14), 16=-302 (LC 15), 32=99 (LC 14)	Max Grav	15=939 (LC 35), 16=2635 (LC 37), 32=2582 (LC 35)	FORCES	(lb) - Maximum Compression/Maximum Tension	TOP CHORD	6-7=-2840/126, 7-8=-3210/337, 8-9=-3210/337, 9-10=-2817/126, 10-11=-2820/228, 11-12=-2803/135, 12-14=-2435/223, 14-15=-1543/447, 2-32=-2470/140, 1-2=0/28, 2-3=-2892/97, 3-5=-3271/136, 5-6=-3294/257	BOT CHORD	31-32=-113/225, 30-31=-114/2524, 28-30=0/2707, 26-28=0/2873, 24-26=0/2873, 20-24=0/2873, 19-20=0/2564, 17-19=-81/2143, 16-17=-334/1326, 15-16=-334/1326, 25-27=-76/34, 23-25=-76/34, 22-23=-76/34 25-26=-209/0, 23-24=-245/0, 14-16=-2328/328, 2-31=-3/2621, 3-31=-806/99, 3-30=0/512, 5-30=-592/201, 6-30=-306/594, 14-17=-68/1854, 12-17=-1110/146, 12-19=-25/780, 11-19=-468/168, 10-19=-567/0, 27-28=-550/251, 27-33=-505/274, 7-33=-490/270, 20-22=-883/224, 22-34=-861/245, 9-34=-840/242, 6-28=0/1154, 33-35=-39/79, 34-35=-171/35, 8-35=-234/82, 7-35=-320/698, 9-35=-294/814, 10-20=0/1807	WEBS	14-16=-2328/328, 2-31=-3/2621, 3-31=-806/99, 3-30=0/512, 5-30=-592/201, 6-30=-306/594, 14-17=-68/1854, 12-17=-1110/146, 12-19=-25/780, 11-19=-468/168, 10-19=-567/0, 27-28=-550/251, 27-33=-505/274, 7-33=-490/270, 20-22=-883/224, 22-34=-861/245, 9-34=-840/242, 6-28=0/1154, 33-35=-39/79, 34-35=-171/35, 8-35=-234/82, 7-35=-320/698, 9-35=-294/814, 10-20=0/1807	NOTES	1) Unbalanced roof live loads have been considered for this design. 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-9-14 to 4-5-15, Interior (1) 4-5-15 to 10-1-12, Exterior(2R) 10-1-12 to 38-11-4, Interior (1) 38-11-4 to 47-10-3, Exterior(2E) 47-10-3 to 53-2-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60 3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10 4) Unbalanced snow loads have been considered for this design.	5) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads. 6) 200.0lb AC unit load placed on the bottom chord, 24-6-8 from left end, supported at two points, 5-0-0 apart. 7) Provide adequate drainage to prevent water ponding. 8) All plates are 2x4 MT20 unless otherwise indicated. 9) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads. 10) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf. 11) Refer to girder(s) for truss to truss connections. 12) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 195 lb uplift at joint 15. 13) One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 32 and 16. This connection is for uplift only and does not consider lateral forces.
--------	-----------	-------------	-----------	-----------------------------------------	------	---------------------------------------------------------	---------	-----------	----------------------------------------------------------------------------------------------------------------------------------	-----------	-----------------------------------------------------------------------------------------	------	-------------------------------------------------------	--------	------------------------------	-----------	-------------------------------------------	-----------	----------------	------------	-------------------------------------------------	----------	--------------------------------------------------	--------	--------------------------------------------	-----------	-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	-----------	-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	------	-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	-------	-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------	-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------



September 8, 2023

Continued on page 2

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**  
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY  
**TRENCO**  
A MiTek Affiliate  
818 Soundside Road  
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	90 Serenity-Roof-B326 A CP	I60667306
23070131-01	A04	Piggyback Base	3	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Fri Sep 08 15:07:27  
 ID:DGN6a6f8caCKWpHw1clz1BzRCZx-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWwCDoi7J4zJC?f

Page: 2

- 14) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 15) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

**LOAD CASE(S)** Standard

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcacomponents.com](http://www.sbcacomponents.com))



818 Soundside Road  
 Edenton, NC 27932

Job 23070131-01	Truss A05	Truss Type Attic Girder	Qty 1	Ply 4	90 Serenity-Roof-B326 A CP Job Reference (optional)	160667307
--------------------	--------------	----------------------------	----------	----------	--------------------------------------------------------	-----------

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Fri Sep 08 15:07:28  
ID:VIY0g5gMUGwQZRyxiBXYltzRA\_fRtC?PsB70Hq3NSgPqnlL8w3u1XBTKWCrDcoI7J4zJC?f

Page: 1

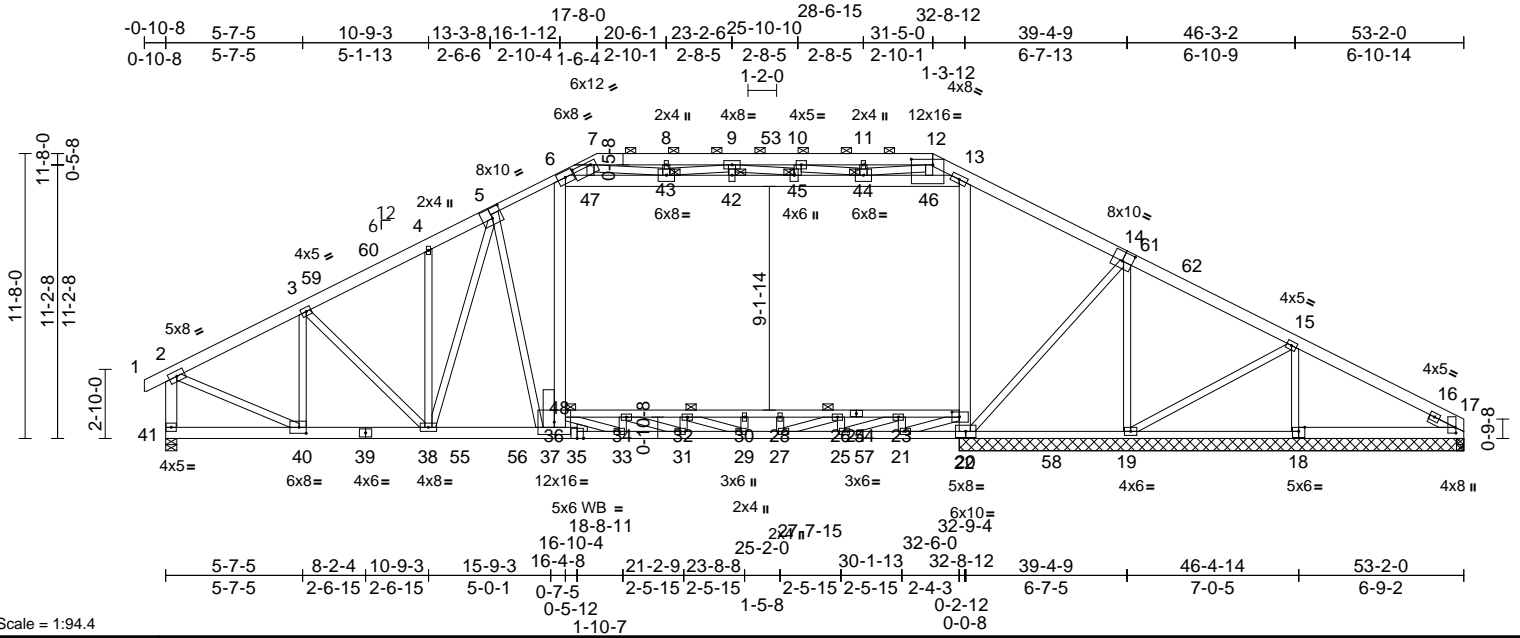


Plate Offsets (X, Y): [5:0-5-0,0-5-0], [7:0-9-4,0-1-12], [12:0-10-8,0-2-12], [14:0-5-0,0-4-8], [17:0-2-14,0-0-8], [22:0-3-8,0-2-8], [40:0-3-8,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.75	Vert(LL)	-0.41	33-37	>957	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.61	Vert(CT)	-0.61	31-33	>636	180		
TCDL	10.0	Rep Stress Incr	NO	WB	0.89	Horz(CT)	0.15	17	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-MSH		Attic	-0.21	22-36	>956	360		
BCDL	10.0											
											Weight: 2026 lb	FT = 20%

LUMBER	TOP CHORD	BOT CHORD	WEBS	OTHERS	SLIDER	BRACING	TOP CHORD	BOT CHORD	WEBS	JOINTS	REACTIONS	FORCES
TOP CHORD	2x6 SP No.2 *Except* 7-5:2x4 SP 2400F 2.0E	2x4 SP No.2 *Except* 41-39,18-17:2x6 SP No.2, 39-35:2x6 SP 2400F 2.0E, 35-20,18-20:2x4 SP 2400F 2.0E	2x4 SP No.3 *Except* 41-2,6-37,13-6,48-37:2x6 SP No.2, 13-20:2x6 SP 2400F 2.0E, 40-2:2x4 SP No.2	2x4 SP No.3	Right 2x4 SP No.3 -- 1-1-8	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 7-12.	Rigid ceiling directly applied or 10-0-0 oc bracing. Except: 6-0-0 oc bracing: 22-36	1 Brace at Jt(s): 36, 42, 43, 44, 45	(size) 17=20-8-0, 18=20-8-0, 19=20-8-0, 20=20-8-0, 41=0-5-8, 49=20-8-0 Max Horiz 41=182 (LC 10) Max Uplift 17=140 (LC 13), 18=-337 (LC 12), 19=-232 (LC 12), 20=-11093 (LC 46), 41=-684 (LC 12), 49=-140 (LC 13) Max Grav 17=2690 (LC 46), 18=7457 (LC 23), 19=4923 (LC 46), 20=1030 (LC 12), 41=11986 (LC 46), 49=2690 (LC 46)	(lb) - Maximum Compression/Maximum Tension	7-8=-3003/519, 8-9=-2995/520, 9-10=-3671/701, 10-11=-1693/1443, 11-12=-1693/1443, 2-41=-11797/704, 1-2-0/28, 2-3=-13726/778, 3-4=-17576/1022, 4-6=-19041/1113, 6-7=-6752/524, 12-13=-4776/421, 13-15=-18363/1094, 15-17=-4930/297 34-36=-1156/0, 32-34=-3282/0, 30-32=-4246/0, 28-30=-4246/0, 26-28=-4246/0, 23-26=-3239/0, 22-23=-468/843, 40-41=-129/436, 38-40=-727/12271, 37-38=-833/16420, 33-37=-897/14968, 31-33=-419/17439, 29-31=-23/19134, 27-29=0/19972, 25-27=-54/19077, 21-25=-354/16094, 19-21=-766/12661, 17-19=-227/4600 36-37=-1290/309, 6-36=-537/8903, 20-22=-688/6421, 13-22=-523/7608, 14-19=-8551/488, 15-18=-7350/427, 33-34=-1076/0, 33-36=0/3037, 31-32=-628/0, 31-34=0/2253, 29-32=0/1021, 21-23=-1684/0, 25-26=-965/0, 23-25=0/3322, 26-27=0/1067, 9-42=-120/2319, 8-43=-480/56, 11-44=-257/67, 10-45=-159/58, 15-19=-388/7669, 21-22=0/3953, 14-20=-392/7609, 6-47=-10392/657, 43-47=-9982/633, 42-43=-11607/676, 42-45=-11608/676, 44-45=-16099/941, 44-46=-12469/763, 13-46=-13033/795, 12-46=-189/3262, 7-47=-143/2198, 9-43=-4333/346, 9-45=-4622/274, 12-44=-5773/322, 10-44=-2476/280, 7-43=-5619/304, 29-30=-273/0, 27-28=-228/0, 4-38=-664/155, 3-38=-238/5005, 3-40=-5398/368, 2-40=-669/13016, 5-37=-136/1760, 5-38=-2710/135	1) 4-ply truss to be connected together with 10d (0.131"x3") nails as follows: Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc, 2x4 - 1 row at 0-9-0 oc. Bottom chords connected as follows: 2x4 - 2 rows staggered at 0-5-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc. Web connected as follows: 2x6 - 2 rows staggered at 0-4-0 oc, Except member 37-48 2x6 - 3 rows staggered at 0-4-0 oc, member 13-20 2x6 - 2 rows staggered at 0-9-0 oc, 2x4 - 1 row at 0-9-0 oc. Attach BC w/ 1/2" diam. bolts (ASTM A-307) in the center of the member w/washers at 4-0-0 oc. 2) All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated. 3) Unbalanced roof live loads have been considered for this design.

NOTES



September 8, 2023

Continued on page 2

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPH Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



818 Soundside Road  
Edenton, NC 27932



Job 23070131-01	Truss A05	Truss Type Attic Girder	Qty 1	Ply 4	90 Serenity-Roof-B326 A CP Job Reference (optional)	I60667307
--------------------	--------------	----------------------------	----------	----------	--------------------------------------------------------	-----------

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Fri Sep 08 15:07:28  
ID:V1Y0g5gMUgwQZRyxixBYltzRA\_f-RfC?PsB70Hq3NSgPqnL8w3uTXbGKwRCDoi7J4zJC?f

Page: 2

- 4) Wind: ASCE 7-16; Vult=130mph (3-second gust)  
Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft;  
Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior  
zone; cantilever left and right exposed ; end vertical left  
and right exposed; Lumber DOL=1.60 plate grip  
DOL=1.60
- 5) TCELL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15  
Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate  
DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9;  
Cs=1.00; Ct=1.10
- 6) Unbalanced snow loads have been considered for this  
design.
- 7) This truss has been designed for greater of min roof live  
load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on  
overhangs non-concurrent with other live loads.
- 8) Provide adequate drainage to prevent water ponding.
- 9) All plates are 3x5 MT20 unless otherwise indicated.
- 10) This truss has been designed for a 10.0 psf bottom  
chord live load nonconcurrent with any other live loads.
- 11) \* This truss has been designed for a live load of 20.0psf  
on the bottom chord in all areas where a rectangle  
3-06-00 tall by 2-00-00 wide will fit between the bottom  
chord and any other members, with BCDL = 10.0psf.
- 12) Ceiling dead load (5.0 psf) on member(s). 6-47, 43-47,  
42-43, 42-45, 44-45, 44-46, 13-46; Wall dead load  
(5.0psf) on member(s).6-36, 13-22
- 13) Bottom chord live load (40.0 psf) and additional bottom  
chord dead load (5.0 psf) applied only to room. 34-36,  
32-34, 30-32, 28-30, 26-28, 23-26, 22-23
- 14) Bearings are assumed to be: , Joint 17 User Defined  
crushing capacity of 425 psi.
- 15) Provide mechanical connection (by others) of truss to  
bearing plate capable of withstanding 11093 lb uplift at  
joint 20.
- 16) N/A

17) N/A

- 18) This truss is designed in accordance with the 2018  
International Residential Code sections R502.11.1 and  
R802.10.2 and referenced standard ANSI/TPI 1.
- 19) Graphical purlin representation does not depict the size  
or the orientation of the purlin along the top and/or  
bottom chord.
- 20) This truss has large uplift reaction(s) from gravity load  
case(s). Proper connection is required to secure truss  
against upward movement at the bearings. Building  
designer must provide for uplift reactions indicated.
- 21) N/A

- 22) Hanger(s) or other connection device(s) shall be  
provided sufficient to support concentrated load(s) 608  
lb down and 52 lb up at 28-7-12, and 9100 lb down and  
774 lb up at 15-11-0 on bottom chord. The design/  
selection of such connection device(s) is the  
responsibility of others.

- 23) Attic room checked for L/360 deflection.

**LOAD CASE(S)** Standard

- 1) Dead + Snow (balanced): Lumber Increase=1.15, Plate  
Increase=1.15  
Uniform Loads (lb/ft)  
Vert: 7-12=-60, 22-36=-30, 41-49=-20, 1-2=-60,  
2-7=-60, 12-17=-60, 6-47=-10, 43-47=-10,  
42-43=-10, 42-45=-10, 44-45=-10, 44-46=-10,  
13-46=-10  
Drag: 36-48=-10, 6-48=-10, 13-22=-10  
Concentrated Loads (lb)  
Vert: 36=-4881 (F), 54=-326 (F)

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcacomponents.com](http://www.sbcacomponents.com))



818 Soundside Road  
Edenton, NC 27932


Job 23070131-01	Truss A06	Truss Type Attic Girder	Qty 1	Ply 4	90 Serenity-Roof-B326 A CP Job Reference (optional)	160667308
--------------------	--------------	----------------------------	----------	----------	--------------------------------------------------------	-----------

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Fri Sep 08 15:07:30

Page: 1

ID:PeZvt1?lwruiNEY\_xH4fkzR7-RfC?PsB70Hq3NSgPqnL8w3u1TXbGKwRcD0i7J4zC?f

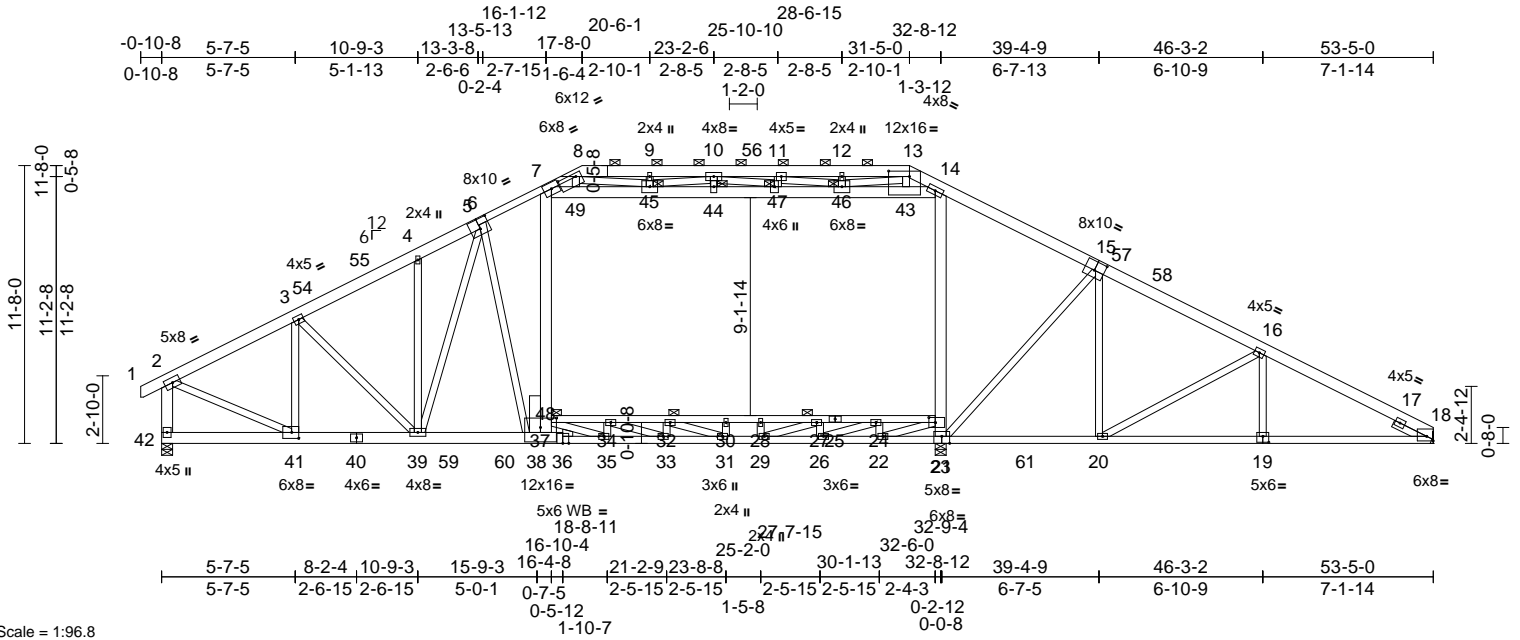

Scale = 1:96.8

[5:0-5-0,0-5-0], [8:0-9-4,0-1-12], [13:0-10-8,0-2-12], [15:0-5-0,0-4-8], [18:Edge,0-2-4], [19:0-3-0,0-3-0], [21:0-4-0,Edge], [23:0-3-4,0-2-8], [37:0-8-0,0-4-12],

Plate Offsets (X, Y): [41:0-3-8,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.94	Vert(LL)	-0.49	35-38	>804	240
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.71	Vert(CT)	-0.73	35-38	>532	180
TCDL	10.0	Rep Stress Incr	NO	WB	0.87	Horz(CT)	0.21	18	n/a	n/a
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-MSH	Attic		-0.24	23-37	>839	360
BCDL	10.0									

Weight: 2009 lb FT = 20%

**LUMBER**  
**TOP CHORD** 2x6 SP No.2 \*Except\* 5-8:2x4 SP 2400F 2.0E  
**BOT CHORD** 2x4 SP 2400F 2.0E \*Except\* 25-23,25-37:2x4 SP No.2, 40-42:2x6 SP No.2, 40-36:2x6 SP 2400F 2.0E  
**WEBS** 2x4 SP No.3 \*Except\* 42-2,7-38,48-38,14-7:2x6 SP No.2, 14-21:2x6 SP 2400F 2.0E, 41-2:2x4 SP No.2  
**OTHERS** 2x4 SP No.3  
**SLIDER** Right 2x4 SP No.3 -- 1-6-0  
**BRACING**  
**TOP CHORD** Structural wood sheathing directly applied or 5-10-15 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 8-13.  
**BOT CHORD** Rigid ceiling directly applied or 10-0-0 oc bracing. Except: 10-0-0 oc bracing: 23-37  
**JOINTS** 1 Brace at Jt(s): 37, 44, 45, 46, 47  
**REACTIONS** (size) 18= Mechanical, 21=0-5-8, 42=0-5-8  
 Max Horiz 42=-184 (LC 10)  
 Max Uplift 18=-407 (LC 12), 21=-5348 (LC 45), 42=-671 (LC 12)  
 Max Grav 18=8869 (LC 46), 21=778 (LC 12), 42=11749 (LC 46)  
**FORCES** (lb) - Maximum Compression/Maximum Tension  
**TOP CHORD** 1-2=0/28, 2-3=-13441/761, 3-4=-17246/1003, 4-6=-18788/1093, 6-7=-18558/1088, 7-8=-6781/520, 8-9=-3065/520, 9-10=-3056/521, 10-11=-3525/692, 11-12=-1491/1788, 12-13=-1491/1788, 13-14=-4278/402, 14-16=-17888/1059, 16-18=-17675/875, 2-42=-11552/690

**BOT CHORD** 41-42=-127/434, 39-41=-710/12020, 38-39=-806/16070, 35-38=-784/13850, 33-35=-337/16866, 31-33=0/17864, 29-31=0/18038, 26-29=0/16339, 22-26=-211/13857, 20-22=-756/16056, 18-20=-719/15527, 34-37=-1156/0, 32-34=-2708/0, 30-32=-3125/0, 28-30=-3125/0, 27-28=-3125/0, 24-27=-1457/724, 23-24=-590/2369, 37-38=690/7935, 7-37=-533/8793, 21-23=-707/6504, 14-23=-503/7225, 15-20=-203/194, 16-19=-10/165, 30-31=-160/10, 28-29=-381/0, 34-35=-848/0, 35-37=0/3509, 32-33=-482/0, 33-34=0/1645, 31-32=-94/441, 22-24=-1354/0, 26-27=-821/0, 24-26=0/2909, 27-29=0/1803, 13-43=-190/3315, 10-44=-115/2244, 9-45=434/53, 12-46=-287/68, 11-47=-116/84, 16-20=-133/749, 22-23=0/2778, 15-21=-654/214, 7-49=-9718/621, 45-49=-9347/599, 44-45=-11261/655, 44-47=-11261/655, 46-47=-15812/921, 43-46=-12557/763, 14-43=-13132/795, 5-39=-2558/130, 4-39=-582/164, 3-39=-235/4941, 3-41=-5344/364, 2-41=-653/12741, 8-45=-5600/301, 10-45=-4034/335, 10-47=-4681/275, 13-46=-5493/306, 11-46=-2567/281, 8-49=-137/2007, 6-38=-129/1481

**NOTES**

- 1) 4-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
 Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc, 2x4 - 1 row at 0-9-0 oc.  
 Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc, 2x4 - 1 row at 0-9-0 oc.  
 Web connected as follows: 2x6 - 2 rows staggered at 0-4-0 oc, Except member 38-48 2x6 - 3 rows staggered at 0-4-0 oc, member 14-21 2x6 - 2 rows staggered at 0-9-0 oc, 2x4 - 1 row at 0-9-0 oc.  
 Attach BC w/ 1/2" diam. bolts (ASTM A-307) in the center of the member w/washers at 4-0-0 oc.
- 2) All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- 3) Unbalanced roof live loads have been considered for this design.



September 8, 2023

Continued on page 2

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPH Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



818 Soundside Road  
 Edenton, NC 27932

Job 23070131-01	Truss A06	Truss Type Attic Girder	Qty 1	Ply 4	90 Serenity-Roof-B326 A CP Job Reference (optional)	I60667308
--------------------	--------------	----------------------------	----------	----------	--------------------------------------------------------	-----------

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Fri Sep 08 15:07:30  
ID:pGeZvt1?IwruINEY\_xH4fkzRAp7-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?I

Page: 2

- 4) Wind: ASCE 7-16; Vult=130mph (3-second gust)  
Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft;  
Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior  
zone; cantilever left and right exposed ; end vertical left  
and right exposed; Lumber DOL=1.60 plate grip  
DOL=1.60
- 5) TLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15  
Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate  
DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9;  
Cs=1.00; Ct=1.10
- 6) Unbalanced snow loads have been considered for this  
design.
- 7) This truss has been designed for greater of min roof live  
load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on  
overhangs non-concurrent with other live loads.
- 8) Provide adequate drainage to prevent water ponding.
- 9) All plates are 3x5 MT20 unless otherwise indicated.
- 10) This truss has been designed for a 10.0 psf bottom  
chord live load nonconcurrent with any other live loads.
- 11) \* This truss has been designed for a live load of 20.0psf  
on the bottom chord in all areas where a rectangle  
3-06-00 tall by 2-00-00 wide will fit between the bottom  
chord and any other members, with BCDL = 10.0psf.
- 12) Ceiling dead load (5.0 psf) on member(s). 7-49, 45-49,  
44-45, 44-47, 46-47, 43-46, 14-43; Wall dead load  
(5.0psf) on member(s).7-37, 14-23
- 13) Bottom chord live load (40.0 psf) and additional bottom  
chord dead load (5.0 psf) applied only to room. 34-37,  
32-34, 30-32, 28-30, 27-28, 24-27, 23-24
- 14) Refer to girder(s) for truss to truss connections.
- 15) Provide mechanical connection (by others) of truss to  
bearing plate capable of withstanding 407 lb uplift at  
joint 18 and 5348 lb uplift at joint 21.
- 16) LGT4-SDS3 Simpson Strong-Tie connectors  
recommended to connect truss to bearing walls due to  
UPLIFT at jt(s) 42. This connection is for uplift only and  
does not consider lateral forces.
- 17) This truss is designed in accordance with the 2018  
International Residential Code sections R502.11.1 and  
R802.10.2 and referenced standard ANSI/TPI 1.
- 18) Graphical purlin representation does not depict the size  
or the orientation of the purlin along the top and/or  
bottom chord.
- 19) This truss has large uplift reaction(s) from gravity load  
case(s). Proper connection is required to secure truss  
against upward movement at the bearings. Building  
designer must provide for uplift reactions indicated.
- 20) LGT4 Hurricane ties must have four studs in line below  
the truss.
- 21) Hanger(s) or other connection device(s) shall be  
provided sufficient to support concentrated load(s) 9100  
lb down and 774 lb up at 15-11-0 on bottom chord. The  
design/selection of such connection device(s) is the  
responsibility of others.
- 22) Attic room checked for L/360 deflection.

**LOAD CASE(S)** Standard

- 1) Dead + Snow (balanced): Lumber Increase=1.15, Plate  
Increase=1.15  
Uniform Loads (lb/ft)  
Vert: 1-2=-60, 2-8=-60, 8-13=-60, 13-18=-60,  
42-50=-20, 23-37=-30, 7-49=-10, 45-49=-10,  
44-45=-10, 44-47=-10, 46-47=-10, 43-46=-10,  
14-43=-10  
Drag: 37-48=-10, 7-48=-10, 14-23=-10  
Concentrated Loads (lb)  
Vert: 38=-4881 (F)

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcacomponents.com](http://www.sbcacomponents.com))



818 Soundside Road  
Edenton, NC 27932


Job 23070131-01	Truss A07	Truss Type Attic	Qty 1	Ply 1	90 Serenity-Roof-B326 A CP Job Reference (optional)	160667309
--------------------	--------------	---------------------	----------	----------	--------------------------------------------------------	-----------

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Fri Sep 08 15:07:32

Page: 1

ID:1d51NYb\_Snpjgfh0e1reGzRBHO-RfC?PsB70Hq3NSgPqnL8w3u1TXbGKWRcDoi7J4zJc7f

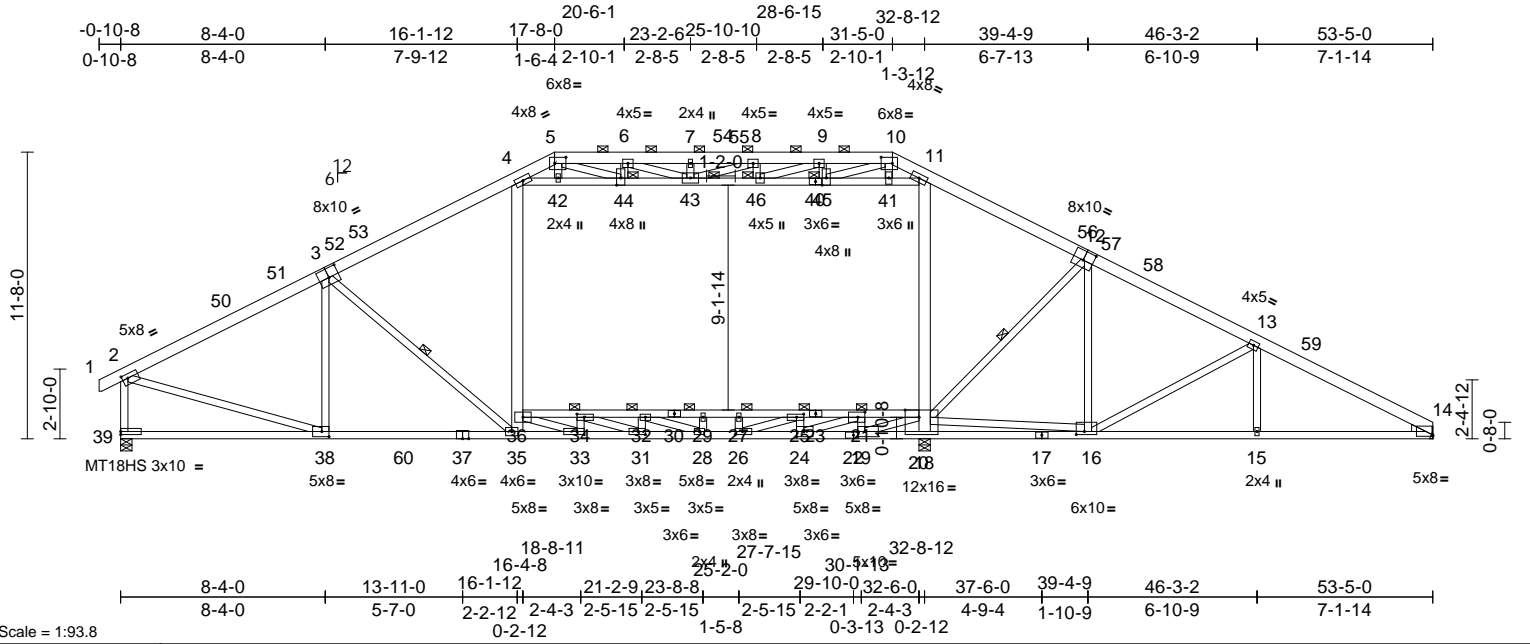


[2:0-2-12,0-2-0], [3:0-5-0,0-4-8], [5:0-5-8,0-3-0], [10:0-5-8,0-3-0], [12:0-5-0,0-4-8], [14:Edge,0-0-11], [16:0-4-0,0-1-8], [19:0-3-8,0-2-8], [20:0-6-12,Edge], [21:0-3-8,0-2-8], [22:0-2-2,0-1-8], [24:0-3-8,0-2-8], [25:0-3-8,0-1-8], [26:0-3-8,0-1-8], [31:0-3-8,0-1-8], [33:0-3-8,0-1-8], [34:0-3-8,0-1-8], [38:0-3-8,0-2-8],

Plate Offsets (X, Y): [44:0-3-8,0-2-0], [45:0-3-8,0-2-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	Vert(LL)	-0.48	29-32	>819	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	Vert(CT)	-0.77	29-32	>506	180	MT18HS	244/190
TCDL	10.0	Rep Stress Incr	YES	WB	Horz(CT)	0.14	14	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-MSH	Attic	-0.35	20-36	>568	360		
BCDL	10.0										

Weight: 453 lb FT = 20%

**LUMBER**  
TOP CHORD 2x6 SP No.2  
BOT CHORD 2x4 SP No.2 \*Except\* 14-17,37-22:2x4 SP 2400F 2.0E, 37-39:2x4 SP No.1  
WEBS 2x4 SP No.3 \*Except\* 4-35,11-18:2x6 SP No.2, 40-11,38-2,40-4:2x4 SP No.2, 36-33,34-31,32-28,21-24,25-26,20-19,16-20: 2x4 SP No.1  
WEDGE Right: 2x4 SP No.3  
**BRACING**  
TOP CHORD Structural wood sheathing directly applied or 2-10-14 oc purlins, except end verticals, and 2-0-0 oc purlins (3-8-13 max.): 5-10.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except:  
2-2-0 oc bracing: 35-38  
2-4-13 oc bracing: 18-19  
3-0-9 oc bracing: 16-18.  
10-0-0 oc bracing: 20-36  
WEBS 1 Row at midpt 3-35, 12-20  
JOINTS 1 Brace at Jt(s): 43, 44, 45, 46  
**REACTIONS** (size) 14= Mechanical, 18=0-5-8, 39=0-5-8  
Max Horiz 39=-189 (LC 12)  
Max Uplift 18=-62 (LC 15), 39=-30 (LC 14)  
Max Grav 14=2299 (LC 46), 18=1776 (LC 38), 39=2998 (LC 36)  
**FORCES** (lb) - Maximum Compression/Maximum Tension  
TOP CHORD 1-2=0/26, 2-4=-3883/11, 4-5=-1900/104, 5-6=-2872/339, 6-7=-3491/494, 7-8=-3491/494, 8-9=-3499/484, 9-10=-2718/358, 10-11=-1709/127, 11-13=-3769/50, 13-14=-4287/33, 2-39=-2868/73  
BOT CHORD 34-36=-1865/0, 32-34=-3331/0, 29-32=-3215/0, 27-29=-3215/0, 25-27=-3215/0, 21-25=-1305/739, 20-21=-42/2036, 38-39=-108/219, 35-38=-16/3320, 33-35=0/3214, 31-33=0/4818, 28-31=0/6229, 26-28=0/6113, 24-26=0/4203, 19-24=0/1393, 18-19=-2254/0, 16-18=-2068/0, 15-16=0/3733, 14-15=-55/3733  
WEBS 3-38=-653/76, 35-36=-42/292, 4-36=0/1162, 18-20=-1417/167, 11-20=-32/1161, 12-16=-258/97, 13-15=0/244, 4-42=-2060/9, 42-44=-2000/10, 43-44=-1792/595, 43-46=-1704/1222, 45-46=-1911/441, 41-45=-2170/28, 11-41=-2301/28, 2-38=0/3374, 28-29=-102/37, 26-27=-394/0, 33-34=-833/0, 33-36=0/2241, 31-32=-320/36, 31-34=0/1554, 28-32=-407/60, 19-21=-1376/0, 24-25=-932/0, 21-24=0/2977, 25-26=0/2025, 10-41=0/529, 5-42=0/295, 7-43=-200/79, 6-44=-432/119, 9-45=-481/114, 10-45=-292/1458, 8-46=-245/65, 9-46=-139/830, 8-43=-158/110, 13-16=-518/208, 3-35=-148/350, 19-20=0/3892, 16-20=0/5036, 12-20=-587/316, 5-44=-297/1339, 6-43=-168/659  
**NOTES**  
1) Unbalanced roof live loads have been considered for this design.  
2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-9-14 to 4-6-4, Interior (1) 4-6-4 to 10-1-6, Exterior(2R) 10-1-6 to 38-11-10, Interior (1) 38-11-10 to 48-0-14, Exterior(2E) 48-0-14 to 53-5-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60  
3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10  
4) Unbalanced snow loads have been considered for this design.  
5) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.  
6) Provide adequate drainage to prevent water ponding.

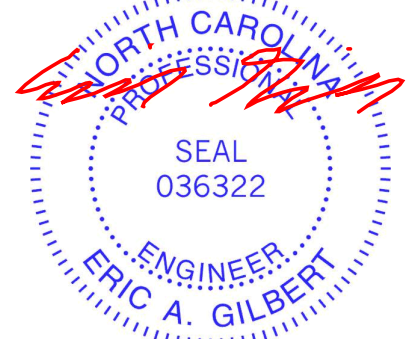

September 8, 2023

Continued on page 2

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPH Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



818 Soundside Road  
Edenton, NC 27932

Job 23070131-01	Truss A07	Truss Type Attic	Qty 1	Ply 1	90 Serenity-Roof-B326 A CP Job Reference (optional)	I60667309
--------------------	--------------	---------------------	----------	----------	--------------------------------------------------------	-----------

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Fri Sep 08 15:07:32  
ID:1d5INYb\_SnpjifH0e1reGzRBHO-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Page: 2

- 7) All plates are MT20 plates unless otherwise indicated.
- 8) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 9) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 10) Ceiling dead load (5.0 psf) on member(s). 4-42, 42-44, 43-44, 43-46, 45-46, 41-45, 11-41; Wall dead load (5.0psf) on member(s).4-36, 11-20
- 11) Bottom chord live load (40.0 psf) and additional bottom chord dead load (5.0 psf) applied only to room. 34-36, 32-34, 29-32, 27-29, 25-27, 21-25, 20-21
- 12) Refer to girder(s) for truss to truss connections.
- 13) One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 39 and 18. This connection is for uplift only and does not consider lateral forces.
- 14) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 15) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 16) Attic room checked for L/360 deflection.

**LOAD CASE(S)** Standard

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcacomponents.com](http://www.sbcacomponents.com))



818 Soundside Road  
Edenton, NC 27932




Job 23070131-01	Truss A08	Truss Type Attic	Qty 6	Ply 1	90 Serenity-Roof-B326 A CP Job Reference (optional)	160667310
--------------------	--------------	---------------------	----------	----------	--------------------------------------------------------	-----------

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Fri Sep 08 15:07:34  
ID:h5TF02tZyfWTVvSpKto8\_zRQij-RfC?PsB70Hq3NSgPqnL8w3uITXbGKwRCD0i7J4zJC?z

Page: 1

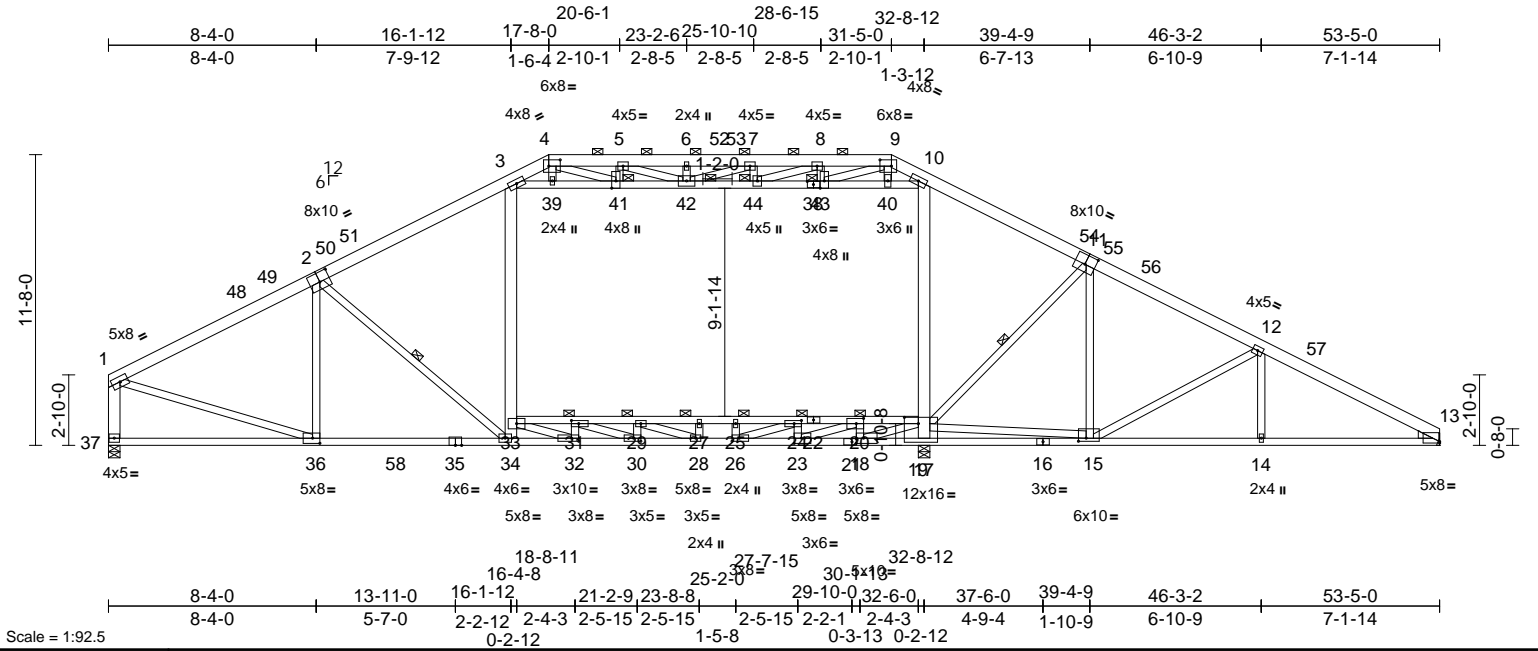

[2:0-5-0,0-4-8], [4:0-5-8,0-3-0], [9:0-5-8,0-3-0], [11:0-5-0,0-4-8], [13:Edge,0-0-11], [15:0-3-12,0-1-8], [17:0-6-12,0-3-0], [18:0-3-8,0-2-8], [20:0-3-8,0-2-8], [21:0-2-2,0-1-8], [23:0-3-8,0-2-8], [24:0-3-8,0-1-8], [26:0-3-8,0-1-8], [30:0-3-8,0-1-8], [31:0-3-8,0-1-8], [32:0-3-8,0-1-8], [36:0-3-8,0-2-8], [38:0-2-15,0-1-8], [41:0-3-8,0-2-0], [43:0-3-8,0-2-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	Vert(LL)	-0.47	27-29	>822	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	Vert(CT)	-0.77	27-29	>509	180		
TCDL	10.0	Rep Stress Incr	YES	WB	Horz(CT)	0.14	13	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-MSH	Attic	-0.35	19-33	>568	360		
BCDL	10.0									Weight: 453 lb	FT = 20%

**LUMBER**  
TOP CHORD 2x6 SP No.2  
BOT CHORD 2x4 SP No.2 \*Except\* 37-35:2x4 SP No.1, 16-13,35-21:2x4 SP 2400F 2.0E  
WEBS 2x4 SP No.3 \*Except\* 3-34,10-17,37-1:2x6 SP No.2, 38-10,36-1,38-3:2x4 SP No.2, 33-32,31-30,29-28,19-18,20-23,24-26,15-19: 2x4 SP No.1  
WEDGE Right: 2x4 SP No.3  
**BRACING**  
TOP CHORD Structural wood sheathing directly applied or 2-11-0 oc purlins, except end verticals, and 2-0-0 oc purlins (3-8-14 max.): 4-9.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except:  
2-5-1 oc bracing: 17-18  
3-0-13 oc bracing: 15-17  
10-0-0 oc bracing: 19-33  
WEBS 1 Row at midpt 2-34, 11-19  
JOINTS 1 Brace at Jt(s): 41, 42, 43, 44  
**REACTIONS** (size) 13= Mechanical, 17=0-5-8, 37=0-5-8  
Max Horiz 37=222 (LC 15)  
Max Uplift 17=64 (LC 15), 37=11 (LC 14)  
Max Grav 13=2293 (LC 45), 17=1772 (LC 37), 37=2946 (LC 35)  
**FORCES** (lb) - Maximum Compression/Maximum Tension  
TOP CHORD 1-3=-3865/14, 3-4=-1893/107, 4-5=-2867/337, 5-6=-3488/492, 6-7=-3488/492, 7-8=-3496/482, 8-9=-2716/356, 9-10=-1707/124, 10-12=-3756/51, 12-13=-4274/39, 1-37=-2815/55  
**NOTES**  
1) Unbalanced roof live loads have been considered for this design.  
2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-2-12 to 5-6-14, Interior (1) 5-6-14 to 10-1-6, Exterior(2R) 10-1-6 to 38-11-10, Interior (1) 38-11-10 to 48-0-14, Exterior(2E) 48-0-14 to 53-5-0 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60  
3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10  
4) Unbalanced snow loads have been considered for this design.  
5) Provide adequate drainage to prevent water ponding.  
6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.



Continued on page 2

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPH Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



818 Soundside Road  
Edenton, NC 27932



Job 23070131-01	Truss A08	Truss Type Attic	Qty 6	Ply 1	90 Serenity-Roof-B326 A CP Job Reference (optional)	I60667310
--------------------	--------------	---------------------	----------	----------	--------------------------------------------------------	-----------

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Fri Sep 08 15:07:34  
ID:h5TFO2tlZyfWTVvSpKto8\_zRQij-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 2

- 7) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 8) Ceiling dead load (5.0 psf) on member(s). 3-39, 39-41, 41-42, 42-44, 43-44, 40-43, 10-40; Wall dead load (5.0psf) on member(s).3-33, 10-19
- 9) Bottom chord live load (40.0 psf) and additional bottom chord dead load (5.0 psf) applied only to room. 31-33, 29-31, 27-29, 25-27, 24-25, 20-24, 19-20
- 10) Refer to girder(s) for truss to truss connections.
- 11) One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 37 and 17. This connection is for uplift only and does not consider lateral forces.
- 12) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 13) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 14) Attic room checked for L/360 deflection.

**LOAD CASE(S)** Standard

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcacompnents.com](http://www.sbcacompnents.com))



818 Soundside Road  
Edenton, NC 27932



Job	Truss	Truss Type	Qty	Ply	90 Serenity-Roof-B326 A CP	160667311
23070131-01	A09	Attic Supported Gable	1	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Fri Sep 08 15:07:36

Page: 2

ID:8kdnaNVfrXy7X5iJovJ26tzRBB2-RfC?PsB70Hq3NSgPqnL8w3uITxBGKWrCDoi7J4zJC?f

WEBS 54-55=-1090/1, 9-54=-1078/106, **LOAD CASE(S)** Standard

38-39=-1116/28, 16-39=-1101/123,  
48-49=-115/0, 46-47=-115/0, 52-53=-171/0,  
53-54=-57/22, 50-51=-147/0, 51-52=-13/11,  
49-50=-11/13, 40-41=-173/0, 44-45=-148/0,  
40-44=-3/15, 45-47=-10/17, 15-65=-48/11,  
9-67=-16/694, 67-69=-15/688,  
68-69=-279/2058, 68-71=-412/2714,  
70-71=-276/1982, 65-70=-11/565,  
16-65=-13/579, 10-67=-15/15,  
12-68=-256/65, 11-69=-470/113,  
14-70=-483/114, 15-70=-281/1498,  
13-71=-239/66, 14-71=-148/778,  
13-68=-66/182, 39-41=-27/17,  
10-69=-279/1447, 11-68=-145/779,  
17-37=-86/159, 18-36=-176/71,  
19-34=-194/69, 21-33=-177/67,  
22-32=-128/68, 23-31=-118/69,  
24-30=-144/52, 25-29=-31/163,  
26-28=-346/91, 8-56=-87/150, 7-58=-187/70,  
6-59=-199/74, 5-60=-183/61, 4-61=-145/69,  
3-62=-120/62, 2-63=-168/118

#### NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust)  
Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=25ft;  
Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-2-12 to 5-6-14, Interior (1) 5-6-14 to 10-1-6, Exterior(2R) 10-1-6 to 38-11-10, Interior (1) 38-11-10 to 48-0-14, Exterior(2E) 48-0-14 to 53-5-0 zone; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 4) T CLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- 5) Unbalanced snow loads have been considered for this design.
- 6) Provide adequate drainage to prevent water ponding.
- 7) All plates are 2x4 MT20 unless otherwise indicated.
- 8) Gable requires continuous bottom chord bearing.
- 9) Gable studs spaced at 2-0-0 oc.
- 10) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 11) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 12) Ceiling dead load (5.0 psf) on member(s). 9-67, 67-69, 68-69, 68-71, 70-71, 65-70, 16-65; Wall dead load (5.0psf) on member(s).9-54, 16-39
- 13) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 109 lb uplift at joint 64, 1 lb uplift at joint 38, 124 lb uplift at joint 37, 46 lb uplift at joint 36, 45 lb uplift at joint 34, 44 lb uplift at joint 33, 43 lb uplift at joint 32, 49 lb uplift at joint 31, 17 lb uplift at joint 30, 189 lb uplift at joint 29, 89 lb uplift at joint 28, 115 lb uplift at joint 56, 45 lb uplift at joint 58, 50 lb uplift at joint 59, 37 lb uplift at joint 60, 47 lb uplift at joint 61, 28 lb uplift at joint 62 and 119 lb uplift at joint 63.
- 14) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 15) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 16) Warning: Additional permanent and stability bracing for truss system (not part of this component design) is always required.
- 17) Attic room checked for L/360 deflection.

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcacomponents.com](http://www.sbcacomponents.com))




818 Soundside Road  
Edenton, NC 27932

Job 23070131-01	Truss B01	Truss Type Common Structural Gable	Qty 1	Ply 1	90 Serenity-Roof-B326 A CP Job Reference (optional)	160667312
--------------------	--------------	---------------------------------------	----------	----------	--------------------------------------------------------	-----------

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Fri Sep 08 15:07:39  
ID:bYvcELRthF7aR0JRUAUJmAzRQ4-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Page: 1

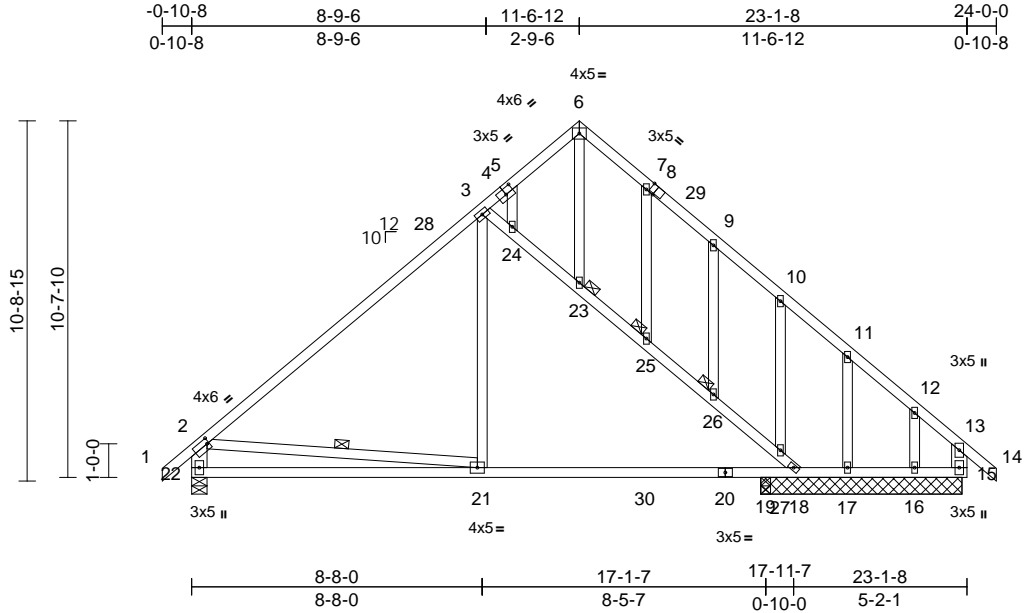

Scale = 1:68.7

Plate Offsets (X, Y): [2:0-0-12,0-2-0], [4:0-3-0,0-2-4], [8:0-2-0,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.83	Vert(LL)	-0.14	19-21	>999	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.73	Vert(CT)	-0.22	21-22	>935	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.48	Horz(CT)	0.02	15	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 165 lb	FT = 20%

**LUMBER**  
TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x6 SP No.2 \*Except\* 3-21,2-21:2x4 SP No.3, 3-18:2x4 SP No.2  
OTHERS 2x4 SP No.3

**BRACING**  
TOP CHORD Structural wood sheathing directly applied or 4-8-11 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 9-0-15 oc bracing.  
WEBS 1 Row at midpt 2-21  
JOINTS 1 Brace at Jt(s): 23, 25, 26

**REACTIONS** (size) 15=6-0-0, 16=6-0-0, 17=6-0-0, 18=6-0-0, 19=0-3-8, 22=0-5-8  
Max Horiz 22=273 (LC 12)  
Max Uplift 16=-216 (LC 15), 17=-55 (LC 15), 18=-298 (LC 14), 22=-46 (LC 14)  
Max Grav 15=570 (LC 22), 16=82 (LC 13), 17=289 (LC 25), 18=368 (LC 1), 19=539 (LC 23), 22=890 (LC 5)


**FORCES** (lb) - Maximum Compression/Maximum Tension  
TOP CHORD 1-2=0/42, 2-3=-882/78, 3-5=-395/167, 5-6=-353/167, 6-7=-341/123, 7-9=-367/53, 9-10=-474/47, 10-11=-367/1, 11-12=-340/44, 12-13=-454/70, 13-14=0/42, 2-22=-782/115, 13-15=-461/37  
BOT CHORD 21-22=-408/730, 19-21=-45/672, 18-19=-45/672, 17-18=-32/262, 16-17=-32/262, 15-16=-32/262

**WEBS** 3-21=0/425, 3-24=-726/270, 23-24=-630/199, 23-25=-618/192, 25-26=-653/214, 26-27=-644/210, 18-27=-740/268, 6-23=-110/195, 5-24=-110/149, 7-25=-164/82, 9-26=-11/26, 10-27=-286/189, 11-17=-166/108, 12-16=-73/148, 2-21=-181/416

- NOTES**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior (1) 2-1-8 to 8-6-12, Exterior(2R) 8-6-12 to 14-6-12, Interior (1) 14-6-12 to 21-0-0, Exterior(2E) 21-0-0 to 24-0-0 zone; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
  - TCCL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
  - Unbalanced snow loads have been considered for this design.
  - This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
  - All plates are 2x4 MT20 unless otherwise indicated.
  - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
  - Gable studs spaced at 2-0-0 oc.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- N/A

13) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.  
**LOAD CASE(S)** Standard

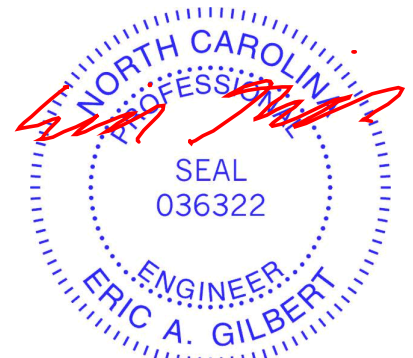

September 8, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road  
Edenton, NC 27932

Job 23070131-01	Truss B02	Truss Type Common Girder	Qty 1	Ply 2	90 Serenity-Roof-B326 A CP Job Reference (optional)	I60667313
--------------------	--------------	-----------------------------	----------	----------	--------------------------------------------------------	-----------

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Fri Sep 08 15:07:39  
ID:IFFKd9\_s5HOVK9vBFwqTAGzRAMn-RfC?PsB70Hq3NSgPqnL8w3uITXbGKwRCDoi7J4zJC?f

Page: 1

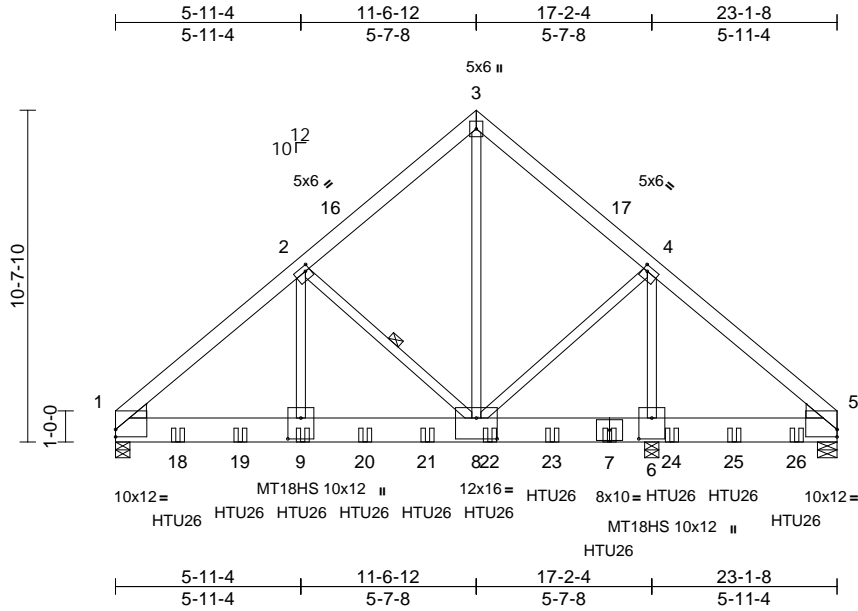

Scale = 1:73.9

Plate Offsets (X, Y): [1:Edge,0-2-13], [2:0-1-12,0-2-0], [4:0-1-12,0-2-0], [5:Edge,0-2-13], [6:0-8-0,0-5-0], [8:0-8-0,0-8-0], [9:0-8-0,0-5-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.31	Vert(LL)	-0.09	8-9	>999	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.36	Vert(CT)	-0.16	8-9	>999	180	MT18HS	244/190
TCDL	10.0	Rep Stress Incr	NO	WB	0.77	Horz(CT)	0.02	6	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 429 lb	FT = 20%

**LUMBER**

TOP CHORD 2x6 SP No.2  
 BOT CHORD 2x10 SP 2400F 2.0E  
 WEBS 2x4 SP No.2  
 WEDGE Left: 2x6 SP No.2  
 Right: 2x6 SP No.2

**BRACING**

TOP CHORD Structural wood sheathing directly applied or 4-9-13 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.  
 WEBS 1 Row at midpt 2-8

**REACTIONS**

(size) 1=0-5-8, 5=0-7-8, 6=0-5-8  
 Max Horiz 1=226 (LC 9)  
 Max Uplift 5=-509 (LC 13)  
 Max Grav 1=8855 (LC 5), 5=658 (LC 19),  
 6=12905 (LC 6)

**FORCES**


(lb) - Maximum Compression/Maximum Tension  
 TOP CHORD 1-2=-9851/0, 2-3=-5016/0, 3-4=-5021/0,  
 4-5=-83/414  
 BOT CHORD 1-9=0/7514, 8-9=0/7514, 6-8=-300/0,  
 5-6=-300/5  
 WEBS 2-9=0/6308, 2-8=-5110/0, 3-8=0/5959,  
 4-8=0/5533, 4-6=-7349/0

**NOTES**

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
 Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.  
 Bottom chords connected as follows: 2x10 - 3 rows staggered at 0-4-0 oc.  
 Web connected as follows: 2x4 - 1 row at 0-5-0 oc.

- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- All plates are MT20 plates unless otherwise indicated.
- The Fabrication Tolerance at joint 9 = 16%, joint 6 = 16%
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 5. This connection is for uplift only and does not consider lateral forces.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

- Use Simpson Strong-Tie HTU26 (20-10d Girder, 11-10dx1 1/2 Truss) or equivalent spaced at 2-0-0 oc max. starting at 2-0-0 from the left end to 15-10-0 to connect truss(es) to back face of bottom chord.
  - Use Simpson Strong-Tie HTU26 (20-10d Girder, 11-10dx1 1/2 Truss, Single Ply Girder) or equivalent spaced at 2-0-0 oc max. starting at 17-10-0 from the left end to 21-10-0 to connect truss(es) to back face of bottom chord.
  - Fill all nail holes where hanger is in contact with lumber.
- LOAD CASE(S)** Standard
- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15  
 Uniform Loads (lb/ft)  
 Vert: 1-3=-60, 3-5=-60, 10-13=-20  
 Concentrated Loads (lb)  
 Vert: 7=-1910 (B), 9=-1910 (B), 18=-1910 (B),  
 19=-1910 (B), 20=-1910 (B), 21=-1910 (B),  
 22=-1910 (B), 23=-1910 (B), 24=-884 (B), 25=-884 (B), 26=-884 (B)

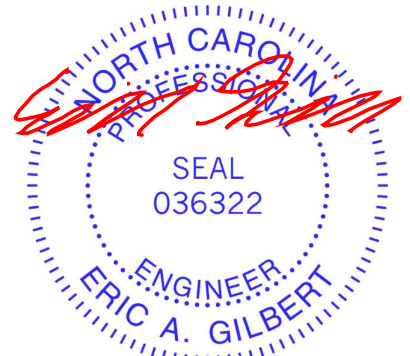

September 8, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



818 Soundside Road  
 Edenton, NC 27932




Job 23070131-01	Truss C01	Truss Type Half Hip	Qty 4	Ply 1	90 Serenity-Roof-B326 A CP Job Reference (optional)	160667314
--------------------	--------------	------------------------	----------	----------	--------------------------------------------------------	-----------

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Fri Sep 08 15:07:40  
ID:Je5w06f8goBW?T4xbCQ60Kyfk?K-RfC?PsB70Hq3NSgPqnL8w3uITxbGKWrCdoi7J4zJC?F

Page: 1

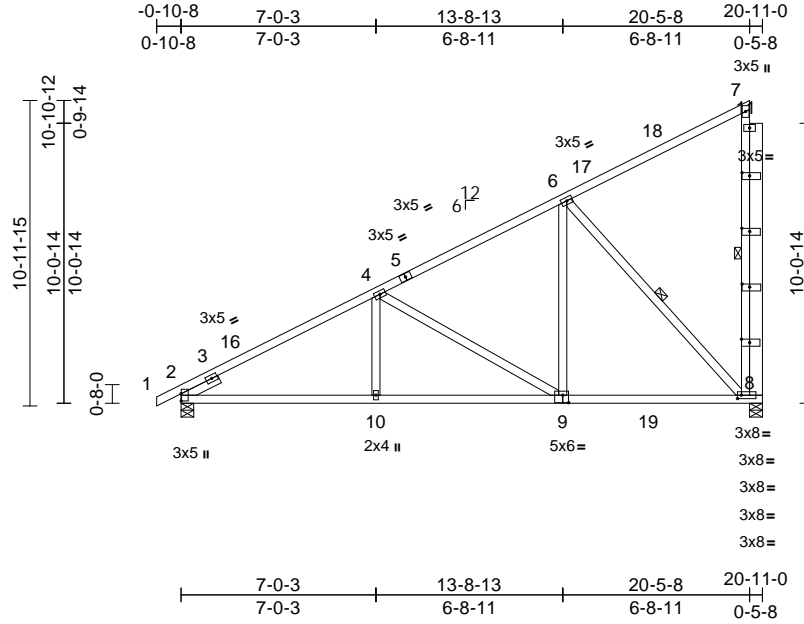

Scale = 1:82.9

Plate Offsets (X, Y): [2:0-3-1,0-0-1], [8:0-1-12,0-1-8], [8:0-3-8,0-1-7], [8:0-3-4,0-1-5], [8:0-3-6,0-1-6], [8:0-3-5,0-1-6], [9:0-2-8,0-3-4]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.95	Vert(LL)	-0.08	8-9	>999	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.68	Vert(CT)	-0.13	8-9	>999	180		
TCDL	10.0	Rep Stress Incr	NO	WB	0.67	Horz(CT)	0.03	8	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 148 lb	FT = 20%

**LUMBER**  
TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.3 \*Except\* 7-8:2x4 SP No.2, 11-8:2x6 SP No.2  
SLIDER Left 2x4 SP No.3 -- 1-6-0

**BRACING**  
TOP CHORD Structural wood sheathing directly applied or 4-9-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
WEBS 1 Row at midpt 7-8, 6-8

**REACTIONS** (size) 2=0-5-8, 8=0-5-8  
Max Horiz 2=386 (LC 14)  
Max Uplift 2=-48 (LC 14), 8=-343 (LC 14)  
Max Grav 2=948 (LC 5), 8=1731 (LC 21)


**FORCES** (lb) - Maximum Compression/Maximum Tension  
TOP CHORD 1-2=0/23, 2-4=-1361/28, 4-6=-813/0, 6-7=-164/105, 7-8=-271/93  
BOT CHORD 2-10=-397/1163, 8-10=-317/1163  
WEBS 4-10=0/264, 4-9=-588/185, 6-9=0/584, 6-8=-953/226

- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 8 and 2. This connection is for uplift only and does not consider lateral forces.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 747 lb down and 128 lb up at 20-5-8 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

**LOAD CASE(S)** Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (lb/ft)  
Vert: 1-7=-60, 8-12=-20  
Concentrated Loads (lb)  
Vert: 8=-747

- NOTES**
- Wind: ASCE 7-16; Vult=130mph (3-second gust)  
Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft;  
Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior (1) 2-1-8 to 17-3-12, Exterior(2E) 17-3-12 to 20-3-12 zone; end vertical left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10

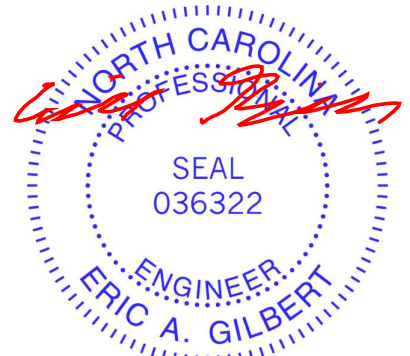

September 8, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



818 Soundside Road  
Edenton, NC 27932




Job 23070131-01	Truss C02	Truss Type Half Hip	Qty 1	Ply 1	90 Serenity-Roof-B326 A CP Job Reference (optional)	160667315
--------------------	--------------	------------------------	----------	----------	--------------------------------------------------------	-----------

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Fri Sep 08 15:07:40  
ID:EGq646Pbf2EXC6nWUjzpaiyfwU-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWRcDoi7J4zJC?f

Page: 1

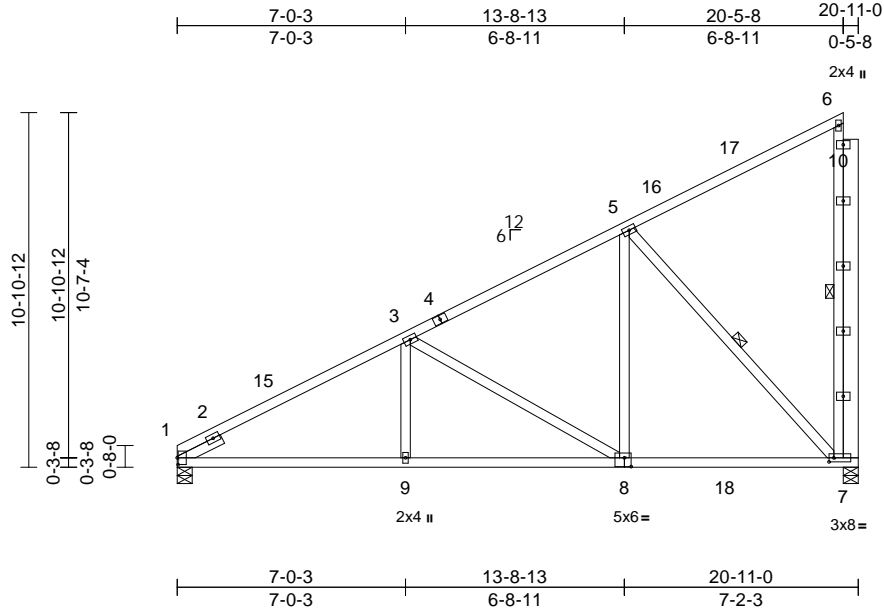

Scale = 1:70.8

Plate Offsets (X, Y): [1:0-2-8,0-0-5], [7:0-1-12,0-1-8], [8:0-2-8,0-3-4]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.79	Vert(LL)	-0.10	7-8	>999	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.73	Vert(CT)	-0.18	7-8	>999	180		
TCDL	10.0	Rep Stress Incr	NO	WB	0.67	Horz(CT)	0.03	7	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 146 lb	FT = 20%

**LUMBER**

TOP CHORD 2x4 SP No.2 \*Except\* 4-6:2x4 SP No.1  
 BOT CHORD 2x4 SP No.2  
 WEBS 2x4 SP No.3 \*Except\* 10-7:2x6 SP No.2,  
 6-7:2x4 SP No.2  
 SLIDER Left 2x4 SP No.3 -- 1-6-0

**BRACING**

TOP CHORD Structural wood sheathing directly applied or  
 4-8-13 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc  
 bracing.  
 WEBS 1 Row at midpt 6-7, 5-7

**REACTIONS**

(size) 1=0-5-8, 7=0-5-8  
 Max Horiz 1=373 (LC 14)  
 Max Uplift 1=-31 (LC 14), 7=-344 (LC 14)  
 Max Grav 1=901 (LC 5), 7=1723 (LC 20)

**FORCES**

(lb) - Maximum Compression/Maximum  
 Tension  
 TOP CHORD 1-3=-1360/29, 3-5=-815/0, 5-6=-153/82  
 BOT CHORD 1-9=-409/1161, 7-9=-318/1161  
 WEBS 3-9=0/260, 3-8=-584/184, 5-8=0/600,  
 6-7=-253/89, 5-7=-981/230

**NOTES**

- Wind: ASCE 7-16; Vult=130mph (3-second gust)  
 Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft;  
 Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior  
 zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior (1)  
 3-0-0 to 17-3-12, Exterior(2E) 17-3-12 to 20-3-12  
 zone;C-C for members and forces & MWFRS for  
 reactions shown; Lumber DOL=1.60 plate grip  
 DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15  
 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate  
 DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9;  
 Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this  
 design.

- Provide adequate drainage to prevent water ponding.
- All plates are 3x5 MT20 unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom  
 chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf  
 on the bottom chord in all areas where a rectangle  
 3-06-00 tall by 2-00-00 wide will fit between the bottom  
 chord and any other members, with BCDL = 10.0psf.
- One H2.5A Simpson Strong-Tie connectors  
 recommended to connect truss to bearing walls due to  
 UPLIFT at jt(s) 1 and 7. This connection is for uplift only  
 and does not consider lateral forces.
- This truss is designed in accordance with the 2018  
 International Residential Code sections R502.11.1 and  
 R802.10.2 and referenced standard ANSI/TPI 1.
- Hanger(s) or other connection device(s) shall be  
 provided sufficient to support concentrated load(s) 747  
 lb down and 128 lb up at 20-5-8 on bottom chord. The  
 design/selection of such connection device(s) is the  
 responsibility of others.

**LOAD CASE(S)** Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate  
 Increase=1.15  
 Uniform Loads (lb/ft)  
 Vert: 1-6=-60, 7-11=-20  
 Concentrated Loads (lb)  
 Vert: 7=-747



September 8, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road  
 Edenton, NC 27932

Job 23070131-01	Truss D01	Truss Type Common Supported Gable	Qty 1	Ply 1	90 Serenity-Roof-B326 A CP Job Reference (optional)	I60667316
--------------------	--------------	--------------------------------------	----------	----------	--------------------------------------------------------	-----------

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Fri Sep 08 15:07:41  
ID:8F2D?hHuvW?rb9K6OMb\_Yz2RQrE-RfC?PsB70Hq3NSgPqnL8w3uTxBGKwRCD0i7J4zJC?f

Page: 1

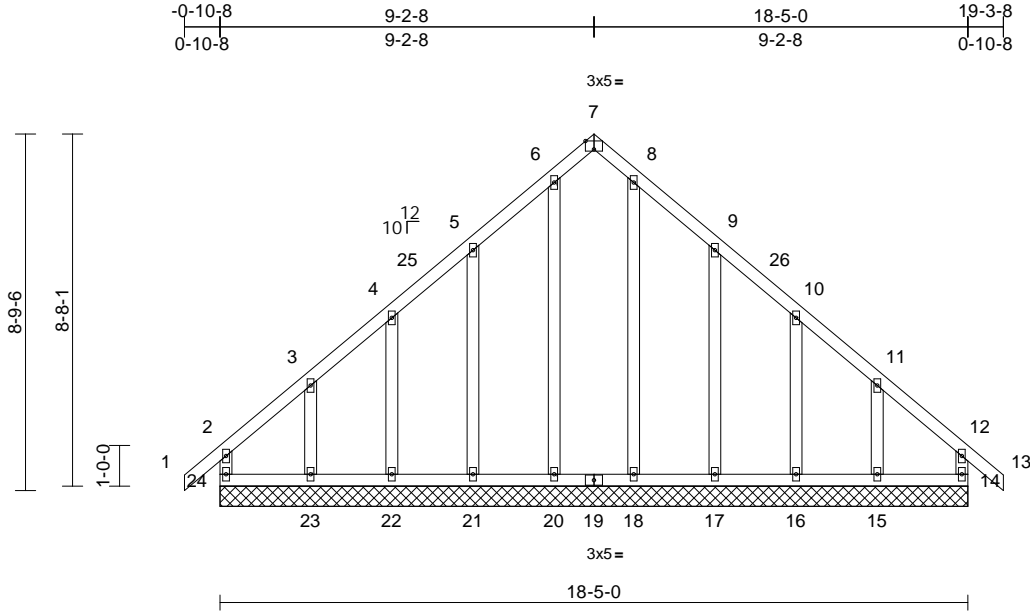

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.21	Vert(LL)	n/a	-	n/a	999	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.12	Vert(CT)	n/a	-	n/a	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.20	Horz(CT)	0.00	14	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-MR								
BCDL	10.0											
											Weight: 126 lb	FT = 20%

**LUMBER**  
TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.3  
OTHERS 2x4 SP No.3

**BRACING**  
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

**REACTIONS** (size)  
14=18-5-0, 15=18-5-0, 16=18-5-0, 17=18-5-0, 18=18-5-0, 20=18-5-0, 21=18-5-0, 22=18-5-0, 23=18-5-0, 24=18-5-0  
Max Horiz 24=224 (LC 13)  
Max Uplift 14=50 (LC 11), 15=163 (LC 15), 16=47 (LC 15), 17=116 (LC 15), 21=114 (LC 14), 22=47 (LC 14), 23=168 (LC 14), 24=69 (LC 10)  
Max Grav 14=189 (LC 28), 15=219 (LC 25), 16=173 (LC 22), 17=253 (LC 22), 18=225 (LC 22), 20=225 (LC 21), 21=253 (LC 21), 22=173 (LC 21), 23=226 (LC 24), 24=204 (LC 25)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
TOP CHORD 2-24=-167/63, 1-2=0/39, 2-3=-165/140, 3-4=-104/90, 4-5=-92/115, 5-6=-114/233, 6-7=-91/169, 7-8=-91/169, 8-9=-114/233, 9-10=-77/115, 10-11=-89/71, 11-12=-153/116, 12-13=0/39, 12-14=-154/47  
BOT CHORD 23-24=-106/187, 22-23=-106/187, 21-22=-106/187, 20-21=-106/187, 18-20=-106/187, 17-18=-106/187, 16-17=-106/187, 15-16=-106/187, 14-15=-106/187

**WEBS** 6-20=-185/8, 8-18=-185/6, 5-21=-213/162, 4-22=-133/94, 3-23=-159/159, 9-17=-213/162, 10-16=-133/92, 11-15=-155/167

- NOTES**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCCL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Corner(3E) -0-10-8 to 2-2-12, Exterior (2N) 2-2-12 to 6-2-8, Corner(3R) 6-2-8 to 12-2-4, Exterior(2N) 12-2-4 to 16-2-4, Corner(3E) 16-2-4 to 19-3-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
  - TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
  - Unbalanced snow loads have been considered for this design.
  - This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
  - All plates are 2x4 MT20 unless otherwise indicated.
  - Gable requires continuous bottom chord bearing.
  - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
  - Gable studs spaced at 2-0-0 oc.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 69 lb uplift at joint 24, 50 lb uplift at joint 14, 114 lb uplift at joint 21, 47 lb uplift at joint 22, 168 lb uplift at joint 23, 116 lb uplift at joint 17, 47 lb uplift at joint 16 and 163 lb uplift at joint 15.
  - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- LOAD CASE(S)** Standard



September 8, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



818 Soundside Road  
Edenton, NC 27932




Job 23070131-01	Truss E01	Truss Type Common Supported Gable	Qty 1	Ply 1	90 Serenity-Roof-B326 A CP Job Reference (optional)	160667318
--------------------	--------------	--------------------------------------	----------	----------	--------------------------------------------------------	-----------

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Fri Sep 08 15:07:42  
ID:XfVx5DgSDeEi7jgY6wjof?zRQtJ-RfC?PsB70Hq3NSgPqnL8w3uITxBGKwRCDoi7J4zJC?f

Page: 1

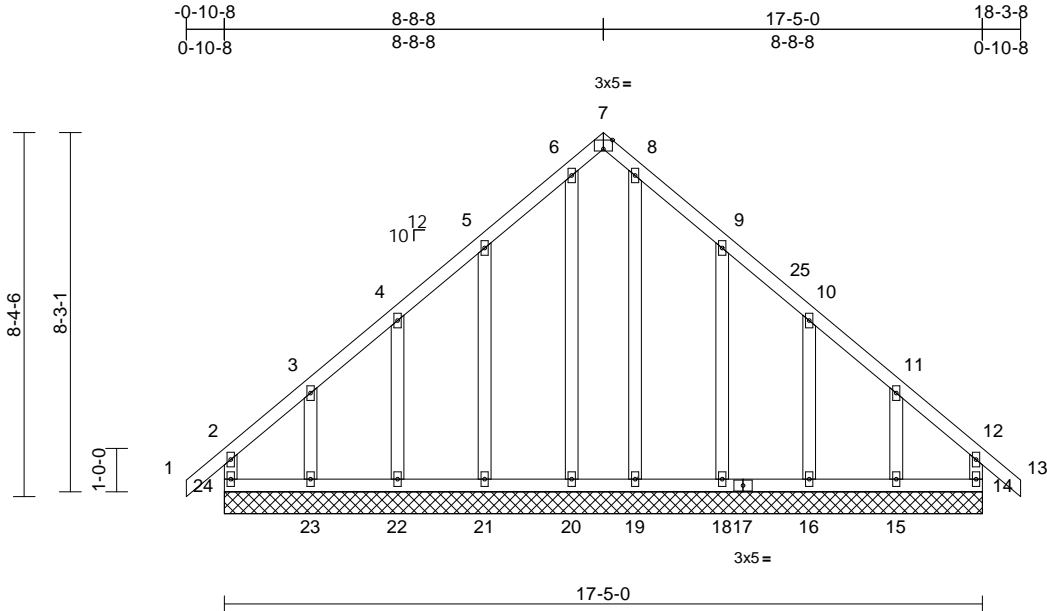

Scale = 1:52.9

Plate Offsets (X, Y): [7:0-2-8,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.19	Vert(LL)	n/a	-	n/a	999	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.10	Vert(CT)	n/a	-	n/a	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.17	Horz(CT)	0.00	14	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-MR								
BCDL	10.0											
											Weight: 120 lb	FT = 20%

**LUMBER**  
TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.3  
OTHERS 2x4 SP No.3

**BRACING**  
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

**REACTIONS** (size)  
14=17-5-0, 15=17-5-0, 16=17-5-0,  
18=17-5-0, 19=17-5-0, 20=17-5-0,  
21=17-5-0, 22=17-5-0, 23=17-5-0,  
24=17-5-0  
Max Horiz 24=214 (LC 12)  
Max Uplift 14=60 (LC 11), 15=146 (LC 15),  
16=56 (LC 15), 18=105 (LC 15),  
21=104 (LC 14), 22=55 (LC 14),  
23=151 (LC 14), 24=83 (LC 10)  
Max Grav 14=173 (LC 24), 15=206 (LC 25),  
16=183 (LC 22), 18=262 (LC 22),  
19=201 (LC 22), 20=165 (LC 27),  
21=182 (LC 24), 22=163 (LC 24),  
23=215 (LC 24), 24=192 (LC 25)


**FORCES** (lb) - Maximum Compression/Maximum Tension  
TOP CHORD 12-14=-141/53, 7-8=-89/185, 8-9=-119/262,  
9-10=-65/150, 10-11=-78/76, 11-12=-124/112,  
12-13=0/39, 1-2=0/39, 2-3=-149/138,  
3-4=-98/97, 4-5=-82/150, 5-6=-119/262,  
6-7=-88/185, 2-24=-156/72  
BOT CHORD 23-24=-102/158, 22-23=-102/158,  
21-22=-102/158, 20-21=-102/158,  
19-20=-102/158, 18-19=-102/158,  
16-18=-102/158, 15-16=-102/158,  
14-15=-102/158

**WEBS** 6-20=-132/14, 8-19=-168/14, 5-21=-139/153,  
4-22=-129/106, 3-23=-149/142,  
9-18=-220/153, 10-16=-143/104,  
11-15=-145/151

**NOTES**

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Corner(3E) -0-10-8 to 1-11-12, Exterior (2N) 1-11-12 to 5-8-8, Corner(3R) 5-8-8 to 11-5-4, Exterior(2N) 11-5-4 to 15-3-8, Corner(3E) 15-3-8 to 18-3-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 60 lb uplift at joint 14, 83 lb uplift at joint 24, 104 lb uplift at joint 21, 55 lb uplift at joint 22, 151 lb uplift at joint 23, 105 lb uplift at joint 18, 56 lb uplift at joint 16 and 146 lb uplift at joint 15.
  - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- LOAD CASE(S)** Standard

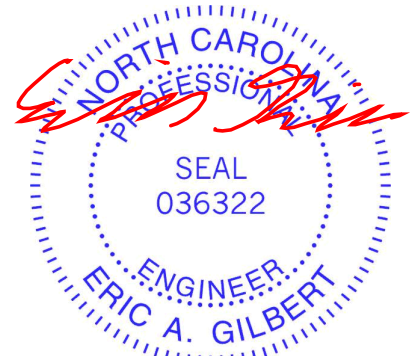

September 8, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbccomponents.com)



818 Soundside Road  
Edenton, NC 27932




Job 23070131-01	Truss G01	Truss Type Monopitch	Qty 5	Ply 1	90 Serenity-Roof-B326 A CP Job Reference (optional)	I60667319
--------------------	--------------	-------------------------	----------	----------	--------------------------------------------------------	-----------

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Fri Sep 08 15:07:42  
ID: PdAAD85\_ICJN?UaWrZnF5zRQu2-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

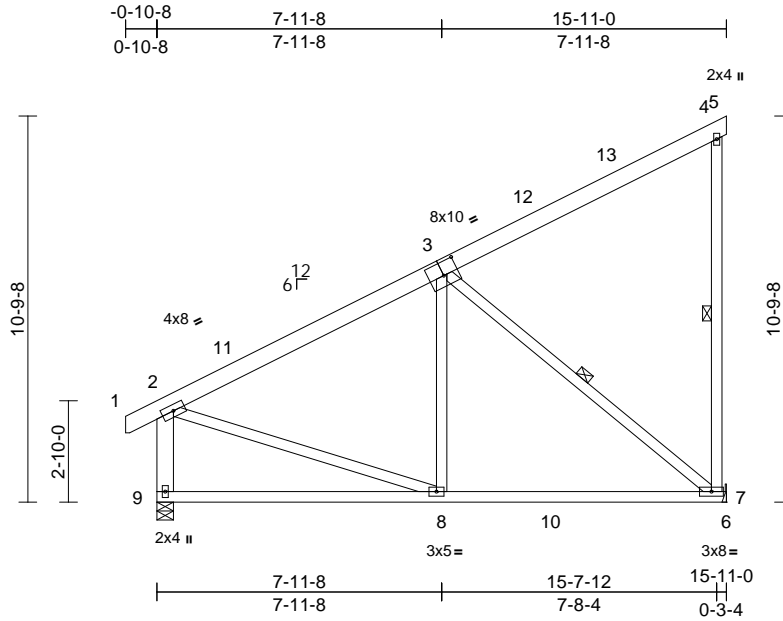

Scale = 1:64.4

Plate Offsets (X, Y): [3:0-5-0,0-4-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.49	Vert(LL)	-0.12	7-8	>999	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.66	Vert(CT)	-0.20	7-8	>909	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.36	Horz(CT)	-0.01	7	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 123 lb	FT = 20%

**LUMBER**

- TOP CHORD 2x6 SP No.2
- BOT CHORD 2x4 SP No.2
- WEBS 2x4 SP No.3 \*Except\* 9-2:2x6 SP No.2

**BRACING**

- TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
- BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
- WEBS 1 Row at midpt 4-7, 3-7

**REACTIONS**

- (size) 7= Mechanical, 9=0-5-8
- Max Horiz 9=271 (LC 14)
- Max Uplift 7=-219 (LC 14)
- Max Grav 7=824 (LC 5), 9=750 (LC 5)

**FORCES**

- (lb) - Maximum Compression/Maximum Tension
- TOP CHORD 4-7=-321/119, 2-9=-643/88, 1-2=0/28, 2-4=-674/91, 4-5=-12/0
- BOT CHORD 8-9=-323/217, 7-8=-198/540, 6-7=0/0
- WEBS 3-8=0/310, 3-7=-686/257, 2-8=0/486

**NOTES**

- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-9-14 to 2-2-2, Interior (1) 2-2-2 to 12-11-0, Exterior(2E) 12-11-0 to 15-11-0 zone; cantilever left and right exposed; end vertical left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.

- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 219 lb uplift at joint 7.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard



September 8, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road  
Edenton, NC 27932

Job 23070131-01	Truss H01	Truss Type Monopitch Supported Gable	Qty 2	Ply 1	90 Serenity-Roof-B326 A CP Job Reference (optional)	160667320
--------------------	--------------	-----------------------------------------	----------	----------	--------------------------------------------------------	-----------

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Fri Sep 08 15:07:42  
ID:kX6Xm09Jm8Rk\_RkgNonK3zRRGV-RfC?PsB70Hq3NSgPqnL8w3uTXbGKwRcDoi7J4zJC?f

Page: 1

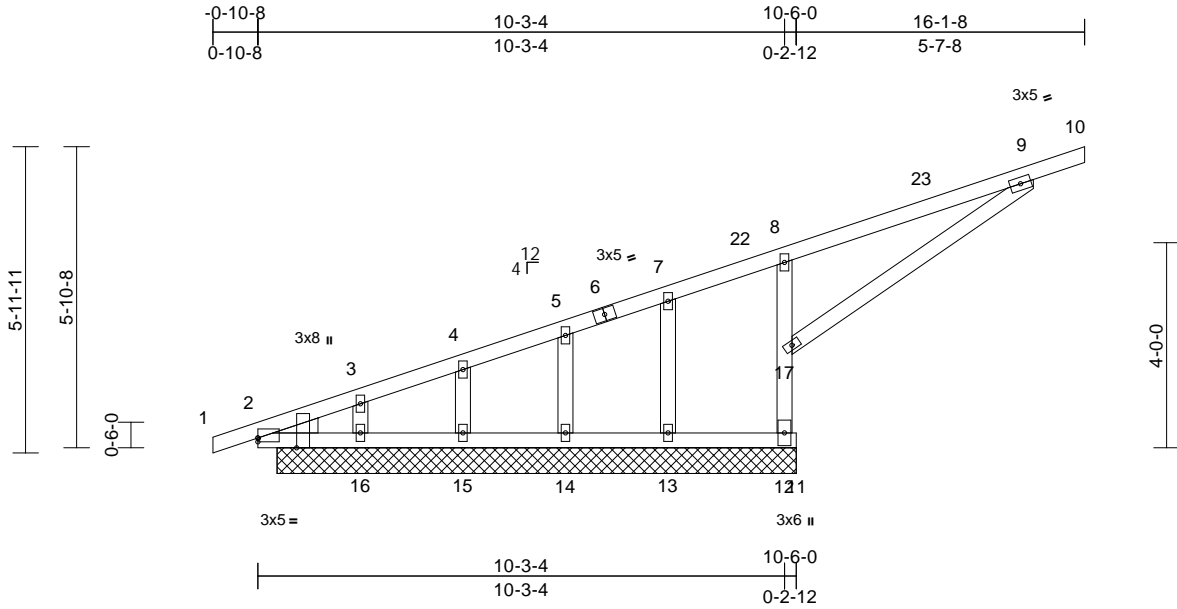

Scale = 1:44.9

Plate Offsets (X, Y): [2:Edge,0-0-14], [2:0-2-5,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.75	Vert(LL)	n/a	-	n/a	999	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.21	Vert(CT)	n/a	-	n/a	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.69	Horz(CT)	-0.01	2	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 67 lb	FT = 20%

**LUMBER**

TOP CHORD 2x4 SP No.2  
 BOT CHORD 2x4 SP No.2  
 WEBS 2x4 SP 2400F 2.0E \*Except\* 17-9:2x4 SP No.3  
 OTHERS 2x4 SP No.3  
 WEDGE Left: 2x4 SP No.3

**BRACING**

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing, Except: 10-0-0 oc bracing: 11-12.

**REACTIONS**

(size) 2=10-1-8, 12=10-1-8, 13=10-1-8, 14=10-1-8, 15=10-1-8, 16=10-1-8, 21=10-1-8  
 Max Horiz 2=210 (LC 10), 21=210 (LC 10)  
 Max Uplift 2=-3 (LC 14), 12=-264 (LC 14), 13=-11 (LC 21), 14=-26 (LC 10), 15=-155 (LC 14), 21=-3 (LC 14)  
 Max Grav 2=1 (LC 21), 12=893 (LC 21), 13=98 (LC 7), 14=202 (LC 21), 15=171 (LC 21), 16=253 (LC 1), 21=1 (LC 21)


**FORCES**

(lb) - Maximum Compression/Maximum Tension  
 TOP CHORD 1-2=0/17, 2-3=-535/377, 3-4=-531/378, 4-5=-474/378, 5-7=-435/359, 7-8=-437/432, 8-9=-579/743, 9-10=-29/0  
 BOT CHORD 2-16=-339/244, 15-16=-339/244, 14-15=-339/244, 13-14=-339/244, 12-13=-339/244, 11-12=0/0  
 WEBS 12-17=-870/552, 8-17=-396/210, 9-17=-810/584, 3-16=-153/3, 4-15=-120/154, 5-14=-167/99, 7-13=-29/60

**NOTES**

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-10-8 to 2-0-0, Interior (1) 2-0-0 to 13-1-8, Exterior(2E) 13-1-8 to 16-1-8 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- 4) Unbalanced snow loads have been considered for this design.
- 5) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof live load of 20.0 psf on overhangs non-concurrent with other live loads.
- 6) All plates are 2x4 MT20 unless otherwise indicated.
- 7) Gable studs spaced at 2-0-0 oc.
- 8) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 9) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 10) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 3 lb uplift at joint 2, 264 lb uplift at joint 12, 155 lb uplift at joint 15, 26 lb uplift at joint 14, 11 lb uplift at joint 13 and 3 lb uplift at joint 2.
- 11) Non Standard bearing condition. Review required.

- 12) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- LOAD CASE(S)** Standard

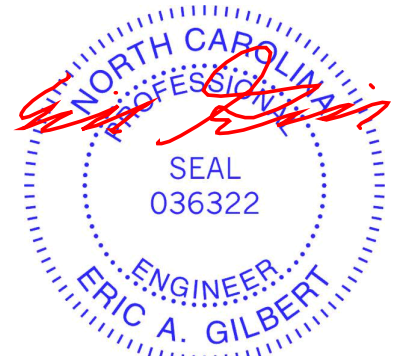

September 8, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPH Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



818 Soundside Road  
Edenton, NC 27932




Job 23070131-01	Truss H02	Truss Type Monopitch	Qty 6	Ply 1	90 Serenity-Roof-B326 A CP Job Reference (optional)	I60667321
--------------------	--------------	-------------------------	----------	----------	--------------------------------------------------------	-----------

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Fri Sep 08 15:07:43  
ID:nLPVeuW3K4TytrtY3LLguzRRHK-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC7f

Page: 1

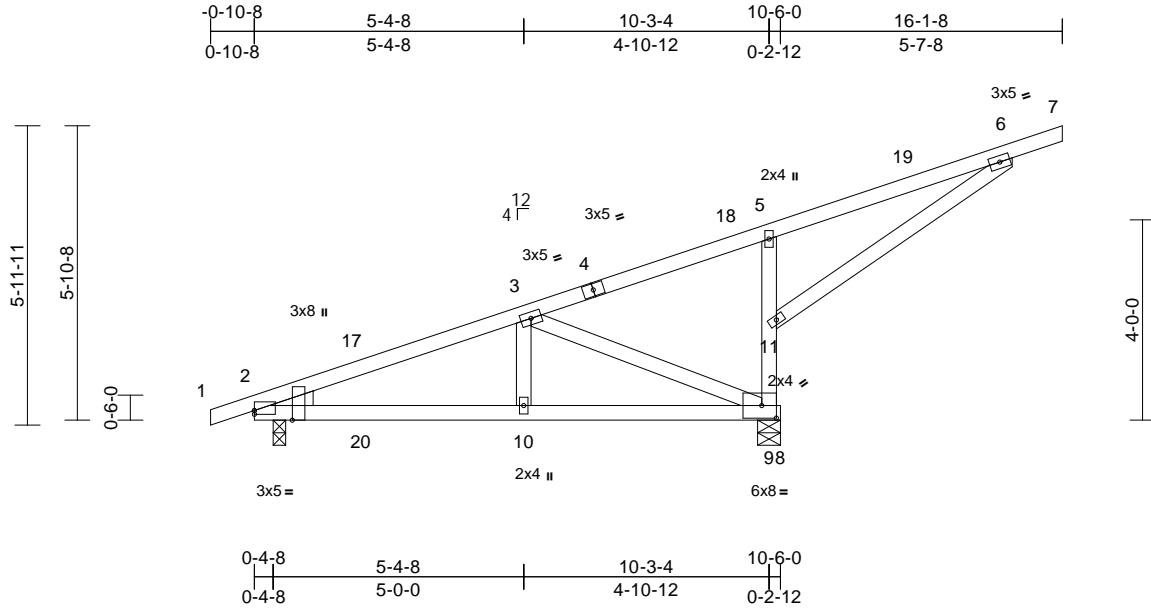

Scale = 1:46

Plate Offsets (X, Y): [2:Edge,0-0-14], [2:0-2-5,Edge], [9:0-3-8,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.71	Vert(LL)	0.04	9-10	>999	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.27	Vert(CT)	-0.04	9-10	>999	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.71	Horz(CT)	-0.01	9	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 67 lb	FT = 20%

**LUMBER**

TOP CHORD 2x4 SP No.2  
 BOT CHORD 2x4 SP No.2  
 WEBS 2x4 SP No.3 \*Except\* 5-9:2x4 SP 2400F 2.0E  
 WEDGE Left: 2x4 SP No.3

**BRACING**

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 8-5-13 oc bracing.

**REACTIONS**

(size) 2=0-3-0, 9=0-5-8  
 Max Horiz 2=210 (LC 10)  
 Max Uplift 2=-99 (LC 10), 9=-379 (LC 20)  
 Max Grav 2=379 (LC 1), 9=1090 (LC 21)

**FORCES**

(lb) - Maximum Compression/Maximum Tension  
 TOP CHORD 1-2=0/17, 2-3=-368/225, 3-5=-447/428, 5-6=-594/757, 6-7=-29/0  
 BOT CHORD 2-10=-447/338, 9-10=-447/338, 8-9=0/0  
 WEBS 9-11=-840/532, 5-11=-358/182, 3-10=-315/219, 3-9=-563/753, 6-11=-825/599

**NOTES**

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust)  
 Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft;  
 Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior (1) 2-1-8 to 13-1-8, Exterior(2E) 13-1-8 to 16-1-8 zone; cantilever left exposed ; porch left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- 3) Unbalanced snow loads have been considered for this design.

- 4) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 7) One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 9 and 2. This connection is for uplift only and does not consider lateral forces.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard



September 8, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road  
 Edenton, NC 27932

Job 23070131-01	Truss J01	Truss Type Common	Qty 5	Ply 1	90 Serenity-Roof-B326 A CP Job Reference (optional)	160667322
--------------------	--------------	----------------------	----------	----------	--------------------------------------------------------	-----------

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Fri Sep 08 15:07:43  
ID:yPXMLbyKekkHSiWSIZLGINzRR58-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWRCDoi7J4zJC?f

Page: 1

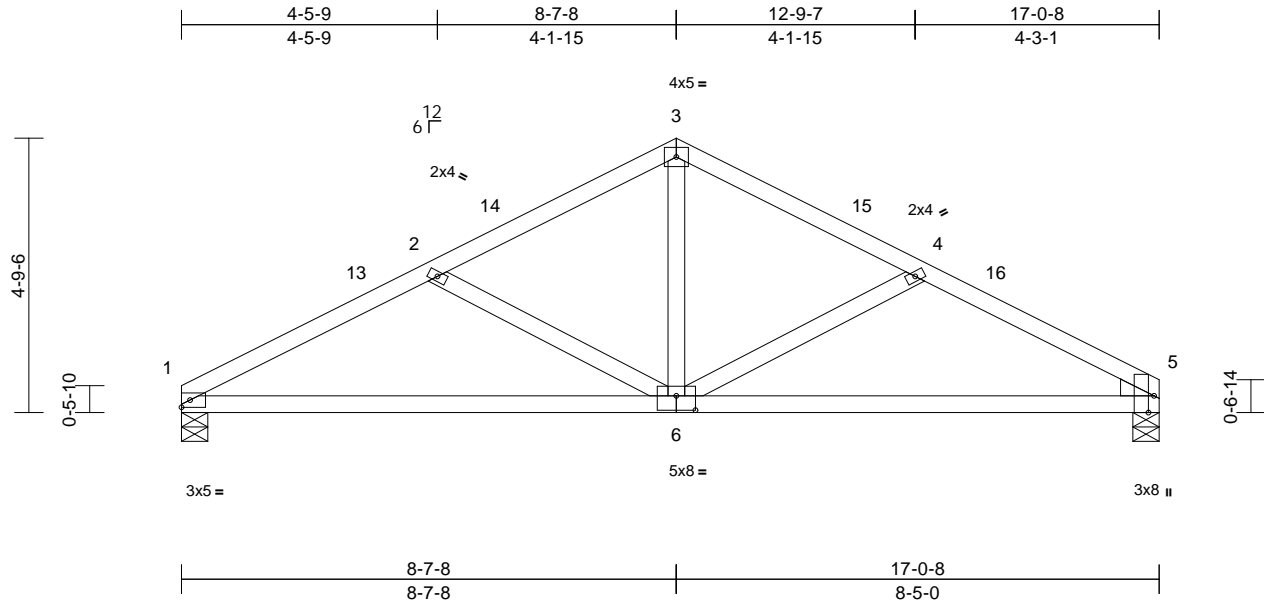

Scale = 1:40.2

Plate Offsets (X, Y): [5:0-3-8,Edge], [6:0-4-0,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.37	Vert(LL)	-0.09	6-9	>999	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.65	Vert(CT)	-0.19	6-9	>999	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.21	Horz(CT)	0.02	5	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 75 lb	FT = 20%

**LUMBER**

TOP CHORD 2x4 SP No.2  
 BOT CHORD 2x4 SP No.2  
 WEBS 2x4 SP No.3  
 WEDGE Right: 2x4 SP No.3

**BRACING**

TOP CHORD Structural wood sheathing directly applied or 5-1-6 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS**

(size) 1=0-5-8, 5=0-5-8  
 Max Horiz 1=71 (LC 14)  
 Max Uplift 1=-66 (LC 14), 5=-64 (LC 15)  
 Max Grav 1=747 (LC 20), 5=746 (LC 21)

**FORCES**


(lb) - Maximum Compression/Maximum Tension  
 TOP CHORD 1-2=-1263/310, 2-3=-883/233, 3-4=-875/232, 4-5=-1219/301  
 BOT CHORD 1-5=-223/1092  
 WEBS 3-6=-53/478, 4-6=-407/160, 2-6=-445/175

**NOTES**

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior (1) 3-0-0 to 5-7-8, Exterior(2R) 5-7-8 to 11-7-8, Interior (1) 11-7-8 to 14-0-8, Exterior(2E) 14-0-8 to 17-0-8 zone;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.

- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Bearings are assumed to be: , Joint 5 User Defined crushing capacity of 425 psi.
- One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 1 and 5. This connection is for uplift only and does not consider lateral forces.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard

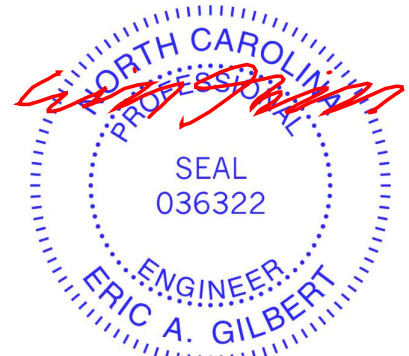

September 8, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road  
 Edenton, NC 27932

Job 23070131-01	Truss PBA	Truss Type Piggyback	Qty 2	Ply 1	90 Serenity-Roof-B326 A CP Job Reference (optional)	160667323
--------------------	--------------	-------------------------	----------	----------	--------------------------------------------------------	-----------

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Fri Sep 08 15:07:43  
ID:RPY8AW\_GFKlcY3mFoYebVhzRQqK-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWRcD0i7J4zJC?f

Page: 1

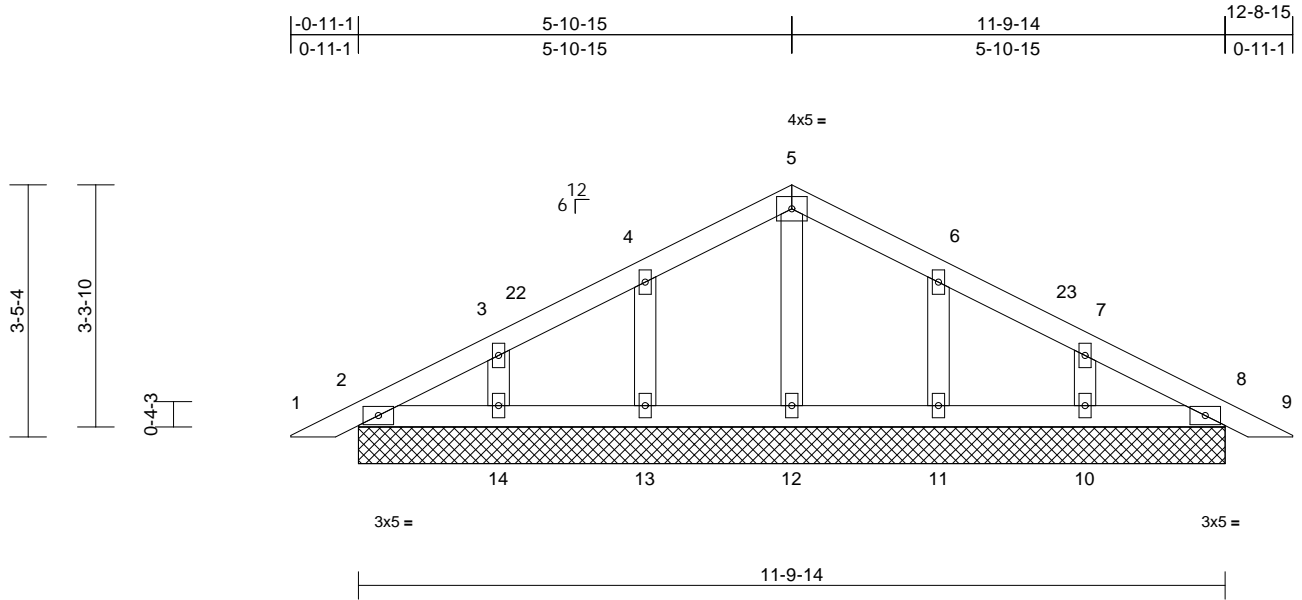

Scale = 1:31.4

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.08	Vert(LL)	n/a	-	n/a	999	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.04	Vert(CT)	n/a	-	n/a	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.04	Horz(CT)	0.00	8	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 52 lb	FT = 20%

**LUMBER**  
TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
OTHERS 2x4 SP No.3

**BRACING**  
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS** (size)  
2=11-9-14, 8=11-9-14, 10=11-9-14,  
11=11-9-14, 12=11-9-14,  
13=11-9-14, 14=11-9-14,  
15=11-9-14, 19=11-9-14  
Max Horiz 2=52 (LC 18), 15=52 (LC 18)  
Max Uplift 2=-9 (LC 15), 8=-11 (LC 15),  
10=-45 (LC 15), 11=-47 (LC 15),  
13=-47 (LC 14), 14=-45 (LC 14),  
15=-9 (LC 15), 19=-11 (LC 15)  
Max Grav 2=123 (LC 21), 8=123 (LC 22),  
10=237 (LC 22), 11=244 (LC 22),  
12=143 (LC 21), 13=244 (LC 21),  
14=237 (LC 21), 15=123 (LC 21),  
19=123 (LC 22)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
TOP CHORD 1-2=0/17, 2-3=-46/33, 3-4=-56/49,  
4-5=-63/116, 5-6=-63/116, 6-7=-56/49,  
7-8=-29/25, 8-9=0/17  
BOT CHORD 2-14=-9/67, 13-14=-9/67, 12-13=-9/67,  
11-12=-9/67, 10-11=-9/67, 8-10=-9/67  
WEBS 5-12=-102/0, 4-13=-208/125, 3-14=-181/113,  
6-11=-208/125, 7-10=-181/113

**NOTES**  
1) Unbalanced roof live loads have been considered for this design.

- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Corner(3E) 0-4-3 to 3-4-3, Exterior(2N) 3-4-3 to 3-10-8, Corner(3R) 3-10-8 to 9-10-8, Exterior (2N) 9-10-8 to 10-4-13, Corner(3E) 10-4-13 to 13-4-13 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- N/A

14) See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.  
**LOAD CASE(S)** Standard

13) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



September 8, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**  
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)


ENGINEERING BY  
**TRENCO**  
A MiTek Affiliate  
818 Soundside Road  
Edenton, NC 27932

Job 23070131-01	Truss PBA1	Truss Type Piggyback	Qty 18	Ply 1	90 Serenity-Roof-B326 A CP Job Reference (optional)	160667324
--------------------	---------------	-------------------------	-----------	----------	--------------------------------------------------------	-----------

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Fri Sep 08 15:07:43  
ID:Cx19sF4HMnJTVINoGDnTDzRQc-RfC?PsB70Hq3NSgPqnL8w3uITXbGkWrCDoi7J4zJC?f

Page: 1

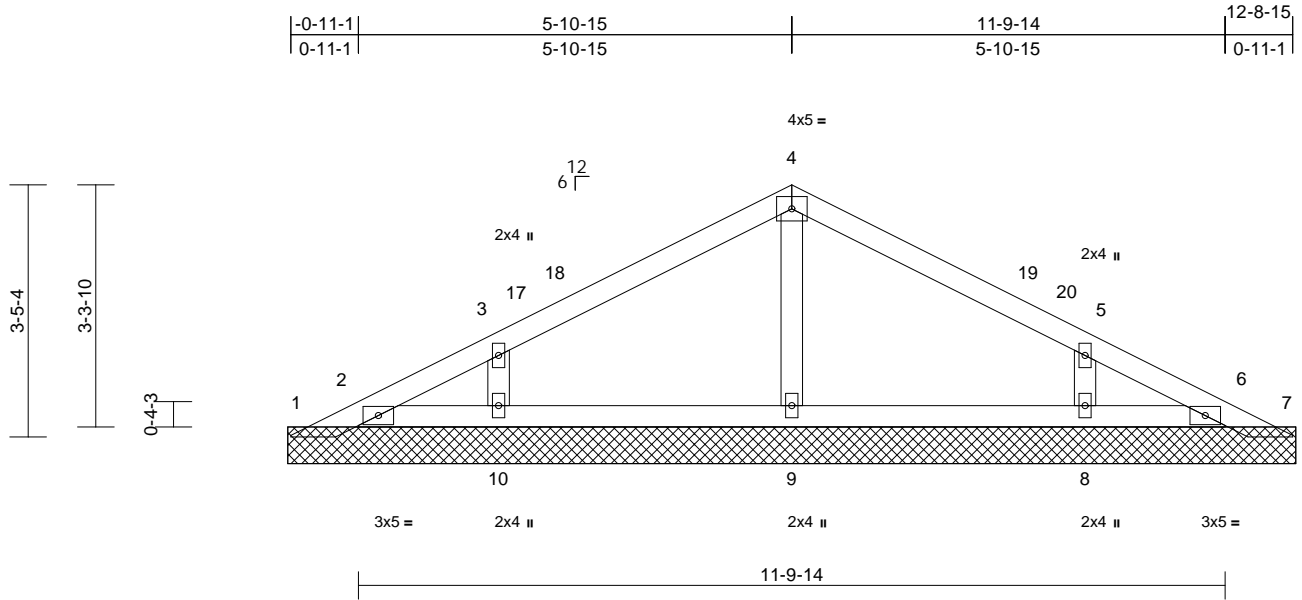

Scale = 1:31.4

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.29	Vert(LL)	n/a	-	n/a	999	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.12	Vert(TL)	n/a	-	n/a	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.08	Horiz(TL)	0.00	7	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 47 lb	FT = 20%

#### LUMBER

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
OTHERS 2x4 SP No.3

#### BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS

(size) 1=13-9-0, 2=13-9-0, 6=13-9-0,  
7=13-9-0, 8=13-9-0, 9=13-9-0,  
10=13-9-0, 11=13-9-0, 14=13-9-0  
Max Horiz 1=52 (LC 14)  
Max Uplift 1=-25 (LC 15), 7=-12 (LC 15),  
8=-92 (LC 15), 10=-91 (LC 14)  
Max Grav 1=47 (LC 21), 2=65 (LC 1), 6=52  
(LC 1), 7=49 (LC 22), 8=439 (LC  
22), 9=299 (LC 21), 10=440 (LC  
21), 11=65 (LC 1), 14=52 (LC 1)

#### FORCES

(lb) - Maximum Compression/Maximum  
Tension  
TOP CHORD 1-2=-56/65, 2-3=-54/49, 3-4=-124/93,  
4-5=-124/93, 5-6=-35/49, 6-7=-20/16  
BOT CHORD 2-10=-8/44, 9-10=-8/44, 8-9=-8/44, 6-8=-8/44  
WEBS 4-9=-213/93, 3-10=-386/207, 5-8=-386/207


#### NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-4-3 to 3-4-3, Interior (1) 3-4-3 to 3-10-8, Exterior(2R) 3-10-8 to 9-10-8, Interior (1) 9-10-8 to 10-4-13, Exterior(2E) 10-4-13 to 13-4-13 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60

- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 25 lb uplift at joint 1 and 12 lb uplift at joint 7.
- N/A

- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

LOAD CASE(S) Standard

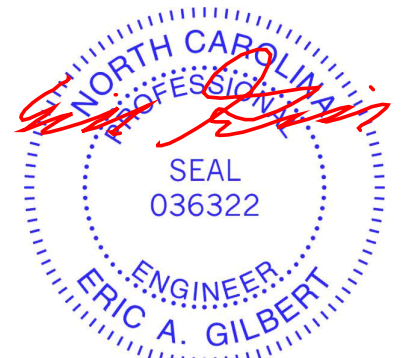

September 8, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY  
**TRENCO**  
A MiTek Affiliate


818 Soundside Road  
Edenton, NC 27932

Job 23070131-01	Truss PBA2	Truss Type Piggyback	Qty 2	Ply 4	90 Serenity-Roof-B326 A CP Job Reference (optional)	160667325
--------------------	---------------	-------------------------	----------	----------	--------------------------------------------------------	-----------

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Fri Sep 08 15:07:44  
ID:m2dQdjyppkexqPVgwg5aZpRCX1-RfC?PsB70Hq3NSgPqnL8w3uITXbGKwKwCDoi7J4zJC?f

Page: 1

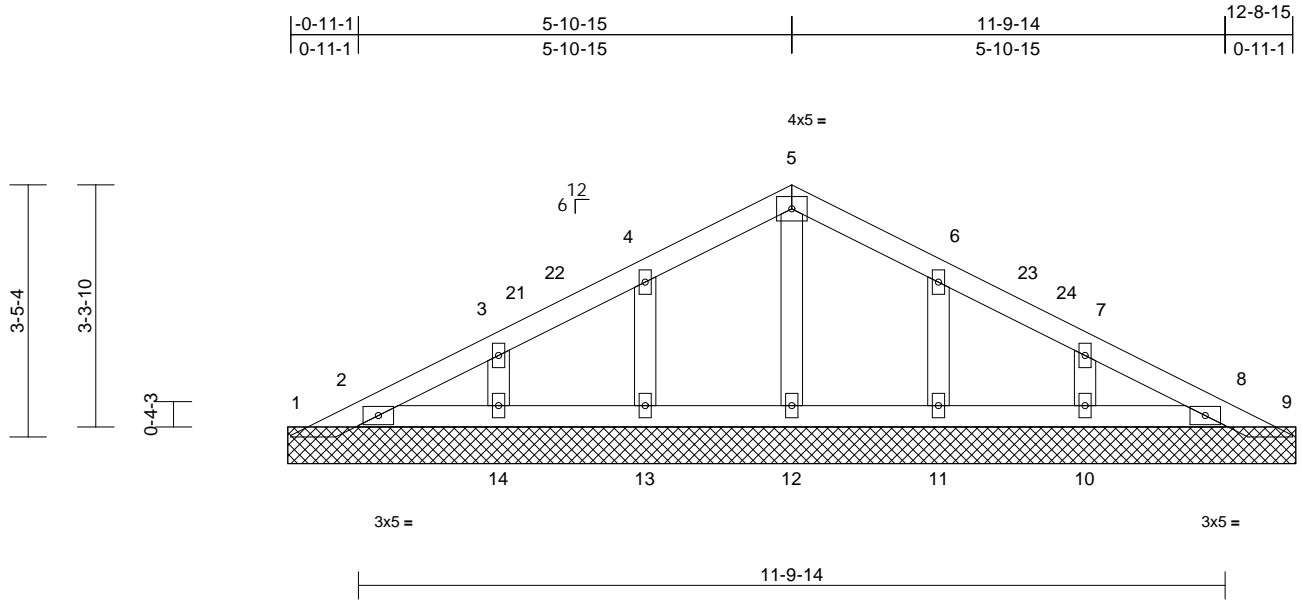

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.02	Vert(LL)	n/a	-	n/a	999	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.01	Vert(TL)	n/a	-	n/a	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.01	Horiz(TL)	0.00	9	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-MSH								
BCDL	10.0										Weight: 207 lb	FT = 20%

**LUMBER**  
 TOP CHORD 2x4 SP No.2  
 BOT CHORD 2x4 SP No.2  
 OTHERS 2x4 SP No.3

**BRACING**  
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


**REACTIONS** (size)  
 1=13-9-0, 2=13-9-0, 8=13-9-0,  
 9=13-9-0, 10=13-9-0, 11=13-9-0,  
 12=13-9-0, 13=13-9-0, 14=13-9-0,  
 15=13-9-0, 18=13-9-0  
 Max Horiz 1=52 (LC 14)  
 Max Uplift 1=-25 (LC 15), 2=-14 (LC 14), 8=-7 (LC 15), 9=-2 (LC 22), 10=-45 (LC 15), 11=-47 (LC 15), 13=-48 (LC 14), 14=-44 (LC 14), 15=-14 (LC 14), 18=-7 (LC 15)  
 Max Grav 1=24 (LC 18), 2=154 (LC 21), 8=142 (LC 22), 9=4 (LC 1), 10=233 (LC 22), 11=245 (LC 22), 12=144 (LC 21), 13=244 (LC 21), 14=234 (LC 21), 15=154 (LC 21), 18=142 (LC 22)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
 TOP CHORD 1-2=-56/69, 2-3=-48/32, 3-4=-55/50, 4-5=-62/105, 5-6=-62/105, 6-7=-55/40, 7-8=-29/26, 8-9=0/24  
 BOT CHORD 2-14=-15/54, 13-14=-15/54, 12-13=-15/54, 11-12=-15/54, 10-11=-15/54, 8-10=-15/54  
 WEBS 5-12=-103/0, 4-13=-208/121, 3-14=-181/90, 6-11=-208/121, 7-10=-180/91

**NOTES**

- 4-ply truss to be connected together as follows: Top chords connected with 10d (0.131"x3") nails as follows: 2x4 - 1 row at 0-9-0 oc. Bottom chords connected with 10d (0.131"x3") nails as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-4-3 to 3-4-3, Interior (1) 3-4-3 to 3-10-8, Exterior(2R) 3-10-8 to 9-10-8, Interior (1) 9-10-8 to 10-4-13, Exterior(2E) 10-4-13 to 13-4-13 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 14 lb uplift at joint 2, 7 lb uplift at joint 8, 25 lb uplift at joint 1, 2 lb uplift at joint 9, 48 lb uplift at joint 13, 44 lb uplift at joint 14, 47 lb uplift at joint 11, 45 lb uplift at joint 10, 14 lb uplift at joint 2 and 7 lb uplift at joint 8.
  - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.
- LOAD CASE(S)** Standard

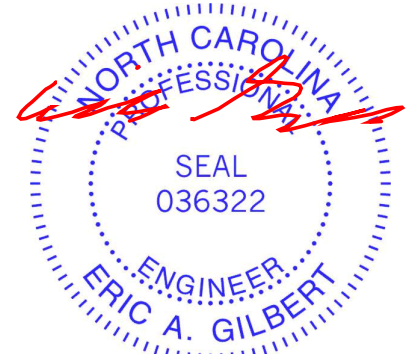

September 8, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**  
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY  
**TRENCO**  
 A MiTek Affiliate  
 818 Soundside Road  
 Edenton, NC 27932




Job 23070131-01	Truss VLB1	Truss Type Valley	Qty 1	Ply 1	90 Serenity-Roof-B326 A CP Job Reference (optional)	160667326
--------------------	---------------	----------------------	----------	----------	--------------------------------------------------------	-----------

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Fri Sep 08 15:07:44  
ID:uRu6rMLa1rlmrJyJNhjxpxzRQsR-RFC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

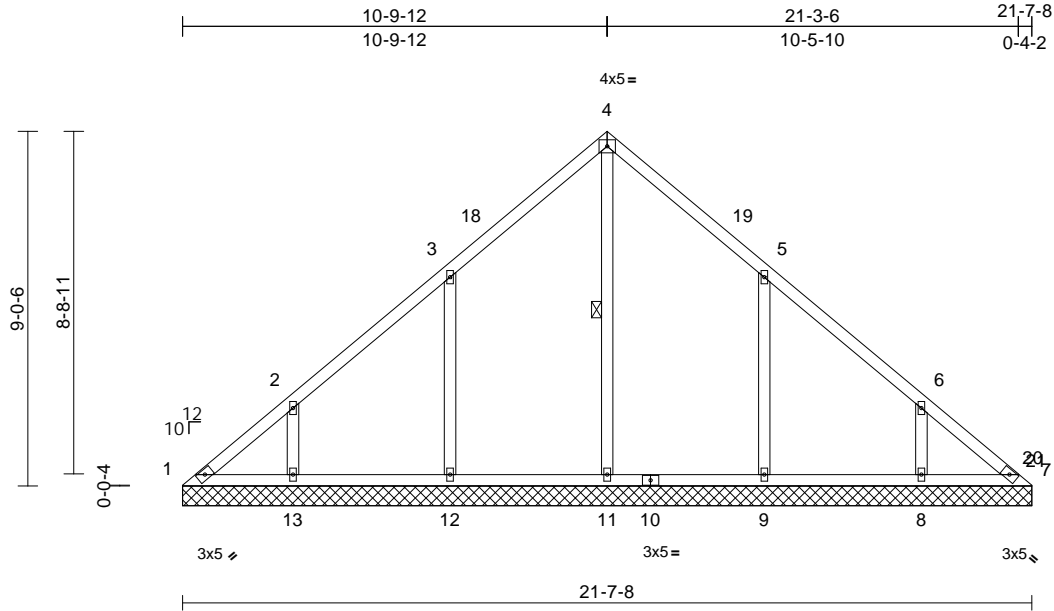


Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.31	Vert(LL)	n/a	-	n/a	999	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.17	Vert(TL)	n/a	-	n/a	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.21	Horiz(TL)	0.01	7	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 106 lb	FT = 20%

LUMBER	
TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
OTHERS	2x4 SP No.3
BRACING	
TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	1 Row at midpt 4-11
REACTIONS	
(size)	1=21-7-8, 7=21-7-8, 8=21-7-8, 9=21-7-8, 11=21-7-8, 12=21-7-8, 13=21-7-8
Max Horiz	1=207 (LC 11)
Max Uplift	1=-48 (LC 10), 7=-6 (LC 11), 8=-114 (LC 15), 9=-174 (LC 15), 12=-173 (LC 14), 13=-120 (LC 14)
Max Grav	1=149 (LC 24), 7=109 (LC 26), 8=363 (LC 24), 9=473 (LC 6), 11=415 (LC 26), 12=473 (LC 5), 13=370 (LC 23)
FORCES	
(lb) - Maximum Compression/Maximum Tension	
TOP CHORD	1-2=-213/174, 2-3=-164/132, 3-4=-187/181, 4-5=-188/154, 5-6=-116/83, 6-7=-168/108
BOT CHORD	1-13=-76/154, 12-13=-76/154, 11-12=-76/154, 9-11=-76/154, 8-9=-76/154, 7-8=-76/154
WEBS	4-11=-208/3, 3-12=-376/222, 2-13=-235/163, 5-9=-376/222, 6-8=-232/161

**NOTES**  
1) Unbalanced roof live loads have been considered for this design.

- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-0-5 to 2-10-1, Interior (1) 2-10-1 to 7-10-1, Exterior(2R) 7-10-1 to 13-10-1, Interior (1) 13-10-1 to 18-3-4, Exterior(2E) 18-3-4 to 21-3-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 48 lb uplift at joint 1, 6 lb uplift at joint 7, 173 lb uplift at joint 12, 120 lb uplift at joint 13, 174 lb uplift at joint 9 and 114 lb uplift at joint 8.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard

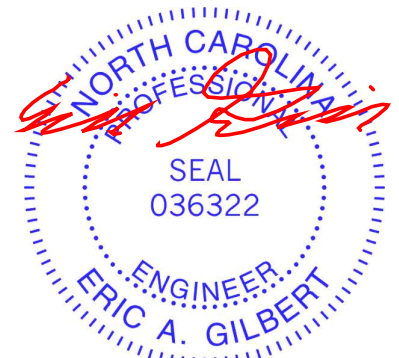

September 8, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY  
**TRENCO**  
A MITEK Affiliate

818 Soundside Road  
Edenton, NC 27932




Job 23070131-01	Truss VLB2	Truss Type Valley	Qty 1	Ply 1	90 Serenity-Roof-B326 A CP Job Reference (optional)	160667327
--------------------	---------------	----------------------	----------	----------	--------------------------------------------------------	-----------

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Fri Sep 08 15:07:44  
ID:yJln\_UX?VSB9dbBmLUS1zzRQsC-RfC?PsB70Hq3NSgPqnL8w3uTXbGKWrCDoi7J4zJC7f

Page: 1

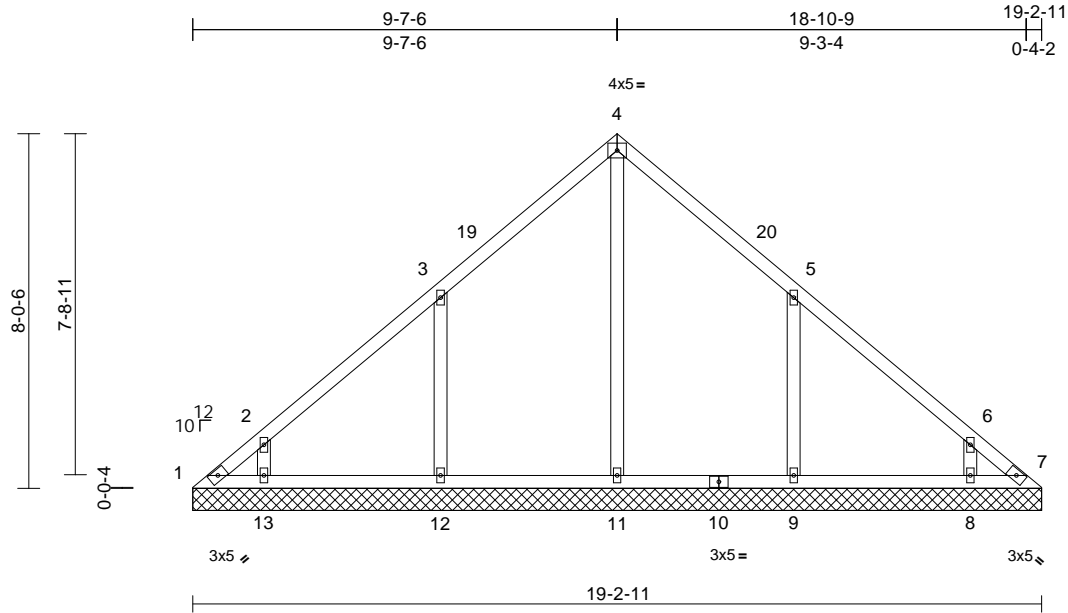

Scale = 1:52.2

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.31	Vert(LL)	n/a	-	n/a	999	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.17	Vert(TL)	n/a	-	n/a	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.29	Horiz(TL)	0.00	7	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 90 lb	FT = 20%

**LUMBER**  
TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
OTHERS 2x4 SP No.3

**BRACING**  
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS** (size)  
1=19-2-11, 7=19-2-11, 8=19-2-11,  
9=19-2-11, 11=19-2-11,  
12=19-2-11, 13=19-2-11,  
18=19-2-11  
Max Horiz 1=184 (LC 11)  
Max Uplift 1=-96 (LC 10), 8=-53 (LC 15),  
9=-193 (LC 15), 12=-174 (LC 14),  
13=-102 (LC 14)  
Max Grav 1=124 (LC 13), 7=0 (LC 13), 8=304  
(LC 28), 9=477 (LC 24), 11=463  
(LC 26), 12=480 (LC 5), 13=317  
(LC 23), 18=0 (LC 13)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
TOP CHORD 1-2=-218/205, 2-3=-217/187, 3-4=-189/267,  
4-5=-178/241, 5-6=-107/66, 6-7=-72/43  
BOT CHORD 1-13=-45/64, 12-13=-18/55, 11-12=-18/55,  
9-11=-18/55, 8-9=-18/55, 7-8=-18/55  
WEBS 4-11=-256/59, 3-12=-379/222,  
2-13=-222/173, 5-9=-376/229, 6-8=-217/154

**NOTES**  
1) Unbalanced roof live loads have been considered for this design.

- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-0-5 to 3-0-5, Interior (1) 3-0-5 to 6-7-10, Exterior(2R) 6-7-10 to 12-7-10, Interior (1) 12-7-10 to 15-10-7, Exterior(2E) 15-10-7 to 18-10-7 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 96 lb uplift at joint 1, 174 lb uplift at joint 12, 102 lb uplift at joint 13, 193 lb uplift at joint 9 and 53 lb uplift at joint 8.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard



September 8, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY  
**TRENCO**  
A MiTek Affiliate


818 Soundside Road  
Edenton, NC 27932

Job 23070131-01	Truss VLB3	Truss Type Valley	Qty 1	Ply 1	90 Serenity-Roof-B326 A CP Job Reference (optional)	160667328
--------------------	---------------	----------------------	----------	----------	--------------------------------------------------------	-----------

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Fri Sep 08 15:07:45  
ID:4pahjxh9RSqoCd5h0aDV3jzRQs?-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC7f

Page: 1

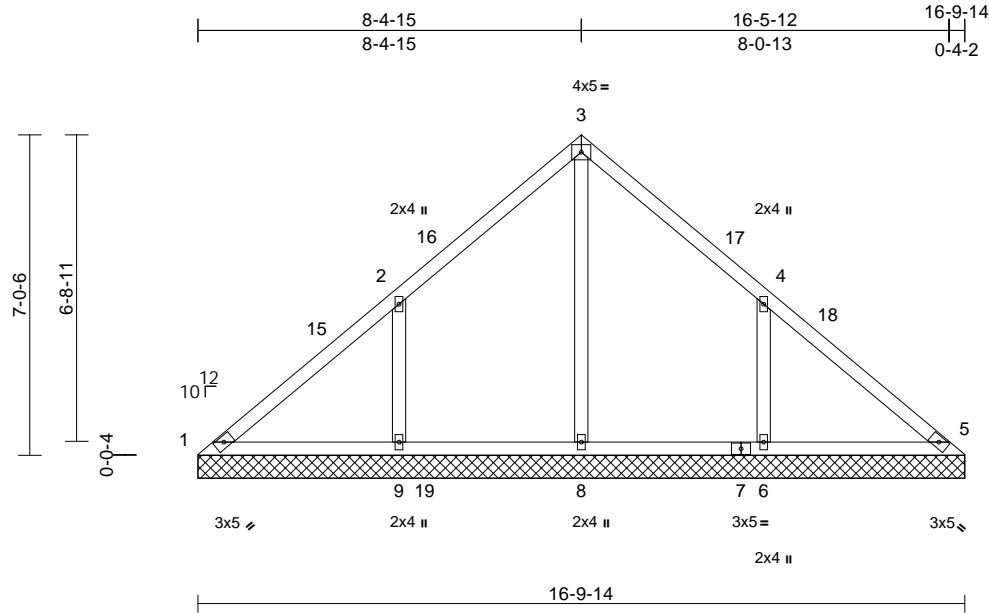

Scale = 1:50.5

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.38	Vert(LL)	n/a	-	n/a	999	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.18	Vert(TL)	n/a	-	n/a	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.41	Horiz(TL)	0.00	5	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-MSH								
BCDL	10.0										Weight: 75 lb	FT = 20%

**LUMBER**

- TOP CHORD 2x4 SP No.2
- BOT CHORD 2x4 SP No.2
- OTHERS 2x4 SP No.3

**BRACING**

- TOP CHORD Structural wood sheathing directly applied or 10-0-0 oc purlins.
- BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

**REACTIONS**

- (size) 1=16-9-14, 5=16-9-14, 6=16-9-14, 8=16-9-14, 9=16-9-14, 14=16-9-14
- Max Horiz 1=160 (LC 11)
- Max Uplift 1=-58 (LC 10), 6=-183 (LC 15), 9=-188 (LC 14)
- Max Grav 1=82 (LC 33), 5=1 (LC 24), 6=511 (LC 6), 8=654 (LC 23), 9=511 (LC 5), 14=1 (LC 24)

**FORCES**

- (lb) - Maximum Compression/Maximum Tension
- TOP CHORD 1-2=-105/370, 2-3=-25/319, 3-4=-2/298, 4-5=-139/290
- BOT CHORD 1-9=-180/76, 8-9=-180/74, 6-8=-180/74, 5-6=-180/74
- WEBS 3-8=-471/0, 2-9=-392/221, 4-6=-392/219

**NOTES**

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-0-5 to 3-0-5, Interior (1) 3-0-5 to 5-5-4, Exterior(2R) 5-5-4 to 11-5-4, Interior (1) 11-5-4 to 13-5-11, Exterior(2E) 13-5-11 to 16-5-11 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60

- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 58 lb uplift at joint 1, 188 lb uplift at joint 9 and 183 lb uplift at joint 6.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard



September 8, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road  
Edenton, NC 27932

Job 23070131-01	Truss VLB4	Truss Type Valley	Qty 1	Ply 1	90 Serenity-Roof-B326 A CP Job Reference (optional)	160667329
--------------------	---------------	----------------------	----------	----------	--------------------------------------------------------	-----------

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Fri Sep 08 15:07:45  
ID:CKtcSNrINSSyGdaBHoyYSzRQro-RFC?PsB70Hq3NSgPqnL8w3uITXbGKWRCoI7J4zJC?f

Page: 1

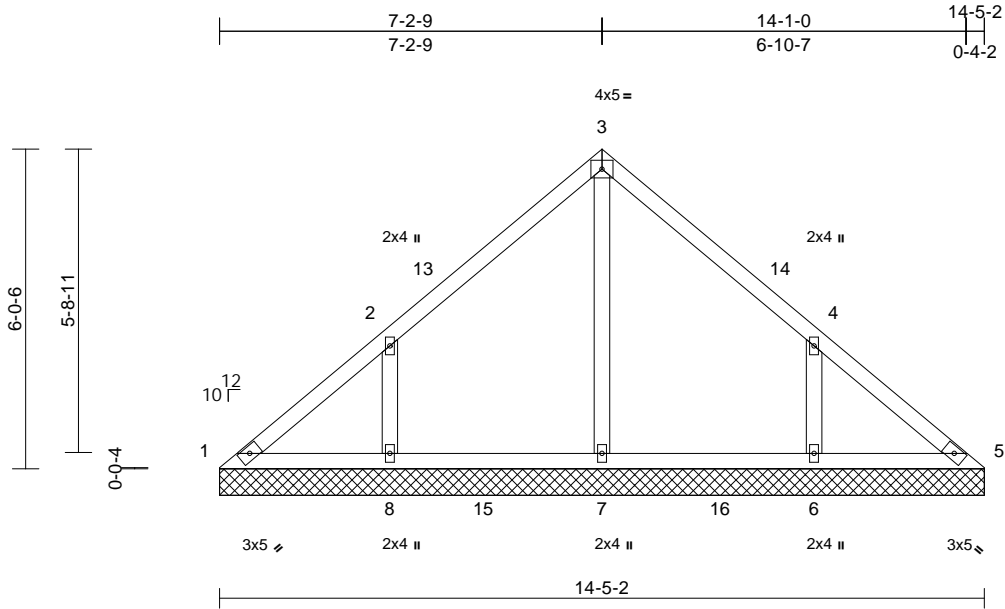

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.31	Vert(LL)	n/a	-	n/a	999	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.16	Vert(TL)	n/a	-	n/a	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.14	Horiz(TL)	0.00	5	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-MSH								
BCDL	10.0											
										Weight: 62 lb	FT = 20%	

**LUMBER**

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
OTHERS 2x4 SP No.3

**BRACING**

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

**REACTIONS** (size) 1=14-5-2, 5=14-5-2, 6=14-5-2, 7=14-5-2, 8=14-5-2  
Max Horiz 1=-137 (LC 10)  
Max Uplift 1=-24 (LC 10), 6=-154 (LC 15), 8=-157 (LC 14)  
Max Grav 1=124 (LC 24), 5=99 (LC 23), 6=454 (LC 21), 7=403 (LC 23), 8=454 (LC 20)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
TOP CHORD 1-2=-152/141, 2-3=-176/118, 3-4=-176/112, 4-5=-121/106  
BOT CHORD 1-8=-59/126, 7-8=-59/100, 6-7=-59/100, 5-6=-59/100  
WEBS 3-7=-224/0, 2-8=-375/196, 4-6=-375/195

- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 24 lb uplift at joint 1, 157 lb uplift at joint 8 and 154 lb uplift at joint 6.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard

- NOTES**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-0-5 to 3-2-14, Interior (1) 3-2-14 to 4-2-14, Exterior(2R) 4-2-14 to 10-2-14, Interior (1) 10-2-14 to 11-2-14, Exterior(2E) 11-2-14 to 14-5-6 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60




September 8, 2023

Job 23070131-01	Truss VLB5	Truss Type Valley	Qty 1	Ply 1	90 Serenity-Roof-B326 A CP Job Reference (optional)	160667330
--------------------	---------------	----------------------	----------	----------	--------------------------------------------------------	-----------

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Fri Sep 08 15:07:45  
ID:vFTOYozalWjXT9L6tv8VZzRQre-RfC?PsB70Hq3NSgPqnL8w3uITxbGkWrCDoi7J4zJC?f

Page: 1

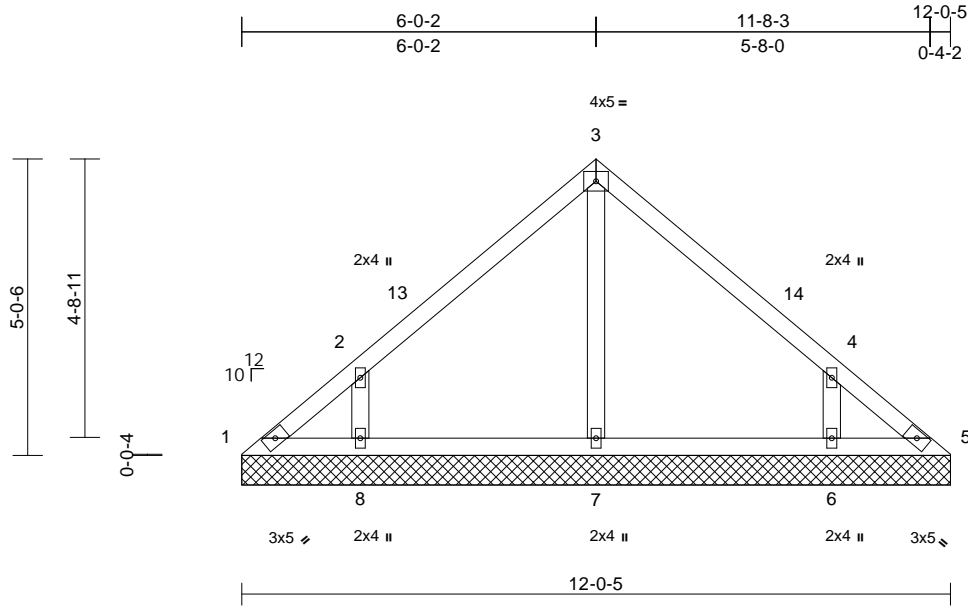

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.31	Vert(LL)	n/a	-	999	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.12	Vert(TL)	n/a	-	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.08	Horiz(TL)	0.00	5	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-MSH							
BCDL	10.0									Weight: 50 lb	FT = 20%

**LUMBER**

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
OTHERS 2x4 SP No.3

**BRACING**

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS** (size) 1=12-0-5, 5=12-0-5, 6=12-0-5, 7=12-0-5, 8=12-0-5  
Max Horiz 1=-114 (LC 10)  
Max Uplift 1=-34 (LC 10), 5=-6 (LC 11), 6=-136 (LC 15), 8=-139 (LC 14)  
Max Grav 1=91 (LC 24), 5=70 (LC 23), 6=434 (LC 21), 7=260 (LC 20), 8=434 (LC 20)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
TOP CHORD 1-2=-114/101, 2-3=-218/115, 3-4=-218/115, 4-5=-88/63  
BOT CHORD 1-8=-32/75, 7-8=-31/73, 6-7=-31/73, 5-6=-31/73  
WEBS 3-7=-172/0, 2-8=-401/220, 4-6=-401/220

- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 34 lb uplift at joint 1, 6 lb uplift at joint 5, 139 lb uplift at joint 8 and 136 lb uplift at joint 6.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard

- NOTES**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-0-5 to 3-0-5, Exterior(2R) 3-0-5 to 9-0-10, Exterior(2E) 9-0-10 to 12-0-10 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60



September 8, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY  
**TRENCO**  
A MiTek Affiliate


818 Soundside Road  
Edenton, NC 27932

Job 23070131-01	Truss VLB6	Truss Type Valley	Qty 1	Ply 1	90 Serenity-Roof-B326 A CP Job Reference (optional)	160667331
--------------------	---------------	----------------------	----------	----------	--------------------------------------------------------	-----------

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Fri Sep 08 15:07:46  
ID:vFTOYoza1WjXT9L6tv8uVZzRQre-RfC?PsB70Hq3NSgPqnL8w3uITxbGkWrCDoi7J4zJC?f

Page: 1

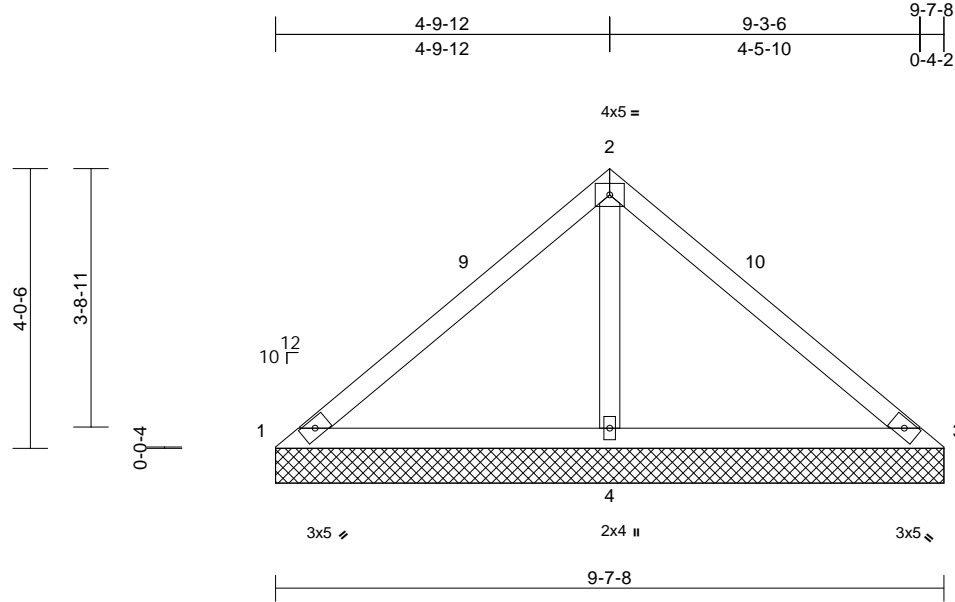

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.45	Vert(LL)	n/a	-	n/a	999	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.42	Vert(TL)	n/a	-	n/a	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.18	Horiz(TL)	0.01	4	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 37 lb	FT = 20%

**LUMBER**  
TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
OTHERS 2x4 SP No.3

**BRACING**  
TOP CHORD Structural wood sheathing directly applied or 9-7-8 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

**REACTIONS** (size) 1=9-7-8, 3=9-7-8, 4=9-7-8  
Max Horiz 1=90 (LC 11)  
Max Uplift 1=-49 (LC 21), 3=-49 (LC 20), 4=-108 (LC 14)  
Max Grav 1=95 (LC 20), 3=95 (LC 21), 4=772 (LC 20)


**FORCES** (lb) - Maximum Compression/Maximum Tension  
TOP CHORD 1-2=-115/373, 2-3=-115/373  
BOT CHORD 1-4=-214/172, 3-4=-214/172  
WEBS 2-4=-595/271

- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 49 lb uplift at joint 1, 49 lb uplift at joint 3 and 108 lb uplift at joint 4.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard

**NOTES**

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-0-5 to 3-0-5, Exterior(2R) 3-0-5 to 6-7-13, Exterior(2E) 6-7-13 to 9-7-13 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.

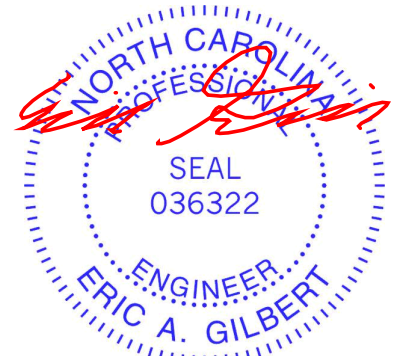

September 8, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY  
**TRENCO**  
A MiTek Affiliate

818 Soundside Road  
Edenton, NC 27932




Job 23070131-01	Truss VLB7	Truss Type Valley	Qty 1	Ply 1	90 Serenity-Roof-B326 A CP Job Reference (optional)	160667332
--------------------	---------------	----------------------	----------	----------	--------------------------------------------------------	-----------

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Fri Sep 08 15:07:46  
ID:vFTOYoza1WjXT9L6tv8uVZzRQre-RfC?PsB70Hq3NSgPqnL8w3uITxbGkWrCDoi7J4zJC?f

Page: 1

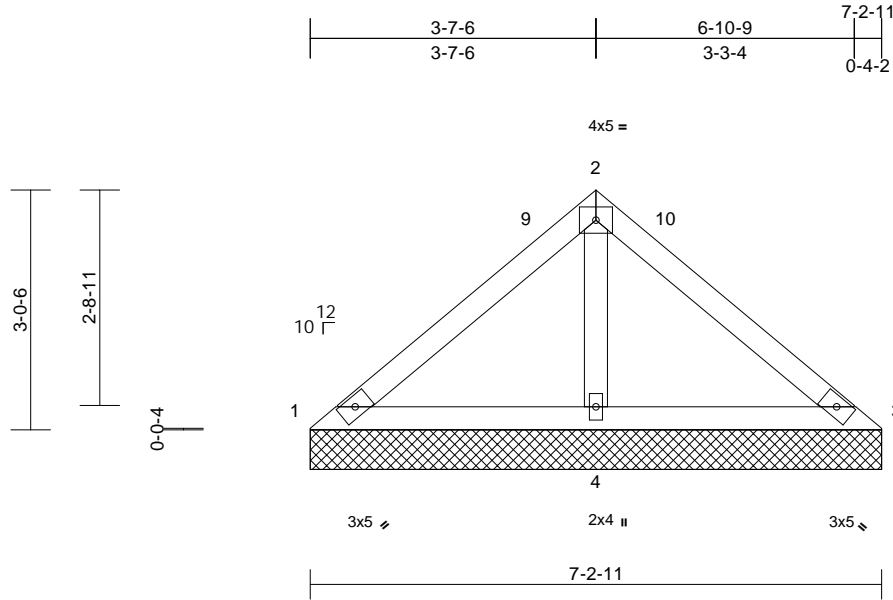

Scale = 1:29.1

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.26	Vert(LL)	n/a	-	n/a	999	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.26	Vert(TL)	n/a	-	n/a	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.09	Horiz(TL)	0.00	4	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-MP								
BCDL	10.0											
											Weight: 27 lb	FT = 20%

#### LUMBER

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
OTHERS 2x4 SP No.3

#### BRACING

TOP CHORD Structural wood sheathing directly applied or 7-2-11 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

#### REACTIONS

(size) 1=7-2-11, 3=7-2-11, 4=7-2-11  
Max Horiz 1=67 (LC 11)  
Max Uplift 1=-17 (LC 21), 3=-17 (LC 20), 4=-73 (LC 14)  
Max Grav 1=105 (LC 20), 3=105 (LC 21), 4=531 (LC 20)

#### FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=-88/228, 2-3=-88/228  
BOT CHORD 1-4=-160/151, 3-4=-160/151  
WEBS 2-4=-378/199

#### NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-0-5 to 3-0-5, Exterior(2R) 3-0-5 to 4-3-0, Exterior(2E) 4-3-0 to 7-3-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.

- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 17 lb uplift at joint 1, 17 lb uplift at joint 3 and 73 lb uplift at joint 4.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



September 8, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcacomponents.com](http://www.sbcacomponents.com))

ENGINEERING BY  
**TRENCO**  
A MiTek Affiliate


818 Soundside Road  
Edenton, NC 27932

Job 23070131-01	Truss VLB8	Truss Type Valley	Qty 1	Ply 1	90 Serenity-Roof-B326 A CP Job Reference (optional)	160667333
--------------------	---------------	----------------------	----------	----------	--------------------------------------------------------	-----------

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Fri Sep 08 15:07:46  
ID:vFTOYoza1WjXT9L6tv8uVZzRQre-RfC?PsB70Hq3NSgPqnL8w3uITxbGKWrCDoi7J4zJC?f

Page: 1

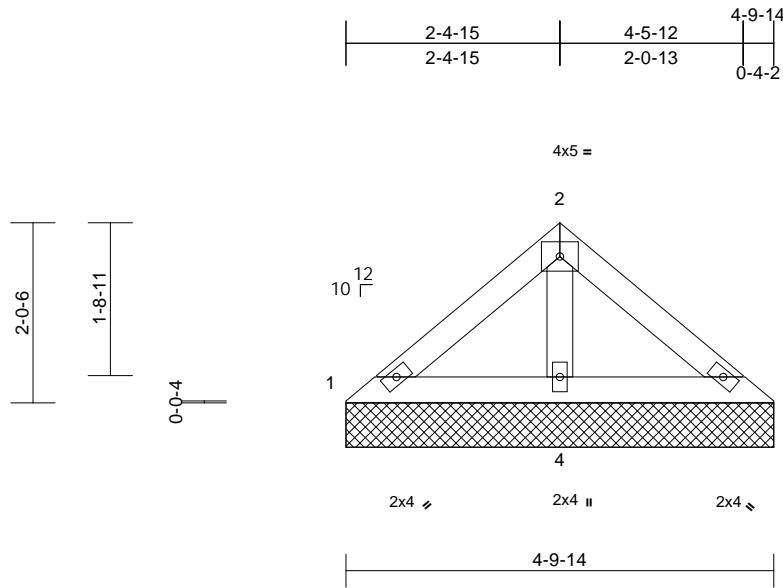

Scale = 1:26

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.09	Vert(LL)	n/a	-	n/a	999	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.11	Vert(TL)	n/a	-	n/a	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.04	Horiz(TL)	0.00	4	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-MP								
BCDL	10.0											
											Weight: 17 lb	FT = 20%

**LUMBER**

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
OTHERS 2x4 SP No.3

**BRACING**

TOP CHORD Structural wood sheathing directly applied or 4-9-14 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

**REACTIONS**

(size) 1=4-9-14, 3=4-9-14, 4=4-9-14  
Max Horiz 1=43 (LC 13)  
Max Uplift 3=-7 (LC 15), 4=-33 (LC 14)  
Max Grav 1=88 (LC 20), 3=88 (LC 21), 4=293 (LC 20)

**FORCES**

(lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=-80/102, 2-3=-80/102  
BOT CHORD 1-4=-79/87, 3-4=-79/87  
WEBS 2-4=-180/95

**NOTES**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 4) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10

- 5) Unbalanced snow loads have been considered for this design.
- 6) Gable requires continuous bottom chord bearing.
- 7) Gable studs spaced at 4-0-0 oc.
- 8) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 9) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 10) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 7 lb uplift at joint 3 and 33 lb uplift at joint 4.
- 11) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard



September 8, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcacomponents.com](http://www.sbcacomponents.com))




818 Soundside Road  
Edenton, NC 27932

Job 23070131-01	Truss VLD1	Truss Type Valley	Qty 1	Ply 1	90 Serenity-Roof-B326 A CP Job Reference (optional)	160667334
--------------------	---------------	----------------------	----------	----------	--------------------------------------------------------	-----------

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Fri Sep 08 15:07:47  
ID: ?VRASUfm0qfd3oFPBHC5FHzRQud-RfC?PsB70Hq3NSgPqnL8w3uITXbGKwRCDoi7J4zJC?f

Page: 1

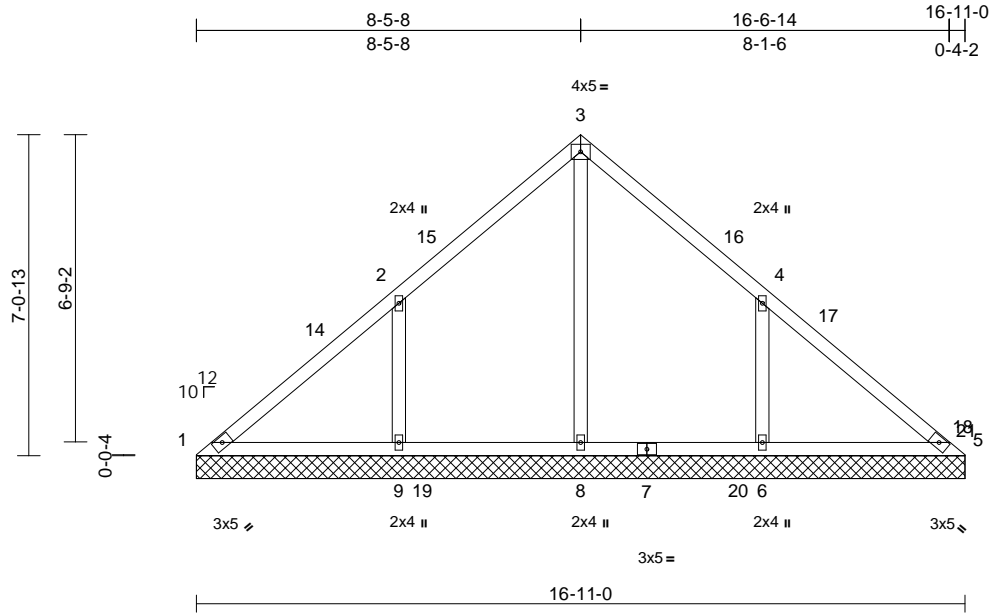

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.35	Vert(LL)	n/a	-	n/a	999	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.18	Vert(TL)	n/a	-	n/a	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.27	Horiz(TL)	0.00	5	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 76 lb	FT = 20%

**LUMBER**  
TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
OTHERS 2x4 SP No.3

**BRACING**  
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

**REACTIONS** (size) 1=16-11-0, 5=16-11-0, 6=16-11-0, 8=16-11-0, 9=16-11-0  
Max Horiz 1=161 (LC 11)  
Max Uplift 1=-21 (LC 10), 6=-183 (LC 15), 9=-186 (LC 14)  
Max Grav 1=123 (LC 24), 5=86 (LC 21), 6=520 (LC 6), 8=495 (LC 23), 9=524 (LC 23)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
TOP CHORD 1-2=-146/252, 2-3=-109/188, 3-4=-110/168, 4-5=-111/210  
BOT CHORD 1-9=-117/132, 8-9=-117/130, 6-8=-117/130, 5-6=-117/130  
WEBS 3-8=-310/0, 2-9=-396/220, 4-6=-396/219

**NOTES**  
1) Unbalanced roof live loads have been considered for this design.  
2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-0-5 to 3-0-5, Interior (1) 3-0-5 to 5-5-13, Exterior(2R) 5-5-13 to 11-5-13, Interior (1) 11-5-13 to 13-6-12, Exterior(2E) 13-6-12 to 16-6-12 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60

- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 21 lb uplift at joint 1, 186 lb uplift at joint 9 and 183 lb uplift at joint 6.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard



September 8, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY  
**TRENCO**  
A MiTek Affiliate


818 Soundside Road  
Edenton, NC 27932

Job 23070131-01	Truss VLD2	Truss Type Valley	Qty 1	Ply 1	90 Serenity-Roof-B326 A CP Job Reference (optional)	160667335
--------------------	---------------	----------------------	----------	----------	--------------------------------------------------------	-----------

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Fri Sep 08 15:07:47  
ID:Th\_ZgqfOm8nUgyqbk?jKoVzRQuC-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?F

Page: 1

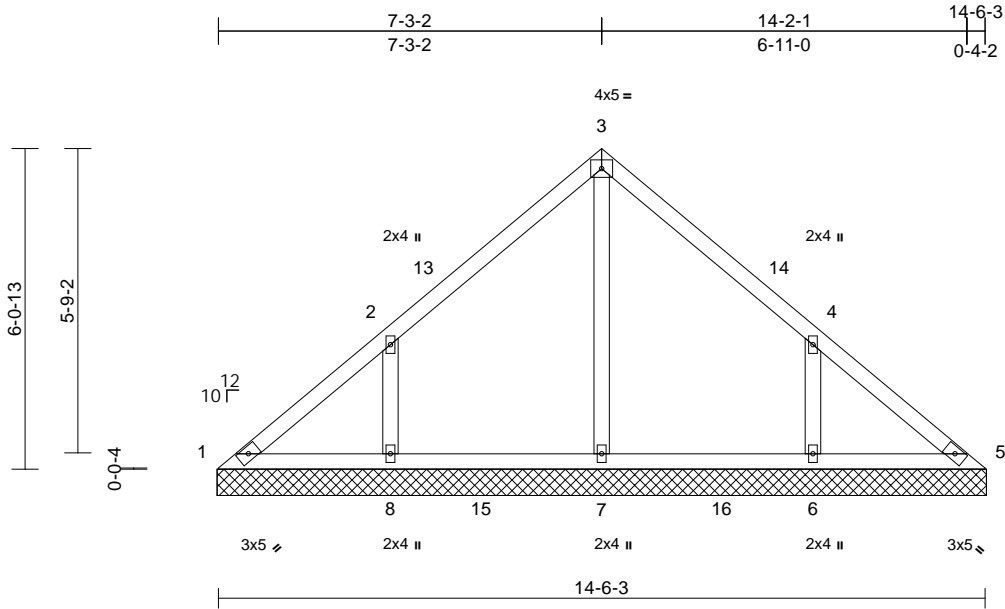

Scale = 1:43.6

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.31	Vert(LL)	n/a	-	n/a	999	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.16	Vert(TL)	n/a	-	n/a	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.15	Horiz(TL)	0.00	5	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-MSH								
BCDL	10.0										Weight: 63 lb	FT = 20%

**LUMBER**

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
OTHERS 2x4 SP No.3

**BRACING**

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

**REACTIONS**

(size) 1=14-6-13, 5=14-6-13, 6=14-6-13,  
7=14-6-13, 8=14-6-13  
Max Horiz 1=138 (LC 13)  
Max Uplift 1=-24 (LC 10), 6=-155 (LC 15),  
8=-158 (LC 14)  
Max Grav 1=123 (LC 24), 5=98 (LC 23),  
6=457 (LC 21), 7=410 (LC 23),  
8=457 (LC 20)

**FORCES**


(lb) - Maximum Compression/Maximum Tension  
TOP CHORD 1-2=-154/148, 2-3=-172/123, 3-4=-172/112,  
4-5=-122/112  
BOT CHORD 1-8=-62/127, 7-8=-62/101, 6-7=-62/101,  
5-6=-62/101  
WEBS 3-7=-230/0, 2-8=-375/197, 4-6=-375/195

**NOTES**

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-0-0 to 3-3-6, Interior (1) 3-3-6 to 4-3-6, Exterior(2R) 4-3-6 to 10-3-6, Interior (1) 10-3-6 to 11-3-6, Exterior(2E) 11-3-6 to 14-6-13 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60

- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 24 lb uplift at joint 1, 158 lb uplift at joint 8 and 155 lb uplift at joint 6.
- Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 1, 5.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard

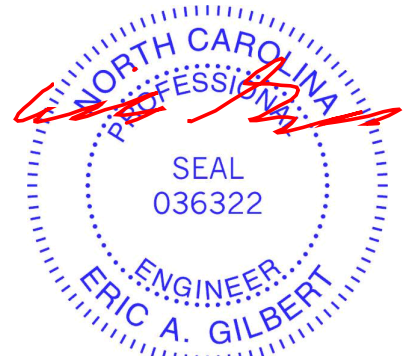

September 8, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road  
Edenton, NC 27932

Job 23070131-01	Truss VLD3	Truss Type Valley	Qty 1	Ply 1	90 Serenity-Roof-B326 A CP Job Reference (optional)	160667336
--------------------	---------------	----------------------	----------	----------	--------------------------------------------------------	-----------

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Fri Sep 08 15:07:47  
ID:kUxM45s?bF21LX?KCRTFVazRQqU-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKwRcDoi7J4zJC?f

Page: 1

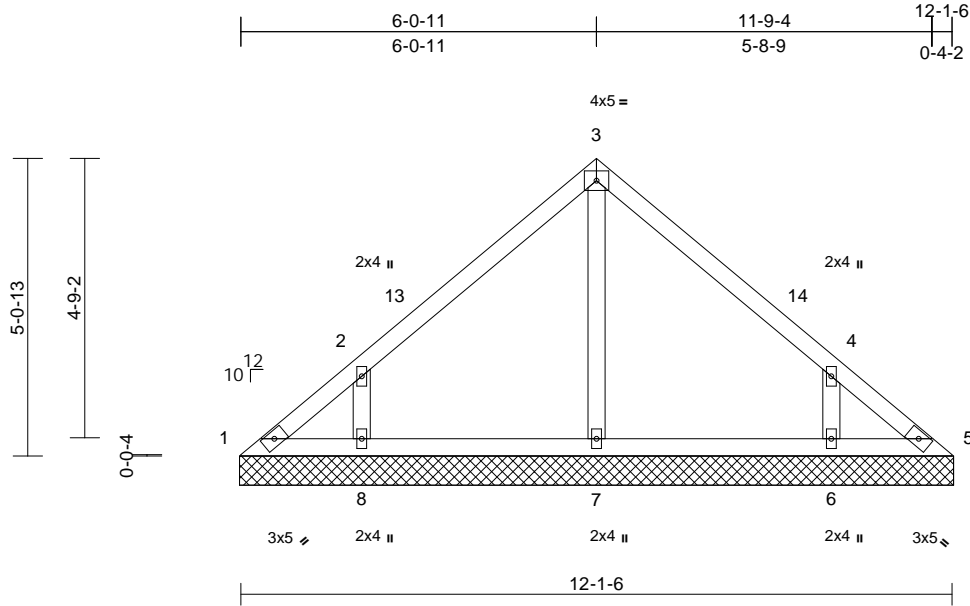

Scale = 1:39.3

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.31	Vert(LL)	n/a	-	n/a	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.12	Vert(TL)	n/a	-	n/a		
TCDL	10.0	Rep Stress Incr	YES	WB	0.08	Horiz(TL)	0.00	5	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-MSH							
BCDL	10.0									Weight: 50 lb	FT = 20%

#### LUMBER

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
OTHERS 2x4 SP No.3

#### BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS

(size) 1=12-2-0, 5=12-2-0, 6=12-2-0,  
7=12-2-0, 8=12-2-0  
Max Horiz 1=-115 (LC 10)  
Max Uplift 1=-32 (LC 10), 5=-4 (LC 11),  
6=-136 (LC 15), 8=-139 (LC 14)  
Max Grav 1=93 (LC 24), 5=72 (LC 23), 6=435  
(LC 21), 7=261 (LC 21), 8=435 (LC 20)

#### FORCES

(lb) - Maximum Compression/Maximum Tension


TOP CHORD 1-2=-118/101, 2-3=-216/117, 3-4=-216/117,  
4-5=-91/63  
BOT CHORD 1-8=-32/78, 7-8=-32/73, 6-7=-32/73,  
5-6=-32/73  
WEBS 3-7=-174/0, 2-8=-398/218, 4-6=-398/218

#### NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust)  
Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft;  
Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Exterior(2R) 3-0-0 to 9-2-0, Exterior(2E) 9-2-0 to 12-2-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60

- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 32 lb uplift at joint 1, 4 lb uplift at joint 5, 139 lb uplift at joint 8 and 136 lb uplift at joint 6.
- Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 1, 5.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

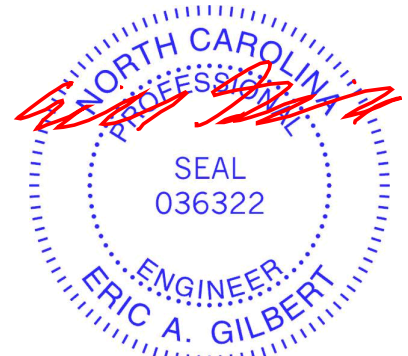

September 8, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY  
**TRENCO**  
A MiTek Affiliate

818 Soundside Road  
Edenton, NC 27932




Job 23070131-01	Truss VLD4	Truss Type Valley	Qty 1	Ply 1	90 Serenity-Roof-B326 A CP Job Reference (optional)	160667337
--------------------	---------------	----------------------	----------	----------	--------------------------------------------------------	-----------

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Fri Sep 08 15:07:48  
ID:kUXM45s?bF21LX?KCRTFVazRQqU-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKwRcDoi7J4zJC?f

Page: 1

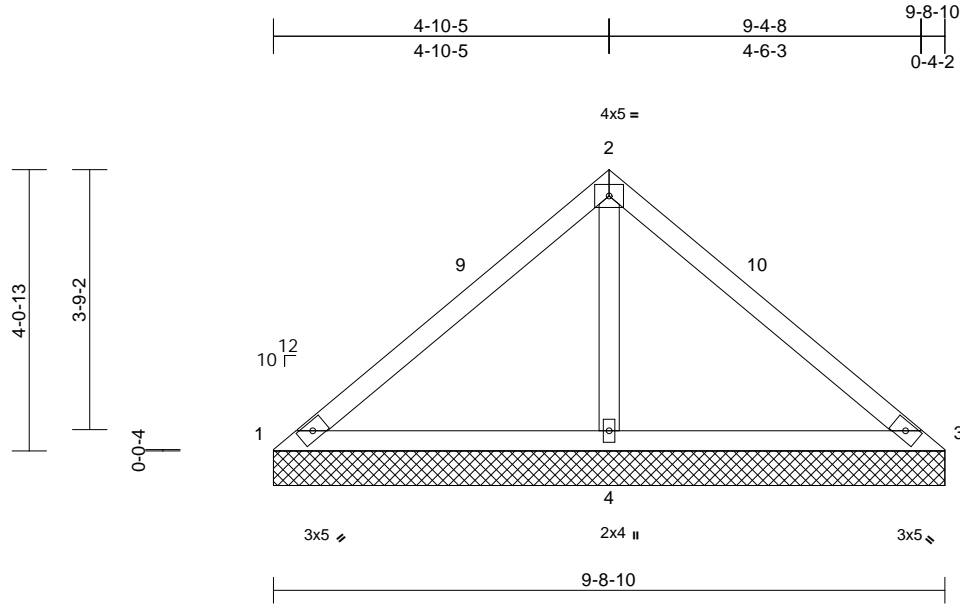

Scale = 1:33.3

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.46	Vert(LL)	n/a	-	n/a	999	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.43	Vert(TL)	n/a	-	n/a	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.19	Horiz(TL)	0.01	4	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-MSH								
BCDL	10.0										Weight: 37 lb	FT = 20%

**LUMBER**

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
OTHERS 2x4 SP No.3

**BRACING**

TOP CHORD Structural wood sheathing directly applied or 9-8-10 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

**REACTIONS**

(size) 1=9-8-10, 3=9-8-10, 4=9-8-10  
Max Horiz 1=-91 (LC 10)  
Max Uplift 1=-51 (LC 21), 3=-51 (LC 20), 4=-110 (LC 14)  
Max Grav 1=95 (LC 20), 3=95 (LC 21), 4=784 (LC 21)

**FORCES**

(lb) - Maximum Compression/Maximum Tension  
TOP CHORD 1-2=-117/380, 2-3=-117/380  
BOT CHORD 1-4=-217/174, 3-4=-217/174  
WEBS 2-4=-605/274

**NOTES**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-0-5 to 3-0-5, Exterior(2R) 3-0-5 to 6-8-14, Exterior(2E) 6-8-14 to 9-8-14 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.

- 4) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- 5) Unbalanced snow loads have been considered for this design.
- 6) Gable requires continuous bottom chord bearing.
- 7) Gable studs spaced at 4-0-0 oc.
- 8) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 9) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 10) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 51 lb uplift at joint 1, 51 lb uplift at joint 3 and 110 lb uplift at joint 4.
- 11) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard



September 8, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road  
Edenton, NC 27932

Job 23070131-01	Truss VLD5	Truss Type Valley	Qty 1	Ply 1	90 Serenity-Roof-B326 A CP Job Reference (optional)	160667338
--------------------	---------------	----------------------	----------	----------	--------------------------------------------------------	-----------

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Fri Sep 08 15:07:48  
ID:CgVkhRtdMZAuzhaXm9\_U1OzRQqT-RFC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

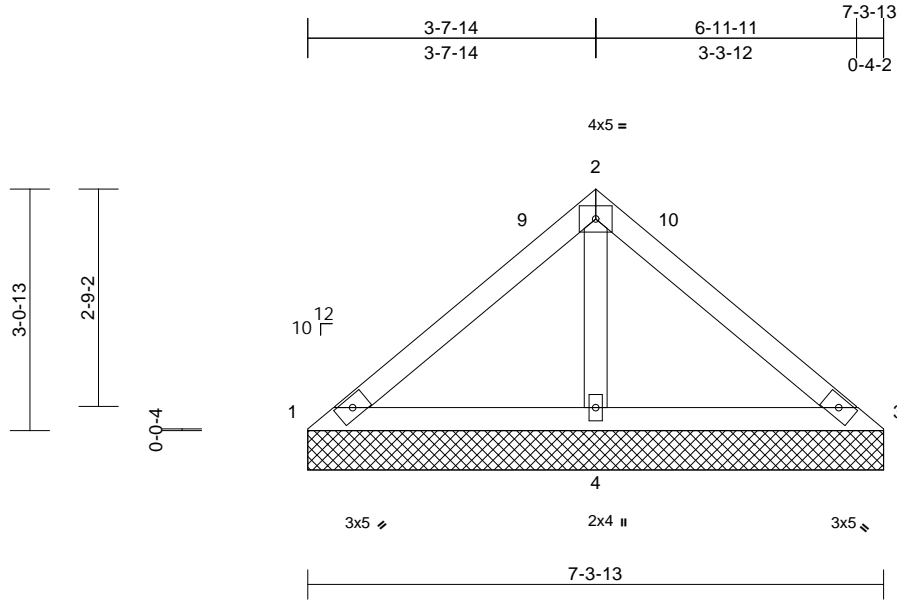

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.26	Vert(LL)	n/a	-	n/a	999	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.27	Vert(TL)	n/a	-	n/a	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.09	Horiz(TL)	0.00	4	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-MP								
BCDL	10.0											
											Weight: 27 lb	FT = 20%

**LUMBER**  
TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
OTHERS 2x4 SP No.3

**BRACING**  
TOP CHORD Structural wood sheathing directly applied or 7-3-13 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

**REACTIONS** (size) 1=7-3-13, 3=7-3-13, 4=7-3-13  
Max Horiz 1=-68 (LC 12)  
Max Uplift 1=-19 (LC 21), 3=-19 (LC 20), 4=-75 (LC 14)  
Max Grav 1=105 (LC 20), 3=105 (LC 21), 4=541 (LC 21)


**FORCES** (lb) - Maximum Compression/Maximum Tension  
TOP CHORD 1-2=-91/234, 2-3=-91/234  
BOT CHORD 1-4=-164/154, 3-4=-164/154  
WEBS 2-4=-387/203

- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 19 lb uplift at joint 1, 19 lb uplift at joint 3 and 75 lb uplift at joint 4.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard

**NOTES**

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-0-5 to 3-0-5, Exterior(2R) 3-0-5 to 4-4-2, Exterior(2E) 4-4-2 to 7-4-2 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.

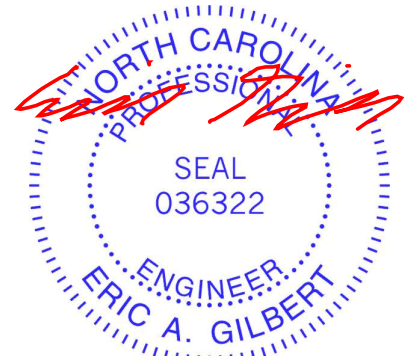

September 8, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road  
Edenton, NC 27932

Job 23070131-01	Truss VLD6	Truss Type Valley	Qty 1	Ply 1	90 Serenity-Roof-B326 A CP Job Reference (optional)	160667339
--------------------	---------------	----------------------	----------	----------	--------------------------------------------------------	-----------

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Fri Sep 08 15:07:48  
ID:CgVkhRtdMZAuzhaXm9\_U1OzRQqT-RFC?PsB70Hq3NSgPqnL8w3uITXbGKwRCDoi7J4zJC?f

Page: 1

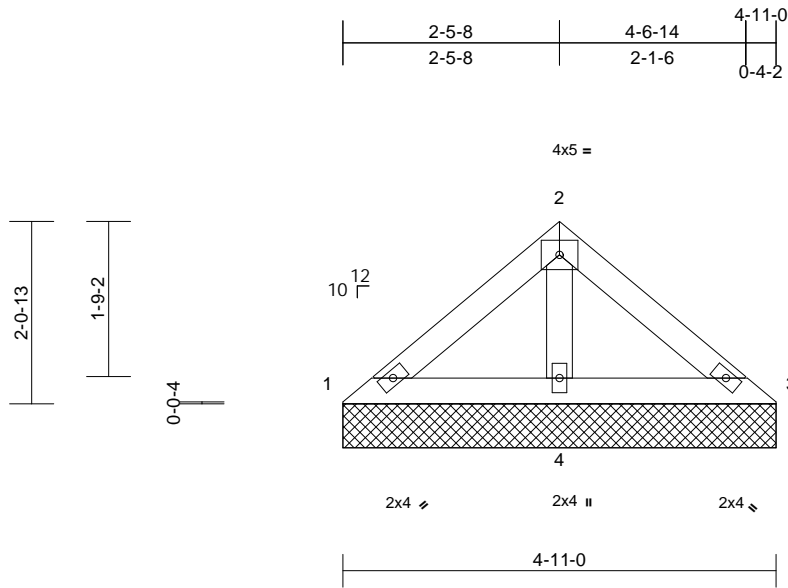

Scale = 1:26.2					
<b>Loading</b> (psf)	<b>Spacing</b> 2-0-0	<b>CSI</b>	<b>DEFL</b> in (loc) l/defl L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL (roof) 20.0	Plate Grip DOL 1.15	TC 0.09	Vert(LL) n/a - n/a 999	MT20	244/190
Snow (Pf) 20.0	Lumber DOL 1.15	BC 0.11	Vert(TL) n/a - n/a 999		
TCDL 10.0	Rep Stress Incr YES	WB 0.04	Horiz(TL) 0.00 4 n/a n/a		
BCLL 0.0*	Code IRC2018/TPI2014	Matrix-MP			
BCDL 10.0				Weight: 18 lb	FT = 20%

**LUMBER**  
TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
OTHERS 2x4 SP No.3

**BRACING**  
TOP CHORD Structural wood sheathing directly applied or 4-11-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

**REACTIONS** (size) 1=4-11-0, 3=4-11-0, 4=4-11-0  
Max Horiz 1=-44 (LC 10)  
Max Uplift 3=-7 (LC 15), 4=-34 (LC 14)  
Max Grav 1=89 (LC 20), 3=89 (LC 21), 4=301 (LC 20)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
TOP CHORD 1-2=-81/106, 2-3=-81/106  
BOT CHORD 1-4=-82/90, 3-4=-82/90  
WEBS 2-4=-187/100

- Unbalanced snow loads have been considered for this design.
  - Gable requires continuous bottom chord bearing.
  - Gable studs spaced at 4-0-0 oc.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 7 lb uplift at joint 3 and 34 lb uplift at joint 4.
  - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- LOAD CASE(S)** Standard

- NOTES**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
  - TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10




September 8, 2023

Job 23070131-01	Truss VLD7	Truss Type Valley	Qty 1	Ply 1	90 Serenity-Roof-B326 A CP Job Reference (optional)	160667340
--------------------	---------------	----------------------	----------	----------	--------------------------------------------------------	-----------

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.63 S Aug 30 2023 Print: 8.630 S Aug 30 2023 MiTek Industries, Inc. Fri Sep 08 15:07:48  
ID:CgVkhRtdMZAuzhaXm9\_U1OzRQqT-RFC?PsB70Hq3NSgPqnL8w3UtXbGKwRCDoi7J4zJC?f

Page: 1

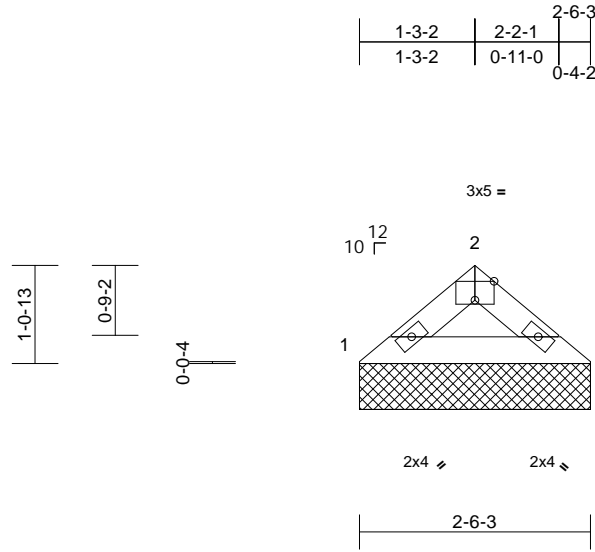

Scale = 1:25.1

Plate Offsets (X, Y): [2:0-2-8,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.05	Vert(LL)	n/a	-	n/a	999	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.05	Vert(TL)	n/a	-	n/a	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.00	Horiz(TL)	0.00	3	n/a	n/a		
BCLL	0.0*	Code	IRC2018/TPI2014	Matrix-MP								
BCDL	10.0										Weight: 7 lb	FT = 20%

**LUMBER**

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2

**BRACING**

TOP CHORD Structural wood sheathing directly applied or 2-6-3 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS**

(size) 1=2-6-3, 3=2-6-3  
Max Horiz 1=21 (LC 11)  
Max Uplift 1=9 (LC 14), 3=9 (LC 15)  
Max Grav 1=114 (LC 20), 3=114 (LC 21)

**FORCES**

(lb) - Maximum Compression/Maximum Tension  
TOP CHORD 1-2=-137/62, 2-3=-137/62  
BOT CHORD 1-3=-33/99

**NOTES**

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- Gable requires continuous bottom chord bearing.

- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 9 lb uplift at joint 1 and 9 lb uplift at joint 3.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

**LOAD CASE(S)** Standard



September 8, 2023

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)




818 Soundside Road  
Edenton, NC 27932

# Symbols

## PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.

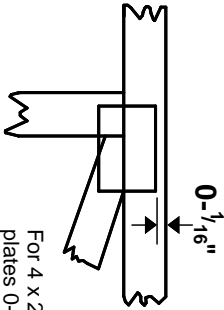

For 4 x 2 orientation, locate plates 0- 1/16\"/>



This symbol indicates the required direction of slots in connector plates.

\* Plate location details available in MITek software or upon request.

## PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

## LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

## BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number/letter where bearings occur. Min size shown is for crushing only.

## Industry Standards:

ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.  
DSB-22: Design Standard for Bracing.  
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses.

# Numbering System

6-4-8 dimensions shown in ft-in-sixteenths (Drawings not to scale)

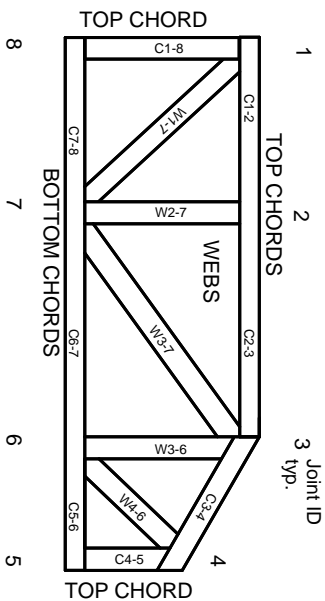

**JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.**

**CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.**

# Product Code Approvals

ICC-ES Reports:

ESR-1988, ESR-2362, ESR-2685, ESR-3282  
ESR-4722, ESL-1388

# Design General Notes

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 section 6.3. These truss designs rely on Lumber values established by others.

© 2023 MITek® All Rights Reserved

**MITek**

ENGINEERING BY  
**TRENGO**  
A MITek Affiliate

MITek Engineering Reference Sheet: MIL-7473 rev. 1/2/2023

# General Safety Notes

## Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability/bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.