

Joe E Godwin Sr. , P.E., P.L.S.

Jason E Godwin , P.L.S.



1403 NC Highway 50 South
Benson, North Carolina 27504
919.894.7765

Email: general@enochengineers.com

www.enochengineers.com

MATERIALS & TEST DIVISION

FIELD REPORT

PROJECT

CLIENT: CARROLL CONST

DATE: 2.13.24

PROJECT: SHILOH S/D

CONTRACTOR: D. PEEBLES

ADDRESS: 59 HOLLY GROVE LN

TECHNICIAN: BH

LOT #: 5

TEST SUMMARY

PERFORMED NDT ON STEM WALL SOIL FILL MATERIAL AT SITE NOTED ABOVE
USING A TARGET DENSITY OF 110 PCF.
SOILS CONFIRMED A COMPACTION GREATER THAN OR EQUAL TO 95%.


TESTING RESULTS

SERVICE PERFORMED	TEST NO.	COMP %	WD PCF	DD PCF	MOISTURE %
NDT	1	95.81	105.4	110.7	4.9

RETURN VISIT REQUIRED

YES
NO

TECHNICIAN:

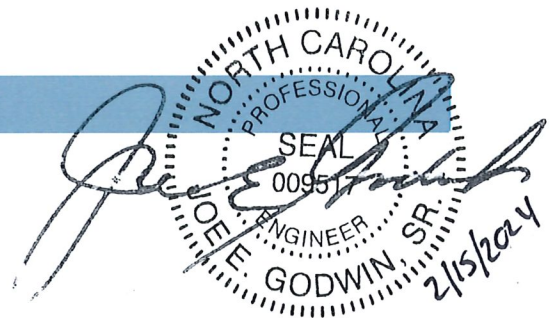

Disclaimer:

Soils & Material inspections, testing results and on-site determinations contained in this report become void after 30 days of non-use of this report and/or following any inclement weather which causes structural soil or material deterioration. Additional testing will be required following a voided report determined by a North Carolina Building Code enforcement official or Enoch Engineers P.A. The client/contractor is responsible for notifying Enoch Engineers P.A. of any soil & material condition changes which could void this report.