

Truss Placement Plan
SCALE: 1/4" = 1'-0"

● = Hanger / HUS 26

All Truss Reactions are Less than 3,000 lbs. Unless Noted Otherwise.

○ -- Denotes Reaction Greater than 3,000 lbs. Reaction / # of Studs

Products					
PlotID	Length	Product	Plies	Net Qty	F
GDH (Dropped)	22-00-00	1-3/4"x 14" LVL Kerto-S	2	2	F

LOAD CHART FOR JACK STUDS			
(BASED ON TABLES B502.5(1) & (2))			
NUMBER OF JACK STUDS REQUIRED @ EA END OF HEADERS			
END REACTION (UP TO) 1700	2550	3400	
END REACTION (UP TO) 3400	5100	6800	
END REACTION (UP TO) 5100	7650	10200	
END REACTION (UP TO) 6800	10200	13600	
END REACTION (UP TO) 8500	12750	17000	
END REACTION (UP TO) 10200	15300		
END REACTION (UP TO) 11900			
END REACTION (UP TO) 13600			
END REACTION (UP TO) 15300			

BUILDER	Weaver Development Co. Inc.	CITY / CO.	Sanford / Harnett
JOB NAME	Lot 1 West Pointe III	ADDRESS	25 Hillwood Dr.
PLAN	Lindsay 1553 A (200505B)	MODEL	Roof
SEAL DATE	Seal Date	DATE REV.	5/27/2020
QUOTE #		DRAWN BY	Lenny Norris
JOB #	J0923-5060	SALES REP.	Lenny Norris

THIS IS A TRUSS PLACEMENT DIAGRAM ONLY.
 These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult BCSH-B1 and BCSH-B3 provided with the truss delivery package or online @ sbcindustry.com


Bearing reactions less than or equal to 3000# are deemed to comply with the prescriptive Code requirements. The contractor shall refer to the attached Tables (derived from the prescriptive Code requirements) to determine the minimum foundation size and number of wood studs required to support reactions greater than 3000# but not greater than 15000#. A registered design professional shall be retained to design the support system for any reaction that exceeds those specified in the attached Tables. A registered design professional shall be retained to design the support system for all reactions that exceed 15000#.

Signature: Lenny Norris
Lenny Norris

comTECH

ROOF & FLOOR TRUSSES & BEAMS

Reilly Road Industrial Park
 Fayetteville, N.C. 28309
 Phone: (910) 864-8787
 Fax: (910) 864-4444

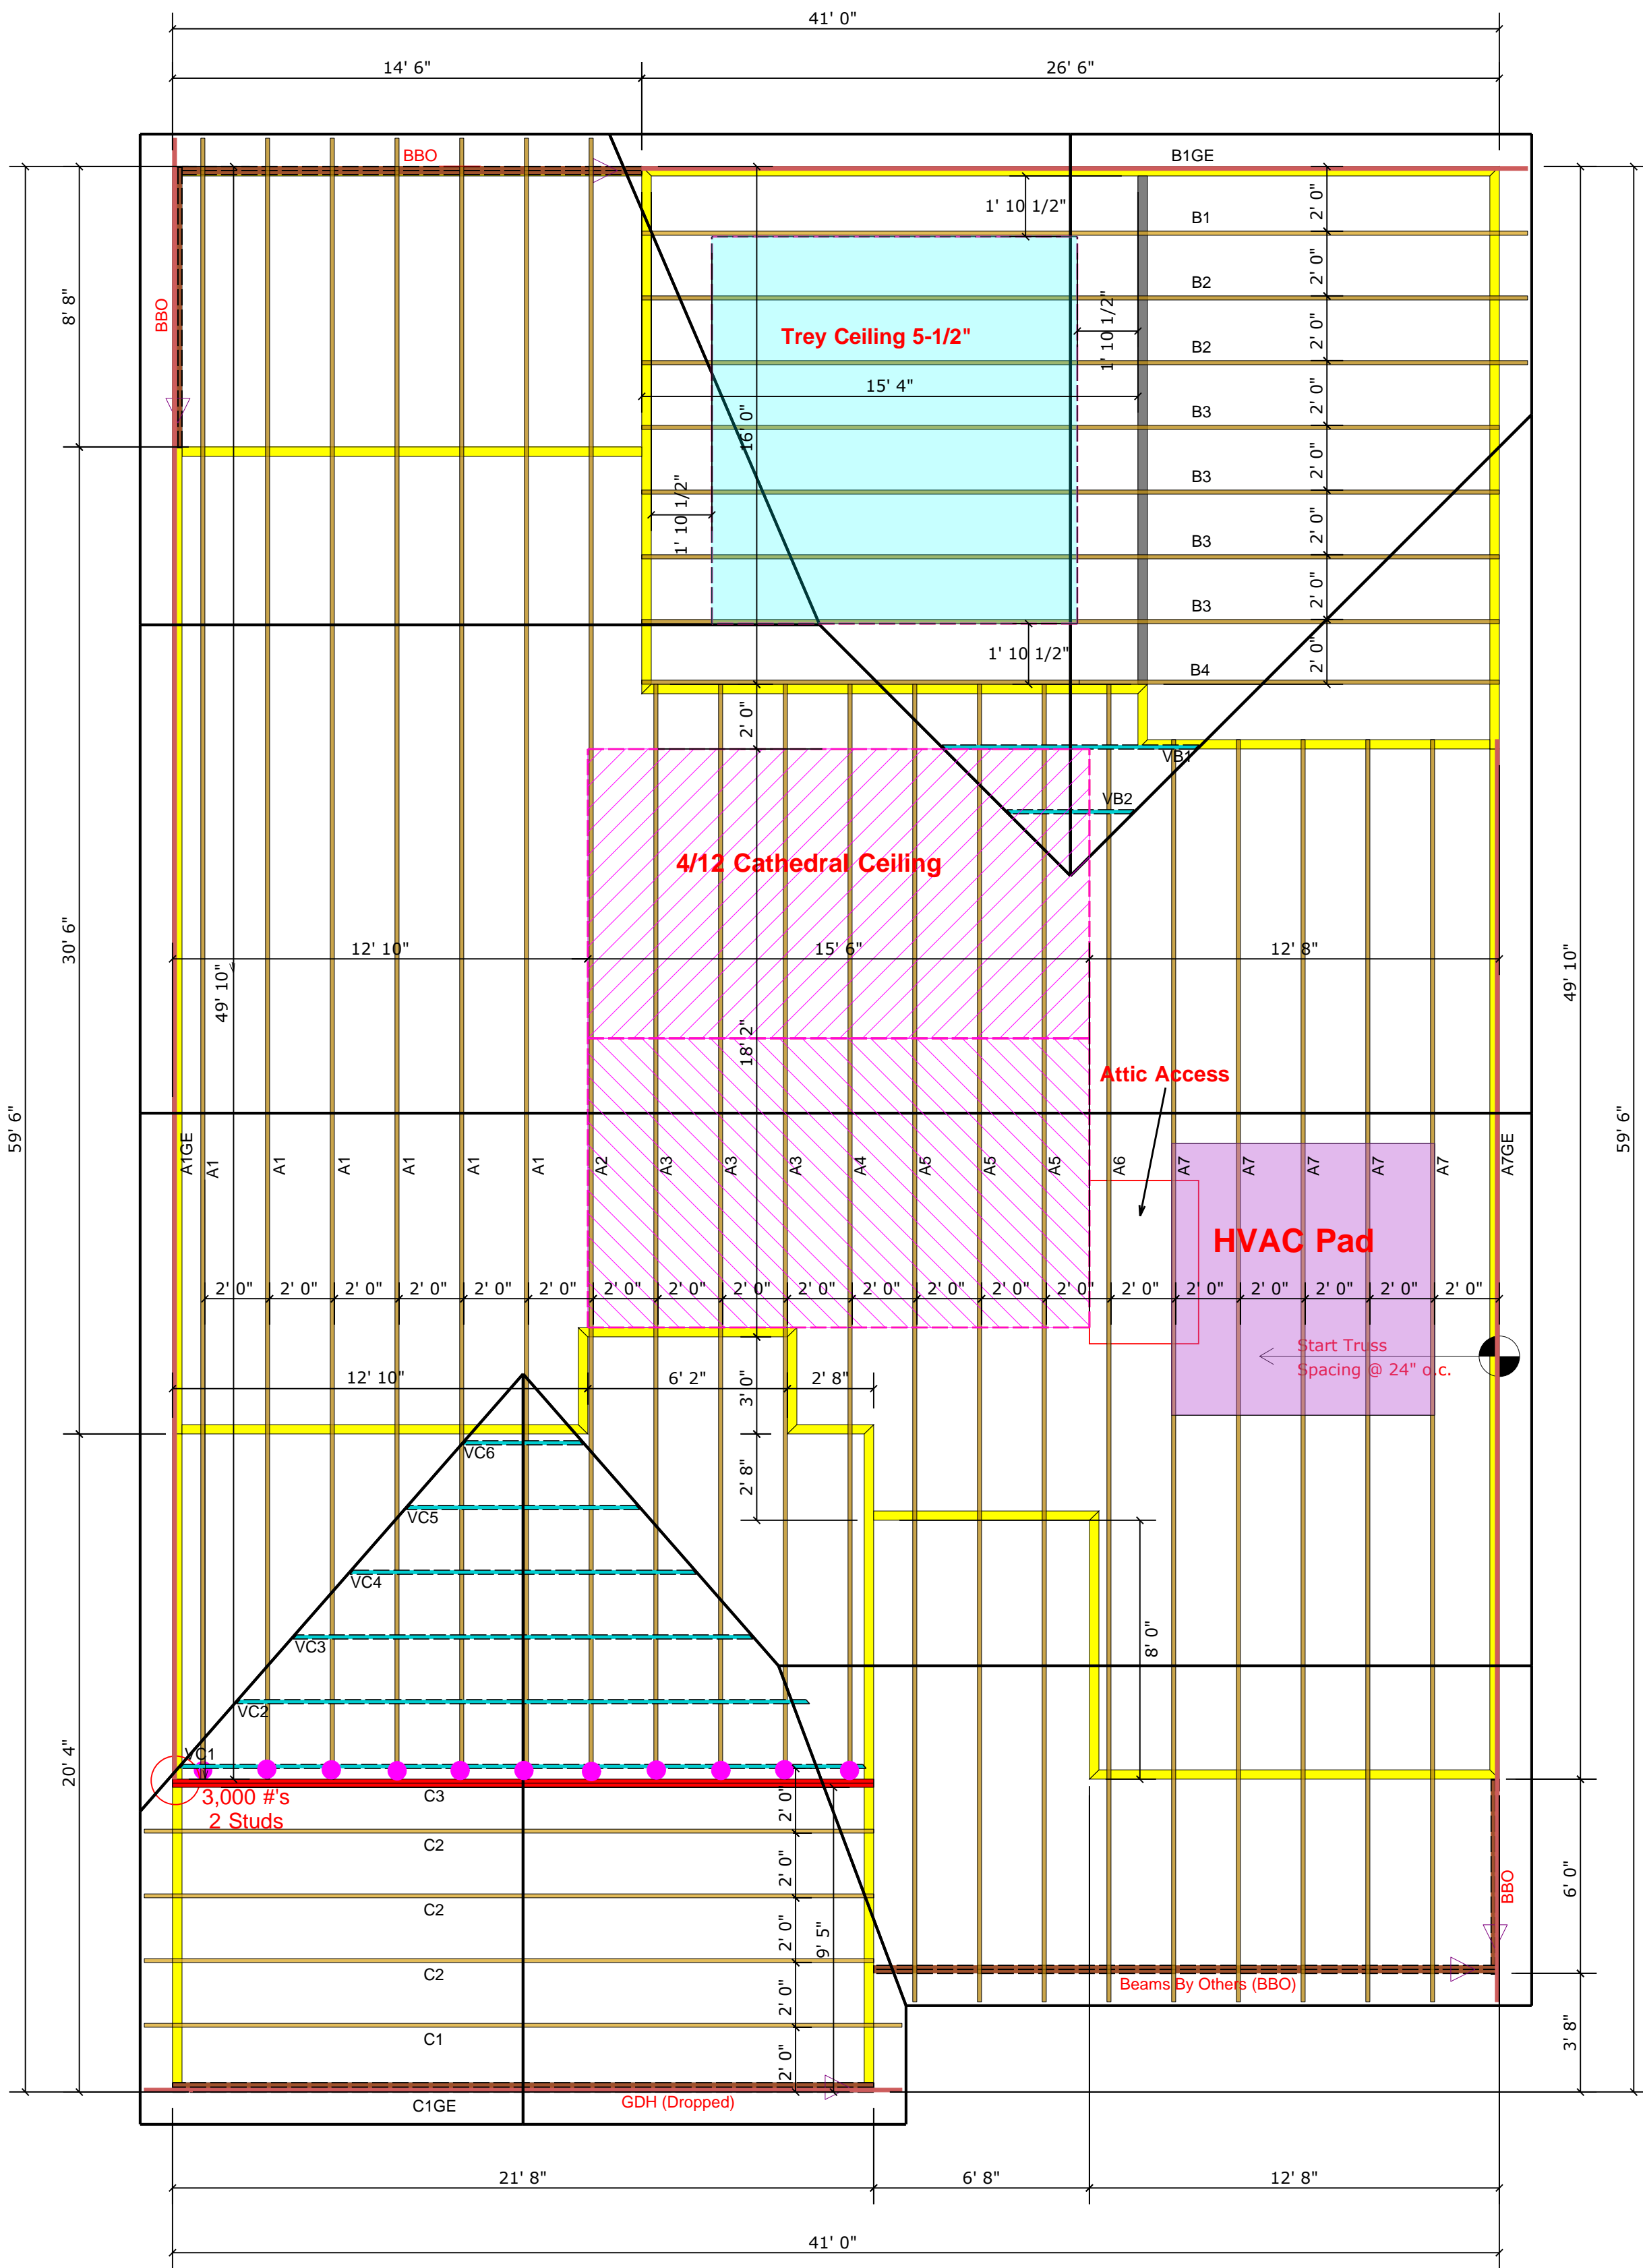

Truss Placement Plan
SCALE: 1/4" = 1'-0"

● = Hanger / HUS 26

All Truss Reactions are Less than 3,000 lbs. Unless Noted Otherwise.

○ -- Denotes Reaction Greater than 3,000 lbs. Reaction / # of Studs

PlotID	Length	Product	Plies	Net Qty	Fat
GDH (Dropped)	22' 0"	1-3/4"x 14" LVL Kerto-S	2	2	FF

END REACTION (UP TO) (DOWN TO)	NUMBER OF JACK STUDS REQUIRED @ EA END OF HEADQUARTER	END REACTION (UP TO) (DOWN TO)	NUMBER OF JACK STUDS REQUIRED @ EA END OF HEADQUARTER
1700	2	2550	2
3400	2	5100	2
5100	3	7650	3
6800	4	10200	4
8500	5	12750	5
10200	6	15300	6
11900	7		
13600	8		
15300	9		

BUILDER	Weaver Development Co. Inc.	CITY / CO.	Sanford / Harnett
JOB NAME	Lot 1 West Pointe III	ADDRESS	25 Hillwood Dr.
PLAN	Lindsay 1553 A (200505B)	MODEL	Roof
SEAL DATE	Seal Date	DATE REV.	5/27/2020
QUOTE #		DRAWN BY	Lenny Norris
JOB #	J0923-5060	SALES REP.	Lenny Norris

THIS IS A TRUSS PLACEMENT DIAGRAM ONLY.
 These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult BCSH-B1 and BCSH-B3 provided with the truss delivery package or online @ sbcindustry.com

Bearing reactions less than or equal to 3000# are deemed to comply with the prescriptive Code requirements. The contractor shall refer to the attached Tables (derived from the prescriptive Code requirements) to determine the minimum foundation size and number of wood studs required to support reactions greater than 3000# but not greater than 15000#. A registered design professional shall be retained to design the support system for any reaction that exceeds those specified in the attached Tables. A registered design professional shall be retained to design the support system for all reactions that exceed 15000#.

Signature: Lenny Norris
Lenny Norris

comTECH

ROOF & FLOOR TRUSSES & BEAMS

Reilly Road Industrial Park
 Fayetteville, N.C. 28309
 Phone: (910) 864-8787
 Fax: (910) 864-4444